


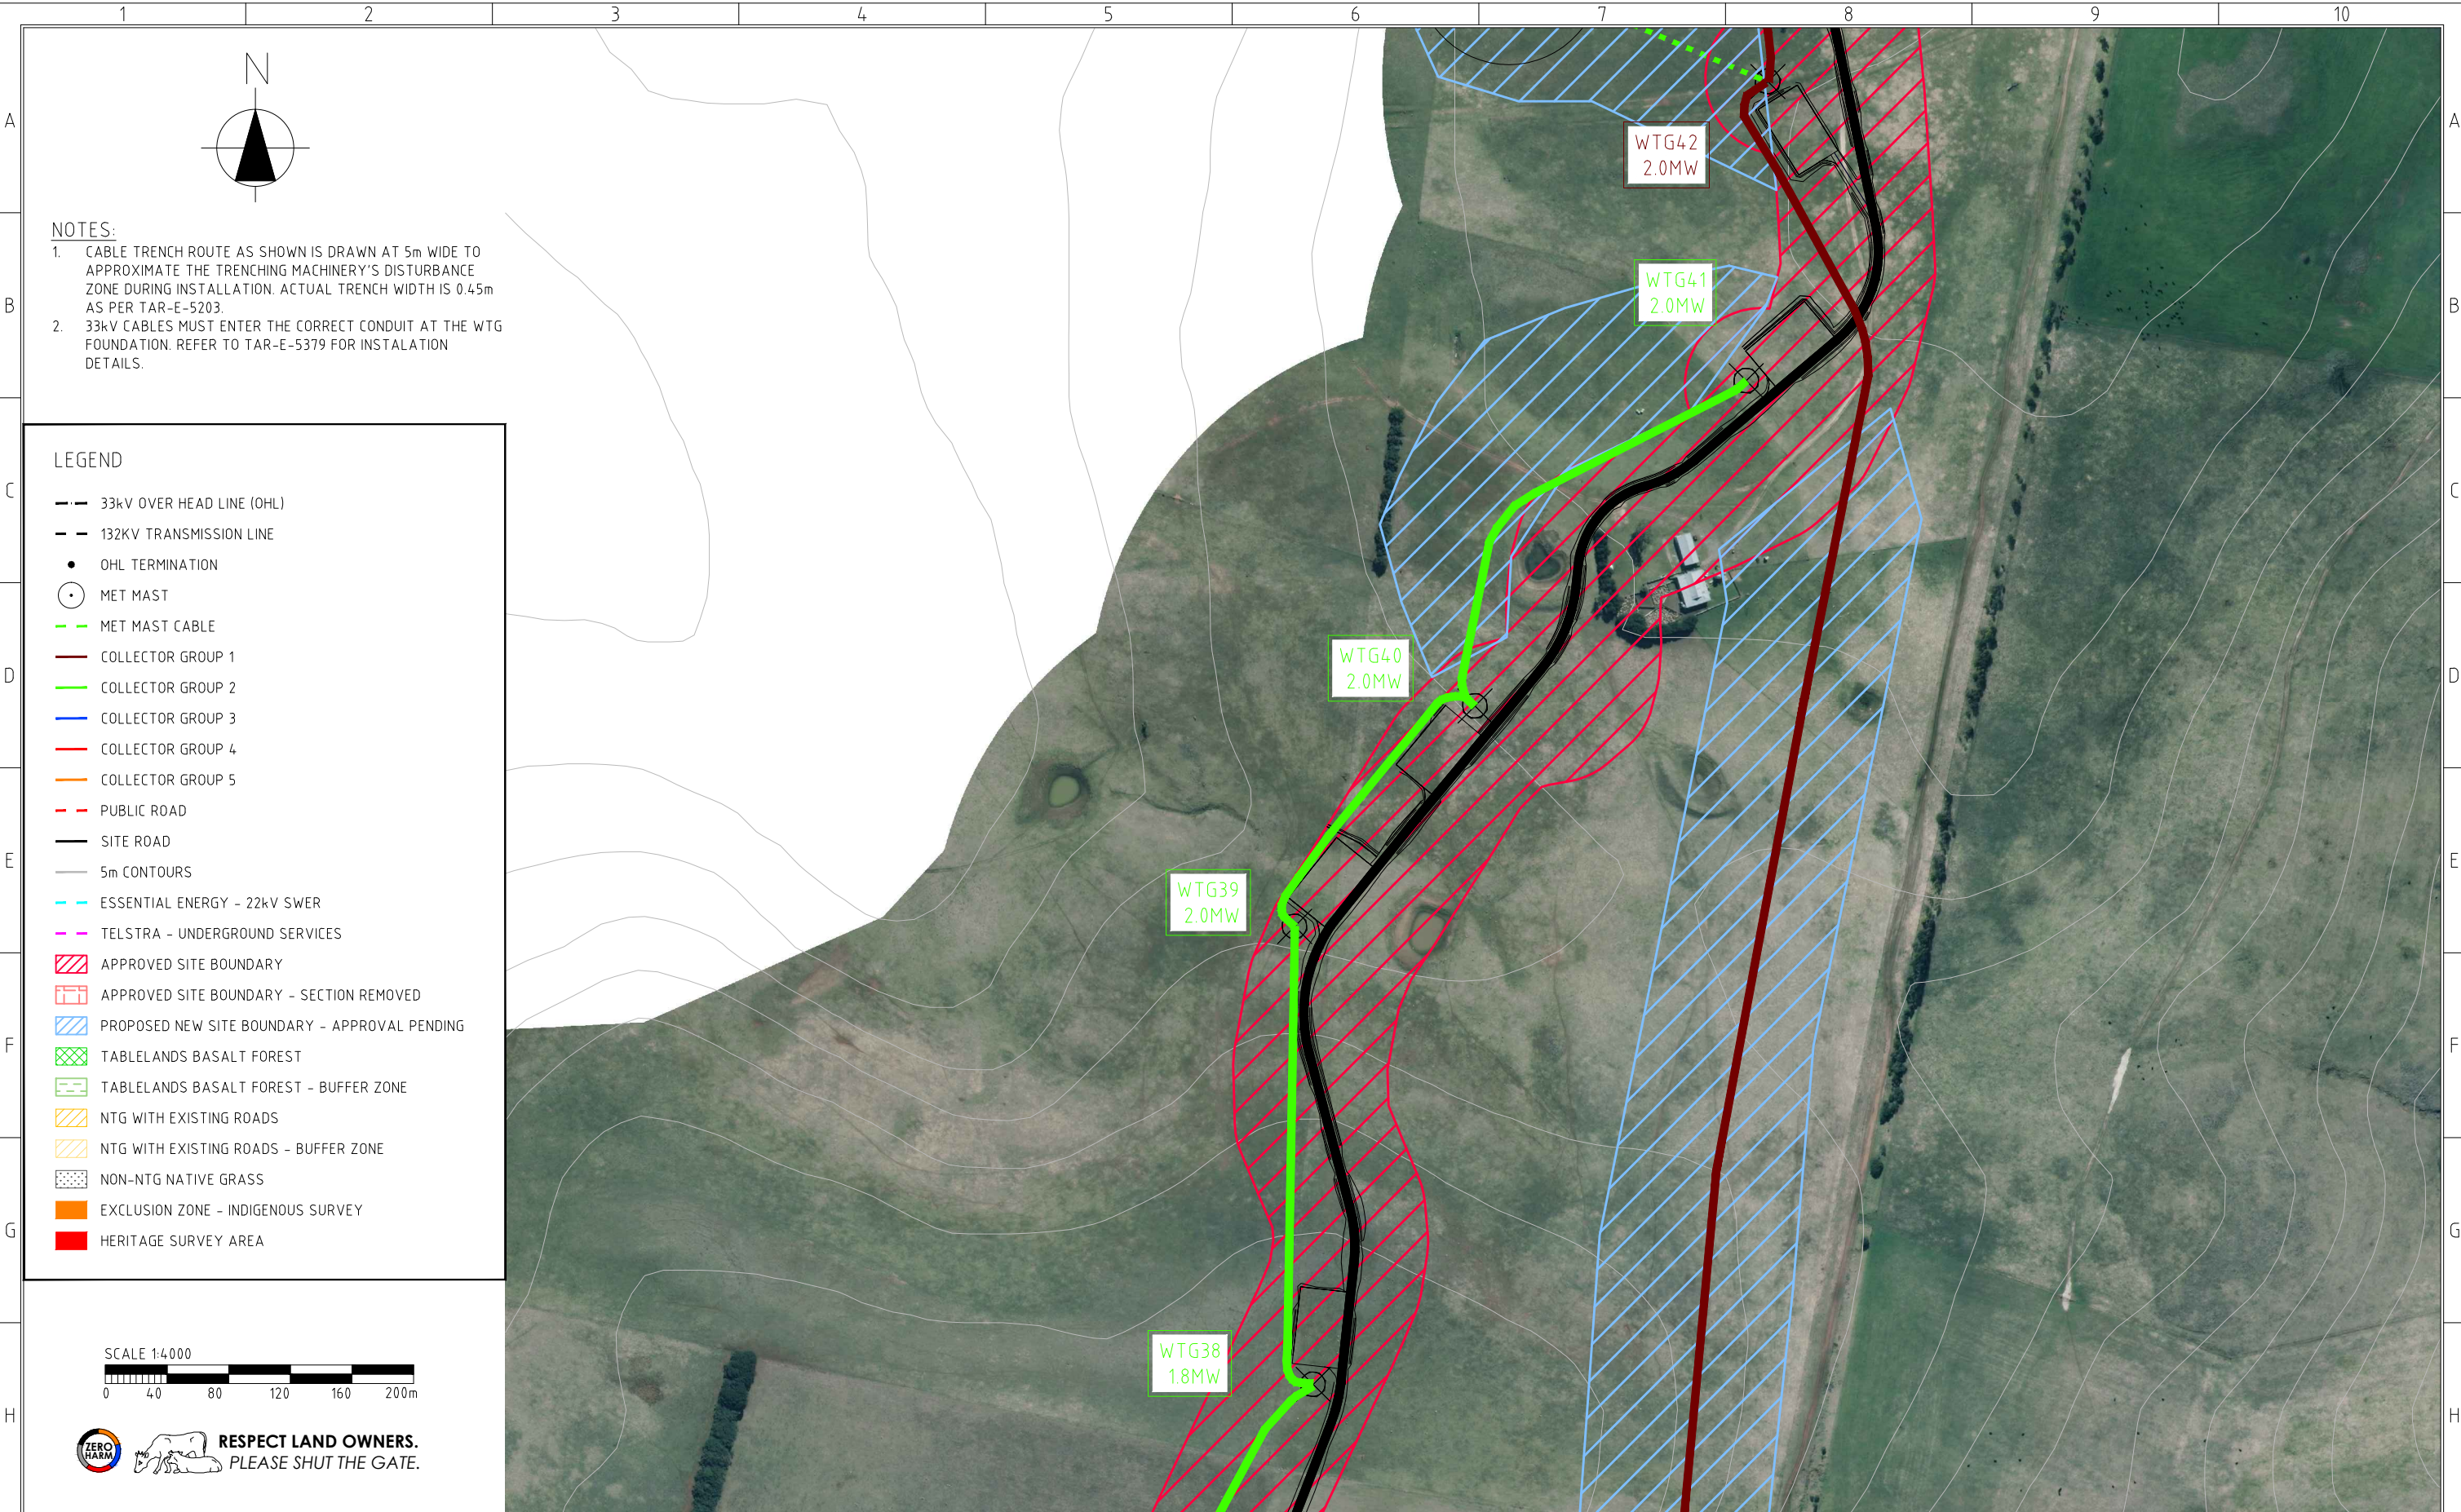

THIS DRAWING REMAINS THE PROPERTY OF
DOWNER EDI ENGINEERING PTY LTD

IT IS SUBJECT TO RETURN UPON DEMAND AND
MAY NOT BE PASSED ON TO ANY THIRD
PARTY, OR USED DIRECTLY OR INDIRECTLY FOR
ANY OTHER PURPOSE THAN THE MANUFACTURE
OR CONSTRUCTION OF EQUIPMENT, OR IN THE
DESIGN AND INSTALLATION OF PLANT TO THE
ORDER OF DOWNER EDI ENGINEERING Pty. Ltd.

1	26.02.14	MINOR AMENDMENTS FOR EIS SUBMISSION	BW	ZB	ABC
0	14.02.14	FOR CONSTRUCTION	BW	BH	ABC
REV	DATE	DESCRIPTION	DRN	CHK'D	C.E.

REVISIONS AND APPROVALS

No.1 in Modern Energy

6-16 GALLEGHAN RD
HEXHAM, NSW, 2322

TEL. +61 2 4918 7400
FAX. +61 2 4918 7401

www.downergroup.com

FOR CONSTRUCTION

DRAWN	BW	11.02.14
CHECKED	ABC	12.02.14
DESIGNED	BW	11.02.14
APPROVED	ABC	12.02.14

DO NOT AMEND
MANUALLY

SCALE
1:4000

APPROVED
APPROVALS

VESTAS


TARALGA WIND FARM
WTG COLLECTOR SYSTEM
RETICULATION NETWORK
GENERAL ARRANGEMENT - 1:4000 SCALE

PROJECT No.
14032

DRAWING No.
TAR-E-5200-11

REV.
1

SIZE
A3

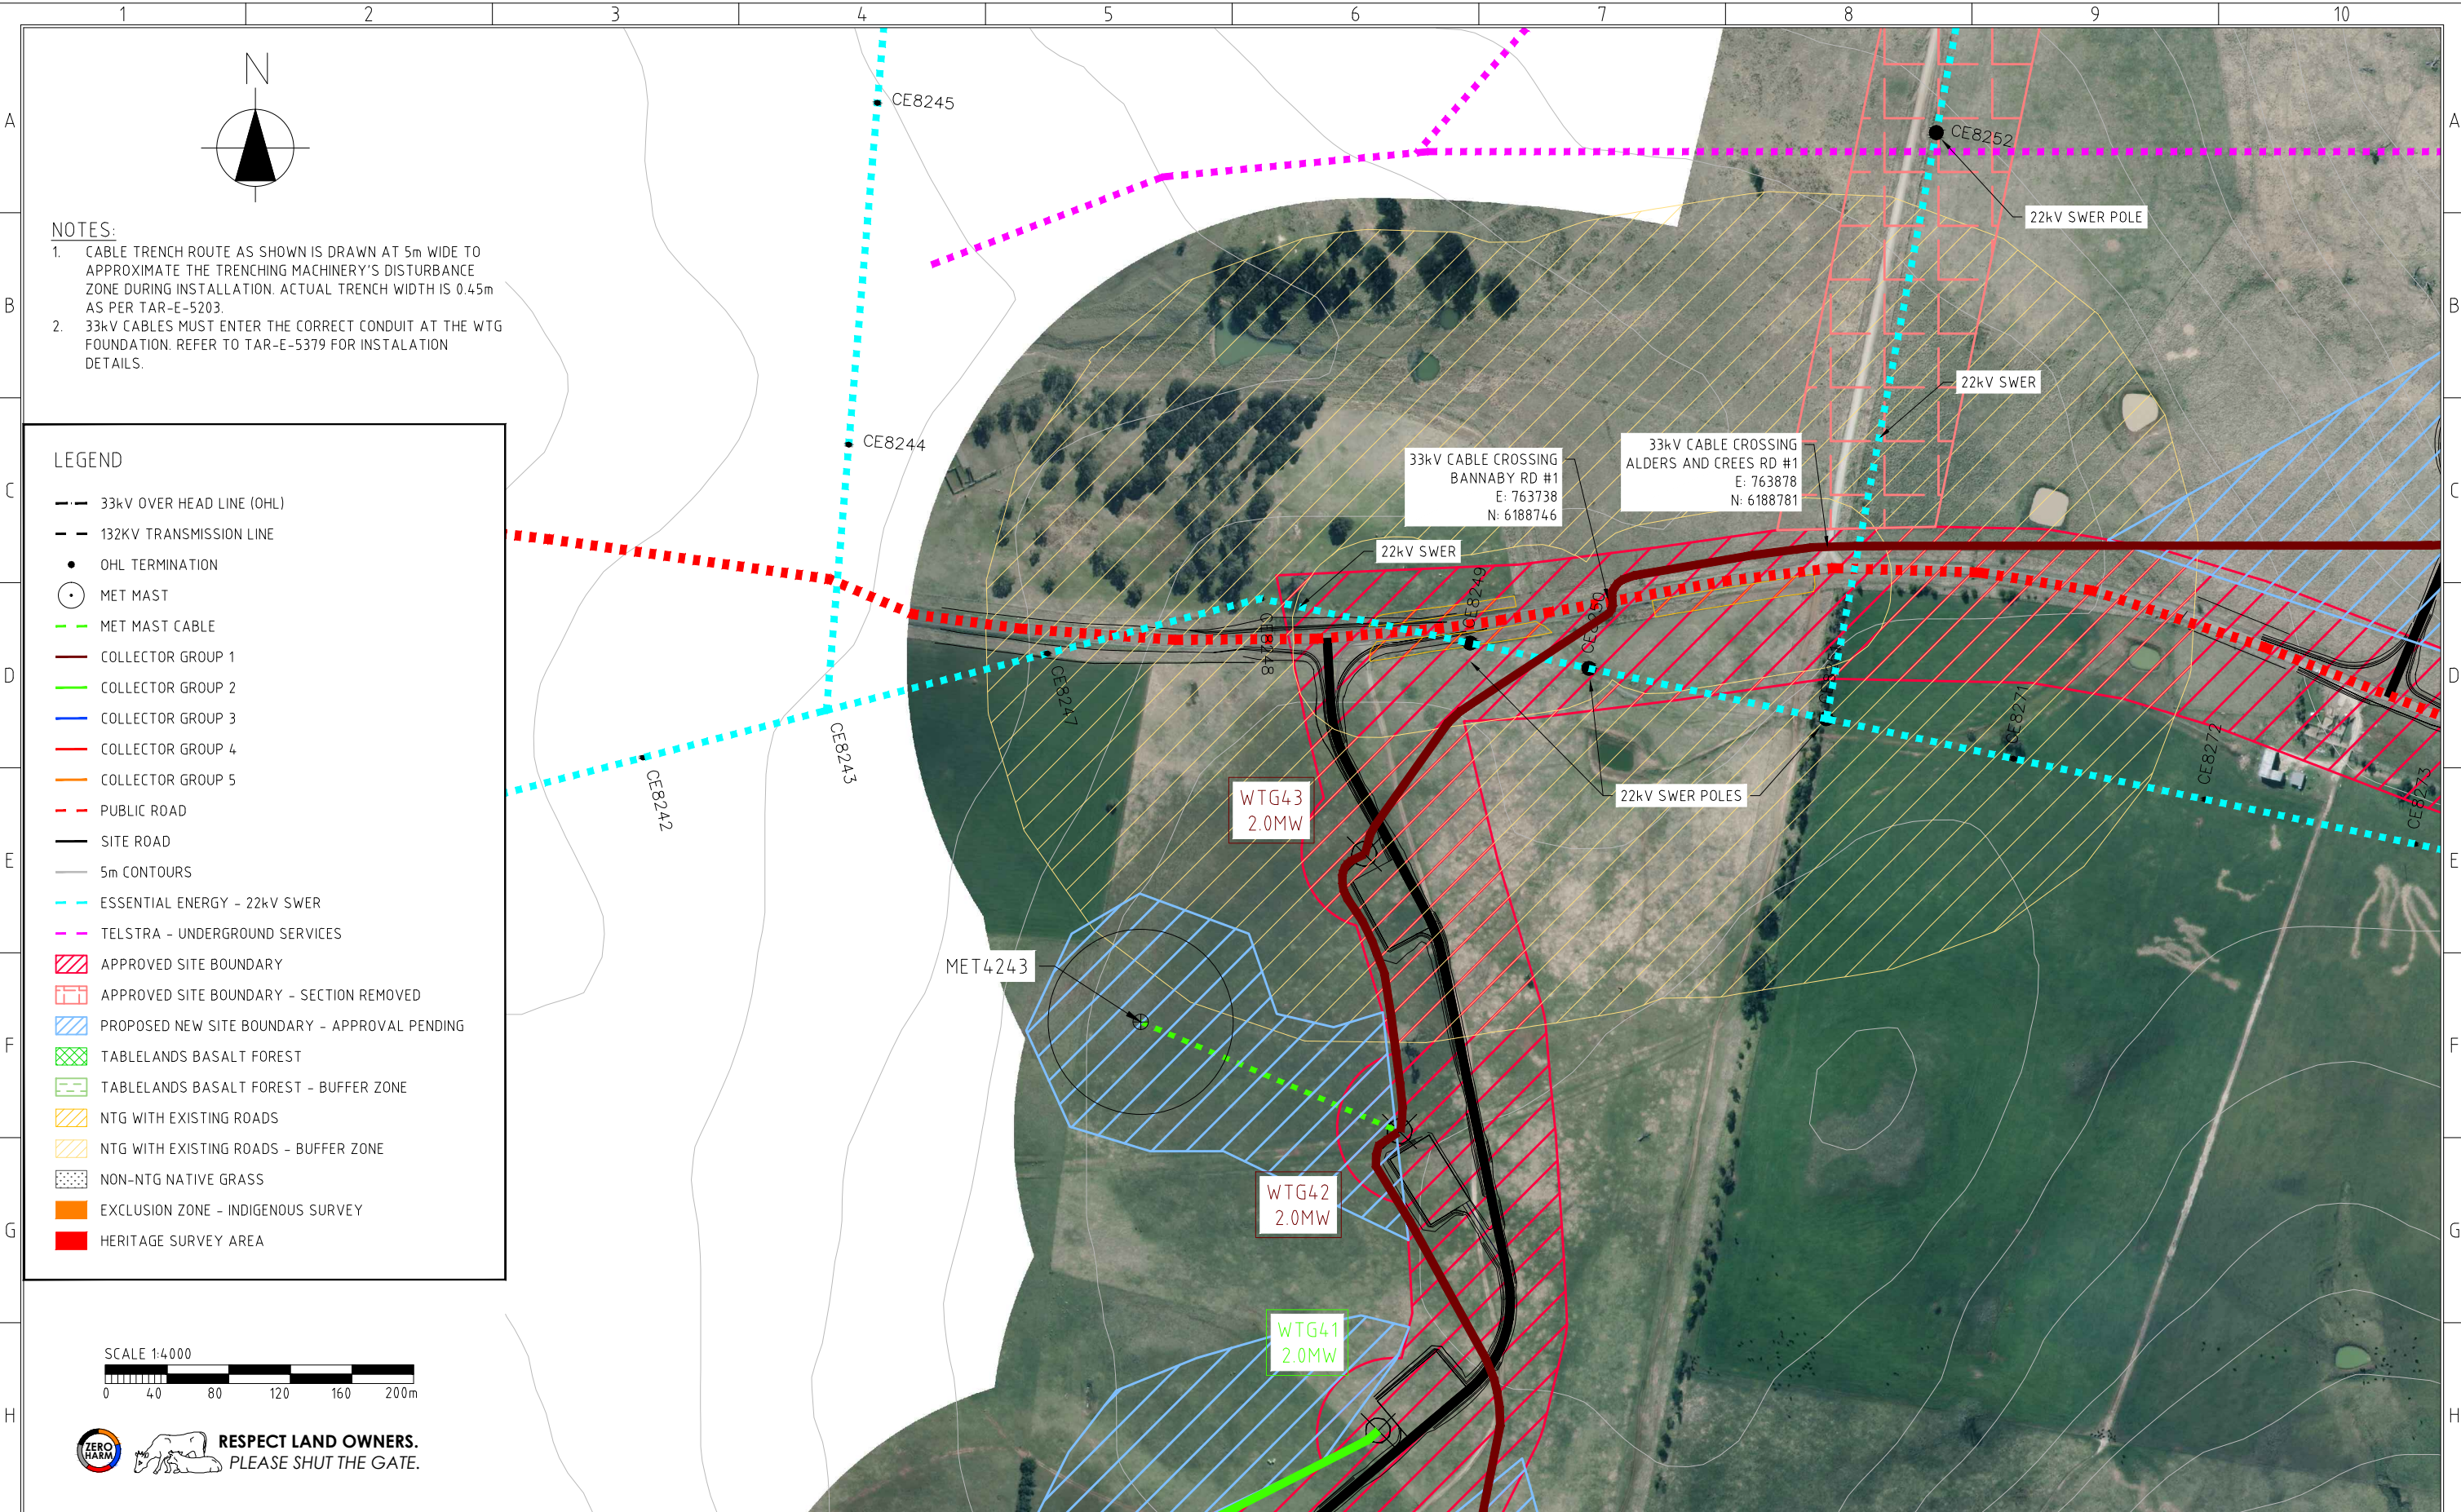

THIS DRAWING REMAINS THE PROPERTY OF
DOWNER EDI ENGINEERING PTY LTD
IT IS SUBJECT TO RETURN UPON DEMAND AND
MAY NOT BE PASSED ON TO ANY THIRD
PARTY, OR USED DIRECTLY OR INDIRECTLY FOR
ANY OTHER PURPOSE THAN THE MANUFACTURE
OR CONSTRUCTION OF EQUIPMENT, OR IN THE
DESIGN AND INSTALLATION OF PLANT TO THE
ORDER OF DOWNER EDI ENGINEERING Pty. Ltd.

1	26.02.14	MINOR AMENDMENTS FOR EIS SUBMISSION	BW	ZB	ABC
0	14.02.14	FOR CONSTRUCTION	BW	BH	ABC
REV	DATE	DESCRIPTION	DRN	CHK'D	C.E.

Vestas
No.1 in Modern Energy

vestas.com

Downer
6-16 GALLEGHAN RD
HEXHAM, NSW, 2322
www.downergroup.com

TEL. +61 2 4918 7400
FAX. +61 2 4918 7401

FOR CONSTRUCTION

DRAWN	BW	11.02.14
CHECKED	ABC	12.02.14
DESIGNED	BW	11.02.14
APPROVED	ABC	12.02.14


cad
DO NOT AMEND
MANUALLY

APPROVED	DATE	SCALE
APPROVALS		1:4000

VESTAS
TARALGA WIND FARM
WTG COLLECTOR SYSTEM
RETICULATION NETWORK
GENERAL ARRANGEMENT - 1:4000 SCALE

PROJECT No.	DRAWING No.	REV.
14032	TAR-E-5200-12	1

SIZE
A3

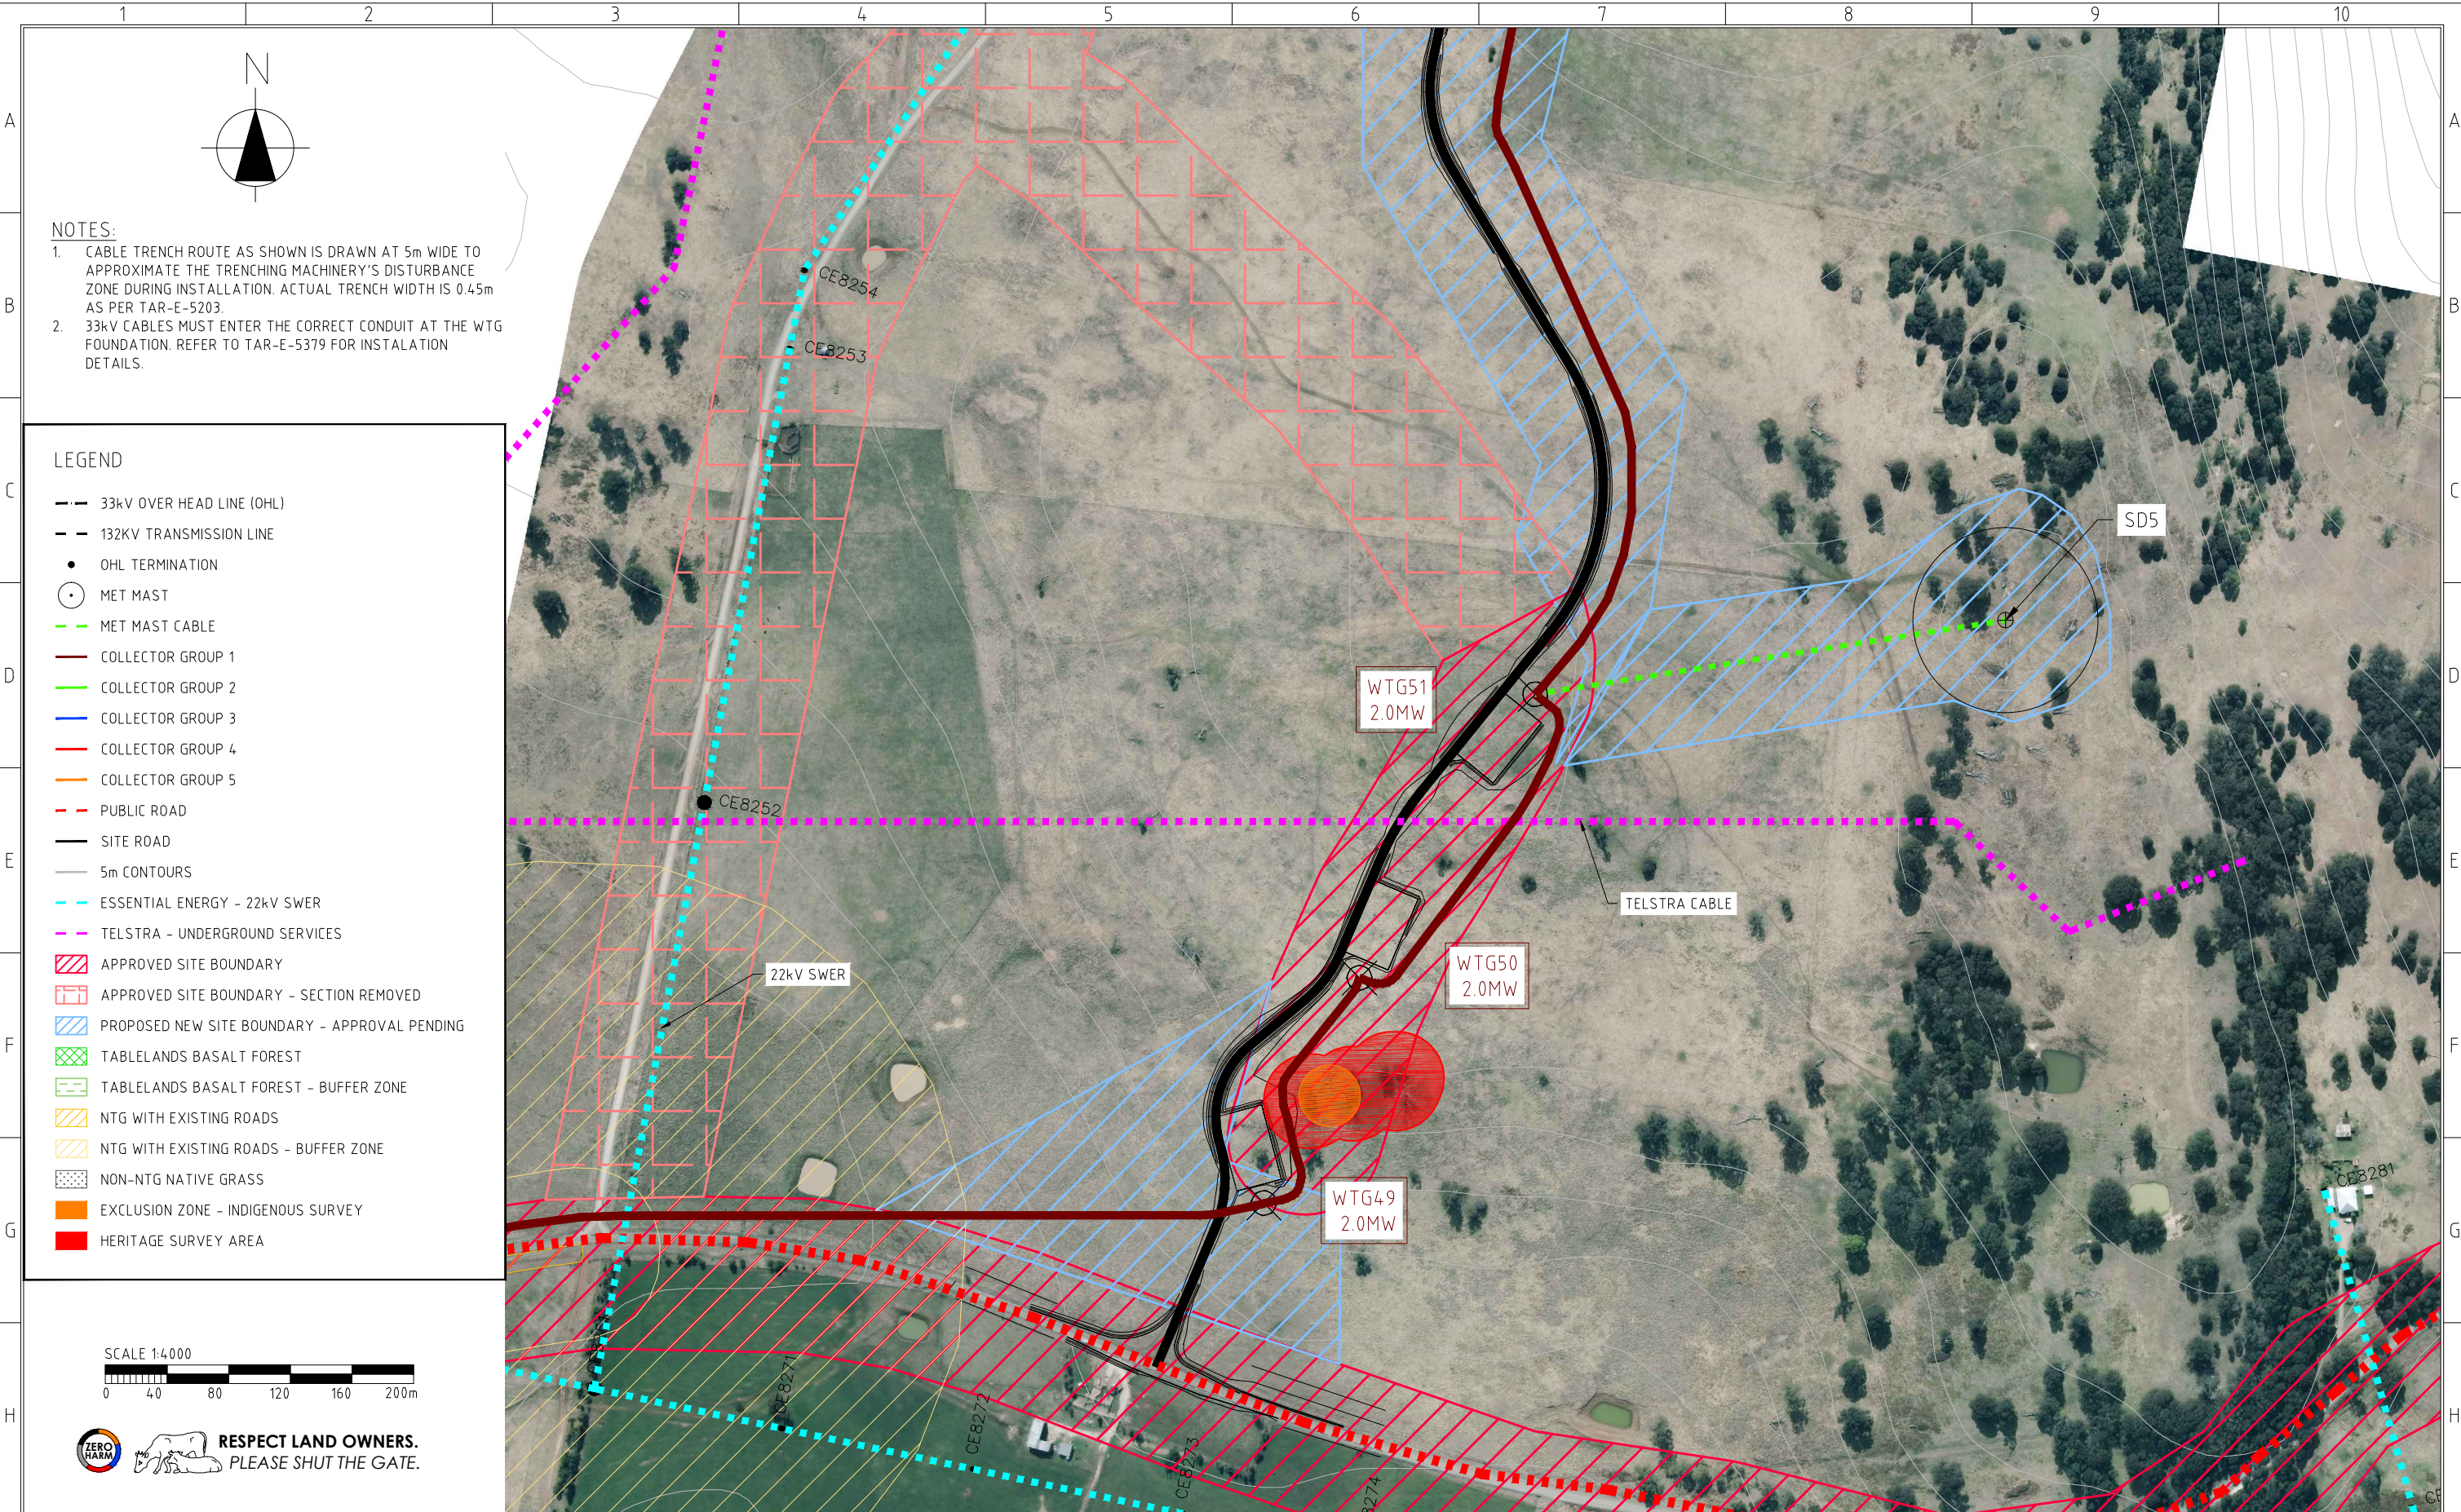

- NOTES:
- CABLE TRENCH ROUTE AS SHOWN IS DRAWN AT 5m WIDE TO APPROXIMATE THE TRENCHING MACHINERY'S DISTURBANCE ZONE DURING INSTALLATION. ACTUAL TRENCH WIDTH IS 0.45m AS PER TAR-E-5203.
 - 33kV CABLES MUST ENTER THE CORRECT CONDUIT AT THE WTG FOUNDATION. REFER TO TAR-E-5379 FOR INSTALATION DETAILS.

- LEGEND
- 33kV OVER HEAD LINE (OHL)
 - 132KV TRANSMISSION LINE
 - OHL TERMINATION
 - MET MAST
 - MET MAST CABLE
 - COLLECTOR GROUP 1
 - COLLECTOR GROUP 2
 - COLLECTOR GROUP 3
 - COLLECTOR GROUP 4
 - COLLECTOR GROUP 5
 - PUBLIC ROAD
 - SITE ROAD
 - 5m CONTOURS
 - ESSENTIAL ENERGY - 22kV SWER
 - TELSTRA - UNDERGROUND SERVICES
 - APPROVED SITE BOUNDARY
 - APPROVED SITE BOUNDARY - SECTION REMOVED
 - PROPOSED NEW SITE BOUNDARY - APPROVAL PENDING
 - TABLELANDS BASALT FOREST
 - TABLELANDS BASALT FOREST - BUFFER ZONE
 - NTG WITH EXISTING ROADS
 - NTG WITH EXISTING ROADS - BUFFER ZONE
 - NON-NTG NATIVE GRASS
 - EXCLUSION ZONE - INDIGENOUS SURVEY
 - HERITAGE SURVEY AREA

SCALE 1:4000

0 40 80 120 160 200m



Vestas
No.1 in Modern Energy

Downer

6-16 GALLEGHAN RD
HEXHAM, NSW, 2322
TEL. +61 2 4918 7400
FAX. +61 2 4918 7401

www.downergroup.com

FOR CONSTRUCTION

DRAWN	BW	11.02.14
CHECKED	ABC	12.02.14
DESIGNED	BW	11.02.14
APPROVED	ABC	12.02.14
APPROVED	DATE	SCALE
APPROVALS	1:4000	



VESTAS

TARALGA WIND FARM
WTG COLLECTOR SYSTEM
RETICULATION NETWORK
GENERAL ARRANGEMENT - 1:4000 SCALE

PROJECT No.
14032


DRAWING No.
TAR-E-5200-13

REV.
1

THIS DRAWING REMAINS THE PROPERTY OF
DOWNER EDI ENGINEERING PTY LTD
IT IS SUBJECT TO RETURN UPON DEMAND AND
MAY NOT BE PASSED ON TO ANY THIRD
PARTY, OR USED DIRECTLY OR INDIRECTLY FOR
ANY OTHER PURPOSE THAN THE MANUFACTURE
OR CONSTRUCTION OF EQUIPMENT, OR IN THE
DESIGN AND INSTALLATION OF PLANT TO THE
ORDER OF DOWNER EDI ENGINEERING Pty. Ltd.

REV	DATE	DESCRIPTION	DRN	CHK'D	C.E.	CLIENT
1	26.02.14	MINOR AMENDMENTS FOR EIS SUBMISSION	BW	ZB	ABC	
0	14.02.14	FOR CONSTRUCTION	BW	BH	ABC	

REVISIONS AND APPROVALS

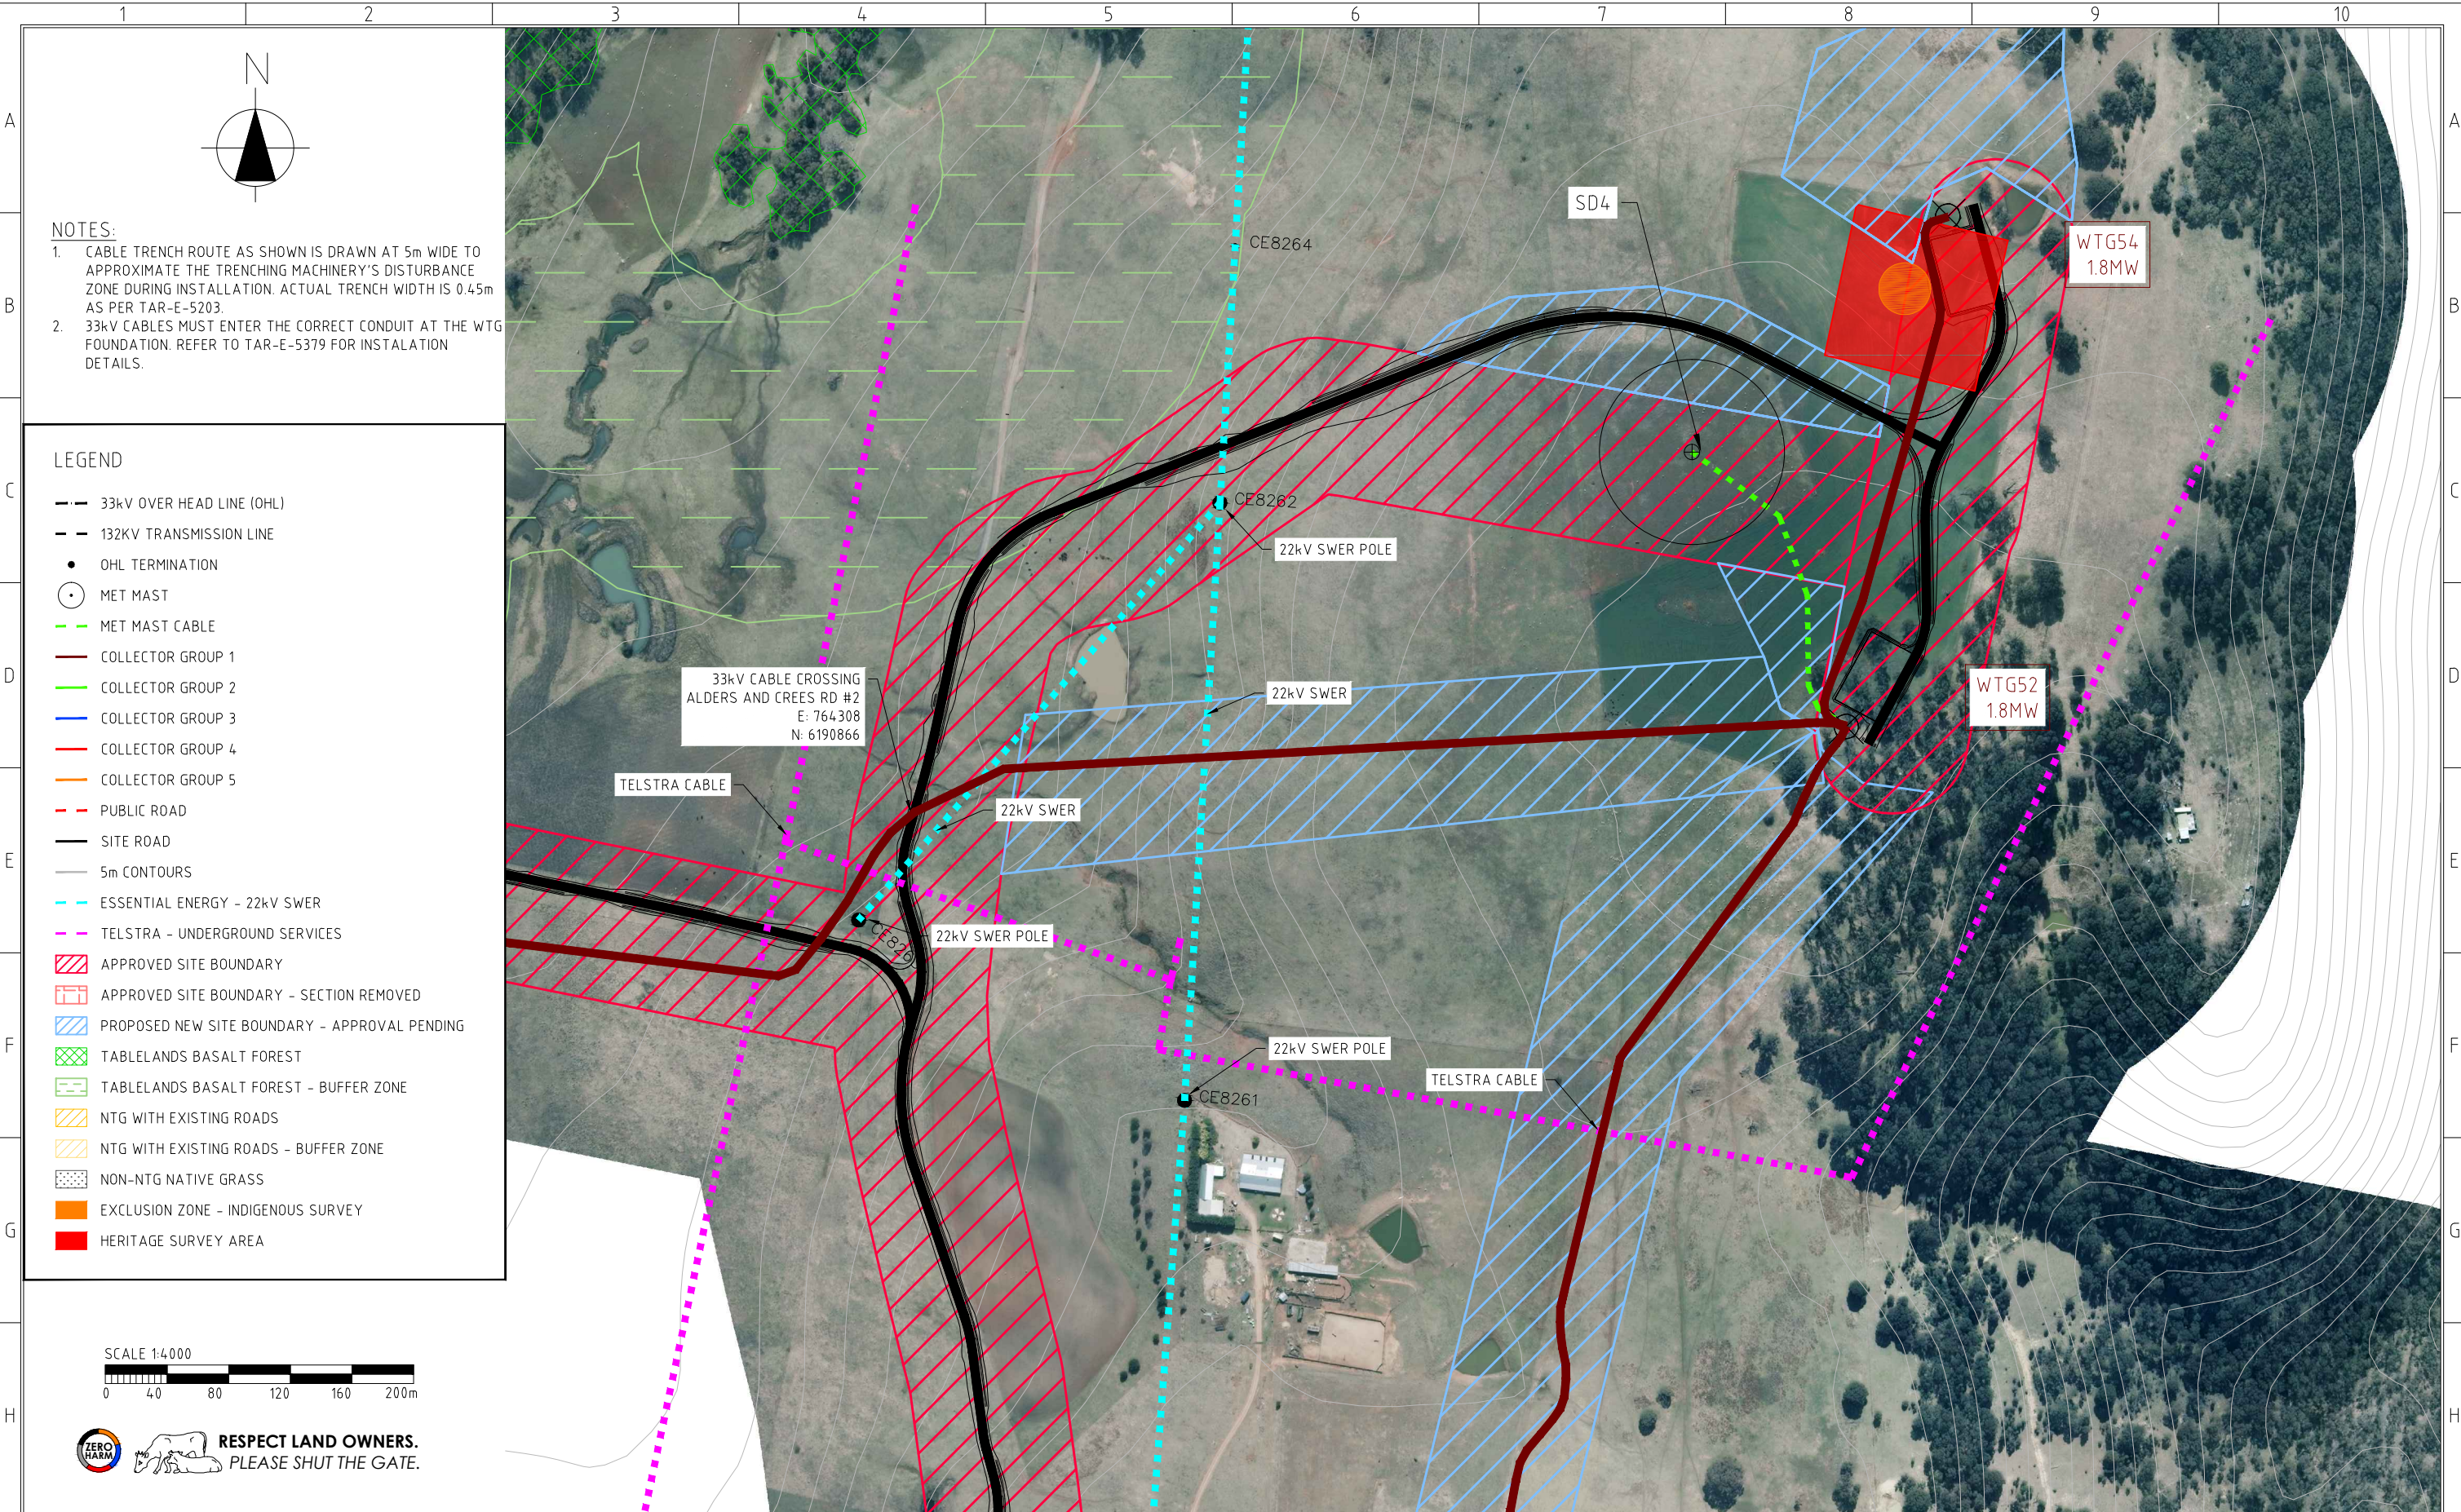

- NOTES:
- CABLE TRENCH ROUTE AS SHOWN IS DRAWN AT 5m WIDE TO APPROXIMATE THE TRENCHING MACHINERY'S DISTURBANCE ZONE DURING INSTALLATION. ACTUAL TRENCH WIDTH IS 0.45m AS PER TAR-E-5203.
 - 33kV CABLES MUST ENTER THE CORRECT CONDUIT AT THE WTG FOUNDATION. REFER TO TAR-E-5379 FOR INSTALATION DETAILS.

- LEGEND
- 33kV OVER HEAD LINE (OHL)
 - 132KV TRANSMISSION LINE
 - OHL TERMINATION
 - MET MAST
 - MET MAST CABLE
 - COLLECTOR GROUP 1
 - COLLECTOR GROUP 2
 - COLLECTOR GROUP 3
 - COLLECTOR GROUP 4
 - COLLECTOR GROUP 5
 - PUBLIC ROAD
 - SITE ROAD
 - 5m CONTOURS
 - ESSENTIAL ENERGY - 22kV SWER
 - TELSTRA - UNDERGROUND SERVICES
 - APPROVED SITE BOUNDARY
 - APPROVED SITE BOUNDARY - SECTION REMOVED
 - PROPOSED NEW SITE BOUNDARY - APPROVAL PENDING
 - TABLELANDS BASALT FOREST
 - TABLELANDS BASALT FOREST - BUFFER ZONE
 - NTG WITH EXISTING ROADS
 - NTG WITH EXISTING ROADS - BUFFER ZONE
 - NON-NTG NATIVE GRASS
 - EXCLUSION ZONE - INDIGENOUS SURVEY
 - HERITAGE SURVEY AREA

SCALE 1:4000

0 40 80 120 160 200m



Copyright	THIS DRAWING REMAINS THE PROPERTY OF DOWNER EDI ENGINEERING PTY LTD IT IS SUBJECT TO RETURN UPON DEMAND AND MAY NOT BE PASSED ON TO ANY THIRD PARTY, OR USED DIRECTLY OR INDIRECTLY FOR ANY OTHER PURPOSE THAN THE MANUFACTURE OR CONSTRUCTION OF EQUIPMENT, OR IN THE DESIGN AND INSTALLATION OF PLANT TO THE ORDER OF DOWNER EDI ENGINEERING Pty. Ltd.									
	1	26.02.14	MINOR AMENDMENTS FOR EIS SUBMISSION	BW	ZB	ABC				
	0	18.02.14	FOR CONSTRUCTION	BW	BH	ABC				
	REV	DATE	DESCRIPTION	DRN	CHK'D	C.E.	CLIENT			
REVISIONS AND APPROVALS										



vestas.com



6-16 GALLEGHAN RD
HEXHAM, NSW, 2322
TEL. +61 2 4918 7400
FAX. +61 2 4918 7401

www.downergroup.com

FOR CONSTRUCTION

DRAWN	BW	11.02.14
CHECKED	ABC	12.02.14
DESIGNED	BW	11.02.14
APPROVED	ABC	12.02.14



APPROVED DATE SCALE
APPROVALS 1:4000

VESTAS


TARALGA WIND FARM
WTG COLLECTOR SYSTEM
RETICULATION NETWORK
GENERAL ARRANGEMENT - 1:4000 SCALE

PROJECT No.
14032

DRAWING No.
TAR-E-5200-15

SIZE
A3

REV.
1

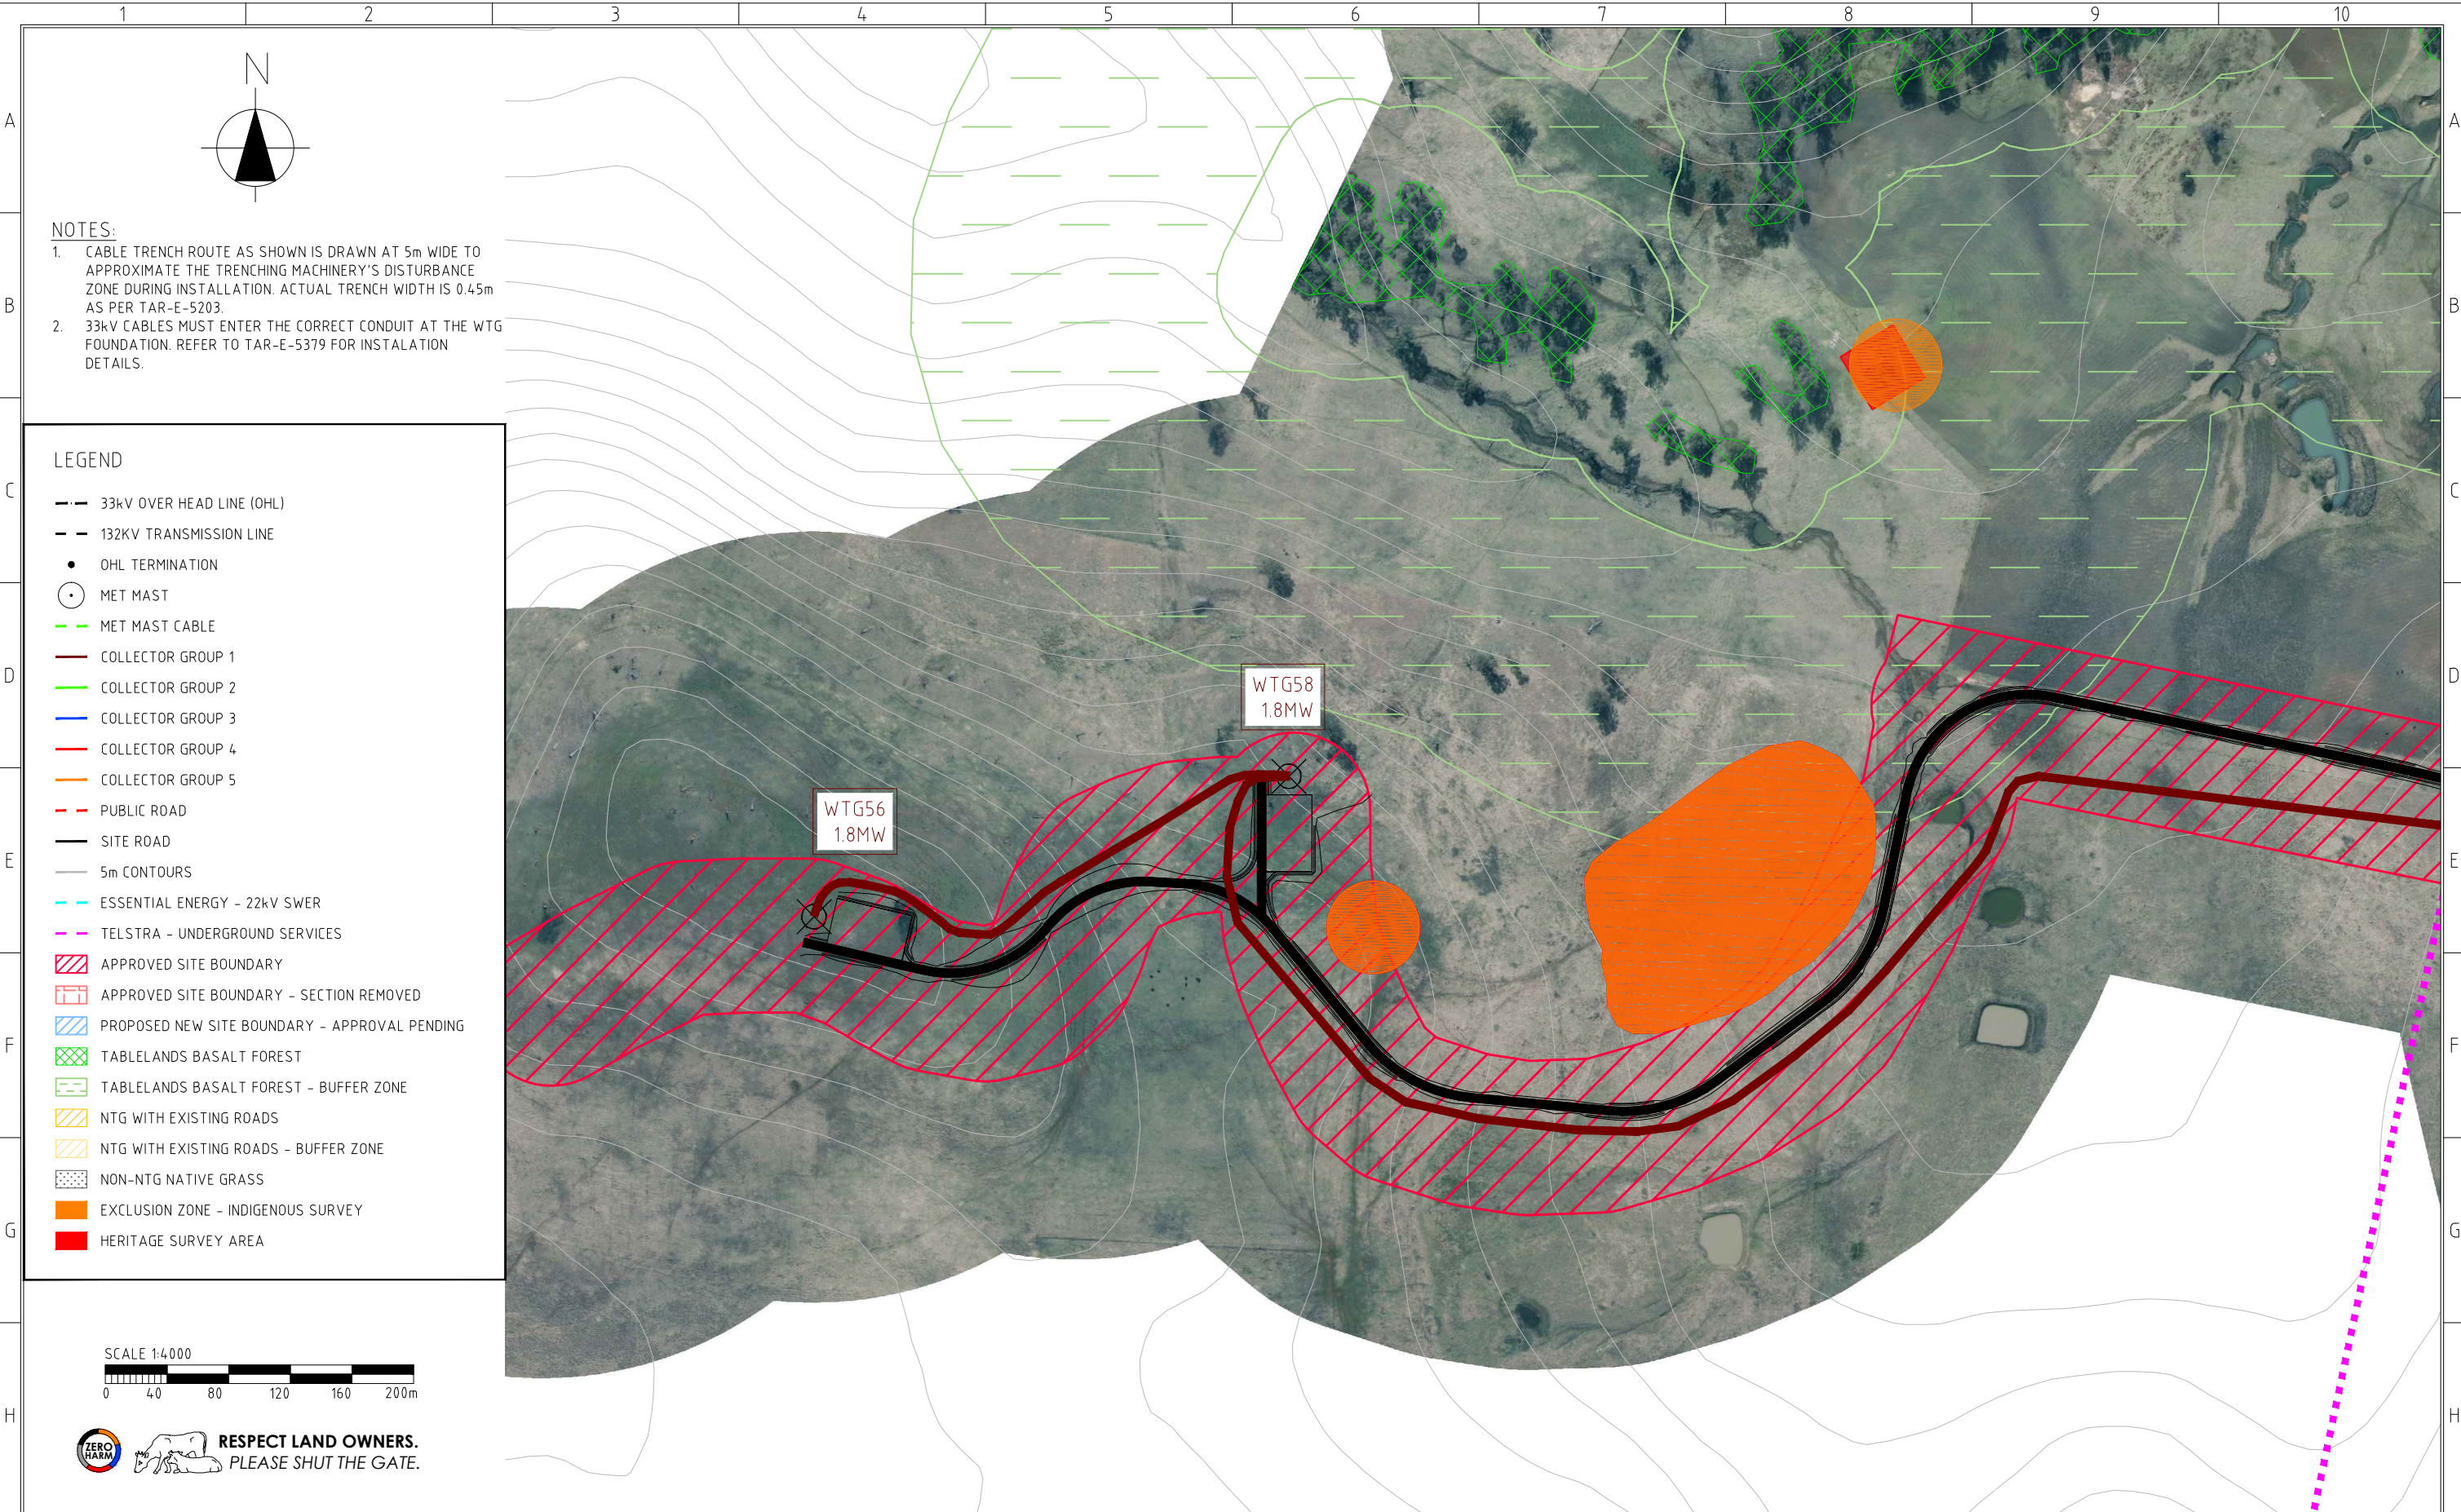

- NOTES:
- CABLE TRENCH ROUTE AS SHOWN IS DRAWN AT 5m WIDE TO APPROXIMATE THE TRENCHING MACHINERY'S DISTURBANCE ZONE DURING INSTALLATION. ACTUAL TRENCH WIDTH IS 0.45m AS PER TAR-E-5203.
 - 33kV CABLES MUST ENTER THE CORRECT CONDUIT AT THE WTG FOUNDATION. REFER TO TAR-E-5379 FOR INSTALATION DETAILS.

- LEGEND
- 33kV OVER HEAD LINE (OHL)
 - 132KV TRANSMISSION LINE
 - OHL TERMINATION
 - MET MAST
 - MET MAST CABLE
 - COLLECTOR GROUP 1
 - COLLECTOR GROUP 2
 - COLLECTOR GROUP 3
 - COLLECTOR GROUP 4
 - COLLECTOR GROUP 5
 - PUBLIC ROAD
 - SITE ROAD
 - 5m CONTOURS
 - ESSENTIAL ENERGY - 22kV SWER
 - TELSTRA - UNDERGROUND SERVICES
 - APPROVED SITE BOUNDARY
 - APPROVED SITE BOUNDARY - SECTION REMOVED
 - PROPOSED NEW SITE BOUNDARY - APPROVAL PENDING
 - TABLELANDS BASALT FOREST
 - TABLELANDS BASALT FOREST - BUFFER ZONE
 - NTG WITH EXISTING ROADS
 - NTG WITH EXISTING ROADS - BUFFER ZONE
 - NON-NTG NATIVE GRASS
 - EXCLUSION ZONE - INDIGENOUS SURVEY
 - HERITAGE SURVEY AREA

SCALE 1:4000

0 40 80 120 160 200m



Vestas
No.1 in Modern Energy

Downer

6-16 GALLEGHAN RD
HEXHAM, NSW, 2322
TEL. +61 2 4918 7400
FAX. +61 2 4918 7401

www.downergroup.com

FOR CONSTRUCTION

DRAWN	BW	11.02.14
CHECKED	ABC	12.02.14
DESIGNED	BW	11.02.14
APPROVED	ABC	12.02.14

cad
DO NOT AMEND
MANUALLY

APPROVED DATE SCALE
APPROVALS 1:4000

VESTAS

TARALGA WIND FARM
WTG COLLECTOR SYSTEM
RETICULATION NETWORK
GENERAL ARRANGEMENT - 1:4000 SCALE

PROJECT No.
14032

DRAWING No.
TAR-E-5200-16

SIZE
A3


REV.
1

Copyright

THIS DRAWING REMAINS THE PROPERTY OF
DOWNER EDI ENGINEERING PTY LTD
IT IS SUBJECT TO RETURN UPON DEMAND AND
MAY NOT BE PASSED ON TO ANY THIRD
PARTY, OR USED DIRECTLY OR INDIRECTLY FOR
ANY OTHER PURPOSE THAN THE MANUFACTURE
OR CONSTRUCTION OF EQUIPMENT, OR IN THE
DESIGN AND INSTALLATION OF PLANT TO THE
ORDER OF DOWNER EDI ENGINEERING Pty. Ltd.

REV	DATE	DESCRIPTION	DRN	CHK'D	C.E.	CLIENT
1	26.02.14	MINOR AMENDMENTS FOR EIS SUBMISSION	BW	ZB	ABC	
0	18.02.14	FOR CONSTRUCTION	BW	BH	ABC	

REVISIONS AND APPROVALS

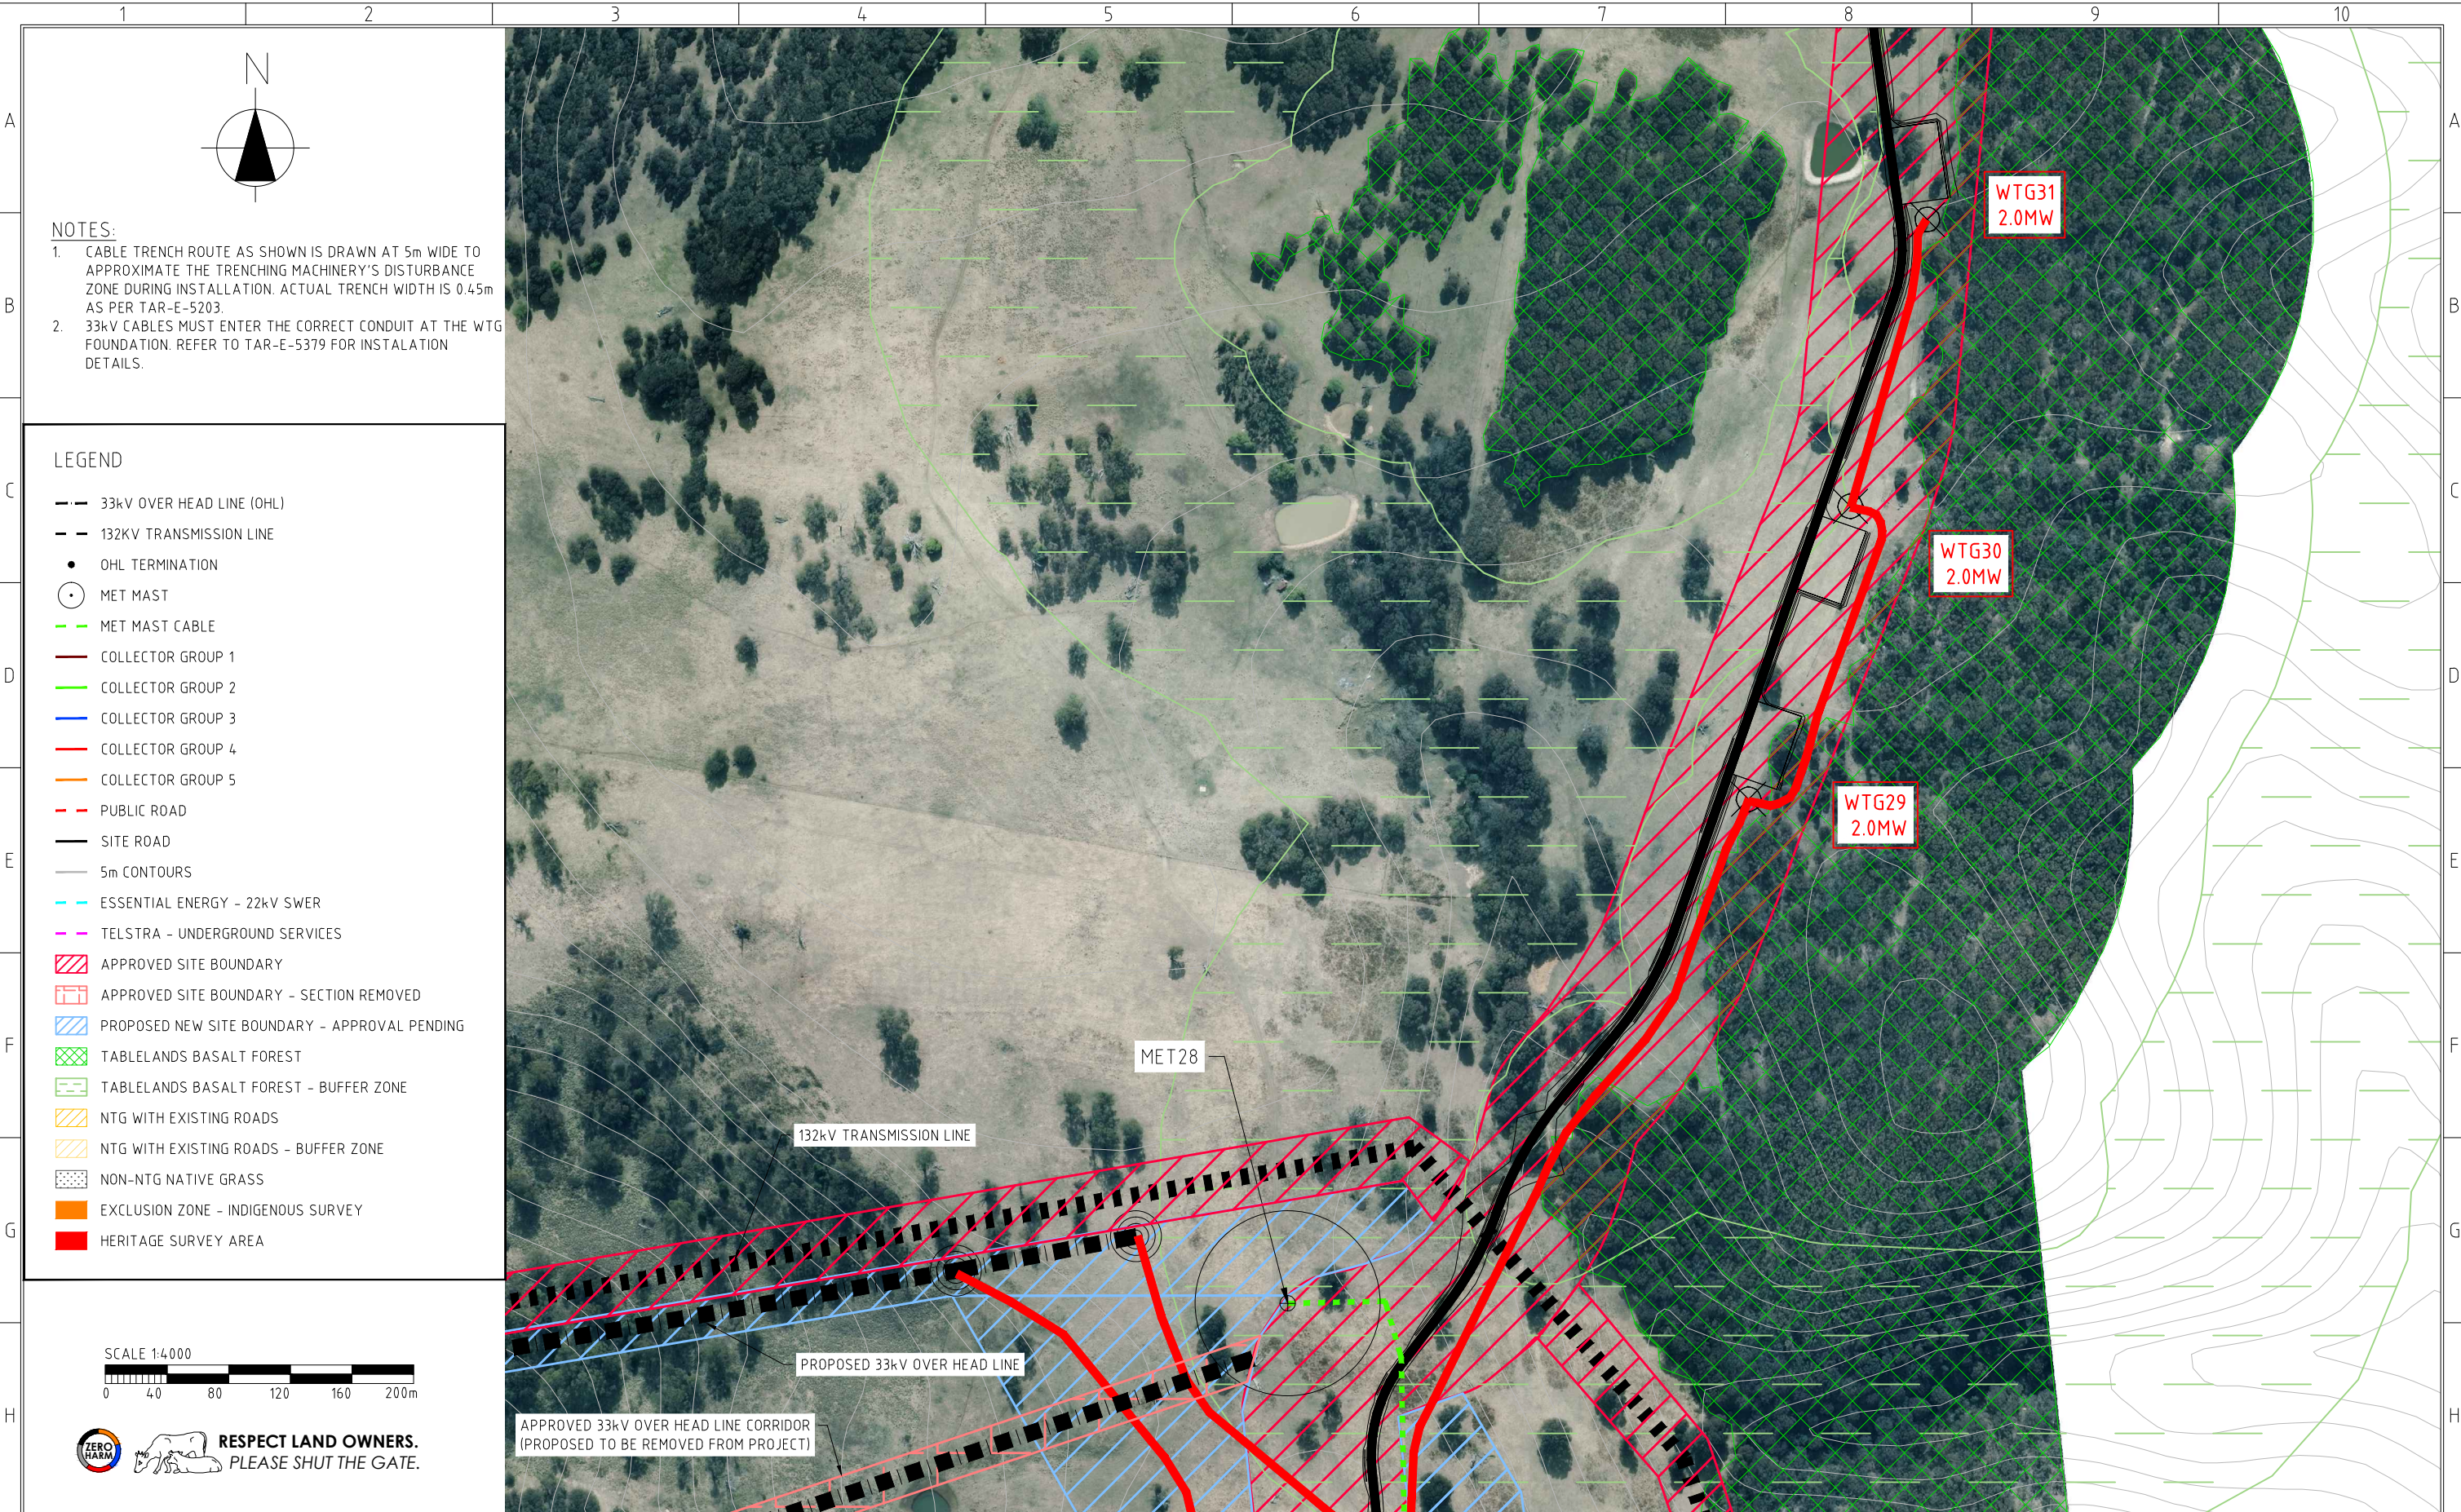

Copyright	THIS DRAWING REMAINS THE PROPERTY OF DOWNER EDI ENGINEERING PTY LTD										 No.1 in Modern Energy		 6-16 GALLEGHAN RD HEXHAM, NSW, 2322 TEL. +61 2 4918 7400 FAX. +61 2 4918 7401 www.downergroup.com		FOR CONSTRUCTION				VESTAS				SIZE A3	
	IT IS SUBJECT TO RETURN UPON DEMAND AND MAY NOT BE PASSED ON TO ANY THIRD PARTY, OR USED DIRECTLY OR INDIRECTLY FOR ANY OTHER PURPOSE THAN THE MANUFACTURE OR CONSTRUCTION OF EQUIPMENT, OR IN THE DESIGN AND INSTALLATION OF PLANT TO THE ORDER OF DOWNER EDI ENGINEERING Pty. Ltd.														TARALGA WIND FARM WTG COLLECTOR SYSTEM RETICULATION NETWORK GENERAL ARRANGEMENT - 1:4000 SCALE				REV. 1					
															 DO NOT AMEND MANUALLY						PROJECT No. 14032		DRAWING No. TAR-E-5200-17	
																					APPROVALS		SCALE 1:4000	
	REVISIONS AND APPROVALS																							
	REV		DATE		DESCRIPTION		DRN		CHK'D		C.E.		CLIENT											
	1		26.02.14		MINOR AMENDMENTS FOR EIS SUBMISSION		BW		ZB		ABC													
	0		18.02.14		FOR CONSTRUCTION		BW		BH		ABC													



THIS DRAWING REMAINS THE PROPERTY OF
DOWNER EDI ENGINEERING PTY LTD

IT IS SUBJECT TO RETURN UPON DEMAND AND
MAY NOT BE PASSED ON TO ANY THIRD
PARTY, OR USED DIRECTLY OR INDIRECTLY FOR
ANY OTHER PURPOSE THAN THE MANUFACTURE
OR CONSTRUCTION OF EQUIPMENT, OR IN THE
DESIGN AND INSTALLATION OF PLANT TO THE
ORDER OF DOWNER EDI ENGINEERING Pty. Ltd.

1	26.02.14	MINOR AMENDMENTS FOR EIS SUBMISSION	BW	ZB	ABC
0	18.02.14	FOR CONSTRUCTION	BW	BH	ABC
REV	DATE	DESCRIPTION	DRN	CHK'D	C.E.

REVISIONS AND APPROVALS

Vestas
No.1 in Modern Energy

Downer

6-16 GALLEGHAN RD
HEXHAM, NSW, 2322

TEL. +61 2 4918 7400
FAX. +61 2 4918 7401

www.downergroup.com

FOR CONSTRUCTION

DRAWN	BW	11.02.14
CHECKED	ABC	12.02.14
DESIGNED	BW	11.02.14
APPROVED	ABC	12.02.14
APPROVED	DATE	SCALE
APPROVALS	1:4000	


cad
DO NOT AMEND
MANUALLY

VESTAS

TARALGA WIND FARM
WTG COLLECTOR SYSTEM
RETICULATION NETWORK
GENERAL ARRANGEMENT - 1:4000 SCALE

PROJECT No. 14032	DRAWING No. TAR-E-5200-18	REV. 1
----------------------	------------------------------	-----------

SIZE
A3

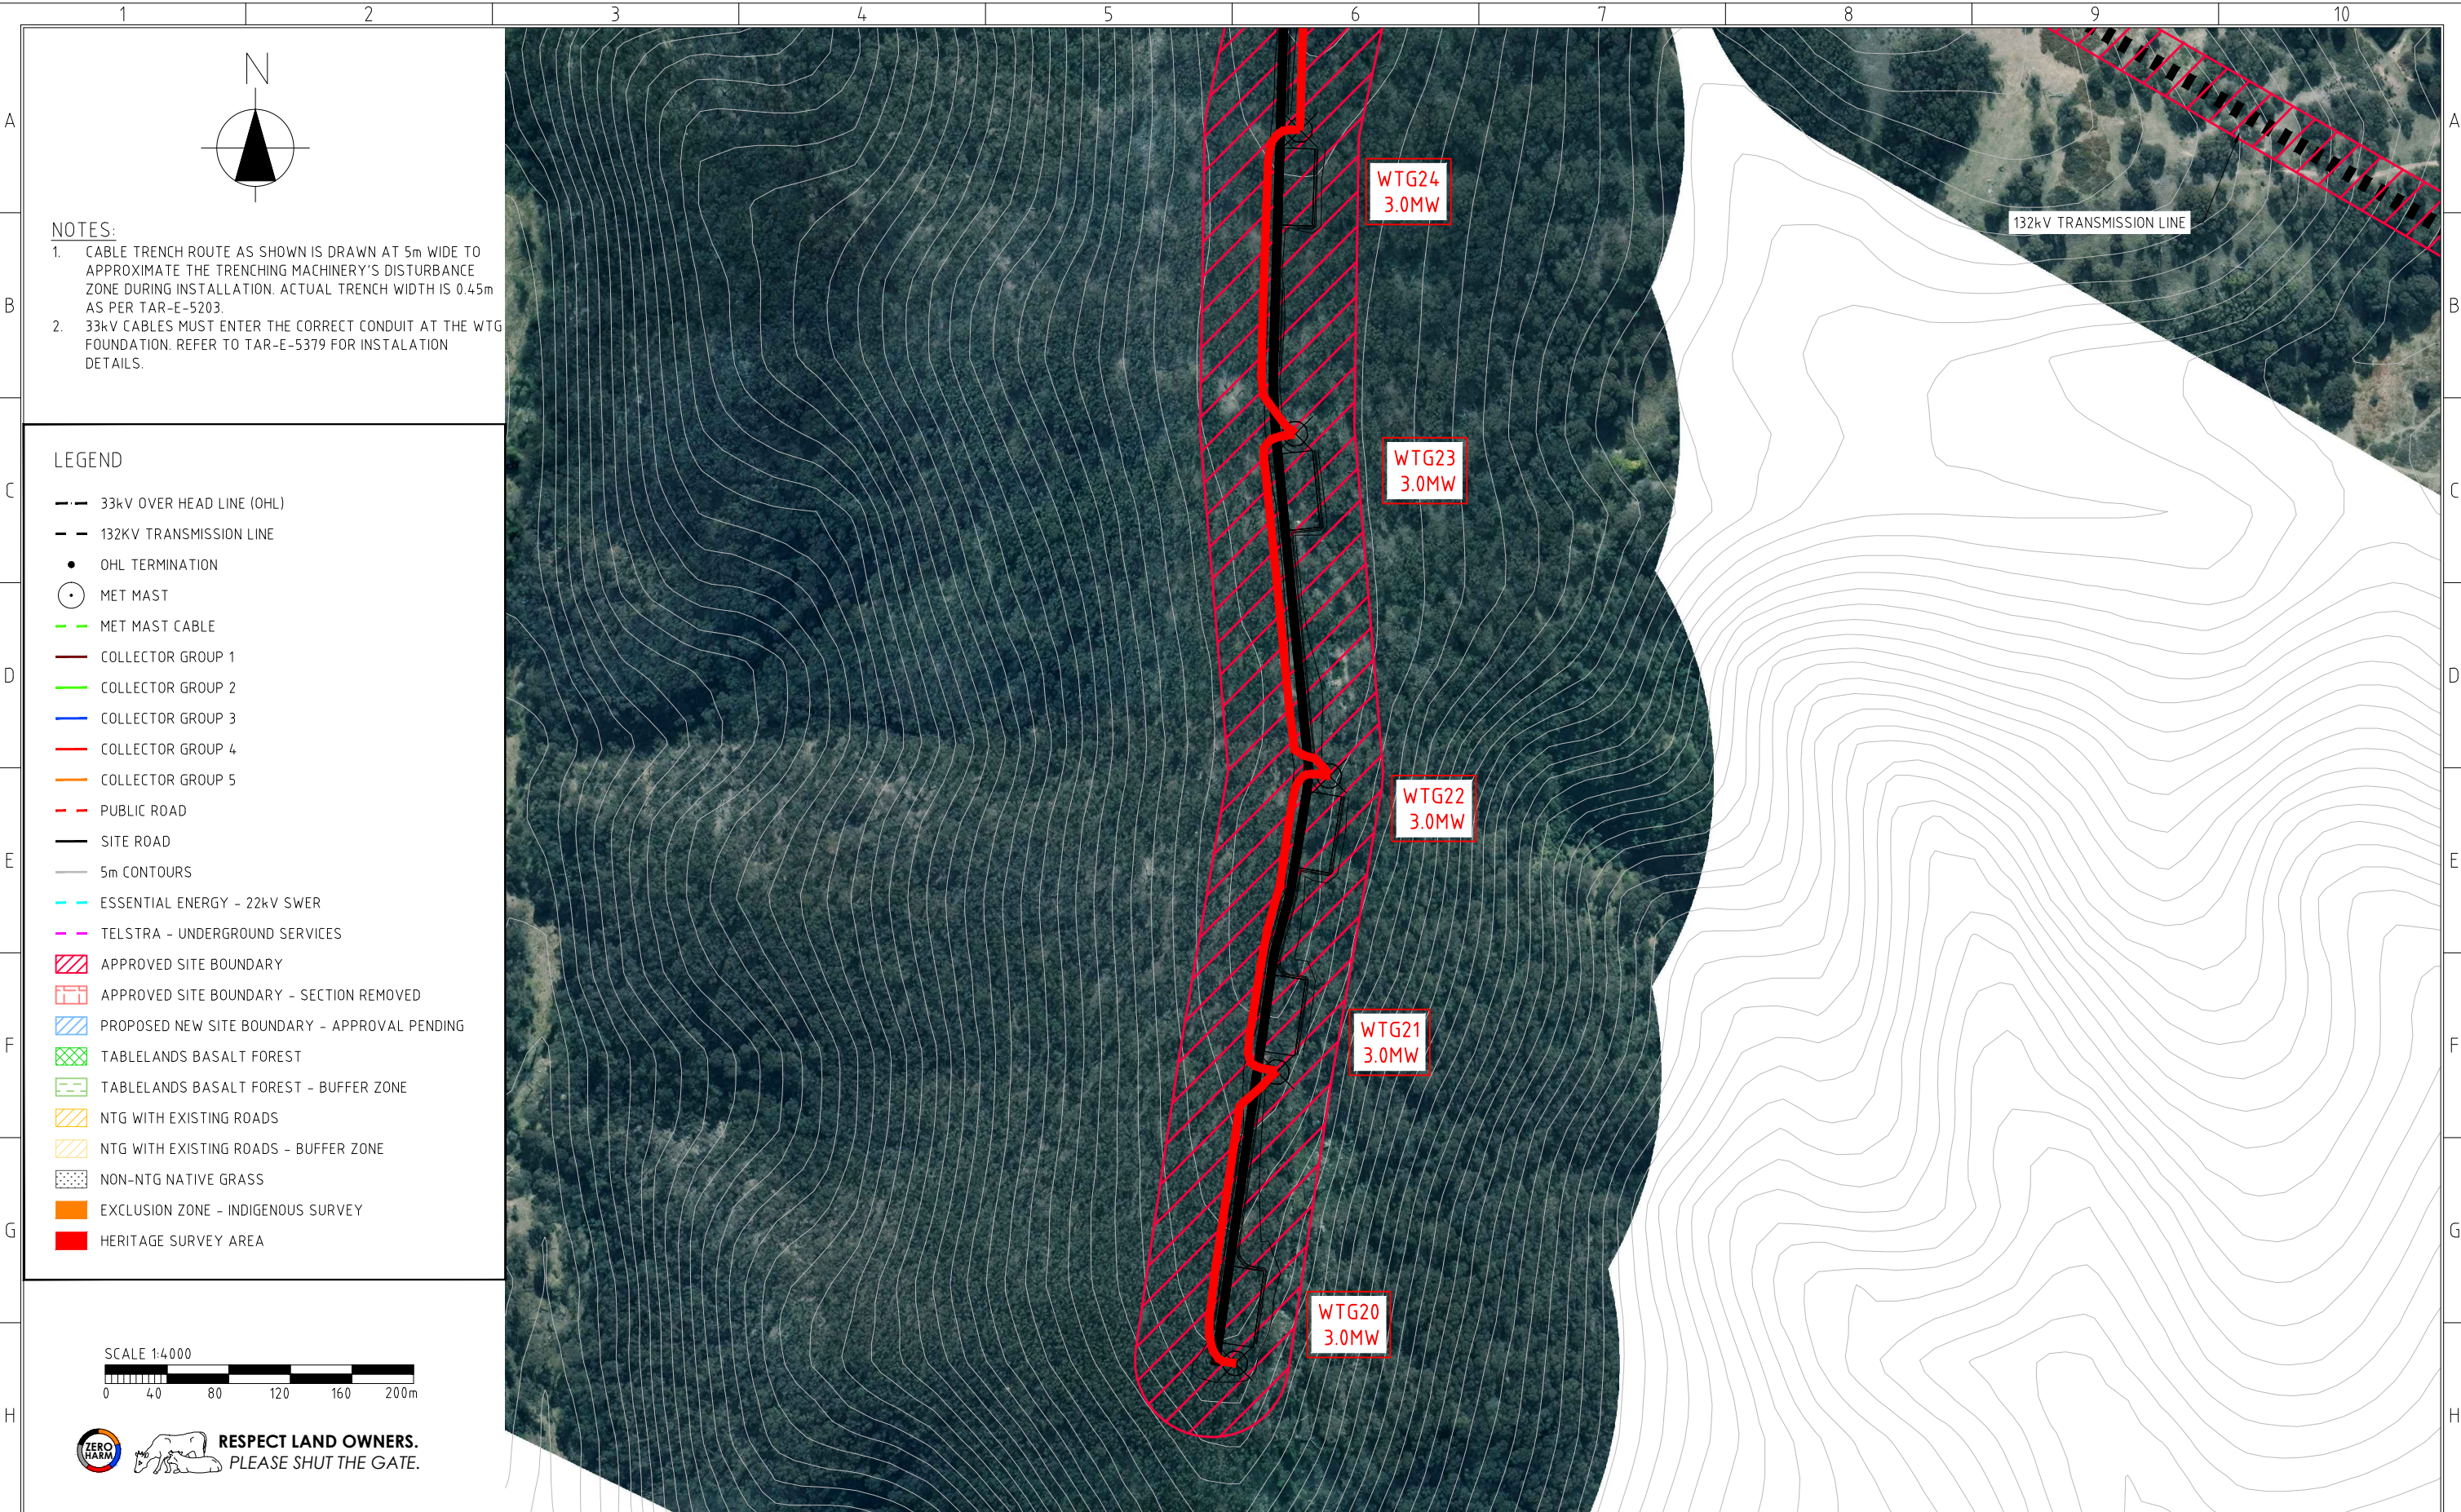

- NOTES:
- CABLE TRENCH ROUTE AS SHOWN IS DRAWN AT 5m WIDE TO APPROXIMATE THE TRENCHING MACHINERY'S DISTURBANCE ZONE DURING INSTALLATION. ACTUAL TRENCH WIDTH IS 0.45m AS PER TAR-E-5203.
 - 33kV CABLES MUST ENTER THE CORRECT CONDUIT AT THE WTG FOUNDATION. REFER TO TAR-E-5379 FOR INSTALATION DETAILS.

- LEGEND
- 33kV OVER HEAD LINE (OHL)
 - 132KV TRANSMISSION LINE
 - OHL TERMINATION
 - MET MAST
 - MET MAST CABLE
 - COLLECTOR GROUP 1
 - COLLECTOR GROUP 2
 - COLLECTOR GROUP 3
 - COLLECTOR GROUP 4
 - COLLECTOR GROUP 5
 - PUBLIC ROAD
 - SITE ROAD
 - 5m CONTOURS
 - ESSENTIAL ENERGY - 22kV SWER
 - TELSTRA - UNDERGROUND SERVICES
 - APPROVED SITE BOUNDARY
 - APPROVED SITE BOUNDARY - SECTION REMOVED
 - PROPOSED NEW SITE BOUNDARY - APPROVAL PENDING
 - TABLELANDS BASALT FOREST
 - TABLELANDS BASALT FOREST - BUFFER ZONE
 - NTG WITH EXISTING ROADS
 - NTG WITH EXISTING ROADS - BUFFER ZONE
 - NON-NTG NATIVE GRASS
 - EXCLUSION ZONE - INDIGENOUS SURVEY
 - HERITAGE SURVEY AREA

SCALE 1:4000

0 40 80 120 160 200m



RESPECT LAND OWNERS.
PLEASE SHUT THE GATE.

Vestas
No.1 in Modern Energy

Downer

6-16 GALLEGHAN RD
HEXHAM, NSW, 2322
TEL. +61 2 4918 7400
FAX. +61 2 4918 7401

www.downergroup.com

FOR CONSTRUCTION

DRAWN	BW	11.02.14
CHECKED	ABC	12.02.14
DESIGNED	BW	11.02.14
APPROVED	ABC	12.02.14
APPROVED	DATE	SCALE
APPROVALS		1:4000

cad
DO NOT AMEND
MANUALLY

VESTAS

TARALGA WIND FARM
WTG COLLECTOR SYSTEM
RETICULATION NETWORK
GENERAL ARRANGEMENT - 1:4000 SCALE

PROJECT No.
14032

DRAWING No.
TAR-E-5200-19

SIZE
A3

REV.
1

Copyright

THIS DRAWING REMAINS THE PROPERTY OF
DOWNER EDI ENGINEERING PTY LTD
IT IS SUBJECT TO RETURN UPON DEMAND AND
MAY NOT BE PASSED ON TO ANY THIRD
PARTY, OR USED DIRECTLY OR INDIRECTLY FOR
ANY OTHER PURPOSE THAN THE MANUFACTURE
OR CONSTRUCTION OF EQUIPMENT, OR IN THE
DESIGN AND INSTALLATION OF PLANT TO THE
ORDER OF DOWNER EDI ENGINEERING Pty. Ltd.

REV	DATE	DESCRIPTION	DRN	CHK'D	C.E.	CLIENT
1	26.02.14	MINOR AMENDMENTS FOR EIS SUBMISSION	BW	ZB	ABC	
0	18.02.14	FOR CONSTRUCTION	BW	BH	ABC	

REVISIONS AND APPROVALS