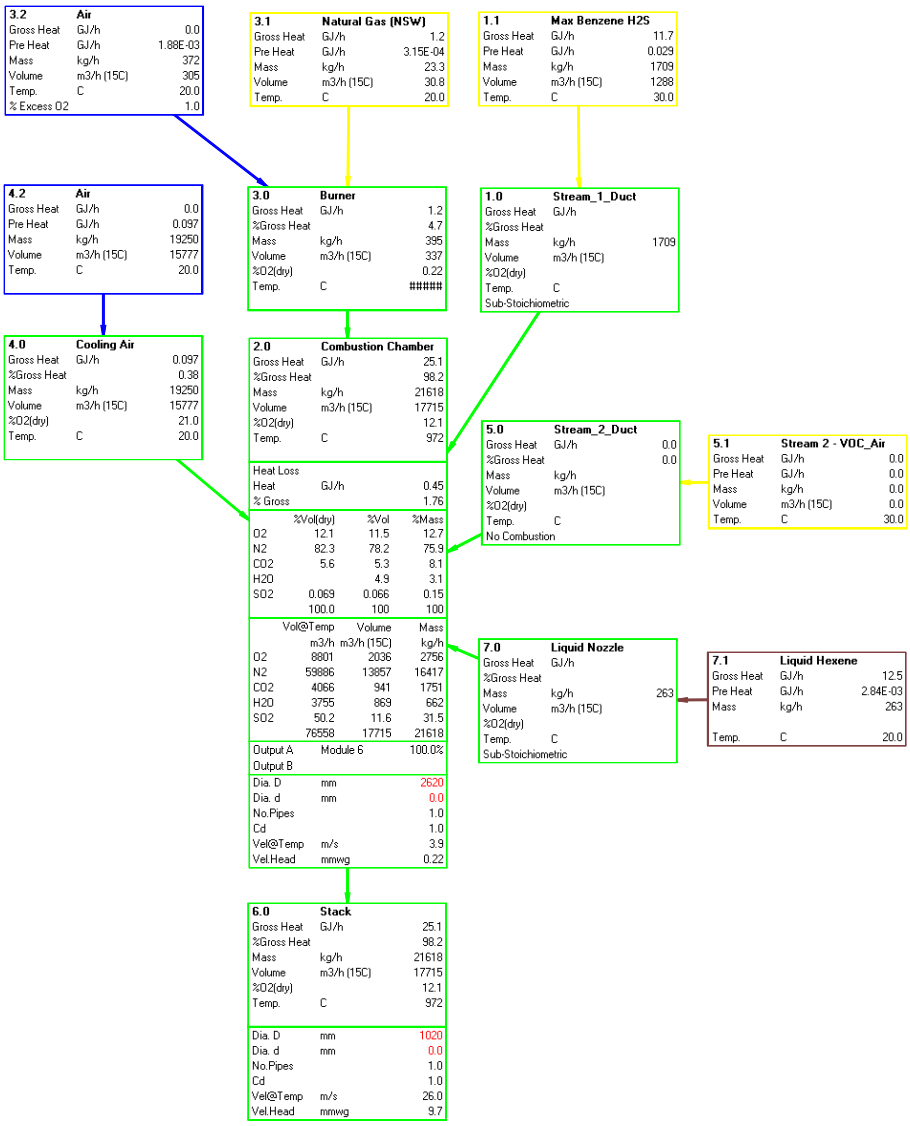

GASCO engineering with flare	Gasco Project	Q12803	Notes:For temperatures >1500C,dissociation must be accounted for
	By	SW	TO for Port Botany (Terminals Pty Ltd / Quantem)
	Checked/Approved		
	Date	3 August, 2021	HMB 2
	Amb.Temp.C	15.0	Heat and Mass Balance Ver. 1.0.3