

14 April 2023

The Secretary  
NSW Department of Planning and Environment

Attention: Nahid Mahmud

**3574/2019/DA - CW at MENANGLE ROAD MENANGLE PARK 2563**

Dear Sir or Madam

I refer to the Department's email of 28 March 2023 regarding St Anthony of Padua Catholic School Redevelopment Modification 3 SSD-8865-Mod-3 to amend the dimensions of the maintenance shed, a minor adjustment to the roof profile of the main school building, modify vehicular access and adjustment of drop-off/pick-up spaces and electric charging station at 125-165 Tenth Avenue and 140-170 Eleventh Avenue, Austral (Lots 810, 811, 812, 840, 841, 842 DP 2475; Lots 1 & 2 DP 1232692) in the Liverpool City Council Local Government Area (LGA). Submissions needed to be made to the Department by 12 April 2023. I apologise for the late submission but trust Endeavour Energy's conditions and advice will still be considered.

Please refer to Endeavour Energy's submissions made to the Department on:

- 10 February 2020 for the Response to Submissions Redevelopment of St Anthony of Padua School. Concept Development application to redevelopment St Anthony of Padua Catholic School including: A Concept Proposal for a school to accommodate 2480 students and a 125 place child care centre and concurrent Stage 1 works with intersection upgrade.
- 12 May 2021 for the request to modify the St Anthony of Padua Catholic School Redevelopment – MOD 1. Proposed amendments to project staging, site layout, the composition of outdoor and indoor recreational facilities, building bulk and scale including a reduction in total gross floor area, and minor changes to drop-off / pick-up area.
- 1 November 2021 for Response to Submissions for request to modify the St Anthony of Padua Catholic School Redevelopment – MOD 1.
- 28 July 2022 for St Anthony of Padua Catholic School Redevelopment Modification 2 SSD-8865-Mod-2 to increase the level of the sports field to reduce excavation, including new associated structures such as retaining walls and ramp access, and amendment to the main building external colours and materials.

From the Section 4.55(1A) Modification Report the proposed amendments do not appear to have a direct or significant impact on the existing or required electricity infrastructure ie. the adjustments to the location of the electric charging station spaces across the site will change the electrical works required on the site but are unlikely to directly affect Endeavour Energy's electricity distribution network.

Notwithstanding the proposed amendments the recommendations and comments provided in Endeavour Energy's previous submissions essentially remain valid. Subject thereto Endeavour Energy has no objection to the Development Application.

For further advice the Department or the applicant can call Endeavour Energy via Head Office enquiries on business days from 9am - 4:30pm on telephone: 133 718 or (02) 9853 6666 and the following contacts:

- Customer Network Solutions Branch for matters related to the electricity supply or asset relocation who are responsible for managing the conditions of supply with the proponent and their Accredited Service Provider (ASP). Alternatively contact can be made by email [cicadmin@endeavourenergy.com.au](mailto:cicadmin@endeavourenergy.com.au) .

The applicant will need to make contact if this Development Application:

- Includes any contestable works projects that are outside of any existing approved / certified works.
- Results in an electricity load that is outside of any existing Supply / Connection Offer requiring the incorporation of the additional load for consideration.
- Easements Officers for matters related to easement management or protected works / assets. Alternatively contact can be made by email [Easements@endeavourenergy.com.au](mailto:Easements@endeavourenergy.com.au) .
- Property Branch for matters related to property tenure. Alternatively contact can be made by email [network\\_property@endeavourenergy.com.au](mailto:network_property@endeavourenergy.com.au) (underscore between 'network' and 'property').
- Field Operations Branch for safety advice for building or working near electrical assets in public areas. The site is in the area covered by Hoxton Park Field Service Centre. Alternatively contact can be made by email [Construction.Works@endeavourenergy.com.au](mailto:Construction.Works@endeavourenergy.com.au) .

Should you wish to discuss this matter, or have any questions, please do not hesitate to contact me or the contacts identified above or in Endeavour Energy's previous submissions in relation to the various matters. Due to the high number of development application / planning proposal notifications submitted to Endeavour Energy, to ensure a response contact by email to [property.development@endeavourenergy.com.au](mailto:property.development@endeavourenergy.com.au) is preferred.

Yours faithfully

**Cornelis Duba** | Development Application Specialist

M 0455250981

E [cornelis.duba@endeavourenergy.com.au](mailto:cornelis.duba@endeavourenergy.com.au)

51 Huntingwood Drive, Huntingwood NSW 2148. Dharug Country

[endeavourenergy.com.au](http://endeavourenergy.com.au)




**Endeavour  
Energy**

**POWER  
together**



Endeavour Energy respectfully acknowledges the Traditional Custodians on whose lands we live, work, and operate and their Elders past, present and emerging.

## Concept Proposal Site Plan

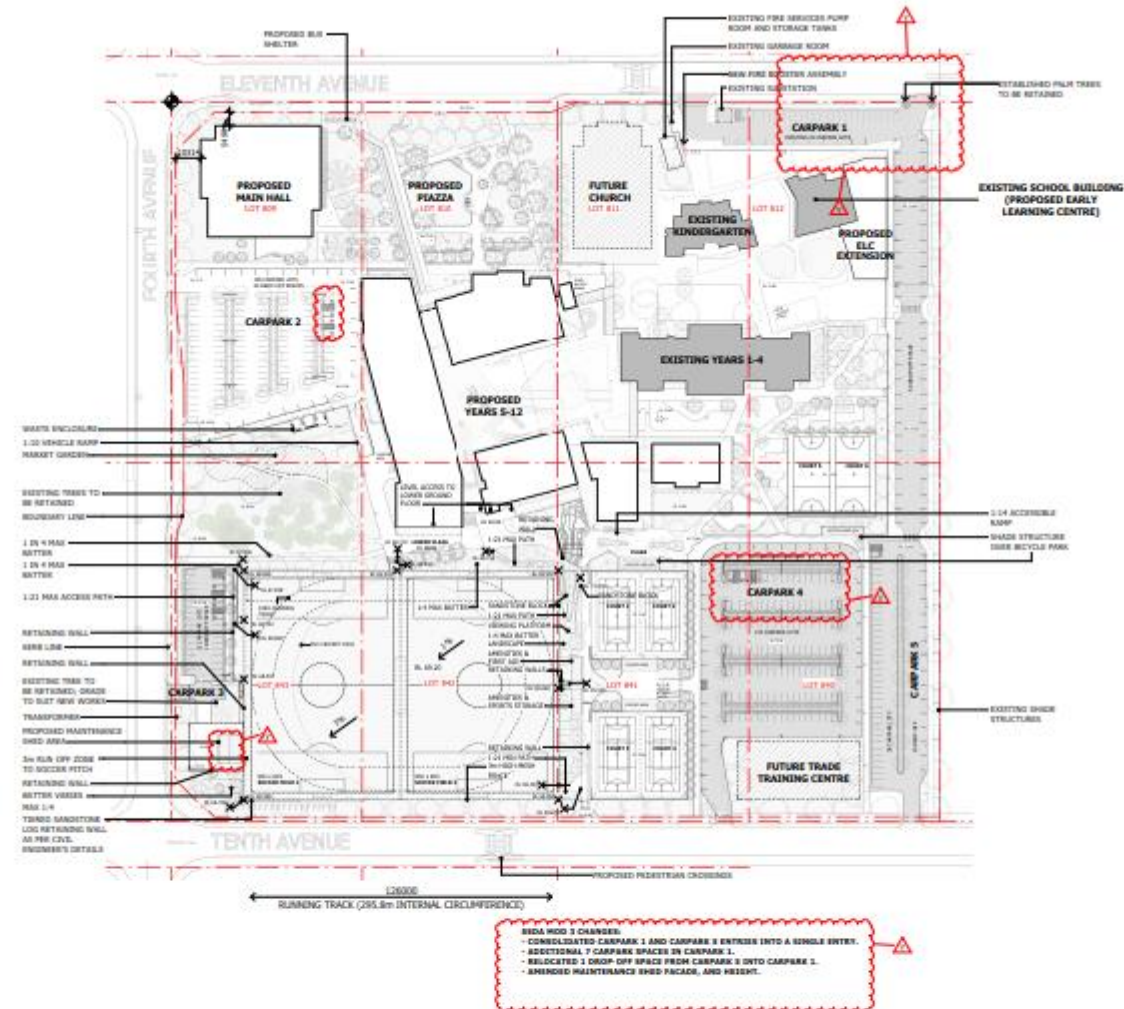

biochemical information derived from copyright and may not be reproduced without explicit prior permission.

NOTICE: All information contained on this and related web pages is disseminated in this form solely for the convenience of users.

Information on this website contains confidential information and/or information that is not to be distributed outside the organization.

Copyright © 2004 by the author(s). All rights reserved.

Reproduction of this document is prohibited without written permission of the author(s).



## DESIGN DEVELOPMENT

**NOT TO BE USED DURING CONSTRUCTION**

Index	Measurement	Units	Units	Unit
1	QUICK RESPONSE TIME (S)	100.000.000	100	100
2	QUICK RESPONSE TIME (S)	100.000.000	100	100
3	QUICK RESPONSE TIME (S)	100.000.000	100	100
4	QUICK RESPONSE TIME (S)	100.000.000	100	100
5	QUICK RESPONSE TIME (S)	100.000.000	100	100
6	QUICK RESPONSE TIME (S)	100.000.000	100	100
7	QUICK RESPONSE TIME (S)	100.000.000	100	100
8	QUICK RESPONSE TIME (S)	100.000.000	100	100
9	QUICK RESPONSE TIME (S)	100.000.000	100	100
10	QUICK RESPONSE TIME (S)	100.000.000	100	100
11	QUICK RESPONSE TIME (S)	100.000.000	100	100
12	QUICK RESPONSE TIME (S)	100.000.000	100	100
13	QUICK RESPONSE TIME (S)	100.000.000	100	100
14	QUICK RESPONSE TIME (S)	100.000.000	100	100
15	QUICK RESPONSE TIME (S)	100.000.000	100	100
16	QUICK RESPONSE TIME (S)	100.000.000	100	100
17	QUICK RESPONSE TIME (S)	100.000.000	100	100
18	QUICK RESPONSE TIME (S)	100.000.000	100	100
19	QUICK RESPONSE TIME (S)	100.000.000	100	100
20	QUICK RESPONSE TIME (S)	100.000.000	100	100

dwip  
www.dwp.com

Sydney Catholic Schools



140 ELEVENTH AVENUE, ALSTRAAL, 2179

ST ANTHONY OF PADUA  
CATHOLIC COLLEGE


CONCEPT PROPOSAL  
SITE PLAN

Page 1 of 1  
12/12/2023 9:12:48 AM







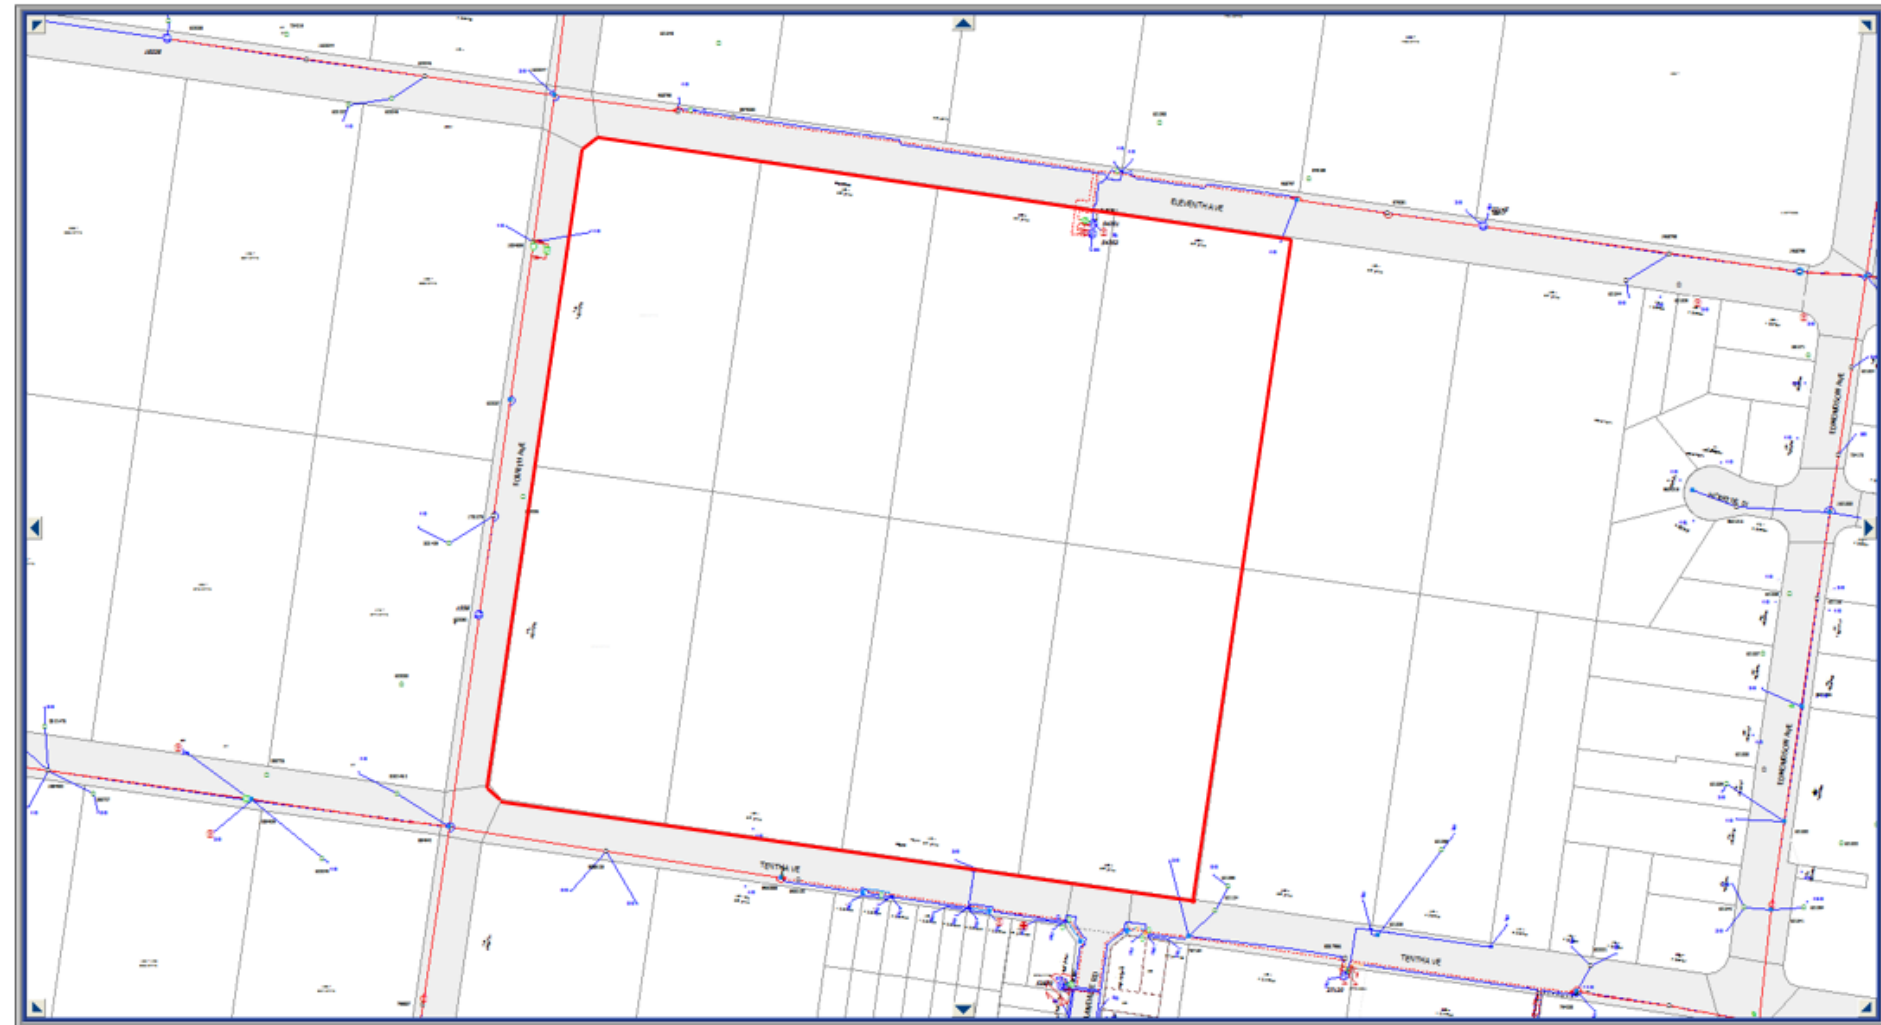


















19-0185  
AA0004



### Site Plan from Endeavour Energy's G/Net Master Facility Model



Please note the location, extent and type of any electricity infrastructure, boundaries etc. shown on the plan is indicative only. In addition it must be recognised that the electricity network is constantly extended, augmented and modified and there is a delay from the completion and commissioning of these works until their capture in the model. Easements benefitting Endeavour Energy are indicated by red hatching. Generally (depending on the scale and/or features selected), low voltage (normally not exceeding 1,000 volts) is indicated by blue lines and high voltage (normally exceeding 1,000 volts but for Endeavour Energy's network not exceeding 132,000 volts / 132 kV) by red lines (these lines can appear as solid or dashed and where there are multiple lines / cables only the higher voltage may be shown). This plan only shows the Endeavour Energy network and does not show electricity infrastructure belonging to other authorities or customers owned electrical equipment beyond the customer connection point / point of supply to the property. This plan does not constitute the provision of information on underground electricity power lines by network operators under Part 5E 'Protection of underground electricity power lines' of the *Electricity Supply Act 1995* (NSW).

LEGEND	
	Padmount substation
	Indoor substation
	Ground substation
	Kiosk substation
	Cottage substation
	Pole mounted substation
	High voltage customer substation
	Metering unit
	Switch station
	Indoor switch station
	Voltage regulator
	Customer connection point
	Low voltage pillar
	Streetlight column
	Life support customer
	Tower
	Pole
	Pole with streetlight
	Customer owned / private pole
	Cable pit
	Load break switch
	Recloser
	Proposed removed
	Easement
	Subject site