

**Development Application and Planning Proposal Review
NSW Planning Portal Concurrence and Referral**



Authority	Authority's Reference	Agency Concurrence and Referral	Authority Contact	Authority Notification	Submission Due	Submission Made
NSW Dept. of Planning & Environment	SSD-44034342		Megan Fu	25/05/2023	21/06/2023	28/05/2023

Address	Land Title
Westmead Hospital, Corner of Hawkesbury Road and Darcy Road, Westmead	Part Lot 1 DP 1194390

Scope of Development Application or Planning Proposal

Environmental Impact Statement (EIS) for the Westmead Integrated Mental Health Complex. Construction and operation of a new 10 storey Integrated Mental Health Complex at Westmead Hospital, including demolition, remediation, earthworks, tree removal, landscaping, services, access arrangements (including link bridge to ASB) and signage.

As shown in the below site plan from Endeavour Energy's G/Net master facility model:

In regard to the Proposed Building Site there are:

- No easements benefitting Endeavour Energy (active easements are indicated by red hatching).
- Endeavour Energy's Westmead Zone Substation is located to the east on the site which supplies Westmead Hospital as a high voltage customer.

Relevant / applicable clause numbers from Endeavour Energy's standard conditions for Development Application and Planning Proposal Review indicated by .

Condition	Advice	Clause No.	Issue	Detail
<input type="checkbox"/>	<input type="checkbox"/>	1	Adjoining Sites	Adjoining or nearby development / use should be compatible with the use of Endeavour Energy's sites.
<input type="checkbox"/>	<input type="checkbox"/>	2	Asbestos	Area identified or suspected of having asbestos or asbestos containing materials (ACM) present in the electricity network.
<input checked="" type="checkbox"/>	<input type="checkbox"/>	3	Asset Planning	Applicants should not assume adequate supply is immediately available to facilitate their proposed development.
<input type="checkbox"/>	<input type="checkbox"/>	4	Asset Relocation	Application must be made for an asset relocation / removal to determine possible solutions to the developer's requirements.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	5	Before You Dig	Before commencing any underground activity the applicant must obtain advice from the Before You Dig service.
<input type="checkbox"/>	<input type="checkbox"/>	6	Bush Fire	Risk needs to be managed to maintain the safety of customers and the communities served by the network.
<input type="checkbox"/>	<input type="checkbox"/>	7	Construction Management	Integrity of electricity infrastructure must be maintained and not impacted by vehicle / plant operation, excessive loads, vibration, dust or moisture penetration.
<input type="checkbox"/>	<input type="checkbox"/>	8	Contamination	Remediation may be required of soils or surfaces impacted by various forms of electricity infrastructure.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	9	Demolition	All electricity infrastructure shall be regarded as live and care must be taken to not interfere with any part of the electricity network.
<input type="checkbox"/>	<input type="checkbox"/>	10	Dispensation	If a proposal is not compliant with Endeavour Energy's engineering documents or standards, the applicant must request a dispensation.
<input type="checkbox"/>	<input type="checkbox"/>	11	Driveways	For public / road safety and to reduce the risk of vehicle impact, the distance of driveways from electricity infrastructure should be maximised.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	12	Earthing	The construction of any building or structure connected to or in close proximity to the electrical network must be properly earthed.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	13	Easement Management	Preference is for no activities to occur in easements and they must adhere to minimum safety requirements.
<input type="checkbox"/>	<input type="checkbox"/>	14	Easement Release	No easement is redundant or obsolete until it is released having regard to risks to its network, commercial and community interests.
<input type="checkbox"/>	<input type="checkbox"/>	15	Easement Subdivision	The incorporation of easements into to multiple / privately owned lots is generally not supported.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	16	Emergency Contact	Endeavour Energy's emergency contact number 131 003 should be included in any relevant risk and safety management plan.
<input type="checkbox"/>	<input type="checkbox"/>	17	Excavation	The integrity of the nearby electricity infrastructure shall not be placed at risk by the carrying out of excavation work.
<input type="checkbox"/>	<input type="checkbox"/>	18	Flooding	Electricity infrastructure should not be subject to flood inundation or stormwater runoff.
<input type="checkbox"/>	<input type="checkbox"/>	19	Hazardous Environment	Electricity infrastructure can be susceptible to hazard sources or in some situations be regarded as a hazardous source.
<input type="checkbox"/>	<input type="checkbox"/>	20	Modifications	Amendments can impact on electricity load and the contestable works required to facilitate the proposed development.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	21	Network Access	Access to the electricity infrastructure may be required at any time particularly in the event of an emergency.
<input checked="" type="checkbox"/>	<input type="checkbox"/>	22	Network Asset Design	Design electricity infrastructure for safety and environmental compliance consistent with safe design lifecycle principles.
<input checked="" type="checkbox"/>	<input type="checkbox"/>	23	Network Connection	Applicants will need to submit an appropriate application based on the maximum demand for electricity for connection of load.

Condition	Advice	Clause No.	Issue	Detail
<input type="checkbox"/>	<input type="checkbox"/>	24	Protected Works	Electricity infrastructure without an easement is deemed to be lawful for all purposes under Section 53 'Protection of certain electricity works' of the <i>Electricity Supply Act 1995</i> (NSW).
<input type="checkbox"/>	<input checked="" type="checkbox"/>	25	Prudent Avoidance	Development should avert the possible risk to health from exposure to emissions from electricity infrastructure such as electric and magnetic fields (EMF) and noise.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	26	Public Safety	Public safety training resources are available to help general public / workers understand the risk and how to work safely near electricity infrastructure.
<input type="checkbox"/>	<input type="checkbox"/>	27	Removal of Electricity	Permission is required to remove service / metering and must be performed by an Accredited Service Provider.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	28	Safety Clearances	Any building or structure must comply with the minimum safe distances / clearances for the applicable voltage/s of the overhead power lines.
<input type="checkbox"/>	<input type="checkbox"/>	29	Security / Climb Points	Minimum buffers appropriate to the electricity infrastructure being protected need to be provided to avoid the creation of climb points.
<input type="checkbox"/>	<input type="checkbox"/>	30	Service Conductors	Low voltage service conductors and customer connection points must comply with the 'Service and Installation Rules of NSW'.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	31	Solar / Generation	The performance of the generation system and its effects on the network and other connected customers needs to be assessed.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	32	Streetlighting	Streetlighting should be reviewed and if necessary upgraded to suit any increase in both vehicular and pedestrian traffic.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	33	Sustainability	Reducing greenhouse gas emissions and helping customers save on their energy consumption and costs through new initiatives and projects to adopt sustainable energy technologies.
<input type="checkbox"/>	<input type="checkbox"/>	34	Swimming Pools	Whenever water and electricity are in close proximity, extra care and awareness is required.
<input type="checkbox"/>	<input type="checkbox"/>	35	Telecommunications	Address the risks associated with poor communications services to support the vital electricity supply network Infrastructure.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	36	Vegetation Management	Landscaping that interferes with electricity infrastructure is a potential safety risk and may result in the interruption of supply.
Completed by:				Decision
Cornelis Duba				Approve (with conditions)

Cornelis Duba | Development Application Specialist

M 0455250981

E comelis.duba@endeavourenenergy.com.au

51 Huntingwood Drive, Huntingwood NSW 2148. Dharug Country

endeavourenenergy.com.au |    



Endeavour Energy respectfully acknowledges the Traditional Custodians on whose lands we live, work, and operate and their Elders past, present and emerging.

Reason(s) for Conditions / Decision (If applicable)

- As a high voltage customer the 'High Voltage Operational and Maintenance Protocol' between Endeavour Energy and the customer regarding the provision of high voltage supply to the site will specify a 'Load of Customers Installation' which is adequate for the then / Customer's current requirements. The Protocol generally also states the following:

'Should any further increase in loads be required, contact should be made with Endeavour Energy's Customer Network Solutions Branch, who will inform you of the requirements in this regard'.

The Protocol also identifies where Endeavour Energy's responsibility terminates (normally at the pole or pillar on the road verge from which supply is taken) in respect of:

- ownership of high voltage equipment;
 - switching operations; and
 - maintenance of equipment.
- The Infrastructure Management Plan Electrical Services prepared by Stantec Australia Pty Ltd dated 14 April 2023

2.2 Infrastructure Upgrades

2.2.1 Supply Authority / Utility

The existing Endeavour Energy Zone Substation 9563 has been recently upgraded. Further discussions with Endeavour Energy are being arranged by other consultants with regards to the Zone Substations capacity and future forecasted loads and developments around the precinct.

It is understood that HI/WSLHD are working with Endeavour Energy and are planning to augment the Westmead Zone Substation to provide a total substation capacity of 70MVA at 33kV or 80MVA at 132kV. This upgrade is currently being progressed and forecast to proceed prior 2024, however, targeting as early as 2023. The current status is that the proposed route has been agreed between WSLHD and Endeavour Energy. The proposed route will run past the future Children's Hospital at Westmead Multi-Storey Carpark which is currently under construction

Endeavour Energy Zone Substation 9563 provides supply to the privately owned Westmead Hospital Substation No. 1.

- Endeavour Energy's Asset Planning and Performance Branch has reviewed the Infrastructure Management Plan Electrical Services and provided the following advice.

Asset Planning and Performance Branch have been in discussions with representatives from Westmead Health Precinct on the expected upgrades and resulting load forecast across the Precinct, which includes the Integrated Mental Health Complex. Westmead Zone Substation is being upgraded to have a third 132 / 11 kilovolt (kV) transformer which will be directly connected to the hospital switchboard and supply hospital loads only. This is currently expected to be commissioned in mid-2025.
- The planting of large / deep rooted trees to near electricity infrastructure is opposed by Endeavour Energy. Existing trees which are of low ecological significance in proximity of electricity infrastructure should be removed and if necessary replaced by an alternative smaller planting. The landscape designer will need to ensure any planting near electricity infrastructure achieves Endeavour Energy's vegetation management requirements.
- Not all the conditions / advice marked may be directly or immediately relevant or significant to the Development Application. However, Endeavour Energy's preference is to alert proponents / applicants of the potential matters that may arise should development within closer proximity of the existing and/or required electricity infrastructure needed to facilitate the proposed development on or in the vicinity of the site occur.

Condition or Advice

With Endeavour Energy's Development Application and Planning Proposal Review process / system the intent of the 'Standard Conditions' being indicated as either a 'Condition' or 'Advice' essentially depends on the risk associated with the matter. If the matter is one that is likely or very likely to be an issue / needed to be addressed by the applicant and may require corrective action, then it is marked as a 'Condition'. If the matter is less likely and the consequences of the applicant not addressing it are lower or can be readily rectified, then it is marked as 'Advice'. If the matter is considered to be not applicable / relevant then it is not marked as either.


For example, the obtaining advice from the Before You Dig service in accordance with the requirements of the *Electricity Supply Act 1995* (NSW) and associated Regulations is a standard / regulatory requirement. It will be generally indicated as 'Advice'. If the Site Plan from Endeavour Energy's G/Net Master Facility Model indicates there is some uncertainty over the extent or location of the underground cables on or near the site, it would then be indicated as 'Condition' and require action to be undertaken by the applicant eg. the use of an underground asset locating device or a certified locator to verify the asset location.

Decision

In the NSW Planning Portal for the 'Agency response', as Endeavour Energy is not a concurring authority under the provision of the *Environmental Planning and Assessment Act 1979* (NSW), it does not 'Approve' or 'Refuse' a Development Application in the Portal. It will 'Approve (with conditions)' (which may 'Object' in the submission and detail the matters requiring resolution), or if all the matters in the submission are marked as for 'Advice', the outcome of the assessment will also be 'Advice'.

Further Advice

The 'Standard Conditions' include additional advice and contact details and further information is also available on Endeavour Energy's website at <https://www.endeavourenergy.com.au/> .

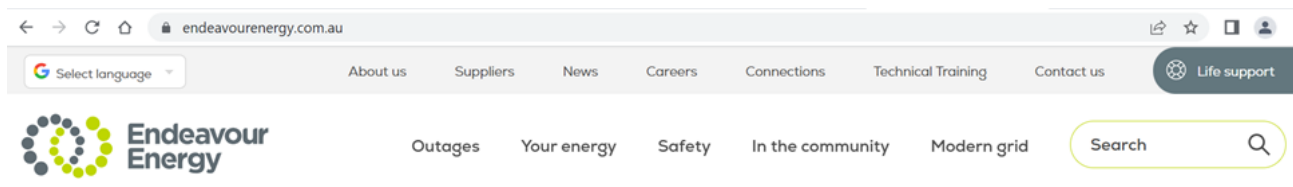

The following contacts can be reached by calling Endeavour Energy via Head Office enquiries on business days from 9am - 4:30pm on telephone: 133 718 or (02) 9853 6666.

Branch / Section	Matters	Email
Customer Network Solutions	Electricity supply or asset relocation who are responsible for managing the conditions of supply with the applicant and their Accredited Service Provider (ASP).	cicadmin@endeavourenergy.com.au
Easement Officers	Easement management or protected works / assets.	Easements@endeavourenergy.com.au
Property	Property tenure eg. the creation or release of easements.	network_property@endeavourenergy.com.au
Field Operations (to the relevant Field Service Centre).	Safety advice for building or working near electrical assets in public areas (including zone and transmission substations).	Construction.Works@endeavourenergy.com.au

Please note Endeavour Energy's above contacts do not have access to the NSW Planning Portal. To resolve any matters direct contact should be made with the responsible contact. This will avoid double handling and possible delays in responding to the applicant / Council.


Details of the Accredited Service Provider (ASP) Scheme which accredits organisations to perform contestable work on the NSW electricity distribution network are available via the following link to the Energy NSW website at <https://www.energysaver.nsw.gov.au/get-energy-smart/dealing-energy-providers/installing-or-altering-your-electricity-service> .

Extract of Environmental Impact Statement



<p>Scale: 1:1000</p> <p>North Arrow</p>	<p>PROBABILITY</p> <p>THE INFORMATION CONTAINED IN THIS DOCUMENT IS FOR INFORMATIONAL PURPOSES ONLY. IT IS NOT INTENDED TO BE USED FOR ANY OTHER PURPOSE.</p>	<p>Stantec</p> <p>Copyright Stantec</p>	<p>Project Logo</p> <p>NSW Health Infrastructure</p> <p>Westmead Integrated Mental Health Complex</p>	<p>Site</p> <p>SITE PLAN</p> <p>EXISTING ENDEAVOUR ENERGY ZONE SUBSTATION LOCATION AND PROPOSED BUILDING SITE</p> <p>Project No: 3010023W</p> <p>Scale: A10</p> <p>Revision: A</p> <p>Drawing No: EL-SK-HV-001</p>	
---	--	--	--	--	--


Site Plan from Endeavour Energy's G/Net Master Facility Model

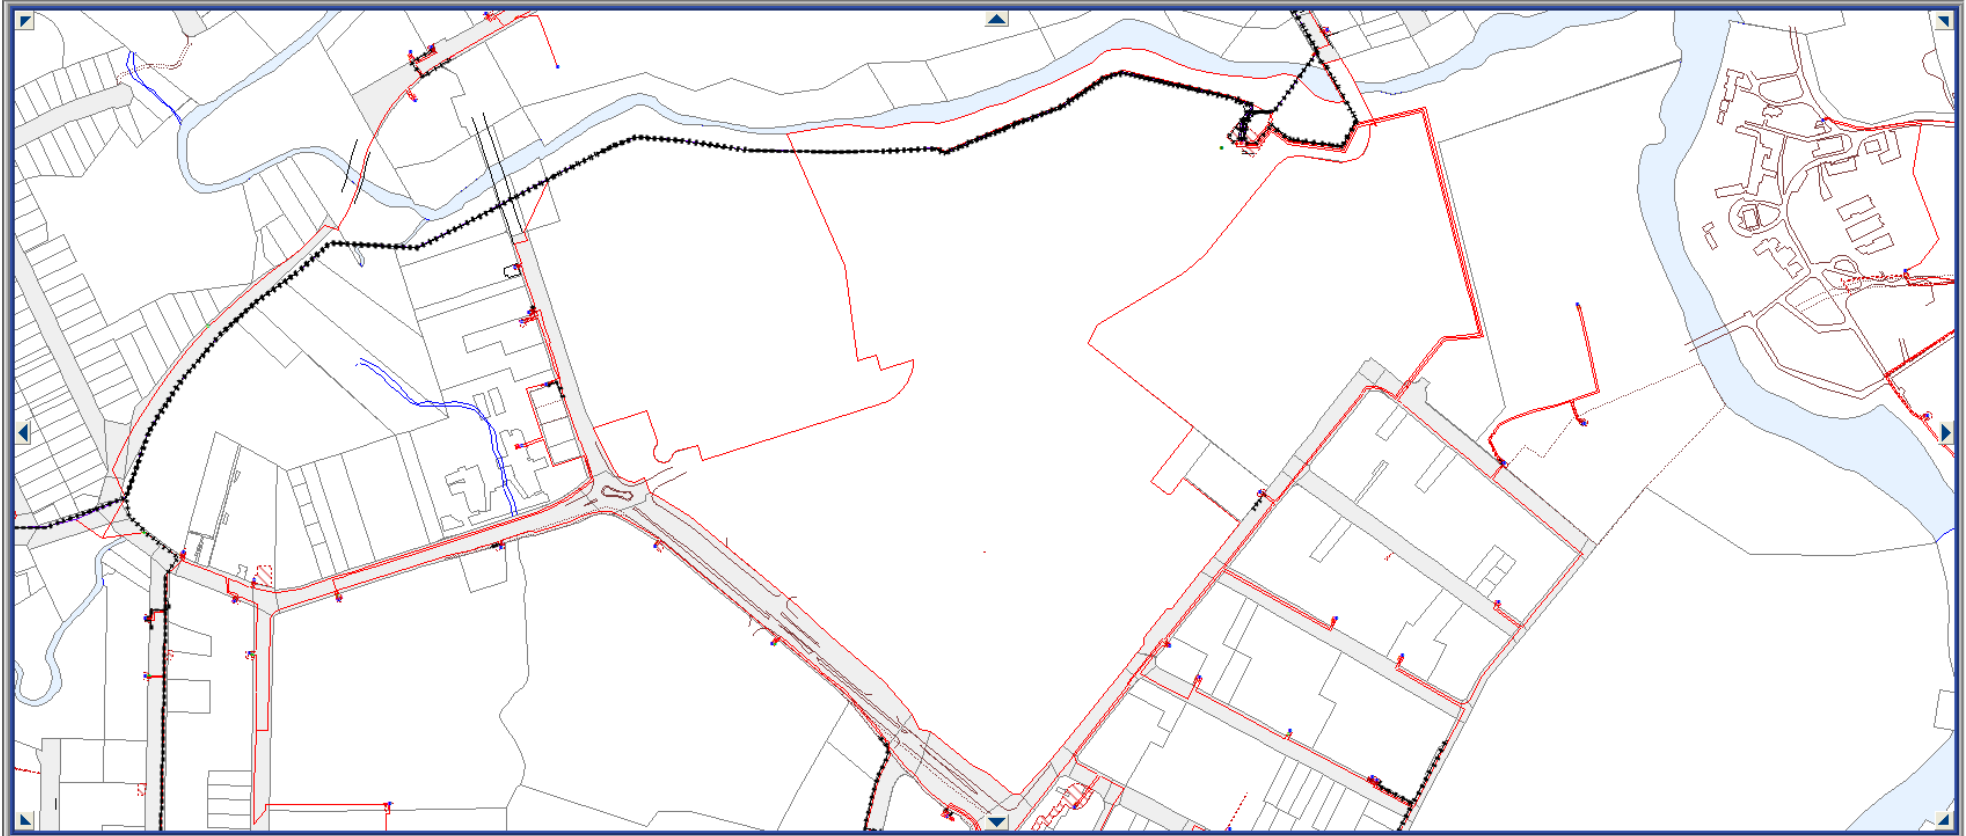







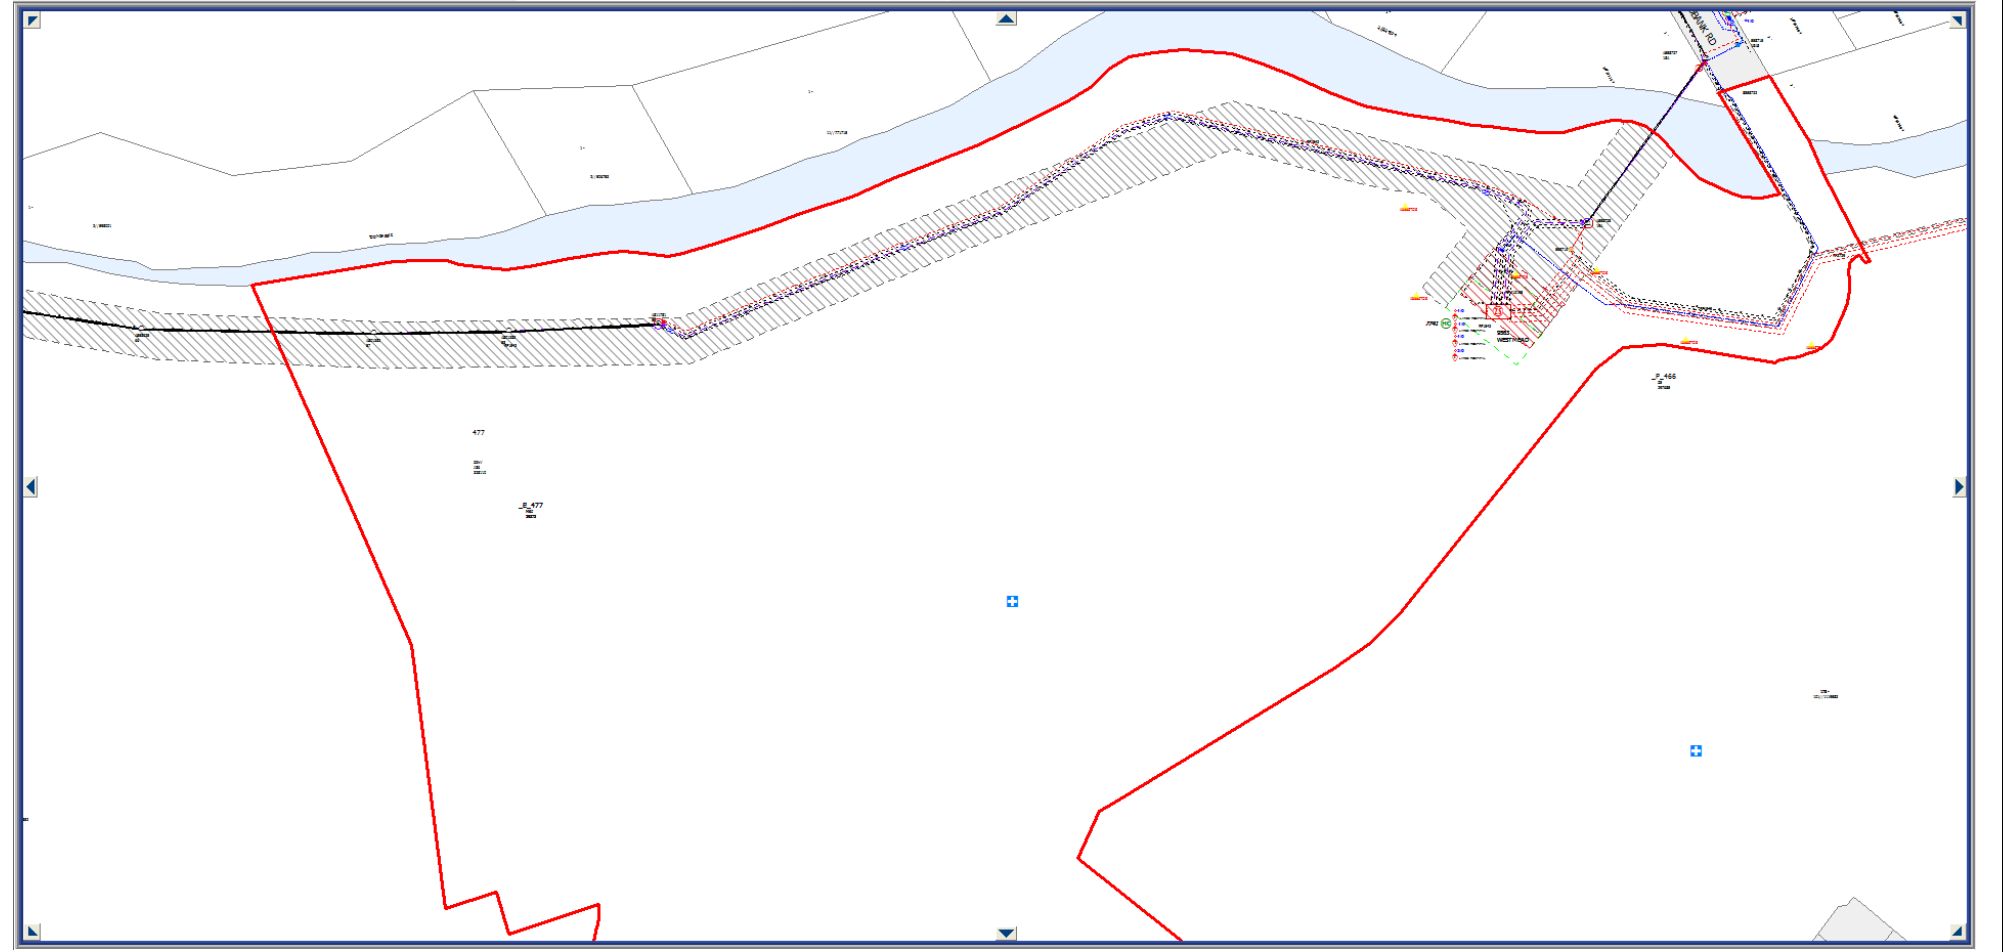


















G3E_FID	Feature Name	Component Name	G3E_CID	G3E_ID	LOT	SECTION	DP
79753145	Crown Parcel	Crown Parcel Find	1	2177760	1		1194390

Please note the location, extent and type of any electricity infrastructure, boundaries etc. shown on the plan is indicative only. In addition it must be recognised that the electricity network is constantly extended, augmented and modified and there is a delay from the completion and commissioning of these works until their capture in the model. Easements benefitting Endeavour Energy are indicated by red hatching. Generally (depending on the scale and/or features selected), low voltage (normally not exceeding 1,000 volts) is indicated by blue lines and high voltage (normally exceeding 1,000 volts but for Endeavour Energy's network not exceeding 132,000 volts / 132 kV) by red lines (these lines can appear as solid or dashed and where there are multiple lines / cables only the higher voltage may be shown). This plan only shows the Endeavour Energy network and does not show electricity infrastructure belonging to other authorities or customers owned electrical equipment beyond the customer connection point / point of supply to the property. This plan does not constitute the provision of information on underground electricity power lines by network operators under Part 5E 'Protection of underground electricity power lines' of the *Electricity Supply Act 1995* (NSW).

Site Plan from Endeavour Energy's G/Net Master Facility Model



LEGEND	
	Padmount substation
	Indoor substation
	Ground substation
	Kiosk substation
	Cottage substation
	Pole mounted substation
	High voltage customer substation
	Metering unit
	Switch station
	Indoor switch station
	Voltage regulator
	Customer connection point
	Low voltage pillar
	Streetlight column
	Life support customer
	Tower
	Pole
	Pole with streetlight
	Customer owned / private pole
	Cable pit
	Load break switch
	Recloser
	Proposed removed
	Easement
	Subject site

Google Maps Street View. Westmead Zone Substation to the left.

