

EMIRATES LUXURY RESORT

WOLGAN VALLEY

FIRE PROTECTION SERVICES

DRAWING LIST:

DWG	TITLE	SERVICE
F-000	COVER SHEET	FIRE PROTECTION SERVICES
F-100	MAIN BUILDING SERVICE FLOOR PLAN	FIRE PROTECTION SERVICES
F-101	MAIN BUILDING LOWER FLOOR PLAN	FIRE PROTECTION SERVICES
F-102	MAIN BUILDING UPPER FLOOR PLAN	FIRE PROTECTION SERVICES
F-103	STAFF COMMUNAL BUILDING PLAN	FIRE PROTECTION SERVICES

LINETYPES:

	RANGES
	MAIN

SYMBOLS:

	EXPOSED SPRINKLER HEAD
	BELOW CEILING SPRINKLER HEAD
	ABOVE CEILING CONCEALED SPRINKLER HEAD
	ALARM VALVE
	SPRINKLER JACKING PUMP
	FLOW SWITCH



NOTES:

01. ALL MATERIALS AND INSTALLATION SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF THE RELEVANT AUTHORITIES.
02. CONTRACTOR TO VERIFY ALL DIMENSIONS ON SITE BEFORE COMMENCING ANY WORK.
03. THESE DRAWINGS SHALL BE READ IN CONJUNCTION WITH ARCHITECTURAL, ELECTRICAL, HYDRAULIC AND MECHANICAL DRAWINGS.
04. THE FIRE SPRINKLER LAYOUT SHOWN IS INDICATIVE ONLY. THE FINAL CO-ORDINATION OF THE SPRINKLER LAYOUT SHALL REMAIN THE RESPONSIBILITY OF THE CONTRACTOR. CO-ORDINATE THE SPRINKLER LAYOUT WITH OTHER TRADES AND BUILDER.
05. ALL SPRINKLER PIPEWORK TO BE KEPT TIGHT TO THE SOFFIT OF SLAB OVER.
06. ALL SPRINKLERS TO BE GLASS BULB TYPE WITH SEMI-RECESSED ESCUTCHEON. SUBMIT SAMPLES FOR APPROVAL PRIOR TO ORDERING EQUIPMENT.
07. ALLOW FOR AN ADDITIONAL TWENTY (20) BELOW CEILING SPRINKLER HEADS (FULLY CONCEALED) FOR CO-ORDINATION PURPOSES.
08. ALLOW FOR AN ADDITIONAL TWENTY (20) EXPOSED SPRINKLER HEADS FOR CO-ORDINATION PURPOSES.
09. SUBMIT FULLY CO-ORDINATED WORKSHOP DRAWINGS FOR APPROVAL PRIOR TO ORDERING EQUIPMENT.

PRELIMINARY ISSUE

NOTE : SYMBOLS ARE DRAWN IN THE CORRECT POSITION BUT ARE NOT SHOWN TO SCALE

Issue	Date	Amendment	Int.	App.
1	20.10.06	TENDER REVIEW	ER	DC

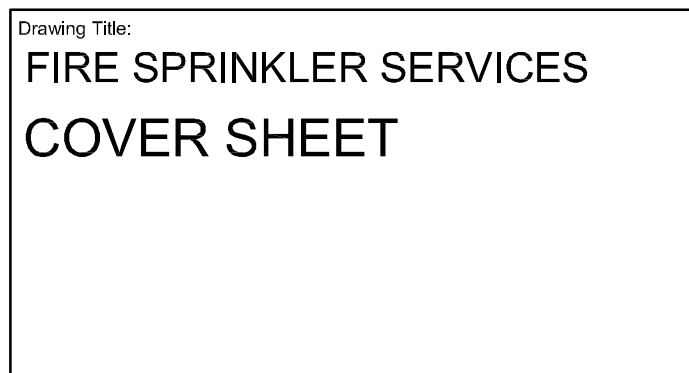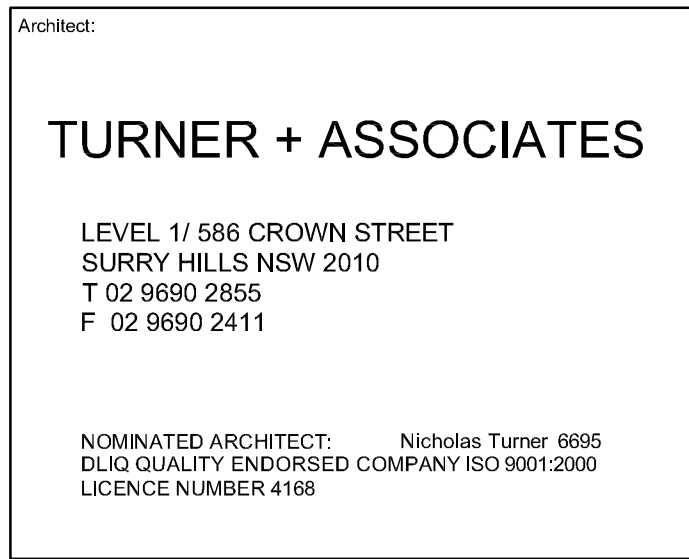

North Point:		Design:	
		ED REA	
		Design Validated:	
		DARREN CAMPBELL	
		Amendment Approved:	
		Drawn:	
		HERBERT XIA	
Date:	Scale:		
AUGUST 2006	(A1) NTS (A3)		
Job No:	Disc:	Dwg No:	Stage:
S05066	- F	- 000	- PR - 1

ORIGINAL SIZE A1