



TYPICAL SHARED TRENCH ARRANGMENT

NOTE:  
 AUTHORITY CONDUITS SHALL BE IN ACCORDANCE WITH THE RELEVANT AUTHORITY REQUIREMENTS & STANDARDS. REFER TO THE FOLLOWING FOR DETAILS:  
 - TELSTRA - DOCUMENT NO. 017153a07 (TELSTRA'S LEAD-IN TRENCHING REQUIREMENTS)  
 - ENERGY AUSTRALIA - NS130 (SPECIFICATION FOR LAYING OF UP TO 22kV UNDERGROUND CABLES)  
 - GAS - MIS 004884 (NATURAL GAS DEVELOPER PROVIDED TRENCH REQUIREMENTS)

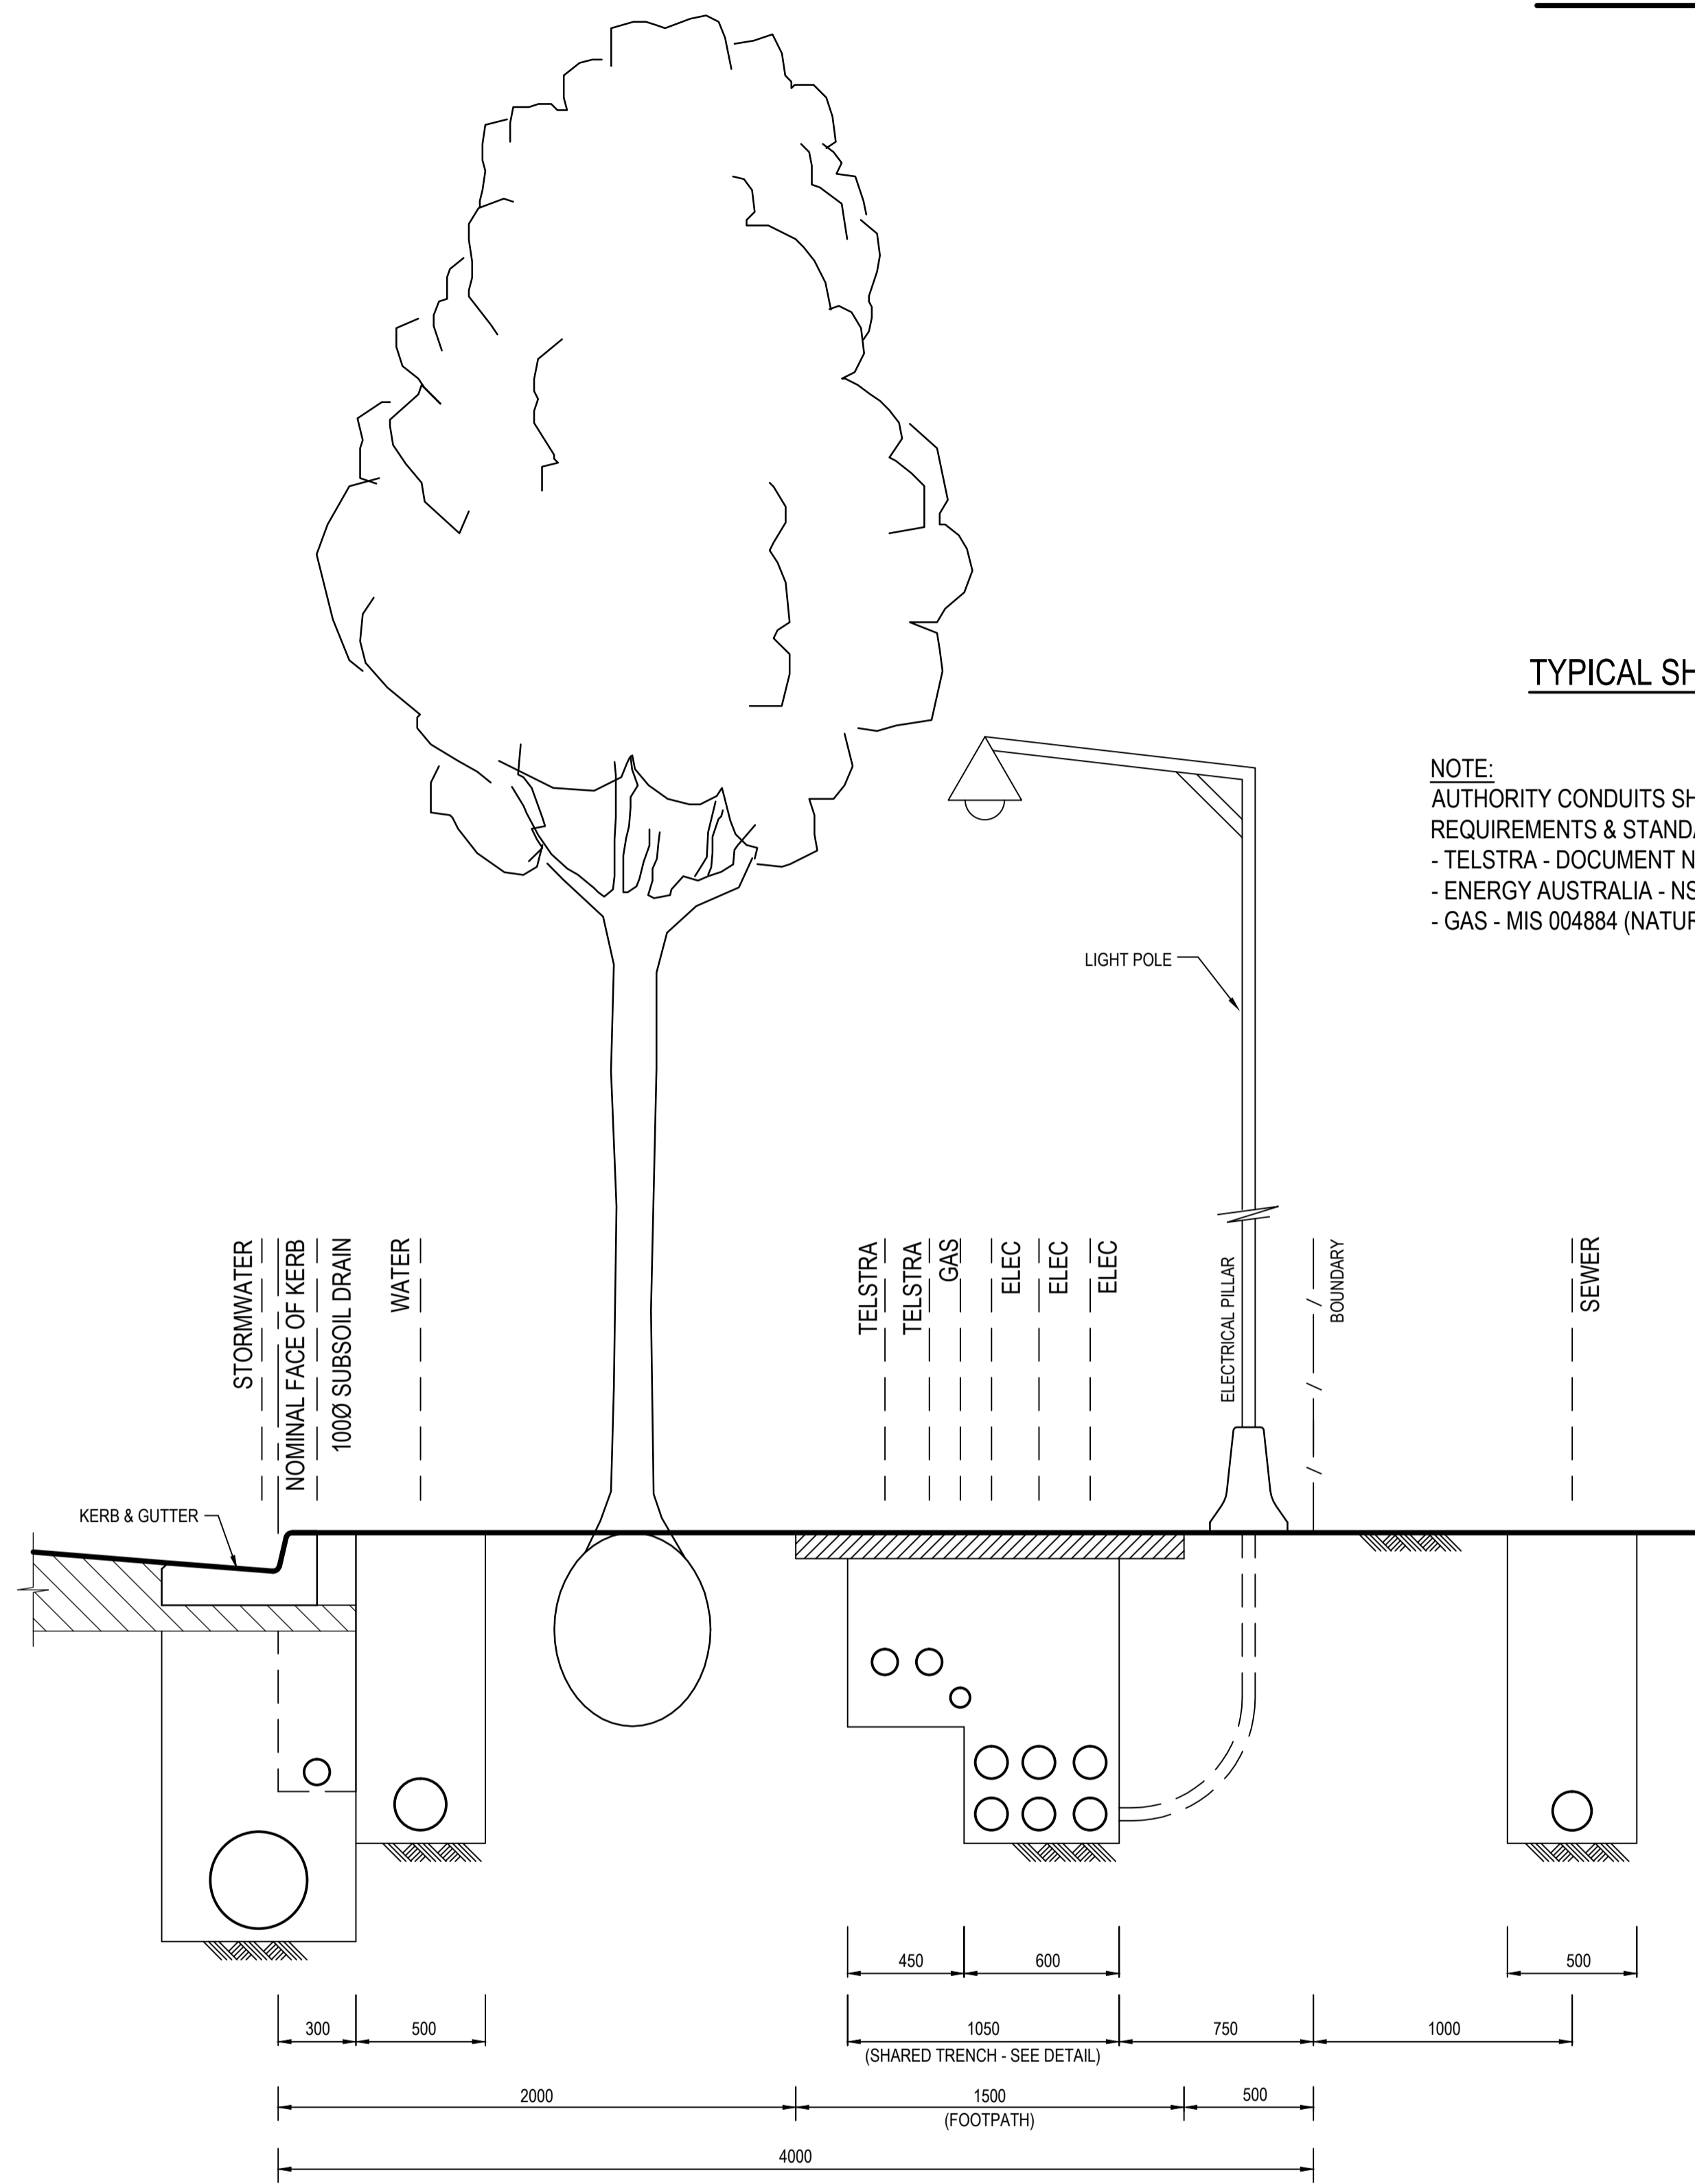

TYPICAL FOOTWAY - ROAD 5  
 NOT TO SCALE

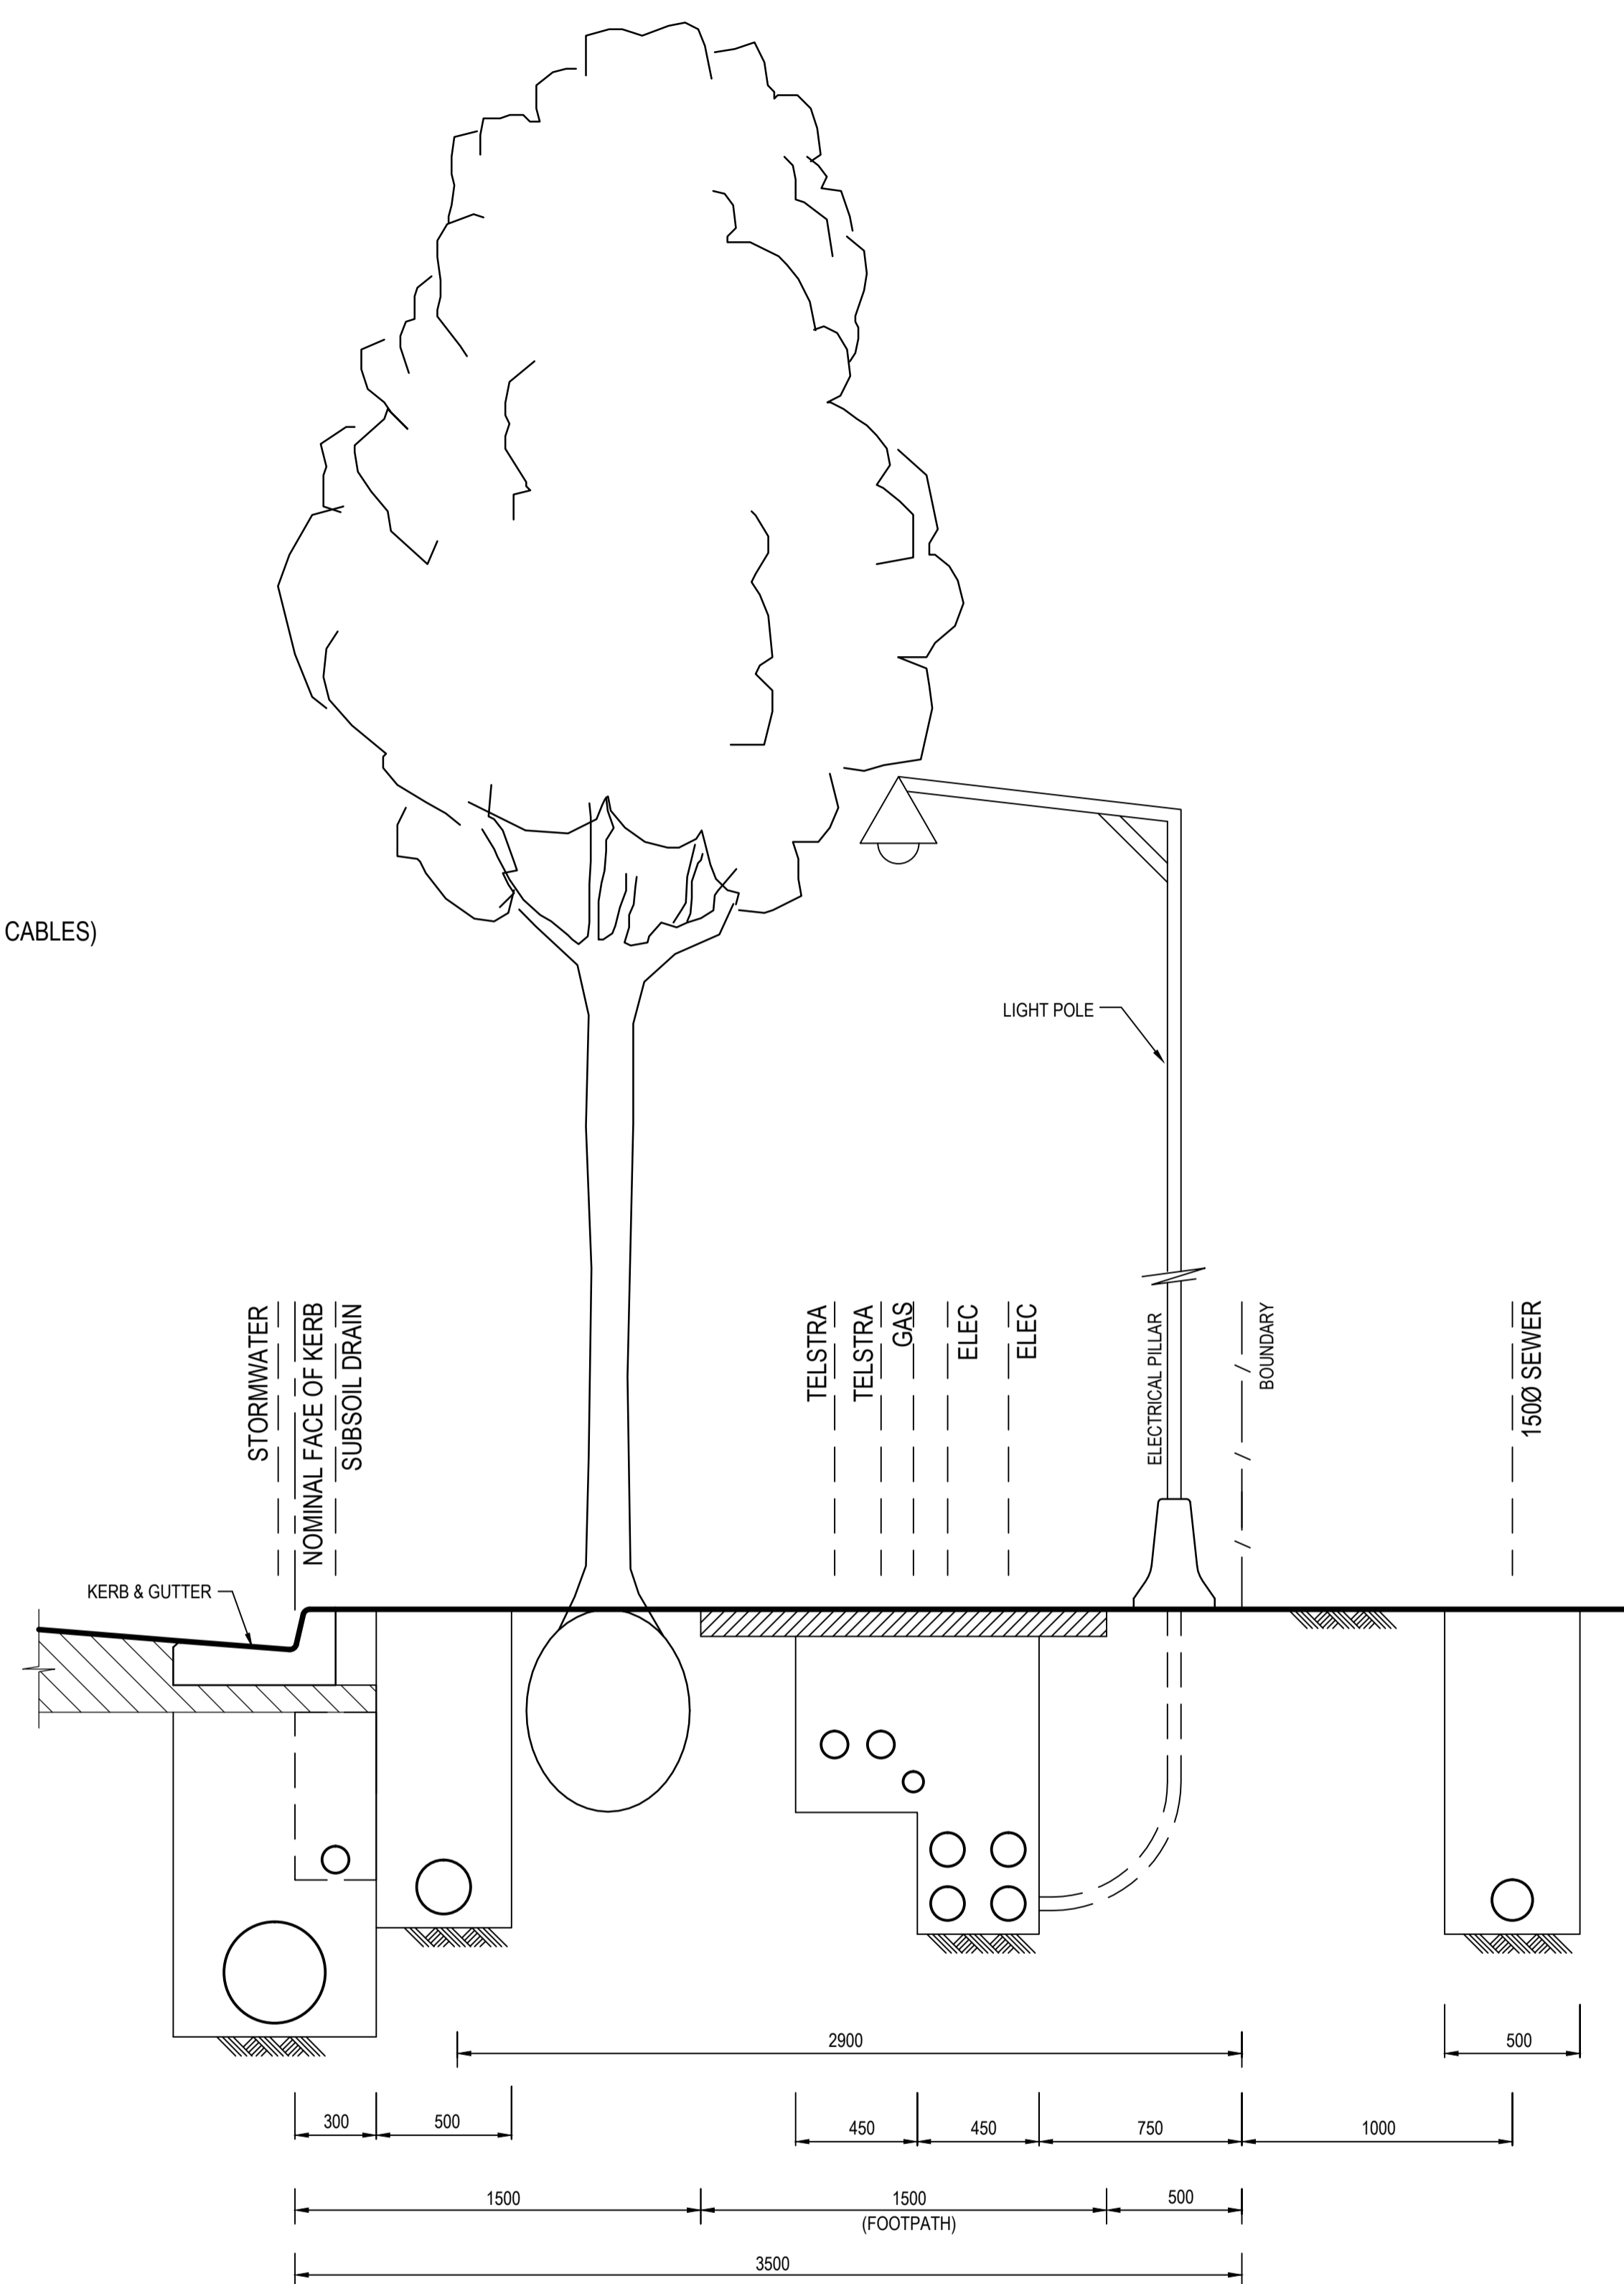

TYPICAL FOOTWAY - ROAD 4  
 NOT TO SCALE

REV	DESCRIPTION	BY	APP	DATE
A	DRAFT CC ISSUE	RL	LD	03-09-10
B	CC ISSUE	RL	PD	08-09-10
D	REVISED FOR CONSTRUCTION CERTIFICATE	RL	LD	24-09-10
E	FOR INFORMATION	RL	LD	22-12-10
F	FOR SECTION 75W	RL	DB	04-03-11
G	FOR SECTION 75W	RL	DB	10-03-11
00	ISSUED FOR CONSTRUCTION	RL	DB	20-04-11

Level 4, 66 Clarence Street  
 Sydney NSW 2000  
 Telephone: (02) 9699 3088  
 Fax: (02) 9319 7508  
 www.mehardtgroup.com  
 A.C.N. 951 627 591  
 © Copyright

**MEINHARDT**  
 INFRASTRUCTURE  
 & ENVIRONMENT

CLIENT FRASERS PUTNEY PTY LTD			
DESIGNED	DRAWN	APPROVED	SCALE @ A1
LD	RL	PD	-
STATUS FOR CONSTRUCTION			

PROJECT FRASERS PUTNEY RESIDENTIAL DEVELOPMENT		NORTH
CHARLES STREET, RYDE		
ROADS 4 & 5 WORKS		REV 00
TITLE TYPICAL SECTIONS - SHEET 2	PROJECT No 104479-00-MIE072	
DRAWING No		

DWG FILE: K:\104479 - Putney Green (Fraser)\66MIS\_3.MHT.MIE072.dwg - MHT PLOT TIME: 20 Apr 2011 5:05pm