


Munmorah Power Station Rehabilitation Environmental Assessment


FIGURE 4: Colongra Power Station - Stability Class F (Adverse)



U:\GIS\Project-2\project\Munmorah\mmea_fig_combined Stability Class A.mxd\41442-002-01-02\01-10-09\KAD\Rev 0

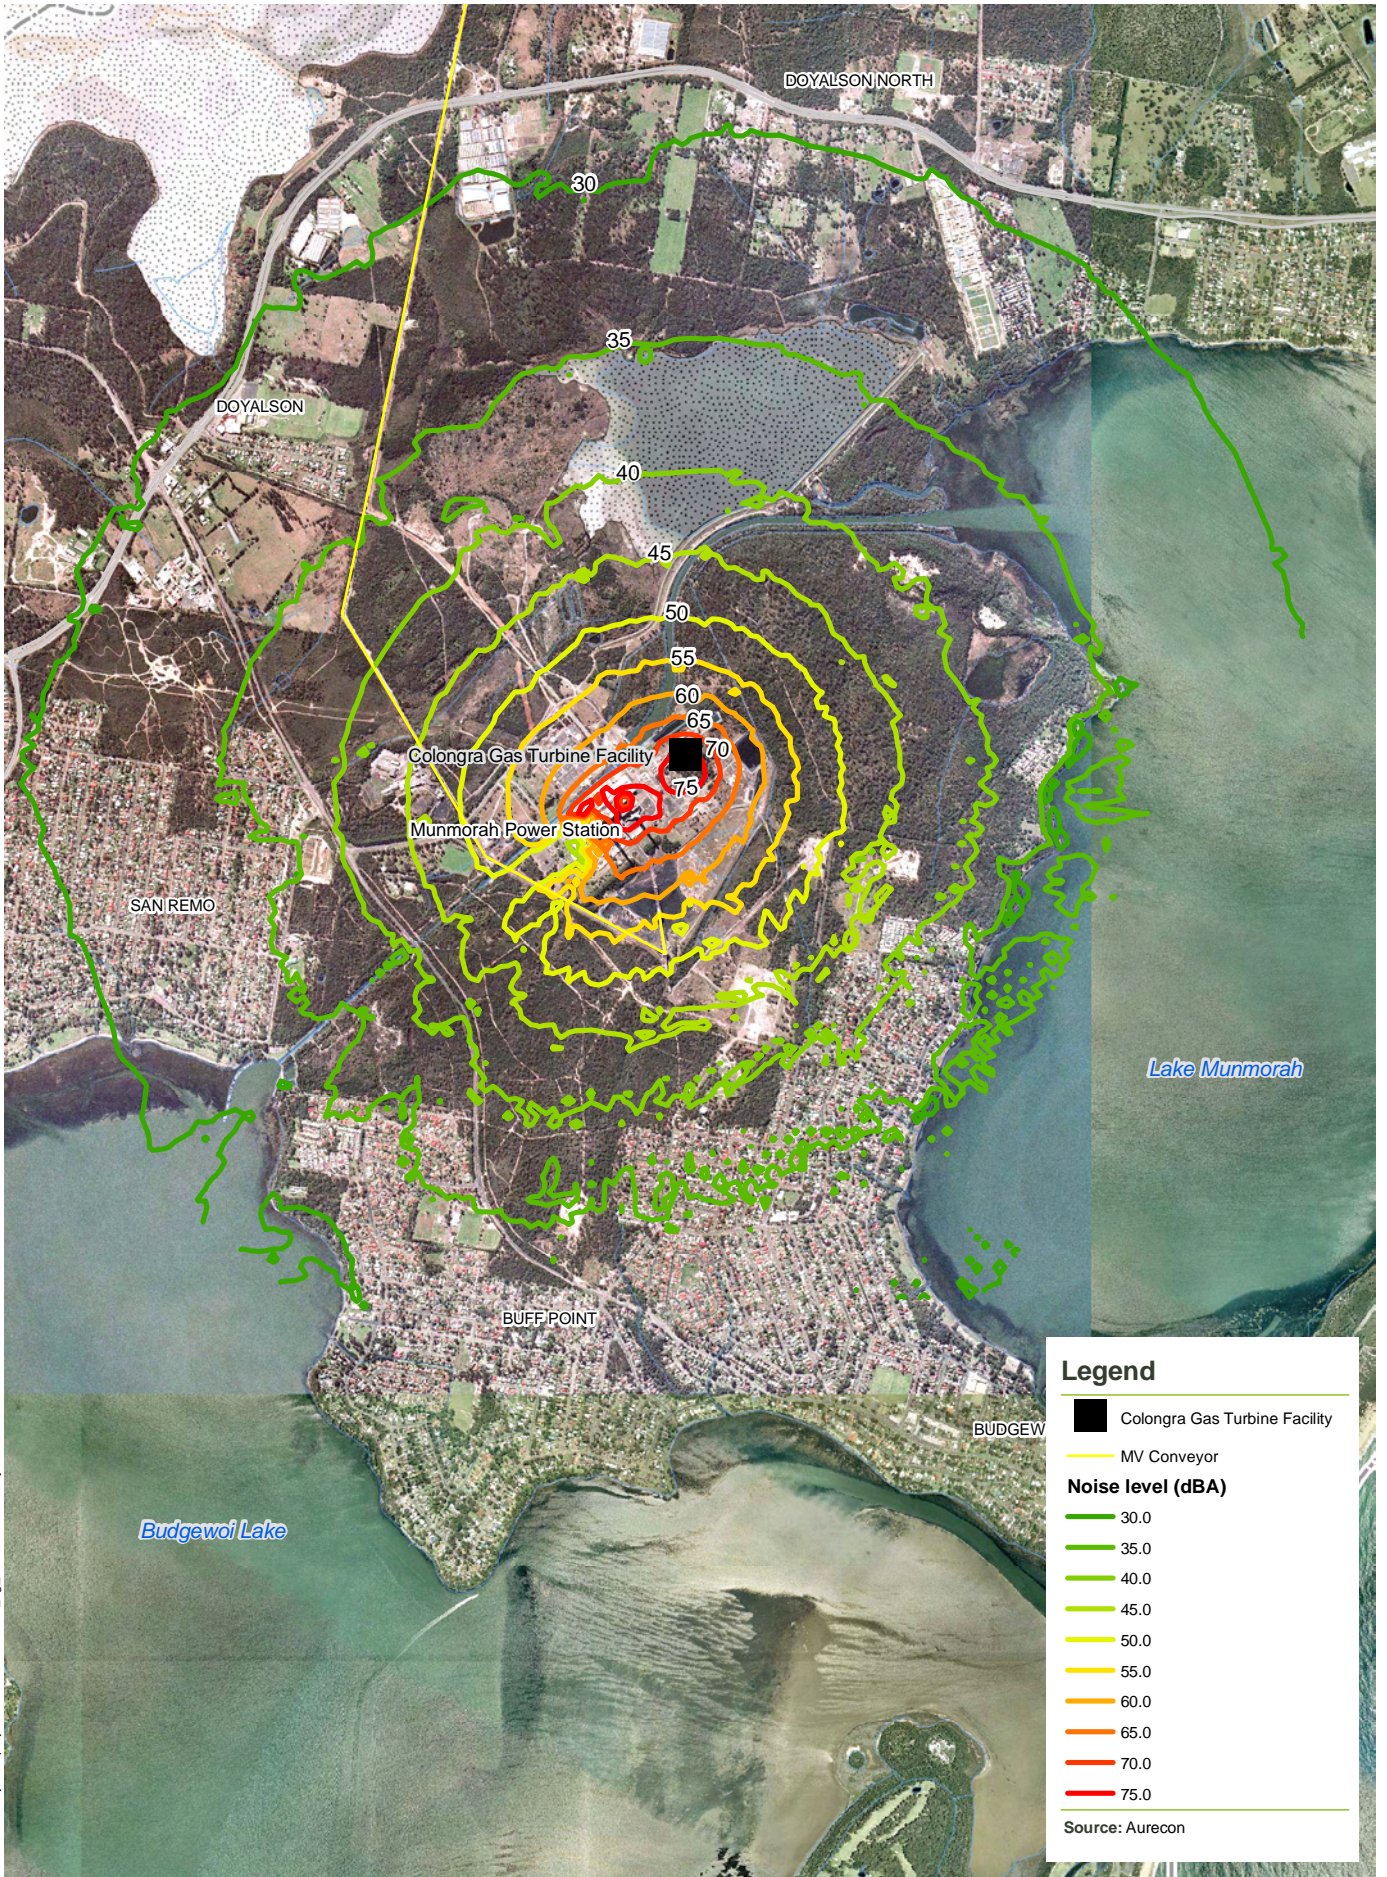


SCALE 1:30,000 @ A4



Projection: MGA

Munmorah Power Station **Rehabilitation Environmental Assessment**

FIGURE 5: Combined Colongra Power Station and Munmorah Power Station - Stability Class A (Neutral)

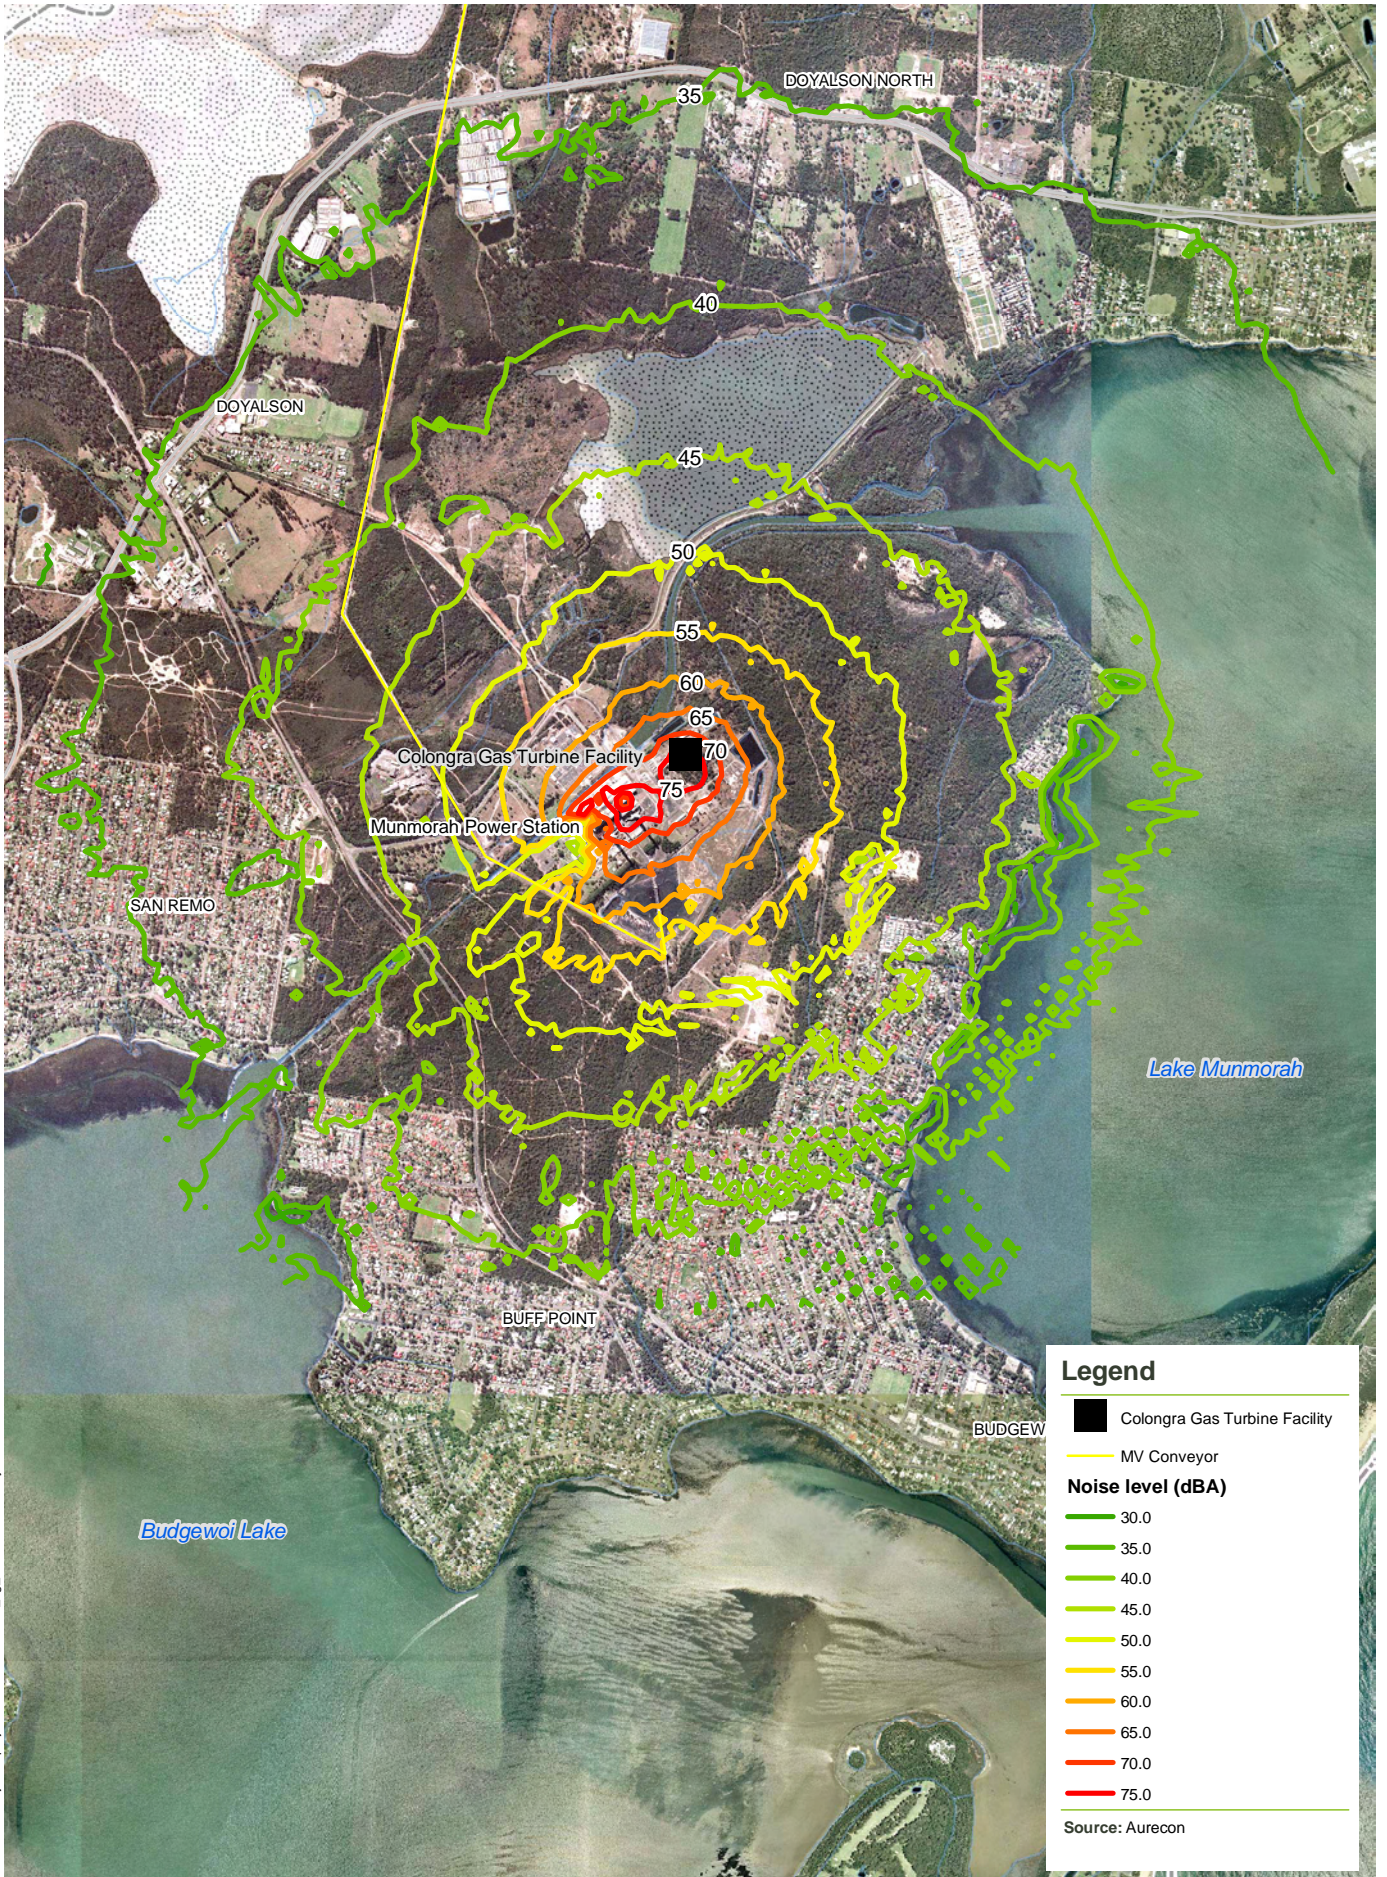

U:\GIS\Project-2\project\Munmorah\mmea_fig_combined Stability Class F.mxd\k1442-002-01-02\01-10-09\KAD\Rev 0

Legend

- Colongra Gas Turbine Facility
- MV Conveyor

Noise level (dBA)

- 30.0
- 35.0
- 40.0
- 45.0
- 50.0
- 55.0
- 60.0
- 65.0
- 70.0
- 75.0

Source: Aurecon

SCALE 1:30,000 @ A4
Projection: MGA

Munmorah Power Station **Rehabilitation Environmental Assessment**

FIGURE 6: Combined Colongra Power Station and Munmorah Power Station - Stability Class F (Adverse)