




12m³ OSD tank for extreme conditions & when low occupancy of building reduces the non-potable water supply demand. Refer to Note 2.

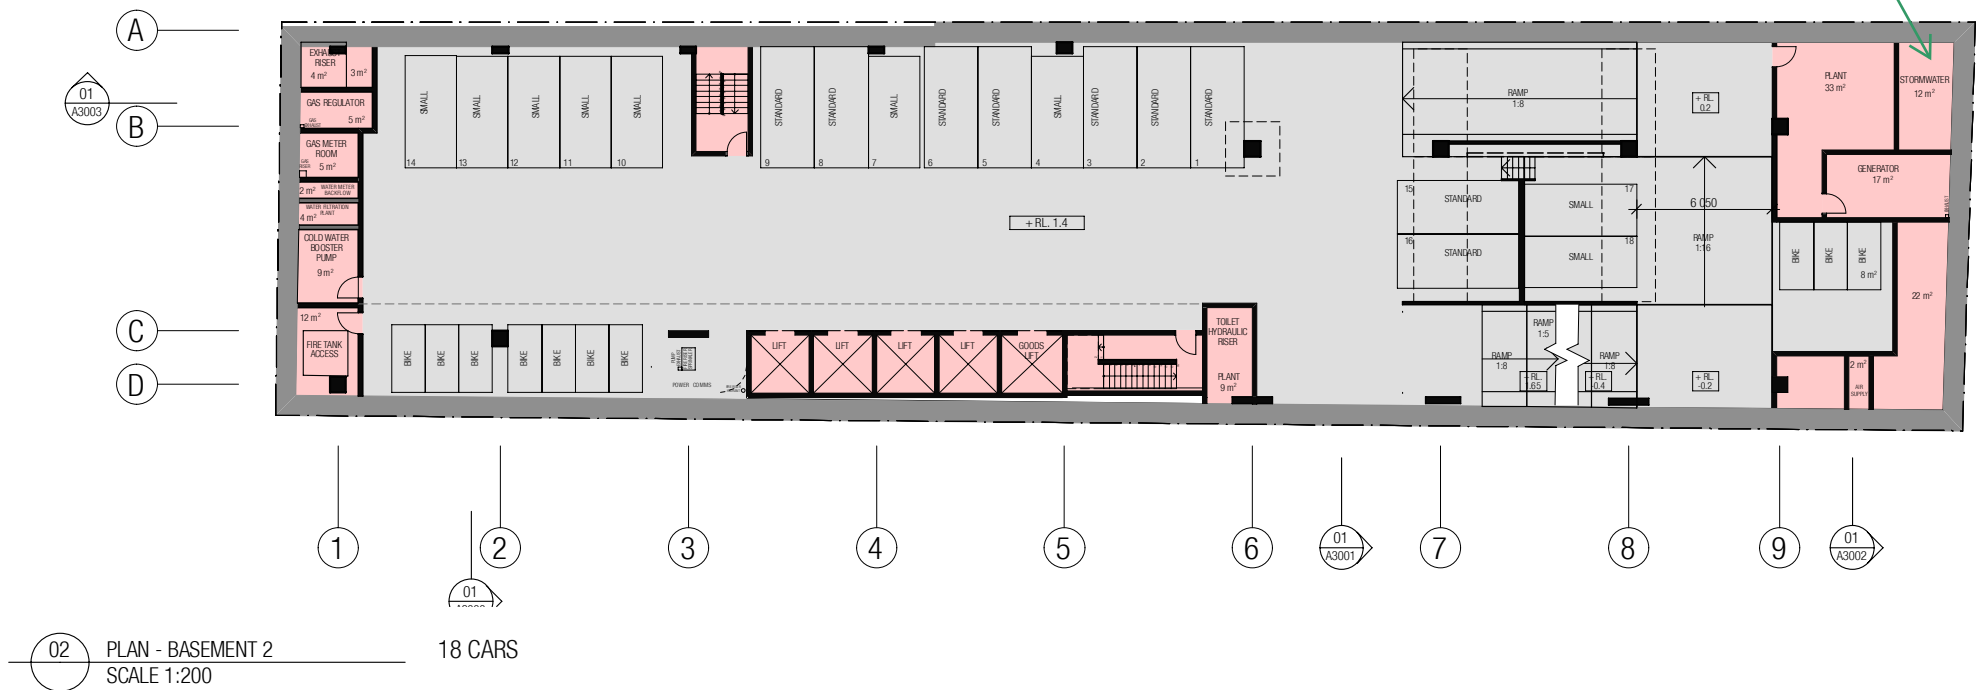

Water treatment & filtration of the non-potable cold water supply. Serving WC flushing system with auto changeover to potable water supply.

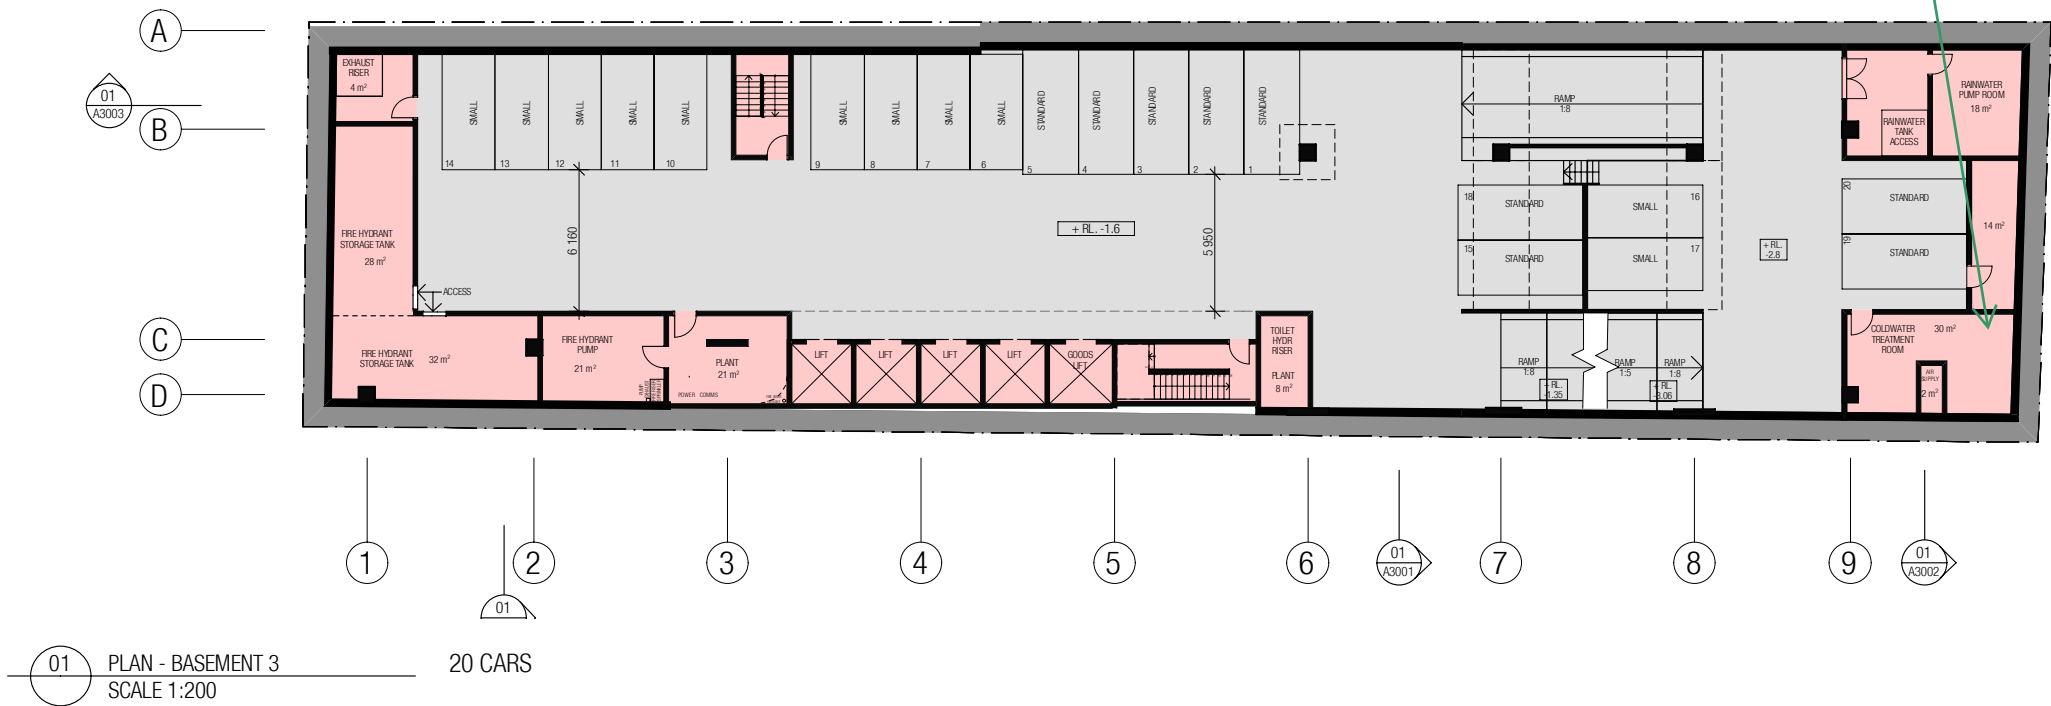


Rainwater harvesting.
40m³ rainwater storage capacity.
Refer to Note 1 & 3.

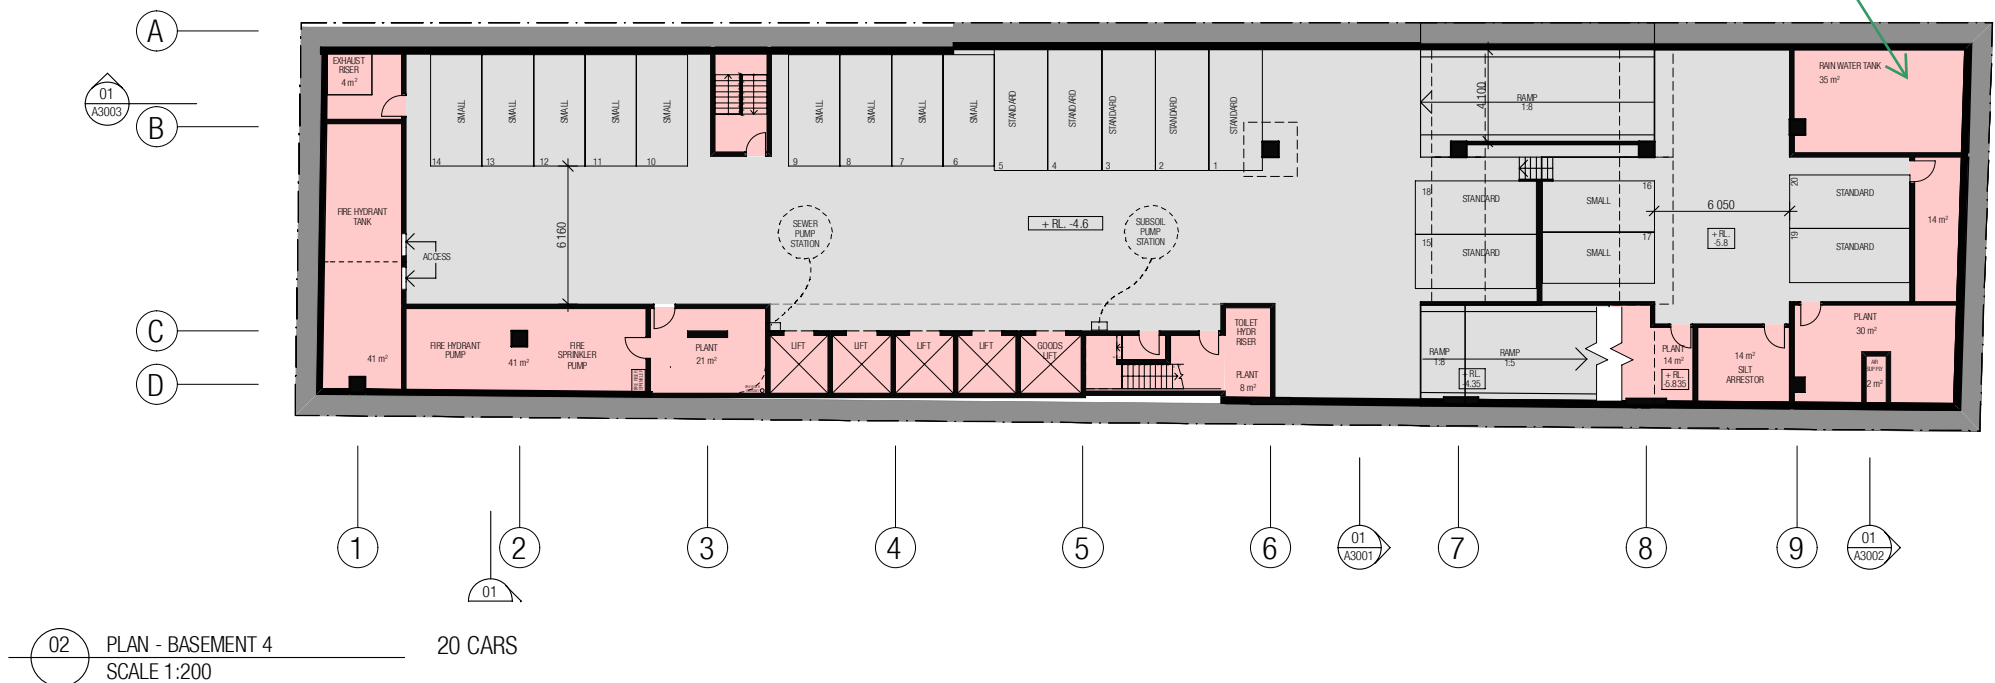

NOTES

1. Assessment based on 10,000 litres / day non-potable water demand
2. Reduction of 80% runoff to the public stormwater drainage system
3. WC flushing used from rainwater harvesting: Roof area provides approx. 32% of water required for WC flushing

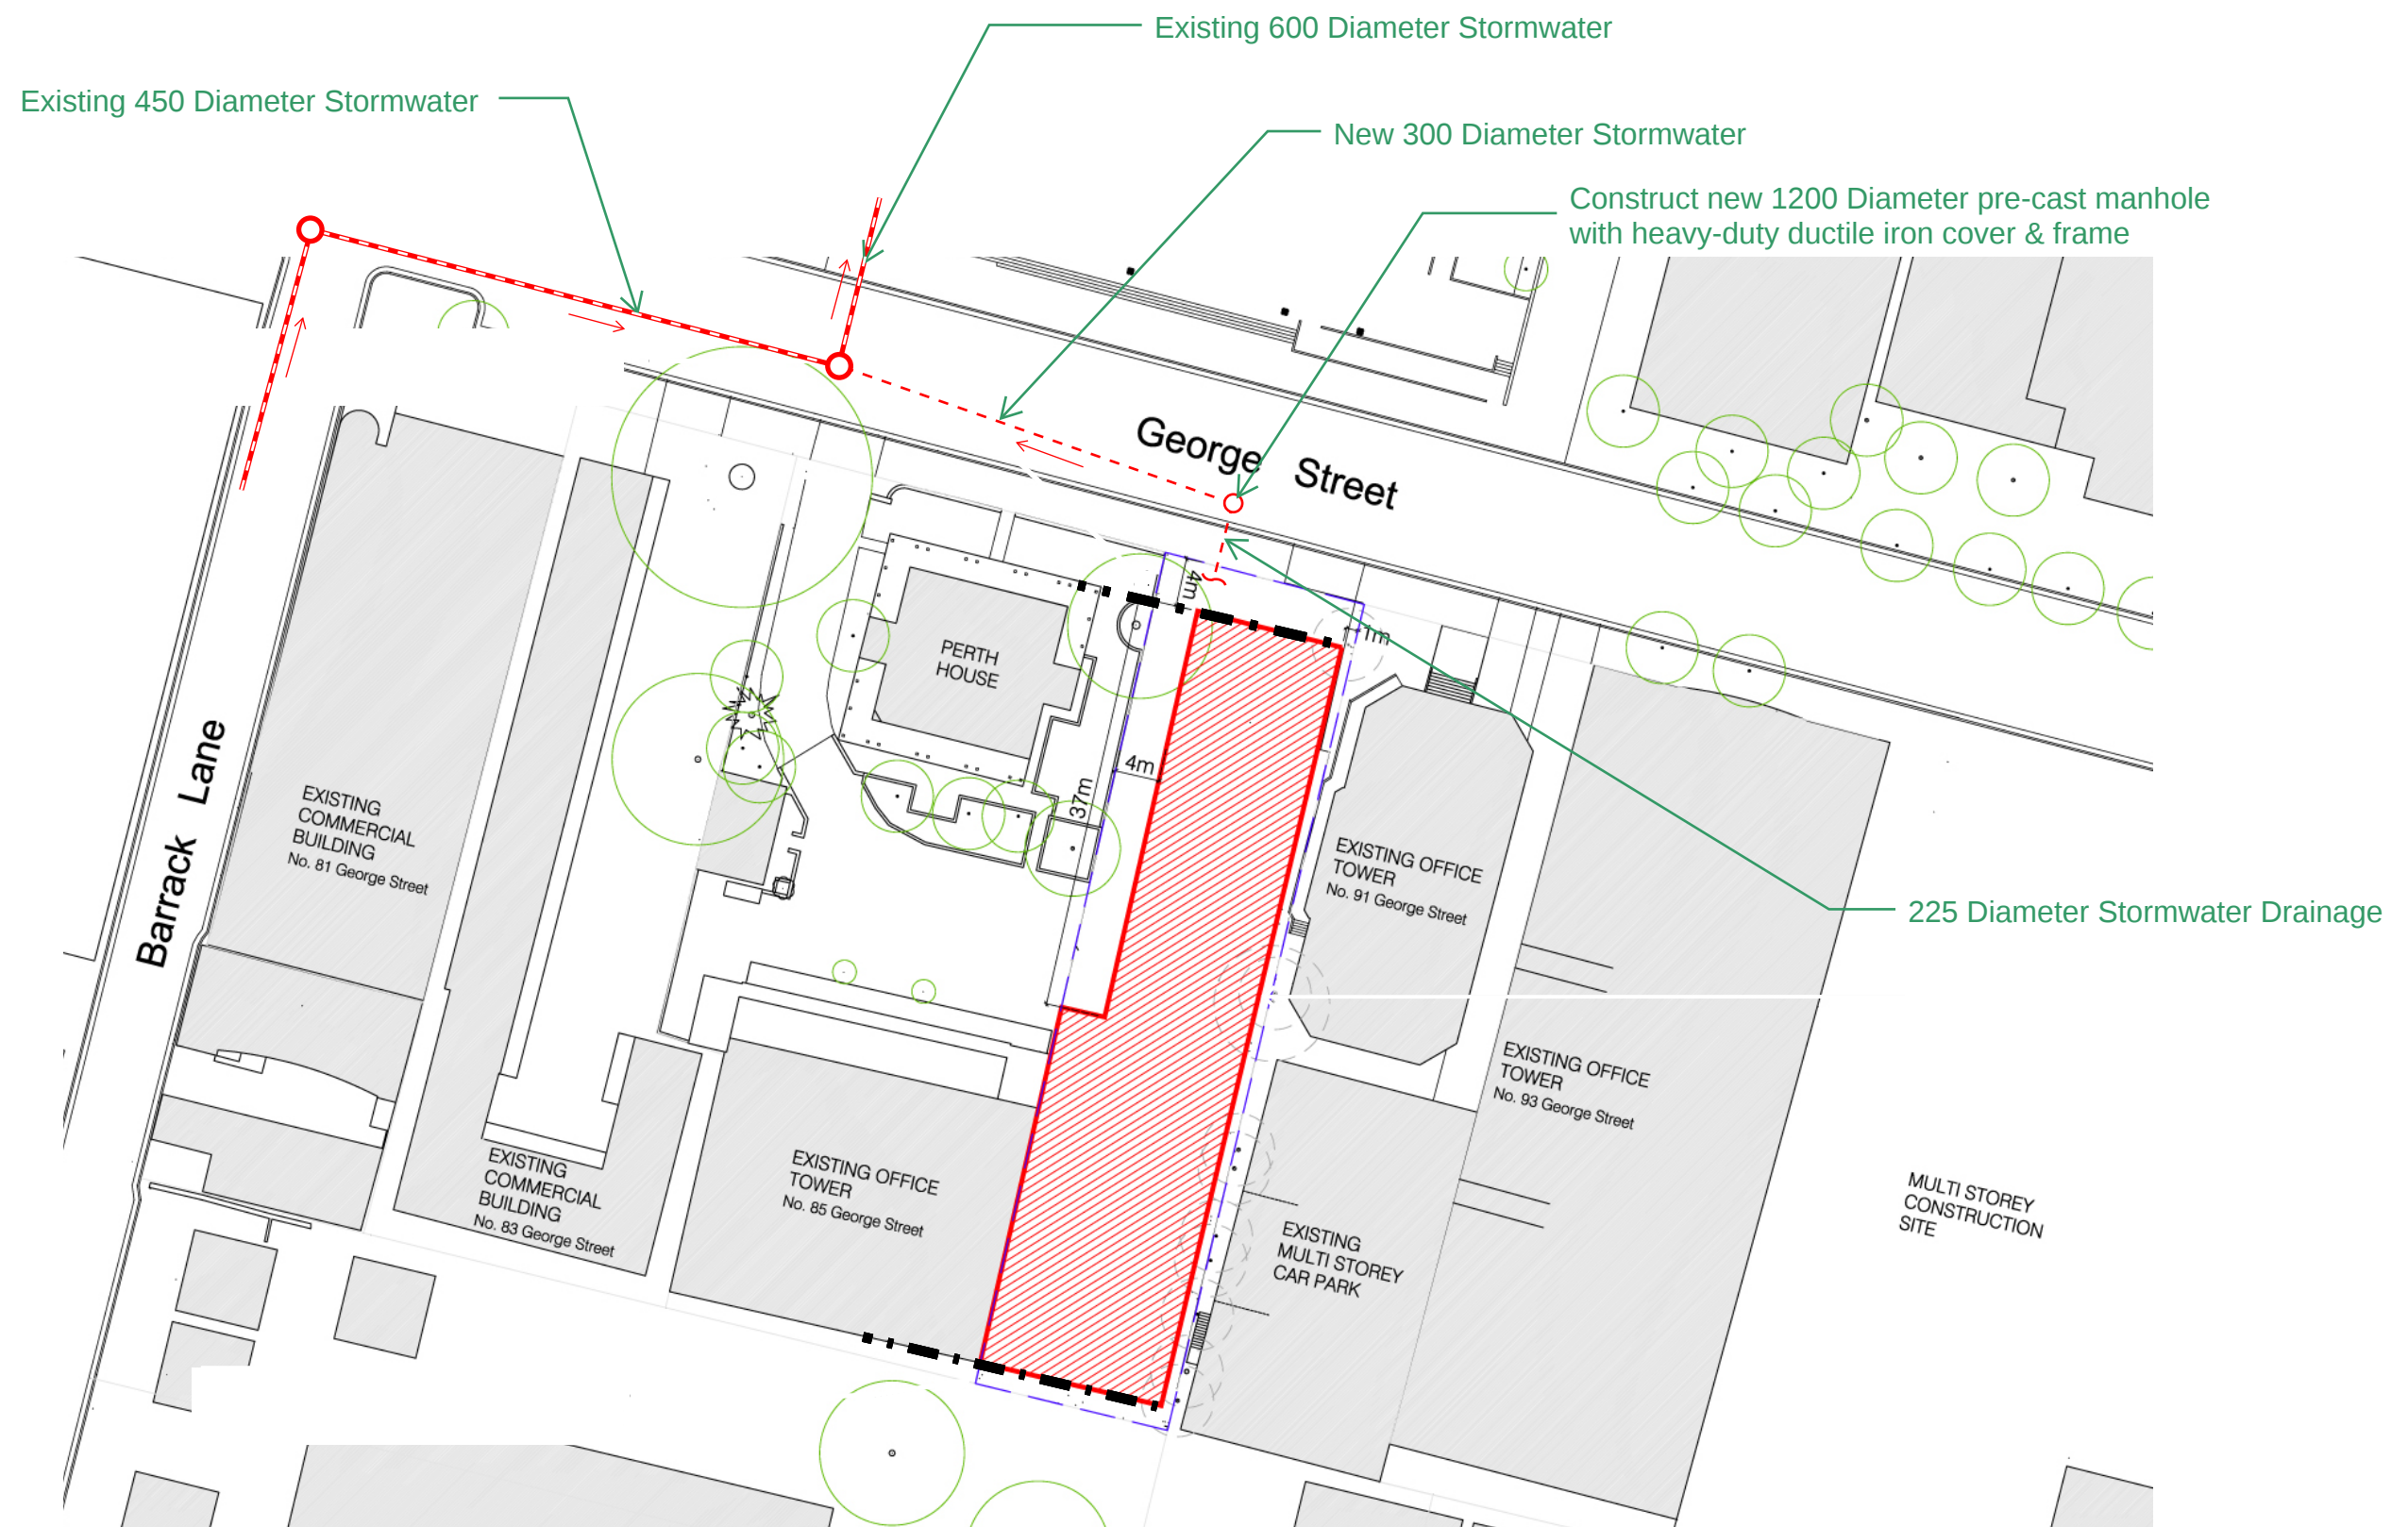

BLOCK LAYOUT (PLAN VIEW)