

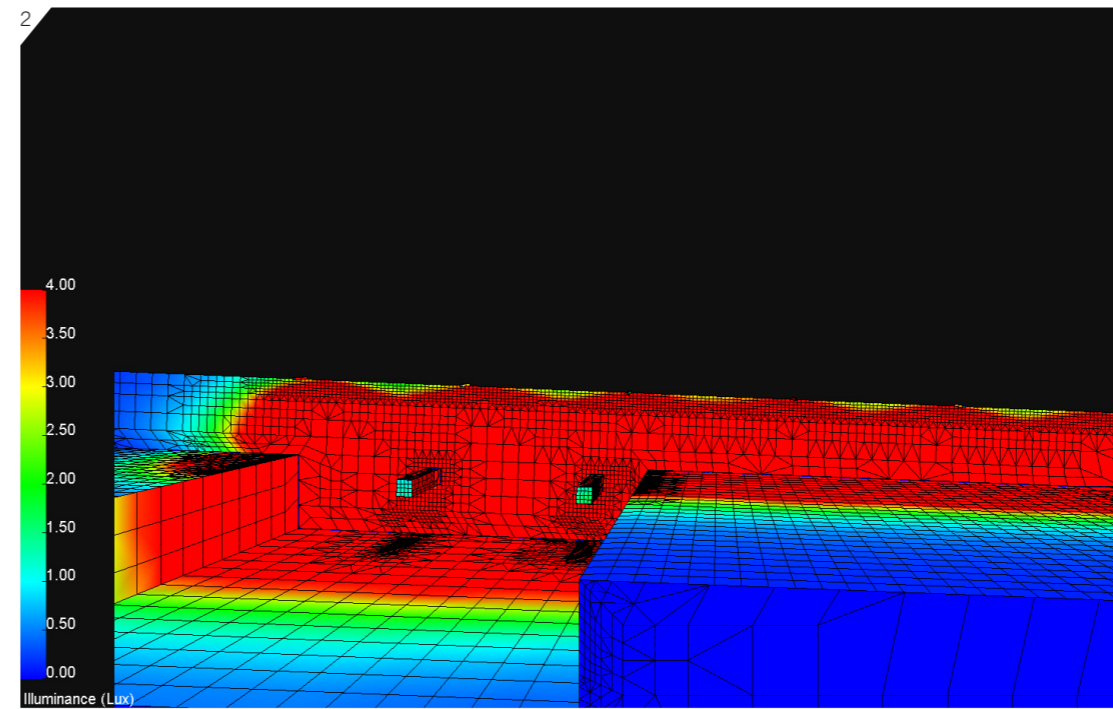


- N°1 Illuminance Level Rendering of Stairs
- N°2 Illuminance Level Rendering of Arcade - aerial view
- N°3 Bega Recessed Wall Luminaire 2043
- N°4 Bega Wall Mounted Fitting 4412 which will be mounted vertically and emits light on either side of the fitting

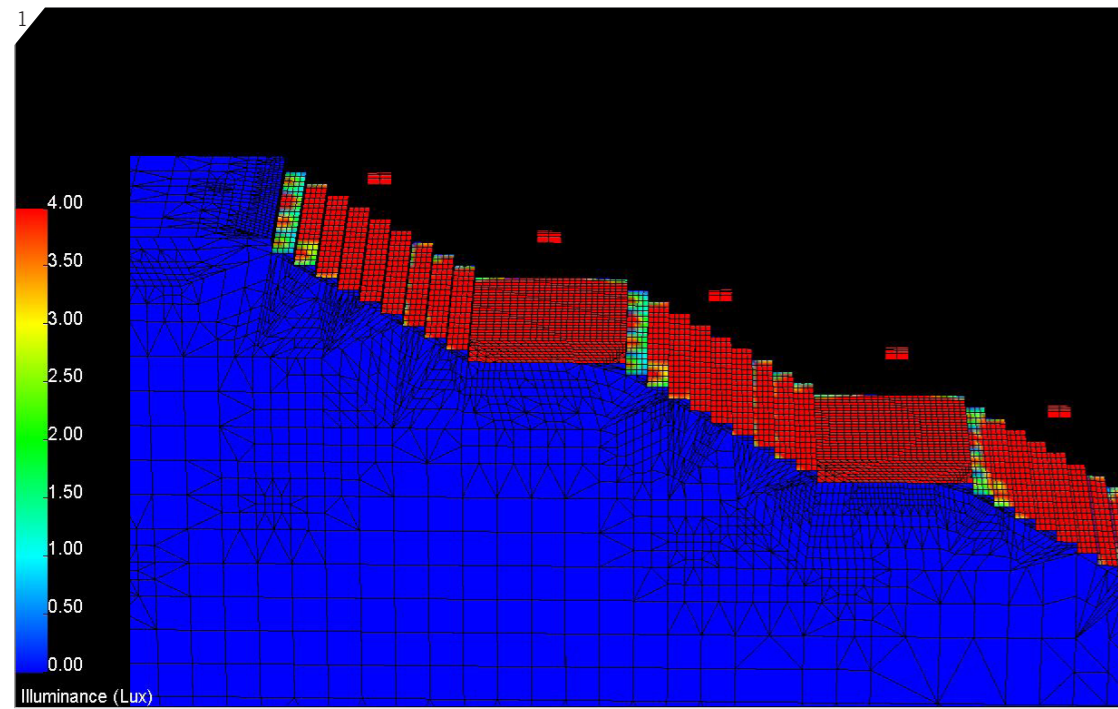

ARCADE, STAIRS & STUDENT UNION TERRACE

The illuminance level renderings shown in Figures 1 and 2 show that the Arcade lighting scheme is compliant with AS/NZS 1158.3.1 P7. The scale has been set to show the minimum requirements for the standard and therefore areas shown in red meet or exceed the lux levels stipulated.

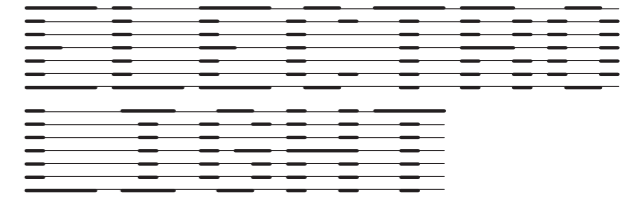