



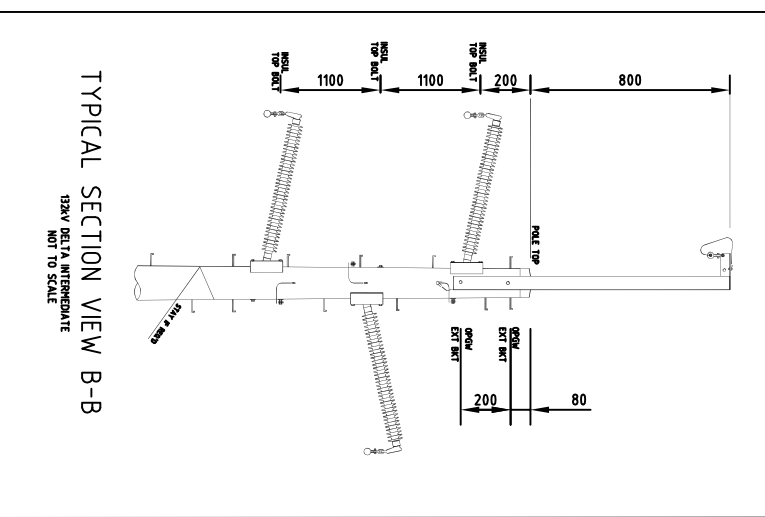

FOR CONSTRUCTION DETAILS, SEE DRG. NO. CEM0402 SERIES			
138KV CONDUCTORS			
SERIES	CONDUCTOR	STRINGING	ROUTE LENGTH
(N) POLE 1 - (N) POLE 59	3-37/3.75 AAAC	215% CBL	-
OPGW CONDUCTORS			
(N) POLE 1 - (N) POLE 59	Z4/L485W OPGW	15% CBL	-
			10.0km (N)

	TITLE	REV.	DATE	DRAWN	M.T.	CHECKED	APPR.
008	PRELIMINARY ISSUE	06.12.10		N.M.			
132KV TRANSMISSION LINE ROUTE FOR E.A.R. BP SOLAR FLAGSHIPS FACILITY MOREE, NSW							
	DRAWING	CNO.	CIRD	ASPER	1 OF 1		
	VENTIC	DATE	DATE	DATE	REV.		
	02.12.10				008		
	CDO REF:	VEMCOM119A/MOREE	SHEET SIZE:	A1			
	SYMBOL:	MCOT11119					

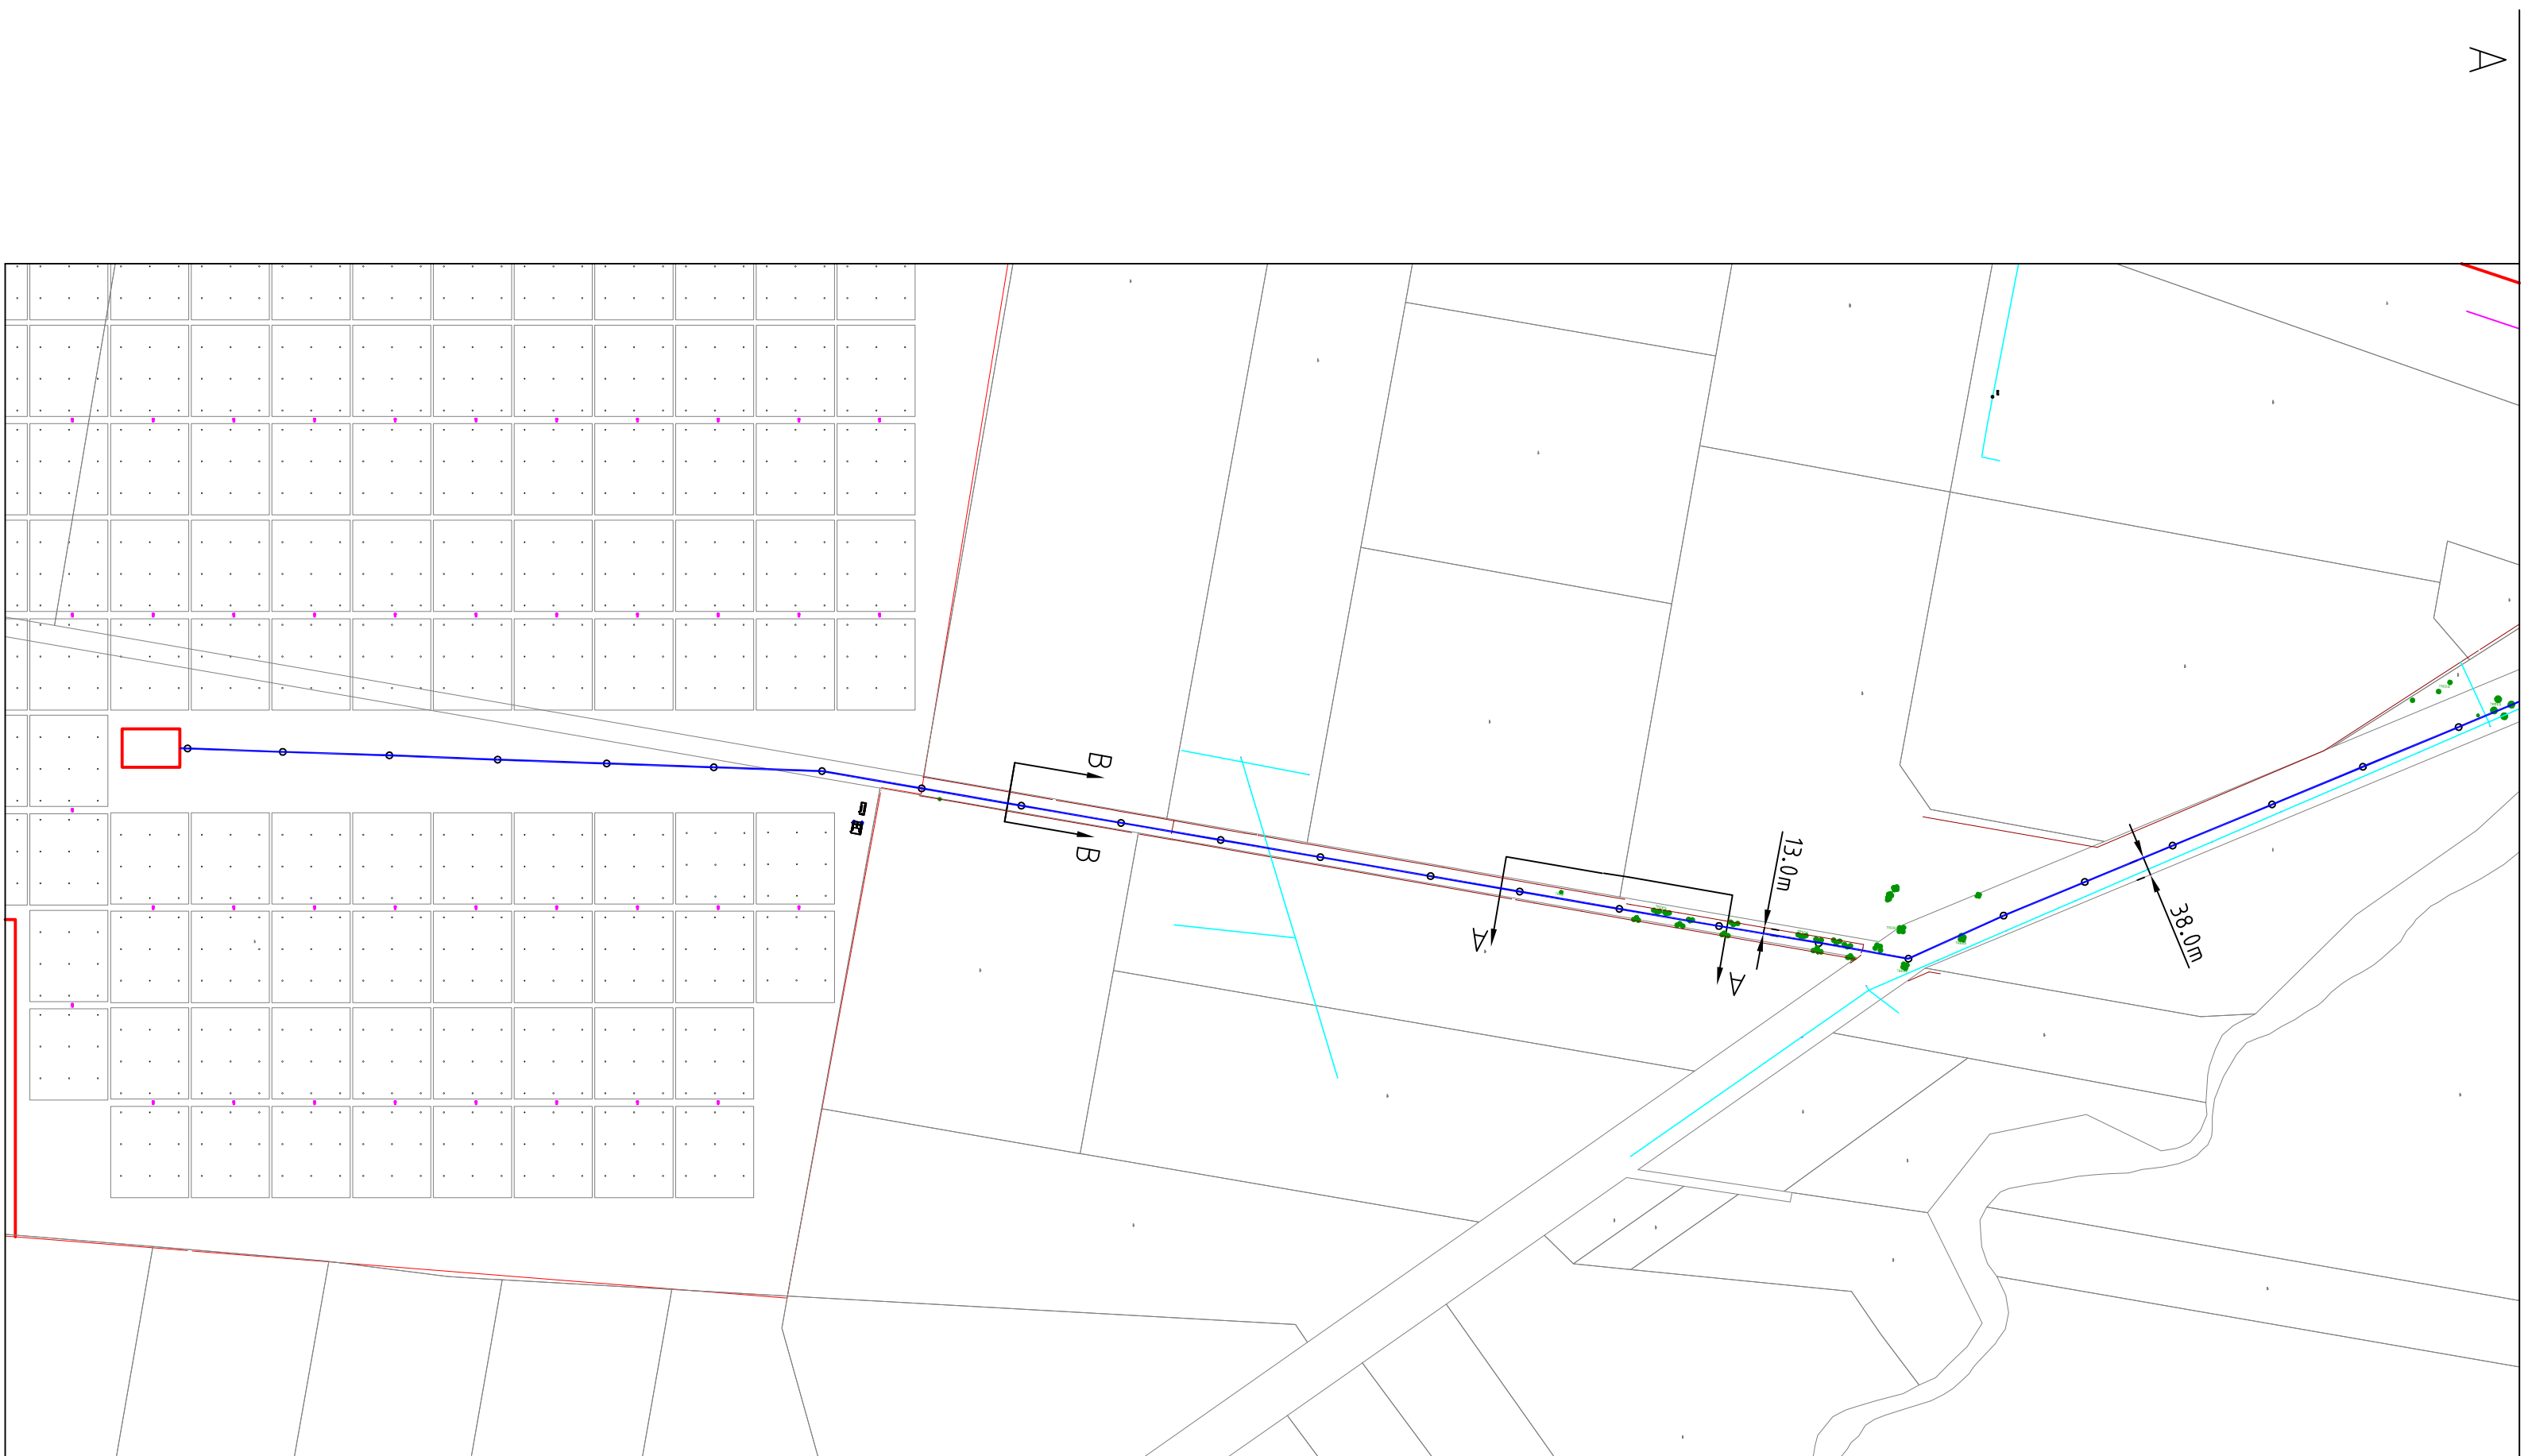

6 December 2010

Gavin Street
Project Development Manager
BP Solar Pty Ltd
Level 1, 71 Epping Road
NORTH RYDE NSW 2113

Our Ref: 10-0291 OUT10/2398FF15

Dear Gavin,

RE: Transmission Line Corridor Study Enquiry for the FRV-BP Solar 180MWdc Solar Flagships Project

I refer to your letter of 2 December 2010 and wish to advise that although the proposed route of your 132kV line generally follows the road network as constructed there appears to be deviations of this from the legal public road reserve. This would need to be clarified by a registered surveyor.

In general I agree with the proposed route as being very feasible and in driving the route have made the following observations:


1. The section between Bullus Drive and Industrial is on top of an existing open trunk storm-water drain. This would need to be piped for 800 metres long to allow for the installation of poles.
2. The section from Tycannah Street near Manildra Grain South to the connection with Burrington Road requires a boundary survey to establish the legal public road reserve bounds.
3. The gravel section of Barton Plains Road accessing the proposed site would require slight shift to the west.

SMK should be able to validate whether the proposed route lies completely within the public road reserve for which Council is the road authority.

Yours faithfully



Murray Erbs
DIRECTOR OF ENGINEERING SERVICES



Moree Plains

S H I R E

Susan Moore

(02) 6757 3381

10-0291 OUT10/1414F4F0

8 December 2010

Gavin Street
Project Development Manager
BP Solar Pty Ltd
Level 1, 71 Epping Road
NORTH RYDE NSW 2113

Dear Gavin,

**Letter of Support - Transmission Line Corridor Study Enquiry for FRV-BP Solar 180MWdc
Solar Flagships Project**

I refer to your letter dated 7 December 2010 and note that your Consortium commits to undertaking additional survey work and consultation with MPSC post 15 December to meet the technical and feasibility requirements identified in our letter dated 6 December 2010.

On the basis of your commitment (as summarised above), I am pleased to advise that Moree Plains Shire Council confirms the subsequent feasibility and conditional support for this transmission line and agrees to the transmission line being routed on the public road reserve.

Yours Faithfully,

David Aber
GENERAL MANAGER

PO Box 420, Moree NSW 2400
Telephone 02) 6757 3222
Facsimile 02) 6752 3934
council@mpsc.nsw.gov.au
mpsc.nsw.gov.au

ABN 46 566 790 582