


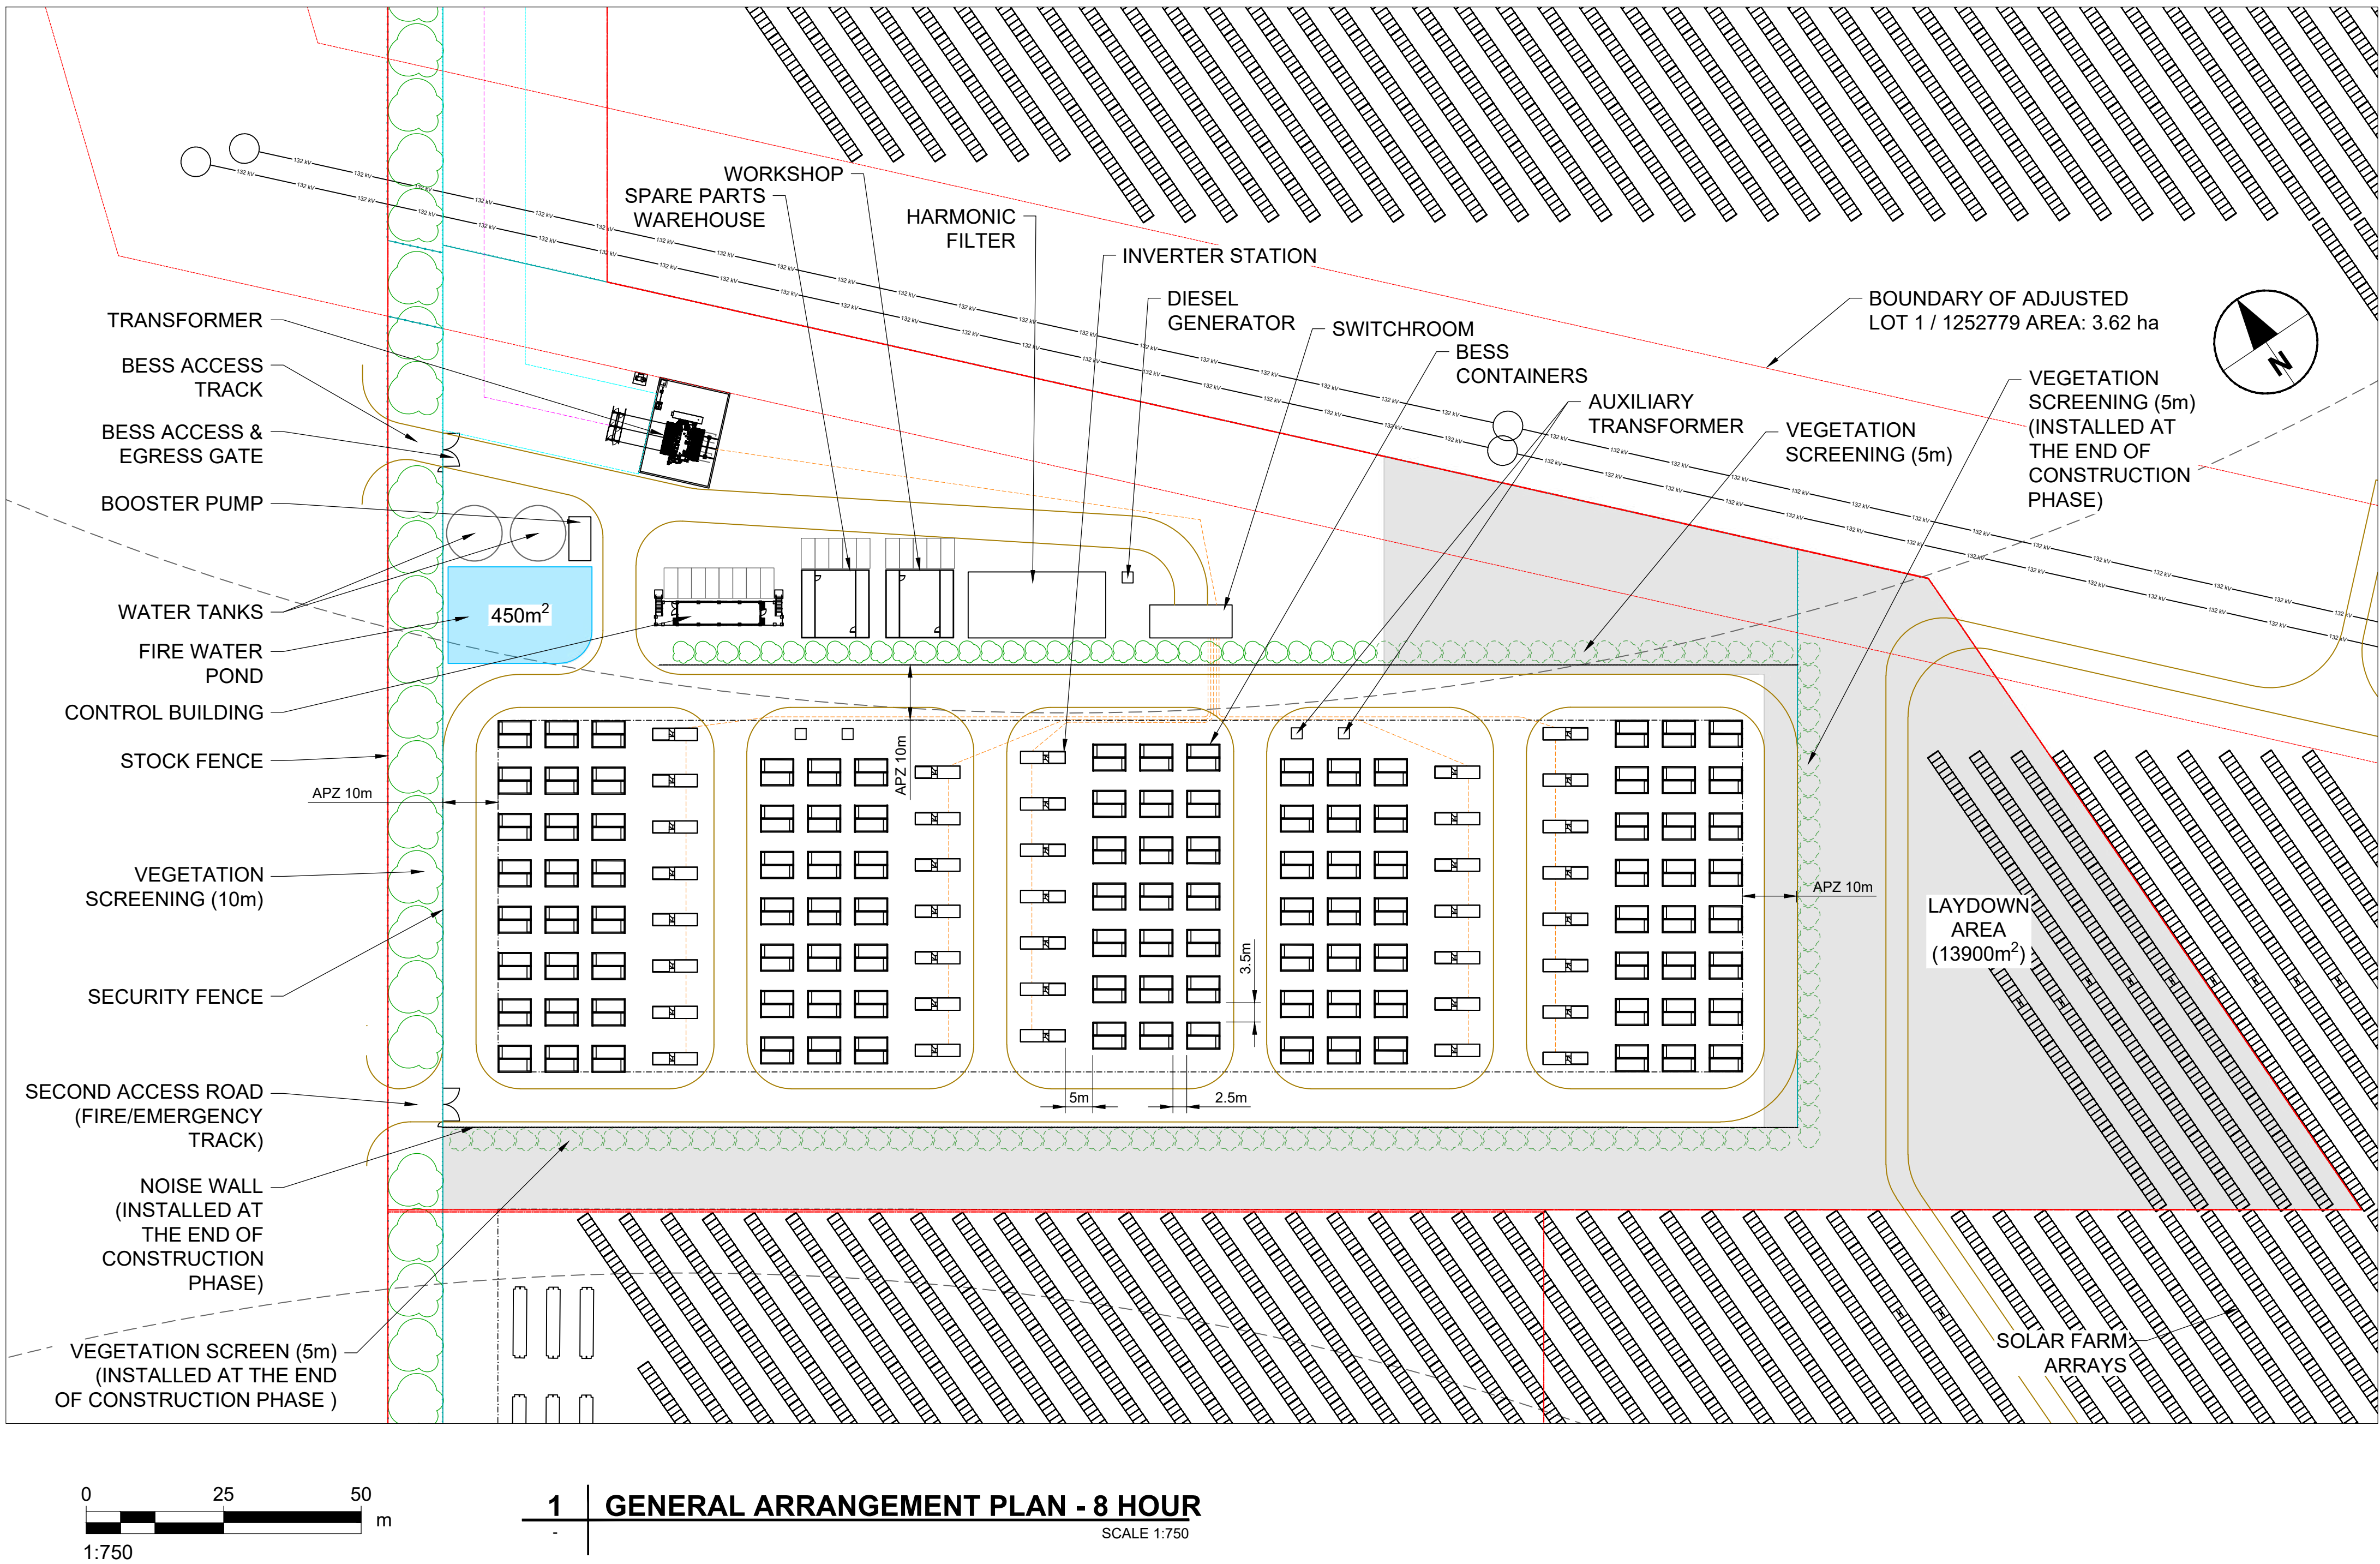

BESS PROJECT INFORMATION	
NOMINAL PROJECT SIZE	100.0 MW / 800.0 MWh
INSTALLED INVERTER & BESS CAPACITY	162.00 MVA / 1065.60 MWh
NO OF BESS CONTAINERS	222
NO OF INVERTER STATIONS	37
SECURITY FENCE SETBACK	MIN. 0m FROM OPTION BOUNDARY
BESS SETBACK	MIN. 10m FROM SECURITY FENCE
ACCESS PATH WIDTH	6m
BESS LOT AREA	3.62 ha

EQUIPMENT INFORMATION	
BESS MODEL	SOLBANK
BESS NAMEPLATE RATING	4800 kWh
INVERTER MODEL	PCSK 4390
INVERTER NAMEPLATE RATING	4390 kVA

LEGEND	
	LOT BOUNDARY
	PROPOSED UG EASEMENT
	EDGE OF BITUMEN ROAD
	EDGE OF ACCESS TRACK
	PROPOSED SECURITY FENCE
	PROPOSED UG HV CABLE (1.5m DEPTH)
	PROPOSED UG HV CABLE (3.1m DEPTH)
	UNDERGROUND DUCTED CABLE
	VEGETATION SCREENING
	LAYDOWN AREA

FOR INFORMATION ONLY

NOT FOR CONSTRUCTION

This drawing is confidential and shall only be used for the purpose of this project. The signing of this title block confirms the design and drafting of this project have been prepared and checked in accordance with the AECOM quality assurance system to ISO 9001-2000.

AECOM

CONSULTANT

AECOM Australia Pty Ltd
A.B.N 20 093 846 925
www.aecom.com

PROJECT


GRIFFITH BESS PROJECT

Bob Irwin Road
Yoogali, NSW 2680

CLIENT

GRIFFITH BESS

Project Co Pty Ltd
Level 16, 60 Carrington St
Sydney, NSW 2000
ekuenergy.com
ABN 44 682 452 973

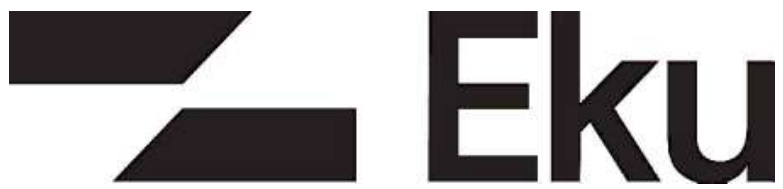

REGISTRATION		
R.P.E.V. APP.	T. DEKI	
R.P.E.V. No.	-	

PROJECT MANAGEMENT INITIALS		
J. GUALTEROS	T. DEKI	K. MEKKI
DESIGNER	CHECKED	APPROVED

PROJECT DATA		
DATUM		SURVEY

ISSUE/REVISION		
C	18.03.25	RE-ISSUED FOR REVIEW
B	10.03.25	RE-ISSUED FOR REVIEW
A	24.02.25	ISSUED FOR REVIEW
I/R	DATE	DESCRIPTION

PROJECT NUMBER

60748296

SHEET TITLE

GENERAL ARRANGEMENT
8 HOUR
PLAN

SHEET NUMBER

60748296-DW-GE-0002