JOHN HOLLAND

SYDNEY FOOTBALL STADIUM REDEVELOPMENT
Landscaping and Finishing works – OOHW Request

24/06/22

Author: Holly Hofland

Rev.B

Date: 24/06/22

Table of Contents

1. Overview 3
2. Out of Hours Request 4
3. Proposed Landscaping and Finishing Activities 5
4. Assessment and Mitigation Measures 8
5. Discussion 9

1. Overview

The Sydney Football Stadium Redevelopment Stage 2 and the Stadium Fitness Facility (SFF) projects (in this document both are jointly referred to as the Project) are an Infrastructure NSW initiative to build a new rectangular stadium. The Project is part of the SCSGT Precinct, adjacent to the SCSGT and part of the wider Moore Park sports and entertainment precinct.

SSD 9835 provides consent for the following works:

- construction of the stadium, including:
  - 45,000 seats (additional 10,000 - person capacity in the playing field in concert mode) in four tiers including general admission areas, members seating and corporate I premium seating;
  - roof cover over all permanent seats and a rectangular playing pitch;
  - a mezzanine level with staff and operational areas;
  - internal pedestrian circulation zones, media facilities and other administration areas on the seating levels;
  - a basement level (at the level of the playing pitch) accommodating pedestrian and vehicular circulation zones, 50 car parking spaces, facilities for teams and officials, media and broadcasting areas, storage and internal loading areas;
  - food and drink kiosks, corporate and media facilities; and
  - four signage zones.
- construction and establishment of the public domain within the site, including:
  - hard and soft landscaping works;
  - publicly accessible event and operational areas;
  - public art; and
  - provision of pedestrian and cycling facilities.
- wayfinding signage and lighting design within the site;
- reinstatement of the existing Moore Park Carpark 1 (MP1) upon completion of construction works with 540 at-grade car parking spaces and vehicular connection to the new stadium basement level;
- operation and use of the new stadium and the public domain areas within the site for a range of sporting and entertainment events; and
- extension and augmentation of utilities and infrastructure.
- construction and operation of integrated members facilities, including
  - gymnasium, training area and three group fitness areas,
  - two squash courts, sauna, spa and steam room as well as wet and dry change rooms
  - day spa and treatment rooms
  - café with indoor and outdoor seating
  - a 25 meter (m) and a 50m open-air swimming pool
  - function spaces on the rooftop, poolside and at the café for members and their guests
  - basement level plant and equipment, landscaping, and associated services

Conditions C3 – C6 establish the construction hours within which the approved development can be undertaken. Condition C5 provides for activities to be undertaken outside of the approved construction hours nominated in condition C3 in the following circumstances:

a) if the delivery of oversized plant or structures has been determined by the police or other public; or authorities to require special arrangements to transport along public roads; or

b) in an emergency to avoid the loss of life, damage to property or to prevent environmental harm;
c) where the works and activities do not cause, when measured at the boundary of the most affected noise sensitive receiver:
    (i) Leq (15 minute) dB(A) noise levels greater than 5dB above the day, evening and night rating background level (RBL) as applicable; and
    (ii) L1(1 minute) dB(A) or LFmax dB(A) noise levels greater than 15dB above the night RBL for night works;
    (iii) continuous or impulsive vibration values greater than those for human exposure to vibration, set out for residences in Table 2.2 in "Environmental noise management - Assessing Vibration: a technical guideline" (Department of Environment and Conservation, February 2006); and
    (iv) intermittent vibration values greater than those for human exposure to vibration, set out for residences in Table 2.4 in "Environmental noise management - Assessing Vibration: a technical guideline" (Department of Environment and Conservation, February 2006); or

Note: For the purpose of this condition, the RBLs are those contained in an environmental assessment for the scheduled activity subject to this licence prepared under the Environmental Planning and Assessment Act 1979. Alternatively, the licensee may use another RBL determined in accordance with the NSW Noise Policy for Industry (EPA, 2017) and provided to the EPA prior to carrying out any works or activities under this condition.

Pursuant to Condition C6 of the consent, any variation to the works hours proposed in accordance with Condition C5 must be approved in advance in writing by the Planning Secretary if appropriate justification is provided for the works. Notification of the activities must be given to affected residents before undertaking the activities or as soon as is practical afterwards.

2. Out of Hours Request

The NSW Government have instructed John Holland to complete the construction of the Sydney Football Stadium and Stadium Fitness Facilities by September 2022 in time for the NRL Grand Final. The Grand Final is a set sporting fixture that is unable to be rescheduled and accordingly the late July/early August 2022 completion date is a hard deadline. To facilitate the commissioning and defect close out period, a deadline of August 2022 is imposed on all construction works.

John Holland is seeking the Planning Secretary's written approval pursuant to Condition C6 to carry out low impact works as identified within Condition C5(c) for the purposes to carrying out the fit out and commissioning, landscaping, pitch install, and roof finishing works of the project during the following times until 30 August 2022:

- 6pm-12am Mon-Fri (6 additional hours per weekday);
- 1pm-12am Sat (11 additional hours per Saturday); and
- 8am-12am Sun (16 additional hours per Sunday)

John Holland has successfully completed several Out of Hours Works (OOHW) to date without exceeding the approved noise levels for construction activities. During these OOHW, there have been no issues or complaints raised by the community and noise monitoring submitted to the Department have demonstrated consistent compliance with regards to noise impacts. Successfully completed OOHW include;

- Delivery of oversize plant and equipment approved 10/8/2020;
- Low impact concreting and finishing activities originally approved 08/09/2020;
- Higher impact activities associated with the installation of roof structures approved 28/4/2021
- Internal fit out, architectural finishes and logistical activities 27/9/2021

The request that forms the basis of this application is sought pursuant to Condition C5(c) on the basis the proposed works scenarios will not exceed the specified noise levels when measured at the boundary of the nearest sensitive noise receiver.

Recognising that there is an existing OOHW approval for internal fit out works which is valid until 31 July 2022, it is important to appropriately manage the sequencing of works to minimise cumulative impacts. Accordingly, JHG commits to scheduled all OOHW in an alternating fashion, so that there will be no cumulative impact to residents from the Landscaping and Finishing OOHW as detailed in the noise assessment (Appendix 1), and

those approved under the Internal fit-out, architectural finishes and logistical activities (27/9/2021). For avoidance of doubt, JHG confirms that it does not propose to undertake any works that are the subject of this OOHW Request concurrently with those works approved under the Internal fit-out, architectural finishes and logistical activities OOHW.

JHG will manage complaints in accordance with the approved process in the CNVMP and the CCS. It is anticipated to not require OOHW every evening and weekend, however the assessment has been conducted on a worst-case scenario.

The unprecedented inclement weather experienced between Jan-current has caused significant difficulties in completing works in a timely fashion and has restricted site access. Between 1 January 2022 and 1 April 2022, the project has experienced 50 rain days with greater than 5mm that have caused restricted access to site or a complete site closure whereby no works could be conducted safely. This has further compounded previous delays experienced due to COVID restrictions and government mandates.

Being largely outdoor and externally based, the activities that are the subject of this OOHW Request are those that have had the greatest impact by the inclement weather and as such pose the greatest risk to the completion of The Project.

3. Proposed Landscaping and Finishing Activities

The proposed activities that are the subject of this OOHW Request will be undertaken by a maximum of 200 personnel onsite, inclusive of supervision, during the extended hours. The equipment proposed to be utilised and modelled as part of the noise modelling for each scenario is as follows:

Façade Cleaning equipment use include:

- Lifting platform; and
- Pressure washer

Figure 1 Facade cleaning works location

Paving and Landscaping including hand laying of pavers on pre-prepared areas of the roadway surrounding the stadium, and hand planting within garden beds. Equipment use includes:

- Non-powered hand tools (e.g. shovels, no hammers)

Figure 2 Hand laying pavers, hand planting locations

Installation of miscellaneous pieces of façade in areas out of line of site of residents where any generated noise will be mitigated by the stadium structure. Only minor finishing is required in most areas, as such equipment will be limited to elevated work platform in the orange area. Equipment use includes:

- Wheeled mobile crane
- Lifting platform; and
- Hand tools (only in designated blue area)

Figure 3 Facade install. Blue - with powered tools Orange - no powered tools

Final finished for installation of roof fabric. Equipment use includes:

- Lifting platform (located on pitch within the stadium); and

- Non-powered hand tools (e.g. spanners, no hammers)

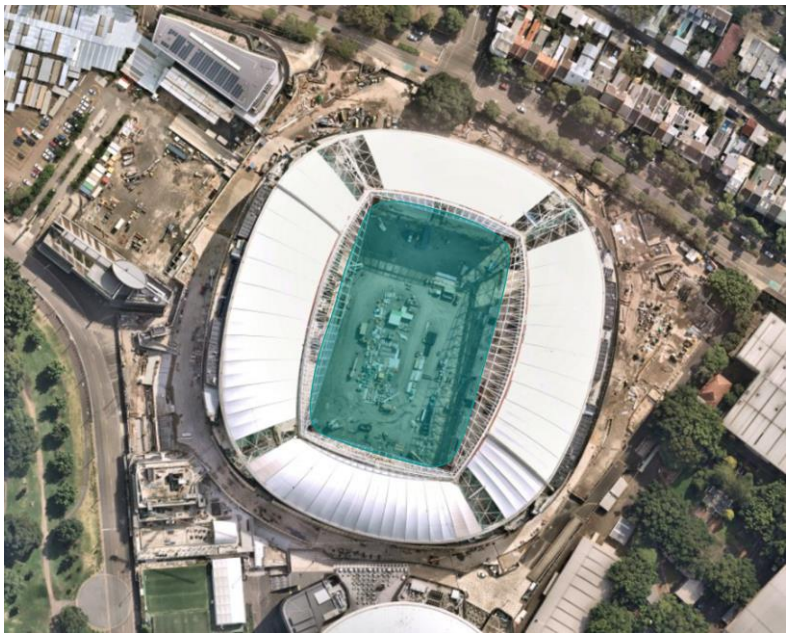

Figure 4 Installation of roof fabric work zone

Delivery and installation of pitch material and turf (restricted to Sat/Sun). Equipment use includes

- Truck and dog; and
- Tracked excavator

Figure 5 Delivery of pitch materials work zone

All activities are proposed to be conducted in areas that will not have line of sight to residents with exception of the façade cleaning. Works conducted within the stadium structure will be out of line of sight and enclosed by the acoustically treated northern façade. The northern façade consists of a glazed acoustic screen, the primary design purpose of which is to mitigate noise transmission to sensitive receivers along Moore Park Road. At this stage of the project, all acoustic attenuation has been installed and functional.

4. Assessment and Mitigation Measures

To demonstrate the proposed activities and tools will not exceed the noise criteria established in Condition C5(c) of SSD 9835, the proposed OOHW have been assessed by Arup in the SNAPshot noise modelling software. The model (provided in Appendix 1) demonstrates that the works comply with the noise limits approved by the SSD-9835 Development Consent. Importantly, the modelling also demonstrates no predicted exceedances of the RBL+5 criteria.

The SNAPshot model is populated with the proposed equipment (i.e.: that identified in Section 4 above), and assumptions are adopted regarding the duration of time that each piece of equipment will be used. The SNAPshot model then predicts airborne noise using algorithms, and with reference to mapped ground topography and ground and air absorption factors, such as buildings and intervening structures. The SNAPshot interface then provides instantaneous assessment of the proposed OOHW activities.

The SNAPShot model adopted a worst-case scenario which assumed that all activities would occur closest to residents along Moore Park Road. However it should be emphasised that the majority of proposed works are proposed to actually be undertaken in locations situated away from the nearest sensitive receivers and accordingly located further away than those modelled, as shown in Appendix 1. In addition, the model is conservative in the assumptions on site conditions, and assumes that all equipment use occurs concurrently, which will not be the case. The model also fails to account for the finalisation of building façade and roof fabric, which will provide significant additional acoustic attenuation for works proposed to be conducted on the pitch.

On this basis, no additional mitigation measures are required above and beyond the already approved mitigation measures, as below:

- Community notifications to residents 7 days prior to commencement of works
- OOHW requirements will be communicated to workers via toolbox at commencement of night works
- All works will utilise task lighting in dedicated works areas. all lighting will be directed inwards and down, not at residents. Lighting will be provided by fixed lighting or solar powered light towers
- Class A hoarding to remain closed including construction access to Moore Park Rd during any activities occurring during the OOHW period.
- Noise monitoring of all activities with results to be reviewed and reported to the Department on a Monthly basis
- Quarterly newsletter updates and community information line available during the OOHW consistent with the approved Community Consultation Strategy; and
- Implementation of the OOHW procedure and permit for all proposed activities

John Holland recognises the sensitive noise receivers along Moore Park Road and will limit works on the Northern aspect of site, only conducting critical works.

In addition, John Holland will ensure that management of out of hours works is appropriately managed via site management team and ensure an appropriate level of supervision to ensure compliance with the OOHW is actively managed throughout the Project

John Holland strongly commits to ensuring compliance with OOHW mitigations and has demonstrated that the impact to residents can be managed to acceptable levels as confirmed in the SNAPshot model and the limited number of noise complaints received to date

Construction Workers will be continually reminded to only park along Driver Avenue in metered parking bays (>150 available), which will complement the agreement made with the Entertainment Quarter car park management to utilise the metered parking station at a discounted rate for the late shift (2000 spaces available). As travel is proposed outside of the PM peak hours, no adverse traffic impacts to the surrounding network are anticipated. No complaints have been received due to workers from OOHW shifts parking in residential parking.

5. Discussion

The modelling shown in Appendix 1 shows that the activities proposed will be compliant with Condition C5(c), and will be inaudible to the nearest residential receiver. There is no expectation for any perceptible vibration of LF Max events, all equipment proposed are non-high impact. The full report is available in Appendix 1.

To date, there have been 4 OOHW applications approved and undertaken across the duration of the project:

- Delivery of oversize plant and equipment approved 10/8/2020;
- Low impact concreting and finishing activities originally approved 08/09/2020;
- Higher impact activities associated with the installation of roof structures approved 28/4/2021
- Internal fit out, architectural finishes and logistical activities 27/9/2021

No complaints have been received regarding any works conducted outside of standard Construction Hours, relating to activities undertaken as part of these OOHW approvals.

The use of noisier equipment such as hand tools, and gurneys as proposed in façade cleaning, will be limited, infrequent and of short duration over the course of the proposed OOHW. Whilst it is accepted that the characteristics of construction noise are different to traffic noise, the likelihood of transmission and perception over the consistently high traffic noise is negligible.

Existing ambient noise levels at the closest affected residence – primarily due to road traffic, is Laeq 62dBA, well above the highest predicted noise level of 53dBA. Attended monitoring and real time monitoring at these receivers shows the Laeq(15min) to be regularly over 70dBA from traffic noise during peak hour periods. There are no predicted exceedances of allowable RBL+ levels.

To reduce the impact on residents, all possible works will be conducted during standard construction hours.

Appendix 1 Noise Assessment

Level 3, 65 Pirrama Road
Pyrmont NSW, 2009

Report No.:
Date: 24 June 2022
Created by:
Checked by:

SFS Redev - Cleared site - OOHW- Building

Section 1 - Introduction

This construction noise assessment has been prepared for **SFS Redev - Cleared site** in accordance with the relevant environmental assessment requirements, outlined in Appendix A.

Figure 1-1: Site and receiver map

Section 2 - Works description

This assessment report relates to the proposed works summarised in Table 2-1.

Table 2-1: Proposed works

Name	Work dates	Relevant assessment periods	Construction Plant, Quantity and Duration*
Facade Cleaning		• Day Outside Standard Hours	• A Lifting Platform x 1 , 100% • B Pressure Washer x 1 , 50%
Paving		• Day Outside Standard Hours	• A Petrol Concrete Trowel x 1 , 100% • B Petrol Concrete Trowel x 1 , 100%
Facade install - no hand tools		• Day Outside Standard Hours	• A Mobile Telescopic Crane (Idling) x 1 , 100% • B Lifting Platform x 1 , 50%
Misc Facade Install		• Day Outside Standard Hours	• A Wheeled Mobile Crane x 1 , 100% • B Lifting Platform x 1 , 50% • C Wheeled Mobile Crane x 1 , 100% • D Lifting Platform x 1 , 100% • E Hydratorque x 1 , 100%
Roof finishes		• Day Outside Standard Hours	• A Lifting Platform x 1 , 100%
Pitch works		• Day Outside Standard Hours	• A Truck and Dog x 1 , 100% • B Tracked Excavator x 1 , 100%

Notes: * Duration % is the percentage that the plant is used in the measurement assessment time period.

Section 3 - Assessment methodology

Airborne noise predictions have been carried out using SoundPLAN implementing ISO 9613-2:1996 Acoustics - Attenuation of sound during propagation outdoors - Part 2: General method of calculation (ISO 9613-2). All sources are nominally located 2 m above the local ground level. The noise model includes the ground topography, ground and air absorption, receptor buildings and intervening structures.

Assessment has been carried out using Arup SNAPshot interface, which provides instantaneous assessment of proposed work Activities. This has ensured works contributing to exceedance of target levels are understood, and all endeavours made to reduce impacts where practicable. Where target noise levels are predicted to be exceeded options for alternative construction methodologies and / or mitigation have also been considered. This report presents the outcomes of the assessment, reflecting the final plant selection and any relevant mitigation and management measures.

Section 4 - Management matrix

Based on the project criteria, the following management matrix has been established, which has been referred to in the subsequent assessment tables in Section 5. Baseline noise levels and fixed criteria (for the relevant receiver types) are outlined in Table 4-2.

Table 4-1 Management Matrix

Name	Category	Description
Non residential: All periods	A	Complies
	B	Exceeds up to 5 dB
	C	Exceeds up to 10 dB
	D	Exceeds up to 15 dB
	E	Exceeds more than 15 dB
Residential: Standard hours	A	Complies (Bgn + 10)
	B	Exceeds up to 5 dB
	C	Exceeds up to 10 dB
	D	Exceeds up to 15 dB
	E	Exceeds > 15 dB or 75 dB(A)
Residential: Outside Standard Hours	A	Complies (Bgn + 5)
	B	Exceeds up to 5 dB
	C	Exceeds up to 10 dB
	D	Exceeds up to 15 dB
	E	Exceeds > 15 dB or 70 dB(A)

Note:

Standard Hours
Monday to Friday: 7 am - 6 pm, Saturday: 8 am - 1 pm

RBL + 10dB

Day Outside Standard Hours
Saturday: 7pm - 8am, 1pm-6pm. Sunday: 8am-6pm

RBL + 5dB

Evening
Monday - Saturday: 6pm -10pm

RBL + 5dB

Night
Monday - Saturday: 10pm - 7 am

RBL + 5dB

Table 4-2 Baseline levels and fixed criteria

Receiver Type	ID	Noice Catchment Area (NCA)	Period	Fixed Criteria (dB Leq)	Ambient (dB Leq)	Background (dB L90)
Town Hall	TH	No NCA	Night	45	-	-
Town Hall	TH	No NCA	Evening	45	-	-
Town Hall	TH	No NCA	Day Outside Standard Hours	45	-	-
Town Hall	TH	No NCA	Standard Hours	45	-	-
Residential	RES	NCA 6	Night	-	49	45
Residential	RES	NCA 6	Evening	-	57	47
Residential	RES	NCA 6	Day Outside Standard Hours	-	57	47
Residential	RES	NCA 6	Standard Hours	-	57	47
Residential	RES	NCA 5	Night	-	43	35

Receiver Type	ID	Noice Catchment Area (NCA)	Period	Fixed Criteria (dB Leq)	Ambient (dB Leq)	Background (dB L90)
Residential	RES	NCA 5	Evening	-	56	36
Residential	RES	NCA 5	Day Outside Standard Hours	-	60	39
Residential	RES	NCA 5	Standard Hours	-	60	39
Residential	RES	NCA 4	Night	-	46	41
Residential	RES	NCA 4	Evening	-	55	41
Residential	RES	NCA 4	Day Outside Standard Hours	-	57	43
Residential	RES	NCA 4	Standard Hours	-	57	43
Residential	RES	NCA 3	Night	-	64	49
Residential	RES	NCA 3	Evening	-	66	49
Residential	RES	NCA 3	Day Outside Standard Hours	-	68	52
Residential	RES	NCA 3	Standard Hours	-	68	52
Residential	RES	NCA 2	Night	-	62	51
Residential	RES	NCA 2	Evening	-	65	52
Residential	RES	NCA 2	Day Outside Standard Hours	-	67	56
Residential	RES	NCA 2	Standard Hours	-	67	56
Residential	RES	NCA 1	Night	-	67	55
Residential	RES	NCA 1	Evening	-	68	56
Residential	RES	NCA 1	Day Outside Standard Hours	-	69	58
Residential	RES	NCA 1	Standard Hours	-	69	58
Place of worship	PoW	No NCA	Night	45	-	-
Place of worship	PoW	No NCA	Evening	45	-	-
Place of worship	PoW	No NCA	Day Outside Standard Hours	45	-	-
Place of worship	PoW	No NCA	Standard Hours	45	-	-
Passive Recreation	PR	No NCA	Night	60	-	-
Passive Recreation	PR	No NCA	Evening	60	-	-
Passive Recreation	PR	No NCA	Day Outside Standard Hours	60	-	-
Passive Recreation	PR	No NCA	Standard Hours	60	-	-
Educational	E	No NCA	Night	45	-	-
Educational	E	No NCA	Evening	45	-	-
Educational	E	No NCA	Day Outside Standard Hours	45	-	-
Educational	E	No NCA	Standard Hours	45	-	-

Receiver Type	ID	Noice Catchment Area (NCA)	Period	Fixed Criteria (dB Leq)	Ambient (dB Leq)	Background (dB L90)
Commercial	C	No NCA	Night	70	-	-
Commercial	C	No NCA	Evening	70	-	-
Commercial	C	No NCA	Day Outside Standard Hours	70	-	-
Commercial	C	No NCA	Standard Hours	70	-	-
Child Care	CC	No NCA	Night	70	-	-
Child Care	CC	No NCA	Evening	70	-	-
Child Care	CC	No NCA	Day Outside Standard Hours	70	-	-
Child Care	CC	No NCA	Standard Hours	70	-	-
Active Recreation	AR	No NCA	Night	65	-	-
Active Recreation	AR	No NCA	Evening	65	-	-
Active Recreation	AR	No NCA	Day Outside Standard Hours	65	-	-
Active Recreation	AR	No NCA	Standard Hours	65	-	-

Section 5 - Modelling, mitigation and management outcomes

The following summarises the assessed equipment details and summary of the assessment outcomes. More detail regarding predicted noise levels at each receiver is included in *Appendix A*.

5.1 - Facade Cleaning

The following tables present the relevant equipment sound power levels and assessment summary.

Table 5-1-1: Facade Cleaning - Equipment details

No.	Name	Location	LwA	63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz	Qty	Duration % of 15-min period
A.	Lifting Platform	[-33.88826457, 151.22581979]	95	106	104	90	91	88	87	86	77	1	100
B.	Pressure Washer	[-33.88826266, 151.22569724]	96	90	90	90	85	90	90	90	6	1	50

Table 5-1-2: Facade Cleaning - Assessment summary

Period	Receiver Type	Management level				
		A	B	C	D	E
Day Outside Standard Hours	Town Hall	5	0	0	0	0
	Residential	1584	0	0	0	0
	Place of worship	16	0	0	0	0
	Passive Recreation	2	0	0	0	0
	Educational	46	0	0	0	0
	Commercial	339	0	0	0	0
	Child Care	5	0	0	0	0
	Active Recreation	33	0	0	0	0

The following figure(s) shows the equipment locations on site for each working period.

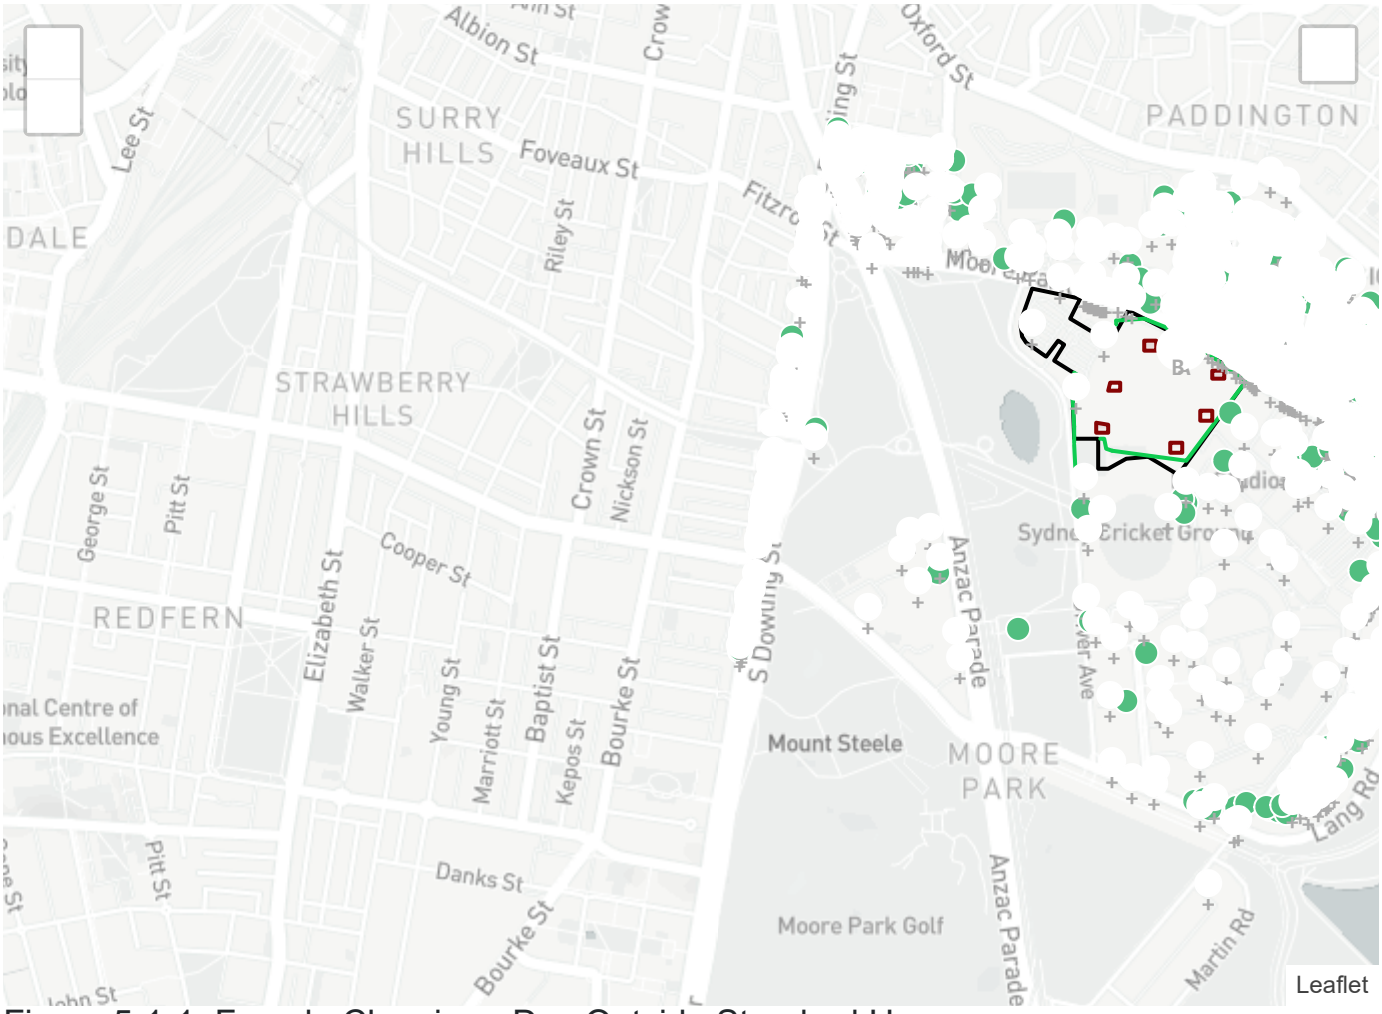

Figure 5-1-1: Facade Cleaning - Day Outside Standard Hours

5.2 - Paving

The following tables present the relevant equipment sound power levels and assessment summary.

Table 5-2-1: Paving - Equipment details

No.	Name	Location	LwA	63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz	Qty	Duration % of 15-min period
A.	Petrol Concrete Trowel	[-33.88825308, 151.22508446]	95	82	85	87	90	90	89	84	76	1	100
B.	Petrol Concrete Trowel	[-33.88987647, 151.22357966]	95	82	85	87	90	90	89	84	76	1	100

Table 5-2-2: Paving - Assessment summary

Period	Receiver Type	Management level				
		A	B	C	D	E
Day Outside Standard Hours	Town Hall	5	0	0	0	0
	Residential	1584	0	0	0	0
	Place of worship	16	0	0	0	0

Period	Receiver Type	Management level				
		A	B	C	D	E
	Passive Recreation	2	0	0	0	0
	Educational	46	0	0	0	0
	Commercial	339	0	0	0	0
	Child Care	5	0	0	0	0
	Active Recreation	33	0	0	0	0

The following figure(s) shows the equipment locations on site for each working period.

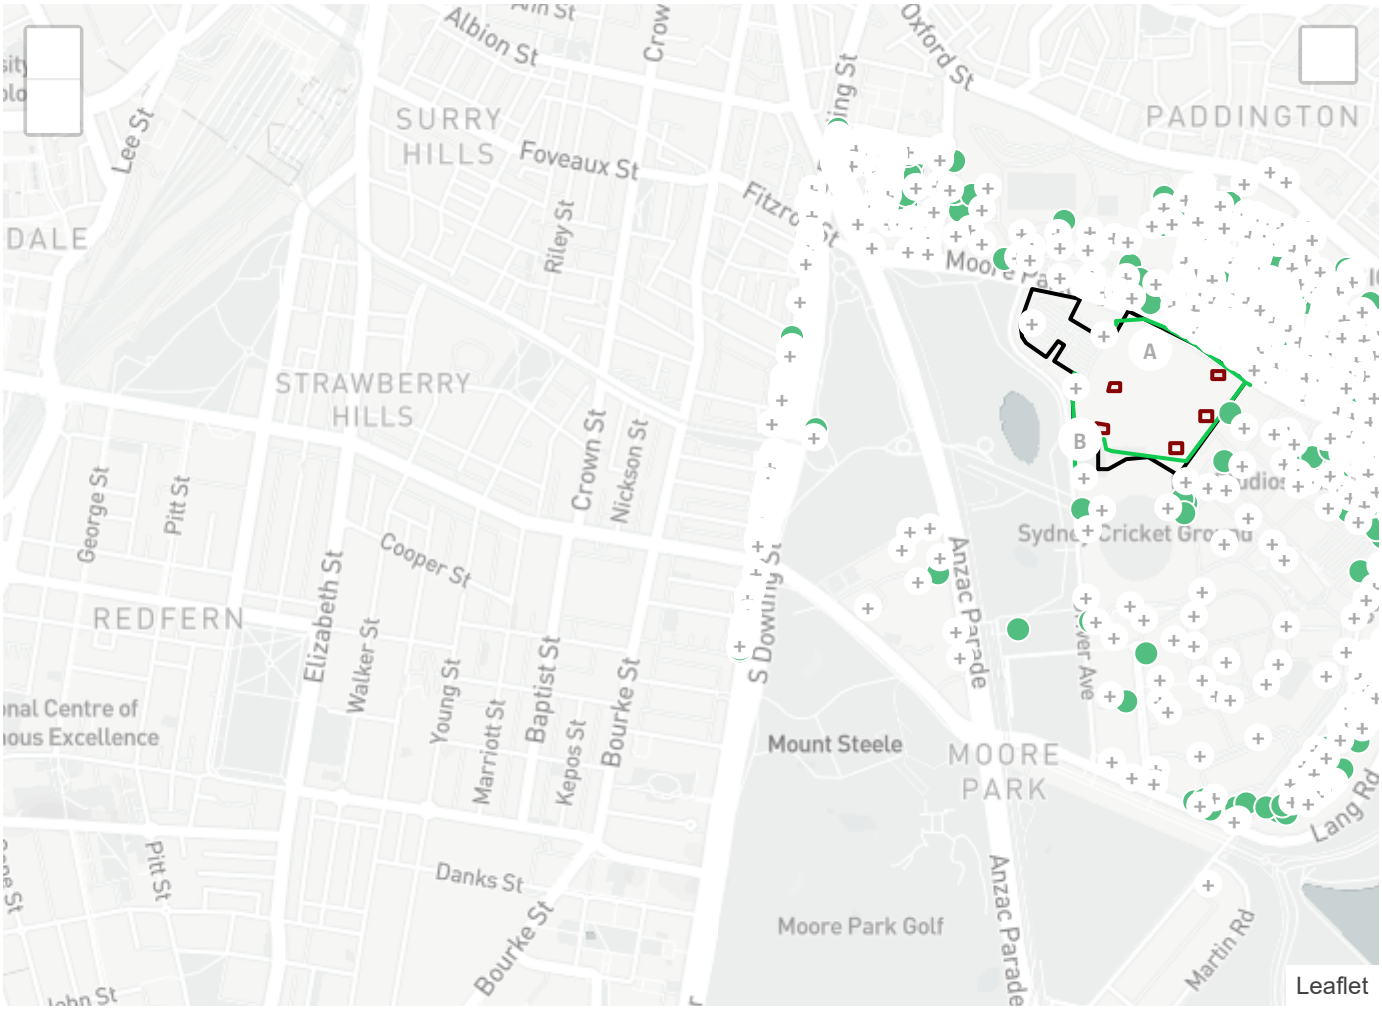

Figure 5-2-1: Paving - Day Outside Standard Hours

5.3 - Facade install - no hand tools

The following tables present the relevant equipment sound power levels and assessment summary.

Table 5-3-1: Facade install - no hand tools - Equipment details

No.	Name	Location	LwA	63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz	Qty	Duration % of 15-min period
A.	Mobile Telescopic Crane (Idling)	[-33.88800672, 151.22508956]	92	99	95	92	89	88	84	78	69	1	100

No.	Name	Location	LwA	63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz	Qty	Duration % of 15-min period
B.	Lifting Platform	[-33.88800672, 151.22508956]	95	106	104	90	91	88	87	86	77	1	50

Table 5-3-2: Facade install - no hand tools - Assessment summary

Period	Receiver Type	Management level				
		A	B	C	D	E
Day Outside Standard Hours	Town Hall	5	0	0	0	0
	Residential	1584	0	0	0	0
	Place of worship	16	0	0	0	0
	Passive Recreation	2	0	0	0	0
	Educational	46	0	0	0	0
	Commercial	339	0	0	0	0
	Child Care	5	0	0	0	0
	Active Recreation	33	0	0	0	0

The following figure(s) shows the equipment locations on site for each working period.

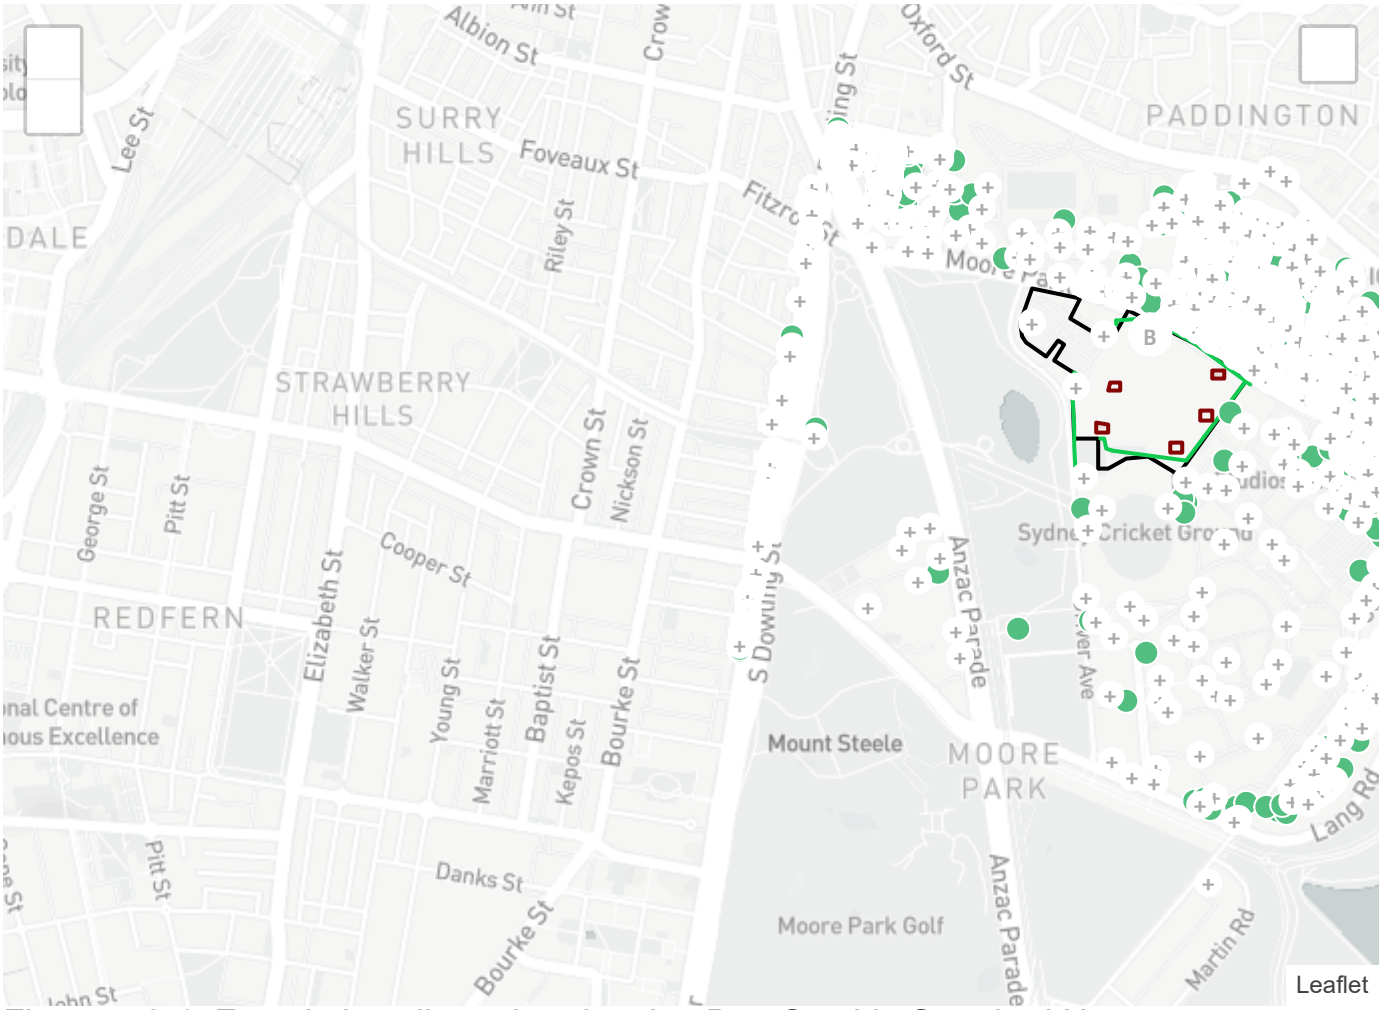

Figure 5-3-1: Facade install - no hand tools - Day Outside Standard Hours

5.4 - Misc Facade Install

The following tables present the relevant equipment sound power levels and assessment summary.

Table 5-4-1: Misc Facade Install - Equipment details

No.	Name	Location	LwA	63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz	Qty	Duration % of 15-min period
A.	Wheeled Mobile Crane	[-33.88807909, 151.22447509]	98	108	100	99	95	93	90	85	77	1	100
B.	Lifting Platform	[-33.88807909, 151.22447509]	95	106	104	90	91	88	87	86	77	1	50
C.	Wheeled Mobile Crane	[-33.88979575, 151.22370393]	98	108	104	99	91	92	91	84	78	1	100
D.	Lifting Platform	[-33.88987805, 151.22370223]	95	106	104	90	91	88	87	86	77	1	100
E.	Hydratorque	[-33.88807909, 151.22447509]	102	105	105	95	94	98	96	90	84	1	100

Table 5-4-2: Misc Facade Install - Assessment summary

Period	Receiver Type	Management level				
		A	B	C	D	E
Day Outside Standard Hours	Town Hall	5	0	0	0	0
	Residential	1584	0	0	0	0
	Place of worship	16	0	0	0	0
	Passive Recreation	2	0	0	0	0
	Educational	46	0	0	0	0
	Commercial	339	0	0	0	0
	Child Care	5	0	0	0	0
	Active Recreation	33	0	0	0	0

The following figure(s) shows the equipment locations on site for each working period.

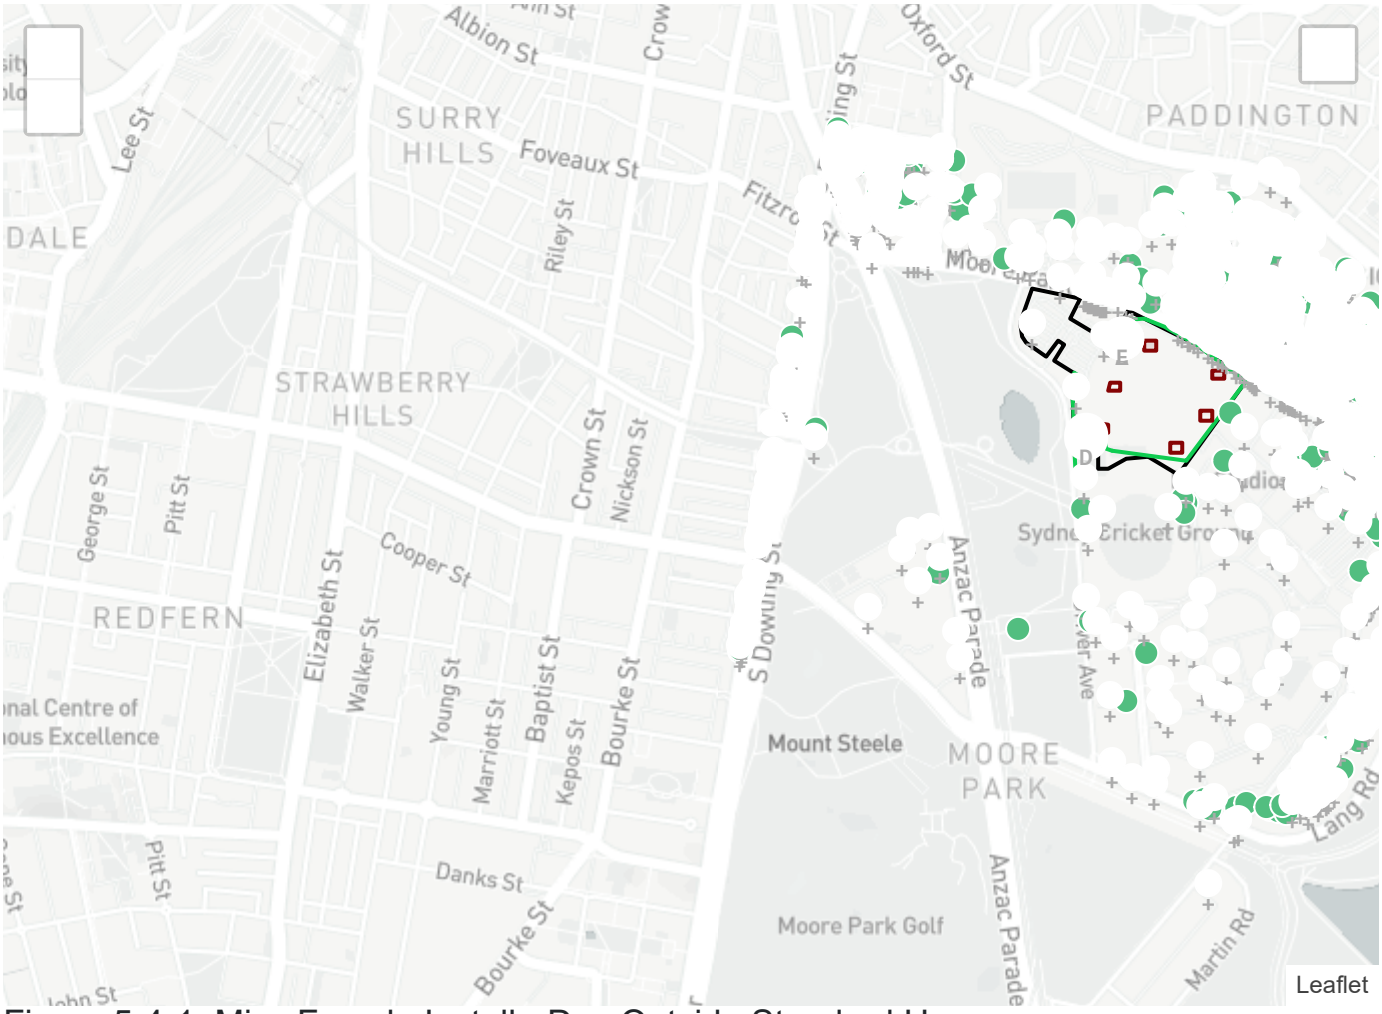

Figure 5-4-1: Misc Facade Install - Day Outside Standard Hours

5.5 - Roof finishes

The following tables present the relevant equipment sound power levels and assessment summary.

Table 5-5-1: Roof finishes - Equipment details

No.	Name	Location	LwA	63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz	Qty	Duration % of 15-min period
A.	Lifting Platform	[-33.88850317, 151.22532447]	95	106	104	90	91	88	87	86	77	1	100

Table 5-5-2: Roof finishes - Assessment summary

Period	Receiver Type	Management level				
		A	B	C	D	E
Day Outside Standard Hours	Town Hall	5	0	0	0	0
	Residential	1584	0	0	0	0
	Place of worship	16	0	0	0	0
	Passive Recreation	2	0	0	0	0
	Educational	46	0	0	0	0
	Commercial	339	0	0	0	0

Period	Receiver Type	Management level				
		A	B	C	D	E
	Child Care	5	0	0	0	0
	Active Recreation	33	0	0	0	0

The following figure(s) shows the equipment locations on site for each working period.

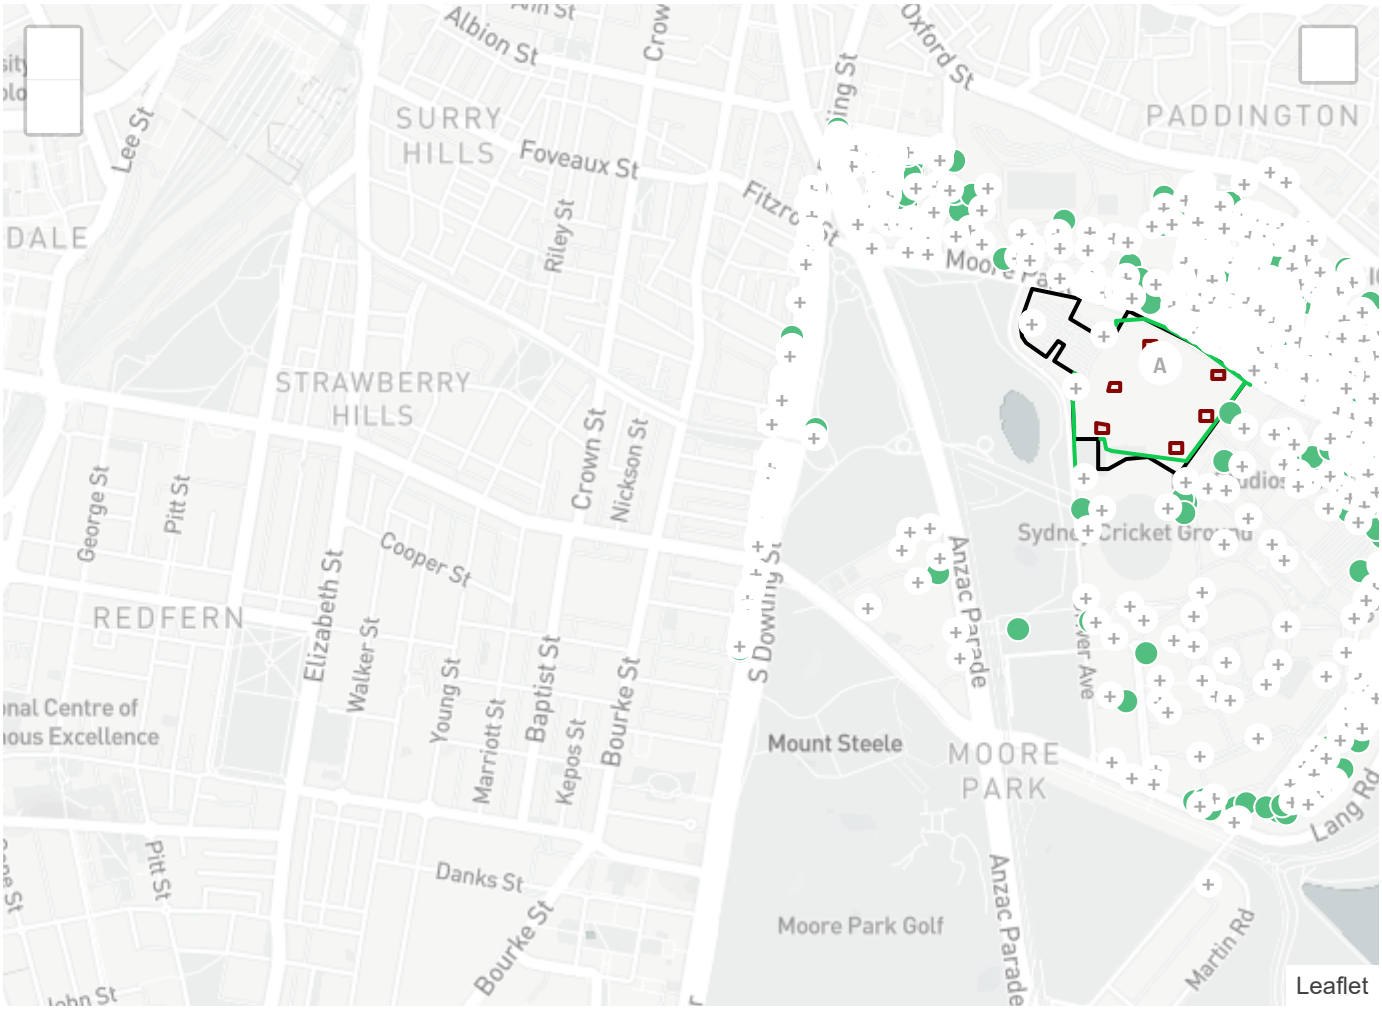

Figure 5-5-1: Roof finishes - Day Outside Standard Hours

5.6 - Pitch works

The following tables present the relevant equipment sound power levels and assessment summary.

Table 5-6-1: Pitch works - Equipment details

No.	Name	Location	LwA	63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz	Qty	Duration % of 15-min period
A.	Truck and Dog	[-33.88874579, 151.22507425]	106	116	109	107	104	10	98	92	88	1	100
B.	Tracked Excavator	[-33.88874579, 151.22507425]	103	102	108	103	101	97	94	88	79	1	100

Table 5-6-2: Pitch works - Assessment summary

Period	Receiver Type	Management level				
		A	B	C	D	E
Day Outside Standard Hours	Town Hall	5	0	0	0	0
	Residential	1584	0	0	0	0
	Place of worship	16	0	0	0	0
	Passive Recreation	2	0	0	0	0
	Educational	46	0	0	0	0
	Commercial	339	0	0	0	0
	Child Care	5	0	0	0	0
	Active Recreation	33	0	0	0	0

The following figure(s) shows the equipment locations on site for each working period.

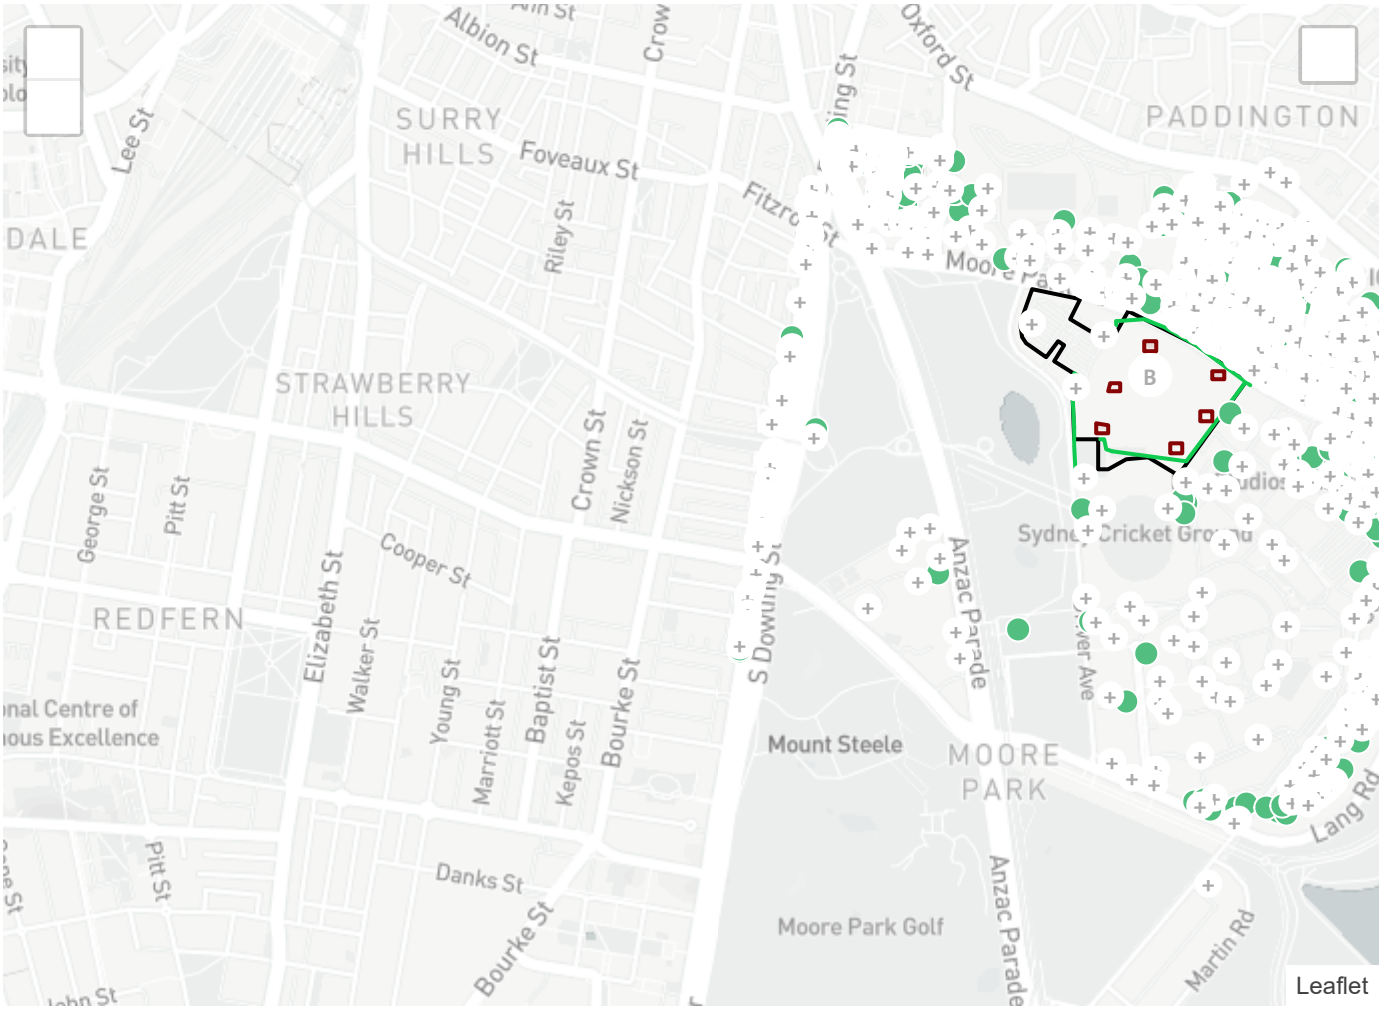

Figure 5-6-1: Pitch works - Day Outside Standard Hours

Appendix A - Assessment details

The following table(s) present the predicted noise levels and corresponding management requirements for receivers that are exceeding noise limit for any working period, for each works scenario.

Table A-1: Facade Cleaning

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1-5 COOK ROAD'	RES	8	5	24 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	7	5	22 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	6	5	21 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	5	5	22 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	4	5	20 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	15 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	14 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	16 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	14 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
' 335203 6248625'	AR	2	0	16 dB(A)	A	Complies
' 335203 6248625'	AR	1	0	15 dB(A)	A	Complies
'2 COOK ROAD'	RES	7	5	25 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	6	5	24 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	5	5	24 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	4	5	22 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	3	5	19 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
' 335206 6248642'	AR	1	0	16 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	7 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	7 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	6 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	1 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	1 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	1 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	5 dB(A)	A	Complies
'1 MARTIN STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1 NEWCOMBE STREET'	C	4	0	15 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	15 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	15 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	15 dB(A)	A	Complies
'1 FURBER ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	8 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	8 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	8 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	8 dB(A)	A	Complies
'1 MITCHELL STREET'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'1 MITCHELL STREET'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	3	3	31 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'2 ANZAC PARADE'	C	1	0	21 dB(A)	A	Complies
'3 LITTLE STEWART STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'3 LITTLE STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'2 FURBER ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'2 IRIS STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'3 CHURCH STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'2 OATLEY ROAD'	C	2	0	19 dB(A)	A	Complies
'2 OATLEY ROAD'	C	1	0	19 dB(A)	A	Complies
'2 MARTIN ROAD'	RES	2	6	4 dB(A)	A	Complies (Bgn + 5)
'2 MARTIN ROAD'	RES	1	6	4 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'3 POATE ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'12 LEINSTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'13 FURBER ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	4	4	23 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'13 POATE ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'14 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'15 CHURCH STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'17 MOORE PARK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	3	4	1 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	2	2	11 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'18 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'19 ALBION AVENUE'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'18 WALTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	3	4	16 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	4	5	24 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'20-22 LEINSTER STREET'	PoW	2	0	10 dB(A)	A	Complies
'20-22 LEINSTER STREET'	PoW	1	0	9 dB(A)	A	Complies
'19 CENTENNIAL LANE'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'19 CENTENNIAL LANE'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'20 FURBER ROAD'	RES	3	5	6 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'20 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'21 WALTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'22 FURBER ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'24 LEINSTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'24 GORDON STREET'	C	4	0	11 dB(A)	A	Complies
'24 GORDON STREET'	C	3	0	11 dB(A)	A	Complies
'24 GORDON STREET'	C	2	0	10 dB(A)	A	Complies
'24 GORDON STREET'	C	1	0	10 dB(A)	A	Complies
'24 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'24 CHURCH STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	1	4	1 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'24 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	11 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'38 WALTER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	8	5	2 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	7	5	2 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	6	5	2 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	5	5	2 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	4	5	2 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'39 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'40-42 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	8	0	5 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	5 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	5 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	5 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	5 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'40 DRIVER AVENUE'	AR	3	0	5 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	5 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	6 dB(A)	A	Complies
'40 COOK ROAD'	RES	3	5	6 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	4	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	13 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	13 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	13 dB(A)	A	Complies
'41 ALBION AVENUE'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	E	2	0	-2 dB(A)	A	Complies
'40 DRIVER AVENUE'	E	1	0	-2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	11	0	28 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	10	0	28 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	9	0	28 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	8	0	27 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	24 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	18 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	17 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	16 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	15 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	2	0	32 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	1	0	30 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	11 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	11 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	12 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	12 dB(A)	A	Complies
'40 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	C	1	0	31 dB(A)	A	Complies
'40 SELWYN STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'41 REGENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	3	5	6 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'42 LEINSTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'42 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'42 SELWYN STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'43 GREENS ROAD'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'44 LEINSTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'44 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	E	11	0	17 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	10	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	9	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	8	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	7	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	6	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	5	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	4	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	3	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	2	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	1	0	12 dB(A)	A	Complies
'44 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	C	5	0	22 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	4	0	22 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	3	0	22 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	2	0	22 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	1	0	14 dB(A)	A	Complies
'46 GORDON STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'46 GORDON STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'44 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'45 GREENS ROAD'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	3	4	10 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'46 WALTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'46 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	4	4	26 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'47 OATLEY ROAD'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'3 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'4 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'4 FURBER ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'5 STEWART PLACE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	4	4	26 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'5 FURBER ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	3	4	1 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'5 RENNY STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'6 CHAPMAN STREET'	C	3	0	20 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	2	0	20 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	1	0	20 dB(A)	A	Complies
'6 CHURCH STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'6 FURBER ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'7 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'8 FURBER ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'8 ALEXANDER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	3	4	6 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'8 IRIS STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'8 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'8 SEYMOUR PLACE'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'9 FURBER ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'10-14 CHURCH STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'10 IRIS STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'10 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'11 FURBER ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'12 FURBER ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'48 STEWART STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	8	5	5 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	7	5	3 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	6	5	2 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	5	5	1 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	4	5	2 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	3	5	2 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	3	4	9 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'48 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	4	4	17 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	3	5	1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'56 SELWYN STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'57 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'58 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	3	5	9 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'61 MOORE PARK ROAD'	CC	1	0	9 dB(A)	A	Complies
'62 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'62 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'61 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'62 LANG ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'63 MOORE PARK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	3	3	19 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'67 REGENT STREET'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	8	5	13 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	7	5	11 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	6	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	5	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	4	5	9 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	3	5	4 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'73 STEWART STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'68 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	3	3	20 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	2	3	19 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'70 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'69-73 MOORE PARK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'70 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'72 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'74 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	10 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	7 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	20 dB(A)	A	Complies
'74 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	18 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	17 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	1	0	15 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	35 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	17 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	12 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	18 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	17 dB(A)	A	Complies
'83 STEWART STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	11 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	12 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	16 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	17 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'81 STEWART STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'81 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	12 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	1	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	32 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	32 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	14 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	18 dB(A)	A	Complies
'33 BENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'30 WALTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	2	2	17 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'31-33 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'31 RENNY STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'31 SELWYN STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	4	4	12 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	2	1	4 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	1	1	3 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	3	3	26 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	3	2	11 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	2	2	11 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'33 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	4	4	13 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'34 LEINSTER STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'33 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'35 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	3	3	26 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'34 MOORE PARK ROAD'	C	1	0	25 dB(A)	A	Complies
'35 MOORE PARK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'37 BENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	3	3	26 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'37 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'37 WALTER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'37 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	16 dB(A)	A	Complies
'38 GORDON STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'38 GORDON STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	8 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	8 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	26 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	18 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	14 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	32 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	AR	1	0	14 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	7 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	7 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	7 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	18 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	15 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	14 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	19 dB(A)	A	Complies
'38 STEWART STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	18 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	35 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	1	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	1 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	1 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	1 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	19 dB(A)	A	Complies
'38 LEINSTER STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	11 dB(A)	A	Complies
'38 SELWYN STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'38 SELWYN STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'38 LANG ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	18 dB(A)	A	Complies
'77-83 COOK ROAD'	RES	7	5	1 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	6	5	0 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	5	5	0 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	4	5	0 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	3	5	0 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	1	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	6	0	29 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	5	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	17 dB(A)	A	Complies
'78 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'78 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'76 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	23 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-1 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-1 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	1 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	2 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	3	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	6 dB(A)	A	Complies
'133-139 COOK ROAD'	RES	3	5	-1 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	2	0	1 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	1 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	2 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	1	0	1 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	2	2	6 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	1	2	6 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'132 FLINDERS STREET'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)
'128 FLINDERS STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	3	2	4 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	4	5	-3 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	3	5	9 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	2	2	5 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	4	2	1 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	3	2	9 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	2	2	9 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	1	2	8 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	2	2	5 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	5	2	1 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'160 FLINDERS STREET'	RES	4	2	1 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	3	2	12 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	2	2	11 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)
'153-155 COOK ROAD'	CC	3	0	-3 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	2	0	3 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	1	0	2 dB(A)	A	Complies
'156 FLINDERS STREET'	RES	2	2	6 dB(A)	A	Complies (Bgn + 5)
'156 FLINDERS STREET'	RES	1	2	6 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	5	2	8 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	4	2	8 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	3	2	8 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	2	2	8 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	1	2	8 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	4	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	38 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	37 dB(A)	A	Complies
'159 COOK ROAD'	CC	1	0	1 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	36 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	38 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	38 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	37 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'228 MOORE PARK ROAD'	C	2	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	34 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	5	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	38 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	38 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	35 dB(A)	A	Complies
'234 MOORE PARK ROAD'	RES	3	3	50 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	3	0	38 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	35 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'236 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'247 OXFORD STREET'	TH	5	0	13 dB(A)	A	Complies
'247 OXFORD STREET'	TH	4	0	12 dB(A)	A	Complies
'247 OXFORD STREET'	TH	3	0	9 dB(A)	A	Complies
'247 OXFORD STREET'	TH	2	0	9 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'247 OXFORD STREET'	TH	1	0	8 dB(A)	A	Complies
'230 MOORE PARK ROAD'	C	1	0	39 dB(A)	A	Complies
'252 MOORE PARK ROAD'	RES	3	3	53 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'230 MOORE PARK ROAD'	C	1	0	28 dB(A)	A	Complies
'255 OXFORD STREET'	RES	4	4	19 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	3	3	51 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'250 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'251-255 OXFORD STREET'	PR	2	0	13 dB(A)	A	Complies
'251-255 OXFORD STREET'	PR	1	0	12 dB(A)	A	Complies
'257 OXFORD STREET'	RES	3	4	16 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	3	3	50 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	3	3	51 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	1	3	43 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	3	3	48 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	44 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'270 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	2	3	43 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'267 OXFORD STREET'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	43 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	12 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	3	4	8 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	3	5	6 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'27 OATLEY ROAD'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	4	4	24 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	3	4	21 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'27 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'28 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'29 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'28 RENNY STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'28 MOORE PARK ROAD'	RES	1	2	13 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	3	4	21 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'29 SELWYN STREET'	RES	2	4	1 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	1	4	1 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	4	5	8 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	4	4	27 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	3	3	15 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'50 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'50 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'52 LANG ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	8	5	6 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	7	5	3 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	6	5	3 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	5	5	1 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	4	5	2 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	3	5	2 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'52 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'54 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'54 LEINSTER STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'54 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'56 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	4	4	17 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'56 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'56 RENNY STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	7	5	1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	6	5	1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	5	5	1 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'57-67 COOK ROAD'	RES	4	5	1 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'280 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	3	3	43 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	2	3	37 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	3	3	42 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	3	3	45 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'345-347 OXFORD STREET'	C	3	0	13 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	2	0	11 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	1	0	12 dB(A)	A	Complies
'358 MOORE PARK ROAD'	RES	3	3	26 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'354 SOUTH DOWLING STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'360 MOORE PARK ROAD'	RES	1	3	17 dB(A)	A	Complies (Bgn + 5)
'349-351 OXFORD STREET'	C	3	0	11 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	2	0	11 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'349-351 OXFORD STREET'	C	1	0	11 dB(A)	A	Complies
'360 MOORE PARK ROAD'	RES	1	3	15 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	5	4	13 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	4	4	12 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	2	2	5 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'356 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	2	3	15 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	3	2	5 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	2	2	5 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	3	2	13 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	2	2	10 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	1	2	8 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	4	2	2 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	3	2	-1 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	2	2	-1 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'360 SOUTH DOWLING STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	3	2	3 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	3	2	14 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	2	2	13 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	1	2	10 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	3	2	17 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	2	2	16 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	1	2	14 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	14 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'378 SOUTH DOWLING STREET'	RES	2	2	14 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	1	2	14 dB(A)	A	Complies (Bgn + 5)
'384 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	14 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'388 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'387-389 OXFORD STREET'	C	3	0	12 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	2	0	12 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	1	0	13 dB(A)	A	Complies
'386 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'385 OXFORD STREET'	C	1	0	11 dB(A)	A	Complies
'390 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	E	1	0	1 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	2 dB(A)	A	Complies
'410 MOORE PARK ROAD'	RES	2	3	12 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	1	0	2 dB(A)	A	Complies
'398 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	2	0	1 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	3 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'414 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'416 MOORE PARK ROAD'	RES	1	3	15 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	3	3	12 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	3	3	9 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	2	3	9 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	3	3	12 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	3	3	8 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	2	3	8 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	8 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	3	3	10 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	2	3	9 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'421 OXFORD STREET'	E	3	0	3 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	1 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	0 dB(A)	A	Complies
'421 OXFORD STREET'	E	3	0	4 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	3 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	2 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	5	0	5 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	4	0	2 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	3	0	2 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	1 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	0 dB(A)	A	Complies
'428 MOORE PARK ROAD'	RES	3	3	7 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	2	3	6 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	1	3	6 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	3	3	15 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	2	3	16 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	3	0	2 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'461-463 OXFORD STREET'	PoW	2	0	1 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	0 dB(A)	A	Complies
'436 MOORE PARK ROAD'	RES	3	3	5 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	2	3	5 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	1	3	5 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	4	2	1 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	3	2	1 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	2	2	1 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	1	2	0 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	3	3	18 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	3	3	3 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	2	3	4 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	1	3	5 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	3	3	18 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	7	2	5 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	6	2	1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	5	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	4	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	3	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	2	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	2	0	-1 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	-2 dB(A)	A	Complies
'473 SOUTH DOWLING STREET'	RES	2	2	2 dB(A)	A	Complies (Bgn + 5)
'473 SOUTH DOWLING STREET'	RES	1	2	1 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	3	1	7 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	2	1	5 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	1	1	4 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	3	1	7 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	2	1	4 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	1	1	4 dB(A)	A	Complies (Bgn + 5)
'495 CLEVELAND STREET'	C	3	0	18 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	2	0	17 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	1	0	17 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'477 SOUTH DOWLING STREET'	RES	4	2	3 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	3	2	3 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	1	2	1 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	5	1	9 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	4	1	9 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	3	1	8 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	2	1	4 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	1	1	4 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	5	2	5 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	4	2	3 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	3	2	3 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	2	2	1 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	1	2	0 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	3	1	7 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	2	1	4 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	1	1	4 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	1	2	1 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	3	1	20 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	3	1	9 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	2	1	4 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	18 dB(A)	A	Complies
'83 LEINSTER STREET'	RES	3	3	18 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	1	3	17 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	8	5	1 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	7	5	1 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	6	5	1 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	5	5	2 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	4	5	2 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	3	5	2 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'80 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	3	3	9 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	2	3	7 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	1	3	6 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	2	3	9 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	1	3	7 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	5	3	31 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	4	3	30 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	3	3	28 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	3	3	12 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	2	3	12 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'84 GORDON STREET'	RES	1	3	4 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	3	3	21 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'90 REGENT STREET'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'84 LANG ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	2	3	12 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'87 PHELPS STREET'	RES	1	1	20 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'88 REGENT STREET'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'97 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	7	5	17 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	6	5	16 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	5	5	10 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	4	5	9 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'95 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	4	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	10 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'104 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	5	0	-2 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	-1 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	-1 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-1 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-1 dB(A)	A	Complies
'114 LANG ROAD'	C	3	0	0 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	3 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'107-111 COOK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'112 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'108 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'110 LANG ROAD'	RES	1	5	-3 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	-2 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	-3 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	1 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'121-125 COOK ROAD'	RES	8	5	0 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	7	5	-2 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	6	5	-2 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	5	5	-2 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	4	5	-2 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	3	5	-2 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	2 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	1 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-3 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	5 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	4	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	10 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	10 dB(A)	A	Complies
'119 LEINSTER STREET'	RES	2	3	12 dB(A)	A	Complies (Bgn + 5)
'119 LEINSTER STREET'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	1	1	20 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	2	1	4 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	1	1	4 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	1	1	15 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	13 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	10 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	4 dB(A)	A	Complies
'569 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'569 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'561 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	3 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	2 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	1 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	16 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	15 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	8 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'560 CLEVELAND STREET'	E	1	0	7 dB(A)	A	Complies
'575 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'575 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	1	0	12 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	14 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	12 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	12 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	10 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	15 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	15 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	14 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	13 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	17 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	17 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	16 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	15 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	11 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	12 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	11 dB(A)	A	Complies
'577 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'577 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	1	1	15 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	3	1	13 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	2	1	12 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	1	1	12 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	3	1	17 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	3	1	14 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	2	1	8 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	1	1	5 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'631 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	3	1	18 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	1	1	18 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	3	1	15 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	1	1	7 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	1	1	15 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	1	1	8 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	4	1	19 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	18 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	1	1	18 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	1	1	18 dB(A)	A	Complies (Bgn + 5)
'653 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	18 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'681 SOUTH DOWLING STREET'	C	2	0	17 dB(A)	A	Complies
'681 SOUTH DOWLING STREET'	C	1	0	17 dB(A)	A	Complies
'691 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	4	1	18 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	3	1	18 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'717 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'721 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'Site Office'	C	1	0	19 dB(A)	A	Complies
'Site Office'	C	1	0	19 dB(A)	A	Complies
'294 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	3	3	39 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	3	3	42 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'304 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'308 MOORE PARK ROAD'	C	5	0	39 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	4	0	39 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	3	0	39 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	2	0	36 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	1	0	35 dB(A)	A	Complies
'302 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	3	3	37 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	3	3	41 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'336 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	3	3	25 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	3	3	25 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'339 OXFORD STREET'	RES	6	4	19 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	5	4	12 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	4	4	11 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'342 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'340 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'338 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	3	3	21 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	1	3	15 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	3	3	23 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)

Table A-2: Paving

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1-5 COOK ROAD'	RES	8	5	26 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	7	5	26 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	6	5	26 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	5	5	24 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	4	5	23 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
' 335203 6248625'	AR	2	0	27 dB(A)	A	Complies
' 335203 6248625'	AR	1	0	27 dB(A)	A	Complies
'2 COOK ROAD'	RES	7	5	28 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	6	5	28 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	5	5	27 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	4	5	25 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	3	5	24 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
' 335206 6248642'	AR	1	0	27 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	13 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	12 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	10 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	5 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	5 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	5 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	17 dB(A)	A	Complies
'1 MARTIN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	31 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	32 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	31 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	30 dB(A)	A	Complies
'1 FURBER ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	15 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	10 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	17 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	17 dB(A)	A	Complies
'1 MITCHELL STREET'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'1 MITCHELL STREET'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1 STEWART STREET'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	3	3	31 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'2 ANZAC PARADE'	C	1	0	30 dB(A)	A	Complies
'3 LITTLE STEWART STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'3 LITTLE STEWART STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'2 IRIS STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'3 CHURCH STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'2 OATLEY ROAD'	C	2	0	36 dB(A)	A	Complies
'2 OATLEY ROAD'	C	1	0	36 dB(A)	A	Complies
'2 MARTIN ROAD'	RES	2	6	12 dB(A)	A	Complies (Bgn + 5)
'2 MARTIN ROAD'	RES	1	6	11 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'3 POATE ROAD'	RES	1	5	29 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'12 LEINSTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	30 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	30 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	4	4	34 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	3	4	34 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'13 POATE ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'14 LANG ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'15 CHURCH STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	2	5	27 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'19 BENT STREET'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	2	2	29 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	1	2	29 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	2	5	29 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'18 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'18 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	4	5	26 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'19 POATE ROAD'	RES	3	5	25 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	26 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'20-22 LEINSTER STREET'	PoW	2	0	23 dB(A)	A	Complies
'20-22 LEINSTER STREET'	PoW	1	0	20 dB(A)	A	Complies
'19 CENTENNIAL LANE'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'19 CENTENNIAL LANE'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'20 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'20 LANG ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'21 WALTER STREET'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	3	5	19 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'23 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'24 LEINSTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'24 GORDON STREET'	C	4	0	29 dB(A)	A	Complies
'24 GORDON STREET'	C	3	0	27 dB(A)	A	Complies
'24 GORDON STREET'	C	2	0	22 dB(A)	A	Complies
'24 GORDON STREET'	C	1	0	20 dB(A)	A	Complies
'24 COOK ROAD'	RES	3	5	24 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'24 CHURCH STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'24 STEWART STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	29 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	29 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'38 WALTER STREET'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	8	5	15 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	7	5	14 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	6	5	14 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	5	5	13 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	4	5	13 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'39-43 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'39 SELWYN STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'40-42 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	8	0	11 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	11 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	11 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	11 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	11 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	10 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	11 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	11 dB(A)	A	Complies
'40 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	4	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	20 dB(A)	A	Complies
'41 ALBION AVENUE'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	E	2	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	E	1	0	3 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	11	0	18 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	10	0	18 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'40 DRIVER AVENUE'	AR	9	0	17 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	8	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	19 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	18 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	17 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	17 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	17 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	17 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	17 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	2	0	47 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	1	0	47 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	19 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	19 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	19 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	19 dB(A)	A	Complies
'40 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	C	1	0	32 dB(A)	A	Complies
'40 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	3	5	6 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'42 LEINSTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'42 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'42 SELWYN STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'43 GREENS ROAD'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'44 LEINSTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	E	11	0	30 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	10	0	29 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	9	0	29 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	8	0	29 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	7	0	29 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	6	0	29 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	5	0	29 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	4	0	29 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	3	0	29 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	2	0	29 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	1	0	28 dB(A)	A	Complies
'44 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	C	5	0	45 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'44 DRIVER AVENUE'	C	4	0	45 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	3	0	45 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	2	0	45 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	1	0	45 dB(A)	A	Complies
'46 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'46 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'44 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	3	4	40 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	3	4	34 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'46 WALTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'47 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'46 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	4	4	40 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	3	4	40 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	2	4	42 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'3 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'4 COOK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'4 FURBER ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'4 RENNY LANE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'5 STEWART PLACE'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	4	4	35 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	3	4	34 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'5 FURBER ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	3	4	7 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'5 RENNY STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'6 CHAPMAN STREET'	C	3	0	26 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	2	0	26 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	1	0	25 dB(A)	A	Complies
'6 CHURCH STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'6 FURBER ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'6 WALTER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'7 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'8 FURBER ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'8 ALEXANDER STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	3	4	9 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'8 IRIS STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'8 LANG ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'8 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'8 SEYMOUR PLACE'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'9 FURBER ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	29 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'10-14 CHURCH STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	5	29 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'10 IRIS STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'10 WALTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'11 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'12 FURBER ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	8	5	16 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	7	5	14 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	6	5	14 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	5	5	13 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	4	5	13 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'48 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'49 REGENT STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	4	4	25 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'56 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	3	4	34 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'57 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'60 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	1	4	40 dB(A)	A	Complies (Bgn + 5)
'61 MOORE PARK ROAD'	CC	1	0	15 dB(A)	A	Complies
'62 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'62 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'61 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'63 MOORE PARK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'69 STEWART STREET'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	1	4	40 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	3	3	26 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'67 REGENT STREET'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	8	5	6 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	7	5	18 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	6	5	18 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	5	5	18 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	4	5	18 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	3	5	9 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	3	4	34 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'68 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'70 REGENT STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'69-73 MOORE PARK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	40 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'70-78 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'70 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'72 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'74 GORDON STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	17 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	11 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	38 dB(A)	A	Complies
'74 LANG ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	35 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	32 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'83 STEWART STREET'	RES	3	4	32 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	35 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	34 dB(A)	A	Complies
'81 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'81 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	42 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	42 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	44 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	39 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	2	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	35 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	31 dB(A)	A	Complies
'33 BENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	3	4	40 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'30 WALTER STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	2	2	31 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	1	2	29 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'31 RENNY STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'31 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'33 ALBION AVENUE'	RES	4	4	21 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	3	4	21 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	1	1	22 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	3	2	30 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	2	2	30 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	1	2	30 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'33 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	4	4	24 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'33 SELWYN STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'35 GORDON STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'34 MOORE PARK ROAD'	C	1	0	27 dB(A)	A	Complies
'35 MOORE PARK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'37 BENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	3	3	28 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'37 GORDON STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'37 SELWYN STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	20 dB(A)	A	Complies
'38 GORDON STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'38 GORDON STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	35 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	4	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	27 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	27 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	28 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	28 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	14 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	41 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	15 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	36 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	2	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	27 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	14 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	32 dB(A)	A	Complies
'38 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	3 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	3 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	24 dB(A)	A	Complies
'38 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	29 dB(A)	A	Complies
'38 SELWYN STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'38 SELWYN STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'39 MOORE PARK ROAD'	RES	3	5	26 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'38 LANG ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'77-83 COOK ROAD'	RES	7	5	12 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	6	5	7 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	5	5	5 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	4	5	5 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	1	0	35 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	6	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	5	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'78 GORDON STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'78 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'76 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	35 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	35 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	10 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	10 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	19 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	15 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	13 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	3	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'133-139 COOK ROAD'	RES	3	5	2 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	2	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	12 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	17 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	2	2	19 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	1	2	19 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'132 FLINDERS STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'128 FLINDERS STREET'	RES	1	2	17 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	3	2	10 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'146 FLINDERS STREET'	RES	2	2	10 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	1	2	13 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	4	5	0 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	3	5	14 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	2	2	19 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	1	2	19 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	4	2	10 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	3	2	13 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	2	2	16 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	1	2	19 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	2	2	15 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	1	2	14 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	5	2	14 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	4	2	13 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	3	2	9 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	2	2	9 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	1	2	9 dB(A)	A	Complies (Bgn + 5)
'153-155 COOK ROAD'	CC	3	0	0 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	2	0	12 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	1	0	9 dB(A)	A	Complies
'156 FLINDERS STREET'	RES	2	2	13 dB(A)	A	Complies (Bgn + 5)
'156 FLINDERS STREET'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	5	2	28 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	4	2	29 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	3	2	29 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	2	2	29 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	1	2	29 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	4	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	44 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'228 MOORE PARK ROAD'	C	1	0	44 dB(A)	A	Complies
'159 COOK ROAD'	CC	1	0	8 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	39 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	5	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	43 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	40 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	41 dB(A)	A	Complies
'234 MOORE PARK ROAD'	RES	3	3	47 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	41 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'236 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'247 OXFORD STREET'	TH	5	0	23 dB(A)	A	Complies
'247 OXFORD STREET'	TH	4	0	23 dB(A)	A	Complies
'247 OXFORD STREET'	TH	3	0	23 dB(A)	A	Complies
'247 OXFORD STREET'	TH	2	0	23 dB(A)	A	Complies
'247 OXFORD STREET'	TH	1	0	23 dB(A)	A	Complies
'230 MOORE PARK ROAD'	C	1	0	45 dB(A)	A	Complies
'252 MOORE PARK ROAD'	RES	3	3	45 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	2	3	45 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'230 MOORE PARK ROAD'	C	1	0	42 dB(A)	A	Complies
'255 OXFORD STREET'	RES	4	4	33 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	3	4	34 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	3	3	45 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	2	3	45 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'250 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'256 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'251-255 OXFORD STREET'	PR	2	0	25 dB(A)	A	Complies
'251-255 OXFORD STREET'	PR	1	0	25 dB(A)	A	Complies
'257 OXFORD STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	3	3	43 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	43 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	3	3	43 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	2	3	43 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	1	3	43 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	3	3	42 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'267 OXFORD STREET'	RES	1	2	22 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	29 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	29 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'25 STEWART STREET'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	1	4	40 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	3	4	16 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	4	4	35 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'27 GORDON STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'28 LEINSTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'28 WALTER STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'29 GORDON STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'28 RENNY STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'28 MOORE PARK ROAD'	RES	1	2	24 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	3	4	40 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	4	5	20 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	4	4	35 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'51 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	3	3	28 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	3	5	19 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'50 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'53 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	3	4	36 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	3	5	19 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	3	4	36 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'52 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	8	5	18 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	7	5	13 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	6	5	13 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	5	5	12 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	4	5	12 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'54 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	3	5	19 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'54 LEINSTER STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'54 REGENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'56 STEWART STREET'	RES	3	4	32 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'56 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	4	4	28 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'56 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'56 RENNY STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	2	3	45 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	7	5	9 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	6	5	8 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	5	5	2 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	4	5	2 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'280 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	3	3	40 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'300 MOORE PARK ROAD'	RES	3	3	39 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	3	3	42 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'345-347 OXFORD STREET'	C	3	0	19 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	2	0	12 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	1	0	10 dB(A)	A	Complies
'358 MOORE PARK ROAD'	RES	3	3	32 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'354 SOUTH DOWLING STREET'	RES	1	2	15 dB(A)	A	Complies (Bgn + 5)
'360 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'349-351 OXFORD STREET'	C	3	0	14 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	2	0	12 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	1	0	12 dB(A)	A	Complies
'360 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	5	4	32 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	4	4	32 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	2	2	12 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)
'356 SOUTH DOWLING STREET'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	3	2	18 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	2	2	18 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	1	2	17 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	3	2	19 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	2	2	17 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'362 SOUTH DOWLING STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	4	2	14 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	3	2	19 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	2	2	19 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'360 SOUTH DOWLING STREET'	RES	1	2	15 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	3	2	17 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	2	2	16 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	1	2	15 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	3	2	21 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	2	2	22 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	1	2	21 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	3	2	21 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	2	2	22 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	1	2	22 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	2	2	21 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	1	2	21 dB(A)	A	Complies (Bgn + 5)
'384 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'388 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'387-389 OXFORD STREET'	C	3	0	18 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	2	0	18 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	1	0	18 dB(A)	A	Complies
'386 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'385 OXFORD STREET'	C	1	0	10 dB(A)	A	Complies
'390 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'390 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	E	1	0	10 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	6 dB(A)	A	Complies
'410 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	1	0	6 dB(A)	A	Complies
'398 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	2	0	4 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	5 dB(A)	A	Complies
'414 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'416 MOORE PARK ROAD'	RES	1	3	17 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	3	3	24 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	3	3	22 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	3	3	22 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	3	3	20 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'424 MOORE PARK ROAD'	RES	3	3	20 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'421 OXFORD STREET'	E	3	0	15 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	10 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	7 dB(A)	A	Complies
'421 OXFORD STREET'	E	3	0	18 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	15 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	13 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	5	0	18 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	4	0	17 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	3	0	13 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	15 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	11 dB(A)	A	Complies
'428 MOORE PARK ROAD'	RES	3	3	21 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	3	3	20 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	2	3	19 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	3	0	13 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	14 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	14 dB(A)	A	Complies
'436 MOORE PARK ROAD'	RES	3	3	20 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	4	2	19 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	3	2	20 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	2	2	19 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	1	2	18 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	3	3	20 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	3	3	7 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	3	3	20 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	2	3	19 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'434 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	7	2	23 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	6	2	23 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	5	2	22 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	4	2	13 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	3	2	8 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	2	2	15 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	2	0	13 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	12 dB(A)	A	Complies
'473 SOUTH DOWLING STREET'	RES	2	2	22 dB(A)	A	Complies (Bgn + 5)
'473 SOUTH DOWLING STREET'	RES	1	2	22 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	3	1	26 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	1	1	26 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	3	1	26 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'495 CLEVELAND STREET'	C	3	0	23 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	2	0	24 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	1	0	24 dB(A)	A	Complies
'477 SOUTH DOWLING STREET'	RES	4	2	24 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	3	2	23 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	2	2	23 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	1	2	22 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	5	1	25 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	4	1	25 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	1	1	22 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	5	2	23 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	4	2	23 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	3	2	22 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	2	2	22 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	1	2	21 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	3	1	26 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'475 SOUTH DOWLING STREET'	RES	2	2	23 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	1	2	23 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	3	1	26 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	3	1	27 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	35 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	31 dB(A)	A	Complies
'83 LEINSTER STREET'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	8	5	7 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	7	5	7 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	6	5	7 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	5	5	7 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	4	5	7 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	3	3	22 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'83 GREENS ROAD'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	5	3	30 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	4	3	30 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	3	3	23 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'84 GORDON STREET'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	3	3	28 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'84 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'87 PHELPS STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'88 REGENT STREET'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'97 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'91 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	7	5	21 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	6	5	21 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	5	5	16 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	4	5	16 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	4	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	17 dB(A)	A	Complies
'104 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'107-111 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	5	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'114 LANG ROAD'	C	3	0	6 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'107-111 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'112 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'108 LANG ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'110 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	12 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	1 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'121-125 COOK ROAD'	RES	8	5	7 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	7	5	3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	6	5	3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	5	5	3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	4	5	3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	6 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	10 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	1 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	0 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	0 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'114 LANG ROAD'	C	1	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	18 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	18 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	10 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'119 LEINSTER STREET'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'119 LEINSTER STREET'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'553 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	20 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	14 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	11 dB(A)	A	Complies
'569 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'569 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'561 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	6 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	4 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	3 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	20 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	11 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	10 dB(A)	A	Complies
'575 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'575 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	1	0	18 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	18 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	19 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	16 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	13 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	20 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	18 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	19 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	19 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	22 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	17 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'560 CLEVELAND STREET'	E	2	0	17 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	18 dB(A)	A	Complies
'577 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'577 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	3	1	24 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	3	1	24 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	4	1	24 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'671 SOUTH DOWLING STREET'	RES	3	1	24 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	2	1	23 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'653 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	24 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	2	1	23 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'681 SOUTH DOWLING STREET'	C	2	0	23 dB(A)	A	Complies
'681 SOUTH DOWLING STREET'	C	1	0	23 dB(A)	A	Complies
'691 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	3	1	19 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	2	1	20 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	1	1	20 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	4	1	22 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	3	1	22 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'705 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'717 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'721 SOUTH DOWLING STREET'	RES	1	1	18 dB(A)	A	Complies (Bgn + 5)
'Site Office'	C	1	0	32 dB(A)	A	Complies
'Site Office'	C	1	0	33 dB(A)	A	Complies
'294 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	3	3	38 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	3	3	39 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'308 MOORE PARK ROAD'	C	5	0	37 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	4	0	37 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	3	0	37 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	2	0	37 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	1	0	37 dB(A)	A	Complies
'302 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	3	3	35 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	3	3	38 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'320 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'336 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	3	3	31 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	6	4	31 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	5	4	31 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	4	4	27 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'342 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'340 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'338 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	3	3	25 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'348 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)

Table A-3: Facade install - no hand tools

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1-5 COOK ROAD'	RES	8	5	24 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	7	5	22 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	6	5	19 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	5	5	19 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	4	5	19 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	3	5	15 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
' 335203 6248625'	AR	2	0	19 dB(A)	A	Complies
' 335203 6248625'	AR	1	0	19 dB(A)	A	Complies
'2 COOK ROAD'	RES	7	5	25 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	6	5	22 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	5	5	22 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	4	5	21 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
' 335206 6248642'	AR	1	0	21 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	-3 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1 DRIVER AVENUE'	C	2	0	-3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	-3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	4 dB(A)	A	Complies
'1 MARTIN STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	21 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	18 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	15 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	14 dB(A)	A	Complies
'1 FURBER ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	9 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	6 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	6 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	6 dB(A)	A	Complies
'1 MITCHELL STREET'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'1 MITCHELL STREET'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'3 GORDON STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'2 ANZAC PARADE'	C	1	0	21 dB(A)	A	Complies
'3 LITTLE STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'3 LITTLE STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'2 IRIS STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'3 CHURCH STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'2 OATLEY ROAD'	C	2	0	36 dB(A)	A	Complies
'2 OATLEY ROAD'	C	1	0	32 dB(A)	A	Complies
'2 MARTIN ROAD'	RES	2	6	-1 dB(A)	A	Complies (Bgn + 5)
'2 MARTIN ROAD'	RES	1	6	-1 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'3 POATE ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'12 LEINSTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'13 ALBION AVENUE'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	4	4	28 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'13 POATE ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'14 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'15 CHURCH STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	3	4	36 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'15 POATE ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	3	4	1 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	2	2	10 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	1	2	10 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	3	4	36 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'18 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'18 FURBER ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'18 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	4	5	22 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	19 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'20-22 LEINSTER STREET'	PoW	2	0	13 dB(A)	A	Complies
'20-22 LEINSTER STREET'	PoW	1	0	10 dB(A)	A	Complies
'19 CENTENNIAL LANE'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'19 CENTENNIAL LANE'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'21 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	3	5	4 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'20 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'21 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'23 MARTIN STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	3	5	9 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'24 LEINSTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'24 GORDON STREET'	C	4	0	16 dB(A)	A	Complies
'24 GORDON STREET'	C	3	0	13 dB(A)	A	Complies
'24 GORDON STREET'	C	2	0	10 dB(A)	A	Complies
'24 GORDON STREET'	C	1	0	9 dB(A)	A	Complies
'24 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'24 CHURCH STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'25 ALBION AVENUE'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'24 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	11 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'38 WALTER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	8	5	2 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	7	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	6	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	5	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	4	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	3	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'39 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'40-42 STEWART STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	8	0	1 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'40 DRIVER AVENUE'	AR	7	0	1 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	1 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	1 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	2 dB(A)	A	Complies
'40 COOK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	4	0	6 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	6 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	7 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	7 dB(A)	A	Complies
'41 ALBION AVENUE'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	E	2	0	-5 dB(A)	A	Complies
'40 DRIVER AVENUE'	E	1	0	-6 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	11	0	7 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	10	0	7 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	9	0	7 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	8	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	2	0	32 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	1	0	31 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	9 dB(A)	A	Complies
'40 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	C	1	0	30 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'40 SELWYN STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	3	5	1 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'42 LEINSTER STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'42 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'42 SELWYN STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'43 GREENS ROAD'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'44 LEINSTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'45 REGENT STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	E	11	0	17 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	10	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	9	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	8	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	7	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	6	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	5	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	4	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	3	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	2	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	1	0	17 dB(A)	A	Complies
'44 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	C	5	0	18 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	4	0	18 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	3	0	18 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	2	0	18 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	1	0	19 dB(A)	A	Complies
'46 GORDON STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'46 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'44 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'47 BENT STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'46 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'46 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'49-51 STEWART STREET'	RES	4	4	30 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	2	4	43 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	1	4	40 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'3 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'4 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'4 FURBER ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'5 STEWART PLACE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	4	4	30 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'8 LEINSTER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'5 FURBER ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	3	4	1 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'5 RENNY STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'6 CHAPMAN STREET'	C	3	0	6 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	2	0	1 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	1	0	0 dB(A)	A	Complies
'6 CHURCH STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'6 FURBER ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'8 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'7 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'8 FURBER ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'8 ALEXANDER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	3	4	4 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'8 IRIS STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'8 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'8 SEYMOUR PLACE'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'9 FURBER ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'10 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'10-14 CHURCH STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'10 IRIS STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'10 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'11 FURBER ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'12 FURBER ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'48 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	8	5	7 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	7	5	4 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	6	5	4 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	5	5	4 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	4	5	4 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	3	5	4 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	3	4	8 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'48 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	4	4	12 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	3	5	-1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'56 SELWYN STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	3	4	21 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'57 SELWYN STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'61 REGENT STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'61 MOORE PARK ROAD'	CC	1	0	7 dB(A)	A	Complies
'62 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'62 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'61 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	2	4	1 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'63 MOORE PARK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	3	3	16 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	2	3	15 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	1	3	14 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'67 REGENT STREET'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	8	5	-2 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	7	5	15 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	6	5	14 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	5	5	13 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	4	5	12 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'69-75 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	3	5	9 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'68 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	3	3	18 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	2	3	17 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'70 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'69-73 MOORE PARK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	3	5	17 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'70 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'72 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'74 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	2	5	-3 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	1	5	-3 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	10 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	7 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	33 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'74 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	14 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	14 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	17 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	12 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	35 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	18 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	18 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	21 dB(A)	A	Complies
'83 STEWART STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	10 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	10 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	17 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'81 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'81 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	11 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	15 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	40 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	14 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	38 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	20 dB(A)	A	Complies
'33 BENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'30 WALTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	2	2	15 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	1	2	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'33 BENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'31 RENNY STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'31 SELWYN STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	3	5	1 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	4	4	10 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	3	4	9 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	2	1	0 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	1	1	0 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	3	3	27 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	3	2	11 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	2	2	11 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'33 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	4	4	9 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'35 ALBION AVENUE'	RES	3	4	8 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'33 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'35 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	3	3	27 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'34 MOORE PARK ROAD'	C	1	0	27 dB(A)	A	Complies
'35 MOORE PARK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'37 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'37 MOORE PARK ROAD'	RES	3	3	27 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'37 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'37 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	12 dB(A)	A	Complies
'38 GORDON STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'38 GORDON STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	7 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	6 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	8 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	8 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	14 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	9 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	9 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	3 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	3 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	1	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	14 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	5 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	5 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	5 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	18 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	18 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	15 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	26 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	18 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	5 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	5 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	15 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	30 dB(A)	A	Complies
'38 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	24 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	5	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	-1 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	-1 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	-1 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	8 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	13 dB(A)	A	Complies
'38 LEINSTER STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	11 dB(A)	A	Complies
'38 SELWYN STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'38 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'38 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'77-83 COOK ROAD'	RES	7	5	3 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	6	5	0 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	5	5	-1 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	4	5	-2 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	3	5	-2 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	32 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	6	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	5	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'78 GORDON STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'78 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'76 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	28 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-3 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	2 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	2 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	3	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'133-139 COOK ROAD'	RES	3	5	-2 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	-3 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'133-139 COOK ROAD'	RES	1	5	-3 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	2	0	0 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-1 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	2 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	2	2	6 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	1	2	6 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'132 FLINDERS STREET'	RES	1	2	7 dB(A)	A	Complies (Bgn + 5)
'128 FLINDERS STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	3	2	4 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	4	5	-4 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	4	2	1 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	3	2	11 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	2	2	11 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	1	2	10 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'144 FLINDERS STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	5	2	1 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	4	2	1 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	3	2	11 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	2	2	11 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	1	2	10 dB(A)	A	Complies (Bgn + 5)
'153-155 COOK ROAD'	CC	3	0	-4 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	2	0	1 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	1	0	2 dB(A)	A	Complies
'156 FLINDERS STREET'	RES	2	2	6 dB(A)	A	Complies (Bgn + 5)
'156 FLINDERS STREET'	RES	1	2	6 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	5	2	5 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	4	2	6 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	3	2	6 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	2	2	6 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	1	2	6 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	4	0	46 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	46 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	46 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	43 dB(A)	A	Complies
'159 COOK ROAD'	CC	1	0	2 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	36 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	46 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	46 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	36 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	38 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'228 MOORE PARK ROAD'	C	2	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	36 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	36 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	5	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	36 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	37 dB(A)	A	Complies
'234 MOORE PARK ROAD'	RES	3	3	48 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	2	3	48 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	3	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	38 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	37 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	1	3	43 dB(A)	A	Complies (Bgn + 5)
'236 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'247 OXFORD STREET'	TH	5	0	23 dB(A)	A	Complies
'247 OXFORD STREET'	TH	4	0	23 dB(A)	A	Complies
'247 OXFORD STREET'	TH	3	0	23 dB(A)	A	Complies
'247 OXFORD STREET'	TH	2	0	23 dB(A)	A	Complies
'247 OXFORD STREET'	TH	1	0	20 dB(A)	A	Complies
'230 MOORE PARK ROAD'	C	1	0	46 dB(A)	A	Complies
'252 MOORE PARK ROAD'	RES	3	3	44 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	2	3	44 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'230 MOORE PARK ROAD'	C	1	0	32 dB(A)	A	Complies
'255 OXFORD STREET'	RES	4	4	27 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	3	3	45 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	2	3	45 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'250 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'251-255 OXFORD STREET'	PR	2	0	13 dB(A)	A	Complies
'251-255 OXFORD STREET'	PR	1	0	13 dB(A)	A	Complies
'257 OXFORD STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	3	3	41 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	3	3	42 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'272 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	3	3	41 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'267 OXFORD STREET'	RES	1	2	10 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	12 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	3	4	7 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'29 BENT STREET'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	4	4	21 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'27 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'28 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'29 GORDON STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'28 RENNY STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'28 MOORE PARK ROAD'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	2	4	1 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	1	4	1 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	3	4	10 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	4	5	9 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	4	4	27 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	1	4	40 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	3	3	16 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'49 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'50 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'52 LANG ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	8	5	8 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	7	5	6 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	6	5	5 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	5	5	6 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'53-55 COOK ROAD'	RES	4	5	3 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'54 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'54 LEINSTER STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'54 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	3	4	21 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'56 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	4	4	21 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	3	4	16 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'56 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'56 RENNY STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'57 OATLEY ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	7	5	6 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	6	5	-1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	5	5	-1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	4	5	-1 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'280 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	3	3	37 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	37 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	3	3	36 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	3	3	40 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'345-347 OXFORD STREET'	C	3	0	8 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	2	0	7 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	1	0	7 dB(A)	A	Complies
'358 MOORE PARK ROAD'	RES	3	3	23 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'354 SOUTH DOWLING STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'360 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'349-351 OXFORD STREET'	C	3	0	8 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	2	0	7 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	1	0	7 dB(A)	A	Complies
'360 MOORE PARK ROAD'	RES	1	3	14 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	5	4	25 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	4	4	20 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	2	2	-1 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'356 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	3	2	6 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	2	2	5 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	1	2	6 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	3	2	14 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	2	2	10 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	1	2	7 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	4	2	3 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	3	2	9 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	2	2	5 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	1	2	2 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'360 SOUTH DOWLING STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	3	2	3 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	3	2	3 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	3	2	14 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'376 SOUTH DOWLING STREET'	RES	2	2	13 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	2	2	12 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	1	2	10 dB(A)	A	Complies (Bgn + 5)
'384 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'388 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'387-389 OXFORD STREET'	C	3	0	10 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	2	0	9 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	1	0	8 dB(A)	A	Complies
'386 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'385 OXFORD STREET'	C	1	0	6 dB(A)	A	Complies
'390 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	14 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	12 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	E	1	0	1 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	-3 dB(A)	A	Complies
'410 MOORE PARK ROAD'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'395 OXFORD STREET'	PoW	1	0	-1 dB(A)	A	Complies
'398 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	2	0	-3 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	-2 dB(A)	A	Complies
'414 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'416 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	3	3	11 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	9 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	3	3	8 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	2	3	7 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	1	3	7 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	3	3	9 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	2	3	8 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	15 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	3	3	7 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	2	3	6 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	1	3	6 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	9 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	3	3	8 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	2	3	7 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	1	3	7 dB(A)	A	Complies (Bgn + 5)
'421 OXFORD STREET'	E	3	0	1 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	-2 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	-4 dB(A)	A	Complies
'421 OXFORD STREET'	E	3	0	5 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	3 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	1 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	5	0	11 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	4	0	9 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	3	0	7 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	2 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	-1 dB(A)	A	Complies
'428 MOORE PARK ROAD'	RES	3	3	5 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	2	3	5 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	1	3	5 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'430 MOORE PARK ROAD'	RES	3	3	3 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	2	3	3 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	1	3	3 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	3	0	4 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	4 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	3 dB(A)	A	Complies
'436 MOORE PARK ROAD'	RES	3	3	4 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	2	3	3 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	1	3	2 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	4	2	0 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	3	2	0 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	2	2	0 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	1	2	0 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	3	3	18 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	1	3	17 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	3	3	1 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	2	3	3 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	1	3	2 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	3	3	18 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	1	3	17 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	7	2	1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	6	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	5	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	4	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	3	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	2	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	2	0	1 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	-1 dB(A)	A	Complies
'473 SOUTH DOWLING STREET'	RES	2	2	1 dB(A)	A	Complies (Bgn + 5)
'473 SOUTH DOWLING STREET'	RES	1	2	1 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	3	1	5 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	2	1	2 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	1	1	2 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	3	1	4 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	2	1	4 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'485 SOUTH DOWLING STREET'	RES	1	1	0 dB(A)	A	Complies (Bgn + 5)
'495 CLEVELAND STREET'	C	3	0	14 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	2	0	14 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	1	0	13 dB(A)	A	Complies
'477 SOUTH DOWLING STREET'	RES	4	2	2 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	3	2	2 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	2	2	2 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	1	2	0 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	5	1	4 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	4	1	4 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	3	1	4 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	2	1	1 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	5	2	2 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	4	2	1 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	3	2	2 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	2	2	2 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	3	1	4 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	2	1	1 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	1	2	1 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	3	1	15 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	2	1	5 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	3	1	4 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	2	1	1 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	1	1	0 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	2	1	2 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	18 dB(A)	A	Complies
'83 LEINSTER STREET'	RES	3	3	16 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	8	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	7	5	0 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'80 COOK ROAD'	RES	6	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	5	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	4	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	3	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	3	3	15 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	2	3	8 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	1	3	6 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	5	3	29 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	4	3	29 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	3	3	16 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'88 GORDON STREET'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'84 GORDON STREET'	RES	1	3	2 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	3	3	19 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	2	3	16 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	1	3	15 dB(A)	A	Complies (Bgn + 5)
'84 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'87 PHELPS STREET'	RES	1	1	0 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'88 REGENT STREET'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'97 STEWART STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	7	5	15 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	6	5	15 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	5	5	16 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	4	5	15 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	3	5	14 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'98 LANG ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	4	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'104 LANG ROAD'	RES	1	5	-4 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	5	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-3 dB(A)	A	Complies
'114 LANG ROAD'	C	3	0	-2 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	-2 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'107-111 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'112 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'108 LANG ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'110 LANG ROAD'	RES	1	5	-4 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'114 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	-4 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	-4 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	0 dB(A)	A	Complies
'121-125 COOK ROAD'	RES	8	5	-1 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	7	5	-3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	6	5	-4 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	5	5	-4 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	4	5	-3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	3	5	-3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	2	5	-3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	1 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	-1 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	-5 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-5 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-5 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	7 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	1	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	1 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'119 LEINSTER STREET'	RES	2	3	17 dB(A)	A	Complies (Bgn + 5)
'119 LEINSTER STREET'	RES	1	3	15 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	2	3	17 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	2	1	4 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	2	1	1 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	2	1	3 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	11 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	11 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	7 dB(A)	A	Complies
'569 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'569 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'561 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	-10 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	-11 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'560 CLEVELAND STREET'	E	1	0	-11 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	16 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	15 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	7 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	6 dB(A)	A	Complies
'575 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'575 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	1	0	11 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	13 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	10 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	10 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	9 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	14 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	14 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	14 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	13 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	15 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	15 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	15 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	14 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	13 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	13 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	13 dB(A)	A	Complies
'577 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'577 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	3	1	20 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	3	1	15 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	3	1	8 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'625-629 SOUTH DOWLING STREET'	RES	2	1	7 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	1	1	5 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	3	1	17 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	3	1	14 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	3	1	15 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	1	1	7 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	1	1	8 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	4	1	14 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	14 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'653 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	14 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'671 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'681 SOUTH DOWLING STREET'	C	2	0	14 dB(A)	A	Complies
'681 SOUTH DOWLING STREET'	C	1	0	13 dB(A)	A	Complies
'691 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	4	1	16 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	1	1	15 dB(A)	A	Complies (Bgn + 5)
'717 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'721 SOUTH DOWLING STREET'	RES	1	1	7 dB(A)	A	Complies (Bgn + 5)
'Site Office'	C	1	0	14 dB(A)	A	Complies
'Site Office'	C	1	0	14 dB(A)	A	Complies
'294 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	3	3	33 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'298 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	3	3	36 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'308 MOORE PARK ROAD'	C	5	0	34 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	4	0	34 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	3	0	34 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	2	0	34 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	1	0	34 dB(A)	A	Complies
'302 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	3	3	36 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'336 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	3	3	22 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'350 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	3	3	22 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	6	4	17 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	5	4	11 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	4	4	10 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	3	4	9 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'342 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'340 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'338 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	3	3	18 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	2	3	19 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	2	3	19 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	3	3	20 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)

Table A-4: Misc Facade Install

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1-5 COOK ROAD'	RES	8	5	33 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	7	5	33 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	6	5	30 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	5	5	31 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	4	5	31 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	3	5	29 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	2	5	27 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
' 335203 6248625'	AR	2	0	34 dB(A)	A	Complies
' 335203 6248625'	AR	1	0	32 dB(A)	A	Complies
'2 COOK ROAD'	RES	7	5	35 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	6	5	34 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	5	5	33 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	4	5	33 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	3	5	31 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	2	5	28 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
' 335206 6248642'	AR	1	0	32 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	14 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	14 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	14 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	9 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	9 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	9 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	15 dB(A)	A	Complies
'1 MARTIN STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	33 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	30 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	28 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	26 dB(A)	A	Complies
'1 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	18 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	15 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	15 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	15 dB(A)	A	Complies
'1 MITCHELL STREET'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'1 MITCHELL STREET'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1 SEYMOUR PLACE'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	3	4	46 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	2	4	44 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	1	4	44 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	3	3	33 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'2 ANZAC PARADE'	C	1	0	35 dB(A)	A	Complies
'3 LITTLE STEWART STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'3 LITTLE STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'2 IRIS STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'3 CHURCH STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'2 OATLEY ROAD'	C	2	0	35 dB(A)	A	Complies
'2 OATLEY ROAD'	C	1	0	35 dB(A)	A	Complies
'2 MARTIN ROAD'	RES	2	6	8 dB(A)	A	Complies (Bgn + 5)
'2 MARTIN ROAD'	RES	1	6	8 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'3 POATE ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'4 RENNY LANE'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'12 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	31 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	29 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	30 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	3	37 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	4	4	36 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'15 WALTER STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'13 POATE ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'14 LANG ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'15 CHURCH STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	2	5	29 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	2	5	29 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'16 WALTER STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	2	2	28 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	1	2	28 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'18 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'18 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'19 GORDON STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	4	5	29 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	28 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	27 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	29 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	27 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'20-22 LEINSTER STREET'	PoW	2	0	25 dB(A)	A	Complies
'20-22 LEINSTER STREET'	PoW	1	0	22 dB(A)	A	Complies
'19 CENTENNIAL LANE'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'19 CENTENNIAL LANE'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'20 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'20 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'21 WALTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'25 BENT STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'24 LEINSTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'24 GORDON STREET'	C	4	0	31 dB(A)	A	Complies
'24 GORDON STREET'	C	3	0	26 dB(A)	A	Complies
'24 GORDON STREET'	C	2	0	22 dB(A)	A	Complies
'24 GORDON STREET'	C	1	0	19 dB(A)	A	Complies
'24 COOK ROAD'	RES	3	5	25 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'24 CHURCH STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'24 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	28 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	28 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'38 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	8	5	21 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	7	5	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'39-43 COOK ROAD'	RES	6	5	19 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	5	5	17 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	4	5	16 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	3	5	17 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	2	4	42 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'39 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'40-42 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	8	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	15 dB(A)	A	Complies
'40 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	4	0	23 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	23 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	23 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	24 dB(A)	A	Complies
'41 ALBION AVENUE'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'40 DRIVER AVENUE'	E	2	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	E	1	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	11	0	19 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	10	0	19 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	9	0	19 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	8	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	2	0	50 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	1	0	50 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	23 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	23 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	23 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	23 dB(A)	A	Complies
'40 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	C	1	0	36 dB(A)	A	Complies
'40 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	2	4	42 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'41 SELWYN STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'42 LEINSTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'42 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'42 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'43 GREENS ROAD'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'44 LEINSTER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	3	5	14 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	E	11	0	38 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	10	0	38 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	9	0	38 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	8	0	38 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	7	0	39 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	6	0	39 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	5	0	39 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	4	0	39 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	3	0	39 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'44 DRIVER AVENUE'	E	2	0	39 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	1	0	39 dB(A)	A	Complies
'44 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	C	5	0	48 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	4	0	49 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	3	0	49 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	2	0	49 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	1	0	49 dB(A)	A	Complies
'46 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'46 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'44 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	3	4	42 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'46 RENNY STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'46 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'46 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	3	4	16 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	4	4	40 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	2	4	44 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	1	4	44 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'3 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'4 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'4 FURBER ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'4 LANG ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'5 STEWART PLACE'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	4	4	40 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	3	4	39 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'5 FURBER ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'5 RENNY STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'6 CHAPMAN STREET'	C	3	0	28 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'6 CHAPMAN STREET'	C	2	0	26 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	1	0	25 dB(A)	A	Complies
'6 CHURCH STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'6 FURBER ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'7 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'8 FURBER ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	3	4	39 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'8 ALEXANDER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	2	3	37 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'8 IRIS STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'8 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'8 SEYMOUR PLACE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'9 FURBER ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'10-14 CHURCH STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	5	28 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'10 IRIS STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	3	37 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	3	5	24 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'10 WALTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'11 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'11 FURBER ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'12 FURBER ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	8	5	26 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	7	5	23 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	6	5	23 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	5	5	19 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	4	5	19 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	3	5	19 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'49 GORDON STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'48 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	4	4	22 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'56 SELWYN STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	3	4	34 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'57 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	3	4	40 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	42 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	3	5	28 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	2	5	27 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'58 COOK ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'61 MOORE PARK ROAD'	CC	1	0	18 dB(A)	A	Complies
'62 REGENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'62 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'61 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'63 MOORE PARK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'64 LANG ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	3	3	27 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'67 REGENT STREET'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	2	5	30 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	1	5	30 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	8	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	7	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	6	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	5	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	4	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	3	4	36 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'68 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	3	3	31 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'70 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'69-73 MOORE PARK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'71 STEWART STREET'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	2	5	28 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'70 COOK ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'72 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'74 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	16 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	18 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	18 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	41 dB(A)	A	Complies
'74 LANG ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	40 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	40 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	41 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	45 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	45 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	28 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	32 dB(A)	A	Complies
'83 STEWART STREET'	RES	3	4	32 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	18 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'81 STEWART STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'81 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	41 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	41 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	46 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	38 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	1	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	47 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	48 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	48 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	47 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	46 dB(A)	A	Complies
'75 OXFORD STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'33 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'30 WALTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	2	2	29 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	1	2	29 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'31 RENNY STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'31 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'32 RENNY STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	4	4	13 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	3	3	36 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	3	2	29 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	2	2	29 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	1	2	29 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'33 GORDON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	4	4	24 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'33 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'35 GORDON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	3	3	36 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'36 POATE LANE'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'34 MOORE PARK ROAD'	C	1	0	25 dB(A)	A	Complies
'35 MOORE PARK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'37 BENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	3	3	32 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'37 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	2	4	42 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'37 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	23 dB(A)	A	Complies
'38 GORDON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'38 GORDON STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	2	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	41 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	41 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	40 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	39 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	39 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	39 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	44 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	39 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	23 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	1	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	44 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	43 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	43 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	43 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	42 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	26 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	25 dB(A)	A	Complies
'38 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	34 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	34 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	34 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	27 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	28 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	28 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	26 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	24 dB(A)	A	Complies
'38 LEINSTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	2	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	35 dB(A)	A	Complies
'38 SELWYN STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'38 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	3	5	30 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	2	5	28 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'38 LANG ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	45 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	45 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	44 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	42 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'77-83 COOK ROAD'	RES	7	5	14 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	6	5	11 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	5	5	10 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	4	5	10 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	6	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	5	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	21 dB(A)	A	Complies
'78 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'78 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'76 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	33 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	17 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	1	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	15 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	14 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	3	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	15 dB(A)	A	Complies
'133-139 COOK ROAD'	RES	3	5	9 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	2	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	8 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	21 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	2	2	24 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	1	2	24 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	2	2	22 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	1	2	21 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'127-131 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'132 FLINDERS STREET'	RES	1	2	21 dB(A)	A	Complies (Bgn + 5)
'128 FLINDERS STREET'	RES	1	2	19 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	3	2	18 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	2	2	17 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	1	2	17 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	4	5	6 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	4	2	14 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	3	2	14 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	2	2	18 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	1	2	18 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	2	2	15 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	2	2	18 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	1	2	19 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	5	2	15 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	4	2	14 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	3	2	13 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	2	2	13 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	1	2	13 dB(A)	A	Complies (Bgn + 5)
'153-155 COOK ROAD'	CC	3	0	6 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	2	0	10 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	1	0	11 dB(A)	A	Complies
'156 FLINDERS STREET'	RES	2	2	18 dB(A)	A	Complies (Bgn + 5)
'156 FLINDERS STREET'	RES	1	2	18 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	5	2	28 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	4	2	29 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	3	2	29 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	2	2	29 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'162 FLINDERS STREET'	RES	1	2	29 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	4	0	55 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	55 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	55 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	50 dB(A)	A	Complies
'159 COOK ROAD'	CC	1	0	10 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	56 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	56 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	56 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	54 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	33 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	33 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	54 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	54 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	54 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	53 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	42 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	5	0	55 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	55 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	55 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	55 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	50 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	40 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'228 MOORE PARK ROAD'	C	3	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	43 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	46 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	43 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	43 dB(A)	A	Complies
'234 MOORE PARK ROAD'	RES	3	3	52 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	2	3	51 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	1	3	47 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	3	0	47 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	47 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	47 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	43 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	2	3	50 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'236 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'247 OXFORD STREET'	TH	5	0	27 dB(A)	A	Complies
'247 OXFORD STREET'	TH	4	0	26 dB(A)	A	Complies
'247 OXFORD STREET'	TH	3	0	19 dB(A)	A	Complies
'247 OXFORD STREET'	TH	2	0	17 dB(A)	A	Complies
'247 OXFORD STREET'	TH	1	0	11 dB(A)	A	Complies
'230 MOORE PARK ROAD'	C	1	0	50 dB(A)	A	Complies
'252 MOORE PARK ROAD'	RES	3	3	51 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	2	3	50 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	1	3	47 dB(A)	A	Complies (Bgn + 5)
'230 MOORE PARK ROAD'	C	1	0	45 dB(A)	A	Complies
'255 OXFORD STREET'	RES	4	4	36 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	3	4	36 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	3	3	50 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'246 MOORE PARK ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'250 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'251-255 OXFORD STREET'	PR	2	0	33 dB(A)	A	Complies
'251-255 OXFORD STREET'	PR	1	0	28 dB(A)	A	Complies
'257 OXFORD STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	3	3	49 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	48 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	3	3	50 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	3	3	48 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'267 OXFORD STREET'	RES	1	2	21 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	48 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'24 MOORE PARK ROAD'	RES	2	2	28 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	28 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	3	4	39 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	4	4	38 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	3	4	39 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'27 WALTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'27 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	3	5	25 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'28 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'29 GORDON STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'28 RENNY STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'28 MOORE PARK ROAD'	RES	1	2	27 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	4	5	21 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	19 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'30-38 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	4	4	40 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	2	4	45 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	1	4	45 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	3	3	31 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	3	4	32 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'50 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	3	5	26 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'53 MOORE PARK ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	3	4	36 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	3	4	36 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'52 LANG ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	8	5	24 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	7	5	21 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	6	5	21 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	5	5	11 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	4	5	11 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'54 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	3	5	27 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'54 LEINSTER STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'54 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'54 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'56 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	4	4	33 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'56 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'56 RENNY STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	2	3	51 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	1	3	49 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	7	5	13 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	6	5	10 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	5	5	10 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	4	5	11 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'280 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	3	3	46 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	45 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'292 MOORE PARK ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	1	3	43 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	3	3	45 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	2	3	45 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	3	3	48 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	48 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'345-347 OXFORD STREET'	C	3	0	22 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'358 MOORE PARK ROAD'	RES	3	3	37 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'354 SOUTH DOWLING STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'360 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'349-351 OXFORD STREET'	C	3	0	17 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	2	0	17 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	1	0	17 dB(A)	A	Complies
'360 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	5	4	32 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	4	4	28 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	2	2	16 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	1	2	15 dB(A)	A	Complies (Bgn + 5)
'356 SOUTH DOWLING STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	3	2	22 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'372 SOUTH DOWLING STREET'	RES	2	2	22 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	3	2	21 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	1	2	18 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	4	2	12 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	3	2	21 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	1	2	19 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'360 SOUTH DOWLING STREET'	RES	1	2	17 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	3	2	21 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	3	2	21 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	2	2	21 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	3	2	21 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	1	2	19 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	2	2	15 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	1	2	15 dB(A)	A	Complies (Bgn + 5)
'384 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'388 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'387-389 OXFORD STREET'	C	3	0	21 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	2	0	19 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	1	0	18 dB(A)	A	Complies
'386 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'385 OXFORD STREET'	C	1	0	17 dB(A)	A	Complies
'390 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	E	1	0	10 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	9 dB(A)	A	Complies
'410 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	1	0	8 dB(A)	A	Complies
'398 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	2	0	6 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	7 dB(A)	A	Complies
'414 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'416 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	3	3	27 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	3	3	24 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	3	3	25 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	3	3	24 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'426 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	17 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	3	3	24 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'421 OXFORD STREET'	E	3	0	13 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	10 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	7 dB(A)	A	Complies
'421 OXFORD STREET'	E	3	0	14 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	12 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	11 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	5	0	22 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	4	0	21 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	3	0	19 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	14 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	11 dB(A)	A	Complies
'428 MOORE PARK ROAD'	RES	3	3	24 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	3	3	23 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	3	0	17 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	16 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	14 dB(A)	A	Complies
'436 MOORE PARK ROAD'	RES	3	3	24 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	4	2	12 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	3	2	13 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	2	2	13 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	1	2	13 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	3	3	23 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	3	3	12 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'438 MOORE PARK ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	3	3	23 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	7	2	24 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	6	2	23 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	5	2	23 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	4	2	20 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	3	2	20 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	2	2	23 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	1	2	23 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	2	0	13 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	11 dB(A)	A	Complies
'473 SOUTH DOWLING STREET'	RES	2	2	24 dB(A)	A	Complies (Bgn + 5)
'473 SOUTH DOWLING STREET'	RES	1	2	24 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'495 CLEVELAND STREET'	C	3	0	24 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	2	0	25 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	1	0	25 dB(A)	A	Complies
'477 SOUTH DOWLING STREET'	RES	4	2	24 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	3	2	24 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	2	2	24 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	1	2	24 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	5	1	25 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	4	1	25 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	5	2	24 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	4	2	24 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	3	2	24 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	2	2	24 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'479 SOUTH DOWLING STREET'	RES	1	2	24 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	2	2	24 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	1	2	24 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	3	1	31 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	2	1	31 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	1	1	31 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	3	1	26 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	2	1	31 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'83 LEINSTER STREET'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	8	5	11 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	7	5	11 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	6	5	11 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	5	5	11 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	4	5	12 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	3	5	25 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	3	3	25 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	3	4	34 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'83 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	5	3	38 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	4	3	38 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	3	3	38 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	3	3	27 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'84 GORDON STREET'	RES	1	3	17 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'84 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'87 PHELPS STREET'	RES	1	1	31 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'88 REGENT STREET'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'90 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'97 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	7	5	26 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	6	5	26 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	5	5	23 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	4	5	22 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	4	0	21 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	20 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	19 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	18 dB(A)	A	Complies
'104 LANG ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'107-111 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	5	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	8 dB(A)	A	Complies
'114 LANG ROAD'	C	3	0	10 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	10 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	10 dB(A)	A	Complies
'107-111 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'112 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'108 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'110 LANG ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	12 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	9 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	8 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'121-125 COOK ROAD'	RES	8	5	10 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	7	5	8 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	6	5	8 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	5	5	8 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	4	5	9 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	3	5	9 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	10 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	14 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	1	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	6 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	10 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	13 dB(A)	A	Complies
'119 LEINSTER STREET'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'119 LEINSTER STREET'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	2	1	31 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	1	1	31 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	2	1	31 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	2	1	30 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	18 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	15 dB(A)	A	Complies
'569 SOUTH DOWLING STREET'	RES	2	1	32 dB(A)	A	Complies (Bgn + 5)
'569 SOUTH DOWLING STREET'	RES	1	1	31 dB(A)	A	Complies (Bgn + 5)
'561 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	2	1	31 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	5 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	4 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	4 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	23 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	22 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	13 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	11 dB(A)	A	Complies
'575 SOUTH DOWLING STREET'	RES	2	1	31 dB(A)	A	Complies (Bgn + 5)
'575 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	1	0	23 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	19 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	20 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	18 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	16 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	25 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	24 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	24 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	23 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	25 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'560 CLEVELAND STREET'	E	3	0	25 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	25 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	24 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	23 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	22 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	22 dB(A)	A	Complies
'577 SOUTH DOWLING STREET'	RES	2	1	31 dB(A)	A	Complies (Bgn + 5)
'577 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	2	1	31 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	2	1	30 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	3	1	31 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	3	1	26 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	3	1	30 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	2	1	30 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	3	1	30 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	30 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	3	1	29 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	22 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	3	1	27 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'649 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	4	1	25 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'653 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'681 SOUTH DOWLING STREET'	C	2	0	24 dB(A)	A	Complies
'681 SOUTH DOWLING STREET'	C	1	0	24 dB(A)	A	Complies
'691 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	2	1	22 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	2	1	22 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	3	1	23 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	2	1	22 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	4	1	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'711 SOUTH DOWLING STREET'	RES	3	1	23 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	2	1	22 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	2	1	22 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	2	1	22 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	2	1	22 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	2	1	22 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'717 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'721 SOUTH DOWLING STREET'	RES	1	1	20 dB(A)	A	Complies (Bgn + 5)
'Site Office'	C	1	0	30 dB(A)	A	Complies
'Site Office'	C	1	0	30 dB(A)	A	Complies
'294 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	3	3	44 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	2	3	43 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	3	3	46 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	2	3	45 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'308 MOORE PARK ROAD'	C	5	0	44 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	4	0	44 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	3	0	43 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	2	0	43 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	1	0	43 dB(A)	A	Complies
'302 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	3	3	42 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	3	3	44 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'306 MOORE PARK ROAD'	RES	2	3	44 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	1	3	43 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	2	3	37 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'336 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	3	3	34 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	3	3	35 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	6	4	34 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	5	4	32 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	4	4	32 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'342 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'340 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'338 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'352 MOORE PARK ROAD'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	3	3	33 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)

Table A-5: Roof finishes

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1-5 COOK ROAD'	RES	8	5	17 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	7	5	15 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	6	5	14 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	5	5	5 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	4	5	5 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	3	5	4 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
' 335203 6248625'	AR	2	0	8 dB(A)	A	Complies
' 335203 6248625'	AR	1	0	8 dB(A)	A	Complies
'2 COOK ROAD'	RES	7	5	20 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	6	5	17 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	5	5	12 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	4	5	12 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	3	5	17 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
' 335206 6248642'	AR	1	0	8 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1 DRIVER AVENUE'	C	3	0	3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	-3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	-3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	-3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	2 dB(A)	A	Complies
'1 MARTIN STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	14 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	14 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	14 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	13 dB(A)	A	Complies
'1 FURBER ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	6 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	5 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	5 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	5 dB(A)	A	Complies
'1 MITCHELL STREET'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'1 MITCHELL STREET'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	3	4	16 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	-2 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	-1 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	1 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	3	3	13 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'3 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'2 ANZAC PARADE'	C	1	0	20 dB(A)	A	Complies
'3 LITTLE STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'3 LITTLE STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'2 IRIS STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'3 CHURCH STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'2 OATLEY ROAD'	C	2	0	29 dB(A)	A	Complies
'2 OATLEY ROAD'	C	1	0	28 dB(A)	A	Complies
'2 MARTIN ROAD'	RES	2	6	-3 dB(A)	A	Complies (Bgn + 5)
'2 MARTIN ROAD'	RES	1	6	-3 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'3 POATE ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'12 LEINSTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	2	4	3 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'12 SEYMOUR PLACE'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	4	4	17 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	3	4	16 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'13 POATE ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	3	5	6 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'14 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'15 CHURCH STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	3	4	1 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	2	4	1 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	2	4	3 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	2	2	21 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	1	2	21 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'18 BENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	2	4	3 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'18 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	0 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	4	5	9 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'20-22 LEINSTER STREET'	PoW	2	0	9 dB(A)	A	Complies
'20-22 LEINSTER STREET'	PoW	1	0	7 dB(A)	A	Complies
'19 CENTENNIAL LANE'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'19 CENTENNIAL LANE'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'19 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	2	4	3 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	2	4	0 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	1	4	0 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'20 SELWYN STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'21 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'22 WALTER STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	3	5	4 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	3	5	6 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'24 LEINSTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'24 GORDON STREET'	C	4	0	14 dB(A)	A	Complies
'24 GORDON STREET'	C	3	0	13 dB(A)	A	Complies
'24 GORDON STREET'	C	2	0	11 dB(A)	A	Complies
'24 GORDON STREET'	C	1	0	10 dB(A)	A	Complies
'24 COOK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'24 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'24 CHURCH STREET'	RES	1	4	-1 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	2	4	1 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	1	4	1 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'24 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	21 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	21 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'38 WALTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	8	5	2 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	7	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	6	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	5	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	4	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	3	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'39 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'40-42 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'40 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	8	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	2 dB(A)	A	Complies
'40 COOK ROAD'	RES	3	5	0 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	4	0	7 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	7 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	7 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	7 dB(A)	A	Complies
'41 ALBION AVENUE'	RES	3	4	4 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	E	2	0	-6 dB(A)	A	Complies
'40 DRIVER AVENUE'	E	1	0	-6 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	11	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	10	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	9	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	8	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	10 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	2	0	28 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	1	0	28 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	9 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'40 DRIVER AVENUE'	AR	2	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	9 dB(A)	A	Complies
'40 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	C	1	0	30 dB(A)	A	Complies
'40 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	3	5	1 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'42 LEINSTER STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	3	4	4 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'42 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'42 SELWYN STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'43 GREENS ROAD'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'43 MOORE PARK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'44 LEINSTER STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	3	5	1 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	E	11	0	25 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	10	0	25 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	9	0	25 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	8	0	25 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	7	0	25 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	6	0	25 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	5	0	25 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	4	0	25 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	3	0	25 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	2	0	6 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	1	0	7 dB(A)	A	Complies
'44 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	C	5	0	23 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	4	0	23 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	3	0	13 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	2	0	13 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	1	0	13 dB(A)	A	Complies
'46 GORDON STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'46 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'44 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'45 OATLEY ROAD'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	3	4	2 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'46 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'46 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	3	4	3 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'47 COOK ROAD'	RES	3	5	2 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	4	4	24 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	3	4	21 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'3 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'4 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'4 FURBER ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'5 STEWART PLACE'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	4	4	25 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	2	4	3 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'5 FURBER ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	3	4	-1 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	2	4	0 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	1	4	0 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'5 RENNY STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'6 CHAPMAN STREET'	C	3	0	18 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	2	0	16 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	1	0	13 dB(A)	A	Complies
'6 CHURCH STREET'	RES	1	4	1 dB(A)	A	Complies (Bgn + 5)
'6 FURBER ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	2	4	0 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	1	4	0 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'7-17 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'7 POATE ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'8 FURBER ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'8 ALEXANDER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	3	4	2 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'8 IRIS STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'8 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'8 SEYMOUR PLACE'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'9 FURBER ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'9 STEWART STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'10-14 CHURCH STREET'	RES	1	4	1 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'10 IRIS STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	2	4	3 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'10 WALTER STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'11 FURBER ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'11 RENNY STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'12 FURBER ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	8	5	8 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	7	5	3 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	6	5	2 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	5	5	2 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	4	5	2 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	3	4	6 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'48 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	4	4	12 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	3	5	-2 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'56 SELWYN STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	3	4	21 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'59 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'57 SELWYN STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	2	4	3 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'65 STEWART STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'61 MOORE PARK ROAD'	CC	1	0	5 dB(A)	A	Complies
'62 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'62 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'61 SELWYN STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	2	4	-1 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	1	4	-1 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	2	5	-3 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	1	5	-3 dB(A)	A	Complies (Bgn + 5)
'63 MOORE PARK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	2	4	3 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	3	3	17 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	2	3	16 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'67 REGENT STREET'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	8	5	-2 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	7	5	9 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	6	5	8 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'69-75 COOK ROAD'	RES	5	5	7 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	4	5	6 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	3	5	0 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'68 GORDON STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	3	3	17 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	2	3	16 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'70 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'69-73 MOORE PARK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'70 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'72 GORDON STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'74 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	2	5	-3 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	1	5	-3 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	3	0	6 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	6 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	5 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'74 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	16 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	16 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	5 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	6 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	6 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	7 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	6 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	13 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	12 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	7 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	8 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	8 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	16 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	15 dB(A)	A	Complies
'83 STEWART STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	9 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	9 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	10 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	3 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	4 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	14 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	16 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	16 dB(A)	A	Complies
'81 STEWART STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'81 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	4 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	6 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	7 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	9 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	9 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	11 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	6 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	6 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	11 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	16 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	15 dB(A)	A	Complies
'33 BENT STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	3	4	21 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'31 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'30 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	2	2	9 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	1	2	9 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'31 RENNY STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'31 SELWYN STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	4	4	-1 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	3	4	-1 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	2	4	-1 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	1	4	0 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	1	1	12 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	3	3	13 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	3	2	4 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'32 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'33 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	4	4	-1 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	3	4	-1 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	2	4	-1 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	1	4	-1 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'33 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'35 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	3	3	12 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	2	3	12 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'34 MOORE PARK ROAD'	C	1	0	8 dB(A)	A	Complies
'35 MOORE PARK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'36 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	2	4	0 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	1	4	0 dB(A)	A	Complies (Bgn + 5)
'37 BENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	3	3	12 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	2	3	9 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'37 GORDON STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'37 SELWYN STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	13 dB(A)	A	Complies
'38 GORDON STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'38 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	5 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	5 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	8 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	11 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	2	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	9 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	2 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	2 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	6 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	6 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	6 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	6 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	6 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	6 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	3 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	18 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	15 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	15 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	6 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	8 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	27 dB(A)	A	Complies
'38 STEWART STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	-2 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	-2 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	-1 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	8 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	13 dB(A)	A	Complies
'38 LEINSTER STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	23 dB(A)	A	Complies
'38 SELWYN STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'38 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'38 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	3 dB(A)	A	Complies
'77-83 COOK ROAD'	RES	7	5	1 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	6	5	0 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	5	5	-1 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'77-83 COOK ROAD'	RES	4	5	-1 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	3	5	0 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	1	0	17 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	8 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	10 dB(A)	A	Complies
'75 OXFORD STREET'	C	6	0	8 dB(A)	A	Complies
'75 OXFORD STREET'	C	5	0	7 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	7 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	7 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	7 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	7 dB(A)	A	Complies
'78 GORDON STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'78 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'76 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	18 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-3 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	-2 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	-2 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	3	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'133-139 COOK ROAD'	RES	3	5	-3 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	-4 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	-4 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	2	0	0 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	0 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	0 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-1 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	-2 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	-2 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	2	2	5 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	1	2	6 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	2	2	2 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	1	2	2 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'132 FLINDERS STREET'	RES	1	2	6 dB(A)	A	Complies (Bgn + 5)
'128 FLINDERS STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	3	2	2 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	2	2	2 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	1	2	2 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	4	5	-5 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	3	5	2 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	4	2	-2 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'158 FLINDERS STREET'	RES	3	2	-1 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	2	2	-1 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	5	2	-2 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	4	2	-1 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	3	2	-1 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	2	2	-1 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'153-155 COOK ROAD'	CC	3	0	-5 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	2	0	-1 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	1	0	0 dB(A)	A	Complies
'156 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'156 FLINDERS STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	5	2	19 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	4	2	19 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	3	2	20 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	4	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	32 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	28 dB(A)	A	Complies
'159 COOK ROAD'	CC	1	0	0 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	30 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	26 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	36 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	36 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	29 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	30 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	26 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	33 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'228 MOORE PARK ROAD'	C	3	0	33 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	26 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	30 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	26 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	30 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	29 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	5	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	27 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	32 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	32 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	26 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	30 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	29 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	32 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	32 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	30 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	26 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	32 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	26 dB(A)	A	Complies
'234 MOORE PARK ROAD'	RES	3	3	44 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	3	0	32 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	26 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'244 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'236 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'247 OXFORD STREET'	TH	5	0	15 dB(A)	A	Complies
'247 OXFORD STREET'	TH	4	0	15 dB(A)	A	Complies
'247 OXFORD STREET'	TH	3	0	15 dB(A)	A	Complies
'247 OXFORD STREET'	TH	2	0	15 dB(A)	A	Complies
'247 OXFORD STREET'	TH	1	0	15 dB(A)	A	Complies
'230 MOORE PARK ROAD'	C	1	0	31 dB(A)	A	Complies
'252 MOORE PARK ROAD'	RES	3	3	44 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'230 MOORE PARK ROAD'	C	1	0	24 dB(A)	A	Complies
'255 OXFORD STREET'	RES	4	4	23 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	3	3	44 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'250 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'251-255 OXFORD STREET'	PR	2	0	8 dB(A)	A	Complies
'251-255 OXFORD STREET'	PR	1	0	7 dB(A)	A	Complies
'257 OXFORD STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	3	3	42 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	3	3	43 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'270 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	3	3	41 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	37 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'267 OXFORD STREET'	RES	1	2	8 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	37 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	22 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	22 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'26 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	3	5	6 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	4	4	22 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	2	3	12 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'27 GORDON STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	2	4	-1 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	1	4	-1 dB(A)	A	Complies (Bgn + 5)
'28 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'29 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'28 RENNY STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'28 MOORE PARK ROAD'	RES	1	2	9 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	2	4	-1 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	1	4	-1 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	3	4	10 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	4	5	5 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	4 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	4	4	24 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	3	4	16 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	3	3	13 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	2	3	12 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'51 GORDON STREET'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'50 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	3	5	6 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	3	4	21 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'52 LANG ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'53-55 COOK ROAD'	RES	8	5	11 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	7	5	1 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	6	5	-1 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	5	5	-1 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	4	5	-1 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	3	5	-1 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'54 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'54 LEINSTER STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'54 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	3	4	16 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'56 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	4	4	21 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'56 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'56 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'56 RENNY STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	7	5	-1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	6	5	-2 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	5	5	-2 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	4	5	-2 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'280 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	3	3	38 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	3	3	37 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	3	4	10 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	3	3	40 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'345-347 OXFORD STREET'	C	3	0	9 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	2	0	8 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'345-347 OXFORD STREET'	C	1	0	8 dB(A)	A	Complies
'358 MOORE PARK ROAD'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'354 SOUTH DOWLING STREET'	RES	1	2	-2 dB(A)	A	Complies (Bgn + 5)
'360 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'349-351 OXFORD STREET'	C	3	0	7 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	2	0	7 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	1	0	7 dB(A)	A	Complies
'360 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	5	4	13 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	4	4	11 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	2	2	-3 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	1	2	-3 dB(A)	A	Complies (Bgn + 5)
'356 SOUTH DOWLING STREET'	RES	1	2	-3 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	3	2	4 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	3	2	-2 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	2	2	-2 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	1	2	-2 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	4	2	-1 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	3	2	-1 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	2	2	-1 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	2	3	9 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'360 SOUTH DOWLING STREET'	RES	1	2	1 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	3	2	1 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	2	2	1 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	1	2	2 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	3	2	2 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'374 SOUTH DOWLING STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	3	2	2 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	2	2	2 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	2	2	2 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	1	2	2 dB(A)	A	Complies (Bgn + 5)
'384 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	7 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	2	3	8 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	1	3	7 dB(A)	A	Complies (Bgn + 5)
'388 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'387-389 OXFORD STREET'	C	3	0	9 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	2	0	9 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	1	0	10 dB(A)	A	Complies
'386 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'385 OXFORD STREET'	C	1	0	7 dB(A)	A	Complies
'390 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	2	3	7 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	1	3	7 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	7 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	7 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	6 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	6 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'395 OXFORD STREET'	E	1	0	-2 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	-1 dB(A)	A	Complies
'410 MOORE PARK ROAD'	RES	2	3	9 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	1	0	-2 dB(A)	A	Complies
'398 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	2	0	-3 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	-1 dB(A)	A	Complies
'414 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'416 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	3	3	11 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	9 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	3	3	6 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	2	3	5 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	1	3	6 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	3	3	8 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	2	3	7 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	1	3	7 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	3	3	5 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	2	3	5 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	1	3	5 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	4 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	4 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	3	3	7 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	2	3	6 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	1	3	6 dB(A)	A	Complies (Bgn + 5)
'421 OXFORD STREET'	E	3	0	-2 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	-4 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	-5 dB(A)	A	Complies
'421 OXFORD STREET'	E	3	0	4 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	2 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	0 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	5	0	3 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	4	0	2 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	3	0	0 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	-3 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'461-463 OXFORD STREET'	PoW	1	0	-5 dB(A)	A	Complies
'428 MOORE PARK ROAD'	RES	3	3	2 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	2	3	2 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	1	3	2 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	3	3	3 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	2	3	2 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	1	3	3 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	3	0	3 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	2 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	-1 dB(A)	A	Complies
'436 MOORE PARK ROAD'	RES	3	3	4 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	2	3	3 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	1	3	2 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	4	2	-2 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	3	2	-1 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	2	2	-1 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	3	3	2 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	2	3	1 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	1	3	1 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	3	3	2 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	2	3	2 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	1	3	1 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	3	3	5 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	2	3	4 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	1	3	3 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	7	2	16 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	6	2	15 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	5	2	7 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	4	2	1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	3	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	2	2	-2 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	1	2	-2 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	2	0	-2 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	-4 dB(A)	A	Complies
'473 SOUTH DOWLING STREET'	RES	2	2	6 dB(A)	A	Complies (Bgn + 5)
'473 SOUTH DOWLING STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	3	1	18 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'487 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	3	1	18 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'495 CLEVELAND STREET'	C	3	0	15 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	2	0	15 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	1	0	15 dB(A)	A	Complies
'477 SOUTH DOWLING STREET'	RES	4	2	3 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	3	2	2 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	2	2	1 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	1	2	0 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	5	1	17 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	4	1	18 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	3	1	18 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	1	1	12 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	5	2	4 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	4	2	3 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	3	2	1 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	2	2	0 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	3	1	18 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	2	2	5 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	3	1	18 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	3	1	19 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	1	1	12 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	16 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	13 dB(A)	A	Complies
'83 LEINSTER STREET'	RES	3	3	16 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'83 LEINSTER STREET'	RES	2	3	15 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	1	3	15 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	8	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	7	5	-1 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	6	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	5	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	4	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	3	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	3	3	7 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	2	3	7 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	1	3	6 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	2	3	7 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	1	3	6 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	3	4	1 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	2	4	1 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	5	3	29 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	4	3	28 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	3	3	25 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'85 STEWART STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	3	3	8 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	2	3	8 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	1	3	7 dB(A)	A	Complies (Bgn + 5)
'84 GORDON STREET'	RES	1	3	1 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	3	3	18 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	2	3	16 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'84 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'87 PHELPS STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'88 REGENT STREET'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	2	5	-4 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'97 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	7	5	15 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	6	5	15 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	5	5	13 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	4	5	11 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'91 GREENS ROAD'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	4	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'104 LANG ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	5	0	-4 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-3 dB(A)	A	Complies
'114 LANG ROAD'	C	3	0	-3 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	-2 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	0 dB(A)	A	Complies
'107-111 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'112 LANG ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'108 LANG ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'110 LANG ROAD'	RES	1	5	-5 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	2 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	-4 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	-5 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	-1 dB(A)	A	Complies
'121-125 COOK ROAD'	RES	8	5	-2 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	7	5	-4 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	6	5	-4 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	5	5	-4 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	4	5	-4 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	3	5	-4 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	2	5	-4 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	0 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	-1 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	-6 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-5 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-5 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	6 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	-1 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	1 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'119 LEINSTER STREET'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'119 LEINSTER STREET'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	2	1	9 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	1	1	8 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	10 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	3 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	-3 dB(A)	A	Complies
'569 SOUTH DOWLING STREET'	RES	2	1	9 dB(A)	A	Complies (Bgn + 5)
'569 SOUTH DOWLING STREET'	RES	1	1	9 dB(A)	A	Complies (Bgn + 5)
'561 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'571 SOUTH DOWLING STREET'	RES	2	1	9 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	1	1	9 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	-1 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	-2 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	-4 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	11 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	11 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	0 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	-2 dB(A)	A	Complies
'575 SOUTH DOWLING STREET'	RES	2	1	9 dB(A)	A	Complies (Bgn + 5)
'575 SOUTH DOWLING STREET'	RES	1	1	8 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	1	0	7 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	9 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	9 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	6 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	2 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	9 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	9 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	9 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	9 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	10 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	10 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	10 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	11 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	8 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	8 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	8 dB(A)	A	Complies
'577 SOUTH DOWLING STREET'	RES	2	1	9 dB(A)	A	Complies (Bgn + 5)
'577 SOUTH DOWLING STREET'	RES	1	1	8 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	2	1	9 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	1	1	8 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	2	1	9 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	1	1	8 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	3	1	10 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	2	1	10 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	1	1	9 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'645 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	3	1	8 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	2	1	1 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	3	1	8 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	7 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	7 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	3	1	8 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	2	1	7 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	1	1	7 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	7 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	7 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	3	1	8 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	2	1	8 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	4	1	15 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	1	1	15 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'653 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'665 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	1	1	15 dB(A)	A	Complies (Bgn + 5)
'681 SOUTH DOWLING STREET'	C	2	0	15 dB(A)	A	Complies
'681 SOUTH DOWLING STREET'	C	1	0	15 dB(A)	A	Complies
'691 SOUTH DOWLING STREET'	RES	1	1	15 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	1	1	15 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	3	1	9 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	2	1	8 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	1	1	6 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	4	1	11 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	3	1	9 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	2	1	8 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	1	1	6 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	2	1	8 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	1	1	7 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	2	1	8 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	1	1	6 dB(A)	A	Complies (Bgn + 5)
'717 SOUTH DOWLING STREET'	RES	1	1	6 dB(A)	A	Complies (Bgn + 5)
'721 SOUTH DOWLING STREET'	RES	1	1	6 dB(A)	A	Complies (Bgn + 5)
'Site Office'	C	1	0	25 dB(A)	A	Complies
'Site Office'	C	1	0	25 dB(A)	A	Complies
'294 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'296 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	3	3	36 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	3	3	37 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'308 MOORE PARK ROAD'	C	5	0	35 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	4	0	35 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	3	0	35 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	2	0	35 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	1	0	31 dB(A)	A	Complies
'302 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	3	3	34 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	3	3	37 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'336 MOORE PARK ROAD'	RES	1	3	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'332-334 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	3	3	31 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	6	4	20 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	5	4	12 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	4	4	11 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	3	4	9 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'342 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'340 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'338 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	3	3	24 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)

Table A-6: Pitch works

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1-5 COOK ROAD'	RES	8	5	29 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	7	5	28 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	6	5	28 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	5	5	19 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	4	5	19 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1-5 COOK ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
' 335203 6248625'	AR	2	0	31 dB(A)	A	Complies
' 335203 6248625'	AR	1	0	31 dB(A)	A	Complies
'2 COOK ROAD'	RES	7	5	30 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	6	5	30 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	5	5	21 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	4	5	23 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
' 335206 6248642'	AR	1	0	20 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	15 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	15 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	15 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	9 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	10 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	10 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	15 dB(A)	A	Complies
'1 MARTIN STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	27 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	25 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	23 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	22 dB(A)	A	Complies
'1 FURBER ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	20 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	17 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	16 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	16 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1 MITCHELL STREET'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'1 MITCHELL STREET'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	3	4	43 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	3	3	25 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'2 ANZAC PARADE'	C	1	0	33 dB(A)	A	Complies
'3 LITTLE STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'3 LITTLE STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'2 IRIS STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'3 CHURCH STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'2 OATLEY ROAD'	C	2	0	40 dB(A)	A	Complies
'2 OATLEY ROAD'	C	1	0	40 dB(A)	A	Complies
'2 MARTIN ROAD'	RES	2	6	9 dB(A)	A	Complies (Bgn + 5)
'2 MARTIN ROAD'	RES	1	6	9 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'3 OATLEY ROAD'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'3 POATE ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'12 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	4	4	32 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	3	4	32 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'15 ALBION AVENUE'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	3	4	32 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'13 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	3	5	19 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'14 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'15 CHURCH STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	3	4	42 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	2	5	31 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	1	5	30 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'15 JOSEPHSON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	2	2	34 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	1	2	34 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'18 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'18 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	4	5	21 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'20-22 LEINSTER STREET'	PoW	2	0	25 dB(A)	A	Complies
'20-22 LEINSTER STREET'	PoW	1	0	22 dB(A)	A	Complies
'19 CENTENNIAL LANE'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'19 CENTENNIAL LANE'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	29 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'21 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'20 SELWYN STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'21 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	3	5	17 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'23 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	3	5	24 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	2	5	27 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'24 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'24 GORDON STREET'	C	4	0	32 dB(A)	A	Complies
'24 GORDON STREET'	C	3	0	28 dB(A)	A	Complies
'24 GORDON STREET'	C	2	0	25 dB(A)	A	Complies
'24 GORDON STREET'	C	1	0	23 dB(A)	A	Complies
'24 COOK ROAD'	RES	3	5	17 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'24 CHURCH STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'24 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	34 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	34 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'38 WALTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'39 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	8	5	25 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	7	5	25 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	6	5	24 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	5	5	20 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	4	5	20 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	1	4	42 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'39 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'40-42 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	8	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	15 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	15 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	15 dB(A)	A	Complies
'40 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	4	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	19 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	20 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'40 DRIVER AVENUE'	AR	1	0	20 dB(A)	A	Complies
'41 ALBION AVENUE'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	E	2	0	7 dB(A)	A	Complies
'40 DRIVER AVENUE'	E	1	0	6 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	11	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	10	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	9	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	8	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	2	0	41 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	1	0	40 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	22 dB(A)	A	Complies
'40 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	C	1	0	42 dB(A)	A	Complies
'40 SELWYN STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	1	4	42 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'43 REGENT STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'42 LEINSTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'42 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'42 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'43 GREENS ROAD'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'44 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	3	5	14 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	E	11	0	43 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	10	0	43 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	9	0	43 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	8	0	43 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	7	0	43 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'44 DRIVER AVENUE'	E	6	0	43 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	5	0	43 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	4	0	42 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	3	0	38 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	2	0	38 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	1	0	36 dB(A)	A	Complies
'44 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	C	5	0	42 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	4	0	27 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	3	0	26 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	2	0	26 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	1	0	26 dB(A)	A	Complies
'46 GORDON STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'46 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'44 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'47 ALBION AVENUE'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'46 WALTER STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'46 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	4	4	41 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	2	4	44 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	1	4	43 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'3 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'4 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'4 FURBER ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	3	4	39 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'5 STEWART PLACE'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	4	4	38 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'5 FURBER ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	32 dB(A)	A	Complies (Bgn + 5)
'5 RENNY STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'6 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	31 dB(A)	A	Complies (Bgn + 5)
'6 CHAPMAN STREET'	C	3	0	30 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	2	0	28 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	1	0	25 dB(A)	A	Complies
'6 CHURCH STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'6 FURBER ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	3	4	39 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'7 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'8 FURBER ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'8 ALEXANDER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'9 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'8 IRIS STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'8 WALTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'8 SEYMOUR PLACE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'9 FURBER ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'10-14 CHURCH STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'10 IRIS STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	3	5	26 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'10 LANG ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'10 WALTER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	3	4	32 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'11 FURBER ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	3	4	39 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	29 dB(A)	A	Complies (Bgn + 5)
'12 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	8	5	25 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	7	5	19 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	6	5	15 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	5	5	13 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	4	5	12 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'49-51 COOK ROAD'	RES	3	5	26 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'48 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	4	4	26 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'56 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'57 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	3	5	29 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	2	5	27 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	3	5	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'59 MOORE PARK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	31 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	3	5	30 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	2	5	30 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	1	5	29 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'61 MOORE PARK ROAD'	CC	1	0	17 dB(A)	A	Complies
'62 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'62 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'61 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'63 MOORE PARK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'66 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'67 REGENT STREET'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	8	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	7	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	6	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	5	5	11 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	4	5	11 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	3	5	14 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'68 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'70 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'68 LANG ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'69-73 MOORE PARK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	2	4	42 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'70 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'72 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'74 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	18 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	40 dB(A)	A	Complies
'74 LANG ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	43 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	1	0	42 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'83 STEWART STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'81 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'81 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	43 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	40 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	41 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	40 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	35 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	2	0	44 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	41 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	43 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	32 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'33 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	3	4	36 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'30 WALTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	2	2	35 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	1	2	35 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'31 RENNY STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'31 SELWYN STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	3	5	15 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	4	4	25 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	3	3	24 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	3	2	34 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	2	2	34 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	1	2	34 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'33 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	4	4	11 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'33 SELWYN STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'35 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'34 LANG ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	3	3	23 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'34 MOORE PARK ROAD'	C	1	0	37 dB(A)	A	Complies
'35 MOORE PARK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'37 BENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	3	3	23 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'37 GORDON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'37 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	25 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	2	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	25 dB(A)	A	Complies
'38 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'38 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	45 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	45 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	45 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	45 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	45 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	41 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	27 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	27 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	27 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	34 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	27 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	37 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	47 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	43 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	16 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	1	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	47 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	47 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	47 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	47 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	47 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	23 dB(A)	A	Complies
'38 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	28 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	28 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	28 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	27 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	22 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	AR	1	0	30 dB(A)	A	Complies
'38 LEINSTER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	37 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	35 dB(A)	A	Complies
'38 SELWYN STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'38 SELWYN STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	3	5	25 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'38 LANG ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	32 dB(A)	A	Complies
'77-83 COOK ROAD'	RES	7	5	14 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	6	5	12 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	5	5	11 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	4	5	11 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	1	0	35 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	6	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	5	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	18 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'78 GORDON STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'78 GORDON STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'76 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	33 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	3	0	32 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	20 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	18 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	13 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	3	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	18 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	18 dB(A)	A	Complies
'133-139 COOK ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	2	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	10 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	10 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	2	2	21 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	2	2	15 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	1	2	14 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'133-139 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'132 FLINDERS STREET'	RES	1	2	18 dB(A)	A	Complies (Bgn + 5)
'128 FLINDERS STREET'	RES	1	2	18 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	3	2	19 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	2	2	18 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	1	2	17 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	4	5	8 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	1	2	19 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	4	2	12 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	3	2	12 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	2	2	12 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	2	2	17 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	2	2	19 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	1	2	18 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	5	2	13 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	4	2	12 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	3	2	12 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	2	2	13 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	1	2	13 dB(A)	A	Complies (Bgn + 5)
'153-155 COOK ROAD'	CC	3	0	8 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	2	0	13 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	1	0	13 dB(A)	A	Complies
'156 FLINDERS STREET'	RES	2	2	18 dB(A)	A	Complies (Bgn + 5)
'156 FLINDERS STREET'	RES	1	2	17 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'162 FLINDERS STREET'	RES	5	2	32 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	4	2	33 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	3	2	33 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	2	2	33 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	1	2	33 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	4	0	49 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	46 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	46 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	43 dB(A)	A	Complies
'159 COOK ROAD'	CC	1	0	11 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	29 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	28 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	28 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	48 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	47 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	47 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	28 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	28 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	28 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	43 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	28 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	27 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	27 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	30 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	29 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	29 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	5	0	50 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	49 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	42 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'228 MOORE PARK ROAD'	C	4	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	43 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	43 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	29 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	28 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	28 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	43 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	43 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	43 dB(A)	A	Complies
'234 MOORE PARK ROAD'	RES	3	3	53 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	2	3	50 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	3	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	43 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	51 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	48 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'236 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'247 OXFORD STREET'	TH	5	0	30 dB(A)	A	Complies
'247 OXFORD STREET'	TH	4	0	29 dB(A)	A	Complies
'247 OXFORD STREET'	TH	3	0	27 dB(A)	A	Complies
'247 OXFORD STREET'	TH	2	0	27 dB(A)	A	Complies
'247 OXFORD STREET'	TH	1	0	27 dB(A)	A	Complies
'230 MOORE PARK ROAD'	C	1	0	46 dB(A)	A	Complies
'252 MOORE PARK ROAD'	RES	3	3	52 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	2	3	51 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	1	3	47 dB(A)	A	Complies (Bgn + 5)
'230 MOORE PARK ROAD'	C	1	0	35 dB(A)	A	Complies
'255 OXFORD STREET'	RES	4	4	37 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'255 OXFORD STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	3	3	52 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'250 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'251-255 OXFORD STREET'	PR	2	0	23 dB(A)	A	Complies
'251-255 OXFORD STREET'	PR	1	0	21 dB(A)	A	Complies
'257 OXFORD STREET'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	3	3	51 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	51 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	3	3	52 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	2	3	51 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	1	3	47 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	3	3	51 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	50 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'267 OXFORD STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'284 MOORE PARK ROAD'	RES	1	3	47 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	34 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	34 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	3	4	40 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	3	4	40 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	4	4	36 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	3	4	32 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'27 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'27 GORDON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	42 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	43 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'28 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'29 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'28 RENNY STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'28 MOORE PARK ROAD'	RES	1	2	26 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'30-38 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	4	5	18 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	17 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	4	4	39 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	3	5	24 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'50 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'51 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	3	4	40 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	3	5	25 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'52 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	8	5	20 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	7	5	14 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	6	5	12 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	5	5	11 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	4	5	11 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'54 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	3	5	26 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	3	5	26 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'55 MOORE PARK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'54 LEINSTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'54 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'56 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	4	4	34 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'56 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'56 RENNY STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	7	5	12 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	6	5	11 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	5	5	11 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	4	5	11 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'280 MOORE PARK ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	3	3	48 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	48 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	2	3	48 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	48 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	3	3	48 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	2	3	48 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	43 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	3	3	51 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	50 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'345-347 OXFORD STREET'	C	3	0	22 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	1	0	20 dB(A)	A	Complies
'358 MOORE PARK ROAD'	RES	3	3	33 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'354 SOUTH DOWLING STREET'	RES	1	2	10 dB(A)	A	Complies (Bgn + 5)
'360 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'349-351 OXFORD STREET'	C	3	0	19 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	2	0	17 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	1	0	17 dB(A)	A	Complies
'360 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	5	4	30 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	4	4	27 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	2	2	12 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'356 SOUTH DOWLING STREET'	RES	1	2	14 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	3	2	24 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	2	2	23 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	1	2	22 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	3	2	17 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	2	2	15 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	1	2	13 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	4	2	21 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	3	2	15 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	2	2	18 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'360 SOUTH DOWLING STREET'	RES	1	2	13 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	3	2	18 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	2	2	18 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	3	2	23 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	2	2	22 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	3	2	22 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	1	2	18 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	1	2	19 dB(A)	A	Complies (Bgn + 5)
'384 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'388 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'387-389 OXFORD STREET'	C	3	0	21 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	1	0	20 dB(A)	A	Complies
'386 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'385 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'390 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	2	3	19 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	19 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	E	1	0	10 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	11 dB(A)	A	Complies
'410 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	1	0	9 dB(A)	A	Complies
'398 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	2	0	8 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	10 dB(A)	A	Complies
'414 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'416 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	3	3	23 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	3	3	18 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	2	3	17 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	1	3	17 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	3	3	19 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'420 MOORE PARK ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	3	3	16 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	2	3	16 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	16 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	15 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	3	3	20 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	2	3	19 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'421 OXFORD STREET'	E	3	0	12 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	9 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	7 dB(A)	A	Complies
'421 OXFORD STREET'	E	3	0	14 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	12 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	11 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	5	0	22 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	4	0	16 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	3	0	14 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	10 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	8 dB(A)	A	Complies
'428 MOORE PARK ROAD'	RES	3	3	15 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	1	3	14 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	3	3	14 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	3	0	13 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	10 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	9 dB(A)	A	Complies
'436 MOORE PARK ROAD'	RES	3	3	14 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	4	2	19 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	3	2	17 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	2	2	16 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	1	2	14 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'432 MOORE PARK ROAD'	RES	3	3	14 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	3	3	21 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	3	3	15 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	7	2	29 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	6	2	28 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	5	2	20 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	4	2	13 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	3	2	11 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	2	2	11 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	2	0	16 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	15 dB(A)	A	Complies
'473 SOUTH DOWLING STREET'	RES	2	2	19 dB(A)	A	Complies (Bgn + 5)
'473 SOUTH DOWLING STREET'	RES	1	2	17 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	3	1	30 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	2	1	28 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	1	1	26 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	3	1	30 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	2	1	28 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	1	1	26 dB(A)	A	Complies (Bgn + 5)
'495 CLEVELAND STREET'	C	3	0	28 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	2	0	28 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	1	0	28 dB(A)	A	Complies
'477 SOUTH DOWLING STREET'	RES	4	2	16 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	3	2	15 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	2	2	13 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	5	1	29 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	4	1	30 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	3	1	30 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'479 SOUTH DOWLING STREET'	RES	5	2	17 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	4	2	16 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	3	2	15 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	2	2	14 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	1	2	13 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	3	1	30 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	2	1	28 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	1	1	26 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	2	2	14 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	3	1	21 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	1	1	20 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	3	1	30 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	1	1	20 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'83 LEINSTER STREET'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	8	5	12 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	7	5	12 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	6	5	12 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	5	5	12 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	4	5	12 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	3	3	26 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	1	3	17 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'83 STEWART STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	5	3	32 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	4	3	31 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	3	3	19 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'84 GORDON STREET'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	3	3	27 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'84 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'87 PHELPS STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'88 REGENT STREET'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'97 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	7	5	23 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	6	5	22 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	5	5	18 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	4	5	17 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	4	0	17 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	3	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'104 LANG ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	5	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	10 dB(A)	A	Complies
'114 LANG ROAD'	C	3	0	10 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	10 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'107-111 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'112 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'108 LANG ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'110 LANG ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	14 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	8 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	8 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	12 dB(A)	A	Complies
'121-125 COOK ROAD'	RES	8	5	11 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	7	5	8 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	6	5	8 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	5	5	8 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	4	5	9 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	3	5	9 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	11 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'114 LANG ROAD'	C	1	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	7 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	18 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	19 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	20 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	18 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	18 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	3	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'119 LEINSTER STREET'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'119 LEINSTER STREET'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	1	1	20 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	2	1	28 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	1	1	20 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	15 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	10 dB(A)	A	Complies
'569 SOUTH DOWLING STREET'	RES	2	1	20 dB(A)	A	Complies (Bgn + 5)
'569 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'561 SOUTH DOWLING STREET'	RES	1	1	20 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	2	1	20 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	3 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	2 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	1 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	24 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	24 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	12 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	10 dB(A)	A	Complies
'575 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'575 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	1	0	18 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	22 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	18 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	14 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	21 dB(A)	A	Complies

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'560 CLEVELAND STREET'	E	3	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	22 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	22 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	23 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	23 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	23 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	23 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	21 dB(A)	A	Complies
'577 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'577 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	3	1	19 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	3	1	29 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	3	1	29 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	1	1	26 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	3	1	29 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	28 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	3	1	29 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	3	1	28 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	2	1	28 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'641 SOUTH DOWLING STREET'	RES	3	1	28 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	4	1	28 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	28 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	28 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'653 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	2	1	28 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	28 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	28 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)
'681 SOUTH DOWLING STREET'	C	2	0	28 dB(A)	A	Complies
'681 SOUTH DOWLING STREET'	C	1	0	27 dB(A)	A	Complies
'691 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'715 SOUTH DOWLING STREET'	RES	3	1	20 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	4	1	22 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	3	1	20 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	2	1	20 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	1	1	18 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'717 SOUTH DOWLING STREET'	RES	1	1	18 dB(A)	A	Complies (Bgn + 5)
'721 SOUTH DOWLING STREET'	RES	1	1	18 dB(A)	A	Complies (Bgn + 5)
'Site Office'	C	1	0	37 dB(A)	A	Complies
'Site Office'	C	1	0	37 dB(A)	A	Complies
'294 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	3	3	47 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	3	3	47 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	1	3	43 dB(A)	A	Complies (Bgn + 5)
'308 MOORE PARK ROAD'	C	5	0	46 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	4	0	46 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	3	0	46 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	2	0	46 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	1	0	44 dB(A)	A	Complies
'302 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	43 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'318 MOORE PARK ROAD'	RES	3	3	45 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	2	3	44 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	3	3	47 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	1	3	43 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	2	3	45 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	2	3	44 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	2	3	43 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	2	3	45 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	2	3	44 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	2	3	43 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	2	3	43 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'336 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	3	3	34 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	3	3	34 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	6	4	34 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	5	4	28 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	4	4	26 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'342 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)

Receiver					Day Outside Standard Hours	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'340 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'338 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	3	3	34 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	3	3	34 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)

Level 3, 65 Pirrama Road
Pyrmont NSW, 2009

Report No.:
Date: 24 June 2022
Created by:
Checked by:

SFS Redev - Cleared site - OOHW- Building

Section 1 - Introduction

This construction noise assessment has been prepared for **SFS Redev - Cleared site** in accordance with the relevant environmental assessment requirements, outlined in Appendix A.

Figure 1-1: Site and receiver map

Section 2 - Works description

This assessment report relates to the proposed works summarised in Table 2-1.

Table 2-1: Proposed works

Name	Work dates	Relevant assessment periods	Construction Plant, Quantity and Duration*
Facade Cleaning		• Evening	• A Lifting Platform x 1 , 100% • B Pressure Washer x 1 , 50%
Paving		• Evening	• A Petrol Concrete Trowel x 1 , 100% • B Petrol Concrete Trowel x 1 , 100%
Facade install - no hand tools		• Evening	• A Mobile Telescopic Crane (Idling) x 1 , 100% • B Lifting Platform x 1 , 50%
Misc Facade Install		• Evening	• A Wheeled Mobile Crane x 1 , 100% • B Lifting Platform x 1 , 50% • C Wheeled Mobile Crane x 1 , 100% • D Lifting Platform x 1 , 100% • E Hydratorque x 1 , 100%
Roof finishes		• Evening	• A Lifting Platform x 1 , 100%
Pitch works		• Evening	• A Truck and Dog x 1 , 100% • B Tracked Excavator x 1 , 100%

Notes: * Duration % is the percentage that the plant is used in the measurement assessment time period.

Section 3 - Assessment methodology

Airborne noise predictions have been carried out using SoundPLAN implementing ISO 9613-2:1996 Acoustics - Attenuation of sound during propagation outdoors - Part 2: General method of calculation (ISO 9613-2). All sources are nominally located 2 m above the local ground level. The noise model includes the ground topography, ground and air absorption, receptor buildings and intervening structures.

Assessment has been carried out using Arup SNAPshot interface, which provides instantaneous assessment of proposed work Activities. This has ensured works contributing to exceedance of target levels are understood, and all endeavours made to reduce impacts where practicable. Where target noise levels are predicted to be exceeded options for alternative construction methodologies and / or mitigation have also been considered. This report presents the outcomes of the assessment, reflecting the final plant selection and any relevant mitigation and management measures.

Section 4 - Management matrix

Based on the project criteria, the following management matrix has been established, which has been referred to in the subsequent assessment tables in Section 5. Baseline noise levels and fixed criteria (for the relevant receiver types) are outlined in Table 4-2.

Table 4-1 Management Matrix

Name	Category	Description
Non residential: All periods	A	Complies
	B	Exceeds up to 5 dB
	C	Exceeds up to 10 dB
	D	Exceeds up to 15 dB
	E	Exceeds more than 15 dB
Residential: Standard hours	A	Complies (Bgn + 10)
	B	Exceeds up to 5 dB
	C	Exceeds up to 10 dB
	D	Exceeds up to 15 dB
	E	Exceeds > 15 dB or 75 dB(A)
Residential: Outside Standard Hours	A	Complies (Bgn + 5)
	B	Exceeds up to 5 dB
	C	Exceeds up to 10 dB
	D	Exceeds up to 15 dB
	E	Exceeds > 15 dB or 70 dB(A)

Note:

Standard Hours
Monday to Friday: 7 am - 6 pm, Saturday: 8 am - 1 pm

RBL + 10dB

Day Outside Standard Hours
Saturday: 7pm - 8am, 1pm-6pm. Sunday: 8am-6pm

RBL + 5dB

Evening
Monday - Saturday: 6pm -10pm

RBL + 5dB

Night
Monday - Saturday: 10pm - 7 am

RBL + 5dB

Table 4-2 Baseline levels and fixed criteria

Receiver Type	ID	Noice Catchment Area (NCA)	Period	Fixed Criteria (dB Leq)	Ambient (dB Leq)	Background (dB L90)
Town Hall	TH	No NCA	Night	45	-	-
Town Hall	TH	No NCA	Evening	45	-	-
Town Hall	TH	No NCA	Day Outside Standard Hours	45	-	-
Town Hall	TH	No NCA	Standard Hours	45	-	-
Residential	RES	NCA 6	Night	-	49	45
Residential	RES	NCA 6	Evening	-	57	47
Residential	RES	NCA 6	Day Outside Standard Hours	-	57	47
Residential	RES	NCA 6	Standard Hours	-	57	47
Residential	RES	NCA 5	Night	-	43	35

Receiver Type	ID	Noice Catchment Area (NCA)	Period	Fixed Criteria (dB Leq)	Ambient (dB Leq)	Background (dB L90)
Residential	RES	NCA 5	Evening	-	56	36
Residential	RES	NCA 5	Day Outside Standard Hours	-	60	39
Residential	RES	NCA 5	Standard Hours	-	60	39
Residential	RES	NCA 4	Night	-	46	41
Residential	RES	NCA 4	Evening	-	55	41
Residential	RES	NCA 4	Day Outside Standard Hours	-	57	43
Residential	RES	NCA 4	Standard Hours	-	57	43
Residential	RES	NCA 3	Night	-	64	49
Residential	RES	NCA 3	Evening	-	66	49
Residential	RES	NCA 3	Day Outside Standard Hours	-	68	52
Residential	RES	NCA 3	Standard Hours	-	68	52
Residential	RES	NCA 2	Night	-	62	51
Residential	RES	NCA 2	Evening	-	65	52
Residential	RES	NCA 2	Day Outside Standard Hours	-	67	56
Residential	RES	NCA 2	Standard Hours	-	67	56
Residential	RES	NCA 1	Night	-	67	55
Residential	RES	NCA 1	Evening	-	68	56
Residential	RES	NCA 1	Day Outside Standard Hours	-	69	58
Residential	RES	NCA 1	Standard Hours	-	69	58
Place of worship	PoW	No NCA	Night	45	-	-
Place of worship	PoW	No NCA	Evening	45	-	-
Place of worship	PoW	No NCA	Day Outside Standard Hours	45	-	-
Place of worship	PoW	No NCA	Standard Hours	45	-	-
Passive Recreation	PR	No NCA	Night	60	-	-
Passive Recreation	PR	No NCA	Evening	60	-	-
Passive Recreation	PR	No NCA	Day Outside Standard Hours	60	-	-
Passive Recreation	PR	No NCA	Standard Hours	60	-	-
Educational	E	No NCA	Night	45	-	-
Educational	E	No NCA	Evening	45	-	-
Educational	E	No NCA	Day Outside Standard Hours	45	-	-
Educational	E	No NCA	Standard Hours	45	-	-

Receiver Type	ID	Noice Catchment Area (NCA)	Period	Fixed Criteria (dB Leq)	Ambient (dB Leq)	Background (dB L90)
Commercial	C	No NCA	Night	70	-	-
Commercial	C	No NCA	Evening	70	-	-
Commercial	C	No NCA	Day Outside Standard Hours	70	-	-
Commercial	C	No NCA	Standard Hours	70	-	-
Child Care	CC	No NCA	Night	70	-	-
Child Care	CC	No NCA	Evening	70	-	-
Child Care	CC	No NCA	Day Outside Standard Hours	70	-	-
Child Care	CC	No NCA	Standard Hours	70	-	-
Active Recreation	AR	No NCA	Night	65	-	-
Active Recreation	AR	No NCA	Evening	65	-	-
Active Recreation	AR	No NCA	Day Outside Standard Hours	65	-	-
Active Recreation	AR	No NCA	Standard Hours	65	-	-

Section 5 - Modelling, mitigation and management outcomes

The following summarises the assessed equipment details and summary of the assessment outcomes. More detail regarding predicted noise levels at each receiver is included in *Appendix A*.

5.1 - Facade Cleaning

The following tables present the relevant equipment sound power levels and assessment summary.

Table 5-1-1: Facade Cleaning - Equipment details

No.	Name	Location	LwA	63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz	Qty	Duration % of 15-min period
A.	Lifting Platform	[-33.88826457, 151.22581979]	95	106	104	90	91	88	87	86	77	1	100
B.	Pressure Washer	[-33.88826266, 151.22569724]	96	90	90	90	85	90	90	90	6	1	50

Table 5-1-2: Facade Cleaning - Assessment summary

Period	Receiver Type	Management level				
		A	B	C	D	E
Evening	Town Hall	5	0	0	0	0
	Residential	1584	0	0	0	0
	Place of worship	16	0	0	0	0
	Passive Recreation	2	0	0	0	0
	Educational	46	0	0	0	0
	Commercial	339	0	0	0	0
	Child Care	5	0	0	0	0
	Active Recreation	33	0	0	0	0

The following figure(s) shows the equipment locations on site for each working period.

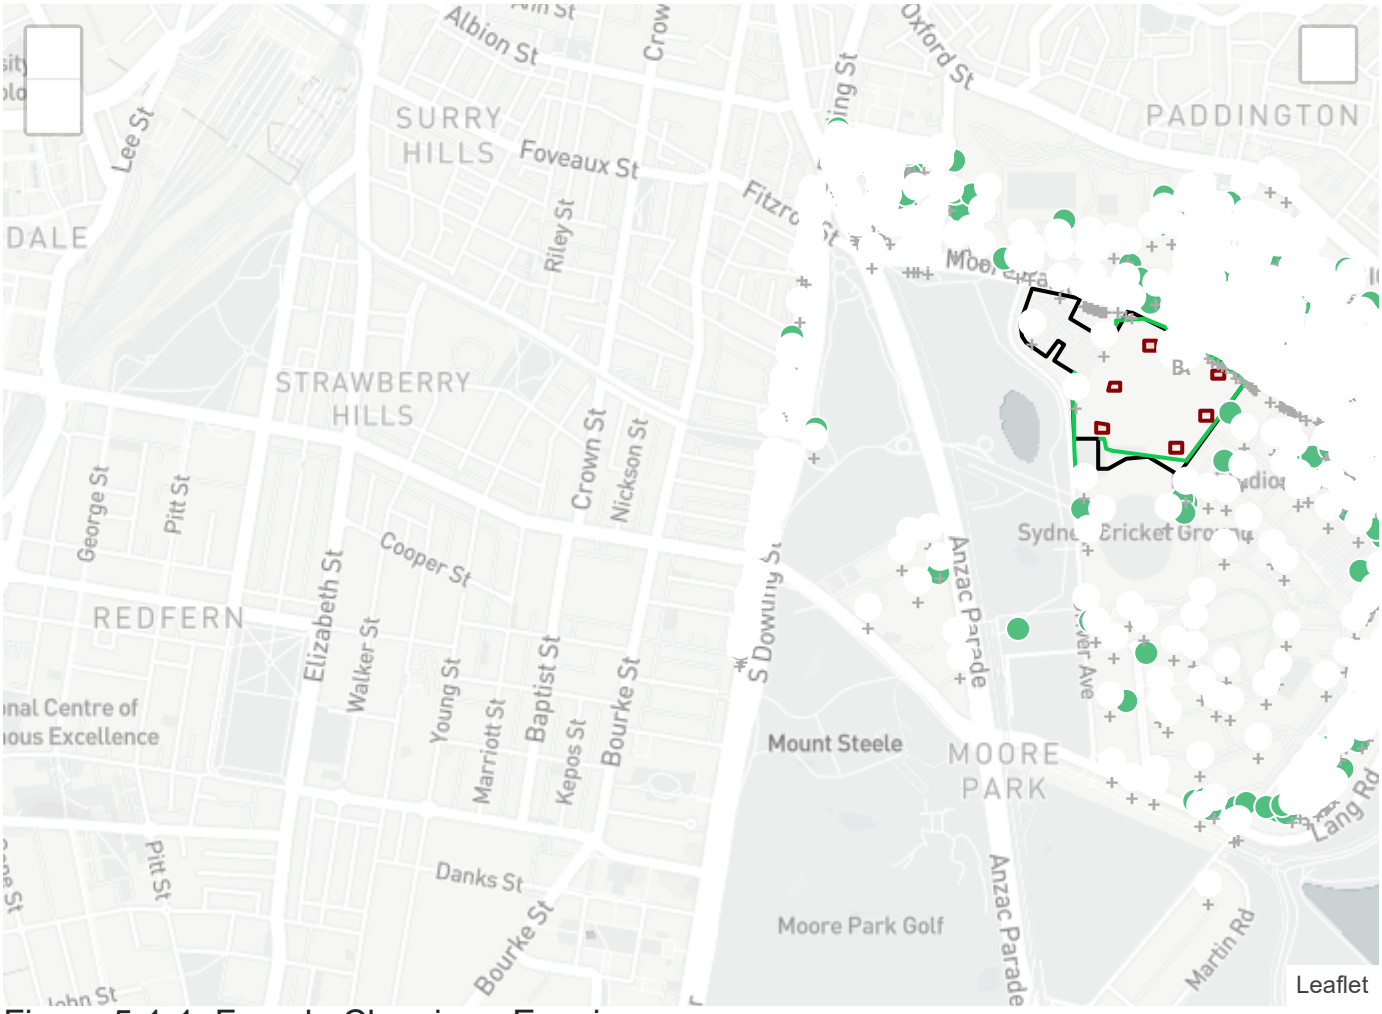

Figure 5-1-1: Facade Cleaning - Evening

5.2 - Paving

The following tables present the relevant equipment sound power levels and assessment summary.

Table 5-2-1: Paving - Equipment details

No.	Name	Location	LwA	63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz	Qty	Duration % of 15-min period
A.	Petrol Concrete Trowel	[-33.88825308, 151.22508446]	95	82	85	87	90	90	89	84	76	1	100
B.	Petrol Concrete Trowel	[-33.88987647, 151.22357966]	95	82	85	87	90	90	89	84	76	1	100

Table 5-2-2: Paving - Assessment summary

Period	Receiver Type	Management level				
		A	B	C	D	E
Evening	Town Hall	5	0	0	0	0
	Residential	1584	0	0	0	0
	Place of worship	16	0	0	0	0

Period	Receiver Type	Management level				
		A	B	C	D	E
	Passive Recreation	2	0	0	0	0
	Educational	46	0	0	0	0
	Commercial	339	0	0	0	0
	Child Care	5	0	0	0	0
	Active Recreation	33	0	0	0	0

The following figure(s) shows the equipment locations on site for each working period.

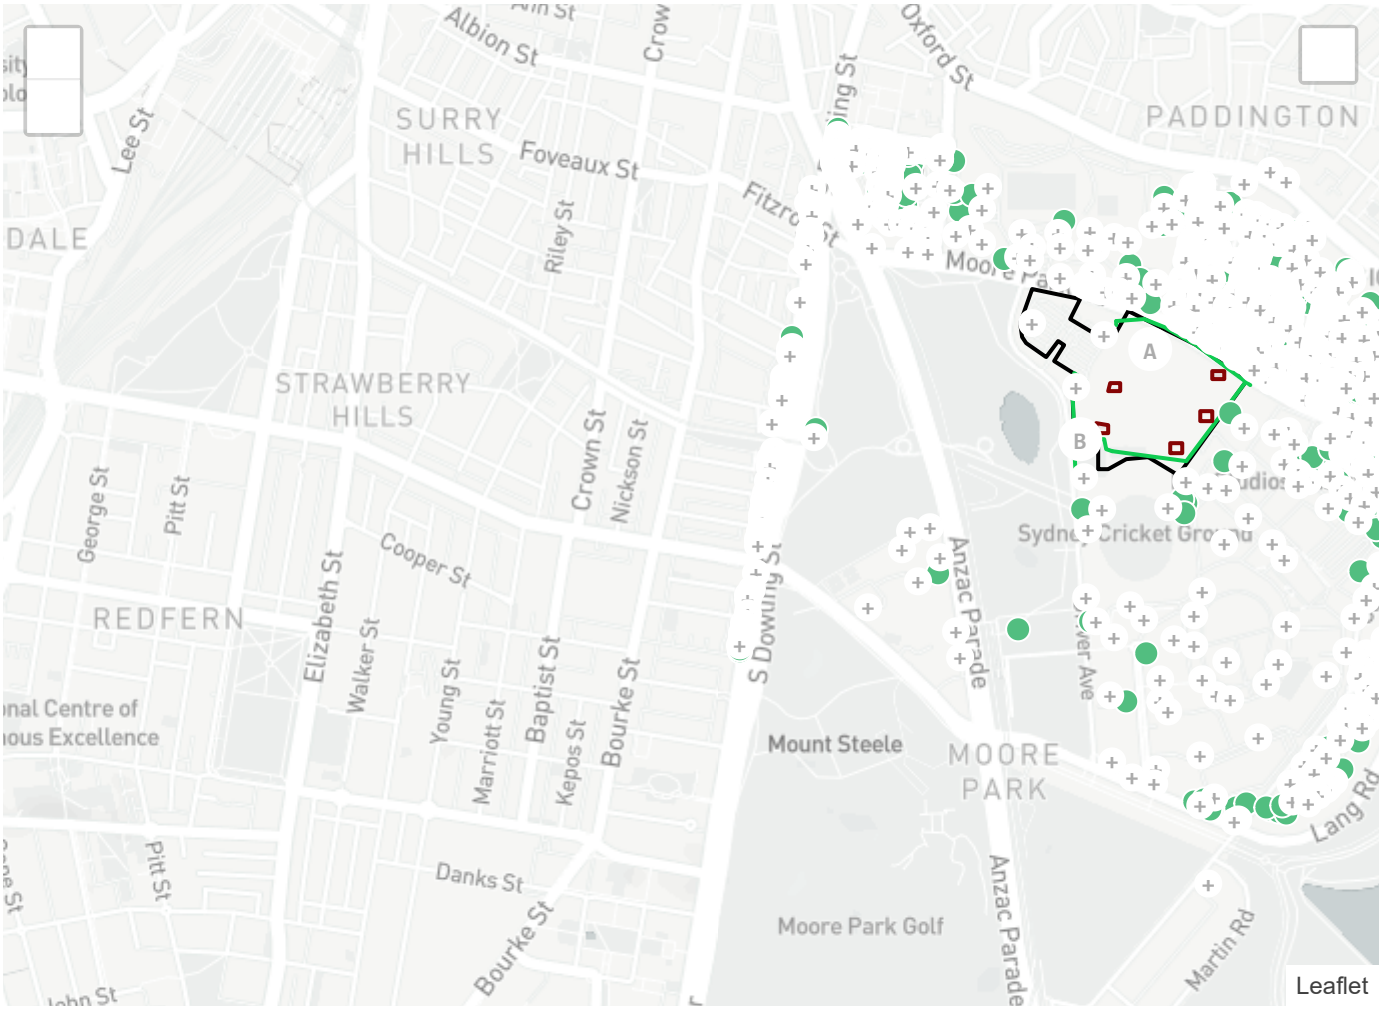

Figure 5-2-1: Paving - Evening

5.3 - Facade install - no hand tools

The following tables present the relevant equipment sound power levels and assessment summary.

Table 5-3-1: Facade install - no hand tools - Equipment details

No.	Name	Location	LwA	63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz	Qty	Duration % of 15-min period
A.	Mobile Telescopic Crane (Idling)	[-33.88800672, 151.22508956]	92	99	95	92	89	88	84	78	69	1	100

No.	Name	Location	LwA	63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz	Qty	Duration % of 15-min period
B.	Lifting Platform	[-33.88800672, 151.22508956]	95	106	104	90	91	88	87	86	77	1	50

Table 5-3-2: Facade install - no hand tools - Assessment summary

Period	Receiver Type	Management level				
		A	B	C	D	E
Evening	Town Hall	5	0	0	0	0
	Residential	1584	0	0	0	0
	Place of worship	16	0	0	0	0
	Passive Recreation	2	0	0	0	0
	Educational	46	0	0	0	0
	Commercial	339	0	0	0	0
	Child Care	5	0	0	0	0
	Active Recreation	33	0	0	0	0

The following figure(s) shows the equipment locations on site for each working period.

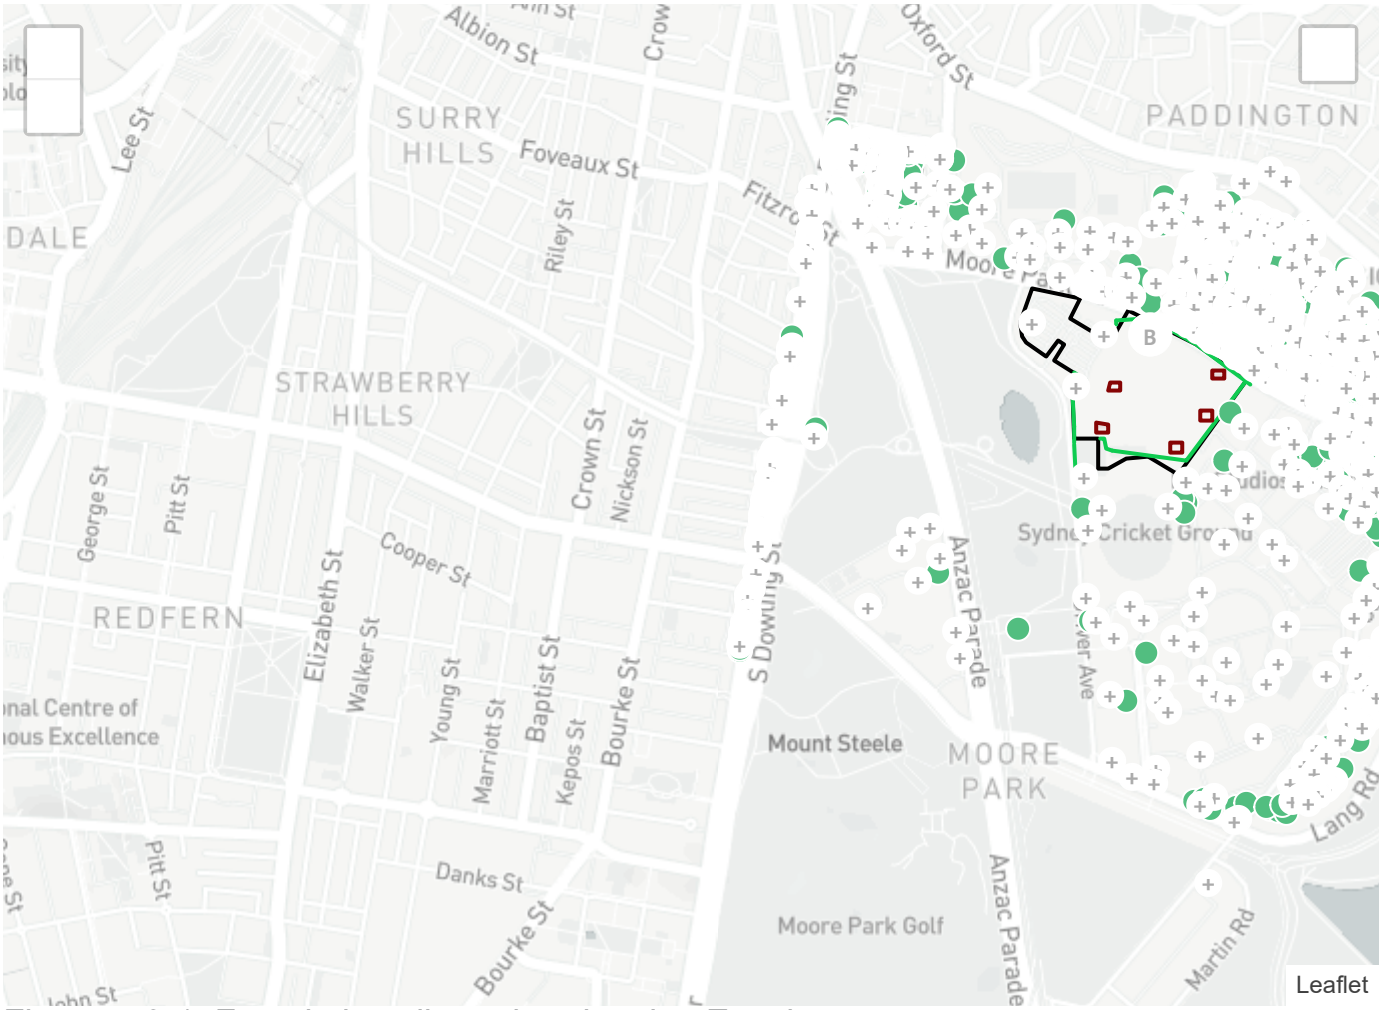

Figure 5-3-1: Facade install - no hand tools - Evening

5.4 - Misc Facade Install

The following tables present the relevant equipment sound power levels and assessment summary.

Table 5-4-1: Misc Facade Install - Equipment details

No.	Name	Location	LwA	63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz	Qty	Duration % of 15-min period
A.	Wheeled Mobile Crane	[-33.88807909, 151.22447509]	98	108	100	99	95	93	90	85	77	1	100
B.	Lifting Platform	[-33.88807909, 151.22447509]	95	106	104	90	91	88	87	86	77	1	50
C.	Wheeled Mobile Crane	[-33.88979575, 151.22370393]	98	108	104	99	91	92	91	84	78	1	100
D.	Lifting Platform	[-33.88987805, 151.22370223]	95	106	104	90	91	88	87	86	77	1	100
E.	Hydratorque	[-33.88807909, 151.22447509]	102	105	105	95	94	98	96	90	84	1	100

Table 5-4-2: Misc Facade Install - Assessment summary

Period	Receiver Type	Management level				
		A	B	C	D	E
Evening	Town Hall	5	0	0	0	0
	Residential	1584	0	0	0	0
	Place of worship	16	0	0	0	0
	Passive Recreation	2	0	0	0	0
	Educational	46	0	0	0	0
	Commercial	339	0	0	0	0
	Child Care	5	0	0	0	0
	Active Recreation	33	0	0	0	0

The following figure(s) shows the equipment locations on site for each working period.

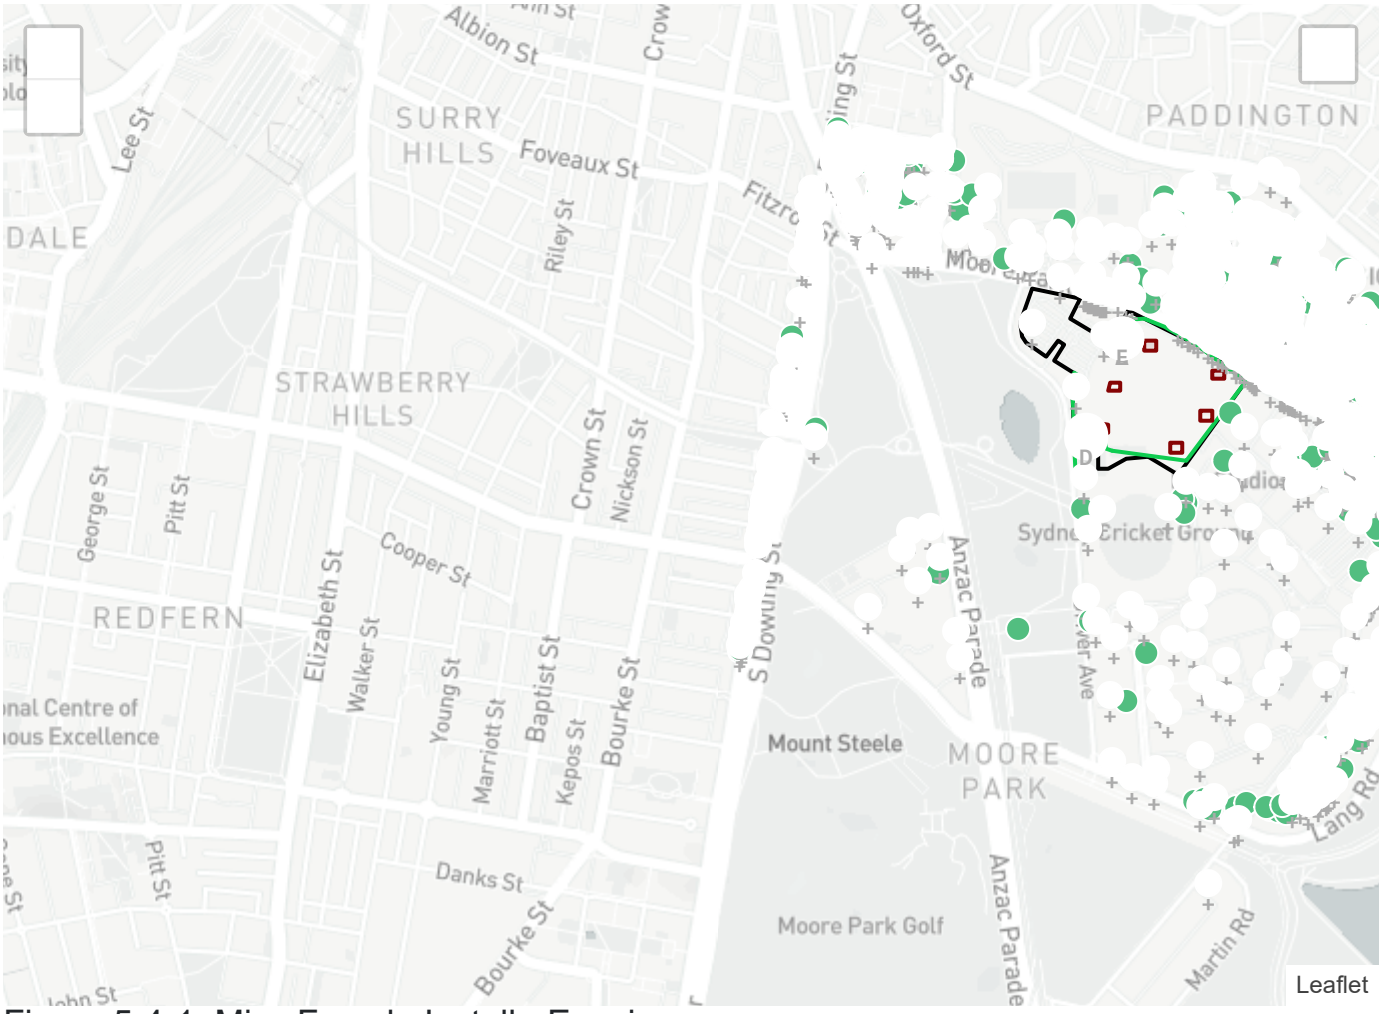

Figure 5-4-1: Misc Facade Install - Evening

5.5 - Roof finishes

The following tables present the relevant equipment sound power levels and assessment summary.

Table 5-5-1: Roof finishes - Equipment details

No.	Name	Location	LwA	63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz	Qty	Duration % of 15-min period
A.	Lifting Platform	[-33.88850317, 151.22532447]	95	106	104	90	91	88	87	86	77	1	100

Table 5-5-2: Roof finishes - Assessment summary

Period	Receiver Type	Management level				
		A	B	C	D	E
Evening	Town Hall	5	0	0	0	0
	Residential	1584	0	0	0	0
	Place of worship	16	0	0	0	0
	Passive Recreation	2	0	0	0	0
	Educational	46	0	0	0	0
	Commercial	339	0	0	0	0

Period	Receiver Type	Management level				
		A	B	C	D	E
	Child Care	5	0	0	0	0
	Active Recreation	33	0	0	0	0

The following figure(s) shows the equipment locations on site for each working period.

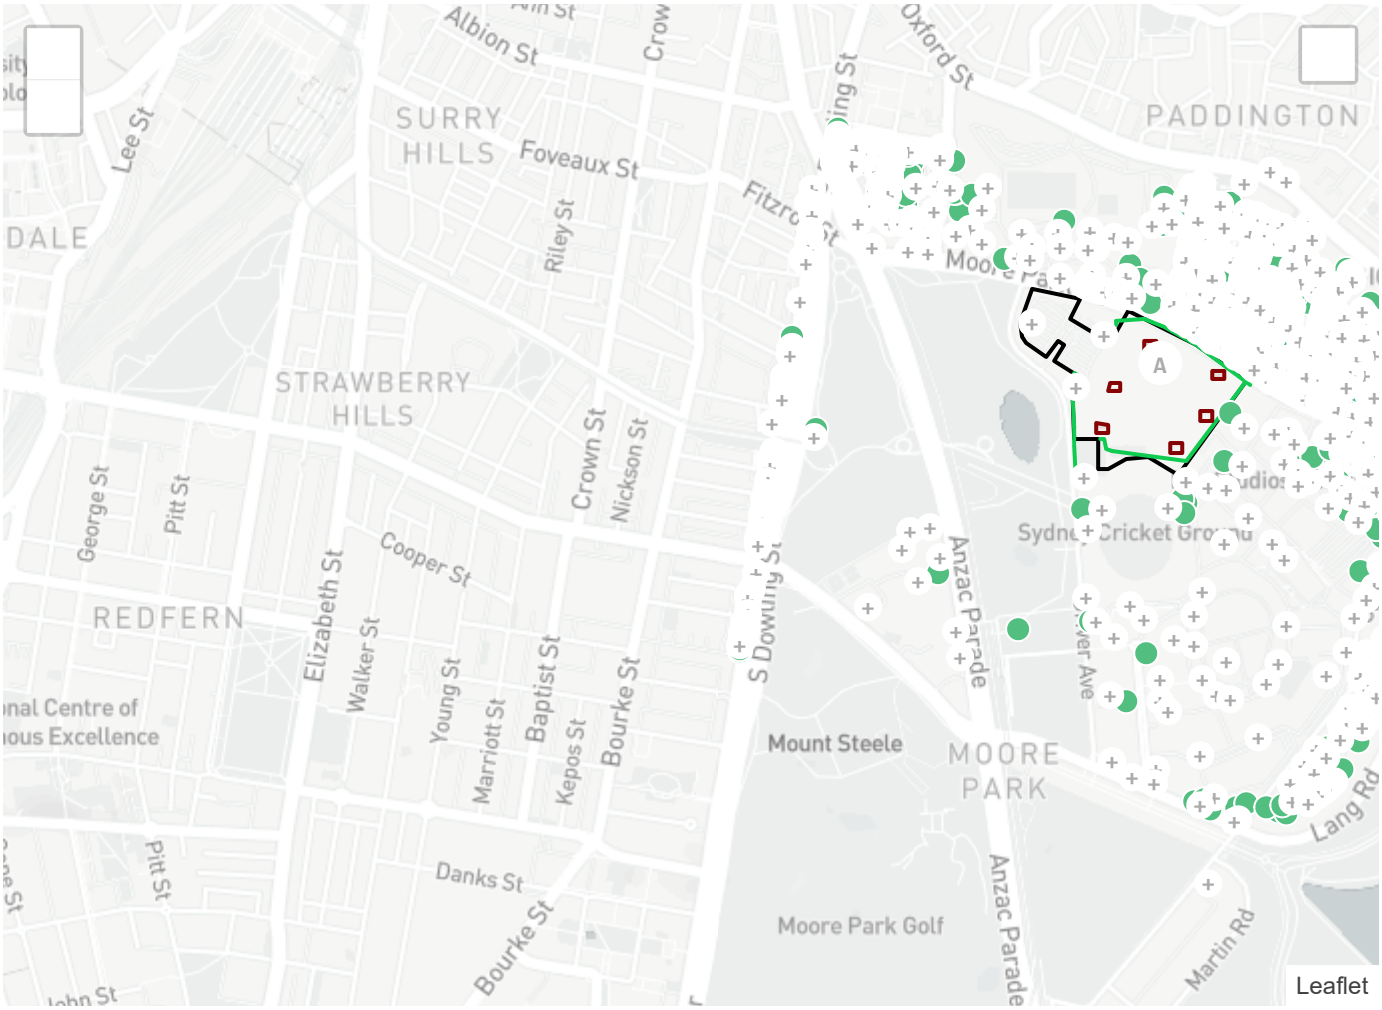

Figure 5-5-1: Roof finishes - Evening

5.6 - Pitch works

The following tables present the relevant equipment sound power levels and assessment summary.

Table 5-6-1: Pitch works - Equipment details

No.	Name	Location	LwA	63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz	Qty	Duration % of 15-min period
A.	Truck and Dog	[-33.88874579, 151.22507425]	106	116	109	107	104	10	98	92	88	1	100
B.	Tracked Excavator	[-33.88874579, 151.22507425]	103	102	108	103	101	97	94	88	79	1	100

Table 5-6-2: Pitch works - Assessment summary

Period	Receiver Type	Management level				
		A	B	C	D	E
Evening	Town Hall	5	0	0	0	0
	Residential	1584	0	0	0	0
	Place of worship	16	0	0	0	0
	Passive Recreation	2	0	0	0	0
	Educational	46	0	0	0	0
	Commercial	339	0	0	0	0
	Child Care	5	0	0	0	0
	Active Recreation	33	0	0	0	0

The following figure(s) shows the equipment locations on site for each working period.

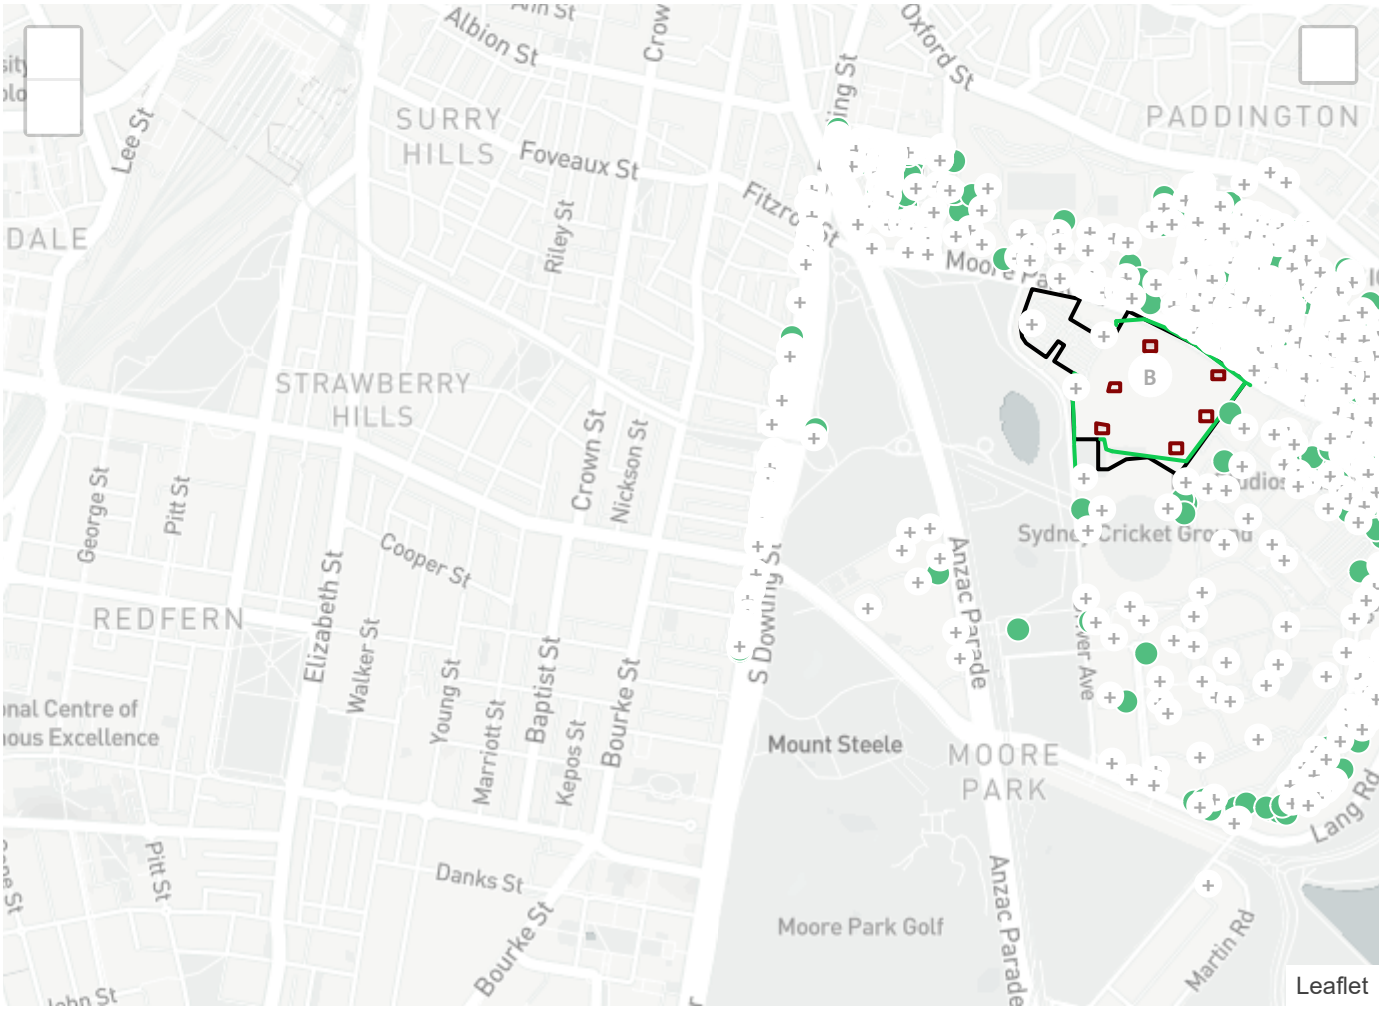

Figure 5-6-1: Pitch works - Evening

Appendix A - Assessment details

The following table(s) present the predicted noise levels and corresponding management requirements for receivers that are exceeding noise limit for any working period, for each works scenario.

Table A-1: Facade Cleaning

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1-5 COOK ROAD'	RES	8	5	24 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	7	5	22 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	6	5	21 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	5	5	22 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	4	5	20 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	15 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	14 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	16 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	14 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
' 335203 6248625'	AR	2	0	16 dB(A)	A	Complies
' 335203 6248625'	AR	1	0	15 dB(A)	A	Complies
'2 COOK ROAD'	RES	7	5	25 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	6	5	24 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	5	5	24 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	4	5	22 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	3	5	19 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
' 335206 6248642'	AR	1	0	16 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	7 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	7 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	6 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	1 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	1 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	1 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	5 dB(A)	A	Complies
'1 MARTIN STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1 NEWCOMBE STREET'	C	4	0	15 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	15 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	15 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	15 dB(A)	A	Complies
'1 FURBER ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	8 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	8 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	8 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	8 dB(A)	A	Complies
'1 MITCHELL STREET'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'1 MITCHELL STREET'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	3	3	31 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'2 ANZAC PARADE'	C	1	0	21 dB(A)	A	Complies
'3 LITTLE STEWART STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'3 LITTLE STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'2 FURBER ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'2 IRIS STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'3 CHURCH STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'2 OATLEY ROAD'	C	2	0	19 dB(A)	A	Complies
'2 OATLEY ROAD'	C	1	0	19 dB(A)	A	Complies
'2 MARTIN ROAD'	RES	2	6	4 dB(A)	A	Complies (Bgn + 5)
'2 MARTIN ROAD'	RES	1	6	4 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'3 POATE ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'12 LEINSTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'13 FURBER ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	4	4	23 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'13 POATE ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'14 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'15 CHURCH STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'17 MOORE PARK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	3	4	1 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	2	2	11 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'18 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'19 ALBION AVENUE'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'18 WALTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	3	4	16 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	4	5	24 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'20-22 LEINSTER STREET'	PoW	2	0	10 dB(A)	A	Complies
'20-22 LEINSTER STREET'	PoW	1	0	9 dB(A)	A	Complies
'19 CENTENNIAL LANE'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'19 CENTENNIAL LANE'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'20 FURBER ROAD'	RES	3	5	6 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'20 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'21 WALTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'22 FURBER ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'24 LEINSTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'24 GORDON STREET'	C	4	0	11 dB(A)	A	Complies
'24 GORDON STREET'	C	3	0	11 dB(A)	A	Complies
'24 GORDON STREET'	C	2	0	10 dB(A)	A	Complies
'24 GORDON STREET'	C	1	0	10 dB(A)	A	Complies
'24 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'24 CHURCH STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	1	4	1 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'24 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	11 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'38 WALTER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	8	5	2 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	7	5	2 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	6	5	2 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	5	5	2 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	4	5	2 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'39 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'40-42 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	8	0	5 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	5 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	5 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	5 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	5 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'40 DRIVER AVENUE'	AR	3	0	5 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	5 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	6 dB(A)	A	Complies
'40 COOK ROAD'	RES	3	5	6 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	4	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	13 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	13 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	13 dB(A)	A	Complies
'41 ALBION AVENUE'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	E	2	0	-2 dB(A)	A	Complies
'40 DRIVER AVENUE'	E	1	0	-2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	11	0	28 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	10	0	28 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	9	0	28 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	8	0	27 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	24 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	18 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	17 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	16 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	15 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	2	0	32 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	1	0	30 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	11 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	11 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	12 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	12 dB(A)	A	Complies
'40 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	C	1	0	31 dB(A)	A	Complies
'40 SELWYN STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'41 REGENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	3	5	6 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'42 LEINSTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'42 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'42 SELWYN STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'43 GREENS ROAD'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'44 LEINSTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'44 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	E	11	0	17 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	10	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	9	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	8	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	7	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	6	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	5	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	4	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	3	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	2	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	1	0	12 dB(A)	A	Complies
'44 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	C	5	0	22 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	4	0	22 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	3	0	22 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	2	0	22 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	1	0	14 dB(A)	A	Complies
'46 GORDON STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'46 GORDON STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'44 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'45 GREENS ROAD'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	3	4	10 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'46 WALTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'46 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	4	4	26 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'47 OATLEY ROAD'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'3 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'4 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'4 FURBER ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'5 STEWART PLACE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	4	4	26 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'5 FURBER ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	3	4	1 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'5 RENNY STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'6 CHAPMAN STREET'	C	3	0	20 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	2	0	20 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	1	0	20 dB(A)	A	Complies
'6 CHURCH STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'6 FURBER ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'7 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'8 FURBER ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'8 ALEXANDER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	3	4	6 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'8 IRIS STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'8 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'8 SEYMOUR PLACE'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'9 FURBER ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'10-14 CHURCH STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'10 IRIS STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'10 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'11 FURBER ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'12 FURBER ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'48 STEWART STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	8	5	5 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	7	5	3 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	6	5	2 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	5	5	1 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	4	5	2 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	3	5	2 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	3	4	9 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'48 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	4	4	17 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	3	5	1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'56 SELWYN STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'57 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'58 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	3	5	9 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'61 MOORE PARK ROAD'	CC	1	0	9 dB(A)	A	Complies
'62 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'62 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'61 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'62 LANG ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'63 MOORE PARK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	3	3	19 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'67 REGENT STREET'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	8	5	13 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	7	5	11 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	6	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	5	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	4	5	9 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	3	5	4 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'73 STEWART STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'68 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	3	3	20 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	2	3	19 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'70 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'69-73 MOORE PARK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'70 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'72 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'74 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	10 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	7 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	20 dB(A)	A	Complies
'74 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	18 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	17 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	1	0	15 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	35 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	17 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	12 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	18 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	17 dB(A)	A	Complies
'83 STEWART STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	11 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	12 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	16 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	17 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'81 STEWART STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'81 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	12 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	1	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	32 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	32 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	14 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	18 dB(A)	A	Complies
'33 BENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'30 WALTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	2	2	17 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'31-33 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'31 RENNY STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'31 SELWYN STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	4	4	12 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	2	1	4 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	1	1	3 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	3	3	26 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	3	2	11 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	2	2	11 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'33 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	4	4	13 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'34 LEINSTER STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'33 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'35 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	3	3	26 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'34 MOORE PARK ROAD'	C	1	0	25 dB(A)	A	Complies
'35 MOORE PARK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'37 BENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	3	3	26 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'37 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'37 WALTER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'37 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	16 dB(A)	A	Complies
'38 GORDON STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'38 GORDON STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	8 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	8 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	26 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	18 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	14 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	32 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	AR	1	0	14 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	7 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	7 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	7 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	18 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	15 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	14 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	19 dB(A)	A	Complies
'38 STEWART STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	18 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	35 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	1	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	1 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	1 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	1 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	19 dB(A)	A	Complies
'38 LEINSTER STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	11 dB(A)	A	Complies
'38 SELWYN STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'38 SELWYN STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'38 LANG ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	18 dB(A)	A	Complies
'77-83 COOK ROAD'	RES	7	5	1 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	6	5	0 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	5	5	0 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	4	5	0 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	3	5	0 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	1	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	6	0	29 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	5	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	17 dB(A)	A	Complies
'78 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'78 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'76 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	23 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-1 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-1 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	1 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	2 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	3	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	6 dB(A)	A	Complies
'133-139 COOK ROAD'	RES	3	5	-1 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	2	0	1 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	1 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	2 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	1	0	1 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	2	2	6 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	1	2	6 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'132 FLINDERS STREET'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)
'128 FLINDERS STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	3	2	4 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	4	5	-3 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	3	5	9 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	2	2	5 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	4	2	1 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	3	2	9 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	2	2	9 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	1	2	8 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	2	2	5 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	5	2	1 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'160 FLINDERS STREET'	RES	4	2	1 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	3	2	12 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	2	2	11 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)
'153-155 COOK ROAD'	CC	3	0	-3 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	2	0	3 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	1	0	2 dB(A)	A	Complies
'156 FLINDERS STREET'	RES	2	2	6 dB(A)	A	Complies (Bgn + 5)
'156 FLINDERS STREET'	RES	1	2	6 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	5	2	8 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	4	2	8 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	3	2	8 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	2	2	8 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	1	2	8 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	4	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	38 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	37 dB(A)	A	Complies
'159 COOK ROAD'	CC	1	0	1 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	36 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	38 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	38 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	37 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'228 MOORE PARK ROAD'	C	2	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	34 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	5	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	38 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	38 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	35 dB(A)	A	Complies
'234 MOORE PARK ROAD'	RES	3	3	50 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	3	0	38 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	35 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'236 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'247 OXFORD STREET'	TH	5	0	13 dB(A)	A	Complies
'247 OXFORD STREET'	TH	4	0	12 dB(A)	A	Complies
'247 OXFORD STREET'	TH	3	0	9 dB(A)	A	Complies
'247 OXFORD STREET'	TH	2	0	9 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'247 OXFORD STREET'	TH	1	0	8 dB(A)	A	Complies
'230 MOORE PARK ROAD'	C	1	0	39 dB(A)	A	Complies
'252 MOORE PARK ROAD'	RES	3	3	53 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'230 MOORE PARK ROAD'	C	1	0	28 dB(A)	A	Complies
'255 OXFORD STREET'	RES	4	4	19 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	3	3	51 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'250 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'251-255 OXFORD STREET'	PR	2	0	13 dB(A)	A	Complies
'251-255 OXFORD STREET'	PR	1	0	12 dB(A)	A	Complies
'257 OXFORD STREET'	RES	3	4	16 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	3	3	50 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	3	3	51 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	1	3	43 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	3	3	48 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	44 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'270 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	2	3	43 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'267 OXFORD STREET'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	43 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	12 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	3	4	8 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	3	5	6 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'27 OATLEY ROAD'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	4	4	24 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	3	4	21 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'27 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'28 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'29 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'28 RENNY STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'28 MOORE PARK ROAD'	RES	1	2	13 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	3	4	21 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'29 SELWYN STREET'	RES	2	4	1 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	1	4	1 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	4	5	8 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	4	4	27 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	3	3	15 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'50 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'50 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'52 LANG ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	8	5	6 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	7	5	3 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	6	5	3 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	5	5	1 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	4	5	2 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	3	5	2 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'52 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'54 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'54 LEINSTER STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'54 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'56 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	4	4	17 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'56 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'56 RENNY STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	7	5	1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	6	5	1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	5	5	1 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'57-67 COOK ROAD'	RES	4	5	1 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'280 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	3	3	43 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	2	3	37 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	3	3	42 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	3	3	45 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'345-347 OXFORD STREET'	C	3	0	13 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	2	0	11 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	1	0	12 dB(A)	A	Complies
'358 MOORE PARK ROAD'	RES	3	3	26 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'354 SOUTH DOWLING STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'360 MOORE PARK ROAD'	RES	1	3	17 dB(A)	A	Complies (Bgn + 5)
'349-351 OXFORD STREET'	C	3	0	11 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	2	0	11 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'349-351 OXFORD STREET'	C	1	0	11 dB(A)	A	Complies
'360 MOORE PARK ROAD'	RES	1	3	15 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	5	4	13 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	4	4	12 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	2	2	5 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'356 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	2	3	15 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	3	2	5 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	2	2	5 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	3	2	13 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	2	2	10 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	1	2	8 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	4	2	2 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	3	2	-1 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	2	2	-1 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'360 SOUTH DOWLING STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	3	2	3 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	3	2	14 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	2	2	13 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	1	2	10 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	3	2	17 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	2	2	16 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	1	2	14 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	14 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'378 SOUTH DOWLING STREET'	RES	2	2	14 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	1	2	14 dB(A)	A	Complies (Bgn + 5)
'384 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	14 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'388 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'387-389 OXFORD STREET'	C	3	0	12 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	2	0	12 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	1	0	13 dB(A)	A	Complies
'386 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'385 OXFORD STREET'	C	1	0	11 dB(A)	A	Complies
'390 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	E	1	0	1 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	2 dB(A)	A	Complies
'410 MOORE PARK ROAD'	RES	2	3	12 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	1	0	2 dB(A)	A	Complies
'398 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	2	0	1 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	3 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'414 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'416 MOORE PARK ROAD'	RES	1	3	15 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	3	3	12 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	3	3	9 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	2	3	9 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	3	3	12 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	3	3	8 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	2	3	8 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	8 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	3	3	10 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	2	3	9 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'421 OXFORD STREET'	E	3	0	3 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	1 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	0 dB(A)	A	Complies
'421 OXFORD STREET'	E	3	0	4 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	3 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	2 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	5	0	5 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	4	0	2 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	3	0	2 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	1 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	0 dB(A)	A	Complies
'428 MOORE PARK ROAD'	RES	3	3	7 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	2	3	6 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	1	3	6 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	3	3	15 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	2	3	16 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	3	0	2 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'461-463 OXFORD STREET'	PoW	2	0	1 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	0 dB(A)	A	Complies
'436 MOORE PARK ROAD'	RES	3	3	5 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	2	3	5 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	1	3	5 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	4	2	1 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	3	2	1 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	2	2	1 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	1	2	0 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	3	3	18 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	3	3	3 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	2	3	4 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	1	3	5 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	3	3	18 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	7	2	5 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	6	2	1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	5	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	4	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	3	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	2	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	2	0	-1 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	-2 dB(A)	A	Complies
'473 SOUTH DOWLING STREET'	RES	2	2	2 dB(A)	A	Complies (Bgn + 5)
'473 SOUTH DOWLING STREET'	RES	1	2	1 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	3	1	7 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	2	1	5 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	1	1	4 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	3	1	7 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	2	1	4 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	1	1	4 dB(A)	A	Complies (Bgn + 5)
'495 CLEVELAND STREET'	C	3	0	18 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	2	0	17 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	1	0	17 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'477 SOUTH DOWLING STREET'	RES	4	2	3 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	3	2	3 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	1	2	1 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	5	1	9 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	4	1	9 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	3	1	8 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	2	1	4 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	1	1	4 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	5	2	5 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	4	2	3 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	3	2	3 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	2	2	1 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	1	2	0 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	3	1	7 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	2	1	4 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	1	1	4 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	1	2	1 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	3	1	20 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	3	1	9 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	2	1	4 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	18 dB(A)	A	Complies
'83 LEINSTER STREET'	RES	3	3	18 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	1	3	17 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	8	5	1 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	7	5	1 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	6	5	1 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	5	5	2 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	4	5	2 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	3	5	2 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'80 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	3	3	9 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	2	3	7 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	1	3	6 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	2	3	9 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	1	3	7 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	5	3	31 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	4	3	30 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	3	3	28 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	3	3	12 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	2	3	12 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'84 GORDON STREET'	RES	1	3	4 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	3	3	21 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'90 REGENT STREET'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'84 LANG ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	2	3	12 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'87 PHELPS STREET'	RES	1	1	20 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'88 REGENT STREET'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'97 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	7	5	17 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	6	5	16 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	5	5	10 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	4	5	9 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'95 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	4	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	10 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'104 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	5	0	-2 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	-1 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	-1 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-1 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-1 dB(A)	A	Complies
'114 LANG ROAD'	C	3	0	0 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	3 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'107-111 COOK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'112 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'108 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'110 LANG ROAD'	RES	1	5	-3 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	-2 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	-3 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	1 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'121-125 COOK ROAD'	RES	8	5	0 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	7	5	-2 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	6	5	-2 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	5	5	-2 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	4	5	-2 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	3	5	-2 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	2 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	1 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-3 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	5 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	4	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	10 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	10 dB(A)	A	Complies
'119 LEINSTER STREET'	RES	2	3	12 dB(A)	A	Complies (Bgn + 5)
'119 LEINSTER STREET'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	1	1	20 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	2	1	4 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	1	1	4 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	1	1	15 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	13 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	10 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	4 dB(A)	A	Complies
'569 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'569 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'561 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	3 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	2 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	1 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	16 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	15 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	8 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'560 CLEVELAND STREET'	E	1	0	7 dB(A)	A	Complies
'575 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'575 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	1	0	12 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	14 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	12 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	12 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	10 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	15 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	15 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	14 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	13 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	17 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	17 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	16 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	15 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	11 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	12 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	11 dB(A)	A	Complies
'577 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'577 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	1	1	15 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	3	1	13 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	2	1	12 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	1	1	12 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	3	1	17 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	3	1	14 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	2	1	8 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	1	1	5 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'631 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	3	1	18 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	1	1	18 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	3	1	15 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	1	1	7 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	1	1	15 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	1	1	8 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	4	1	19 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	18 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	1	1	18 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	1	1	18 dB(A)	A	Complies (Bgn + 5)
'653 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	18 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'681 SOUTH DOWLING STREET'	C	2	0	17 dB(A)	A	Complies
'681 SOUTH DOWLING STREET'	C	1	0	17 dB(A)	A	Complies
'691 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	4	1	18 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	3	1	18 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'717 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'721 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'Site Office'	C	1	0	19 dB(A)	A	Complies
'Site Office'	C	1	0	19 dB(A)	A	Complies
'294 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	3	3	39 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	3	3	42 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'304 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'308 MOORE PARK ROAD'	C	5	0	39 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	4	0	39 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	3	0	39 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	2	0	36 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	1	0	35 dB(A)	A	Complies
'302 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	3	3	37 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	3	3	41 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'336 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	3	3	25 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	3	3	25 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'339 OXFORD STREET'	RES	6	4	19 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	5	4	12 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	4	4	11 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'342 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'340 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'338 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	3	3	21 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	1	3	15 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	3	3	23 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)

Table A-2: Paving

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1-5 COOK ROAD'	RES	8	5	26 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	7	5	26 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	6	5	26 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	5	5	24 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	4	5	23 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
' 335203 6248625'	AR	2	0	27 dB(A)	A	Complies
' 335203 6248625'	AR	1	0	27 dB(A)	A	Complies
'2 COOK ROAD'	RES	7	5	28 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	6	5	28 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	5	5	27 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	4	5	25 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	3	5	24 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
' 335206 6248642'	AR	1	0	27 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	13 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	12 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	10 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	5 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	5 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	5 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	17 dB(A)	A	Complies
'1 MARTIN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	31 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	32 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	31 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	30 dB(A)	A	Complies
'1 FURBER ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	15 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	10 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	17 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	17 dB(A)	A	Complies
'1 MITCHELL STREET'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'1 MITCHELL STREET'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1 STEWART STREET'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	3	3	31 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'2 ANZAC PARADE'	C	1	0	30 dB(A)	A	Complies
'3 LITTLE STEWART STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'3 LITTLE STEWART STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'2 IRIS STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'3 CHURCH STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'2 OATLEY ROAD'	C	2	0	36 dB(A)	A	Complies
'2 OATLEY ROAD'	C	1	0	36 dB(A)	A	Complies
'2 MARTIN ROAD'	RES	2	6	12 dB(A)	A	Complies (Bgn + 5)
'2 MARTIN ROAD'	RES	1	6	11 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'3 POATE ROAD'	RES	1	5	29 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'12 LEINSTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	30 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	30 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	4	4	34 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	3	4	34 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'13 POATE ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'14 LANG ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'15 CHURCH STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	2	5	27 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'19 BENT STREET'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	2	2	29 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	1	2	29 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	2	5	29 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'18 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'18 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	4	5	26 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'19 POATE ROAD'	RES	3	5	25 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	26 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'20-22 LEINSTER STREET'	PoW	2	0	23 dB(A)	A	Complies
'20-22 LEINSTER STREET'	PoW	1	0	20 dB(A)	A	Complies
'19 CENTENNIAL LANE'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'19 CENTENNIAL LANE'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'20 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'20 LANG ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'21 WALTER STREET'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	3	5	19 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'23 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'24 LEINSTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'24 GORDON STREET'	C	4	0	29 dB(A)	A	Complies
'24 GORDON STREET'	C	3	0	27 dB(A)	A	Complies
'24 GORDON STREET'	C	2	0	22 dB(A)	A	Complies
'24 GORDON STREET'	C	1	0	20 dB(A)	A	Complies
'24 COOK ROAD'	RES	3	5	24 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'24 CHURCH STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'24 STEWART STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	29 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	29 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'38 WALTER STREET'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	8	5	15 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	7	5	14 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	6	5	14 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	5	5	13 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	4	5	13 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'39-43 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'39 SELWYN STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'40-42 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	8	0	11 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	11 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	11 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	11 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	11 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	10 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	11 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	11 dB(A)	A	Complies
'40 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	4	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	20 dB(A)	A	Complies
'41 ALBION AVENUE'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	E	2	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	E	1	0	3 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	11	0	18 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	10	0	18 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'40 DRIVER AVENUE'	AR	9	0	17 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	8	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	19 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	18 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	17 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	17 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	17 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	17 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	17 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	2	0	47 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	1	0	47 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	19 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	19 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	19 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	19 dB(A)	A	Complies
'40 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	C	1	0	32 dB(A)	A	Complies
'40 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	3	5	6 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'42 LEINSTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'42 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'42 SELWYN STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'43 GREENS ROAD'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'44 LEINSTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	E	11	0	30 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	10	0	29 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	9	0	29 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	8	0	29 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	7	0	29 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	6	0	29 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	5	0	29 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	4	0	29 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	3	0	29 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	2	0	29 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	1	0	28 dB(A)	A	Complies
'44 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	C	5	0	45 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'44 DRIVER AVENUE'	C	4	0	45 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	3	0	45 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	2	0	45 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	1	0	45 dB(A)	A	Complies
'46 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'46 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'44 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	3	4	40 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	3	4	34 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'46 WALTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'47 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'46 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	4	4	40 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	3	4	40 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	2	4	42 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'3 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'4 COOK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'4 FURBER ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'4 RENNY LANE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'5 STEWART PLACE'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	4	4	35 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	3	4	34 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'5 FURBER ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	3	4	7 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'5 RENNY STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'6 CHAPMAN STREET'	C	3	0	26 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	2	0	26 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	1	0	25 dB(A)	A	Complies
'6 CHURCH STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'6 FURBER ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'6 WALTER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'7 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'8 FURBER ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'8 ALEXANDER STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	3	4	9 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'8 IRIS STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'8 LANG ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'8 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'8 SEYMOUR PLACE'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'9 FURBER ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	29 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'10-14 CHURCH STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	5	29 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'10 IRIS STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'10 WALTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'11 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'12 FURBER ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	8	5	16 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	7	5	14 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	6	5	14 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	5	5	13 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	4	5	13 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'48 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'49 REGENT STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	4	4	25 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'56 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	3	4	34 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'57 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'60 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	1	4	40 dB(A)	A	Complies (Bgn + 5)
'61 MOORE PARK ROAD'	CC	1	0	15 dB(A)	A	Complies
'62 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'62 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'61 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'63 MOORE PARK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'69 STEWART STREET'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	1	4	40 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	3	3	26 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'67 REGENT STREET'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	8	5	6 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	7	5	18 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	6	5	18 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	5	5	18 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	4	5	18 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	3	5	9 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	3	4	34 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'68 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'70 REGENT STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'69-73 MOORE PARK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	40 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'70-78 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'70 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'72 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'74 GORDON STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	17 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	11 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	38 dB(A)	A	Complies
'74 LANG ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	35 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	32 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'83 STEWART STREET'	RES	3	4	32 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	35 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	34 dB(A)	A	Complies
'81 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'81 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	42 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	42 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	44 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	39 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	2	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	35 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	31 dB(A)	A	Complies
'33 BENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	3	4	40 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'30 WALTER STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	2	2	31 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	1	2	29 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'31 RENNY STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'31 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'33 ALBION AVENUE'	RES	4	4	21 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	3	4	21 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	1	1	22 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	3	2	30 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	2	2	30 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	1	2	30 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'33 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	4	4	24 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'33 SELWYN STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'35 GORDON STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'34 MOORE PARK ROAD'	C	1	0	27 dB(A)	A	Complies
'35 MOORE PARK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'37 BENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	3	3	28 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'37 GORDON STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'37 SELWYN STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	20 dB(A)	A	Complies
'38 GORDON STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'38 GORDON STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	35 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	4	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	27 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	27 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	28 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	28 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	14 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	41 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	15 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	36 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	2	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	27 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	14 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	32 dB(A)	A	Complies
'38 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	3 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	3 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	24 dB(A)	A	Complies
'38 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	29 dB(A)	A	Complies
'38 SELWYN STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'38 SELWYN STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'39 MOORE PARK ROAD'	RES	3	5	26 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'38 LANG ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'77-83 COOK ROAD'	RES	7	5	12 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	6	5	7 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	5	5	5 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	4	5	5 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	1	0	35 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	6	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	5	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'78 GORDON STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'78 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'76 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	35 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	35 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	10 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	10 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	19 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	15 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	13 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	3	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'133-139 COOK ROAD'	RES	3	5	2 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	2	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	12 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	17 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	2	2	19 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	1	2	19 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'132 FLINDERS STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'128 FLINDERS STREET'	RES	1	2	17 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	3	2	10 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'146 FLINDERS STREET'	RES	2	2	10 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	1	2	13 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	4	5	0 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	3	5	14 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	2	2	19 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	1	2	19 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	4	2	10 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	3	2	13 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	2	2	16 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	1	2	19 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	2	2	15 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	1	2	14 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	5	2	14 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	4	2	13 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	3	2	9 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	2	2	9 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	1	2	9 dB(A)	A	Complies (Bgn + 5)
'153-155 COOK ROAD'	CC	3	0	0 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	2	0	12 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	1	0	9 dB(A)	A	Complies
'156 FLINDERS STREET'	RES	2	2	13 dB(A)	A	Complies (Bgn + 5)
'156 FLINDERS STREET'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	5	2	28 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	4	2	29 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	3	2	29 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	2	2	29 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	1	2	29 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	4	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	44 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'228 MOORE PARK ROAD'	C	1	0	44 dB(A)	A	Complies
'159 COOK ROAD'	CC	1	0	8 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	39 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	5	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	43 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	40 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	41 dB(A)	A	Complies
'234 MOORE PARK ROAD'	RES	3	3	47 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	41 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'236 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'247 OXFORD STREET'	TH	5	0	23 dB(A)	A	Complies
'247 OXFORD STREET'	TH	4	0	23 dB(A)	A	Complies
'247 OXFORD STREET'	TH	3	0	23 dB(A)	A	Complies
'247 OXFORD STREET'	TH	2	0	23 dB(A)	A	Complies
'247 OXFORD STREET'	TH	1	0	23 dB(A)	A	Complies
'230 MOORE PARK ROAD'	C	1	0	45 dB(A)	A	Complies
'252 MOORE PARK ROAD'	RES	3	3	45 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	2	3	45 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'230 MOORE PARK ROAD'	C	1	0	42 dB(A)	A	Complies
'255 OXFORD STREET'	RES	4	4	33 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	3	4	34 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	3	3	45 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	2	3	45 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'250 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'256 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'251-255 OXFORD STREET'	PR	2	0	25 dB(A)	A	Complies
'251-255 OXFORD STREET'	PR	1	0	25 dB(A)	A	Complies
'257 OXFORD STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	3	3	43 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	43 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	3	3	43 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	2	3	43 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	1	3	43 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	3	3	42 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'267 OXFORD STREET'	RES	1	2	22 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	29 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	29 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'25 STEWART STREET'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	1	4	40 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	3	4	16 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	4	4	35 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'27 GORDON STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'28 LEINSTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'28 WALTER STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'29 GORDON STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'28 RENNY STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'28 MOORE PARK ROAD'	RES	1	2	24 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	3	4	40 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	4	5	20 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	4	4	35 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'51 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	3	3	28 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	3	5	19 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'50 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'53 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	3	4	36 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	3	5	19 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	3	4	36 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'52 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	8	5	18 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	7	5	13 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	6	5	13 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	5	5	12 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	4	5	12 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'54 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	3	5	19 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'54 LEINSTER STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'54 REGENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'56 STEWART STREET'	RES	3	4	32 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'56 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	4	4	28 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'56 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'56 RENNY STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	2	3	45 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	7	5	9 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	6	5	8 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	5	5	2 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	4	5	2 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'280 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	3	3	40 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'300 MOORE PARK ROAD'	RES	3	3	39 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	3	3	42 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'345-347 OXFORD STREET'	C	3	0	19 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	2	0	12 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	1	0	10 dB(A)	A	Complies
'358 MOORE PARK ROAD'	RES	3	3	32 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'354 SOUTH DOWLING STREET'	RES	1	2	15 dB(A)	A	Complies (Bgn + 5)
'360 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'349-351 OXFORD STREET'	C	3	0	14 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	2	0	12 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	1	0	12 dB(A)	A	Complies
'360 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	5	4	32 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	4	4	32 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	2	2	12 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)
'356 SOUTH DOWLING STREET'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	3	2	18 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	2	2	18 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	1	2	17 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	3	2	19 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	2	2	17 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'362 SOUTH DOWLING STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	4	2	14 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	3	2	19 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	2	2	19 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'360 SOUTH DOWLING STREET'	RES	1	2	15 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	3	2	17 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	2	2	16 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	1	2	15 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	3	2	21 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	2	2	22 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	1	2	21 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	3	2	21 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	2	2	22 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	1	2	22 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	2	2	21 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	1	2	21 dB(A)	A	Complies (Bgn + 5)
'384 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'388 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'387-389 OXFORD STREET'	C	3	0	18 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	2	0	18 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	1	0	18 dB(A)	A	Complies
'386 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'385 OXFORD STREET'	C	1	0	10 dB(A)	A	Complies
'390 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'390 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	E	1	0	10 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	6 dB(A)	A	Complies
'410 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	1	0	6 dB(A)	A	Complies
'398 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	2	0	4 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	5 dB(A)	A	Complies
'414 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'416 MOORE PARK ROAD'	RES	1	3	17 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	3	3	24 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	3	3	22 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	3	3	22 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	3	3	20 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'424 MOORE PARK ROAD'	RES	3	3	20 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'421 OXFORD STREET'	E	3	0	15 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	10 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	7 dB(A)	A	Complies
'421 OXFORD STREET'	E	3	0	18 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	15 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	13 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	5	0	18 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	4	0	17 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	3	0	13 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	15 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	11 dB(A)	A	Complies
'428 MOORE PARK ROAD'	RES	3	3	21 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	3	3	20 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	2	3	19 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	3	0	13 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	14 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	14 dB(A)	A	Complies
'436 MOORE PARK ROAD'	RES	3	3	20 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	4	2	19 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	3	2	20 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	2	2	19 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	1	2	18 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	3	3	20 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	3	3	7 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	3	3	20 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	2	3	19 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'434 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	7	2	23 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	6	2	23 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	5	2	22 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	4	2	13 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	3	2	8 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	2	2	15 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	2	0	13 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	12 dB(A)	A	Complies
'473 SOUTH DOWLING STREET'	RES	2	2	22 dB(A)	A	Complies (Bgn + 5)
'473 SOUTH DOWLING STREET'	RES	1	2	22 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	3	1	26 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	1	1	26 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	3	1	26 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'495 CLEVELAND STREET'	C	3	0	23 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	2	0	24 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	1	0	24 dB(A)	A	Complies
'477 SOUTH DOWLING STREET'	RES	4	2	24 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	3	2	23 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	2	2	23 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	1	2	22 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	5	1	25 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	4	1	25 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	1	1	22 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	5	2	23 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	4	2	23 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	3	2	22 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	2	2	22 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	1	2	21 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	3	1	26 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'475 SOUTH DOWLING STREET'	RES	2	2	23 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	1	2	23 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	3	1	26 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	3	1	27 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	35 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	31 dB(A)	A	Complies
'83 LEINSTER STREET'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	8	5	7 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	7	5	7 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	6	5	7 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	5	5	7 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	4	5	7 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	3	3	22 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'83 GREENS ROAD'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	5	3	30 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	4	3	30 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	3	3	23 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'84 GORDON STREET'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	3	3	28 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'84 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'87 PHELPS STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'88 REGENT STREET'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'97 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'91 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	7	5	21 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	6	5	21 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	5	5	16 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	4	5	16 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	4	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	17 dB(A)	A	Complies
'104 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'107-111 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	5	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'114 LANG ROAD'	C	3	0	6 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'107-111 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'112 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'108 LANG ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'110 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	12 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	1 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'121-125 COOK ROAD'	RES	8	5	7 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	7	5	3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	6	5	3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	5	5	3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	4	5	3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	6 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	10 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	1 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	0 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	0 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'114 LANG ROAD'	C	1	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	18 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	18 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	10 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'119 LEINSTER STREET'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'119 LEINSTER STREET'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'553 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	20 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	14 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	11 dB(A)	A	Complies
'569 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'569 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'561 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	6 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	4 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	3 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	20 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	11 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	10 dB(A)	A	Complies
'575 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'575 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	1	0	18 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	18 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	19 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	16 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	13 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	20 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	18 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	19 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	19 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	22 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	17 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'560 CLEVELAND STREET'	E	2	0	17 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	18 dB(A)	A	Complies
'577 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'577 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	3	1	24 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	3	1	24 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	4	1	24 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'671 SOUTH DOWLING STREET'	RES	3	1	24 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	2	1	23 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'653 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	24 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	2	1	23 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'681 SOUTH DOWLING STREET'	C	2	0	23 dB(A)	A	Complies
'681 SOUTH DOWLING STREET'	C	1	0	23 dB(A)	A	Complies
'691 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	3	1	19 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	2	1	20 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	1	1	20 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	4	1	22 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	3	1	22 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'705 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'717 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'721 SOUTH DOWLING STREET'	RES	1	1	18 dB(A)	A	Complies (Bgn + 5)
'Site Office'	C	1	0	32 dB(A)	A	Complies
'Site Office'	C	1	0	33 dB(A)	A	Complies
'294 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	3	3	38 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	3	3	39 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'308 MOORE PARK ROAD'	C	5	0	37 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	4	0	37 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	3	0	37 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	2	0	37 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	1	0	37 dB(A)	A	Complies
'302 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	3	3	35 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	3	3	38 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'320 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'336 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	3	3	31 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	6	4	31 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	5	4	31 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	4	4	27 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'342 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'340 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'338 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	3	3	25 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'348 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)

Table A-3: Facade install - no hand tools

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1-5 COOK ROAD'	RES	8	5	24 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	7	5	22 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	6	5	19 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	5	5	19 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	4	5	19 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	3	5	15 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
' 335203 6248625'	AR	2	0	19 dB(A)	A	Complies
' 335203 6248625'	AR	1	0	19 dB(A)	A	Complies
'2 COOK ROAD'	RES	7	5	25 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	6	5	22 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	5	5	22 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	4	5	21 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
' 335206 6248642'	AR	1	0	21 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	-3 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1 DRIVER AVENUE'	C	2	0	-3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	-3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	4 dB(A)	A	Complies
'1 MARTIN STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	21 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	18 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	15 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	14 dB(A)	A	Complies
'1 FURBER ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	9 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	6 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	6 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	6 dB(A)	A	Complies
'1 MITCHELL STREET'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'1 MITCHELL STREET'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'3 GORDON STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'2 ANZAC PARADE'	C	1	0	21 dB(A)	A	Complies
'3 LITTLE STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'3 LITTLE STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'2 IRIS STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'3 CHURCH STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'2 OATLEY ROAD'	C	2	0	36 dB(A)	A	Complies
'2 OATLEY ROAD'	C	1	0	32 dB(A)	A	Complies
'2 MARTIN ROAD'	RES	2	6	-1 dB(A)	A	Complies (Bgn + 5)
'2 MARTIN ROAD'	RES	1	6	-1 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'3 POATE ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'12 LEINSTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'13 ALBION AVENUE'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	4	4	28 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'13 POATE ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'14 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'15 CHURCH STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	3	4	36 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'15 POATE ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	3	4	1 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	2	2	10 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	1	2	10 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	3	4	36 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'18 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'18 FURBER ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'18 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	4	5	22 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	19 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'20-22 LEINSTER STREET'	PoW	2	0	13 dB(A)	A	Complies
'20-22 LEINSTER STREET'	PoW	1	0	10 dB(A)	A	Complies
'19 CENTENNIAL LANE'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'19 CENTENNIAL LANE'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'21 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	3	5	4 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'20 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'21 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'23 MARTIN STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	3	5	9 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'24 LEINSTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'24 GORDON STREET'	C	4	0	16 dB(A)	A	Complies
'24 GORDON STREET'	C	3	0	13 dB(A)	A	Complies
'24 GORDON STREET'	C	2	0	10 dB(A)	A	Complies
'24 GORDON STREET'	C	1	0	9 dB(A)	A	Complies
'24 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'24 CHURCH STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'25 ALBION AVENUE'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'24 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	11 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'38 WALTER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	8	5	2 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	7	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	6	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	5	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	4	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	3	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'39 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'40-42 STEWART STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	8	0	1 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'40 DRIVER AVENUE'	AR	7	0	1 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	1 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	1 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	2 dB(A)	A	Complies
'40 COOK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	4	0	6 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	6 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	7 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	7 dB(A)	A	Complies
'41 ALBION AVENUE'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	E	2	0	-5 dB(A)	A	Complies
'40 DRIVER AVENUE'	E	1	0	-6 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	11	0	7 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	10	0	7 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	9	0	7 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	8	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	2	0	32 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	1	0	31 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	9 dB(A)	A	Complies
'40 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	C	1	0	30 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'40 SELWYN STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	3	5	1 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'42 LEINSTER STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'42 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'42 SELWYN STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'43 GREENS ROAD'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'44 LEINSTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'45 REGENT STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	E	11	0	17 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	10	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	9	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	8	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	7	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	6	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	5	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	4	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	3	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	2	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	1	0	17 dB(A)	A	Complies
'44 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	C	5	0	18 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	4	0	18 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	3	0	18 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	2	0	18 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	1	0	19 dB(A)	A	Complies
'46 GORDON STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'46 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'44 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'47 BENT STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'46 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'46 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'49-51 STEWART STREET'	RES	4	4	30 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	2	4	43 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	1	4	40 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'3 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'4 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'4 FURBER ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'5 STEWART PLACE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	4	4	30 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'8 LEINSTER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'5 FURBER ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	3	4	1 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'5 RENNY STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'6 CHAPMAN STREET'	C	3	0	6 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	2	0	1 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	1	0	0 dB(A)	A	Complies
'6 CHURCH STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'6 FURBER ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'8 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'7 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'8 FURBER ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'8 ALEXANDER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	3	4	4 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'8 IRIS STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'8 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'8 SEYMOUR PLACE'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'9 FURBER ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'10 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'10-14 CHURCH STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'10 IRIS STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'10 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'11 FURBER ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'12 FURBER ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'48 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	8	5	7 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	7	5	4 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	6	5	4 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	5	5	4 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	4	5	4 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	3	5	4 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	3	4	8 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'48 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	4	4	12 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	3	5	-1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'56 SELWYN STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	3	4	21 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'57 SELWYN STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'61 REGENT STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'61 MOORE PARK ROAD'	CC	1	0	7 dB(A)	A	Complies
'62 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'62 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'61 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	2	4	1 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'63 MOORE PARK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	3	3	16 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	2	3	15 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	1	3	14 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'67 REGENT STREET'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	8	5	-2 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	7	5	15 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	6	5	14 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	5	5	13 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	4	5	12 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'69-75 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	3	5	9 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'68 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	3	3	18 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	2	3	17 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'70 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'69-73 MOORE PARK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	3	5	17 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'70 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'72 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'74 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	2	5	-3 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	1	5	-3 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	10 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	7 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	33 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'74 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	14 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	14 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	17 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	12 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	35 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	18 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	18 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	21 dB(A)	A	Complies
'83 STEWART STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	10 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	10 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	17 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'81 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'81 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	11 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	15 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	40 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	14 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	38 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	20 dB(A)	A	Complies
'33 BENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'30 WALTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	2	2	15 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	1	2	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'33 BENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'31 RENNY STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'31 SELWYN STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	3	5	1 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	4	4	10 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	3	4	9 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	2	1	0 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	1	1	0 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	3	3	27 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	3	2	11 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	2	2	11 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'33 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	4	4	9 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'35 ALBION AVENUE'	RES	3	4	8 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'33 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'35 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	3	3	27 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'34 MOORE PARK ROAD'	C	1	0	27 dB(A)	A	Complies
'35 MOORE PARK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'37 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'37 MOORE PARK ROAD'	RES	3	3	27 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'37 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'37 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	12 dB(A)	A	Complies
'38 GORDON STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'38 GORDON STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	7 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	6 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	8 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	8 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	14 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	9 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	9 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	3 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	3 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	1	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	14 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	5 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	5 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	5 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	18 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	18 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	15 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	26 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	18 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	5 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	5 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	15 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	30 dB(A)	A	Complies
'38 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	24 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	5	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	-1 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	-1 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	-1 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	8 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	13 dB(A)	A	Complies
'38 LEINSTER STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	11 dB(A)	A	Complies
'38 SELWYN STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'38 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'38 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'77-83 COOK ROAD'	RES	7	5	3 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	6	5	0 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	5	5	-1 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	4	5	-2 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	3	5	-2 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	32 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	6	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	5	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'78 GORDON STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'78 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'76 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	28 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-3 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	2 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	2 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	3	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'133-139 COOK ROAD'	RES	3	5	-2 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	-3 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'133-139 COOK ROAD'	RES	1	5	-3 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	2	0	0 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-1 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	2 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	2	2	6 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	1	2	6 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'132 FLINDERS STREET'	RES	1	2	7 dB(A)	A	Complies (Bgn + 5)
'128 FLINDERS STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	3	2	4 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	4	5	-4 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	4	2	1 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	3	2	11 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	2	2	11 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	1	2	10 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'144 FLINDERS STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	5	2	1 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	4	2	1 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	3	2	11 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	2	2	11 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	1	2	10 dB(A)	A	Complies (Bgn + 5)
'153-155 COOK ROAD'	CC	3	0	-4 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	2	0	1 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	1	0	2 dB(A)	A	Complies
'156 FLINDERS STREET'	RES	2	2	6 dB(A)	A	Complies (Bgn + 5)
'156 FLINDERS STREET'	RES	1	2	6 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	5	2	5 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	4	2	6 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	3	2	6 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	2	2	6 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	1	2	6 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	4	0	46 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	46 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	46 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	43 dB(A)	A	Complies
'159 COOK ROAD'	CC	1	0	2 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	36 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	46 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	46 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	36 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	38 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'228 MOORE PARK ROAD'	C	2	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	36 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	36 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	5	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	36 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	37 dB(A)	A	Complies
'234 MOORE PARK ROAD'	RES	3	3	48 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	2	3	48 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	3	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	38 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	37 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	1	3	43 dB(A)	A	Complies (Bgn + 5)
'236 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'247 OXFORD STREET'	TH	5	0	23 dB(A)	A	Complies
'247 OXFORD STREET'	TH	4	0	23 dB(A)	A	Complies
'247 OXFORD STREET'	TH	3	0	23 dB(A)	A	Complies
'247 OXFORD STREET'	TH	2	0	23 dB(A)	A	Complies
'247 OXFORD STREET'	TH	1	0	20 dB(A)	A	Complies
'230 MOORE PARK ROAD'	C	1	0	46 dB(A)	A	Complies
'252 MOORE PARK ROAD'	RES	3	3	44 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	2	3	44 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'230 MOORE PARK ROAD'	C	1	0	32 dB(A)	A	Complies
'255 OXFORD STREET'	RES	4	4	27 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	3	3	45 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	2	3	45 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'250 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'251-255 OXFORD STREET'	PR	2	0	13 dB(A)	A	Complies
'251-255 OXFORD STREET'	PR	1	0	13 dB(A)	A	Complies
'257 OXFORD STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	3	3	41 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	3	3	42 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'272 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	3	3	41 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'267 OXFORD STREET'	RES	1	2	10 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	12 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	3	4	7 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'29 BENT STREET'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	4	4	21 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'27 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'28 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'29 GORDON STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'28 RENNY STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'28 MOORE PARK ROAD'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	2	4	1 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	1	4	1 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	3	4	10 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	4	5	9 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	4	4	27 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	1	4	40 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	3	3	16 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'49 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'50 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'52 LANG ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	8	5	8 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	7	5	6 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	6	5	5 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	5	5	6 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'53-55 COOK ROAD'	RES	4	5	3 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'54 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'54 LEINSTER STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'54 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	3	4	21 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'56 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	4	4	21 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	3	4	16 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'56 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'56 RENNY STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'57 OATLEY ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	7	5	6 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	6	5	-1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	5	5	-1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	4	5	-1 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'280 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	3	3	37 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	37 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	3	3	36 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	3	3	40 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'345-347 OXFORD STREET'	C	3	0	8 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	2	0	7 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	1	0	7 dB(A)	A	Complies
'358 MOORE PARK ROAD'	RES	3	3	23 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'354 SOUTH DOWLING STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'360 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'349-351 OXFORD STREET'	C	3	0	8 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	2	0	7 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	1	0	7 dB(A)	A	Complies
'360 MOORE PARK ROAD'	RES	1	3	14 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	5	4	25 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	4	4	20 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	2	2	-1 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'356 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	3	2	6 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	2	2	5 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	1	2	6 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	3	2	14 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	2	2	10 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	1	2	7 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	4	2	3 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	3	2	9 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	2	2	5 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	1	2	2 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'360 SOUTH DOWLING STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	3	2	3 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	3	2	3 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	3	2	14 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'376 SOUTH DOWLING STREET'	RES	2	2	13 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	2	2	12 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	1	2	10 dB(A)	A	Complies (Bgn + 5)
'384 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'388 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'387-389 OXFORD STREET'	C	3	0	10 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	2	0	9 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	1	0	8 dB(A)	A	Complies
'386 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'385 OXFORD STREET'	C	1	0	6 dB(A)	A	Complies
'390 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	14 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	12 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	E	1	0	1 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	-3 dB(A)	A	Complies
'410 MOORE PARK ROAD'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'395 OXFORD STREET'	PoW	1	0	-1 dB(A)	A	Complies
'398 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	2	0	-3 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	-2 dB(A)	A	Complies
'414 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'416 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	3	3	11 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	9 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	3	3	8 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	2	3	7 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	1	3	7 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	3	3	9 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	2	3	8 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	15 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	3	3	7 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	2	3	6 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	1	3	6 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	9 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	3	3	8 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	2	3	7 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	1	3	7 dB(A)	A	Complies (Bgn + 5)
'421 OXFORD STREET'	E	3	0	1 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	-2 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	-4 dB(A)	A	Complies
'421 OXFORD STREET'	E	3	0	5 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	3 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	1 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	5	0	11 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	4	0	9 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	3	0	7 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	2 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	-1 dB(A)	A	Complies
'428 MOORE PARK ROAD'	RES	3	3	5 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	2	3	5 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	1	3	5 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'430 MOORE PARK ROAD'	RES	3	3	3 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	2	3	3 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	1	3	3 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	3	0	4 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	4 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	3 dB(A)	A	Complies
'436 MOORE PARK ROAD'	RES	3	3	4 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	2	3	3 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	1	3	2 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	4	2	0 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	3	2	0 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	2	2	0 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	1	2	0 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	3	3	18 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	1	3	17 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	3	3	1 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	2	3	3 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	1	3	2 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	3	3	18 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	1	3	17 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	7	2	1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	6	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	5	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	4	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	3	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	2	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	2	0	1 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	-1 dB(A)	A	Complies
'473 SOUTH DOWLING STREET'	RES	2	2	1 dB(A)	A	Complies (Bgn + 5)
'473 SOUTH DOWLING STREET'	RES	1	2	1 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	3	1	5 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	2	1	2 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	1	1	2 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	3	1	4 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	2	1	4 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'485 SOUTH DOWLING STREET'	RES	1	1	0 dB(A)	A	Complies (Bgn + 5)
'495 CLEVELAND STREET'	C	3	0	14 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	2	0	14 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	1	0	13 dB(A)	A	Complies
'477 SOUTH DOWLING STREET'	RES	4	2	2 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	3	2	2 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	2	2	2 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	1	2	0 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	5	1	4 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	4	1	4 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	3	1	4 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	2	1	1 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	5	2	2 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	4	2	1 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	3	2	2 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	2	2	2 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	3	1	4 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	2	1	1 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	1	2	1 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	3	1	15 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	2	1	5 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	3	1	4 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	2	1	1 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	1	1	0 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	2	1	2 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	18 dB(A)	A	Complies
'83 LEINSTER STREET'	RES	3	3	16 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	8	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	7	5	0 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'80 COOK ROAD'	RES	6	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	5	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	4	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	3	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	3	3	15 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	2	3	8 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	1	3	6 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	5	3	29 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	4	3	29 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	3	3	16 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'88 GORDON STREET'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'84 GORDON STREET'	RES	1	3	2 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	3	3	19 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	2	3	16 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	1	3	15 dB(A)	A	Complies (Bgn + 5)
'84 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'87 PHELPS STREET'	RES	1	1	0 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'88 REGENT STREET'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'97 STEWART STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	7	5	15 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	6	5	15 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	5	5	16 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	4	5	15 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	3	5	14 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'98 LANG ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	4	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'104 LANG ROAD'	RES	1	5	-4 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	5	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-3 dB(A)	A	Complies
'114 LANG ROAD'	C	3	0	-2 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	-2 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'107-111 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'112 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'108 LANG ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'110 LANG ROAD'	RES	1	5	-4 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'114 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	-4 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	-4 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	0 dB(A)	A	Complies
'121-125 COOK ROAD'	RES	8	5	-1 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	7	5	-3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	6	5	-4 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	5	5	-4 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	4	5	-3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	3	5	-3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	2	5	-3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	1 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	-1 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	-5 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-5 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-5 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	7 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	1	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	1 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'119 LEINSTER STREET'	RES	2	3	17 dB(A)	A	Complies (Bgn + 5)
'119 LEINSTER STREET'	RES	1	3	15 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	2	3	17 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	2	1	4 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	2	1	1 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	2	1	3 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	11 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	11 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	7 dB(A)	A	Complies
'569 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'569 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'561 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	-10 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	-11 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'560 CLEVELAND STREET'	E	1	0	-11 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	16 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	15 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	7 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	6 dB(A)	A	Complies
'575 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'575 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	1	0	11 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	13 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	10 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	10 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	9 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	14 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	14 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	14 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	13 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	15 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	15 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	15 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	14 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	13 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	13 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	13 dB(A)	A	Complies
'577 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'577 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	3	1	20 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	3	1	15 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	3	1	8 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'625-629 SOUTH DOWLING STREET'	RES	2	1	7 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	1	1	5 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	3	1	17 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	3	1	14 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	3	1	15 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	1	1	7 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	1	1	8 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	4	1	14 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	14 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'653 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	14 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'671 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'681 SOUTH DOWLING STREET'	C	2	0	14 dB(A)	A	Complies
'681 SOUTH DOWLING STREET'	C	1	0	13 dB(A)	A	Complies
'691 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	4	1	16 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	1	1	15 dB(A)	A	Complies (Bgn + 5)
'717 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'721 SOUTH DOWLING STREET'	RES	1	1	7 dB(A)	A	Complies (Bgn + 5)
'Site Office'	C	1	0	14 dB(A)	A	Complies
'Site Office'	C	1	0	14 dB(A)	A	Complies
'294 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	3	3	33 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'298 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	3	3	36 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'308 MOORE PARK ROAD'	C	5	0	34 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	4	0	34 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	3	0	34 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	2	0	34 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	1	0	34 dB(A)	A	Complies
'302 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	3	3	36 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'336 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	3	3	22 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'350 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	3	3	22 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	6	4	17 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	5	4	11 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	4	4	10 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	3	4	9 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'342 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'340 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'338 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	3	3	18 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	2	3	19 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	2	3	19 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	3	3	20 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)

Table A-4: Misc Facade Install

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1-5 COOK ROAD'	RES	8	5	33 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	7	5	33 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	6	5	30 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	5	5	31 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	4	5	31 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	3	5	29 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	2	5	27 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
' 335203 6248625'	AR	2	0	34 dB(A)	A	Complies
' 335203 6248625'	AR	1	0	32 dB(A)	A	Complies
'2 COOK ROAD'	RES	7	5	35 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	6	5	34 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	5	5	33 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	4	5	33 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	3	5	31 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	2	5	28 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
' 335206 6248642'	AR	1	0	32 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	14 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	14 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	14 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	9 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	9 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	9 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	15 dB(A)	A	Complies
'1 MARTIN STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	33 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	30 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	28 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	26 dB(A)	A	Complies
'1 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	18 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	15 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	15 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	15 dB(A)	A	Complies
'1 MITCHELL STREET'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'1 MITCHELL STREET'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1 SEYMOUR PLACE'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	3	4	46 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	2	4	44 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	1	4	44 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	3	3	33 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'2 ANZAC PARADE'	C	1	0	35 dB(A)	A	Complies
'3 LITTLE STEWART STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'3 LITTLE STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'2 IRIS STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'3 CHURCH STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'2 OATLEY ROAD'	C	2	0	35 dB(A)	A	Complies
'2 OATLEY ROAD'	C	1	0	35 dB(A)	A	Complies
'2 MARTIN ROAD'	RES	2	6	8 dB(A)	A	Complies (Bgn + 5)
'2 MARTIN ROAD'	RES	1	6	8 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'3 POATE ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'4 RENNY LANE'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'12 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	31 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	29 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	30 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	3	37 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	4	4	36 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'15 WALTER STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'13 POATE ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'14 LANG ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'15 CHURCH STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	2	5	29 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	2	5	29 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'16 WALTER STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	2	2	28 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	1	2	28 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'18 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'18 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'19 GORDON STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	4	5	29 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	28 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	27 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	29 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	27 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'20-22 LEINSTER STREET'	PoW	2	0	25 dB(A)	A	Complies
'20-22 LEINSTER STREET'	PoW	1	0	22 dB(A)	A	Complies
'19 CENTENNIAL LANE'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'19 CENTENNIAL LANE'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'20 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'20 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'21 WALTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'25 BENT STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'24 LEINSTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'24 GORDON STREET'	C	4	0	31 dB(A)	A	Complies
'24 GORDON STREET'	C	3	0	26 dB(A)	A	Complies
'24 GORDON STREET'	C	2	0	22 dB(A)	A	Complies
'24 GORDON STREET'	C	1	0	19 dB(A)	A	Complies
'24 COOK ROAD'	RES	3	5	25 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'24 CHURCH STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'24 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	28 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	28 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'38 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	8	5	21 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	7	5	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'39-43 COOK ROAD'	RES	6	5	19 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	5	5	17 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	4	5	16 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	3	5	17 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	2	4	42 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'39 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'40-42 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	8	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	15 dB(A)	A	Complies
'40 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	4	0	23 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	23 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	23 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	24 dB(A)	A	Complies
'41 ALBION AVENUE'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'40 DRIVER AVENUE'	E	2	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	E	1	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	11	0	19 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	10	0	19 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	9	0	19 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	8	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	2	0	50 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	1	0	50 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	23 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	23 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	23 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	23 dB(A)	A	Complies
'40 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	C	1	0	36 dB(A)	A	Complies
'40 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	2	4	42 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'41 SELWYN STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'42 LEINSTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'42 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'42 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'43 GREENS ROAD'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'44 LEINSTER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	3	5	14 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	E	11	0	38 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	10	0	38 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	9	0	38 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	8	0	38 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	7	0	39 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	6	0	39 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	5	0	39 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	4	0	39 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	3	0	39 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'44 DRIVER AVENUE'	E	2	0	39 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	1	0	39 dB(A)	A	Complies
'44 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	C	5	0	48 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	4	0	49 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	3	0	49 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	2	0	49 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	1	0	49 dB(A)	A	Complies
'46 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'46 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'44 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	3	4	42 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'46 RENNY STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'46 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'46 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	3	4	16 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	4	4	40 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	2	4	44 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	1	4	44 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'3 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'4 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'4 FURBER ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'4 LANG ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'5 STEWART PLACE'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	4	4	40 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	3	4	39 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'5 FURBER ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'5 RENNY STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'6 CHAPMAN STREET'	C	3	0	28 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'6 CHAPMAN STREET'	C	2	0	26 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	1	0	25 dB(A)	A	Complies
'6 CHURCH STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'6 FURBER ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'7 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'8 FURBER ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	3	4	39 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'8 ALEXANDER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	2	3	37 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'8 IRIS STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'8 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'8 SEYMOUR PLACE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'9 FURBER ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'10-14 CHURCH STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	5	28 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'10 IRIS STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	3	37 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	3	5	24 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'10 WALTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'11 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'11 FURBER ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'12 FURBER ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	8	5	26 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	7	5	23 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	6	5	23 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	5	5	19 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	4	5	19 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	3	5	19 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'49 GORDON STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'48 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	4	4	22 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'56 SELWYN STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	3	4	34 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'57 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	3	4	40 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	42 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	3	5	28 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	2	5	27 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'58 COOK ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'61 MOORE PARK ROAD'	CC	1	0	18 dB(A)	A	Complies
'62 REGENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'62 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'61 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'63 MOORE PARK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'64 LANG ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	3	3	27 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'67 REGENT STREET'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	2	5	30 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	1	5	30 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	8	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	7	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	6	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	5	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	4	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	3	4	36 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'68 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	3	3	31 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'70 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'69-73 MOORE PARK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'71 STEWART STREET'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	2	5	28 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'70 COOK ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'72 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'74 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	16 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	18 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	18 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	41 dB(A)	A	Complies
'74 LANG ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	40 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	40 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	41 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	45 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	45 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	28 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	32 dB(A)	A	Complies
'83 STEWART STREET'	RES	3	4	32 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	18 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'81 STEWART STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'81 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	41 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	41 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	46 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	38 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	1	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	47 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	48 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	48 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	47 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	46 dB(A)	A	Complies
'75 OXFORD STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'33 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'30 WALTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	2	2	29 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	1	2	29 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'31 RENNY STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'31 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'32 RENNY STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	4	4	13 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	3	3	36 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	3	2	29 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	2	2	29 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	1	2	29 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'33 GORDON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	4	4	24 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'33 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'35 GORDON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	3	3	36 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'36 POATE LANE'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'34 MOORE PARK ROAD'	C	1	0	25 dB(A)	A	Complies
'35 MOORE PARK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'37 BENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	3	3	32 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'37 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	2	4	42 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'37 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	23 dB(A)	A	Complies
'38 GORDON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'38 GORDON STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	2	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	41 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	41 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	40 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	39 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	39 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	39 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	44 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	39 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	23 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	1	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	44 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	43 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	43 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	43 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	42 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	26 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	25 dB(A)	A	Complies
'38 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	34 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	34 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	34 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	27 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	28 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	28 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	26 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	24 dB(A)	A	Complies
'38 LEINSTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	2	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	35 dB(A)	A	Complies
'38 SELWYN STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'38 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	3	5	30 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	2	5	28 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'38 LANG ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	45 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	45 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	44 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	42 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'77-83 COOK ROAD'	RES	7	5	14 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	6	5	11 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	5	5	10 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	4	5	10 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	6	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	5	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	21 dB(A)	A	Complies
'78 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'78 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'76 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	33 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	17 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	1	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	15 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	14 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	3	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	15 dB(A)	A	Complies
'133-139 COOK ROAD'	RES	3	5	9 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	2	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	8 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	21 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	2	2	24 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	1	2	24 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	2	2	22 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	1	2	21 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'127-131 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'132 FLINDERS STREET'	RES	1	2	21 dB(A)	A	Complies (Bgn + 5)
'128 FLINDERS STREET'	RES	1	2	19 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	3	2	18 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	2	2	17 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	1	2	17 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	4	5	6 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	4	2	14 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	3	2	14 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	2	2	18 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	1	2	18 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	2	2	15 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	2	2	18 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	1	2	19 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	5	2	15 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	4	2	14 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	3	2	13 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	2	2	13 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	1	2	13 dB(A)	A	Complies (Bgn + 5)
'153-155 COOK ROAD'	CC	3	0	6 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	2	0	10 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	1	0	11 dB(A)	A	Complies
'156 FLINDERS STREET'	RES	2	2	18 dB(A)	A	Complies (Bgn + 5)
'156 FLINDERS STREET'	RES	1	2	18 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	5	2	28 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	4	2	29 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	3	2	29 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	2	2	29 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'162 FLINDERS STREET'	RES	1	2	29 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	4	0	55 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	55 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	55 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	50 dB(A)	A	Complies
'159 COOK ROAD'	CC	1	0	10 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	56 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	56 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	56 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	54 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	33 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	33 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	54 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	54 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	54 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	53 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	42 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	5	0	55 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	55 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	55 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	55 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	50 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	40 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'228 MOORE PARK ROAD'	C	3	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	43 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	46 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	43 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	43 dB(A)	A	Complies
'234 MOORE PARK ROAD'	RES	3	3	52 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	2	3	51 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	1	3	47 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	3	0	47 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	47 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	47 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	43 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	2	3	50 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'236 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'247 OXFORD STREET'	TH	5	0	27 dB(A)	A	Complies
'247 OXFORD STREET'	TH	4	0	26 dB(A)	A	Complies
'247 OXFORD STREET'	TH	3	0	19 dB(A)	A	Complies
'247 OXFORD STREET'	TH	2	0	17 dB(A)	A	Complies
'247 OXFORD STREET'	TH	1	0	11 dB(A)	A	Complies
'230 MOORE PARK ROAD'	C	1	0	50 dB(A)	A	Complies
'252 MOORE PARK ROAD'	RES	3	3	51 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	2	3	50 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	1	3	47 dB(A)	A	Complies (Bgn + 5)
'230 MOORE PARK ROAD'	C	1	0	45 dB(A)	A	Complies
'255 OXFORD STREET'	RES	4	4	36 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	3	4	36 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	3	3	50 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'246 MOORE PARK ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'250 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'251-255 OXFORD STREET'	PR	2	0	33 dB(A)	A	Complies
'251-255 OXFORD STREET'	PR	1	0	28 dB(A)	A	Complies
'257 OXFORD STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	3	3	49 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	48 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	3	3	50 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	3	3	48 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'267 OXFORD STREET'	RES	1	2	21 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	48 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'24 MOORE PARK ROAD'	RES	2	2	28 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	28 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	3	4	39 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	4	4	38 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	3	4	39 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'27 WALTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'27 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	3	5	25 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'28 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'29 GORDON STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'28 RENNY STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'28 MOORE PARK ROAD'	RES	1	2	27 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	4	5	21 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	19 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'30-38 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	4	4	40 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	2	4	45 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	1	4	45 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	3	3	31 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	3	4	32 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'50 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	3	5	26 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'53 MOORE PARK ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	3	4	36 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	3	4	36 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'52 LANG ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	8	5	24 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	7	5	21 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	6	5	21 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	5	5	11 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	4	5	11 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'54 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	3	5	27 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'54 LEINSTER STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'54 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'54 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'56 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	4	4	33 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'56 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'56 RENNY STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	2	3	51 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	1	3	49 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	7	5	13 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	6	5	10 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	5	5	10 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	4	5	11 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'280 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	3	3	46 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	45 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'292 MOORE PARK ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	1	3	43 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	3	3	45 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	2	3	45 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	3	3	48 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	48 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'345-347 OXFORD STREET'	C	3	0	22 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'358 MOORE PARK ROAD'	RES	3	3	37 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'354 SOUTH DOWLING STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'360 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'349-351 OXFORD STREET'	C	3	0	17 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	2	0	17 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	1	0	17 dB(A)	A	Complies
'360 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	5	4	32 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	4	4	28 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	2	2	16 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	1	2	15 dB(A)	A	Complies (Bgn + 5)
'356 SOUTH DOWLING STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	3	2	22 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'372 SOUTH DOWLING STREET'	RES	2	2	22 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	3	2	21 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	1	2	18 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	4	2	12 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	3	2	21 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	1	2	19 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'360 SOUTH DOWLING STREET'	RES	1	2	17 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	3	2	21 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	3	2	21 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	2	2	21 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	3	2	21 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	1	2	19 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	2	2	15 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	1	2	15 dB(A)	A	Complies (Bgn + 5)
'384 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'388 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'387-389 OXFORD STREET'	C	3	0	21 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	2	0	19 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	1	0	18 dB(A)	A	Complies
'386 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'385 OXFORD STREET'	C	1	0	17 dB(A)	A	Complies
'390 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	E	1	0	10 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	9 dB(A)	A	Complies
'410 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	1	0	8 dB(A)	A	Complies
'398 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	2	0	6 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	7 dB(A)	A	Complies
'414 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'416 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	3	3	27 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	3	3	24 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	3	3	25 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	3	3	24 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'426 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	17 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	3	3	24 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'421 OXFORD STREET'	E	3	0	13 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	10 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	7 dB(A)	A	Complies
'421 OXFORD STREET'	E	3	0	14 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	12 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	11 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	5	0	22 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	4	0	21 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	3	0	19 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	14 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	11 dB(A)	A	Complies
'428 MOORE PARK ROAD'	RES	3	3	24 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	3	3	23 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	3	0	17 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	16 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	14 dB(A)	A	Complies
'436 MOORE PARK ROAD'	RES	3	3	24 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	4	2	12 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	3	2	13 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	2	2	13 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	1	2	13 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	3	3	23 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	3	3	12 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'438 MOORE PARK ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	3	3	23 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	7	2	24 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	6	2	23 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	5	2	23 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	4	2	20 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	3	2	20 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	2	2	23 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	1	2	23 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	2	0	13 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	11 dB(A)	A	Complies
'473 SOUTH DOWLING STREET'	RES	2	2	24 dB(A)	A	Complies (Bgn + 5)
'473 SOUTH DOWLING STREET'	RES	1	2	24 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'495 CLEVELAND STREET'	C	3	0	24 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	2	0	25 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	1	0	25 dB(A)	A	Complies
'477 SOUTH DOWLING STREET'	RES	4	2	24 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	3	2	24 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	2	2	24 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	1	2	24 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	5	1	25 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	4	1	25 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	5	2	24 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	4	2	24 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	3	2	24 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	2	2	24 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'479 SOUTH DOWLING STREET'	RES	1	2	24 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	2	2	24 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	1	2	24 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	3	1	31 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	2	1	31 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	1	1	31 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	3	1	26 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	2	1	31 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'83 LEINSTER STREET'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	8	5	11 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	7	5	11 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	6	5	11 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	5	5	11 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	4	5	12 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	3	5	25 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	3	3	25 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	3	4	34 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'83 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	5	3	38 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	4	3	38 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	3	3	38 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	3	3	27 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'84 GORDON STREET'	RES	1	3	17 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'84 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'87 PHELPS STREET'	RES	1	1	31 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'88 REGENT STREET'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'90 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'97 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	7	5	26 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	6	5	26 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	5	5	23 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	4	5	22 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	4	0	21 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	20 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	19 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	18 dB(A)	A	Complies
'104 LANG ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'107-111 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	5	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	8 dB(A)	A	Complies
'114 LANG ROAD'	C	3	0	10 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	10 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	10 dB(A)	A	Complies
'107-111 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'112 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'108 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'110 LANG ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	12 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	9 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	8 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'121-125 COOK ROAD'	RES	8	5	10 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	7	5	8 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	6	5	8 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	5	5	8 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	4	5	9 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	3	5	9 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	10 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	14 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	1	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	6 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	10 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	13 dB(A)	A	Complies
'119 LEINSTER STREET'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'119 LEINSTER STREET'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	2	1	31 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	1	1	31 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	2	1	31 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	2	1	30 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	18 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	15 dB(A)	A	Complies
'569 SOUTH DOWLING STREET'	RES	2	1	32 dB(A)	A	Complies (Bgn + 5)
'569 SOUTH DOWLING STREET'	RES	1	1	31 dB(A)	A	Complies (Bgn + 5)
'561 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	2	1	31 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	5 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	4 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	4 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	23 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	22 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	13 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	11 dB(A)	A	Complies
'575 SOUTH DOWLING STREET'	RES	2	1	31 dB(A)	A	Complies (Bgn + 5)
'575 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	1	0	23 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	19 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	20 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	18 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	16 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	25 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	24 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	24 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	23 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	25 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'560 CLEVELAND STREET'	E	3	0	25 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	25 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	24 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	23 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	22 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	22 dB(A)	A	Complies
'577 SOUTH DOWLING STREET'	RES	2	1	31 dB(A)	A	Complies (Bgn + 5)
'577 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	2	1	31 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	2	1	30 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	3	1	31 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	3	1	26 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	3	1	30 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	2	1	30 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	3	1	30 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	30 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	3	1	29 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	22 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	3	1	27 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'649 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	4	1	25 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'653 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'681 SOUTH DOWLING STREET'	C	2	0	24 dB(A)	A	Complies
'681 SOUTH DOWLING STREET'	C	1	0	24 dB(A)	A	Complies
'691 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	2	1	22 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	2	1	22 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	3	1	23 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	2	1	22 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	4	1	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'711 SOUTH DOWLING STREET'	RES	3	1	23 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	2	1	22 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	2	1	22 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	2	1	22 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	2	1	22 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	2	1	22 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'717 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'721 SOUTH DOWLING STREET'	RES	1	1	20 dB(A)	A	Complies (Bgn + 5)
'Site Office'	C	1	0	30 dB(A)	A	Complies
'Site Office'	C	1	0	30 dB(A)	A	Complies
'294 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	3	3	44 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	2	3	43 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	3	3	46 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	2	3	45 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'308 MOORE PARK ROAD'	C	5	0	44 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	4	0	44 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	3	0	43 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	2	0	43 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	1	0	43 dB(A)	A	Complies
'302 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	3	3	42 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	3	3	44 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'306 MOORE PARK ROAD'	RES	2	3	44 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	1	3	43 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	2	3	37 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'336 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	3	3	34 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	3	3	35 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	6	4	34 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	5	4	32 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	4	4	32 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'342 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'340 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'338 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'352 MOORE PARK ROAD'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	3	3	33 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)

Table A-5: Roof finishes

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1-5 COOK ROAD'	RES	8	5	17 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	7	5	15 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	6	5	14 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	5	5	5 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	4	5	5 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	3	5	4 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
' 335203 6248625'	AR	2	0	8 dB(A)	A	Complies
' 335203 6248625'	AR	1	0	8 dB(A)	A	Complies
'2 COOK ROAD'	RES	7	5	20 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	6	5	17 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	5	5	12 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	4	5	12 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	3	5	17 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
' 335206 6248642'	AR	1	0	8 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1 DRIVER AVENUE'	C	3	0	3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	-3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	-3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	-3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	2 dB(A)	A	Complies
'1 MARTIN STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	14 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	14 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	14 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	13 dB(A)	A	Complies
'1 FURBER ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	6 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	5 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	5 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	5 dB(A)	A	Complies
'1 MITCHELL STREET'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'1 MITCHELL STREET'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	3	4	16 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	-2 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	-1 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	1 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	3	3	13 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'3 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'2 ANZAC PARADE'	C	1	0	20 dB(A)	A	Complies
'3 LITTLE STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'3 LITTLE STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'2 IRIS STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'3 CHURCH STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'2 OATLEY ROAD'	C	2	0	29 dB(A)	A	Complies
'2 OATLEY ROAD'	C	1	0	28 dB(A)	A	Complies
'2 MARTIN ROAD'	RES	2	6	-3 dB(A)	A	Complies (Bgn + 5)
'2 MARTIN ROAD'	RES	1	6	-3 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'3 POATE ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'12 LEINSTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	2	4	3 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'12 SEYMOUR PLACE'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	4	4	17 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	3	4	16 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'13 POATE ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	3	5	6 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'14 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'15 CHURCH STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	3	4	1 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	2	4	1 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	2	4	3 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	2	2	21 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	1	2	21 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'18 BENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	2	4	3 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'18 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	0 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	4	5	9 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'20-22 LEINSTER STREET'	PoW	2	0	9 dB(A)	A	Complies
'20-22 LEINSTER STREET'	PoW	1	0	7 dB(A)	A	Complies
'19 CENTENNIAL LANE'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'19 CENTENNIAL LANE'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'19 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	2	4	3 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	2	4	0 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	1	4	0 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'20 SELWYN STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'21 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'22 WALTER STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	3	5	4 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	3	5	6 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'24 LEINSTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'24 GORDON STREET'	C	4	0	14 dB(A)	A	Complies
'24 GORDON STREET'	C	3	0	13 dB(A)	A	Complies
'24 GORDON STREET'	C	2	0	11 dB(A)	A	Complies
'24 GORDON STREET'	C	1	0	10 dB(A)	A	Complies
'24 COOK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'24 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'24 CHURCH STREET'	RES	1	4	-1 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	2	4	1 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	1	4	1 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'24 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	21 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	21 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'38 WALTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	8	5	2 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	7	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	6	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	5	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	4	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	3	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'39 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'40-42 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'40 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	8	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	2 dB(A)	A	Complies
'40 COOK ROAD'	RES	3	5	0 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	4	0	7 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	7 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	7 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	7 dB(A)	A	Complies
'41 ALBION AVENUE'	RES	3	4	4 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	E	2	0	-6 dB(A)	A	Complies
'40 DRIVER AVENUE'	E	1	0	-6 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	11	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	10	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	9	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	8	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	10 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	2	0	28 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	1	0	28 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	9 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'40 DRIVER AVENUE'	AR	2	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	9 dB(A)	A	Complies
'40 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	C	1	0	30 dB(A)	A	Complies
'40 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	3	5	1 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'42 LEINSTER STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	3	4	4 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'42 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'42 SELWYN STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'43 GREENS ROAD'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'43 MOORE PARK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'44 LEINSTER STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	3	5	1 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	E	11	0	25 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	10	0	25 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	9	0	25 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	8	0	25 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	7	0	25 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	6	0	25 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	5	0	25 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	4	0	25 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	3	0	25 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	2	0	6 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	1	0	7 dB(A)	A	Complies
'44 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	C	5	0	23 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	4	0	23 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	3	0	13 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	2	0	13 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	1	0	13 dB(A)	A	Complies
'46 GORDON STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'46 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'44 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'45 OATLEY ROAD'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	3	4	2 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'46 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'46 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	3	4	3 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'47 COOK ROAD'	RES	3	5	2 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	4	4	24 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	3	4	21 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'3 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'4 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'4 FURBER ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'5 STEWART PLACE'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	4	4	25 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	2	4	3 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'5 FURBER ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	3	4	-1 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	2	4	0 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	1	4	0 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'5 RENNY STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'6 CHAPMAN STREET'	C	3	0	18 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	2	0	16 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	1	0	13 dB(A)	A	Complies
'6 CHURCH STREET'	RES	1	4	1 dB(A)	A	Complies (Bgn + 5)
'6 FURBER ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	2	4	0 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	1	4	0 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'7-17 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'7 POATE ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'8 FURBER ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'8 ALEXANDER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	3	4	2 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'8 IRIS STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'8 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'8 SEYMOUR PLACE'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'9 FURBER ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'9 STEWART STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'10-14 CHURCH STREET'	RES	1	4	1 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'10 IRIS STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	2	4	3 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'10 WALTER STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'11 FURBER ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'11 RENNY STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'12 FURBER ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	8	5	8 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	7	5	3 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	6	5	2 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	5	5	2 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	4	5	2 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	3	4	6 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'48 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	4	4	12 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	3	5	-2 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'56 SELWYN STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	3	4	21 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'59 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'57 SELWYN STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	2	4	3 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'65 STEWART STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'61 MOORE PARK ROAD'	CC	1	0	5 dB(A)	A	Complies
'62 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'62 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'61 SELWYN STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	2	4	-1 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	1	4	-1 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	2	5	-3 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	1	5	-3 dB(A)	A	Complies (Bgn + 5)
'63 MOORE PARK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	2	4	3 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	3	3	17 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	2	3	16 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'67 REGENT STREET'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	8	5	-2 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	7	5	9 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	6	5	8 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'69-75 COOK ROAD'	RES	5	5	7 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	4	5	6 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	3	5	0 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'68 GORDON STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	3	3	17 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	2	3	16 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'70 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'69-73 MOORE PARK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'70 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'72 GORDON STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'74 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	2	5	-3 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	1	5	-3 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	3	0	6 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	6 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	5 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'74 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	16 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	16 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	5 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	6 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	6 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	7 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	6 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	13 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	12 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	7 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	8 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	8 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	16 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	15 dB(A)	A	Complies
'83 STEWART STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	9 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	9 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	10 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	3 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	4 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	14 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	16 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	16 dB(A)	A	Complies
'81 STEWART STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'81 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	4 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	6 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	7 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	9 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	9 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	11 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	6 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	6 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	11 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	16 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	15 dB(A)	A	Complies
'33 BENT STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	3	4	21 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'31 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'30 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	2	2	9 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	1	2	9 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'31 RENNY STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'31 SELWYN STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	4	4	-1 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	3	4	-1 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	2	4	-1 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	1	4	0 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	1	1	12 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	3	3	13 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	3	2	4 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'32 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'33 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	4	4	-1 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	3	4	-1 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	2	4	-1 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	1	4	-1 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'33 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'35 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	3	3	12 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	2	3	12 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'34 MOORE PARK ROAD'	C	1	0	8 dB(A)	A	Complies
'35 MOORE PARK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'36 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	2	4	0 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	1	4	0 dB(A)	A	Complies (Bgn + 5)
'37 BENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	3	3	12 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	2	3	9 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'37 GORDON STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'37 SELWYN STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	13 dB(A)	A	Complies
'38 GORDON STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'38 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	5 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	5 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	8 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	11 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	2	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	9 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	2 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	2 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	6 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	6 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	6 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	6 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	6 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	6 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	3 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	18 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	15 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	15 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	6 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	8 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	27 dB(A)	A	Complies
'38 STEWART STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	-2 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	-2 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	-1 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	8 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	13 dB(A)	A	Complies
'38 LEINSTER STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	23 dB(A)	A	Complies
'38 SELWYN STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'38 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'38 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	3 dB(A)	A	Complies
'77-83 COOK ROAD'	RES	7	5	1 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	6	5	0 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	5	5	-1 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'77-83 COOK ROAD'	RES	4	5	-1 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	3	5	0 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	1	0	17 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	8 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	10 dB(A)	A	Complies
'75 OXFORD STREET'	C	6	0	8 dB(A)	A	Complies
'75 OXFORD STREET'	C	5	0	7 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	7 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	7 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	7 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	7 dB(A)	A	Complies
'78 GORDON STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'78 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'76 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	18 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-3 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	-2 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	-2 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	3	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'133-139 COOK ROAD'	RES	3	5	-3 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	-4 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	-4 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	2	0	0 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	0 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	0 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-1 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	-2 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	-2 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	2	2	5 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	1	2	6 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	2	2	2 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	1	2	2 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'132 FLINDERS STREET'	RES	1	2	6 dB(A)	A	Complies (Bgn + 5)
'128 FLINDERS STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	3	2	2 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	2	2	2 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	1	2	2 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	4	5	-5 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	3	5	2 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	4	2	-2 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'158 FLINDERS STREET'	RES	3	2	-1 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	2	2	-1 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	5	2	-2 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	4	2	-1 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	3	2	-1 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	2	2	-1 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'153-155 COOK ROAD'	CC	3	0	-5 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	2	0	-1 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	1	0	0 dB(A)	A	Complies
'156 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'156 FLINDERS STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	5	2	19 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	4	2	19 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	3	2	20 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	4	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	32 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	28 dB(A)	A	Complies
'159 COOK ROAD'	CC	1	0	0 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	30 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	26 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	36 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	36 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	29 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	30 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	26 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	33 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'228 MOORE PARK ROAD'	C	3	0	33 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	26 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	30 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	26 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	30 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	29 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	5	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	27 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	32 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	32 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	26 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	30 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	29 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	32 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	32 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	30 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	26 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	32 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	26 dB(A)	A	Complies
'234 MOORE PARK ROAD'	RES	3	3	44 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	3	0	32 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	26 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'244 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'236 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'247 OXFORD STREET'	TH	5	0	15 dB(A)	A	Complies
'247 OXFORD STREET'	TH	4	0	15 dB(A)	A	Complies
'247 OXFORD STREET'	TH	3	0	15 dB(A)	A	Complies
'247 OXFORD STREET'	TH	2	0	15 dB(A)	A	Complies
'247 OXFORD STREET'	TH	1	0	15 dB(A)	A	Complies
'230 MOORE PARK ROAD'	C	1	0	31 dB(A)	A	Complies
'252 MOORE PARK ROAD'	RES	3	3	44 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'230 MOORE PARK ROAD'	C	1	0	24 dB(A)	A	Complies
'255 OXFORD STREET'	RES	4	4	23 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	3	3	44 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'250 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'251-255 OXFORD STREET'	PR	2	0	8 dB(A)	A	Complies
'251-255 OXFORD STREET'	PR	1	0	7 dB(A)	A	Complies
'257 OXFORD STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	3	3	42 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	3	3	43 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'270 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	3	3	41 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	37 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'267 OXFORD STREET'	RES	1	2	8 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	37 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	22 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	22 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'26 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	3	5	6 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	4	4	22 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	2	3	12 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'27 GORDON STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	2	4	-1 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	1	4	-1 dB(A)	A	Complies (Bgn + 5)
'28 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'29 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'28 RENNY STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'28 MOORE PARK ROAD'	RES	1	2	9 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	2	4	-1 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	1	4	-1 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	3	4	10 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	4	5	5 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	4 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	4	4	24 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	3	4	16 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	3	3	13 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	2	3	12 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'51 GORDON STREET'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'50 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	3	5	6 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	3	4	21 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'52 LANG ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'53-55 COOK ROAD'	RES	8	5	11 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	7	5	1 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	6	5	-1 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	5	5	-1 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	4	5	-1 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	3	5	-1 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'54 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'54 LEINSTER STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'54 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	3	4	16 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'56 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	4	4	21 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'56 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'56 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'56 RENNY STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	7	5	-1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	6	5	-2 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	5	5	-2 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	4	5	-2 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'280 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	3	3	38 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	3	3	37 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	3	4	10 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	3	3	40 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'345-347 OXFORD STREET'	C	3	0	9 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	2	0	8 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'345-347 OXFORD STREET'	C	1	0	8 dB(A)	A	Complies
'358 MOORE PARK ROAD'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'354 SOUTH DOWLING STREET'	RES	1	2	-2 dB(A)	A	Complies (Bgn + 5)
'360 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'349-351 OXFORD STREET'	C	3	0	7 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	2	0	7 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	1	0	7 dB(A)	A	Complies
'360 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	5	4	13 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	4	4	11 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	2	2	-3 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	1	2	-3 dB(A)	A	Complies (Bgn + 5)
'356 SOUTH DOWLING STREET'	RES	1	2	-3 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	3	2	4 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	3	2	-2 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	2	2	-2 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	1	2	-2 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	4	2	-1 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	3	2	-1 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	2	2	-1 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	2	3	9 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'360 SOUTH DOWLING STREET'	RES	1	2	1 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	3	2	1 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	2	2	1 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	1	2	2 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	3	2	2 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'374 SOUTH DOWLING STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	3	2	2 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	2	2	2 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	2	2	2 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	1	2	2 dB(A)	A	Complies (Bgn + 5)
'384 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	7 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	2	3	8 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	1	3	7 dB(A)	A	Complies (Bgn + 5)
'388 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'387-389 OXFORD STREET'	C	3	0	9 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	2	0	9 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	1	0	10 dB(A)	A	Complies
'386 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'385 OXFORD STREET'	C	1	0	7 dB(A)	A	Complies
'390 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	2	3	7 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	1	3	7 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	7 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	7 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	6 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	6 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'395 OXFORD STREET'	E	1	0	-2 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	-1 dB(A)	A	Complies
'410 MOORE PARK ROAD'	RES	2	3	9 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	1	0	-2 dB(A)	A	Complies
'398 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	2	0	-3 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	-1 dB(A)	A	Complies
'414 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'416 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	3	3	11 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	9 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	3	3	6 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	2	3	5 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	1	3	6 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	3	3	8 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	2	3	7 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	1	3	7 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	3	3	5 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	2	3	5 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	1	3	5 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	4 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	4 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	3	3	7 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	2	3	6 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	1	3	6 dB(A)	A	Complies (Bgn + 5)
'421 OXFORD STREET'	E	3	0	-2 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	-4 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	-5 dB(A)	A	Complies
'421 OXFORD STREET'	E	3	0	4 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	2 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	0 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	5	0	3 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	4	0	2 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	3	0	0 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	-3 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'461-463 OXFORD STREET'	PoW	1	0	-5 dB(A)	A	Complies
'428 MOORE PARK ROAD'	RES	3	3	2 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	2	3	2 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	1	3	2 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	3	3	3 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	2	3	2 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	1	3	3 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	3	0	3 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	2 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	-1 dB(A)	A	Complies
'436 MOORE PARK ROAD'	RES	3	3	4 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	2	3	3 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	1	3	2 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	4	2	-2 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	3	2	-1 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	2	2	-1 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	3	3	2 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	2	3	1 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	1	3	1 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	3	3	2 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	2	3	2 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	1	3	1 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	3	3	5 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	2	3	4 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	1	3	3 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	7	2	16 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	6	2	15 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	5	2	7 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	4	2	1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	3	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	2	2	-2 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	1	2	-2 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	2	0	-2 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	-4 dB(A)	A	Complies
'473 SOUTH DOWLING STREET'	RES	2	2	6 dB(A)	A	Complies (Bgn + 5)
'473 SOUTH DOWLING STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	3	1	18 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'487 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	3	1	18 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'495 CLEVELAND STREET'	C	3	0	15 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	2	0	15 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	1	0	15 dB(A)	A	Complies
'477 SOUTH DOWLING STREET'	RES	4	2	3 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	3	2	2 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	2	2	1 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	1	2	0 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	5	1	17 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	4	1	18 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	3	1	18 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	1	1	12 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	5	2	4 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	4	2	3 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	3	2	1 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	2	2	0 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	3	1	18 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	2	2	5 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	3	1	18 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	3	1	19 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	1	1	12 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	16 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	13 dB(A)	A	Complies
'83 LEINSTER STREET'	RES	3	3	16 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'83 LEINSTER STREET'	RES	2	3	15 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	1	3	15 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	8	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	7	5	-1 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	6	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	5	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	4	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	3	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	3	3	7 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	2	3	7 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	1	3	6 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	2	3	7 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	1	3	6 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	3	4	1 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	2	4	1 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	5	3	29 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	4	3	28 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	3	3	25 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'85 STEWART STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	3	3	8 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	2	3	8 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	1	3	7 dB(A)	A	Complies (Bgn + 5)
'84 GORDON STREET'	RES	1	3	1 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	3	3	18 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	2	3	16 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'84 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'87 PHELPS STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'88 REGENT STREET'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	2	5	-4 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'97 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	7	5	15 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	6	5	15 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	5	5	13 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	4	5	11 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'91 GREENS ROAD'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	4	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'104 LANG ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	5	0	-4 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-3 dB(A)	A	Complies
'114 LANG ROAD'	C	3	0	-3 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	-2 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	0 dB(A)	A	Complies
'107-111 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'112 LANG ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'108 LANG ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'110 LANG ROAD'	RES	1	5	-5 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	2 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	-4 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	-5 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	-1 dB(A)	A	Complies
'121-125 COOK ROAD'	RES	8	5	-2 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	7	5	-4 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	6	5	-4 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	5	5	-4 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	4	5	-4 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	3	5	-4 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	2	5	-4 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	0 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	-1 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	-6 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-5 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-5 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	6 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	-1 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	1 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'119 LEINSTER STREET'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'119 LEINSTER STREET'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	2	1	9 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	1	1	8 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	10 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	3 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	-3 dB(A)	A	Complies
'569 SOUTH DOWLING STREET'	RES	2	1	9 dB(A)	A	Complies (Bgn + 5)
'569 SOUTH DOWLING STREET'	RES	1	1	9 dB(A)	A	Complies (Bgn + 5)
'561 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'571 SOUTH DOWLING STREET'	RES	2	1	9 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	1	1	9 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	-1 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	-2 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	-4 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	11 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	11 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	0 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	-2 dB(A)	A	Complies
'575 SOUTH DOWLING STREET'	RES	2	1	9 dB(A)	A	Complies (Bgn + 5)
'575 SOUTH DOWLING STREET'	RES	1	1	8 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	1	0	7 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	9 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	9 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	6 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	2 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	9 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	9 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	9 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	9 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	10 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	10 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	10 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	11 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	8 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	8 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	8 dB(A)	A	Complies
'577 SOUTH DOWLING STREET'	RES	2	1	9 dB(A)	A	Complies (Bgn + 5)
'577 SOUTH DOWLING STREET'	RES	1	1	8 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	2	1	9 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	1	1	8 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	2	1	9 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	1	1	8 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	3	1	10 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	2	1	10 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	1	1	9 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'645 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	3	1	8 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	2	1	1 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	3	1	8 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	7 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	7 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	3	1	8 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	2	1	7 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	1	1	7 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	7 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	7 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	3	1	8 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	2	1	8 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	4	1	15 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	1	1	15 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'653 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'665 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	1	1	15 dB(A)	A	Complies (Bgn + 5)
'681 SOUTH DOWLING STREET'	C	2	0	15 dB(A)	A	Complies
'681 SOUTH DOWLING STREET'	C	1	0	15 dB(A)	A	Complies
'691 SOUTH DOWLING STREET'	RES	1	1	15 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	1	1	15 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	3	1	9 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	2	1	8 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	1	1	6 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	4	1	11 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	3	1	9 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	2	1	8 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	1	1	6 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	2	1	8 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	1	1	7 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	2	1	8 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	1	1	6 dB(A)	A	Complies (Bgn + 5)
'717 SOUTH DOWLING STREET'	RES	1	1	6 dB(A)	A	Complies (Bgn + 5)
'721 SOUTH DOWLING STREET'	RES	1	1	6 dB(A)	A	Complies (Bgn + 5)
'Site Office'	C	1	0	25 dB(A)	A	Complies
'Site Office'	C	1	0	25 dB(A)	A	Complies
'294 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'296 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	3	3	36 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	3	3	37 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'308 MOORE PARK ROAD'	C	5	0	35 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	4	0	35 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	3	0	35 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	2	0	35 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	1	0	31 dB(A)	A	Complies
'302 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	3	3	34 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	3	3	37 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'336 MOORE PARK ROAD'	RES	1	3	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'332-334 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	3	3	31 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	6	4	20 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	5	4	12 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	4	4	11 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	3	4	9 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'342 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'340 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'338 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	3	3	24 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)

Table A-6: Pitch works

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1-5 COOK ROAD'	RES	8	5	29 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	7	5	28 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	6	5	28 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	5	5	19 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	4	5	19 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1-5 COOK ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
' 335203 6248625'	AR	2	0	31 dB(A)	A	Complies
' 335203 6248625'	AR	1	0	31 dB(A)	A	Complies
'2 COOK ROAD'	RES	7	5	30 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	6	5	30 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	5	5	21 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	4	5	23 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
' 335206 6248642'	AR	1	0	20 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	15 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	15 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	15 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	9 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	10 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	10 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	15 dB(A)	A	Complies
'1 MARTIN STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	27 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	25 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	23 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	22 dB(A)	A	Complies
'1 FURBER ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	20 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	17 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	16 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	16 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1 MITCHELL STREET'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'1 MITCHELL STREET'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	3	4	43 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	3	3	25 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'2 ANZAC PARADE'	C	1	0	33 dB(A)	A	Complies
'3 LITTLE STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'3 LITTLE STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'2 IRIS STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'3 CHURCH STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'2 OATLEY ROAD'	C	2	0	40 dB(A)	A	Complies
'2 OATLEY ROAD'	C	1	0	40 dB(A)	A	Complies
'2 MARTIN ROAD'	RES	2	6	9 dB(A)	A	Complies (Bgn + 5)
'2 MARTIN ROAD'	RES	1	6	9 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'3 OATLEY ROAD'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'3 POATE ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'12 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	4	4	32 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	3	4	32 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'15 ALBION AVENUE'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	3	4	32 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'13 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	3	5	19 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'14 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'15 CHURCH STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	3	4	42 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	2	5	31 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	1	5	30 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'15 JOSEPHSON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	2	2	34 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	1	2	34 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'18 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'18 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	4	5	21 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'20-22 LEINSTER STREET'	PoW	2	0	25 dB(A)	A	Complies
'20-22 LEINSTER STREET'	PoW	1	0	22 dB(A)	A	Complies
'19 CENTENNIAL LANE'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'19 CENTENNIAL LANE'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	29 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'21 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'20 SELWYN STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'21 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	3	5	17 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'23 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	3	5	24 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	2	5	27 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'24 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'24 GORDON STREET'	C	4	0	32 dB(A)	A	Complies
'24 GORDON STREET'	C	3	0	28 dB(A)	A	Complies
'24 GORDON STREET'	C	2	0	25 dB(A)	A	Complies
'24 GORDON STREET'	C	1	0	23 dB(A)	A	Complies
'24 COOK ROAD'	RES	3	5	17 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'24 CHURCH STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'24 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	34 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	34 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'38 WALTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'39 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	8	5	25 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	7	5	25 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	6	5	24 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	5	5	20 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	4	5	20 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	1	4	42 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'39 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'40-42 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	8	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	15 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	15 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	15 dB(A)	A	Complies
'40 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	4	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	19 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	20 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'40 DRIVER AVENUE'	AR	1	0	20 dB(A)	A	Complies
'41 ALBION AVENUE'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	E	2	0	7 dB(A)	A	Complies
'40 DRIVER AVENUE'	E	1	0	6 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	11	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	10	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	9	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	8	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	2	0	41 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	1	0	40 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	22 dB(A)	A	Complies
'40 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	C	1	0	42 dB(A)	A	Complies
'40 SELWYN STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	1	4	42 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'43 REGENT STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'42 LEINSTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'42 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'42 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'43 GREENS ROAD'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'44 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	3	5	14 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	E	11	0	43 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	10	0	43 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	9	0	43 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	8	0	43 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	7	0	43 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'44 DRIVER AVENUE'	E	6	0	43 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	5	0	43 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	4	0	42 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	3	0	38 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	2	0	38 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	1	0	36 dB(A)	A	Complies
'44 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	C	5	0	42 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	4	0	27 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	3	0	26 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	2	0	26 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	1	0	26 dB(A)	A	Complies
'46 GORDON STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'46 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'44 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'47 ALBION AVENUE'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'46 WALTER STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'46 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	4	4	41 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	2	4	44 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	1	4	43 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'3 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'4 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'4 FURBER ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	3	4	39 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'5 STEWART PLACE'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	4	4	38 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'5 FURBER ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	32 dB(A)	A	Complies (Bgn + 5)
'5 RENNY STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'6 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	31 dB(A)	A	Complies (Bgn + 5)
'6 CHAPMAN STREET'	C	3	0	30 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	2	0	28 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	1	0	25 dB(A)	A	Complies
'6 CHURCH STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'6 FURBER ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	3	4	39 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'7 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'8 FURBER ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'8 ALEXANDER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'9 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'8 IRIS STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'8 WALTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'8 SEYMOUR PLACE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'9 FURBER ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'10-14 CHURCH STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'10 IRIS STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	3	5	26 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'10 LANG ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'10 WALTER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	3	4	32 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'11 FURBER ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	3	4	39 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	29 dB(A)	A	Complies (Bgn + 5)
'12 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	8	5	25 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	7	5	19 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	6	5	15 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	5	5	13 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	4	5	12 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'49-51 COOK ROAD'	RES	3	5	26 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'48 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	4	4	26 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'56 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'57 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	3	5	29 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	2	5	27 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	3	5	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'59 MOORE PARK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	31 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	3	5	30 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	2	5	30 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	1	5	29 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'61 MOORE PARK ROAD'	CC	1	0	17 dB(A)	A	Complies
'62 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'62 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'61 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'63 MOORE PARK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'66 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'67 REGENT STREET'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	8	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	7	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	6	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	5	5	11 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	4	5	11 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	3	5	14 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'68 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'70 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'68 LANG ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'69-73 MOORE PARK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	2	4	42 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'70 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'72 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'74 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	18 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	40 dB(A)	A	Complies
'74 LANG ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	43 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	1	0	42 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'83 STEWART STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'81 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'81 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	43 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	40 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	41 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	40 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	35 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	2	0	44 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	41 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	43 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	32 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'33 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	3	4	36 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'30 WALTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	2	2	35 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	1	2	35 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'31 RENNY STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'31 SELWYN STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	3	5	15 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	4	4	25 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	3	3	24 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	3	2	34 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	2	2	34 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	1	2	34 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'33 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	4	4	11 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'33 SELWYN STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'35 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'34 LANG ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	3	3	23 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'34 MOORE PARK ROAD'	C	1	0	37 dB(A)	A	Complies
'35 MOORE PARK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'37 BENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	3	3	23 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'37 GORDON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'37 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	25 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	2	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	25 dB(A)	A	Complies
'38 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'38 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	45 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	45 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	45 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	45 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	45 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	41 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	27 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	27 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	27 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	34 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	27 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	37 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	47 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	43 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	16 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	1	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	47 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	47 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	47 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	47 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	47 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	23 dB(A)	A	Complies
'38 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	28 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	28 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	28 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	27 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	22 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	AR	1	0	30 dB(A)	A	Complies
'38 LEINSTER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	37 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	35 dB(A)	A	Complies
'38 SELWYN STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'38 SELWYN STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	3	5	25 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'38 LANG ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	32 dB(A)	A	Complies
'77-83 COOK ROAD'	RES	7	5	14 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	6	5	12 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	5	5	11 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	4	5	11 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	1	0	35 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	6	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	5	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	18 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'78 GORDON STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'78 GORDON STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'76 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	33 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	3	0	32 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	20 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	18 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	13 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	3	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	18 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	18 dB(A)	A	Complies
'133-139 COOK ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	2	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	10 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	10 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	2	2	21 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	2	2	15 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	1	2	14 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'133-139 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'132 FLINDERS STREET'	RES	1	2	18 dB(A)	A	Complies (Bgn + 5)
'128 FLINDERS STREET'	RES	1	2	18 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	3	2	19 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	2	2	18 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	1	2	17 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	4	5	8 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	1	2	19 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	4	2	12 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	3	2	12 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	2	2	12 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	2	2	17 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	2	2	19 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	1	2	18 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	5	2	13 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	4	2	12 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	3	2	12 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	2	2	13 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	1	2	13 dB(A)	A	Complies (Bgn + 5)
'153-155 COOK ROAD'	CC	3	0	8 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	2	0	13 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	1	0	13 dB(A)	A	Complies
'156 FLINDERS STREET'	RES	2	2	18 dB(A)	A	Complies (Bgn + 5)
'156 FLINDERS STREET'	RES	1	2	17 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'162 FLINDERS STREET'	RES	5	2	32 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	4	2	33 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	3	2	33 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	2	2	33 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	1	2	33 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	4	0	49 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	46 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	46 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	43 dB(A)	A	Complies
'159 COOK ROAD'	CC	1	0	11 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	29 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	28 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	28 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	48 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	47 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	47 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	28 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	28 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	28 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	43 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	28 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	27 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	27 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	30 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	29 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	29 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	5	0	50 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	49 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	42 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'228 MOORE PARK ROAD'	C	4	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	43 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	43 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	29 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	28 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	28 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	43 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	43 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	43 dB(A)	A	Complies
'234 MOORE PARK ROAD'	RES	3	3	53 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	2	3	50 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	3	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	43 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	51 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	48 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'236 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'247 OXFORD STREET'	TH	5	0	30 dB(A)	A	Complies
'247 OXFORD STREET'	TH	4	0	29 dB(A)	A	Complies
'247 OXFORD STREET'	TH	3	0	27 dB(A)	A	Complies
'247 OXFORD STREET'	TH	2	0	27 dB(A)	A	Complies
'247 OXFORD STREET'	TH	1	0	27 dB(A)	A	Complies
'230 MOORE PARK ROAD'	C	1	0	46 dB(A)	A	Complies
'252 MOORE PARK ROAD'	RES	3	3	52 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	2	3	51 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	1	3	47 dB(A)	A	Complies (Bgn + 5)
'230 MOORE PARK ROAD'	C	1	0	35 dB(A)	A	Complies
'255 OXFORD STREET'	RES	4	4	37 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'255 OXFORD STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	3	3	52 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'250 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'251-255 OXFORD STREET'	PR	2	0	23 dB(A)	A	Complies
'251-255 OXFORD STREET'	PR	1	0	21 dB(A)	A	Complies
'257 OXFORD STREET'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	3	3	51 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	51 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	3	3	52 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	2	3	51 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	1	3	47 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	3	3	51 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	50 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'267 OXFORD STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'284 MOORE PARK ROAD'	RES	1	3	47 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	34 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	34 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	3	4	40 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	3	4	40 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	4	4	36 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	3	4	32 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'27 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'27 GORDON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	42 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	43 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'28 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'29 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'28 RENNY STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'28 MOORE PARK ROAD'	RES	1	2	26 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'30-38 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	4	5	18 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	17 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	4	4	39 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	3	5	24 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'50 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'51 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	3	4	40 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	3	5	25 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'52 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	8	5	20 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	7	5	14 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	6	5	12 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	5	5	11 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	4	5	11 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'54 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	3	5	26 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	3	5	26 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'55 MOORE PARK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'54 LEINSTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'54 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'56 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	4	4	34 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'56 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'56 RENNY STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	7	5	12 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	6	5	11 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	5	5	11 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	4	5	11 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'280 MOORE PARK ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	3	3	48 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	48 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	2	3	48 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	48 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	3	3	48 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	2	3	48 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	43 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	3	3	51 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	50 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'345-347 OXFORD STREET'	C	3	0	22 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	1	0	20 dB(A)	A	Complies
'358 MOORE PARK ROAD'	RES	3	3	33 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'354 SOUTH DOWLING STREET'	RES	1	2	10 dB(A)	A	Complies (Bgn + 5)
'360 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'349-351 OXFORD STREET'	C	3	0	19 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	2	0	17 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	1	0	17 dB(A)	A	Complies
'360 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	5	4	30 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	4	4	27 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	2	2	12 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'356 SOUTH DOWLING STREET'	RES	1	2	14 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	3	2	24 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	2	2	23 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	1	2	22 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	3	2	17 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	2	2	15 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	1	2	13 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	4	2	21 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	3	2	15 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	2	2	18 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'360 SOUTH DOWLING STREET'	RES	1	2	13 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	3	2	18 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	2	2	18 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	3	2	23 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	2	2	22 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	3	2	22 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	1	2	18 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	1	2	19 dB(A)	A	Complies (Bgn + 5)
'384 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'388 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'387-389 OXFORD STREET'	C	3	0	21 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	1	0	20 dB(A)	A	Complies
'386 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'385 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'390 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	2	3	19 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	19 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	E	1	0	10 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	11 dB(A)	A	Complies
'410 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	1	0	9 dB(A)	A	Complies
'398 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	2	0	8 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	10 dB(A)	A	Complies
'414 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'416 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	3	3	23 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	3	3	18 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	2	3	17 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	1	3	17 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	3	3	19 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'420 MOORE PARK ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	3	3	16 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	2	3	16 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	16 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	15 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	3	3	20 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	2	3	19 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'421 OXFORD STREET'	E	3	0	12 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	9 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	7 dB(A)	A	Complies
'421 OXFORD STREET'	E	3	0	14 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	12 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	11 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	5	0	22 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	4	0	16 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	3	0	14 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	10 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	8 dB(A)	A	Complies
'428 MOORE PARK ROAD'	RES	3	3	15 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	1	3	14 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	3	3	14 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	3	0	13 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	10 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	9 dB(A)	A	Complies
'436 MOORE PARK ROAD'	RES	3	3	14 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	4	2	19 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	3	2	17 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	2	2	16 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	1	2	14 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'432 MOORE PARK ROAD'	RES	3	3	14 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	3	3	21 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	3	3	15 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	7	2	29 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	6	2	28 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	5	2	20 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	4	2	13 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	3	2	11 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	2	2	11 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	2	0	16 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	15 dB(A)	A	Complies
'473 SOUTH DOWLING STREET'	RES	2	2	19 dB(A)	A	Complies (Bgn + 5)
'473 SOUTH DOWLING STREET'	RES	1	2	17 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	3	1	30 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	2	1	28 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	1	1	26 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	3	1	30 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	2	1	28 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	1	1	26 dB(A)	A	Complies (Bgn + 5)
'495 CLEVELAND STREET'	C	3	0	28 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	2	0	28 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	1	0	28 dB(A)	A	Complies
'477 SOUTH DOWLING STREET'	RES	4	2	16 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	3	2	15 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	2	2	13 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	5	1	29 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	4	1	30 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	3	1	30 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'479 SOUTH DOWLING STREET'	RES	5	2	17 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	4	2	16 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	3	2	15 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	2	2	14 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	1	2	13 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	3	1	30 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	2	1	28 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	1	1	26 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	2	2	14 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	3	1	21 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	1	1	20 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	3	1	30 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	1	1	20 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'83 LEINSTER STREET'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	8	5	12 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	7	5	12 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	6	5	12 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	5	5	12 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	4	5	12 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	3	3	26 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	1	3	17 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'83 STEWART STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	5	3	32 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	4	3	31 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	3	3	19 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'84 GORDON STREET'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	3	3	27 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'84 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'87 PHELPS STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'88 REGENT STREET'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'97 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	7	5	23 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	6	5	22 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	5	5	18 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	4	5	17 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	4	0	17 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	3	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'104 LANG ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	5	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	10 dB(A)	A	Complies
'114 LANG ROAD'	C	3	0	10 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	10 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'107-111 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'112 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'108 LANG ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'110 LANG ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	14 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	8 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	8 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	12 dB(A)	A	Complies
'121-125 COOK ROAD'	RES	8	5	11 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	7	5	8 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	6	5	8 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	5	5	8 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	4	5	9 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	3	5	9 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	11 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'114 LANG ROAD'	C	1	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	7 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	18 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	19 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	20 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	18 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	18 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	3	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'119 LEINSTER STREET'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'119 LEINSTER STREET'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	1	1	20 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	2	1	28 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	1	1	20 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	15 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	10 dB(A)	A	Complies
'569 SOUTH DOWLING STREET'	RES	2	1	20 dB(A)	A	Complies (Bgn + 5)
'569 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'561 SOUTH DOWLING STREET'	RES	1	1	20 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	2	1	20 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	3 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	2 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	1 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	24 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	24 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	12 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	10 dB(A)	A	Complies
'575 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'575 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	1	0	18 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	22 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	18 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	14 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	21 dB(A)	A	Complies

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'560 CLEVELAND STREET'	E	3	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	22 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	22 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	23 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	23 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	23 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	23 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	21 dB(A)	A	Complies
'577 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'577 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	3	1	19 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	3	1	29 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	3	1	29 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	1	1	26 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	3	1	29 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	28 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	3	1	29 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	3	1	28 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	2	1	28 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'641 SOUTH DOWLING STREET'	RES	3	1	28 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	4	1	28 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	28 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	28 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'653 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	2	1	28 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	28 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	28 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)
'681 SOUTH DOWLING STREET'	C	2	0	28 dB(A)	A	Complies
'681 SOUTH DOWLING STREET'	C	1	0	27 dB(A)	A	Complies
'691 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'715 SOUTH DOWLING STREET'	RES	3	1	20 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	4	1	22 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	3	1	20 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	2	1	20 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	1	1	18 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'717 SOUTH DOWLING STREET'	RES	1	1	18 dB(A)	A	Complies (Bgn + 5)
'721 SOUTH DOWLING STREET'	RES	1	1	18 dB(A)	A	Complies (Bgn + 5)
'Site Office'	C	1	0	37 dB(A)	A	Complies
'Site Office'	C	1	0	37 dB(A)	A	Complies
'294 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	3	3	47 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	3	3	47 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	1	3	43 dB(A)	A	Complies (Bgn + 5)
'308 MOORE PARK ROAD'	C	5	0	46 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	4	0	46 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	3	0	46 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	2	0	46 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	1	0	44 dB(A)	A	Complies
'302 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	43 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'318 MOORE PARK ROAD'	RES	3	3	45 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	2	3	44 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	3	3	47 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	1	3	43 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	2	3	45 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	2	3	44 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	2	3	43 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	2	3	45 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	2	3	44 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	2	3	43 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	2	3	43 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'336 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	3	3	34 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	3	3	34 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	6	4	34 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	5	4	28 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	4	4	26 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'342 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)

Receiver					Evening	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'340 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'338 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	3	3	34 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	3	3	34 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)

Level 3, 65 Pirrama Road
Pyrmont NSW, 2009

Report No.:
Date: 24 June 2022
Created by:
Checked by:

SFS Redev - Cleared site - OOHW- Building

Section 1 - Introduction

This construction noise assessment has been prepared for **SFS Redev - Cleared site** in accordance with the relevant environmental assessment requirements, outlined in Appendix A.

Figure 1-1: Site and receiver map

Section 2 - Works description

This assessment report relates to the proposed works summarised in Table 2-1.

Table 2-1: Proposed works

Name	Work dates	Relevant assessment periods	Construction Plant, Quantity and Duration*
Facade Cleaning		• Night	• A Lifting Platform x 1 , 100% • B Pressure Washer x 1 , 50%
Paving		• Night	• A Petrol Concrete Trowel x 1 , 100% • B Petrol Concrete Trowel x 1 , 100%
Facade install - no hand tools		• Night	• A Mobile Telescopic Crane (Idling) x 1 , 100% • B Lifting Platform x 1 , 50%
Misc Facade Install		• Night	• A Wheeled Mobile Crane x 1 , 100% • B Lifting Platform x 1 , 50% • C Wheeled Mobile Crane x 1 , 100% • D Lifting Platform x 1 , 100% • E Hydratorque x 1 , 100%
Roof finishes		• Night	• A Lifting Platform x 1 , 100%
Pitch works		• Night	• A Truck and Dog x 1 , 100% • B Tracked Excavator x 1 , 100%

Notes: * Duration % is the percentage that the plant is used in the measurement assessment time period.

Section 3 - Assessment methodology

Airborne noise predictions have been carried out using SoundPLAN implementing ISO 9613-2:1996 Acoustics - Attenuation of sound during propagation outdoors - Part 2: General method of calculation (ISO 9613-2). All sources are nominally located 2 m above the local ground level. The noise model includes the ground topography, ground and air absorption, receptor buildings and intervening structures.

Assessment has been carried out using Arup SNAPshot interface, which provides instantaneous assessment of proposed work Activities. This has ensured works contributing to exceedance of target levels are understood, and all endeavours made to reduce impacts where practicable. Where target noise levels are predicted to be exceeded options for alternative construction methodologies and / or mitigation have also been considered. This report presents the outcomes of the assessment, reflecting the final plant selection and any relevant mitigation and management measures.

Section 4 - Management matrix

Based on the project criteria, the following management matrix has been established, which has been referred to in the subsequent assessment tables in Section 5. Baseline noise levels and fixed criteria (for the relevant receiver types) are outlined in Table 4-2.

Table 4-1 Management Matrix

Name	Category	Description
Non residential: All periods	A	Complies
	B	Exceeds up to 5 dB
	C	Exceeds up to 10 dB
	D	Exceeds up to 15 dB
	E	Exceeds more than 15 dB
Residential: Standard hours	A	Complies (Bgn + 10)
	B	Exceeds up to 5 dB
	C	Exceeds up to 10 dB
	D	Exceeds up to 15 dB
	E	Exceeds > 15 dB or 75 dB(A)
Residential: Outside Standard Hours	A	Complies (Bgn + 5)
	B	Exceeds up to 5 dB
	C	Exceeds up to 10 dB
	D	Exceeds up to 15 dB
	E	Exceeds > 15 dB or 70 dB(A)

Note:

Standard Hours
Monday to Friday: 7 am - 6 pm, Saturday: 8 am - 1 pm

RBL + 10dB

Day Outside Standard Hours
Saturday: 7pm - 8am, 1pm-6pm. Sunday: 8am-6pm

RBL + 5dB

Evening
Monday - Saturday: 6pm -10pm

RBL + 5dB

Night
Monday - Saturday: 10pm - 7 am

RBL + 5dB

Table 4-2 Baseline levels and fixed criteria

Receiver Type	ID	Noice Catchment Area (NCA)	Period	Fixed Criteria (dB Leq)	Ambient (dB Leq)	Background (dB L90)
Town Hall	TH	No NCA	Night	45	-	-
Town Hall	TH	No NCA	Evening	45	-	-
Town Hall	TH	No NCA	Day Outside Standard Hours	45	-	-
Town Hall	TH	No NCA	Standard Hours	45	-	-
Residential	RES	NCA 6	Night	-	49	45
Residential	RES	NCA 6	Evening	-	57	47
Residential	RES	NCA 6	Day Outside Standard Hours	-	57	47
Residential	RES	NCA 6	Standard Hours	-	57	47
Residential	RES	NCA 5	Night	-	43	35

Receiver Type	ID	Noice Catchment Area (NCA)	Period	Fixed Criteria (dB Leq)	Ambient (dB Leq)	Background (dB L90)
Residential	RES	NCA 5	Evening	-	56	36
Residential	RES	NCA 5	Day Outside Standard Hours	-	60	39
Residential	RES	NCA 5	Standard Hours	-	60	39
Residential	RES	NCA 4	Night	-	46	41
Residential	RES	NCA 4	Evening	-	55	41
Residential	RES	NCA 4	Day Outside Standard Hours	-	57	43
Residential	RES	NCA 4	Standard Hours	-	57	43
Residential	RES	NCA 3	Night	-	64	49
Residential	RES	NCA 3	Evening	-	66	49
Residential	RES	NCA 3	Day Outside Standard Hours	-	68	52
Residential	RES	NCA 3	Standard Hours	-	68	52
Residential	RES	NCA 2	Night	-	62	51
Residential	RES	NCA 2	Evening	-	65	52
Residential	RES	NCA 2	Day Outside Standard Hours	-	67	56
Residential	RES	NCA 2	Standard Hours	-	67	56
Residential	RES	NCA 1	Night	-	67	55
Residential	RES	NCA 1	Evening	-	68	56
Residential	RES	NCA 1	Day Outside Standard Hours	-	69	58
Residential	RES	NCA 1	Standard Hours	-	69	58
Place of worship	PoW	No NCA	Night	45	-	-
Place of worship	PoW	No NCA	Evening	45	-	-
Place of worship	PoW	No NCA	Day Outside Standard Hours	45	-	-
Place of worship	PoW	No NCA	Standard Hours	45	-	-
Passive Recreation	PR	No NCA	Night	60	-	-
Passive Recreation	PR	No NCA	Evening	60	-	-
Passive Recreation	PR	No NCA	Day Outside Standard Hours	60	-	-
Passive Recreation	PR	No NCA	Standard Hours	60	-	-
Educational	E	No NCA	Night	45	-	-
Educational	E	No NCA	Evening	45	-	-
Educational	E	No NCA	Day Outside Standard Hours	45	-	-
Educational	E	No NCA	Standard Hours	45	-	-

Receiver Type	ID	Noice Catchment Area (NCA)	Period	Fixed Criteria (dB Leq)	Ambient (dB Leq)	Background (dB L90)
Commercial	C	No NCA	Night	70	-	-
Commercial	C	No NCA	Evening	70	-	-
Commercial	C	No NCA	Day Outside Standard Hours	70	-	-
Commercial	C	No NCA	Standard Hours	70	-	-
Child Care	CC	No NCA	Night	70	-	-
Child Care	CC	No NCA	Evening	70	-	-
Child Care	CC	No NCA	Day Outside Standard Hours	70	-	-
Child Care	CC	No NCA	Standard Hours	70	-	-
Active Recreation	AR	No NCA	Night	65	-	-
Active Recreation	AR	No NCA	Evening	65	-	-
Active Recreation	AR	No NCA	Day Outside Standard Hours	65	-	-
Active Recreation	AR	No NCA	Standard Hours	65	-	-

Section 5 - Modelling, mitigation and management outcomes

The following summarises the assessed equipment details and summary of the assessment outcomes. More detail regarding predicted noise levels at each receiver is included in *Appendix A*.

5.1 - Facade Cleaning

The following tables present the relevant equipment sound power levels and assessment summary.

Table 5-1-1: Facade Cleaning - Equipment details

No.	Name	Location	LwA	63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz	Qty	Duration % of 15-min period
A.	Lifting Platform	[-33.88826457, 151.22581979]	95	106	104	90	91	88	87	86	77	1	100
B.	Pressure Washer	[-33.88826266, 151.22569724]	96	90	90	90	85	90	90	90	6	1	50

Table 5-1-2: Facade Cleaning - Assessment summary

Period	Receiver Type	Management level				
		A	B	C	D	E
Night	Town Hall	5	0	0	0	0
	Residential	1584	0	0	0	0
	Place of worship	16	0	0	0	0
	Passive Recreation	2	0	0	0	0
	Educational	46	0	0	0	0
	Commercial	339	0	0	0	0
	Child Care	5	0	0	0	0
	Active Recreation	33	0	0	0	0

The following figure(s) shows the equipment locations on site for each working period.

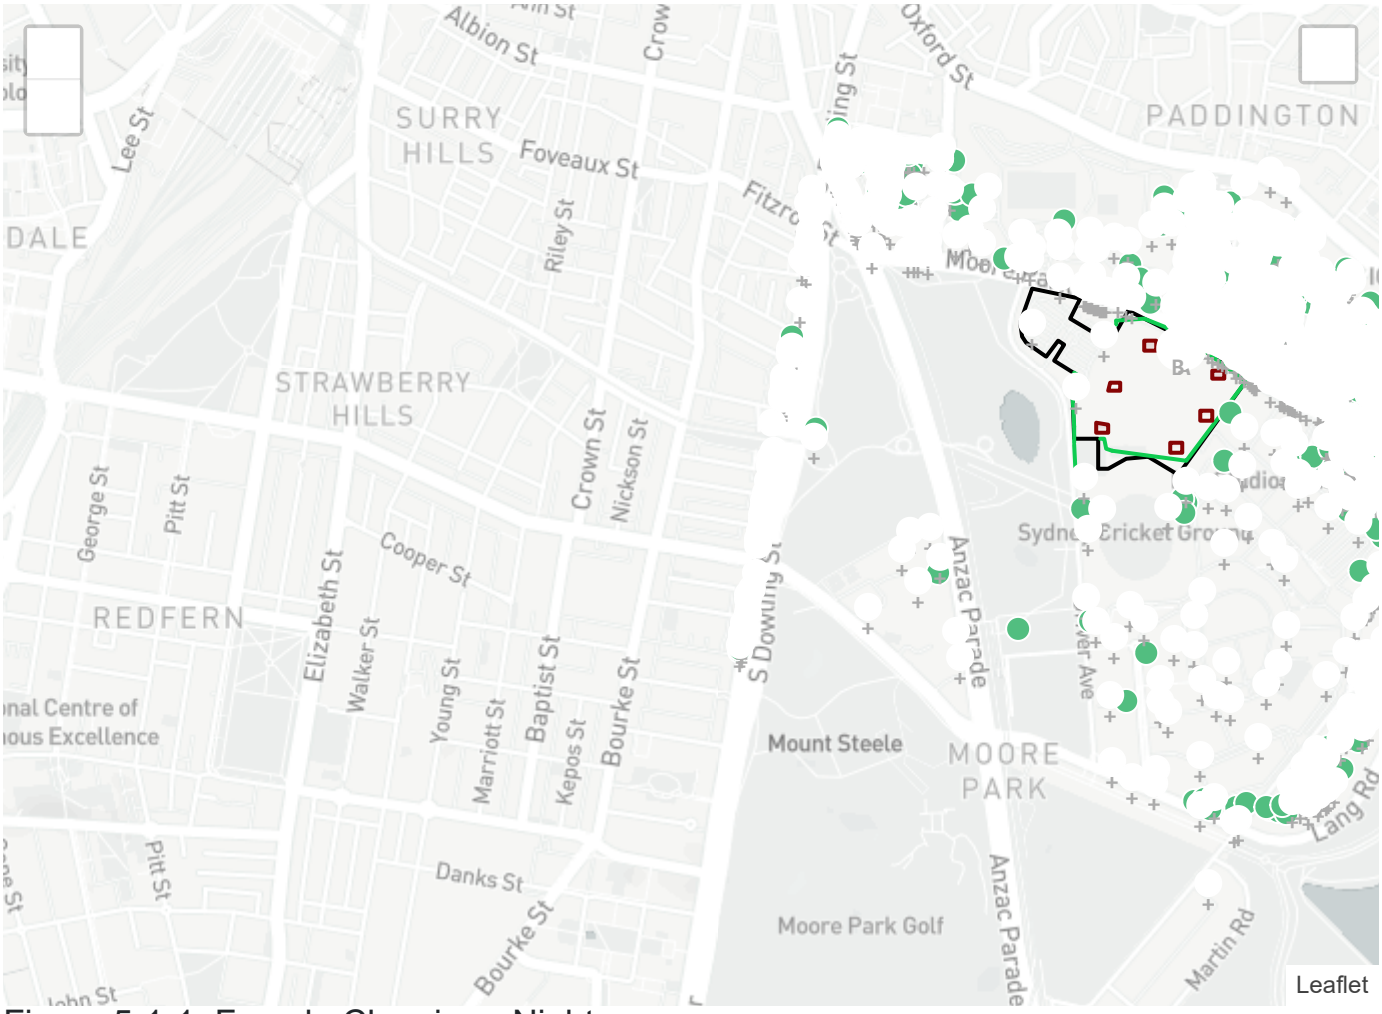

Figure 5-1-1: Facade Cleaning - Night

5.2 - Paving

The following tables present the relevant equipment sound power levels and assessment summary.

Table 5-2-1: Paving - Equipment details

No.	Name	Location	LwA	63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz	Qty	Duration % of 15-min period
A.	Petrol Concrete Trowel	[-33.88825308, 151.22508446]	95	82	85	87	90	90	89	84	76	1	100
B.	Petrol Concrete Trowel	[-33.88987647, 151.22357966]	95	82	85	87	90	90	89	84	76	1	100

Table 5-2-2: Paving - Assessment summary

Period	Receiver Type	Management level				
		A	B	C	D	E
Night	Town Hall	5	0	0	0	0
	Residential	1584	0	0	0	0
	Place of worship	16	0	0	0	0

Period	Receiver Type	Management level				
		A	B	C	D	E
	Passive Recreation	2	0	0	0	0
	Educational	46	0	0	0	0
	Commercial	339	0	0	0	0
	Child Care	5	0	0	0	0
	Active Recreation	33	0	0	0	0

The following figure(s) shows the equipment locations on site for each working period.

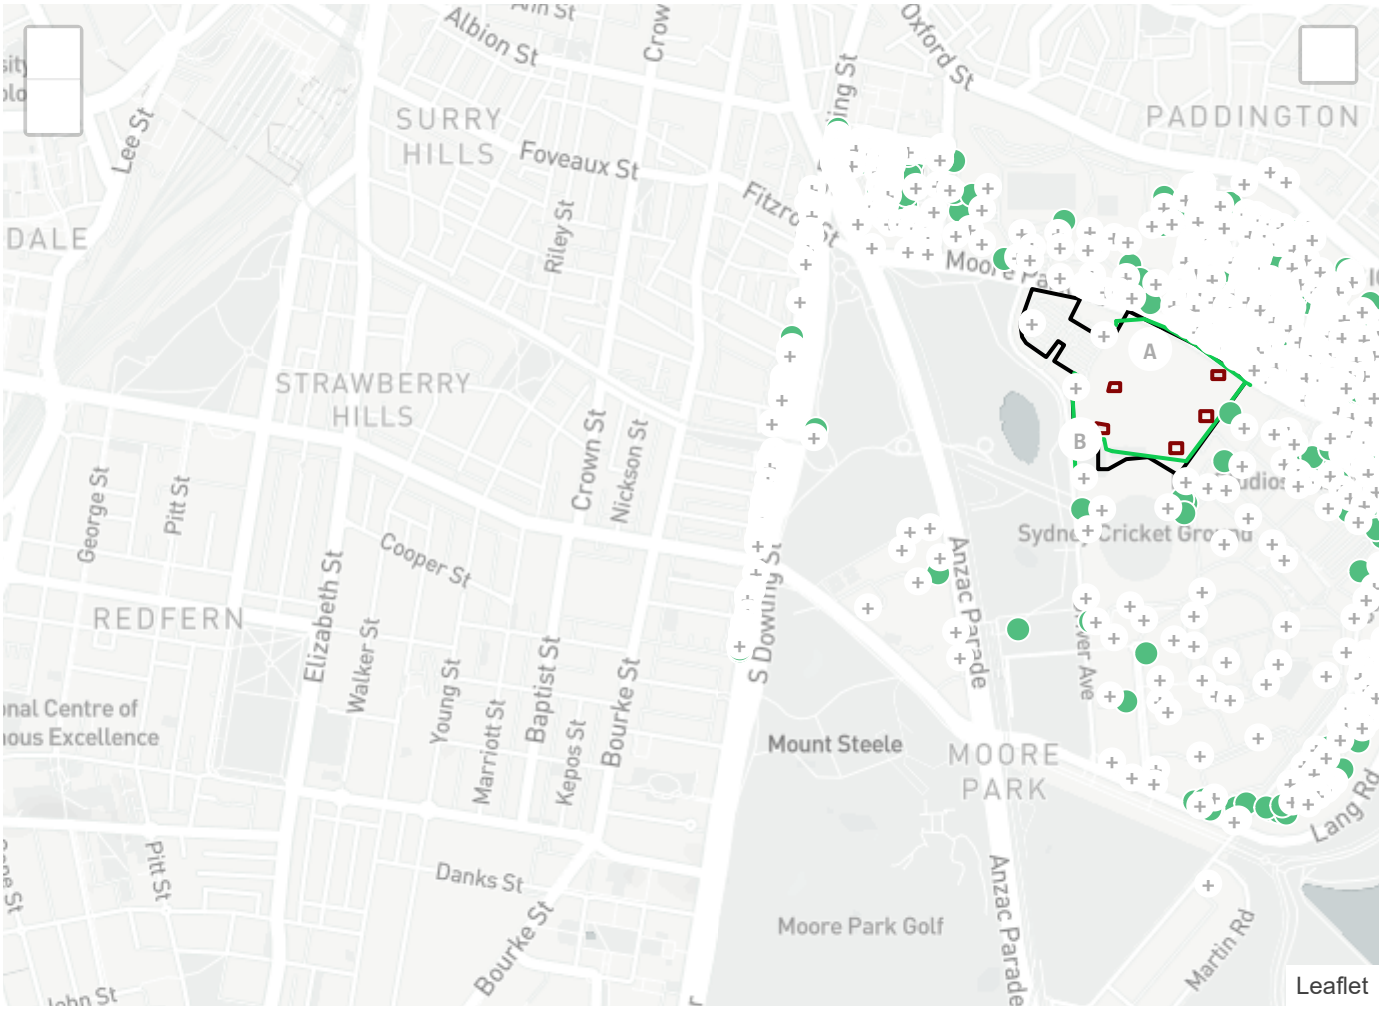

Figure 5-2-1: Paving - Night

5.3 - Facade install - no hand tools

The following tables present the relevant equipment sound power levels and assessment summary.

Table 5-3-1: Facade install - no hand tools - Equipment details

No.	Name	Location	LwA	63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz	Qty	Duration % of 15-min period
A.	Mobile Telescopic Crane (Idling)	[-33.88800672, 151.22508956]	92	99	95	92	89	88	84	78	69	1	100

No.	Name	Location	LwA	63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz	Qty	Duration % of 15-min period
B.	Lifting Platform	[-33.88800672, 151.22508956]	95	106	104	90	91	88	87	86	77	1	50

Table 5-3-2: Facade install - no hand tools - Assessment summary

Period	Receiver Type	Management level				
		A	B	C	D	E
Night	Town Hall	5	0	0	0	0
	Residential	1584	0	0	0	0
	Place of worship	16	0	0	0	0
	Passive Recreation	2	0	0	0	0
	Educational	46	0	0	0	0
	Commercial	339	0	0	0	0
	Child Care	5	0	0	0	0
	Active Recreation	33	0	0	0	0

The following figure(s) shows the equipment locations on site for each working period.

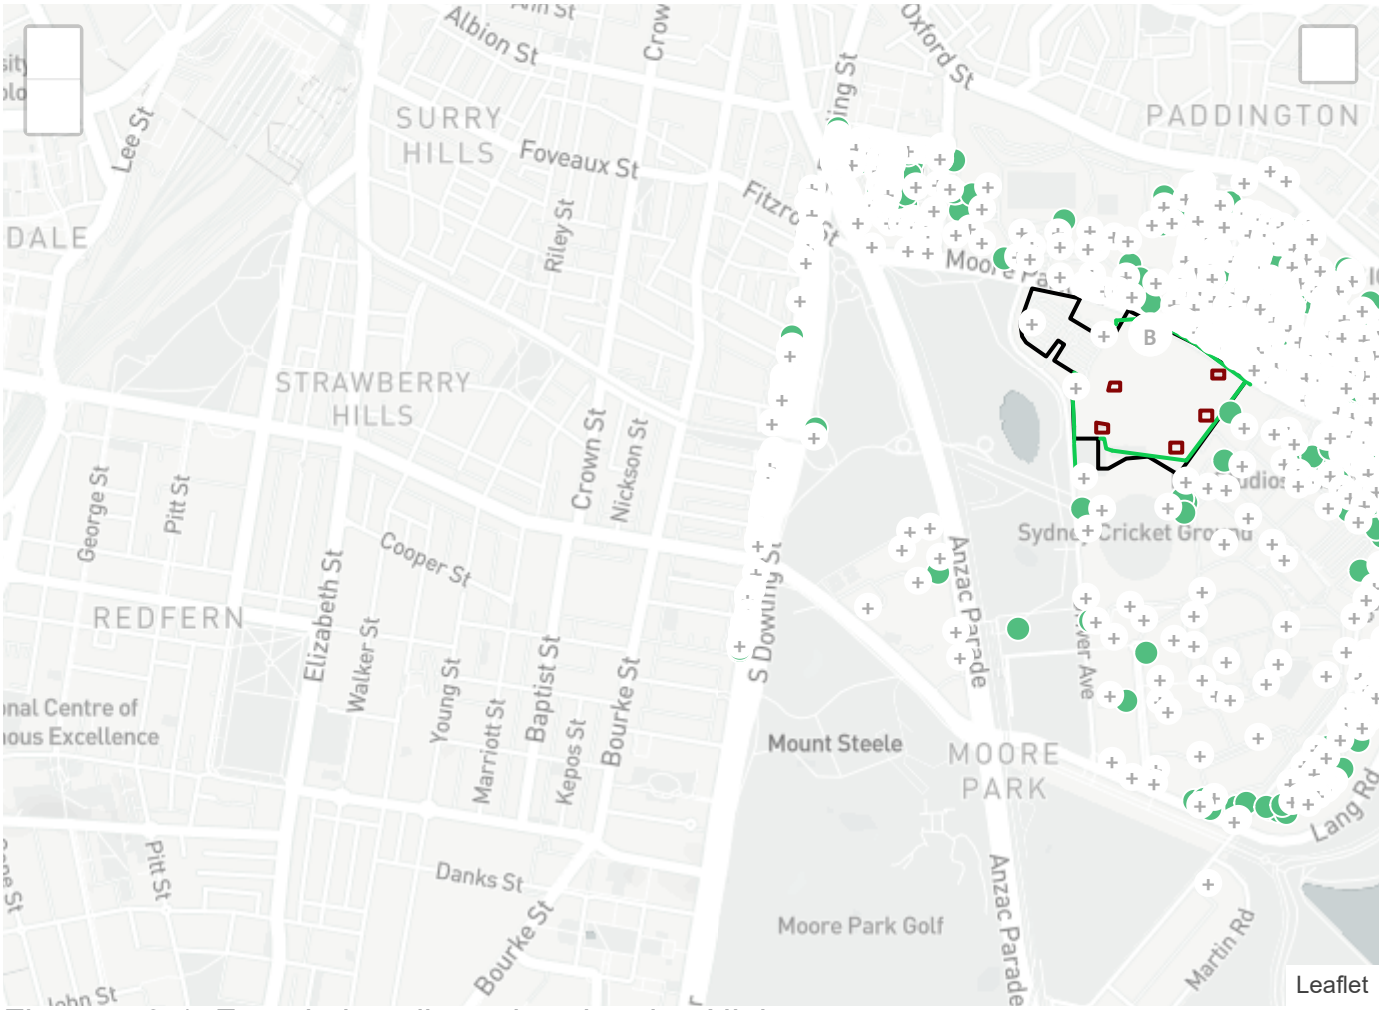

Figure 5-3-1: Facade install - no hand tools - Night

5.4 - Misc Facade Install

The following tables present the relevant equipment sound power levels and assessment summary.

Table 5-4-1: Misc Facade Install - Equipment details

No.	Name	Location	LwA	63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz	Qty	Duration % of 15-min period
A.	Wheeled Mobile Crane	[-33.88807909, 151.22447509]	98	108	100	99	95	93	90	85	77	1	100
B.	Lifting Platform	[-33.88807909, 151.22447509]	95	106	104	90	91	88	87	86	77	1	50
C.	Wheeled Mobile Crane	[-33.88979575, 151.22370393]	98	108	104	99	91	92	91	84	78	1	100
D.	Lifting Platform	[-33.88987805, 151.22370223]	95	106	104	90	91	88	87	86	77	1	100
E.	Hydratorque	[-33.88807909, 151.22447509]	102	105	105	95	94	98	96	90	84	1	100

Table 5-4-2: Misc Facade Install - Assessment summary

Period	Receiver Type	Management level				
		A	B	C	D	E
Night	Town Hall	5	0	0	0	0
	Residential	1584	0	0	0	0
	Place of worship	16	0	0	0	0
	Passive Recreation	2	0	0	0	0
	Educational	46	0	0	0	0
	Commercial	339	0	0	0	0
	Child Care	5	0	0	0	0
	Active Recreation	33	0	0	0	0

The following figure(s) shows the equipment locations on site for each working period.

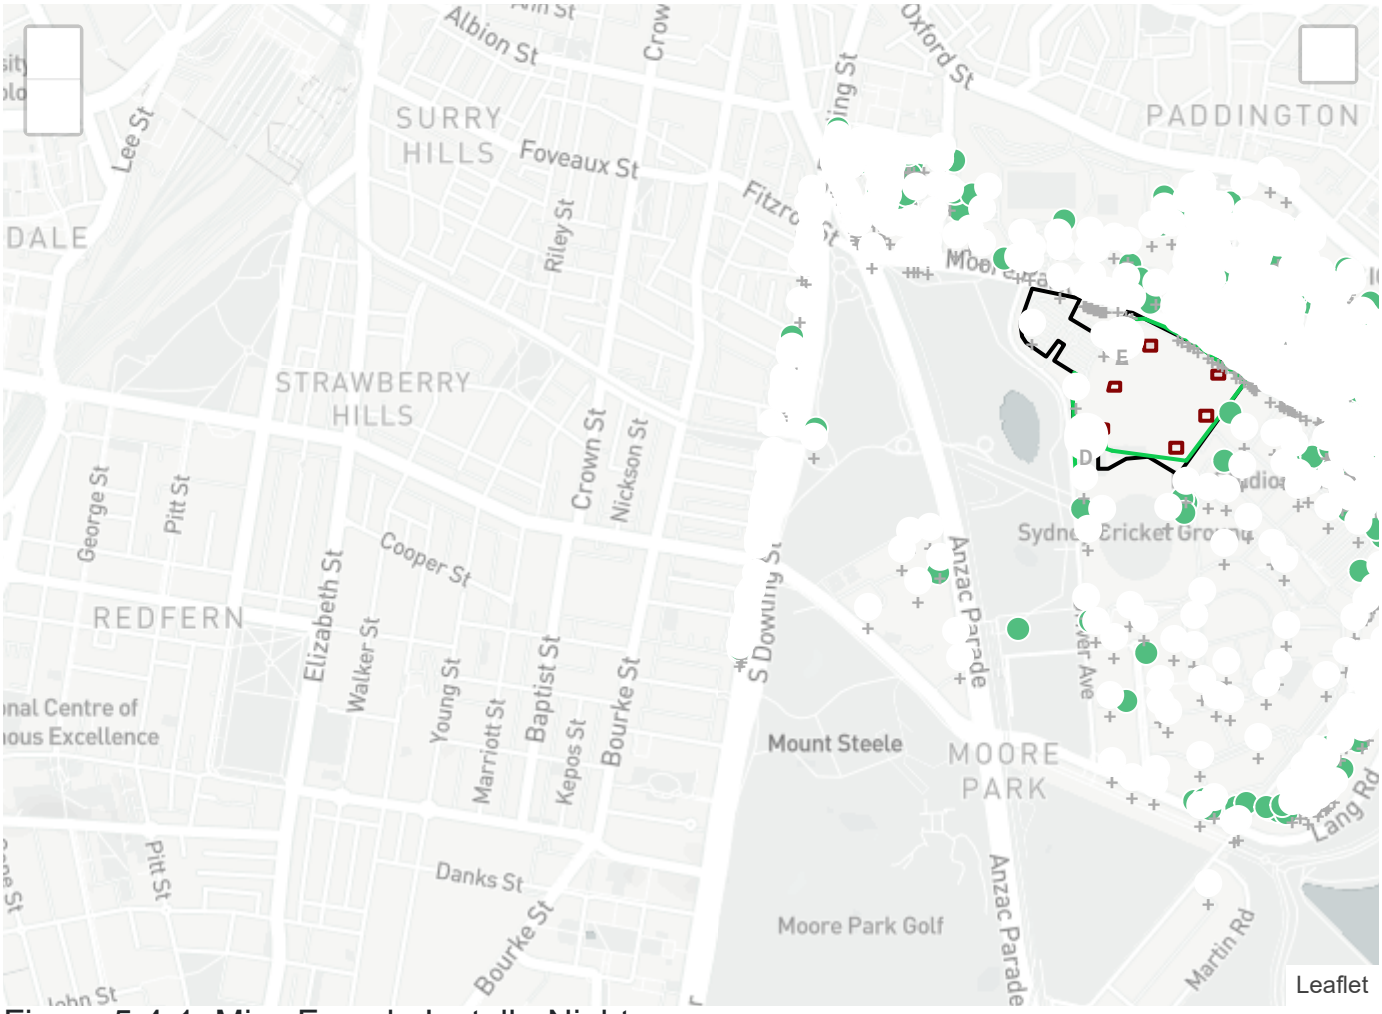

Figure 5-4-1: Misc Facade Install - Night

5.5 - Roof finishes

The following tables present the relevant equipment sound power levels and assessment summary.

Table 5-5-1: Roof finishes - Equipment details

No.	Name	Location	LwA	63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz	Qty	Duration % of 15-min period
A.	Lifting Platform	[-33.88850317, 151.22532447]	95	106	104	90	91	88	87	86	77	1	100

Table 5-5-2: Roof finishes - Assessment summary

Period	Receiver Type	Management level				
		A	B	C	D	E
Night	Town Hall	5	0	0	0	0
	Residential	1584	0	0	0	0
	Place of worship	16	0	0	0	0
	Passive Recreation	2	0	0	0	0
	Educational	46	0	0	0	0
	Commercial	339	0	0	0	0

Period	Receiver Type	Management level				
		A	B	C	D	E
	Child Care	5	0	0	0	0
	Active Recreation	33	0	0	0	0

The following figure(s) shows the equipment locations on site for each working period.

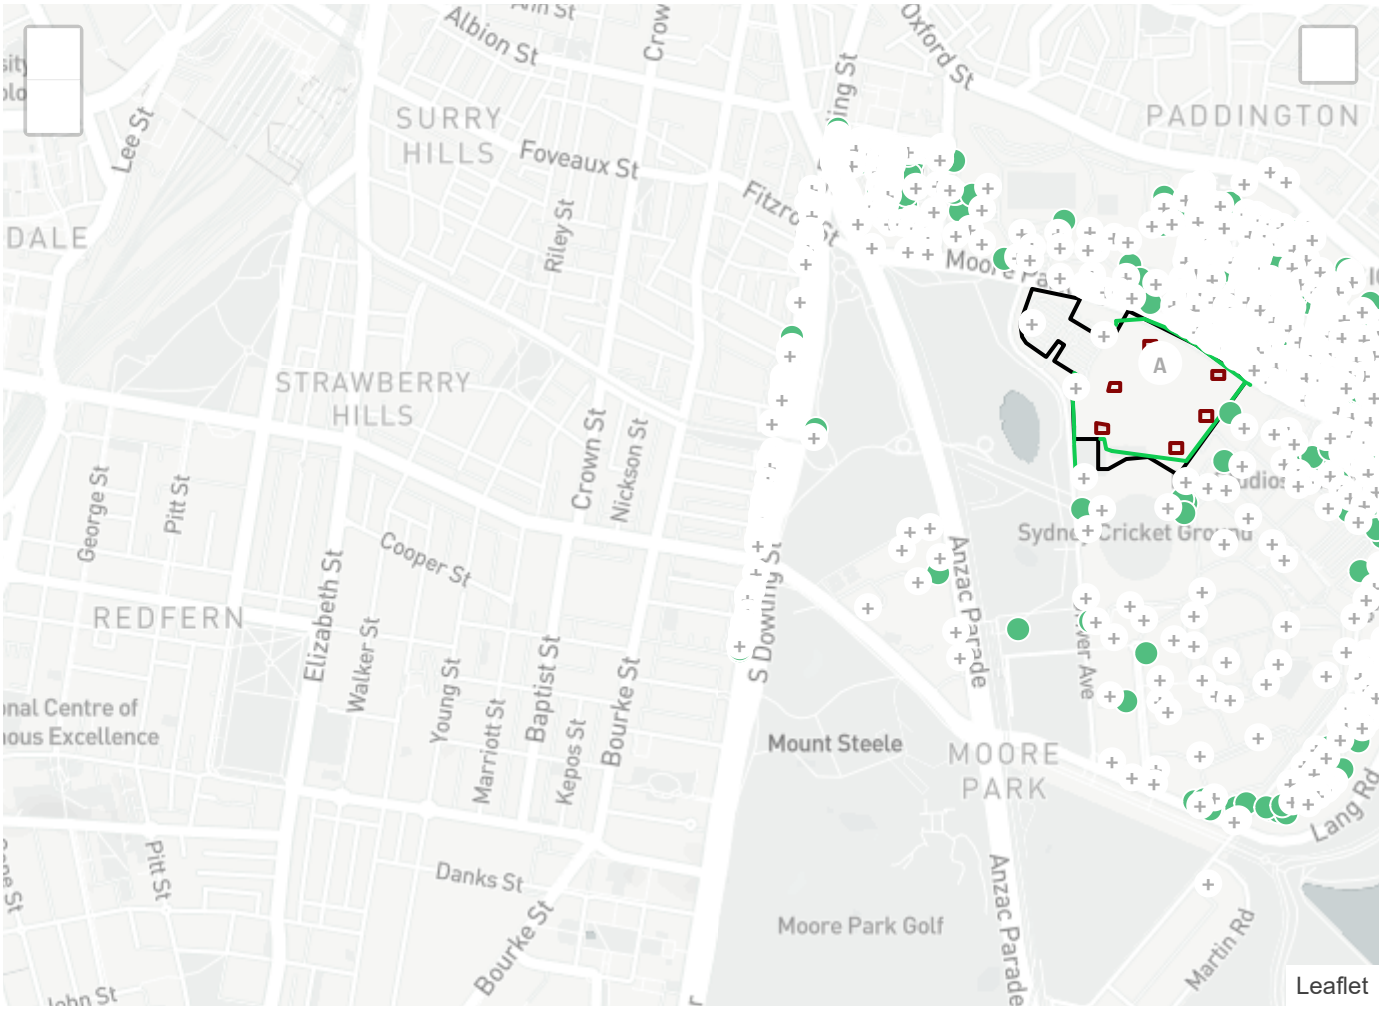

Figure 5-5-1: Roof finishes - Night

5.6 - Pitch works

The following tables present the relevant equipment sound power levels and assessment summary.

Table 5-6-1: Pitch works - Equipment details

No.	Name	Location	LwA	63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz	Qty	Duration % of 15-min period
A.	Truck and Dog	[-33.88874579, 151.22507425]	106	116	109	107	104	10	98	92	88	1	100
B.	Tracked Excavator	[-33.88874579, 151.22507425]	103	102	108	103	101	97	94	88	79	1	100

Table 5-6-2: Pitch works - Assessment summary

Period	Receiver Type	Management level				
		A	B	C	D	E
Night	Town Hall	5	0	0	0	0
	Residential	1584	0	0	0	0
	Place of worship	16	0	0	0	0
	Passive Recreation	2	0	0	0	0
	Educational	46	0	0	0	0
	Commercial	339	0	0	0	0
	Child Care	5	0	0	0	0
	Active Recreation	33	0	0	0	0

The following figure(s) shows the equipment locations on site for each working period.

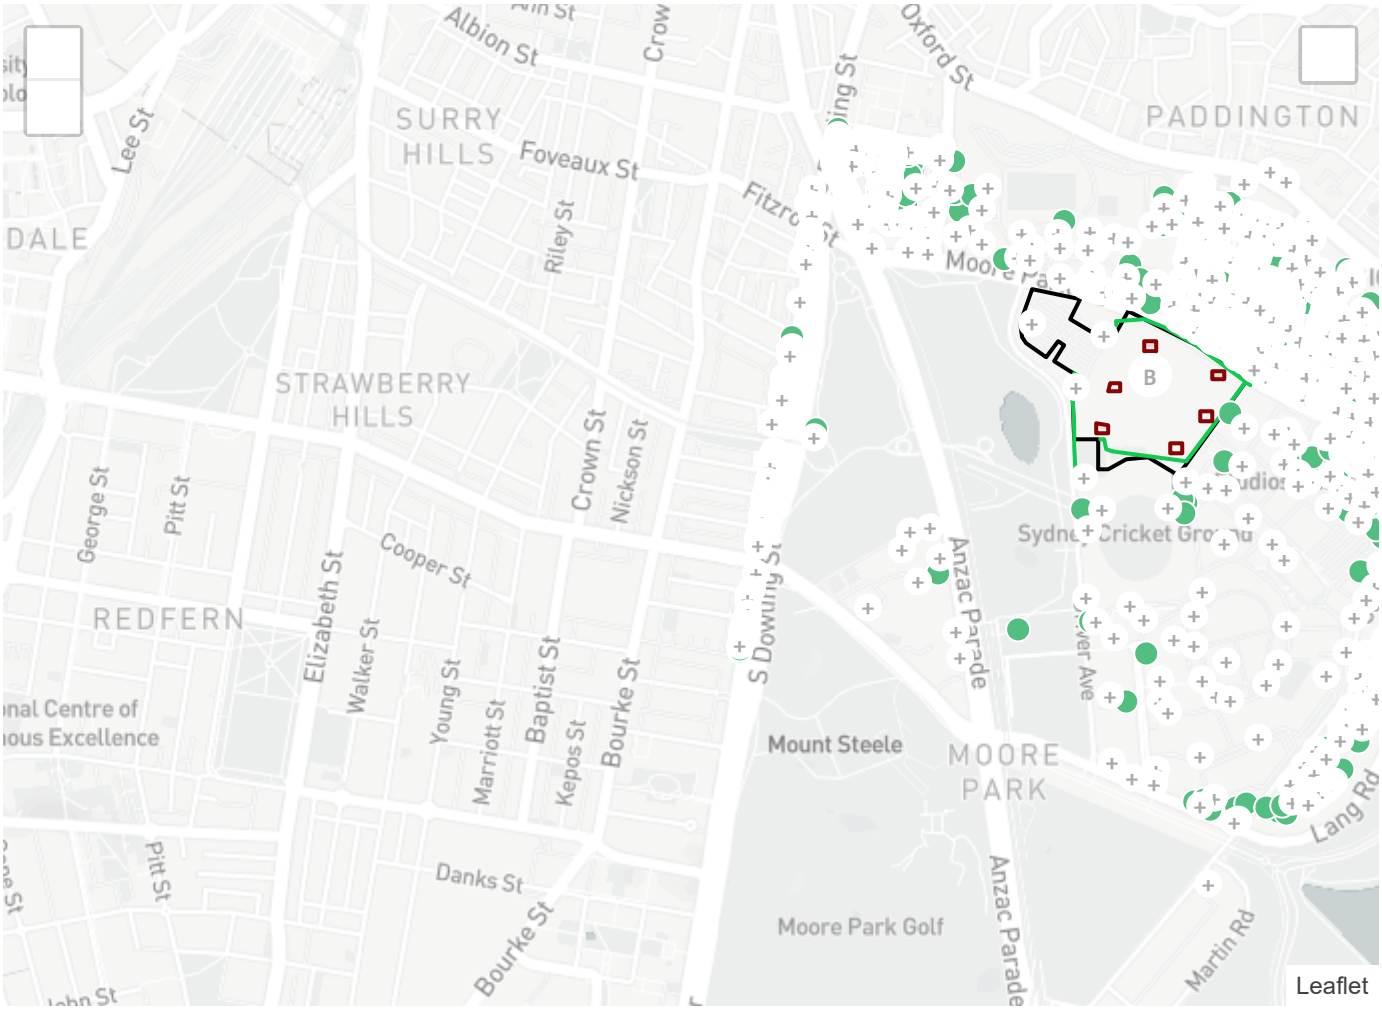

Figure 5-6-1: Pitch works - Night

Appendix A - Assessment details

The following table(s) present the predicted noise levels and corresponding management requirements for receivers that are exceeding noise limit for any working period, for each works scenario.

Table A-1: Facade Cleaning

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1-5 COOK ROAD'	RES	8	5	24 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	7	5	22 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	6	5	21 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	5	5	22 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	4	5	20 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	15 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	14 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	16 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	14 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
' 335203 6248625'	AR	2	0	16 dB(A)	A	Complies
' 335203 6248625'	AR	1	0	15 dB(A)	A	Complies
'2 COOK ROAD'	RES	7	5	25 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	6	5	24 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	5	5	24 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	4	5	22 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	3	5	19 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
' 335206 6248642'	AR	1	0	16 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	7 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	7 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	6 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	1 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	1 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	1 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	5 dB(A)	A	Complies
'1 MARTIN STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1 NEWCOMBE STREET'	C	4	0	15 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	15 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	15 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	15 dB(A)	A	Complies
'1 FURBER ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	8 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	8 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	8 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	8 dB(A)	A	Complies
'1 MITCHELL STREET'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'1 MITCHELL STREET'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	3	3	31 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'2 ANZAC PARADE'	C	1	0	21 dB(A)	A	Complies
'3 LITTLE STEWART STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'3 LITTLE STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'2 FURBER ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'2 IRIS STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'3 CHURCH STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'2 OATLEY ROAD'	C	2	0	19 dB(A)	A	Complies
'2 OATLEY ROAD'	C	1	0	19 dB(A)	A	Complies
'2 MARTIN ROAD'	RES	2	6	4 dB(A)	A	Complies (Bgn + 5)
'2 MARTIN ROAD'	RES	1	6	4 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'3 POATE ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'12 LEINSTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'13 FURBER ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	4	4	23 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'13 POATE ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'14 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'15 CHURCH STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'17 MOORE PARK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	3	4	1 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	2	2	11 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'18 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'19 ALBION AVENUE'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'18 WALTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	3	4	16 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	4	5	24 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'20-22 LEINSTER STREET'	PoW	2	0	10 dB(A)	A	Complies
'20-22 LEINSTER STREET'	PoW	1	0	9 dB(A)	A	Complies
'19 CENTENNIAL LANE'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'19 CENTENNIAL LANE'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'20 FURBER ROAD'	RES	3	5	6 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'20 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'21 WALTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'22 FURBER ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'24 LEINSTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'24 GORDON STREET'	C	4	0	11 dB(A)	A	Complies
'24 GORDON STREET'	C	3	0	11 dB(A)	A	Complies
'24 GORDON STREET'	C	2	0	10 dB(A)	A	Complies
'24 GORDON STREET'	C	1	0	10 dB(A)	A	Complies
'24 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'24 CHURCH STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	1	4	1 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'24 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	11 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'38 WALTER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	8	5	2 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	7	5	2 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	6	5	2 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	5	5	2 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	4	5	2 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'39 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'40-42 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	8	0	5 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	5 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	5 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	5 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	5 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'40 DRIVER AVENUE'	AR	3	0	5 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	5 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	6 dB(A)	A	Complies
'40 COOK ROAD'	RES	3	5	6 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	4	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	13 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	13 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	13 dB(A)	A	Complies
'41 ALBION AVENUE'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	E	2	0	-2 dB(A)	A	Complies
'40 DRIVER AVENUE'	E	1	0	-2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	11	0	28 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	10	0	28 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	9	0	28 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	8	0	27 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	24 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	18 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	17 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	16 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	15 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	2	0	32 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	1	0	30 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	11 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	11 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	12 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	12 dB(A)	A	Complies
'40 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	C	1	0	31 dB(A)	A	Complies
'40 SELWYN STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'41 REGENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	3	5	6 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'42 LEINSTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'42 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'42 SELWYN STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'43 GREENS ROAD'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'44 LEINSTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'44 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	E	11	0	17 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	10	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	9	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	8	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	7	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	6	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	5	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	4	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	3	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	2	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	1	0	12 dB(A)	A	Complies
'44 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	C	5	0	22 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	4	0	22 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	3	0	22 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	2	0	22 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	1	0	14 dB(A)	A	Complies
'46 GORDON STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'46 GORDON STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'44 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'45 GREENS ROAD'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	3	4	10 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'46 WALTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'46 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	4	4	26 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'47 OATLEY ROAD'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'3 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'4 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'4 FURBER ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'5 STEWART PLACE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	4	4	26 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'5 FURBER ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	3	4	1 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'5 RENNY STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'6 CHAPMAN STREET'	C	3	0	20 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	2	0	20 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	1	0	20 dB(A)	A	Complies
'6 CHURCH STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'6 FURBER ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'7 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'8 FURBER ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'8 ALEXANDER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	3	4	6 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'8 IRIS STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'8 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'8 SEYMOUR PLACE'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'9 FURBER ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'10-14 CHURCH STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'10 IRIS STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'10 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'11 FURBER ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'12 FURBER ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'48 STEWART STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	8	5	5 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	7	5	3 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	6	5	2 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	5	5	1 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	4	5	2 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	3	5	2 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	3	4	9 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'48 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	4	4	17 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	3	5	1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'56 SELWYN STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'57 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'58 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	3	5	9 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'61 MOORE PARK ROAD'	CC	1	0	9 dB(A)	A	Complies
'62 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'62 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'61 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'62 LANG ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'63 MOORE PARK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	3	3	19 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'67 REGENT STREET'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	8	5	13 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	7	5	11 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	6	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	5	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	4	5	9 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	3	5	4 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'73 STEWART STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'68 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	3	3	20 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	2	3	19 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'70 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'69-73 MOORE PARK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'70 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'72 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'74 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	10 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	7 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	20 dB(A)	A	Complies
'74 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	18 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	17 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	1	0	15 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	35 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	17 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	12 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	18 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	17 dB(A)	A	Complies
'83 STEWART STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	11 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	12 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	16 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	17 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'81 STEWART STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'81 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	12 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	1	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	32 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	32 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	14 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	18 dB(A)	A	Complies
'33 BENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'30 WALTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	2	2	17 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'31-33 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'31 RENNY STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'31 SELWYN STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	4	4	12 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	2	1	4 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	1	1	3 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	3	3	26 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	3	2	11 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	2	2	11 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'33 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	4	4	13 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'34 LEINSTER STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'33 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'35 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	3	3	26 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'34 MOORE PARK ROAD'	C	1	0	25 dB(A)	A	Complies
'35 MOORE PARK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'37 BENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	3	3	26 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'37 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'37 WALTER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'37 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	16 dB(A)	A	Complies
'38 GORDON STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'38 GORDON STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	8 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	8 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	26 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	18 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	14 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	32 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	AR	1	0	14 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	7 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	7 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	7 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	18 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	15 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	14 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	19 dB(A)	A	Complies
'38 STEWART STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	18 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	35 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	1	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	1 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	1 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	1 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	19 dB(A)	A	Complies
'38 LEINSTER STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	11 dB(A)	A	Complies
'38 SELWYN STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'38 SELWYN STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'38 LANG ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	18 dB(A)	A	Complies
'77-83 COOK ROAD'	RES	7	5	1 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	6	5	0 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	5	5	0 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	4	5	0 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	3	5	0 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	1	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	6	0	29 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	5	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	17 dB(A)	A	Complies
'78 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'78 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'76 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	23 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-1 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-1 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	1 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	2 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	3	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	6 dB(A)	A	Complies
'133-139 COOK ROAD'	RES	3	5	-1 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	2	0	1 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	1 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	2 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	1	0	1 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	2	2	6 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	1	2	6 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'132 FLINDERS STREET'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)
'128 FLINDERS STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	3	2	4 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	4	5	-3 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	3	5	9 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	2	2	5 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	4	2	1 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	3	2	9 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	2	2	9 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	1	2	8 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	2	2	5 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	5	2	1 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'160 FLINDERS STREET'	RES	4	2	1 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	3	2	12 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	2	2	11 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)
'153-155 COOK ROAD'	CC	3	0	-3 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	2	0	3 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	1	0	2 dB(A)	A	Complies
'156 FLINDERS STREET'	RES	2	2	6 dB(A)	A	Complies (Bgn + 5)
'156 FLINDERS STREET'	RES	1	2	6 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	5	2	8 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	4	2	8 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	3	2	8 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	2	2	8 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	1	2	8 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	4	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	38 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	37 dB(A)	A	Complies
'159 COOK ROAD'	CC	1	0	1 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	36 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	38 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	38 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	37 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'228 MOORE PARK ROAD'	C	2	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	34 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	5	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	38 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	38 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	35 dB(A)	A	Complies
'234 MOORE PARK ROAD'	RES	3	3	50 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	3	0	38 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	35 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'236 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'247 OXFORD STREET'	TH	5	0	13 dB(A)	A	Complies
'247 OXFORD STREET'	TH	4	0	12 dB(A)	A	Complies
'247 OXFORD STREET'	TH	3	0	9 dB(A)	A	Complies
'247 OXFORD STREET'	TH	2	0	9 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'247 OXFORD STREET'	TH	1	0	8 dB(A)	A	Complies
'230 MOORE PARK ROAD'	C	1	0	39 dB(A)	A	Complies
'252 MOORE PARK ROAD'	RES	3	3	53 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'230 MOORE PARK ROAD'	C	1	0	28 dB(A)	A	Complies
'255 OXFORD STREET'	RES	4	4	19 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	3	3	51 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'250 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'251-255 OXFORD STREET'	PR	2	0	13 dB(A)	A	Complies
'251-255 OXFORD STREET'	PR	1	0	12 dB(A)	A	Complies
'257 OXFORD STREET'	RES	3	4	16 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	3	3	50 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	3	3	51 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	1	3	43 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	3	3	48 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	44 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'270 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	2	3	43 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'267 OXFORD STREET'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	43 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	12 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	3	4	8 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	3	5	6 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'27 OATLEY ROAD'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	4	4	24 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	3	4	21 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'27 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'28 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'29 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'28 RENNY STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'28 MOORE PARK ROAD'	RES	1	2	13 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	3	4	21 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'29 SELWYN STREET'	RES	2	4	1 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	1	4	1 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	4	5	8 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	4	4	27 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	3	3	15 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'50 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'50 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'52 LANG ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	8	5	6 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	7	5	3 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	6	5	3 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	5	5	1 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	4	5	2 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	3	5	2 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'52 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'54 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'54 LEINSTER STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'54 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'56 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	4	4	17 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'56 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'56 RENNY STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	7	5	1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	6	5	1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	5	5	1 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'57-67 COOK ROAD'	RES	4	5	1 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'280 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	3	3	43 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	2	3	37 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	3	3	42 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	3	3	45 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'345-347 OXFORD STREET'	C	3	0	13 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	2	0	11 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	1	0	12 dB(A)	A	Complies
'358 MOORE PARK ROAD'	RES	3	3	26 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'354 SOUTH DOWLING STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'360 MOORE PARK ROAD'	RES	1	3	17 dB(A)	A	Complies (Bgn + 5)
'349-351 OXFORD STREET'	C	3	0	11 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	2	0	11 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'349-351 OXFORD STREET'	C	1	0	11 dB(A)	A	Complies
'360 MOORE PARK ROAD'	RES	1	3	15 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	5	4	13 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	4	4	12 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	2	2	5 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'356 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	2	3	15 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	3	2	5 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	2	2	5 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	3	2	13 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	2	2	10 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	1	2	8 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	4	2	2 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	3	2	-1 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	2	2	-1 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'360 SOUTH DOWLING STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	3	2	3 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	3	2	14 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	2	2	13 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	1	2	10 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	3	2	17 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	2	2	16 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	1	2	14 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	14 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'378 SOUTH DOWLING STREET'	RES	2	2	14 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	1	2	14 dB(A)	A	Complies (Bgn + 5)
'384 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	14 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'388 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'387-389 OXFORD STREET'	C	3	0	12 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	2	0	12 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	1	0	13 dB(A)	A	Complies
'386 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'385 OXFORD STREET'	C	1	0	11 dB(A)	A	Complies
'390 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	E	1	0	1 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	2 dB(A)	A	Complies
'410 MOORE PARK ROAD'	RES	2	3	12 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	1	0	2 dB(A)	A	Complies
'398 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	2	0	1 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	3 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'414 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'416 MOORE PARK ROAD'	RES	1	3	15 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	3	3	12 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	3	3	9 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	2	3	9 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	3	3	12 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	3	3	8 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	2	3	8 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	8 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	3	3	10 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	2	3	9 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'421 OXFORD STREET'	E	3	0	3 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	1 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	0 dB(A)	A	Complies
'421 OXFORD STREET'	E	3	0	4 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	3 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	2 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	5	0	5 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	4	0	2 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	3	0	2 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	1 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	0 dB(A)	A	Complies
'428 MOORE PARK ROAD'	RES	3	3	7 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	2	3	6 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	1	3	6 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	3	3	15 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	2	3	16 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	3	0	2 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'461-463 OXFORD STREET'	PoW	2	0	1 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	0 dB(A)	A	Complies
'436 MOORE PARK ROAD'	RES	3	3	5 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	2	3	5 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	1	3	5 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	4	2	1 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	3	2	1 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	2	2	1 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	1	2	0 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	3	3	18 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	3	3	3 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	2	3	4 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	1	3	5 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	3	3	18 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	7	2	5 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	6	2	1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	5	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	4	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	3	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	2	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	2	0	-1 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	-2 dB(A)	A	Complies
'473 SOUTH DOWLING STREET'	RES	2	2	2 dB(A)	A	Complies (Bgn + 5)
'473 SOUTH DOWLING STREET'	RES	1	2	1 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	3	1	7 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	2	1	5 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	1	1	4 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	3	1	7 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	2	1	4 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	1	1	4 dB(A)	A	Complies (Bgn + 5)
'495 CLEVELAND STREET'	C	3	0	18 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	2	0	17 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	1	0	17 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'477 SOUTH DOWLING STREET'	RES	4	2	3 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	3	2	3 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	1	2	1 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	5	1	9 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	4	1	9 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	3	1	8 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	2	1	4 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	1	1	4 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	5	2	5 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	4	2	3 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	3	2	3 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	2	2	1 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	1	2	0 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	3	1	7 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	2	1	4 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	1	1	4 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	1	2	1 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	3	1	20 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	3	1	9 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	2	1	4 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	18 dB(A)	A	Complies
'83 LEINSTER STREET'	RES	3	3	18 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	1	3	17 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	8	5	1 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	7	5	1 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	6	5	1 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	5	5	2 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	4	5	2 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	3	5	2 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'80 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	3	3	9 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	2	3	7 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	1	3	6 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	2	3	9 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	1	3	7 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	5	3	31 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	4	3	30 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	3	3	28 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	3	3	12 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	2	3	12 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'84 GORDON STREET'	RES	1	3	4 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	3	3	21 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'90 REGENT STREET'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'84 LANG ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	2	3	12 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'87 PHELPS STREET'	RES	1	1	20 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'88 REGENT STREET'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'97 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	7	5	17 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	6	5	16 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	5	5	10 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	4	5	9 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'95 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	4	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	10 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'104 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	5	0	-2 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	-1 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	-1 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-1 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-1 dB(A)	A	Complies
'114 LANG ROAD'	C	3	0	0 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	3 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'107-111 COOK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'112 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'108 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'110 LANG ROAD'	RES	1	5	-3 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	-2 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	-3 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	1 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'121-125 COOK ROAD'	RES	8	5	0 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	7	5	-2 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	6	5	-2 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	5	5	-2 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	4	5	-2 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	3	5	-2 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	2 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	1 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-3 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	5 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	4	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	10 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	10 dB(A)	A	Complies
'119 LEINSTER STREET'	RES	2	3	12 dB(A)	A	Complies (Bgn + 5)
'119 LEINSTER STREET'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	1	1	20 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	2	1	4 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	1	1	4 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	1	1	15 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	13 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	10 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	4 dB(A)	A	Complies
'569 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'569 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'561 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	3 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	2 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	1 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	16 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	15 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	8 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'560 CLEVELAND STREET'	E	1	0	7 dB(A)	A	Complies
'575 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'575 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	1	0	12 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	14 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	12 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	12 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	10 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	15 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	15 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	14 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	13 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	17 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	17 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	16 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	15 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	11 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	12 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	11 dB(A)	A	Complies
'577 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'577 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	1	1	15 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	3	1	13 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	2	1	12 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	1	1	12 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	3	1	17 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	3	1	14 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	2	1	8 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	1	1	5 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'631 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	3	1	18 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	1	1	18 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	3	1	15 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	1	1	7 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	1	1	15 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	1	1	8 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	4	1	19 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	18 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	1	1	18 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	1	1	18 dB(A)	A	Complies (Bgn + 5)
'653 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	18 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'681 SOUTH DOWLING STREET'	C	2	0	17 dB(A)	A	Complies
'681 SOUTH DOWLING STREET'	C	1	0	17 dB(A)	A	Complies
'691 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	4	1	18 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	3	1	18 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	2	1	18 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'717 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'721 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'Site Office'	C	1	0	19 dB(A)	A	Complies
'Site Office'	C	1	0	19 dB(A)	A	Complies
'294 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	3	3	39 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	3	3	42 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'304 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'308 MOORE PARK ROAD'	C	5	0	39 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	4	0	39 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	3	0	39 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	2	0	36 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	1	0	35 dB(A)	A	Complies
'302 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	3	3	37 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	3	3	41 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'336 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	3	3	25 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	3	3	25 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'339 OXFORD STREET'	RES	6	4	19 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	5	4	12 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	4	4	11 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'342 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'340 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'338 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	3	3	21 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	1	3	15 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	3	3	23 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)

Table A-2: Paving

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1-5 COOK ROAD'	RES	8	5	26 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	7	5	26 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	6	5	26 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	5	5	24 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	4	5	23 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
' 335203 6248625'	AR	2	0	27 dB(A)	A	Complies
' 335203 6248625'	AR	1	0	27 dB(A)	A	Complies
'2 COOK ROAD'	RES	7	5	28 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	6	5	28 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	5	5	27 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	4	5	25 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	3	5	24 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
' 335206 6248642'	AR	1	0	27 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	13 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	12 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	10 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	5 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	5 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	5 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	17 dB(A)	A	Complies
'1 MARTIN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	31 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	32 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	31 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	30 dB(A)	A	Complies
'1 FURBER ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	15 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	10 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	17 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	17 dB(A)	A	Complies
'1 MITCHELL STREET'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'1 MITCHELL STREET'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1 STEWART STREET'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	3	3	31 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'2 ANZAC PARADE'	C	1	0	30 dB(A)	A	Complies
'3 LITTLE STEWART STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'3 LITTLE STEWART STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'2 IRIS STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'3 CHURCH STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'2 OATLEY ROAD'	C	2	0	36 dB(A)	A	Complies
'2 OATLEY ROAD'	C	1	0	36 dB(A)	A	Complies
'2 MARTIN ROAD'	RES	2	6	12 dB(A)	A	Complies (Bgn + 5)
'2 MARTIN ROAD'	RES	1	6	11 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'3 POATE ROAD'	RES	1	5	29 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'12 LEINSTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	30 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	30 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	4	4	34 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	3	4	34 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'13 POATE ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'14 LANG ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'15 CHURCH STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	2	5	27 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'19 BENT STREET'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	2	2	29 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	1	2	29 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	2	5	29 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'18 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'18 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	4	5	26 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'19 POATE ROAD'	RES	3	5	25 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	26 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'20-22 LEINSTER STREET'	PoW	2	0	23 dB(A)	A	Complies
'20-22 LEINSTER STREET'	PoW	1	0	20 dB(A)	A	Complies
'19 CENTENNIAL LANE'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'19 CENTENNIAL LANE'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'20 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'20 LANG ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'21 WALTER STREET'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	3	5	19 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'23 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'24 LEINSTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'24 GORDON STREET'	C	4	0	29 dB(A)	A	Complies
'24 GORDON STREET'	C	3	0	27 dB(A)	A	Complies
'24 GORDON STREET'	C	2	0	22 dB(A)	A	Complies
'24 GORDON STREET'	C	1	0	20 dB(A)	A	Complies
'24 COOK ROAD'	RES	3	5	24 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'24 CHURCH STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'24 STEWART STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	29 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	29 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'38 WALTER STREET'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	8	5	15 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	7	5	14 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	6	5	14 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	5	5	13 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	4	5	13 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'39-43 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'39 SELWYN STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'40-42 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	8	0	11 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	11 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	11 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	11 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	11 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	10 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	11 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	11 dB(A)	A	Complies
'40 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	4	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	20 dB(A)	A	Complies
'41 ALBION AVENUE'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	E	2	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	E	1	0	3 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	11	0	18 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	10	0	18 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'40 DRIVER AVENUE'	AR	9	0	17 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	8	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	19 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	18 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	17 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	17 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	17 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	17 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	17 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	2	0	47 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	1	0	47 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	19 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	19 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	19 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	19 dB(A)	A	Complies
'40 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	C	1	0	32 dB(A)	A	Complies
'40 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	3	5	6 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'42 LEINSTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'42 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'42 SELWYN STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'43 GREENS ROAD'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'44 LEINSTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	E	11	0	30 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	10	0	29 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	9	0	29 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	8	0	29 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	7	0	29 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	6	0	29 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	5	0	29 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	4	0	29 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	3	0	29 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	2	0	29 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	1	0	28 dB(A)	A	Complies
'44 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	C	5	0	45 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'44 DRIVER AVENUE'	C	4	0	45 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	3	0	45 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	2	0	45 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	1	0	45 dB(A)	A	Complies
'46 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'46 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'44 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	3	4	40 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	3	4	34 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'46 WALTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'47 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'46 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	4	4	40 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	3	4	40 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	2	4	42 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'3 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'4 COOK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'4 FURBER ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'4 RENNY LANE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'5 STEWART PLACE'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	4	4	35 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	3	4	34 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'5 FURBER ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	3	4	7 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'5 RENNY STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'6 CHAPMAN STREET'	C	3	0	26 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	2	0	26 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	1	0	25 dB(A)	A	Complies
'6 CHURCH STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'6 FURBER ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'6 WALTER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'7 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'8 FURBER ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'8 ALEXANDER STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	3	4	9 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'8 IRIS STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'8 LANG ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'8 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'8 SEYMOUR PLACE'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'9 FURBER ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	29 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'10-14 CHURCH STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	5	29 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'10 IRIS STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'10 WALTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'11 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'12 FURBER ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	8	5	16 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	7	5	14 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	6	5	14 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	5	5	13 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	4	5	13 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'48 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'49 REGENT STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	4	4	25 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'56 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	3	4	34 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'57 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'60 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	1	4	40 dB(A)	A	Complies (Bgn + 5)
'61 MOORE PARK ROAD'	CC	1	0	15 dB(A)	A	Complies
'62 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'62 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'61 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'63 MOORE PARK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'69 STEWART STREET'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	1	4	40 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	3	3	26 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'67 REGENT STREET'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	8	5	6 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	7	5	18 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	6	5	18 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	5	5	18 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	4	5	18 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	3	5	9 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	3	4	34 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'68 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'70 REGENT STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'69-73 MOORE PARK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	40 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'70-78 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'70 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'72 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'74 GORDON STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	17 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	11 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	38 dB(A)	A	Complies
'74 LANG ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	35 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	32 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'83 STEWART STREET'	RES	3	4	32 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	35 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	34 dB(A)	A	Complies
'81 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'81 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	42 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	42 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	44 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	39 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	2	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	35 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	31 dB(A)	A	Complies
'33 BENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	3	4	40 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'30 WALTER STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	2	2	31 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	1	2	29 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'31 RENNY STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'31 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'33 ALBION AVENUE'	RES	4	4	21 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	3	4	21 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	1	1	22 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	3	2	30 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	2	2	30 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	1	2	30 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'33 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	4	4	24 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'33 SELWYN STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'35 GORDON STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'34 MOORE PARK ROAD'	C	1	0	27 dB(A)	A	Complies
'35 MOORE PARK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'37 BENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	3	3	28 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'37 GORDON STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'37 SELWYN STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	20 dB(A)	A	Complies
'38 GORDON STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'38 GORDON STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	35 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	4	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	27 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	27 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	28 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	28 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	14 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	41 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	15 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	36 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	2	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	27 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	14 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	32 dB(A)	A	Complies
'38 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	3 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	3 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	24 dB(A)	A	Complies
'38 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	29 dB(A)	A	Complies
'38 SELWYN STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'38 SELWYN STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'39 MOORE PARK ROAD'	RES	3	5	26 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'38 LANG ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'77-83 COOK ROAD'	RES	7	5	12 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	6	5	7 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	5	5	5 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	4	5	5 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	1	0	35 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	6	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	5	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'78 GORDON STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'78 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'76 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	35 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	35 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	10 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	10 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	19 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	15 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	13 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	3	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'133-139 COOK ROAD'	RES	3	5	2 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	2	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	12 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	17 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	2	2	19 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	1	2	19 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'132 FLINDERS STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'128 FLINDERS STREET'	RES	1	2	17 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	3	2	10 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'146 FLINDERS STREET'	RES	2	2	10 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	1	2	13 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	4	5	0 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	3	5	14 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	2	2	19 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	1	2	19 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	4	2	10 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	3	2	13 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	2	2	16 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	1	2	19 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	2	2	15 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	1	2	14 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	5	2	14 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	4	2	13 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	3	2	9 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	2	2	9 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	1	2	9 dB(A)	A	Complies (Bgn + 5)
'153-155 COOK ROAD'	CC	3	0	0 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	2	0	12 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	1	0	9 dB(A)	A	Complies
'156 FLINDERS STREET'	RES	2	2	13 dB(A)	A	Complies (Bgn + 5)
'156 FLINDERS STREET'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	5	2	28 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	4	2	29 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	3	2	29 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	2	2	29 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	1	2	29 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	4	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	44 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'228 MOORE PARK ROAD'	C	1	0	44 dB(A)	A	Complies
'159 COOK ROAD'	CC	1	0	8 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	39 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	5	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	43 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	40 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	41 dB(A)	A	Complies
'234 MOORE PARK ROAD'	RES	3	3	47 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	41 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'236 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'247 OXFORD STREET'	TH	5	0	23 dB(A)	A	Complies
'247 OXFORD STREET'	TH	4	0	23 dB(A)	A	Complies
'247 OXFORD STREET'	TH	3	0	23 dB(A)	A	Complies
'247 OXFORD STREET'	TH	2	0	23 dB(A)	A	Complies
'247 OXFORD STREET'	TH	1	0	23 dB(A)	A	Complies
'230 MOORE PARK ROAD'	C	1	0	45 dB(A)	A	Complies
'252 MOORE PARK ROAD'	RES	3	3	45 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	2	3	45 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'230 MOORE PARK ROAD'	C	1	0	42 dB(A)	A	Complies
'255 OXFORD STREET'	RES	4	4	33 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	3	4	34 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	3	3	45 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	2	3	45 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'250 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'256 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'251-255 OXFORD STREET'	PR	2	0	25 dB(A)	A	Complies
'251-255 OXFORD STREET'	PR	1	0	25 dB(A)	A	Complies
'257 OXFORD STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	3	3	43 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	43 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	3	3	43 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	2	3	43 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	1	3	43 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	3	3	42 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'267 OXFORD STREET'	RES	1	2	22 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	29 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	29 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'25 STEWART STREET'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	1	4	40 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	3	4	16 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	4	4	35 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'27 GORDON STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'28 LEINSTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'28 WALTER STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'29 GORDON STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'28 RENNY STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'28 MOORE PARK ROAD'	RES	1	2	24 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	3	4	40 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	4	5	20 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	4	4	35 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'51 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	3	3	28 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	3	5	19 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'50 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'53 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	3	4	36 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	3	5	19 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	3	4	36 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'52 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	8	5	18 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	7	5	13 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	6	5	13 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	5	5	12 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	4	5	12 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'54 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	3	5	19 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'54 LEINSTER STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'54 REGENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'56 STEWART STREET'	RES	3	4	32 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'56 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	4	4	28 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'56 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'56 RENNY STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	2	3	45 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	7	5	9 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	6	5	8 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	5	5	2 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	4	5	2 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'280 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	3	3	40 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'300 MOORE PARK ROAD'	RES	3	3	39 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	3	3	42 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'345-347 OXFORD STREET'	C	3	0	19 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	2	0	12 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	1	0	10 dB(A)	A	Complies
'358 MOORE PARK ROAD'	RES	3	3	32 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'354 SOUTH DOWLING STREET'	RES	1	2	15 dB(A)	A	Complies (Bgn + 5)
'360 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'349-351 OXFORD STREET'	C	3	0	14 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	2	0	12 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	1	0	12 dB(A)	A	Complies
'360 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	5	4	32 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	4	4	32 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	2	2	12 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)
'356 SOUTH DOWLING STREET'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	3	2	18 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	2	2	18 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	1	2	17 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	3	2	19 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	2	2	17 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'362 SOUTH DOWLING STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	4	2	14 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	3	2	19 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	2	2	19 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'360 SOUTH DOWLING STREET'	RES	1	2	15 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	3	2	17 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	2	2	16 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	1	2	15 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	3	2	21 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	2	2	22 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	1	2	21 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	3	2	21 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	2	2	22 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	1	2	22 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	2	2	21 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	1	2	21 dB(A)	A	Complies (Bgn + 5)
'384 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'388 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'387-389 OXFORD STREET'	C	3	0	18 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	2	0	18 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	1	0	18 dB(A)	A	Complies
'386 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'385 OXFORD STREET'	C	1	0	10 dB(A)	A	Complies
'390 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'390 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	E	1	0	10 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	6 dB(A)	A	Complies
'410 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	1	0	6 dB(A)	A	Complies
'398 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	2	0	4 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	5 dB(A)	A	Complies
'414 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'416 MOORE PARK ROAD'	RES	1	3	17 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	3	3	24 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	3	3	22 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	3	3	22 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	3	3	20 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'424 MOORE PARK ROAD'	RES	3	3	20 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'421 OXFORD STREET'	E	3	0	15 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	10 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	7 dB(A)	A	Complies
'421 OXFORD STREET'	E	3	0	18 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	15 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	13 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	5	0	18 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	4	0	17 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	3	0	13 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	15 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	11 dB(A)	A	Complies
'428 MOORE PARK ROAD'	RES	3	3	21 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	3	3	20 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	2	3	19 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	3	0	13 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	14 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	14 dB(A)	A	Complies
'436 MOORE PARK ROAD'	RES	3	3	20 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	4	2	19 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	3	2	20 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	2	2	19 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	1	2	18 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	3	3	20 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	3	3	7 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	3	3	20 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	2	3	19 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'434 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	7	2	23 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	6	2	23 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	5	2	22 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	4	2	13 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	3	2	8 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	2	2	15 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	2	0	13 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	12 dB(A)	A	Complies
'473 SOUTH DOWLING STREET'	RES	2	2	22 dB(A)	A	Complies (Bgn + 5)
'473 SOUTH DOWLING STREET'	RES	1	2	22 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	3	1	26 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	1	1	26 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	3	1	26 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'495 CLEVELAND STREET'	C	3	0	23 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	2	0	24 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	1	0	24 dB(A)	A	Complies
'477 SOUTH DOWLING STREET'	RES	4	2	24 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	3	2	23 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	2	2	23 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	1	2	22 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	5	1	25 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	4	1	25 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	1	1	22 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	5	2	23 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	4	2	23 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	3	2	22 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	2	2	22 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	1	2	21 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	3	1	26 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'475 SOUTH DOWLING STREET'	RES	2	2	23 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	1	2	23 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	3	1	26 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	3	1	27 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	35 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	31 dB(A)	A	Complies
'83 LEINSTER STREET'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	8	5	7 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	7	5	7 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	6	5	7 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	5	5	7 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	4	5	7 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	3	3	22 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'83 GREENS ROAD'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	5	3	30 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	4	3	30 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	3	3	23 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'84 GORDON STREET'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	3	3	28 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'84 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'87 PHELPS STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'88 REGENT STREET'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'97 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'91 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	7	5	21 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	6	5	21 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	5	5	16 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	4	5	16 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	4	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	17 dB(A)	A	Complies
'104 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'107-111 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	5	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'114 LANG ROAD'	C	3	0	6 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'107-111 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'112 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'108 LANG ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'110 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	12 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	1 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'121-125 COOK ROAD'	RES	8	5	7 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	7	5	3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	6	5	3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	5	5	3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	4	5	3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	6 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	10 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	1 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	0 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	0 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'114 LANG ROAD'	C	1	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	18 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	18 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	10 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'119 LEINSTER STREET'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'119 LEINSTER STREET'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'553 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	20 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	14 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	11 dB(A)	A	Complies
'569 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'569 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'561 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	6 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	4 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	3 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	20 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	11 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	10 dB(A)	A	Complies
'575 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'575 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	1	0	18 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	18 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	19 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	16 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	13 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	20 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	18 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	19 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	19 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	22 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	17 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'560 CLEVELAND STREET'	E	2	0	17 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	18 dB(A)	A	Complies
'577 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'577 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	3	1	24 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	3	1	24 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	4	1	24 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'671 SOUTH DOWLING STREET'	RES	3	1	24 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	2	1	23 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'653 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	24 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	2	1	23 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'681 SOUTH DOWLING STREET'	C	2	0	23 dB(A)	A	Complies
'681 SOUTH DOWLING STREET'	C	1	0	23 dB(A)	A	Complies
'691 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	3	1	19 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	2	1	20 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	1	1	20 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	4	1	22 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	3	1	22 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'705 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'717 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'721 SOUTH DOWLING STREET'	RES	1	1	18 dB(A)	A	Complies (Bgn + 5)
'Site Office'	C	1	0	32 dB(A)	A	Complies
'Site Office'	C	1	0	33 dB(A)	A	Complies
'294 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	3	3	38 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	3	3	39 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'308 MOORE PARK ROAD'	C	5	0	37 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	4	0	37 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	3	0	37 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	2	0	37 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	1	0	37 dB(A)	A	Complies
'302 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	3	3	35 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	3	3	38 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'320 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'336 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	3	3	31 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	6	4	31 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	5	4	31 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	4	4	27 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'342 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'340 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'338 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	3	3	25 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'348 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)

Table A-3: Facade install - no hand tools

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1-5 COOK ROAD'	RES	8	5	24 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	7	5	22 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	6	5	19 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	5	5	19 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	4	5	19 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	3	5	15 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
' 335203 6248625'	AR	2	0	19 dB(A)	A	Complies
' 335203 6248625'	AR	1	0	19 dB(A)	A	Complies
'2 COOK ROAD'	RES	7	5	25 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	6	5	22 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	5	5	22 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	4	5	21 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
' 335206 6248642'	AR	1	0	21 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	-3 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1 DRIVER AVENUE'	C	2	0	-3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	-3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	4 dB(A)	A	Complies
'1 MARTIN STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	21 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	18 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	15 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	14 dB(A)	A	Complies
'1 FURBER ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	9 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	6 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	6 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	6 dB(A)	A	Complies
'1 MITCHELL STREET'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'1 MITCHELL STREET'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'3 GORDON STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'2 ANZAC PARADE'	C	1	0	21 dB(A)	A	Complies
'3 LITTLE STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'3 LITTLE STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'2 IRIS STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'3 CHURCH STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'2 OATLEY ROAD'	C	2	0	36 dB(A)	A	Complies
'2 OATLEY ROAD'	C	1	0	32 dB(A)	A	Complies
'2 MARTIN ROAD'	RES	2	6	-1 dB(A)	A	Complies (Bgn + 5)
'2 MARTIN ROAD'	RES	1	6	-1 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'3 POATE ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'12 LEINSTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'13 ALBION AVENUE'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	4	4	28 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'13 POATE ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'14 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'15 CHURCH STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	3	4	36 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'15 POATE ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	3	4	1 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	2	2	10 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	1	2	10 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	3	4	36 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'18 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'18 FURBER ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'18 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	4	5	22 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	19 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'20-22 LEINSTER STREET'	PoW	2	0	13 dB(A)	A	Complies
'20-22 LEINSTER STREET'	PoW	1	0	10 dB(A)	A	Complies
'19 CENTENNIAL LANE'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'19 CENTENNIAL LANE'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'21 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	3	5	4 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'20 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'21 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'23 MARTIN STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	3	5	9 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'24 LEINSTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'24 GORDON STREET'	C	4	0	16 dB(A)	A	Complies
'24 GORDON STREET'	C	3	0	13 dB(A)	A	Complies
'24 GORDON STREET'	C	2	0	10 dB(A)	A	Complies
'24 GORDON STREET'	C	1	0	9 dB(A)	A	Complies
'24 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'24 CHURCH STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'25 ALBION AVENUE'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'24 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	11 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'38 WALTER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	8	5	2 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	7	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	6	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	5	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	4	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	3	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'39 SELWYN STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'40-42 STEWART STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	8	0	1 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'40 DRIVER AVENUE'	AR	7	0	1 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	1 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	1 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	2 dB(A)	A	Complies
'40 COOK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	4	0	6 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	6 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	7 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	7 dB(A)	A	Complies
'41 ALBION AVENUE'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	E	2	0	-5 dB(A)	A	Complies
'40 DRIVER AVENUE'	E	1	0	-6 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	11	0	7 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	10	0	7 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	9	0	7 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	8	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	2	0	32 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	1	0	31 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	9 dB(A)	A	Complies
'40 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	C	1	0	30 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'40 SELWYN STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	3	5	1 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'42 LEINSTER STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'42 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'42 SELWYN STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'43 GREENS ROAD'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'44 LEINSTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'45 REGENT STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	E	11	0	17 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	10	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	9	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	8	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	7	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	6	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	5	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	4	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	3	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	2	0	16 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	1	0	17 dB(A)	A	Complies
'44 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	C	5	0	18 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	4	0	18 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	3	0	18 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	2	0	18 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	1	0	19 dB(A)	A	Complies
'46 GORDON STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'46 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'44 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'47 BENT STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'46 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'46 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'49-51 STEWART STREET'	RES	4	4	30 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	2	4	43 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	1	4	40 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'3 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'4 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'4 FURBER ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'5 STEWART PLACE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	4	4	30 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'8 LEINSTER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'5 FURBER ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	3	4	1 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'5 RENNY STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'6 CHAPMAN STREET'	C	3	0	6 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	2	0	1 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	1	0	0 dB(A)	A	Complies
'6 CHURCH STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'6 FURBER ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'8 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'7 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'8 FURBER ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'8 ALEXANDER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	3	4	4 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'8 IRIS STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'8 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'8 SEYMOUR PLACE'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'9 FURBER ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'10 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'10-14 CHURCH STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'10 IRIS STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'10 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'11 FURBER ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'12 FURBER ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'48 GORDON STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	8	5	7 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	7	5	4 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	6	5	4 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	5	5	4 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	4	5	4 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	3	5	4 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	3	4	8 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'48 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	4	4	12 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	3	5	-1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'56 SELWYN STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	3	4	21 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'57 SELWYN STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'61 REGENT STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'61 MOORE PARK ROAD'	CC	1	0	7 dB(A)	A	Complies
'62 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'62 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'61 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	2	4	1 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'63 MOORE PARK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	3	3	16 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	2	3	15 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	1	3	14 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'67 REGENT STREET'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	8	5	-2 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	7	5	15 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	6	5	14 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	5	5	13 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	4	5	12 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'69-75 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	3	5	9 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'68 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	3	3	18 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	2	3	17 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'70 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'69-73 MOORE PARK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	3	5	17 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'70 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'72 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'74 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	2	5	-3 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	1	5	-3 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	10 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	7 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	33 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'74 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	14 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	14 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	17 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	12 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	35 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	18 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	18 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	21 dB(A)	A	Complies
'83 STEWART STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	10 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	10 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	17 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'81 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'81 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	11 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	15 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	40 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	14 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	38 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	20 dB(A)	A	Complies
'33 BENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'30 WALTER STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	2	2	15 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	1	2	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'33 BENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'31 RENNY STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'31 SELWYN STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	3	5	1 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	4	4	10 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	3	4	9 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	2	1	0 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	1	1	0 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	3	3	27 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	3	2	11 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	2	2	11 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'33 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	4	4	9 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'35 ALBION AVENUE'	RES	3	4	8 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'33 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'35 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	3	3	27 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'34 MOORE PARK ROAD'	C	1	0	27 dB(A)	A	Complies
'35 MOORE PARK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'37 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'37 MOORE PARK ROAD'	RES	3	3	27 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'37 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'37 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	12 dB(A)	A	Complies
'38 GORDON STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'38 GORDON STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	7 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	6 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	8 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	8 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	14 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	9 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	9 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	3 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	3 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	1	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	14 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	5 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	5 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	5 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	18 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	18 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	15 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	26 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	18 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	5 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	5 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	15 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	30 dB(A)	A	Complies
'38 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	24 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	5	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	-1 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	-1 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	-1 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	8 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	13 dB(A)	A	Complies
'38 LEINSTER STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	11 dB(A)	A	Complies
'38 SELWYN STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'38 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'38 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	39 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'77-83 COOK ROAD'	RES	7	5	3 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	6	5	0 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	5	5	-1 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	4	5	-2 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	3	5	-2 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	32 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	6	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	5	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'78 GORDON STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'78 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'76 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	28 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-3 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	2 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	2 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	3	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'133-139 COOK ROAD'	RES	3	5	-2 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	-3 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'133-139 COOK ROAD'	RES	1	5	-3 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	2	0	0 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-1 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	2 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	2	2	6 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	1	2	6 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'132 FLINDERS STREET'	RES	1	2	7 dB(A)	A	Complies (Bgn + 5)
'128 FLINDERS STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	3	2	4 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	4	5	-4 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	4	2	1 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	3	2	11 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	2	2	11 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	1	2	10 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'144 FLINDERS STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	5	2	1 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	4	2	1 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	3	2	11 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	2	2	11 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	1	2	10 dB(A)	A	Complies (Bgn + 5)
'153-155 COOK ROAD'	CC	3	0	-4 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	2	0	1 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	1	0	2 dB(A)	A	Complies
'156 FLINDERS STREET'	RES	2	2	6 dB(A)	A	Complies (Bgn + 5)
'156 FLINDERS STREET'	RES	1	2	6 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	5	2	5 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	4	2	6 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	3	2	6 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	2	2	6 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	1	2	6 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	4	0	46 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	46 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	46 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	43 dB(A)	A	Complies
'159 COOK ROAD'	CC	1	0	2 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	36 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	46 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	46 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	36 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	38 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'228 MOORE PARK ROAD'	C	2	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	36 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	36 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	5	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	39 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	36 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	37 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	37 dB(A)	A	Complies
'234 MOORE PARK ROAD'	RES	3	3	48 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	2	3	48 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	3	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	38 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	37 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	1	3	43 dB(A)	A	Complies (Bgn + 5)
'236 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'247 OXFORD STREET'	TH	5	0	23 dB(A)	A	Complies
'247 OXFORD STREET'	TH	4	0	23 dB(A)	A	Complies
'247 OXFORD STREET'	TH	3	0	23 dB(A)	A	Complies
'247 OXFORD STREET'	TH	2	0	23 dB(A)	A	Complies
'247 OXFORD STREET'	TH	1	0	20 dB(A)	A	Complies
'230 MOORE PARK ROAD'	C	1	0	46 dB(A)	A	Complies
'252 MOORE PARK ROAD'	RES	3	3	44 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	2	3	44 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'230 MOORE PARK ROAD'	C	1	0	32 dB(A)	A	Complies
'255 OXFORD STREET'	RES	4	4	27 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	3	3	45 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	2	3	45 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'250 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'251-255 OXFORD STREET'	PR	2	0	13 dB(A)	A	Complies
'251-255 OXFORD STREET'	PR	1	0	13 dB(A)	A	Complies
'257 OXFORD STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	3	3	41 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	3	3	42 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'272 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	3	3	41 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'267 OXFORD STREET'	RES	1	2	10 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	12 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	3	4	7 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'29 BENT STREET'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	4	4	21 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'27 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'28 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'29 GORDON STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'28 RENNY STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'28 MOORE PARK ROAD'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	2	4	1 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	1	4	1 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	3	4	10 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	4	5	9 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	4	4	27 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	1	4	40 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	3	3	16 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'49 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'50 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'52 LANG ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	8	5	8 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	7	5	6 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	6	5	5 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	5	5	6 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'53-55 COOK ROAD'	RES	4	5	3 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'54 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'54 LEINSTER STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'54 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	3	4	21 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'56 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	4	4	21 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	3	4	16 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'56 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'56 RENNY STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'57 OATLEY ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	7	5	6 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	6	5	-1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	5	5	-1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	4	5	-1 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'280 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	3	3	37 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	37 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	3	3	36 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	3	3	40 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'345-347 OXFORD STREET'	C	3	0	8 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	2	0	7 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	1	0	7 dB(A)	A	Complies
'358 MOORE PARK ROAD'	RES	3	3	23 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'354 SOUTH DOWLING STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'360 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'349-351 OXFORD STREET'	C	3	0	8 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	2	0	7 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	1	0	7 dB(A)	A	Complies
'360 MOORE PARK ROAD'	RES	1	3	14 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	5	4	25 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	4	4	20 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	2	2	-1 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'356 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	3	2	6 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	2	2	5 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	1	2	6 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	3	2	14 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	2	2	10 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	1	2	7 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	4	2	3 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	3	2	9 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	2	2	5 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	1	2	2 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'360 SOUTH DOWLING STREET'	RES	1	2	5 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	3	2	3 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	3	2	3 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	3	2	14 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'376 SOUTH DOWLING STREET'	RES	2	2	13 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	2	2	12 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	1	2	10 dB(A)	A	Complies (Bgn + 5)
'384 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'388 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'387-389 OXFORD STREET'	C	3	0	10 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	2	0	9 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	1	0	8 dB(A)	A	Complies
'386 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'385 OXFORD STREET'	C	1	0	6 dB(A)	A	Complies
'390 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	14 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	12 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	E	1	0	1 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	-3 dB(A)	A	Complies
'410 MOORE PARK ROAD'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'395 OXFORD STREET'	PoW	1	0	-1 dB(A)	A	Complies
'398 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	2	0	-3 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	-2 dB(A)	A	Complies
'414 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'416 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	3	3	11 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	9 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	3	3	8 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	2	3	7 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	1	3	7 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	3	3	9 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	2	3	8 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	15 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	3	3	7 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	2	3	6 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	1	3	6 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	9 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	3	3	8 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	2	3	7 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	1	3	7 dB(A)	A	Complies (Bgn + 5)
'421 OXFORD STREET'	E	3	0	1 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	-2 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	-4 dB(A)	A	Complies
'421 OXFORD STREET'	E	3	0	5 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	3 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	1 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	5	0	11 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	4	0	9 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	3	0	7 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	2 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	-1 dB(A)	A	Complies
'428 MOORE PARK ROAD'	RES	3	3	5 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	2	3	5 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	1	3	5 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'430 MOORE PARK ROAD'	RES	3	3	3 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	2	3	3 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	1	3	3 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	3	0	4 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	4 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	3 dB(A)	A	Complies
'436 MOORE PARK ROAD'	RES	3	3	4 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	2	3	3 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	1	3	2 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	4	2	0 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	3	2	0 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	2	2	0 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	1	2	0 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	3	3	18 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	1	3	17 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	3	3	1 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	2	3	3 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	1	3	2 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	3	3	18 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	1	3	17 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	7	2	1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	6	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	5	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	4	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	3	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	2	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	2	0	1 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	-1 dB(A)	A	Complies
'473 SOUTH DOWLING STREET'	RES	2	2	1 dB(A)	A	Complies (Bgn + 5)
'473 SOUTH DOWLING STREET'	RES	1	2	1 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	3	1	5 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	2	1	2 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	1	1	2 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	3	1	4 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	2	1	4 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'485 SOUTH DOWLING STREET'	RES	1	1	0 dB(A)	A	Complies (Bgn + 5)
'495 CLEVELAND STREET'	C	3	0	14 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	2	0	14 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	1	0	13 dB(A)	A	Complies
'477 SOUTH DOWLING STREET'	RES	4	2	2 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	3	2	2 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	2	2	2 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	1	2	0 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	5	1	4 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	4	1	4 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	3	1	4 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	2	1	1 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	5	2	2 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	4	2	1 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	3	2	2 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	2	2	2 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	3	1	4 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	2	1	1 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	1	2	1 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	3	1	15 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	2	1	5 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	3	1	4 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	2	1	1 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	1	1	0 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	2	1	2 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	18 dB(A)	A	Complies
'83 LEINSTER STREET'	RES	3	3	16 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	8	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	7	5	0 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'80 COOK ROAD'	RES	6	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	5	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	4	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	3	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	3	3	15 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	2	3	8 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	1	3	6 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	5	3	29 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	4	3	29 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	3	3	16 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'88 GORDON STREET'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'84 GORDON STREET'	RES	1	3	2 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	3	3	19 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	2	3	16 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	1	3	15 dB(A)	A	Complies (Bgn + 5)
'84 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'87 PHELPS STREET'	RES	1	1	0 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'88 REGENT STREET'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'97 STEWART STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	7	5	15 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	6	5	15 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	5	5	16 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	4	5	15 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	3	5	14 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'98 LANG ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	4	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'104 LANG ROAD'	RES	1	5	-4 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	5	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-3 dB(A)	A	Complies
'114 LANG ROAD'	C	3	0	-2 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	-2 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'107-111 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'112 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'108 LANG ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'110 LANG ROAD'	RES	1	5	-4 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'114 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	-4 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	-4 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	0 dB(A)	A	Complies
'121-125 COOK ROAD'	RES	8	5	-1 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	7	5	-3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	6	5	-4 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	5	5	-4 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	4	5	-3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	3	5	-3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	2	5	-3 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	1 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	-1 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	-5 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-5 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-5 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	7 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	1	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	1 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'119 LEINSTER STREET'	RES	2	3	17 dB(A)	A	Complies (Bgn + 5)
'119 LEINSTER STREET'	RES	1	3	15 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	2	3	17 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	2	1	4 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	2	1	1 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	2	1	3 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	11 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	11 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	7 dB(A)	A	Complies
'569 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'569 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'561 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	-10 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	-11 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'560 CLEVELAND STREET'	E	1	0	-11 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	16 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	15 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	7 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	6 dB(A)	A	Complies
'575 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'575 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	1	0	11 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	13 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	10 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	10 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	9 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	14 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	14 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	14 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	13 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	15 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	15 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	15 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	14 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	13 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	13 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	13 dB(A)	A	Complies
'577 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'577 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	3	1	20 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	3	1	15 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	3	1	8 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'625-629 SOUTH DOWLING STREET'	RES	2	1	7 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	1	1	5 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	3	1	17 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	3	1	14 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	3	1	15 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	1	1	7 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	1	1	8 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	4	1	14 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	14 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'653 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	14 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'671 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'681 SOUTH DOWLING STREET'	C	2	0	14 dB(A)	A	Complies
'681 SOUTH DOWLING STREET'	C	1	0	13 dB(A)	A	Complies
'691 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	4	1	16 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	1	1	15 dB(A)	A	Complies (Bgn + 5)
'717 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'721 SOUTH DOWLING STREET'	RES	1	1	7 dB(A)	A	Complies (Bgn + 5)
'Site Office'	C	1	0	14 dB(A)	A	Complies
'Site Office'	C	1	0	14 dB(A)	A	Complies
'294 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	3	3	33 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'298 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	3	3	36 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'308 MOORE PARK ROAD'	C	5	0	34 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	4	0	34 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	3	0	34 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	2	0	34 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	1	0	34 dB(A)	A	Complies
'302 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	3	3	36 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'336 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	3	3	22 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'350 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	3	3	22 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	6	4	17 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	5	4	11 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	4	4	10 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	3	4	9 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'342 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'340 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'338 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	3	3	18 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	2	3	19 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	2	3	19 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	3	3	20 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)

Table A-4: Misc Facade Install

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1-5 COOK ROAD'	RES	8	5	33 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	7	5	33 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	6	5	30 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	5	5	31 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	4	5	31 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	3	5	29 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	2	5	27 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
' 335203 6248625'	AR	2	0	34 dB(A)	A	Complies
' 335203 6248625'	AR	1	0	32 dB(A)	A	Complies
'2 COOK ROAD'	RES	7	5	35 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	6	5	34 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	5	5	33 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	4	5	33 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	3	5	31 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	2	5	28 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
' 335206 6248642'	AR	1	0	32 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	14 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	14 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	14 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	9 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	9 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	9 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	15 dB(A)	A	Complies
'1 MARTIN STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	33 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	30 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	28 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	26 dB(A)	A	Complies
'1 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	18 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	15 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	15 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	15 dB(A)	A	Complies
'1 MITCHELL STREET'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'1 MITCHELL STREET'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1 SEYMOUR PLACE'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	3	4	46 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	2	4	44 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	1	4	44 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	3	3	33 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'2 ANZAC PARADE'	C	1	0	35 dB(A)	A	Complies
'3 LITTLE STEWART STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'3 LITTLE STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'2 IRIS STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'3 CHURCH STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'2 OATLEY ROAD'	C	2	0	35 dB(A)	A	Complies
'2 OATLEY ROAD'	C	1	0	35 dB(A)	A	Complies
'2 MARTIN ROAD'	RES	2	6	8 dB(A)	A	Complies (Bgn + 5)
'2 MARTIN ROAD'	RES	1	6	8 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'3 POATE ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'4 RENNY LANE'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'12 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	31 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	29 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	30 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	3	37 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	4	4	36 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'15 WALTER STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'13 POATE ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'14 LANG ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'15 CHURCH STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	2	5	29 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	2	5	29 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'16 WALTER STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	2	2	28 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	1	2	28 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'18 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'18 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'19 GORDON STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	4	5	29 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	28 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	27 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	29 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	27 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'20-22 LEINSTER STREET'	PoW	2	0	25 dB(A)	A	Complies
'20-22 LEINSTER STREET'	PoW	1	0	22 dB(A)	A	Complies
'19 CENTENNIAL LANE'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'19 CENTENNIAL LANE'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'20 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'20 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'21 WALTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'25 BENT STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'24 LEINSTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'24 GORDON STREET'	C	4	0	31 dB(A)	A	Complies
'24 GORDON STREET'	C	3	0	26 dB(A)	A	Complies
'24 GORDON STREET'	C	2	0	22 dB(A)	A	Complies
'24 GORDON STREET'	C	1	0	19 dB(A)	A	Complies
'24 COOK ROAD'	RES	3	5	25 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'24 CHURCH STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'24 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	28 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	28 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'38 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	8	5	21 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	7	5	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'39-43 COOK ROAD'	RES	6	5	19 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	5	5	17 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	4	5	16 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	3	5	17 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	2	4	42 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'39 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'40-42 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	8	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	15 dB(A)	A	Complies
'40 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	4	0	23 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	23 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	23 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	24 dB(A)	A	Complies
'41 ALBION AVENUE'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'40 DRIVER AVENUE'	E	2	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	E	1	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	11	0	19 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	10	0	19 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	9	0	19 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	8	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	2	0	50 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	1	0	50 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	23 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	23 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	23 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	23 dB(A)	A	Complies
'40 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	C	1	0	36 dB(A)	A	Complies
'40 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	2	4	42 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'41 SELWYN STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'42 LEINSTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'42 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'42 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'43 GREENS ROAD'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'44 LEINSTER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	3	5	14 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	E	11	0	38 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	10	0	38 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	9	0	38 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	8	0	38 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	7	0	39 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	6	0	39 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	5	0	39 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	4	0	39 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	3	0	39 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'44 DRIVER AVENUE'	E	2	0	39 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	1	0	39 dB(A)	A	Complies
'44 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	C	5	0	48 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	4	0	49 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	3	0	49 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	2	0	49 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	1	0	49 dB(A)	A	Complies
'46 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'46 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'44 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	3	4	42 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'46 RENNY STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'46 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'46 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	3	4	16 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	4	4	40 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	2	4	44 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	1	4	44 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'3 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'4 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'4 FURBER ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'4 LANG ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'5 STEWART PLACE'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	4	4	40 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	3	4	39 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'5 FURBER ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'5 RENNY STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'6 CHAPMAN STREET'	C	3	0	28 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'6 CHAPMAN STREET'	C	2	0	26 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	1	0	25 dB(A)	A	Complies
'6 CHURCH STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'6 FURBER ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'7 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'8 FURBER ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	3	4	39 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'8 ALEXANDER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	2	3	37 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'8 IRIS STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'8 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'8 SEYMOUR PLACE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'9 FURBER ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'10-14 CHURCH STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	5	28 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'10 IRIS STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	3	37 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	3	5	24 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'10 WALTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'11 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'11 FURBER ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'12 FURBER ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	8	5	26 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	7	5	23 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	6	5	23 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	5	5	19 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	4	5	19 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	3	5	19 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'49 GORDON STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'48 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	4	4	22 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'56 SELWYN STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	3	4	34 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'57 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	3	4	40 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	42 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	3	5	28 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	2	5	27 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'58 COOK ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'61 MOORE PARK ROAD'	CC	1	0	18 dB(A)	A	Complies
'62 REGENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'62 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'61 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'63 MOORE PARK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'64 LANG ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	3	3	27 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'67 REGENT STREET'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	2	5	30 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	1	5	30 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	8	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	7	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	6	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	5	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	4	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	3	4	36 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'68 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	3	3	31 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'70 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'69-73 MOORE PARK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'71 STEWART STREET'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	2	5	28 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'70 COOK ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'72 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'74 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	16 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	18 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	18 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	41 dB(A)	A	Complies
'74 LANG ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	40 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	40 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	41 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	45 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	45 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	28 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	32 dB(A)	A	Complies
'83 STEWART STREET'	RES	3	4	32 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	18 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'81 STEWART STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'81 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	41 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	41 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	46 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	38 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	1	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	47 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	48 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	48 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	47 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	46 dB(A)	A	Complies
'75 OXFORD STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'33 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'30 WALTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	2	2	29 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	1	2	29 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'31 RENNY STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'31 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'32 RENNY STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	4	4	13 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	3	3	36 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	3	2	29 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	2	2	29 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	1	2	29 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'33 GORDON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	4	4	24 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'33 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'35 GORDON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	3	3	36 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'36 POATE LANE'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'34 MOORE PARK ROAD'	C	1	0	25 dB(A)	A	Complies
'35 MOORE PARK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'37 BENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	3	3	32 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'37 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	2	4	42 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'37 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	23 dB(A)	A	Complies
'38 GORDON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'38 GORDON STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	2	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	41 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	41 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	40 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	39 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	39 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	39 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	44 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	39 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	23 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	1	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	44 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	43 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	43 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	43 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	42 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	26 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	25 dB(A)	A	Complies
'38 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	34 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	34 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	34 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	27 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	28 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	28 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	26 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	24 dB(A)	A	Complies
'38 LEINSTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	2	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	35 dB(A)	A	Complies
'38 SELWYN STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'38 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	3	5	30 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	2	5	28 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'38 LANG ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	45 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	45 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	44 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	42 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'77-83 COOK ROAD'	RES	7	5	14 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	6	5	11 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	5	5	10 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	4	5	10 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	6	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	5	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	21 dB(A)	A	Complies
'78 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'78 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'76 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	33 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	17 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	1	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	15 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	14 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	3	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	15 dB(A)	A	Complies
'133-139 COOK ROAD'	RES	3	5	9 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	2	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	8 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	21 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	2	2	24 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	1	2	24 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	2	2	22 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	1	2	21 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'127-131 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'132 FLINDERS STREET'	RES	1	2	21 dB(A)	A	Complies (Bgn + 5)
'128 FLINDERS STREET'	RES	1	2	19 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	3	2	18 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	2	2	17 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	1	2	17 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	4	5	6 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	4	2	14 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	3	2	14 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	2	2	18 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	1	2	18 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	2	2	15 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	2	2	18 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	1	2	19 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	5	2	15 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	4	2	14 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	3	2	13 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	2	2	13 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	1	2	13 dB(A)	A	Complies (Bgn + 5)
'153-155 COOK ROAD'	CC	3	0	6 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	2	0	10 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	1	0	11 dB(A)	A	Complies
'156 FLINDERS STREET'	RES	2	2	18 dB(A)	A	Complies (Bgn + 5)
'156 FLINDERS STREET'	RES	1	2	18 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	5	2	28 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	4	2	29 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	3	2	29 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	2	2	29 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'162 FLINDERS STREET'	RES	1	2	29 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	4	0	55 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	55 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	55 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	50 dB(A)	A	Complies
'159 COOK ROAD'	CC	1	0	10 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	56 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	56 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	56 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	54 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	33 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	33 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	54 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	54 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	54 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	53 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	42 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	5	0	55 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	55 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	55 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	55 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	50 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	41 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	40 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	40 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'228 MOORE PARK ROAD'	C	3	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	43 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	46 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	43 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	43 dB(A)	A	Complies
'234 MOORE PARK ROAD'	RES	3	3	52 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	2	3	51 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	1	3	47 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	3	0	47 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	47 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	47 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	43 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	2	3	50 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'236 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'247 OXFORD STREET'	TH	5	0	27 dB(A)	A	Complies
'247 OXFORD STREET'	TH	4	0	26 dB(A)	A	Complies
'247 OXFORD STREET'	TH	3	0	19 dB(A)	A	Complies
'247 OXFORD STREET'	TH	2	0	17 dB(A)	A	Complies
'247 OXFORD STREET'	TH	1	0	11 dB(A)	A	Complies
'230 MOORE PARK ROAD'	C	1	0	50 dB(A)	A	Complies
'252 MOORE PARK ROAD'	RES	3	3	51 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	2	3	50 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	1	3	47 dB(A)	A	Complies (Bgn + 5)
'230 MOORE PARK ROAD'	C	1	0	45 dB(A)	A	Complies
'255 OXFORD STREET'	RES	4	4	36 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	3	4	36 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	3	3	50 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'246 MOORE PARK ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'250 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'251-255 OXFORD STREET'	PR	2	0	33 dB(A)	A	Complies
'251-255 OXFORD STREET'	PR	1	0	28 dB(A)	A	Complies
'257 OXFORD STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	3	3	49 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	48 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	3	3	50 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	3	3	48 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'267 OXFORD STREET'	RES	1	2	21 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	48 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'24 MOORE PARK ROAD'	RES	2	2	28 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	28 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	3	4	39 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	4	4	38 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	3	4	39 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'27 WALTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'27 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	3	5	25 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'28 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'29 GORDON STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'28 RENNY STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'28 MOORE PARK ROAD'	RES	1	2	27 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	4	5	21 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	19 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'30-38 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	4	4	40 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	2	4	45 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	1	4	45 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	3	3	31 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	3	4	32 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'50 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	3	5	26 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'53 MOORE PARK ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	3	4	36 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	3	4	36 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'52 LANG ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	8	5	24 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	7	5	21 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	6	5	21 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	5	5	11 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	4	5	11 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'54 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	3	5	27 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'54 LEINSTER STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'54 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'54 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'56 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	4	4	33 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'56 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'56 RENNY STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	2	3	51 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	1	3	49 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	7	5	13 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	6	5	10 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	5	5	10 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	4	5	11 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'280 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	3	3	46 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	45 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'292 MOORE PARK ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	1	3	43 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	3	3	45 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	2	3	45 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	3	3	48 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	48 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'345-347 OXFORD STREET'	C	3	0	22 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'358 MOORE PARK ROAD'	RES	3	3	37 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'354 SOUTH DOWLING STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'360 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'349-351 OXFORD STREET'	C	3	0	17 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	2	0	17 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	1	0	17 dB(A)	A	Complies
'360 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	5	4	32 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	4	4	28 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	2	2	16 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	1	2	15 dB(A)	A	Complies (Bgn + 5)
'356 SOUTH DOWLING STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	3	2	22 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'372 SOUTH DOWLING STREET'	RES	2	2	22 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	3	2	21 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	1	2	18 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	4	2	12 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	3	2	21 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	1	2	19 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'360 SOUTH DOWLING STREET'	RES	1	2	17 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	3	2	21 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	3	2	21 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	2	2	21 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	3	2	21 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	1	2	19 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	2	2	15 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	1	2	15 dB(A)	A	Complies (Bgn + 5)
'384 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'388 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'387-389 OXFORD STREET'	C	3	0	21 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	2	0	19 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	1	0	18 dB(A)	A	Complies
'386 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'385 OXFORD STREET'	C	1	0	17 dB(A)	A	Complies
'390 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	E	1	0	10 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	9 dB(A)	A	Complies
'410 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	1	0	8 dB(A)	A	Complies
'398 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	2	0	6 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	7 dB(A)	A	Complies
'414 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'416 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	3	3	27 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	3	3	24 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	3	3	25 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	3	3	24 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'426 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	17 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	3	3	24 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'421 OXFORD STREET'	E	3	0	13 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	10 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	7 dB(A)	A	Complies
'421 OXFORD STREET'	E	3	0	14 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	12 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	11 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	5	0	22 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	4	0	21 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	3	0	19 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	14 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	11 dB(A)	A	Complies
'428 MOORE PARK ROAD'	RES	3	3	24 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	3	3	23 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	3	0	17 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	16 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	14 dB(A)	A	Complies
'436 MOORE PARK ROAD'	RES	3	3	24 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	4	2	12 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	3	2	13 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	2	2	13 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	1	2	13 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	3	3	23 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	3	3	12 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'438 MOORE PARK ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	3	3	23 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	7	2	24 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	6	2	23 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	5	2	23 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	4	2	20 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	3	2	20 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	2	2	23 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	1	2	23 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	2	0	13 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	11 dB(A)	A	Complies
'473 SOUTH DOWLING STREET'	RES	2	2	24 dB(A)	A	Complies (Bgn + 5)
'473 SOUTH DOWLING STREET'	RES	1	2	24 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'495 CLEVELAND STREET'	C	3	0	24 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	2	0	25 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	1	0	25 dB(A)	A	Complies
'477 SOUTH DOWLING STREET'	RES	4	2	24 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	3	2	24 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	2	2	24 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	1	2	24 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	5	1	25 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	4	1	25 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	5	2	24 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	4	2	24 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	3	2	24 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	2	2	24 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'479 SOUTH DOWLING STREET'	RES	1	2	24 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	2	2	24 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	1	2	24 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	3	1	31 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	2	1	31 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	1	1	31 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	3	1	26 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	2	1	31 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'83 LEINSTER STREET'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	8	5	11 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	7	5	11 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	6	5	11 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	5	5	11 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	4	5	12 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	3	5	25 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	3	3	25 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	3	4	34 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'83 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	5	3	38 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	4	3	38 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	3	3	38 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	3	3	27 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'84 GORDON STREET'	RES	1	3	17 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'84 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'87 PHELPS STREET'	RES	1	1	31 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'88 REGENT STREET'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'90 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'97 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	7	5	26 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	6	5	26 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	5	5	23 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	4	5	22 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	4	0	21 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	20 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	19 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	18 dB(A)	A	Complies
'104 LANG ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'107-111 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	5	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	8 dB(A)	A	Complies
'114 LANG ROAD'	C	3	0	10 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	10 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	10 dB(A)	A	Complies
'107-111 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'112 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'108 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'110 LANG ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	12 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	9 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	8 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'121-125 COOK ROAD'	RES	8	5	10 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	7	5	8 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	6	5	8 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	5	5	8 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	4	5	9 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	3	5	9 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	10 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	14 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	1	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	6 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	10 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	13 dB(A)	A	Complies
'119 LEINSTER STREET'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'119 LEINSTER STREET'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	2	1	31 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	1	1	31 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	2	1	31 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	2	1	30 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	18 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	15 dB(A)	A	Complies
'569 SOUTH DOWLING STREET'	RES	2	1	32 dB(A)	A	Complies (Bgn + 5)
'569 SOUTH DOWLING STREET'	RES	1	1	31 dB(A)	A	Complies (Bgn + 5)
'561 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	2	1	31 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	5 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	4 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	4 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	23 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	22 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	13 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	11 dB(A)	A	Complies
'575 SOUTH DOWLING STREET'	RES	2	1	31 dB(A)	A	Complies (Bgn + 5)
'575 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	1	0	23 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	19 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	20 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	18 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	16 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	25 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	24 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	24 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	23 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	25 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'560 CLEVELAND STREET'	E	3	0	25 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	25 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	24 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	23 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	22 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	22 dB(A)	A	Complies
'577 SOUTH DOWLING STREET'	RES	2	1	31 dB(A)	A	Complies (Bgn + 5)
'577 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	2	1	31 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	2	1	30 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	3	1	31 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	3	1	26 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	3	1	30 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	2	1	30 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	3	1	30 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	30 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	30 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	3	1	29 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	22 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	3	1	27 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'649 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	4	1	25 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'653 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	25 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	25 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'681 SOUTH DOWLING STREET'	C	2	0	24 dB(A)	A	Complies
'681 SOUTH DOWLING STREET'	C	1	0	24 dB(A)	A	Complies
'691 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	2	1	22 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	2	1	24 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	2	1	22 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	3	1	23 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	2	1	22 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	4	1	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'711 SOUTH DOWLING STREET'	RES	3	1	23 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	2	1	22 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	2	1	22 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	2	1	22 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	2	1	22 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	2	1	22 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'717 SOUTH DOWLING STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'721 SOUTH DOWLING STREET'	RES	1	1	20 dB(A)	A	Complies (Bgn + 5)
'Site Office'	C	1	0	30 dB(A)	A	Complies
'Site Office'	C	1	0	30 dB(A)	A	Complies
'294 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	35 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	3	3	44 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	2	3	43 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	3	3	46 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	2	3	45 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'308 MOORE PARK ROAD'	C	5	0	44 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	4	0	44 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	3	0	43 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	2	0	43 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	1	0	43 dB(A)	A	Complies
'302 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	3	3	42 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	3	3	44 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'306 MOORE PARK ROAD'	RES	2	3	44 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	1	3	43 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	2	3	37 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'336 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	3	3	34 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	3	3	35 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	6	4	34 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	5	4	32 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	4	4	32 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'342 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'340 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'338 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'352 MOORE PARK ROAD'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	2	3	30 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	3	3	33 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)

Table A-5: Roof finishes

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1-5 COOK ROAD'	RES	8	5	17 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	7	5	15 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	6	5	14 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	5	5	5 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	4	5	5 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	3	5	4 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
' 335203 6248625'	AR	2	0	8 dB(A)	A	Complies
' 335203 6248625'	AR	1	0	8 dB(A)	A	Complies
'2 COOK ROAD'	RES	7	5	20 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	6	5	17 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	5	5	12 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	4	5	12 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	3	5	17 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
' 335206 6248642'	AR	1	0	8 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1 DRIVER AVENUE'	C	3	0	3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	-3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	-3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	-3 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	2 dB(A)	A	Complies
'1 MARTIN STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	14 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	14 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	14 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	13 dB(A)	A	Complies
'1 FURBER ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	6 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	5 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	5 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	5 dB(A)	A	Complies
'1 MITCHELL STREET'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'1 MITCHELL STREET'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	3	4	16 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	-2 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	-1 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	1 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	3	3	13 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'3 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'2 ANZAC PARADE'	C	1	0	20 dB(A)	A	Complies
'3 LITTLE STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'3 LITTLE STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'2 IRIS STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'3 CHURCH STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'2 OATLEY ROAD'	C	2	0	29 dB(A)	A	Complies
'2 OATLEY ROAD'	C	1	0	28 dB(A)	A	Complies
'2 MARTIN ROAD'	RES	2	6	-3 dB(A)	A	Complies (Bgn + 5)
'2 MARTIN ROAD'	RES	1	6	-3 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'3 POATE ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'12 LEINSTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	2	4	3 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'12 SEYMOUR PLACE'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	4	4	17 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	3	4	16 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'13 POATE ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	3	5	6 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'14 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'15 CHURCH STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	3	4	1 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	2	4	1 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	2	4	3 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	2	2	21 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	1	2	21 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'18 BENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	2	4	3 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'18 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	0 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	4	5	9 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'20-22 LEINSTER STREET'	PoW	2	0	9 dB(A)	A	Complies
'20-22 LEINSTER STREET'	PoW	1	0	7 dB(A)	A	Complies
'19 CENTENNIAL LANE'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'19 CENTENNIAL LANE'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'19 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	2	4	3 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	2	4	0 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	1	4	0 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'20 SELWYN STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'21 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'22 WALTER STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	2	5	8 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	3	5	4 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	3	5	6 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'24 LEINSTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'24 GORDON STREET'	C	4	0	14 dB(A)	A	Complies
'24 GORDON STREET'	C	3	0	13 dB(A)	A	Complies
'24 GORDON STREET'	C	2	0	11 dB(A)	A	Complies
'24 GORDON STREET'	C	1	0	10 dB(A)	A	Complies
'24 COOK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'24 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'24 CHURCH STREET'	RES	1	4	-1 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	2	4	1 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	1	4	1 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'24 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	21 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	21 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'38 WALTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	8	5	2 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	7	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	6	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	5	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	4	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	3	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'39 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'40-42 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'40 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	8	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	2 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	2 dB(A)	A	Complies
'40 COOK ROAD'	RES	3	5	0 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	4	0	7 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	7 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	7 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	7 dB(A)	A	Complies
'41 ALBION AVENUE'	RES	3	4	4 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	E	2	0	-6 dB(A)	A	Complies
'40 DRIVER AVENUE'	E	1	0	-6 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	11	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	10	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	9	0	8 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	8	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	10 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	2	0	28 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	1	0	28 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	9 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'40 DRIVER AVENUE'	AR	2	0	9 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	9 dB(A)	A	Complies
'40 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	C	1	0	30 dB(A)	A	Complies
'40 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	3	5	1 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'42 LEINSTER STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	3	4	4 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'42 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'42 SELWYN STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'43 GREENS ROAD'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'43 MOORE PARK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'44 LEINSTER STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	3	5	1 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	E	11	0	25 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	10	0	25 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	9	0	25 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	8	0	25 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	7	0	25 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	6	0	25 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	5	0	25 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	4	0	25 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	3	0	25 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	2	0	6 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	1	0	7 dB(A)	A	Complies
'44 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	C	5	0	23 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	4	0	23 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	3	0	13 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	2	0	13 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	1	0	13 dB(A)	A	Complies
'46 GORDON STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'46 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'44 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'45 OATLEY ROAD'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	3	4	2 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'46 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'46 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	3	4	3 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'47 COOK ROAD'	RES	3	5	2 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	4	4	24 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	3	4	21 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'3 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'4 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'4 FURBER ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'5 STEWART PLACE'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	4	4	25 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	2	4	3 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'5 FURBER ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	3	4	-1 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	2	4	0 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	1	4	0 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'5 RENNY STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'6 CHAPMAN STREET'	C	3	0	18 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	2	0	16 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	1	0	13 dB(A)	A	Complies
'6 CHURCH STREET'	RES	1	4	1 dB(A)	A	Complies (Bgn + 5)
'6 FURBER ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	2	4	0 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	1	4	0 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'7-17 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'7 POATE ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'8 FURBER ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'8 ALEXANDER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	3	4	2 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'8 IRIS STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'8 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'8 SEYMOUR PLACE'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'9 FURBER ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'9 STEWART STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'10-14 CHURCH STREET'	RES	1	4	1 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'10 IRIS STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	2	4	3 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'10 WALTER STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'11 FURBER ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'11 RENNY STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'12 FURBER ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	8	5	8 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	7	5	3 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	6	5	2 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	5	5	2 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	4	5	2 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	3	4	6 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'48 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	4	4	12 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	3	5	-2 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'56 SELWYN STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	3	4	21 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'59 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'57 SELWYN STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	6 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	2	4	3 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'65 STEWART STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'61 MOORE PARK ROAD'	CC	1	0	5 dB(A)	A	Complies
'62 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'62 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'61 SELWYN STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	2	4	-1 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	1	4	-1 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	2	5	-3 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	1	5	-3 dB(A)	A	Complies (Bgn + 5)
'63 MOORE PARK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	2	4	3 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	3	3	17 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	2	3	16 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'67 REGENT STREET'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	8	5	-2 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	7	5	9 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	6	5	8 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'69-75 COOK ROAD'	RES	5	5	7 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	4	5	6 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	3	5	0 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'68 GORDON STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	3	3	17 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	2	3	16 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'70 REGENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'69-73 MOORE PARK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'70 COOK ROAD'	RES	1	5	7 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'72 GORDON STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'74 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	2	5	-3 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	1	5	-3 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	3	0	6 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	6 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	5 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'74 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	16 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	16 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	5 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	25 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	6 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	6 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	7 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	6 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	13 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	12 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	7 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	8 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	8 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	16 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	15 dB(A)	A	Complies
'83 STEWART STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	9 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	9 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	10 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	3 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	4 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	14 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	16 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	16 dB(A)	A	Complies
'81 STEWART STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'81 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	4 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	6 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	7 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	9 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	9 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	11 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	6 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	6 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	11 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	16 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	15 dB(A)	A	Complies
'33 BENT STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	3	4	21 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'31 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'30 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	2	2	9 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	1	2	9 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'31 RENNY STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'31 SELWYN STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	4	4	-1 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	3	4	-1 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	2	4	-1 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	1	4	0 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	1	1	12 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	3	3	13 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	3	2	4 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'32 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'33 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	4	4	-1 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	3	4	-1 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	2	4	-1 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	1	4	-1 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'33 SELWYN STREET'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'35 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	3	3	12 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	2	3	12 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'34 MOORE PARK ROAD'	C	1	0	8 dB(A)	A	Complies
'35 MOORE PARK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'36 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	2	4	0 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	1	4	0 dB(A)	A	Complies (Bgn + 5)
'37 BENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	3	3	12 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	2	3	9 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'37 GORDON STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'37 SELWYN STREET'	RES	1	4	3 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	13 dB(A)	A	Complies
'38 GORDON STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'38 GORDON STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	5 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	5 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	8 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	11 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	2	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	9 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	2 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	2 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	12 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	13 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	6 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	6 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	6 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	6 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	6 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	6 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	3 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	18 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	15 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	15 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	6 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	4 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	10 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	8 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	30 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	27 dB(A)	A	Complies
'38 STEWART STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	-2 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	-2 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	-1 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	8 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	13 dB(A)	A	Complies
'38 LEINSTER STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	23 dB(A)	A	Complies
'38 SELWYN STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'38 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'38 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	3 dB(A)	A	Complies
'77-83 COOK ROAD'	RES	7	5	1 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	6	5	0 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	5	5	-1 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'77-83 COOK ROAD'	RES	4	5	-1 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	3	5	0 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	1	0	17 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	8 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	10 dB(A)	A	Complies
'75 OXFORD STREET'	C	6	0	8 dB(A)	A	Complies
'75 OXFORD STREET'	C	5	0	7 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	7 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	7 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	7 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	7 dB(A)	A	Complies
'78 GORDON STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'78 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'76 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	18 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-3 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	-2 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	-2 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	3	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'133-139 COOK ROAD'	RES	3	5	-3 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	-4 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	-4 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	2	0	0 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	0 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	0 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-1 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	-2 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	-2 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	2	2	5 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	1	2	6 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	2	2	2 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	1	2	2 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'132 FLINDERS STREET'	RES	1	2	6 dB(A)	A	Complies (Bgn + 5)
'128 FLINDERS STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	3	2	2 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	2	2	2 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	1	2	2 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	4	5	-5 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	3	5	2 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	5 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	4	2	-2 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'158 FLINDERS STREET'	RES	3	2	-1 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	2	2	-1 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	5	2	-2 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	4	2	-1 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	3	2	-1 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	2	2	-1 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'153-155 COOK ROAD'	CC	3	0	-5 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	2	0	-1 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	1	0	0 dB(A)	A	Complies
'156 FLINDERS STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'156 FLINDERS STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	5	2	19 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	4	2	19 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	3	2	20 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	4	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	32 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	28 dB(A)	A	Complies
'159 COOK ROAD'	CC	1	0	0 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	30 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	26 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	36 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	36 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	29 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	30 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	26 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	33 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'228 MOORE PARK ROAD'	C	3	0	33 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	26 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	30 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	26 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	30 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	29 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	5	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	35 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	34 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	27 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	32 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	32 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	26 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	30 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	29 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	32 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	32 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	30 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	26 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	32 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	26 dB(A)	A	Complies
'234 MOORE PARK ROAD'	RES	3	3	44 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	3	0	32 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	26 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	42 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'244 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'236 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'247 OXFORD STREET'	TH	5	0	15 dB(A)	A	Complies
'247 OXFORD STREET'	TH	4	0	15 dB(A)	A	Complies
'247 OXFORD STREET'	TH	3	0	15 dB(A)	A	Complies
'247 OXFORD STREET'	TH	2	0	15 dB(A)	A	Complies
'247 OXFORD STREET'	TH	1	0	15 dB(A)	A	Complies
'230 MOORE PARK ROAD'	C	1	0	31 dB(A)	A	Complies
'252 MOORE PARK ROAD'	RES	3	3	44 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'230 MOORE PARK ROAD'	C	1	0	24 dB(A)	A	Complies
'255 OXFORD STREET'	RES	4	4	23 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	3	4	17 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	3	3	44 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'250 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'251-255 OXFORD STREET'	PR	2	0	8 dB(A)	A	Complies
'251-255 OXFORD STREET'	PR	1	0	7 dB(A)	A	Complies
'257 OXFORD STREET'	RES	3	4	15 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	3	3	42 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	3	3	43 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'270 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	3	3	41 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	37 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	2	4	4 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'267 OXFORD STREET'	RES	1	2	8 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	37 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	22 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	22 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	8 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	2	4	2 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'26 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	3	5	6 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	4	4	22 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	2	3	12 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'27 GORDON STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	2	4	-1 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	1	4	-1 dB(A)	A	Complies (Bgn + 5)
'28 WALTER STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'29 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'28 RENNY STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'28 MOORE PARK ROAD'	RES	1	2	9 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	3	4	20 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	2	4	-1 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	1	4	-1 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	3	4	10 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	3 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	3 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	4	5	5 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	4 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	4	4	24 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	3	4	16 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	3	3	13 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	2	3	12 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'51 GORDON STREET'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	2	5	5 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'50 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	3	5	6 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	3	4	21 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'52 LANG ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'53-55 COOK ROAD'	RES	8	5	11 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	7	5	1 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	6	5	-1 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	5	5	-1 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	4	5	-1 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	3	5	-1 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	4 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'54 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	3	5	5 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	3	5	7 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	2	5	7 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	1	5	6 dB(A)	A	Complies (Bgn + 5)
'54 LEINSTER STREET'	RES	1	4	6 dB(A)	A	Complies (Bgn + 5)
'54 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	3	4	16 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'56 REGENT STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	4	4	21 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	3	4	12 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	9 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'56 COOK ROAD'	RES	1	5	4 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'56 LANG ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'56 RENNY STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	7	5	-1 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	6	5	-2 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	5	5	-2 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	4	5	-2 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'280 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	3	3	38 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	3	3	37 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	3	4	10 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	3	3	40 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'345-347 OXFORD STREET'	C	3	0	9 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	2	0	8 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'345-347 OXFORD STREET'	C	1	0	8 dB(A)	A	Complies
'358 MOORE PARK ROAD'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'354 SOUTH DOWLING STREET'	RES	1	2	-2 dB(A)	A	Complies (Bgn + 5)
'360 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'349-351 OXFORD STREET'	C	3	0	7 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	2	0	7 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	1	0	7 dB(A)	A	Complies
'360 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	5	4	13 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	4	4	11 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	2	4	10 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	1	4	9 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	2	2	-3 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	1	2	-3 dB(A)	A	Complies (Bgn + 5)
'356 SOUTH DOWLING STREET'	RES	1	2	-3 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	2	3	11 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	3	2	4 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	2	2	4 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	3	2	-2 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	2	2	-2 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	1	2	-2 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	4	2	-1 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	3	2	-1 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	2	2	-1 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	2	3	9 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'360 SOUTH DOWLING STREET'	RES	1	2	1 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	3	2	1 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	2	2	1 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	1	2	2 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	3	2	2 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'374 SOUTH DOWLING STREET'	RES	2	2	3 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	3	2	2 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	2	2	2 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	11 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	2	2	2 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	1	2	2 dB(A)	A	Complies (Bgn + 5)
'384 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	7 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	2	3	8 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	1	3	7 dB(A)	A	Complies (Bgn + 5)
'388 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'387-389 OXFORD STREET'	C	3	0	9 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	2	0	9 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	1	0	10 dB(A)	A	Complies
'386 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'385 OXFORD STREET'	C	1	0	7 dB(A)	A	Complies
'390 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	2	3	7 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	1	3	7 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	10 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	7 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	7 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	6 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	6 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'395 OXFORD STREET'	E	1	0	-2 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	-1 dB(A)	A	Complies
'410 MOORE PARK ROAD'	RES	2	3	9 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	1	0	-2 dB(A)	A	Complies
'398 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	2	0	-3 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	-1 dB(A)	A	Complies
'414 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'416 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	3	3	11 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	9 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	3	3	6 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	2	3	5 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	1	3	6 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	3	3	8 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	2	3	7 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	1	3	7 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	8 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	3	3	5 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	2	3	5 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	1	3	5 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	4 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	4 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	3	3	7 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	2	3	6 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	1	3	6 dB(A)	A	Complies (Bgn + 5)
'421 OXFORD STREET'	E	3	0	-2 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	-4 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	-5 dB(A)	A	Complies
'421 OXFORD STREET'	E	3	0	4 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	2 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	0 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	5	0	3 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	4	0	2 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	3	0	0 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	-3 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'461-463 OXFORD STREET'	PoW	1	0	-5 dB(A)	A	Complies
'428 MOORE PARK ROAD'	RES	3	3	2 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	2	3	2 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	1	3	2 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	3	3	3 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	2	3	2 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	1	3	3 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	3	0	3 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	2 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	-1 dB(A)	A	Complies
'436 MOORE PARK ROAD'	RES	3	3	4 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	2	3	3 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	1	3	2 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	4	2	-2 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	3	2	-1 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	2	2	-1 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	3	3	2 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	2	3	1 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	1	3	1 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	3	3	2 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	2	3	2 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	1	3	1 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	3	3	5 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	2	3	4 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	1	3	3 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	7	2	16 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	6	2	15 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	5	2	7 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	4	2	1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	3	2	-1 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	2	2	-2 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	1	2	-2 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	2	0	-2 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	-4 dB(A)	A	Complies
'473 SOUTH DOWLING STREET'	RES	2	2	6 dB(A)	A	Complies (Bgn + 5)
'473 SOUTH DOWLING STREET'	RES	1	2	4 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	3	1	18 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'487 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	3	1	18 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'495 CLEVELAND STREET'	C	3	0	15 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	2	0	15 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	1	0	15 dB(A)	A	Complies
'477 SOUTH DOWLING STREET'	RES	4	2	3 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	3	2	2 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	2	2	1 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	1	2	0 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	5	1	17 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	4	1	18 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	3	1	18 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	1	1	12 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	5	2	4 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	4	2	3 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	3	2	1 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	2	2	0 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	1	2	-1 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	3	1	18 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	2	2	5 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	1	2	3 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	3	1	18 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	3	1	19 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	1	1	12 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	16 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	13 dB(A)	A	Complies
'83 LEINSTER STREET'	RES	3	3	16 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'83 LEINSTER STREET'	RES	2	3	15 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	1	3	15 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	8	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	7	5	-1 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	6	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	5	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	4	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	3	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	3	3	7 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	2	3	7 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	1	3	6 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	2	3	7 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	1	3	6 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	3	4	1 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	2	4	1 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	1	4	2 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	5	3	29 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	4	3	28 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	3	3	25 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'85 STEWART STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	3	3	8 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	2	3	8 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	1	3	7 dB(A)	A	Complies (Bgn + 5)
'84 GORDON STREET'	RES	1	3	1 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	3	3	18 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	2	3	16 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'84 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'87 PHELPS STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	11 dB(A)	A	Complies (Bgn + 5)
'88 REGENT STREET'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	2	5	-4 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'97 STEWART STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	2	4	12 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	2	5	4 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	1	5	3 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	7	5	15 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	6	5	15 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	5	5	13 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	4	5	11 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	3	5	8 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	2	5	6 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	2	4	7 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'91 GREENS ROAD'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	10 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	2	5	0 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	2	5	-1 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	2	4	5 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	1	4	5 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	2 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	4	0	8 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'104 LANG ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	-2 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	5	0	-4 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-3 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-3 dB(A)	A	Complies
'114 LANG ROAD'	C	3	0	-3 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	-2 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	0 dB(A)	A	Complies
'107-111 COOK ROAD'	RES	2	5	1 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	0 dB(A)	A	Complies (Bgn + 5)
'112 LANG ROAD'	RES	1	5	-1 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'108 LANG ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	2 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	1 dB(A)	A	Complies (Bgn + 5)
'110 LANG ROAD'	RES	1	5	-5 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	2 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	-4 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	-5 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	-1 dB(A)	A	Complies
'121-125 COOK ROAD'	RES	8	5	-2 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	7	5	-4 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	6	5	-4 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	5	5	-4 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	4	5	-4 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	3	5	-4 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	2	5	-4 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	1	5	-2 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	0 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	-1 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	-6 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	-5 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	-5 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	6 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	5 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	3 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	-1 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	1 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	2 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	6 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	4 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	4 dB(A)	A	Complies
'119 LEINSTER STREET'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'119 LEINSTER STREET'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	2	3	10 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	1	3	9 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	2	1	17 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	2	1	9 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	1	1	8 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	10 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	3 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	-3 dB(A)	A	Complies
'569 SOUTH DOWLING STREET'	RES	2	1	9 dB(A)	A	Complies (Bgn + 5)
'569 SOUTH DOWLING STREET'	RES	1	1	9 dB(A)	A	Complies (Bgn + 5)
'561 SOUTH DOWLING STREET'	RES	1	1	13 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'571 SOUTH DOWLING STREET'	RES	2	1	9 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	1	1	9 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	-1 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	-2 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	-4 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	11 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	11 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	0 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	-2 dB(A)	A	Complies
'575 SOUTH DOWLING STREET'	RES	2	1	9 dB(A)	A	Complies (Bgn + 5)
'575 SOUTH DOWLING STREET'	RES	1	1	8 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	1	0	7 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	9 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	9 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	6 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	2 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	9 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	9 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	9 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	9 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	10 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	10 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	10 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	11 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	8 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	8 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	8 dB(A)	A	Complies
'577 SOUTH DOWLING STREET'	RES	2	1	9 dB(A)	A	Complies (Bgn + 5)
'577 SOUTH DOWLING STREET'	RES	1	1	8 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	2	1	9 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	1	1	8 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	2	1	9 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	1	1	8 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	3	1	10 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	2	1	10 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	1	1	9 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'645 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	3	1	8 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	2	1	1 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	3	1	8 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	7 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	7 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	3	1	8 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	2	1	7 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	1	1	7 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	7 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	7 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	3	1	8 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	2	1	8 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	1	1	1 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	4	1	15 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	1	1	15 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'653 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'665 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	16 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	16 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	16 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	1	1	15 dB(A)	A	Complies (Bgn + 5)
'681 SOUTH DOWLING STREET'	C	2	0	15 dB(A)	A	Complies
'681 SOUTH DOWLING STREET'	C	1	0	15 dB(A)	A	Complies
'691 SOUTH DOWLING STREET'	RES	1	1	15 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	2	1	15 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	1	1	15 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	3	1	9 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	2	1	8 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	1	1	6 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	4	1	11 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	3	1	9 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	2	1	8 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	1	1	6 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	2	1	14 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	1	1	14 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	2	1	8 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	1	1	7 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	2	1	8 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	1	1	6 dB(A)	A	Complies (Bgn + 5)
'717 SOUTH DOWLING STREET'	RES	1	1	6 dB(A)	A	Complies (Bgn + 5)
'721 SOUTH DOWLING STREET'	RES	1	1	6 dB(A)	A	Complies (Bgn + 5)
'Site Office'	C	1	0	25 dB(A)	A	Complies
'Site Office'	C	1	0	25 dB(A)	A	Complies
'294 MOORE PARK ROAD'	RES	1	3	36 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'296 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	3	3	36 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	3	3	37 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'308 MOORE PARK ROAD'	C	5	0	35 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	4	0	35 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	3	0	35 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	2	0	35 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	1	0	31 dB(A)	A	Complies
'302 MOORE PARK ROAD'	RES	2	3	38 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	3	3	34 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	3	3	37 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'336 MOORE PARK ROAD'	RES	1	3	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'332-334 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	3	3	31 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	6	4	20 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	5	4	12 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	4	4	11 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	3	4	9 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	2	4	8 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	1	4	7 dB(A)	A	Complies (Bgn + 5)
'342 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'340 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'338 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	1	3	28 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	3	3	24 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)

Table A-6: Pitch works

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1-5 COOK ROAD'	RES	8	5	29 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	7	5	28 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	6	5	28 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	5	5	19 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	4	5	19 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1-5 COOK ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'1-5 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'1 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'1 STEWART PLACE'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
' 335203 6248625'	AR	2	0	31 dB(A)	A	Complies
' 335203 6248625'	AR	1	0	31 dB(A)	A	Complies
'2 COOK ROAD'	RES	7	5	30 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	6	5	30 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	5	5	21 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	4	5	23 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'2 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
' 335206 6248642'	AR	1	0	20 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	15 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	15 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	15 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	3	0	9 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	2	0	10 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	10 dB(A)	A	Complies
'1 DRIVER AVENUE'	C	1	0	15 dB(A)	A	Complies
'1 MARTIN STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	27 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	25 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	23 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	22 dB(A)	A	Complies
'1 FURBER ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'1 NEWCOMBE STREET'	C	4	0	20 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	3	0	17 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	2	0	16 dB(A)	A	Complies
'1 NEWCOMBE STREET'	C	1	0	16 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'1 MITCHELL STREET'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'1 MITCHELL STREET'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'1 RENNY STREET'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'1 SEYMOUR PLACE'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	3	4	43 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'1 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	2	4	38 dB(A)	A	Complies (Bgn + 5)
'1 OATLEY ROAD'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'2 BENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'2 RENNY LANE'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'2 CHURCH STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	3	3	25 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'3 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'3 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'2 ANZAC PARADE'	C	1	0	33 dB(A)	A	Complies
'3 LITTLE STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'3 LITTLE STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'2 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'2 IRIS STREET'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'3 CHURCH STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'2 OATLEY ROAD'	C	2	0	40 dB(A)	A	Complies
'2 OATLEY ROAD'	C	1	0	40 dB(A)	A	Complies
'2 MARTIN ROAD'	RES	2	6	9 dB(A)	A	Complies (Bgn + 5)
'2 MARTIN ROAD'	RES	1	6	9 dB(A)	A	Complies (Bgn + 5)
'3 OATLEY ROAD'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'3 OATLEY ROAD'	RES	1	4	38 dB(A)	A	Complies (Bgn + 5)
'3 POATE ROAD'	RES	1	5	26 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'4 CHURCH STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'12 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'13 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	26 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'13 MARTIN STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'12 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'12 LANG ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'12 SEYMOUR PLACE'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'13 ALBION AVENUE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'13 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'13 FURBER ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	4	4	32 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	3	4	32 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'13 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'15 ALBION AVENUE'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'15 ALBION AVENUE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	3	4	32 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'15 WALTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'15 BENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'13 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'13 OATLEY ROAD'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'14 ALEXANDER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	3	5	19 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'14 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'15 GORDON STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'14 RENNY STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'14 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'15 CHURCH STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	3	4	42 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'15 OATLEY ROAD'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	2	5	31 dB(A)	A	Complies (Bgn + 5)
'15 POATE ROAD'	RES	1	5	30 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'15 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	2	5	24 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'16 SELWYN STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'16 ALEXANDER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'16 RENNY STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'15 JOSEPHSON STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'15 JOSEPHSON STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'17 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'16 WALTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'16 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'19 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	2	2	34 dB(A)	A	Complies (Bgn + 5)
'16 MOORE PARK ROAD'	RES	1	2	34 dB(A)	A	Complies (Bgn + 5)
'17 MOORE PARK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'17 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'17 OATLEY ROAD'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'18 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'17 STEWART STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'18 FURBER ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'19 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'17 POATE ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'18 SELWYN STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'18 REGENT STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'18 LANG ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'18 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'19 OATLEY ROAD'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'19 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'19 ALBION AVENUE'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	4	5	21 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'20-22 LEINSTER STREET'	PoW	2	0	25 dB(A)	A	Complies
'20-22 LEINSTER STREET'	PoW	1	0	22 dB(A)	A	Complies
'19 CENTENNIAL LANE'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'19 CENTENNIAL LANE'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'19 JOSEPHSON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	2	5	29 dB(A)	A	Complies (Bgn + 5)
'19 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'21 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'20 ALEXANDER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'19 WALTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	3	5	23 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'20 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'21-23 ALBION AVENUE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'20 CHURCH STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'22 BENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'21 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'21 OATLEY ROAD'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'20 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'20 SELWYN STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'20 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'21 JOSEPHSON STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'21 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'23 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'21 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'22 ALEXANDER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'21 POATE ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'23 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'23 MARTIN STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'22 FURBER ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'22 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	3	5	17 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'22 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'23 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'23 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'22 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'22 RENNY STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'25 BENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	3	4	41 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'23 OATLEY ROAD'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	3	5	24 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	2	5	27 dB(A)	A	Complies (Bgn + 5)
'23 POATE ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'24 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'23 WALTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'24 GORDON STREET'	C	4	0	32 dB(A)	A	Complies
'24 GORDON STREET'	C	3	0	28 dB(A)	A	Complies
'24 GORDON STREET'	C	2	0	25 dB(A)	A	Complies
'24 GORDON STREET'	C	1	0	23 dB(A)	A	Complies
'24 COOK ROAD'	RES	3	5	17 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'24 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'24 CHURCH STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'25 ALBION AVENUE'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'27 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'24 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	34 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	34 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'38 WALTER STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'39 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'39 REGENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'39 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	8	5	25 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	7	5	25 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	6	5	24 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	5	5	20 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	4	5	20 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'39-43 COOK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'41 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'39 GREENS ROAD'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'39 OATLEY ROAD'	RES	1	4	42 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'40 WALTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'39 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'40-42 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'40 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'41 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	8	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	14 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	15 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	15 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	15 dB(A)	A	Complies
'40 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'40 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	AR	4	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	19 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	20 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'40 DRIVER AVENUE'	AR	1	0	20 dB(A)	A	Complies
'41 ALBION AVENUE'	RES	3	4	14 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'41 ALBION AVENUE'	RES	1	4	14 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	E	2	0	7 dB(A)	A	Complies
'40 DRIVER AVENUE'	E	1	0	6 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	11	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	10	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	9	0	20 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	8	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	7	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	6	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	5	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	2	0	41 dB(A)	A	Complies
'40 DRIVER AVENUE'	C	1	0	40 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	4	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	3	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	2	0	22 dB(A)	A	Complies
'40 DRIVER AVENUE'	AR	1	0	22 dB(A)	A	Complies
'40 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'40 DRIVER AVENUE'	C	1	0	42 dB(A)	A	Complies
'40 SELWYN STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'42 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'41 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'41 GREENS ROAD'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'41 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'41 OATLEY ROAD'	RES	1	4	42 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'43 REGENT STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'43 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	2	4	20 dB(A)	A	Complies (Bgn + 5)
'41 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'42 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'42 LEINSTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'43 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	3	4	13 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'43 ALBION AVENUE'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'42 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'44 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'42 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'43 GREENS ROAD'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'43 MOORE PARK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'45 BENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'44 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'45 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	3	5	14 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'44 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'44 WALTER STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	E	11	0	43 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	10	0	43 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	9	0	43 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	8	0	43 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	7	0	43 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'44 DRIVER AVENUE'	E	6	0	43 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	5	0	43 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	4	0	42 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	3	0	38 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	2	0	38 dB(A)	A	Complies
'44 DRIVER AVENUE'	E	1	0	36 dB(A)	A	Complies
'44 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'44 DRIVER AVENUE'	C	5	0	42 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	4	0	27 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	3	0	26 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	2	0	26 dB(A)	A	Complies
'44 DRIVER AVENUE'	C	1	0	26 dB(A)	A	Complies
'46 GORDON STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'46 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'44 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'46 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'45 GORDON STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'45 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	3	4	29 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'45 OATLEY ROAD'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'47 BENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'45 COOK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'45 GREENS ROAD'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'46 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'46 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'47 ALBION AVENUE'	RES	3	4	19 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'47 ALBION AVENUE'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'46 RENNY STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'46 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'46 WALTER STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'47 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'46 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'47 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	3	4	18 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'47 GREENS ROAD'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	3	5	21 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	2	5	20 dB(A)	A	Complies (Bgn + 5)
'47 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'47 MOORE PARK ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	4	4	41 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	2	4	44 dB(A)	A	Complies (Bgn + 5)
'47 OATLEY ROAD'	RES	1	4	43 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'48 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'3 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'3 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'4 BENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'4 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'4 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'4 FURBER ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'4 LANG ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'4 WALTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'5-7 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'4 RENNY LANE'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	3	4	39 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'6 LEINSTER STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'5 STEWART PLACE'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'5 MOORE PARK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	4	4	38 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'8 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'5 IRIS STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'5 FURBER ROAD'	RES	1	5	27 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'5 WALTER STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'6 SELWYN STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	32 dB(A)	A	Complies (Bgn + 5)
'5 RENNY STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'6 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'6 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'5 POATE ROAD'	RES	1	5	31 dB(A)	A	Complies (Bgn + 5)
'6 CHAPMAN STREET'	C	3	0	30 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	2	0	28 dB(A)	A	Complies
'6 CHAPMAN STREET'	C	1	0	25 dB(A)	A	Complies
'6 CHURCH STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'6 FURBER ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'6 WALTER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'7 STEWART PLACE'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	3	4	37 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'7 REGENT STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'7 MOORE PARK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'7 ALBION AVENUE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'7-17 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'8 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	3	4	39 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'7 OATLEY ROAD'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'7 POATE ROAD'	RES	1	5	28 dB(A)	A	Complies (Bgn + 5)
'8 FURBER ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'10 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'8 ALEXANDER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	3	4	28 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'8 SELWYN STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'9 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'9 BENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'9 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'8 IRIS STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'8 LANG ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'8 WALTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'8 SEYMOUR PLACE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'9 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'9 FURBER ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'9 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'10 ALEXANDER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'9 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'9 POATE ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'10 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'10-14 CHURCH STREET'	RES	1	4	16 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'10 IRIS STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'11 ALBION AVENUE'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'11 BENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'11 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	3	5	26 dB(A)	A	Complies (Bgn + 5)
'10 LANG ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'10 LANG ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'10 WALTER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	3	4	32 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'11 WALTER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'11 STEWART PLACE'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'11 FURBER ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'12 BENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'11 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	3	4	39 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	2	4	39 dB(A)	A	Complies (Bgn + 5)
'11 OATLEY ROAD'	RES	1	4	39 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'11 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	2	4	37 dB(A)	A	Complies (Bgn + 5)
'11 RENNY STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'11 POATE ROAD'	RES	1	5	29 dB(A)	A	Complies (Bgn + 5)
'12 FURBER ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'12 ALEXANDER STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'48 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'49-51 STEWART STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'48 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'48 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	8	5	25 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	7	5	19 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	6	5	15 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	5	5	13 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	4	5	12 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'49-51 COOK ROAD'	RES	3	5	26 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'49-51 COOK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'49 GORDON STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'48 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	2	4	15 dB(A)	A	Complies (Bgn + 5)
'49 ALBION AVENUE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	4	4	26 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'56 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'59 REGENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'57 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	3	4	38 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	3	5	29 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	2	5	27 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'58-60 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'58 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	3	5	25 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'59 MOORE PARK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'58 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'58 COOK ROAD'	RES	1	5	31 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'59 MOORE PARK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'60 STEWART STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'61 REGENT STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'63 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	3	5	30 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	2	5	30 dB(A)	A	Complies (Bgn + 5)
'60-62 COOK ROAD'	RES	1	5	29 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'62 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'61 IRIS STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'65 STEWART STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'61 MOORE PARK ROAD'	CC	1	0	17 dB(A)	A	Complies
'62 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'62 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'61 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'63-65 SELWYN STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'62 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'63 MOORE PARK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	2	4	18 dB(A)	A	Complies (Bgn + 5)
'62 SELWYN STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'64 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'66 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'66 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'67 STEWART STREET'	RES	1	4	33 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'64 LANG ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)
'65 MOORE PARK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'69 STEWART STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'71 LEINSTER STREET'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'68 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'67 REGENT STREET'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	2	5	25 dB(A)	A	Complies (Bgn + 5)
'66 COOK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	8	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	7	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	6	5	10 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	5	5	11 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	4	5	11 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'69-75 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	3	5	14 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'68 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	3	4	31 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'73 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'68 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	3	3	29 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'75 LEINSTER STREET'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'70 REGENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'68 LANG ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'68 LANG ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'69-73 MOORE PARK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'69 MOORE PARK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	2	4	42 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	35 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	22 dB(A)	A	Complies (Bgn + 5)
'70-78 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'71 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'70 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'77 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'72 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'74 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'76 REGENT STREET'	RES	1	4	37 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'72 LANG ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	18 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	40 dB(A)	A	Complies
'74 LANG ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	22 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	43 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	1	0	42 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	37 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'83 STEWART STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	3	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	33 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'81 STEWART STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'81 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	43 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	40 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	26 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	21 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	34 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	41 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	40 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	35 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	2	0	44 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	41 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	24 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	43 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	32 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	29 dB(A)	A	Complies
'33 BENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'30 ALEXANDER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	3	4	36 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'31 GORDON STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'30 WALTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	2	2	35 dB(A)	A	Complies (Bgn + 5)
'30 MOORE PARK ROAD'	RES	1	2	35 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'31-33 STEWART STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'32 LEINSTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'31 MOORE PARK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'31 WALTER STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'31 RENNY STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'35 BENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'31 SELWYN STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'32 RENNY STREET'	RES	1	4	36 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	3	5	15 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'32 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	4	4	25 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	3	4	25 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'33 ALBION AVENUE'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'32 MCELHONE PLACE'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	3	3	24 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'33 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	3	2	34 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	2	2	34 dB(A)	A	Complies (Bgn + 5)
'32 MOORE PARK ROAD'	RES	1	2	34 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'32 SELWYN STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'33 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	4	4	11 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	3	4	11 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	2	4	11 dB(A)	A	Complies (Bgn + 5)
'35 ALBION AVENUE'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'34 LEINSTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	2	4	40 dB(A)	A	Complies (Bgn + 5)
'33 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'34 GORDON STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'33 SELWYN STREET'	RES	1	4	13 dB(A)	A	Complies (Bgn + 5)
'35 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'35 REGENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'34 LANG ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	3	3	23 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'36 POATE LANE'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'34 LANG ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'36 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'34 MOORE PARK ROAD'	C	1	0	37 dB(A)	A	Complies
'35 MOORE PARK ROAD'	RES	1	5	24 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'36 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'35 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'36 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'37 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'36 WALTER STREET'	RES	1	4	31 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'36 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'37 ALBION AVENUE'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'37 BENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	3	3	23 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'37 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'37 GORDON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'37 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	2	4	41 dB(A)	A	Complies (Bgn + 5)
'37 OATLEY ROAD'	RES	1	4	41 dB(A)	A	Complies (Bgn + 5)
'37 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	25 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	2	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	25 dB(A)	A	Complies
'38 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'38 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	45 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	45 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	45 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	45 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	45 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	41 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	27 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	27 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	27 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	34 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	27 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	37 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	36 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	21 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	20 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	47 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	43 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	6	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	16 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	C	1	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	22 dB(A)	A	Complies
'38 DRIVER AVENUE'	AR	1	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	16 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	47 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	47 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	47 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	47 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	47 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	31 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	19 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	17 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	29 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	25 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	23 dB(A)	A	Complies
'38 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	3	0	28 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	28 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	28 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	5	0	33 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	32 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	23 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	11 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	24 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	4	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	3	0	35 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	2	0	27 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	22 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'38 DRIVER AVENUE'	AR	1	0	30 dB(A)	A	Complies
'38 LEINSTER STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'38 STEWART STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'38 DRIVER AVENUE'	C	2	0	37 dB(A)	A	Complies
'38 DRIVER AVENUE'	C	1	0	35 dB(A)	A	Complies
'38 SELWYN STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'38 SELWYN STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	3	5	25 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	2	5	23 dB(A)	A	Complies (Bgn + 5)
'39 MOORE PARK ROAD'	RES	1	5	23 dB(A)	A	Complies (Bgn + 5)
'39 BENT STREET'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'38 LANG ROAD'	RES	1	5	25 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	31 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	29 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	28 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	32 dB(A)	A	Complies
'77-83 COOK ROAD'	RES	7	5	14 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	6	5	12 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	5	5	11 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	4	5	11 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	3	5	11 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'77-83 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	1	0	35 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	36 dB(A)	A	Complies
'75 OXFORD STREET'	C	6	0	23 dB(A)	A	Complies
'75 OXFORD STREET'	C	5	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	4	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	3	0	18 dB(A)	A	Complies
'75 OXFORD STREET'	C	2	0	19 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'78 GORDON STREET'	RES	2	4	19 dB(A)	A	Complies (Bgn + 5)
'78 GORDON STREET'	RES	1	4	17 dB(A)	A	Complies (Bgn + 5)
'76 GORDON STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	4	0	33 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'75 OXFORD STREET'	C	3	0	32 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	20 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	18 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	9 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	13 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	3	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	18 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	18 dB(A)	A	Complies
'133-139 COOK ROAD'	RES	3	5	10 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	2	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'126 FLINDERS STREET'	RES	2	2	10 dB(A)	A	Complies (Bgn + 5)
'126 FLINDERS STREET'	RES	1	2	10 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	9 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	2	2	21 dB(A)	A	Complies (Bgn + 5)
'136 FLINDERS STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	2	2	15 dB(A)	A	Complies (Bgn + 5)
'130 FLINDERS STREET'	RES	1	2	14 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'133-139 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'133-139 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'127-131 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'132 FLINDERS STREET'	RES	1	2	18 dB(A)	A	Complies (Bgn + 5)
'128 FLINDERS STREET'	RES	1	2	18 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	3	2	19 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	2	2	18 dB(A)	A	Complies (Bgn + 5)
'146 FLINDERS STREET'	RES	1	2	17 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	4	5	8 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'149-151 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'140 FLINDERS STREET'	RES	1	2	19 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'141-147 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	4	2	12 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	3	2	12 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	2	2	12 dB(A)	A	Complies (Bgn + 5)
'158 FLINDERS STREET'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	2	2	17 dB(A)	A	Complies (Bgn + 5)
'144 FLINDERS STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	2	2	19 dB(A)	A	Complies (Bgn + 5)
'150 FLINDERS STREET'	RES	1	2	18 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	5	2	13 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	4	2	12 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	3	2	12 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	2	2	13 dB(A)	A	Complies (Bgn + 5)
'160 FLINDERS STREET'	RES	1	2	13 dB(A)	A	Complies (Bgn + 5)
'153-155 COOK ROAD'	CC	3	0	8 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	2	0	13 dB(A)	A	Complies
'153-155 COOK ROAD'	CC	1	0	13 dB(A)	A	Complies
'156 FLINDERS STREET'	RES	2	2	18 dB(A)	A	Complies (Bgn + 5)
'156 FLINDERS STREET'	RES	1	2	17 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'162 FLINDERS STREET'	RES	5	2	32 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	4	2	33 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	3	2	33 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	2	2	33 dB(A)	A	Complies (Bgn + 5)
'162 FLINDERS STREET'	RES	1	2	33 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	4	0	49 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	46 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	46 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	43 dB(A)	A	Complies
'159 COOK ROAD'	CC	1	0	11 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	29 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	28 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	28 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	48 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	47 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	47 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	28 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	28 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	28 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	43 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	28 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	27 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	27 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	31 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	30 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	29 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	29 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	5	0	50 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	49 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	45 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	42 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'228 MOORE PARK ROAD'	C	4	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	43 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	43 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	29 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	28 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	28 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	4	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	43 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	42 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	3	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	43 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	43 dB(A)	A	Complies
'234 MOORE PARK ROAD'	RES	3	3	53 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	2	3	50 dB(A)	A	Complies (Bgn + 5)
'234 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'228 MOORE PARK ROAD'	C	3	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	2	0	44 dB(A)	A	Complies
'228 MOORE PARK ROAD'	C	1	0	43 dB(A)	A	Complies
'244 MOORE PARK ROAD'	RES	2	3	51 dB(A)	A	Complies (Bgn + 5)
'244 MOORE PARK ROAD'	RES	1	3	48 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)
'238 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'236 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'247 OXFORD STREET'	TH	5	0	30 dB(A)	A	Complies
'247 OXFORD STREET'	TH	4	0	29 dB(A)	A	Complies
'247 OXFORD STREET'	TH	3	0	27 dB(A)	A	Complies
'247 OXFORD STREET'	TH	2	0	27 dB(A)	A	Complies
'247 OXFORD STREET'	TH	1	0	27 dB(A)	A	Complies
'230 MOORE PARK ROAD'	C	1	0	46 dB(A)	A	Complies
'252 MOORE PARK ROAD'	RES	3	3	52 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	2	3	51 dB(A)	A	Complies (Bgn + 5)
'252 MOORE PARK ROAD'	RES	1	3	47 dB(A)	A	Complies (Bgn + 5)
'230 MOORE PARK ROAD'	C	1	0	35 dB(A)	A	Complies
'255 OXFORD STREET'	RES	4	4	37 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'255 OXFORD STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'255 OXFORD STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	3	3	52 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)
'248-250 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'246 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'250 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'256 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'251-255 OXFORD STREET'	PR	2	0	23 dB(A)	A	Complies
'251-255 OXFORD STREET'	PR	1	0	21 dB(A)	A	Complies
'257 OXFORD STREET'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'257 OXFORD STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	3	3	51 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	51 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	3	3	52 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	2	3	51 dB(A)	A	Complies (Bgn + 5)
'258 MOORE PARK ROAD'	RES	1	3	47 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	2	3	41 dB(A)	A	Complies (Bgn + 5)
'262 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'272 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	3	3	51 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	2	3	50 dB(A)	A	Complies (Bgn + 5)
'270 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)
'274 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	2	4	16 dB(A)	A	Complies (Bgn + 5)
'266 OXFORD STREET'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'278 MOORE PARK ROAD'	RES	1	3	34 dB(A)	A	Complies (Bgn + 5)
'267 OXFORD STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'284 MOORE PARK ROAD'	RES	1	3	47 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'25 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	2	2	34 dB(A)	A	Complies (Bgn + 5)
'24 MOORE PARK ROAD'	RES	1	2	34 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'25 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'25 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	3	4	40 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	2	4	36 dB(A)	A	Complies (Bgn + 5)
'25 OATLEY ROAD'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'25 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'26 LEINSTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	2	4	17 dB(A)	A	Complies (Bgn + 5)
'27 ALBION AVENUE'	RES	1	4	15 dB(A)	A	Complies (Bgn + 5)
'26 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	2	4	24 dB(A)	A	Complies (Bgn + 5)
'29 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	3	4	40 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	18 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	4	4	36 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	3	4	32 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'27 RENNY STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'27 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'27 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'27-35 COOK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'27 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'27 GORDON STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'28 LEINSTER STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	2	4	42 dB(A)	A	Complies (Bgn + 5)
'27 OATLEY ROAD'	RES	1	4	43 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	2	4	35 dB(A)	A	Complies (Bgn + 5)
'28 ALEXANDER STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	3	5	22 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'28 COOK ROAD'	RES	1	5	18 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	2	4	14 dB(A)	A	Complies (Bgn + 5)
'29 ALBION AVENUE'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'28 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'29 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'29 GORDON STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'28 RENNY STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'29 WALTER STREET'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'28 MOORE PARK ROAD'	RES	1	2	26 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	3	4	35 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	2	4	31 dB(A)	A	Complies (Bgn + 5)
'30 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	2	4	13 dB(A)	A	Complies (Bgn + 5)
'29 SELWYN STREET'	RES	1	4	12 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'30 LEINSTER STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	3	4	22 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'31 BENT STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	13 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	13 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'30-38 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	4	5	18 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	3	5	17 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'30-38 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	4	4	39 dB(A)	A	Complies (Bgn + 5)
'33 BENT STREET'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'51 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'50 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	5	21 dB(A)	A	Complies (Bgn + 5)
'49 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'49 OATLEY ROAD'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'50 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	2	3	28 dB(A)	A	Complies (Bgn + 5)
'51 GORDON STREET'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	3	4	30 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'52 LEINSTER STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'49 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	3	5	24 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'50 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'50 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'50 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'50 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'51 MOORE PARK ROAD'	RES	1	3	23 dB(A)	A	Complies (Bgn + 5)
'50 SELWYN STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'51 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'52 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	3	5	18 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	2	5	17 dB(A)	A	Complies (Bgn + 5)
'53 MOORE PARK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'53 REGENT STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	3	4	40 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	2	4	32 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	3	5	25 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	2	5	21 dB(A)	A	Complies (Bgn + 5)
'52 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'52 REGENT STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	3	4	26 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'57 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'52 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	8	5	20 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	7	5	14 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	6	5	12 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	5	5	11 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	4	5	11 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	3	5	12 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'53-55 COOK ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'52 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'52 SELWYN STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'54 GORDON STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	3	5	26 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'54 COOK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	3	5	26 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'55 MOORE PARK ROAD'	RES	2	5	22 dB(A)	A	Complies (Bgn + 5)
'55 MOORE PARK ROAD'	RES	1	5	20 dB(A)	A	Complies (Bgn + 5)
'54 LEINSTER STREET'	RES	1	4	18 dB(A)	A	Complies (Bgn + 5)
'54 REGENT STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'54 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'56 GORDON STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'56 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'55 REGENT STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'56 REGENT STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	4	4	34 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	2	4	23 dB(A)	A	Complies (Bgn + 5)
'58 LEINSTER STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'57 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'56 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'56 RENNY STREET'	RES	1	4	21 dB(A)	A	Complies (Bgn + 5)
'56 LANG ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	2	3	46 dB(A)	A	Complies (Bgn + 5)
'57 OATLEY ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	7	5	12 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	6	5	11 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	5	5	11 dB(A)	A	Complies (Bgn + 5)
'57-67 COOK ROAD'	RES	4	5	11 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	2	3	49 dB(A)	A	Complies (Bgn + 5)
'276 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'284 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'280 MOORE PARK ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	3	3	48 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	48 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	2	3	48 dB(A)	A	Complies (Bgn + 5)
'292 MOORE PARK ROAD'	RES	1	3	44 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	2	3	48 dB(A)	A	Complies (Bgn + 5)
'286 MOORE PARK ROAD'	RES	1	3	45 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	3	3	48 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	2	3	48 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	43 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	2	4	22 dB(A)	A	Complies (Bgn + 5)
'292 OXFORD STREET'	RES	1	4	20 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	2	3	40 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	3	3	51 dB(A)	A	Complies (Bgn + 5)
'294 MOORE PARK ROAD'	RES	2	3	50 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'345-347 OXFORD STREET'	C	3	0	22 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'345-347 OXFORD STREET'	C	1	0	20 dB(A)	A	Complies
'358 MOORE PARK ROAD'	RES	3	3	33 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'358 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'354 SOUTH DOWLING STREET'	RES	1	2	10 dB(A)	A	Complies (Bgn + 5)
'360 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'349-351 OXFORD STREET'	C	3	0	19 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	2	0	17 dB(A)	A	Complies
'349-351 OXFORD STREET'	C	1	0	17 dB(A)	A	Complies
'360 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	5	4	30 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	4	4	27 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	3	4	24 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'363-379 OXFORD STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	2	2	12 dB(A)	A	Complies (Bgn + 5)
'358 SOUTH DOWLING STREET'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'356 SOUTH DOWLING STREET'	RES	1	2	14 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'380 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	3	2	24 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	2	2	23 dB(A)	A	Complies (Bgn + 5)
'372 SOUTH DOWLING STREET'	RES	1	2	22 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	3	2	17 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	2	2	15 dB(A)	A	Complies (Bgn + 5)
'362 SOUTH DOWLING STREET'	RES	1	2	13 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	4	2	21 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	3	2	15 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	2	2	18 dB(A)	A	Complies (Bgn + 5)
'368 SOUTH DOWLING STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'378 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'360 SOUTH DOWLING STREET'	RES	1	2	13 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	3	2	18 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	2	2	18 dB(A)	A	Complies (Bgn + 5)
'370 SOUTH DOWLING STREET'	RES	1	2	16 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	3	2	23 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	2	2	22 dB(A)	A	Complies (Bgn + 5)
'374 SOUTH DOWLING STREET'	RES	1	2	20 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	3	2	22 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'376 SOUTH DOWLING STREET'	RES	1	2	18 dB(A)	A	Complies (Bgn + 5)
'374 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	2	2	20 dB(A)	A	Complies (Bgn + 5)
'378 SOUTH DOWLING STREET'	RES	1	2	19 dB(A)	A	Complies (Bgn + 5)
'384 MOORE PARK ROAD'	RES	1	3	22 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'382 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	2	3	26 dB(A)	A	Complies (Bgn + 5)
'392 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'388 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'386 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'387-389 OXFORD STREET'	C	3	0	21 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	2	0	20 dB(A)	A	Complies
'387-389 OXFORD STREET'	C	1	0	20 dB(A)	A	Complies
'386 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'385 OXFORD STREET'	C	1	0	19 dB(A)	A	Complies
'390 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'390 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'402 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	2	3	19 dB(A)	A	Complies (Bgn + 5)
'400 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'394 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'408 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	19 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'406 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	E	1	0	10 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	11 dB(A)	A	Complies
'410 MOORE PARK ROAD'	RES	2	3	21 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	1	0	9 dB(A)	A	Complies
'398 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'395 OXFORD STREET'	PoW	2	0	8 dB(A)	A	Complies
'395 OXFORD STREET'	PoW	1	0	10 dB(A)	A	Complies
'414 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'416 MOORE PARK ROAD'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	3	3	23 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	22 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	3	3	18 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	2	3	17 dB(A)	A	Complies (Bgn + 5)
'422 MOORE PARK ROAD'	RES	1	3	17 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	3	3	19 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'420 MOORE PARK ROAD'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'420 MOORE PARK ROAD'	RES	1	3	18 dB(A)	A	Complies (Bgn + 5)
'410 MOORE PARK ROAD'	RES	1	3	20 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	3	3	16 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	2	3	16 dB(A)	A	Complies (Bgn + 5)
'426 MOORE PARK ROAD'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	2	3	16 dB(A)	A	Complies (Bgn + 5)
'418 MOORE PARK ROAD'	RES	1	3	15 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	3	3	20 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	2	3	19 dB(A)	A	Complies (Bgn + 5)
'424 MOORE PARK ROAD'	RES	1	3	19 dB(A)	A	Complies (Bgn + 5)
'421 OXFORD STREET'	E	3	0	12 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	9 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	7 dB(A)	A	Complies
'421 OXFORD STREET'	E	3	0	14 dB(A)	A	Complies
'421 OXFORD STREET'	E	2	0	12 dB(A)	A	Complies
'421 OXFORD STREET'	E	1	0	11 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	5	0	22 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	4	0	16 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	3	0	14 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	10 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	8 dB(A)	A	Complies
'428 MOORE PARK ROAD'	RES	3	3	15 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'428 MOORE PARK ROAD'	RES	1	3	14 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	3	3	14 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'430 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	3	0	13 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	2	0	10 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	9 dB(A)	A	Complies
'436 MOORE PARK ROAD'	RES	3	3	14 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'436 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	4	2	19 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	3	2	17 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	2	2	16 dB(A)	A	Complies (Bgn + 5)
'459 SOUTH DOWLING STREET'	RES	1	2	14 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'432 MOORE PARK ROAD'	RES	3	3	14 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	2	3	13 dB(A)	A	Complies (Bgn + 5)
'432 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	3	3	21 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'438 MOORE PARK ROAD'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	3	3	15 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	2	3	14 dB(A)	A	Complies (Bgn + 5)
'434 MOORE PARK ROAD'	RES	1	3	13 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	7	2	29 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	6	2	28 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	5	2	20 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	4	2	13 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	3	2	11 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	2	2	11 dB(A)	A	Complies (Bgn + 5)
'471 SOUTH DOWLING STREET'	RES	1	2	11 dB(A)	A	Complies (Bgn + 5)
'461-463 OXFORD STREET'	PoW	2	0	16 dB(A)	A	Complies
'461-463 OXFORD STREET'	PoW	1	0	15 dB(A)	A	Complies
'473 SOUTH DOWLING STREET'	RES	2	2	19 dB(A)	A	Complies (Bgn + 5)
'473 SOUTH DOWLING STREET'	RES	1	2	17 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	3	1	30 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	2	1	28 dB(A)	A	Complies (Bgn + 5)
'487 SOUTH DOWLING STREET'	RES	1	1	26 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	3	1	30 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	2	1	28 dB(A)	A	Complies (Bgn + 5)
'485 SOUTH DOWLING STREET'	RES	1	1	26 dB(A)	A	Complies (Bgn + 5)
'495 CLEVELAND STREET'	C	3	0	28 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	2	0	28 dB(A)	A	Complies
'495 CLEVELAND STREET'	C	1	0	28 dB(A)	A	Complies
'477 SOUTH DOWLING STREET'	RES	4	2	16 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	3	2	15 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	2	2	13 dB(A)	A	Complies (Bgn + 5)
'477 SOUTH DOWLING STREET'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	5	1	29 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	4	1	30 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	3	1	30 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'503 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'479 SOUTH DOWLING STREET'	RES	5	2	17 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	4	2	16 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	3	2	15 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	2	2	14 dB(A)	A	Complies (Bgn + 5)
'479 SOUTH DOWLING STREET'	RES	1	2	13 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	3	1	30 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	2	1	28 dB(A)	A	Complies (Bgn + 5)
'491 SOUTH DOWLING STREET'	RES	1	1	26 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	2	2	14 dB(A)	A	Complies (Bgn + 5)
'475 SOUTH DOWLING STREET'	RES	1	2	12 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	3	1	21 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'555 SOUTH DOWLING STREET'	RES	1	1	20 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	3	1	30 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'505 SOUTH DOWLING STREET'	RES	1	1	23 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'559 SOUTH DOWLING STREET'	RES	1	1	20 dB(A)	A	Complies (Bgn + 5)
'75 OXFORD STREET'	C	2	0	30 dB(A)	A	Complies
'75 OXFORD STREET'	C	1	0	27 dB(A)	A	Complies
'83 LEINSTER STREET'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	2	3	29 dB(A)	A	Complies (Bgn + 5)
'83 LEINSTER STREET'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	8	5	12 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	7	5	12 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	6	5	12 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	5	5	12 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	4	5	12 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	3	5	20 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	2	5	19 dB(A)	A	Complies (Bgn + 5)
'80 COOK ROAD'	RES	1	5	19 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	3	3	26 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	2	3	20 dB(A)	A	Complies (Bgn + 5)
'82 GORDON STREET'	RES	1	3	17 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'80 GORDON STREET'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'83 STEWART STREET'	RES	2	4	33 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	32 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	3	4	33 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	30 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	2	4	27 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	3	4	27 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'83 GREENS ROAD'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	27 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	26 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	25 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	5	3	32 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	4	3	31 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	3	3	30 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'97 LEINSTER STREET'	RES	1	3	24 dB(A)	A	Complies (Bgn + 5)
'83 STEWART STREET'	RES	1	4	28 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'87 STEWART STREET'	RES	1	4	24 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	2	4	28 dB(A)	A	Complies (Bgn + 5)
'85 STEWART STREET'	RES	1	4	26 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	3	3	19 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	2	3	18 dB(A)	A	Complies (Bgn + 5)
'88 GORDON STREET'	RES	1	3	16 dB(A)	A	Complies (Bgn + 5)
'84 GORDON STREET'	RES	1	3	12 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	3	3	27 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	2	3	27 dB(A)	A	Complies (Bgn + 5)
'90 REGENT STREET'	RES	1	3	26 dB(A)	A	Complies (Bgn + 5)
'84 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	2	3	25 dB(A)	A	Complies (Bgn + 5)
'90 GORDON STREET'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'85-91 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'87 PHELPS STREET'	RES	1	1	21 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'88 REGENT STREET'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'97 STEWART STREET'	RES	1	4	30 dB(A)	A	Complies (Bgn + 5)
'88 LANG ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	2	4	25 dB(A)	A	Complies (Bgn + 5)
'91 STEWART STREET'	RES	1	4	23 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'90 LANG ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	2	5	16 dB(A)	A	Complies (Bgn + 5)
'92 LANG ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	7	5	23 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	6	5	22 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	5	5	18 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	4	5	17 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	3	5	16 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	2	5	15 dB(A)	A	Complies (Bgn + 5)
'105 COOK ROAD'	RES	1	5	17 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	2	4	29 dB(A)	A	Complies (Bgn + 5)
'91 GREENS ROAD'	RES	1	4	29 dB(A)	A	Complies (Bgn + 5)
'93 STEWART STREET'	RES	1	4	22 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'94 LANG ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'98 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'95 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	14 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	2	4	34 dB(A)	A	Complies (Bgn + 5)
'101 GREENS ROAD'	RES	1	4	34 dB(A)	A	Complies (Bgn + 5)
'99 COOK ROAD'	RES	1	5	16 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	2	5	10 dB(A)	A	Complies (Bgn + 5)
'103 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	4	0	17 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	3	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'104 LANG ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	14 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	13 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	2	5	11 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	15 dB(A)	A	Complies (Bgn + 5)
'116 LANG ROAD'	C	5	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	9 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	10 dB(A)	A	Complies
'114 LANG ROAD'	C	3	0	10 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	10 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'107-111 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'107-111 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'112 LANG ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'108 LANG ROAD'	RES	1	5	12 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	2	5	12 dB(A)	A	Complies (Bgn + 5)
'113-119 COOK ROAD'	RES	1	5	11 dB(A)	A	Complies (Bgn + 5)
'110 LANG ROAD'	RES	1	5	8 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	14 dB(A)	A	Complies
'114 LANG ROAD'	C	2	0	8 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	8 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	12 dB(A)	A	Complies
'121-125 COOK ROAD'	RES	8	5	11 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	7	5	8 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	6	5	8 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	5	5	8 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	4	5	9 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	3	5	9 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	2	5	9 dB(A)	A	Complies (Bgn + 5)
'121-125 COOK ROAD'	RES	1	5	10 dB(A)	A	Complies (Bgn + 5)
'114 LANG ROAD'	C	1	0	11 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'114 LANG ROAD'	C	1	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	7 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	7 dB(A)	A	Complies
'114 LANG ROAD'	C	1	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	17 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	11 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	18 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	19 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	20 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	12 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	13 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	14 dB(A)	A	Complies
'116 LANG ROAD'	C	5	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	4	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	3	0	15 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	18 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	18 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'116 LANG ROAD'	C	3	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	2	0	16 dB(A)	A	Complies
'116 LANG ROAD'	C	1	0	16 dB(A)	A	Complies
'119 LEINSTER STREET'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'119 LEINSTER STREET'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	2	3	23 dB(A)	A	Complies (Bgn + 5)
'121 LEINSTER STREET'	RES	1	3	21 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'553 SOUTH DOWLING STREET'	RES	1	1	20 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	2	1	28 dB(A)	A	Complies (Bgn + 5)
'495 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	2	1	21 dB(A)	A	Complies (Bgn + 5)
'557 SOUTH DOWLING STREET'	RES	1	1	20 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'585 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	15 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	10 dB(A)	A	Complies
'569 SOUTH DOWLING STREET'	RES	2	1	20 dB(A)	A	Complies (Bgn + 5)
'569 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'561 SOUTH DOWLING STREET'	RES	1	1	20 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	2	1	20 dB(A)	A	Complies (Bgn + 5)
'571 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	3	0	3 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	2 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	1 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	24 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	24 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	12 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	10 dB(A)	A	Complies
'575 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'575 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'560 CLEVELAND STREET'	E	1	0	18 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	22 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	18 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	14 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	21 dB(A)	A	Complies

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'560 CLEVELAND STREET'	E	3	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	22 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	22 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	4	0	23 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	23 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	23 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	23 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	3	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	2	0	21 dB(A)	A	Complies
'560 CLEVELAND STREET'	E	1	0	21 dB(A)	A	Complies
'577 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'577 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'573 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'581 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	3	1	19 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'591-623 SOUTH DOWLING STREET'	RES	1	1	19 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	3	1	29 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'645 SOUTH DOWLING STREET'	RES	1	1	25 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'651 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	3	1	29 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'625-629 SOUTH DOWLING STREET'	RES	1	1	26 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	3	1	29 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	28 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	3	1	29 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'633 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'631 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	3	1	28 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	2	1	28 dB(A)	A	Complies (Bgn + 5)
'663 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'641 SOUTH DOWLING STREET'	RES	3	1	28 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	2	1	26 dB(A)	A	Complies (Bgn + 5)
'641 SOUTH DOWLING STREET'	RES	1	1	24 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'649 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'647 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	4	1	28 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	28 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	28 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'655 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'657 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'685-687 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'659 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'653 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	2	1	28 dB(A)	A	Complies (Bgn + 5)
'665 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	2	1	29 dB(A)	A	Complies (Bgn + 5)
'667 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	3	1	28 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	2	1	28 dB(A)	A	Complies (Bgn + 5)
'671 SOUTH DOWLING STREET'	RES	1	1	28 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'683 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)
'681 SOUTH DOWLING STREET'	C	2	0	28 dB(A)	A	Complies
'681 SOUTH DOWLING STREET'	C	1	0	27 dB(A)	A	Complies
'691 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'697 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'695 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'699 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'715 SOUTH DOWLING STREET'	RES	3	1	20 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'715 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	4	1	22 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	3	1	20 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'711 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	2	1	20 dB(A)	A	Complies (Bgn + 5)
'705 SOUTH DOWLING STREET'	RES	1	1	18 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	2	1	27 dB(A)	A	Complies (Bgn + 5)
'703 SOUTH DOWLING STREET'	RES	1	1	27 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'707 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	2	1	19 dB(A)	A	Complies (Bgn + 5)
'709 SOUTH DOWLING STREET'	RES	1	1	17 dB(A)	A	Complies (Bgn + 5)
'717 SOUTH DOWLING STREET'	RES	1	1	18 dB(A)	A	Complies (Bgn + 5)
'721 SOUTH DOWLING STREET'	RES	1	1	18 dB(A)	A	Complies (Bgn + 5)
'Site Office'	C	1	0	37 dB(A)	A	Complies
'Site Office'	C	1	0	37 dB(A)	A	Complies
'294 MOORE PARK ROAD'	RES	1	3	46 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	31 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	2	3	34 dB(A)	A	Complies (Bgn + 5)
'296 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	3	3	47 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'298 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'300 MOORE PARK ROAD'	RES	1	3	29 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	3	3	47 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'304 MOORE PARK ROAD'	RES	1	3	43 dB(A)	A	Complies (Bgn + 5)
'308 MOORE PARK ROAD'	C	5	0	46 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	4	0	46 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	3	0	46 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	2	0	46 dB(A)	A	Complies
'308 MOORE PARK ROAD'	C	1	0	44 dB(A)	A	Complies
'302 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'302 MOORE PARK ROAD'	RES	1	3	43 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'318 MOORE PARK ROAD'	RES	3	3	45 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	2	3	44 dB(A)	A	Complies (Bgn + 5)
'318 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	3	3	47 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	2	3	47 dB(A)	A	Complies (Bgn + 5)
'306 MOORE PARK ROAD'	RES	1	3	43 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	2	3	45 dB(A)	A	Complies (Bgn + 5)
'314 MOORE PARK ROAD'	RES	1	3	42 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	2	3	44 dB(A)	A	Complies (Bgn + 5)
'320 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	2	3	43 dB(A)	A	Complies (Bgn + 5)
'324 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	2	3	45 dB(A)	A	Complies (Bgn + 5)
'316 MOORE PARK ROAD'	RES	1	3	41 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	2	3	44 dB(A)	A	Complies (Bgn + 5)
'322 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	2	3	43 dB(A)	A	Complies (Bgn + 5)
'326 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	2	3	43 dB(A)	A	Complies (Bgn + 5)
'330 MOORE PARK ROAD'	RES	1	3	40 dB(A)	A	Complies (Bgn + 5)
'336 MOORE PARK ROAD'	RES	1	3	30 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	2	3	39 dB(A)	A	Complies (Bgn + 5)
'332-334 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	3	3	34 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)
'350 MOORE PARK ROAD'	RES	1	3	32 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	3	3	34 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	2	3	31 dB(A)	A	Complies (Bgn + 5)
'356 MOORE PARK ROAD'	RES	1	3	27 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	6	4	34 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	5	4	28 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	4	4	26 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	3	4	23 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	2	4	21 dB(A)	A	Complies (Bgn + 5)
'339 OXFORD STREET'	RES	1	4	19 dB(A)	A	Complies (Bgn + 5)
'342 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	2	3	36 dB(A)	A	Complies (Bgn + 5)
'344 MOORE PARK ROAD'	RES	1	3	39 dB(A)	A	Complies (Bgn + 5)

Receiver					Night	
Address	**Rec ID**	**Floor**	**NCA**	**Prediction**	**Lvl**	**Description**
'340 MOORE PARK ROAD'	RES	1	3	38 dB(A)	A	Complies (Bgn + 5)
'338 MOORE PARK ROAD'	RES	1	3	25 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'346 MOORE PARK ROAD'	RES	1	3	37 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	3	3	34 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	2	3	33 dB(A)	A	Complies (Bgn + 5)
'352 MOORE PARK ROAD'	RES	1	3	33 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	2	3	24 dB(A)	A	Complies (Bgn + 5)
'348 MOORE PARK ROAD'	RES	1	3	35 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	3	3	34 dB(A)	A	Complies (Bgn + 5)
'354 MOORE PARK ROAD'	RES	2	3	32 dB(A)	A	Complies (Bgn + 5)

Appendix 2 OOHW Permit and Procedure

Out of Hours Work Permit

JOHN HOLLAND

Section 1: Permit Details		Permit Number:
Project	Sydney Football Stadium Redevelopment	
Title		
Date		
Commencement date of works		
Proposed duration and working hours		

Section 2: Proposed OOHW Details	
Description of works: **Including:** **Work methodologies.** **List of plant/equipment to be used (worst case scenario).** **Map attached indicating location of works, plant/equipment locations and sensitive receivers (including distance to nearest sensitive receiver for noisiest plant/equipment).**	
Justification	☐*The delivery of oversized plant or structures has been determined by the police or other public authorities to require special arrangements to transport along public roads* ☐*an emergency to avoid the loss of life, damage to property or to prevent environmental harm* ☐*where the works and activities do not cause, when measured at the boundary of the most affected noise sensitive receiver:* *(i) Leq (15 minute) dB(A) noise levels greater than 5dB above the day, evening and night rating background level (RBL) as applicable; and* *(ii) L1(1 minute) dB(A) or LFmax dB(A) noise levels greater than 15dB above the night RBL for night works;* *(iii) continuous or impulsive vibration values greater than those for human exposure to*

	vibration, set out for residences in Table 2.2 in "Environmental noise management - Assessing Vibration: a technical guideline" (Department of Environment and Conservation, February 2006); and *(iv) intermittent vibration values greater than those for human exposure to vibration, set out for* *residences in Table 2.4 in "Environmental noise management - Assessing Vibration: a technical guideline" (Department of Environment and Conservation, February 2006);* ☐*None of the above – approval is required from DPIE. Describe below:*

Section 3: Impact Assessment	
Impacts **Describe impacts and any exceedances of the NML's**	
Mitigation Measures **List proposed mitigation measures .eg respite, noise barriers**	
Community Consultation **List community consultation carried out and any notifications issued**	

Section 4: Signoff
Project Engineer / Project Manager Name: ..... Signature: ..... Date: .....
HSEQ/ Environment Manager Name: ..... Signature: ..... Date: .....
Communications, Stakeholder and External Authorities Manager Name: ..... Signature: ..... Date: .....
Special Conditions / Comments

OUT OF HOURS WORK PROCEDURE

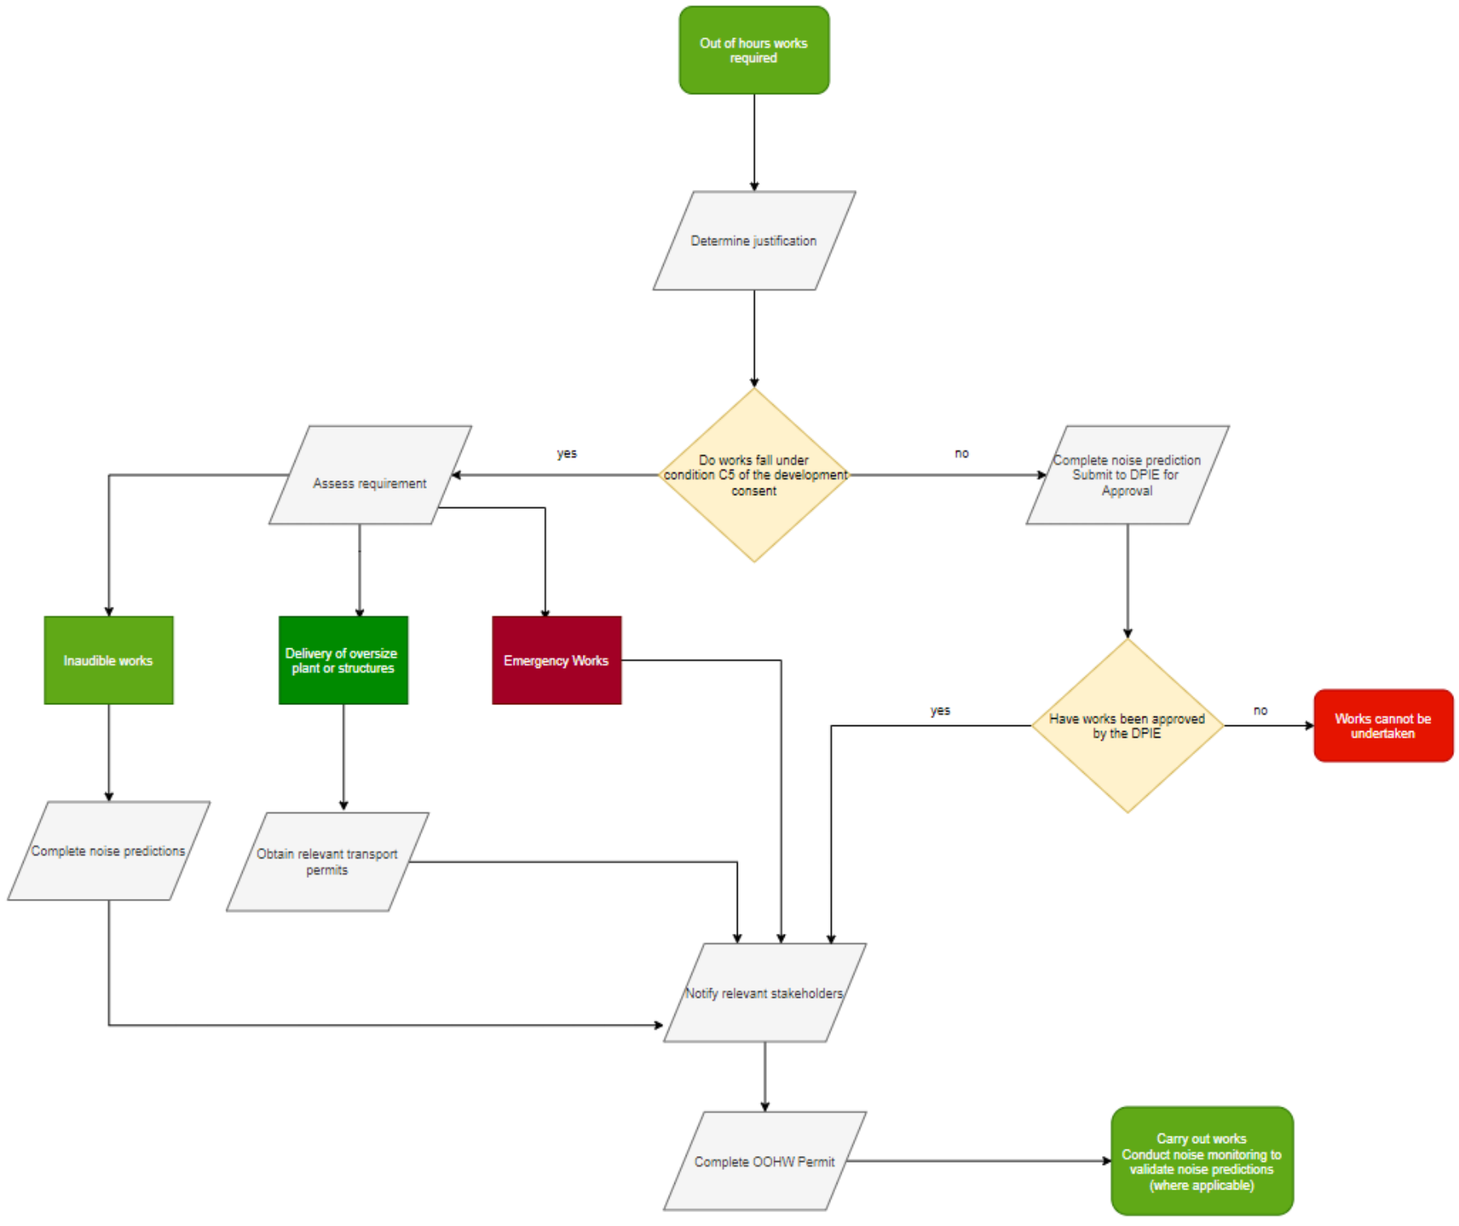

RESPONSIBILITIES

Environment Manager

- Review all documentation and sign off permits
- Complete noise predictions
- Conduct monitoring

Communications and Stakeholder Manager

- Notify affected stakeholders

Project Engineer

- Communicate requirements to subcontractor

Site Manager

- Manage works
- Enforce permit requirements

Subcontractor

- Comply with the permit

PROCEDURE

This is to be carried out in accordance with the following relevant plans

- Construction Environmental Management Plan
- Construction Noise and Vibration Management Plan

Inaudible works must meet the following criteria:

Leq (15 minute) dB(A) noise levels greater than 5dB above the day, evening and night rating background level (RBL) as applicable; and
(ii) L1(1 minute) dB(A) or LFmax dB(A) noise levels greater than 15dB above the night RBL for night works;
(iii) continuous or impulsive vibration values greater than those for human exposure to vibration, set out for residences in Table 2.2 in "Environmental noise management - Assessing Vibration: a technical guideline" (Department of Environment and Conservation, February 2006); and
(iv) intermittent vibration values greater than those for human exposure to vibration, set out for residences in Table 2.4 in "Environmental noise management - Assessing Vibration: a technical guideline" (Department of Environment and Conservation, February 2006)

The delivery of oversized plant or structures must be determined by the police or other public authorities to require special arrangements to transport along public roads

Emergency works are only to avoid the loss of life, damage to property or to prevent environmental harm

All OOHW must have appropriate justification. Eg, safety reasons, isolation, night road closures etc

Surrounding community and stakeholders must be notified as soon as possible prior to the works occurring

Appropriate mitigation measures will be considered for each scenario such as temporary noise barriers, respite offers etc.

Noise predicitions will be completed for all activities

An OOHW Permit is required prior to any of proposed works occurring