


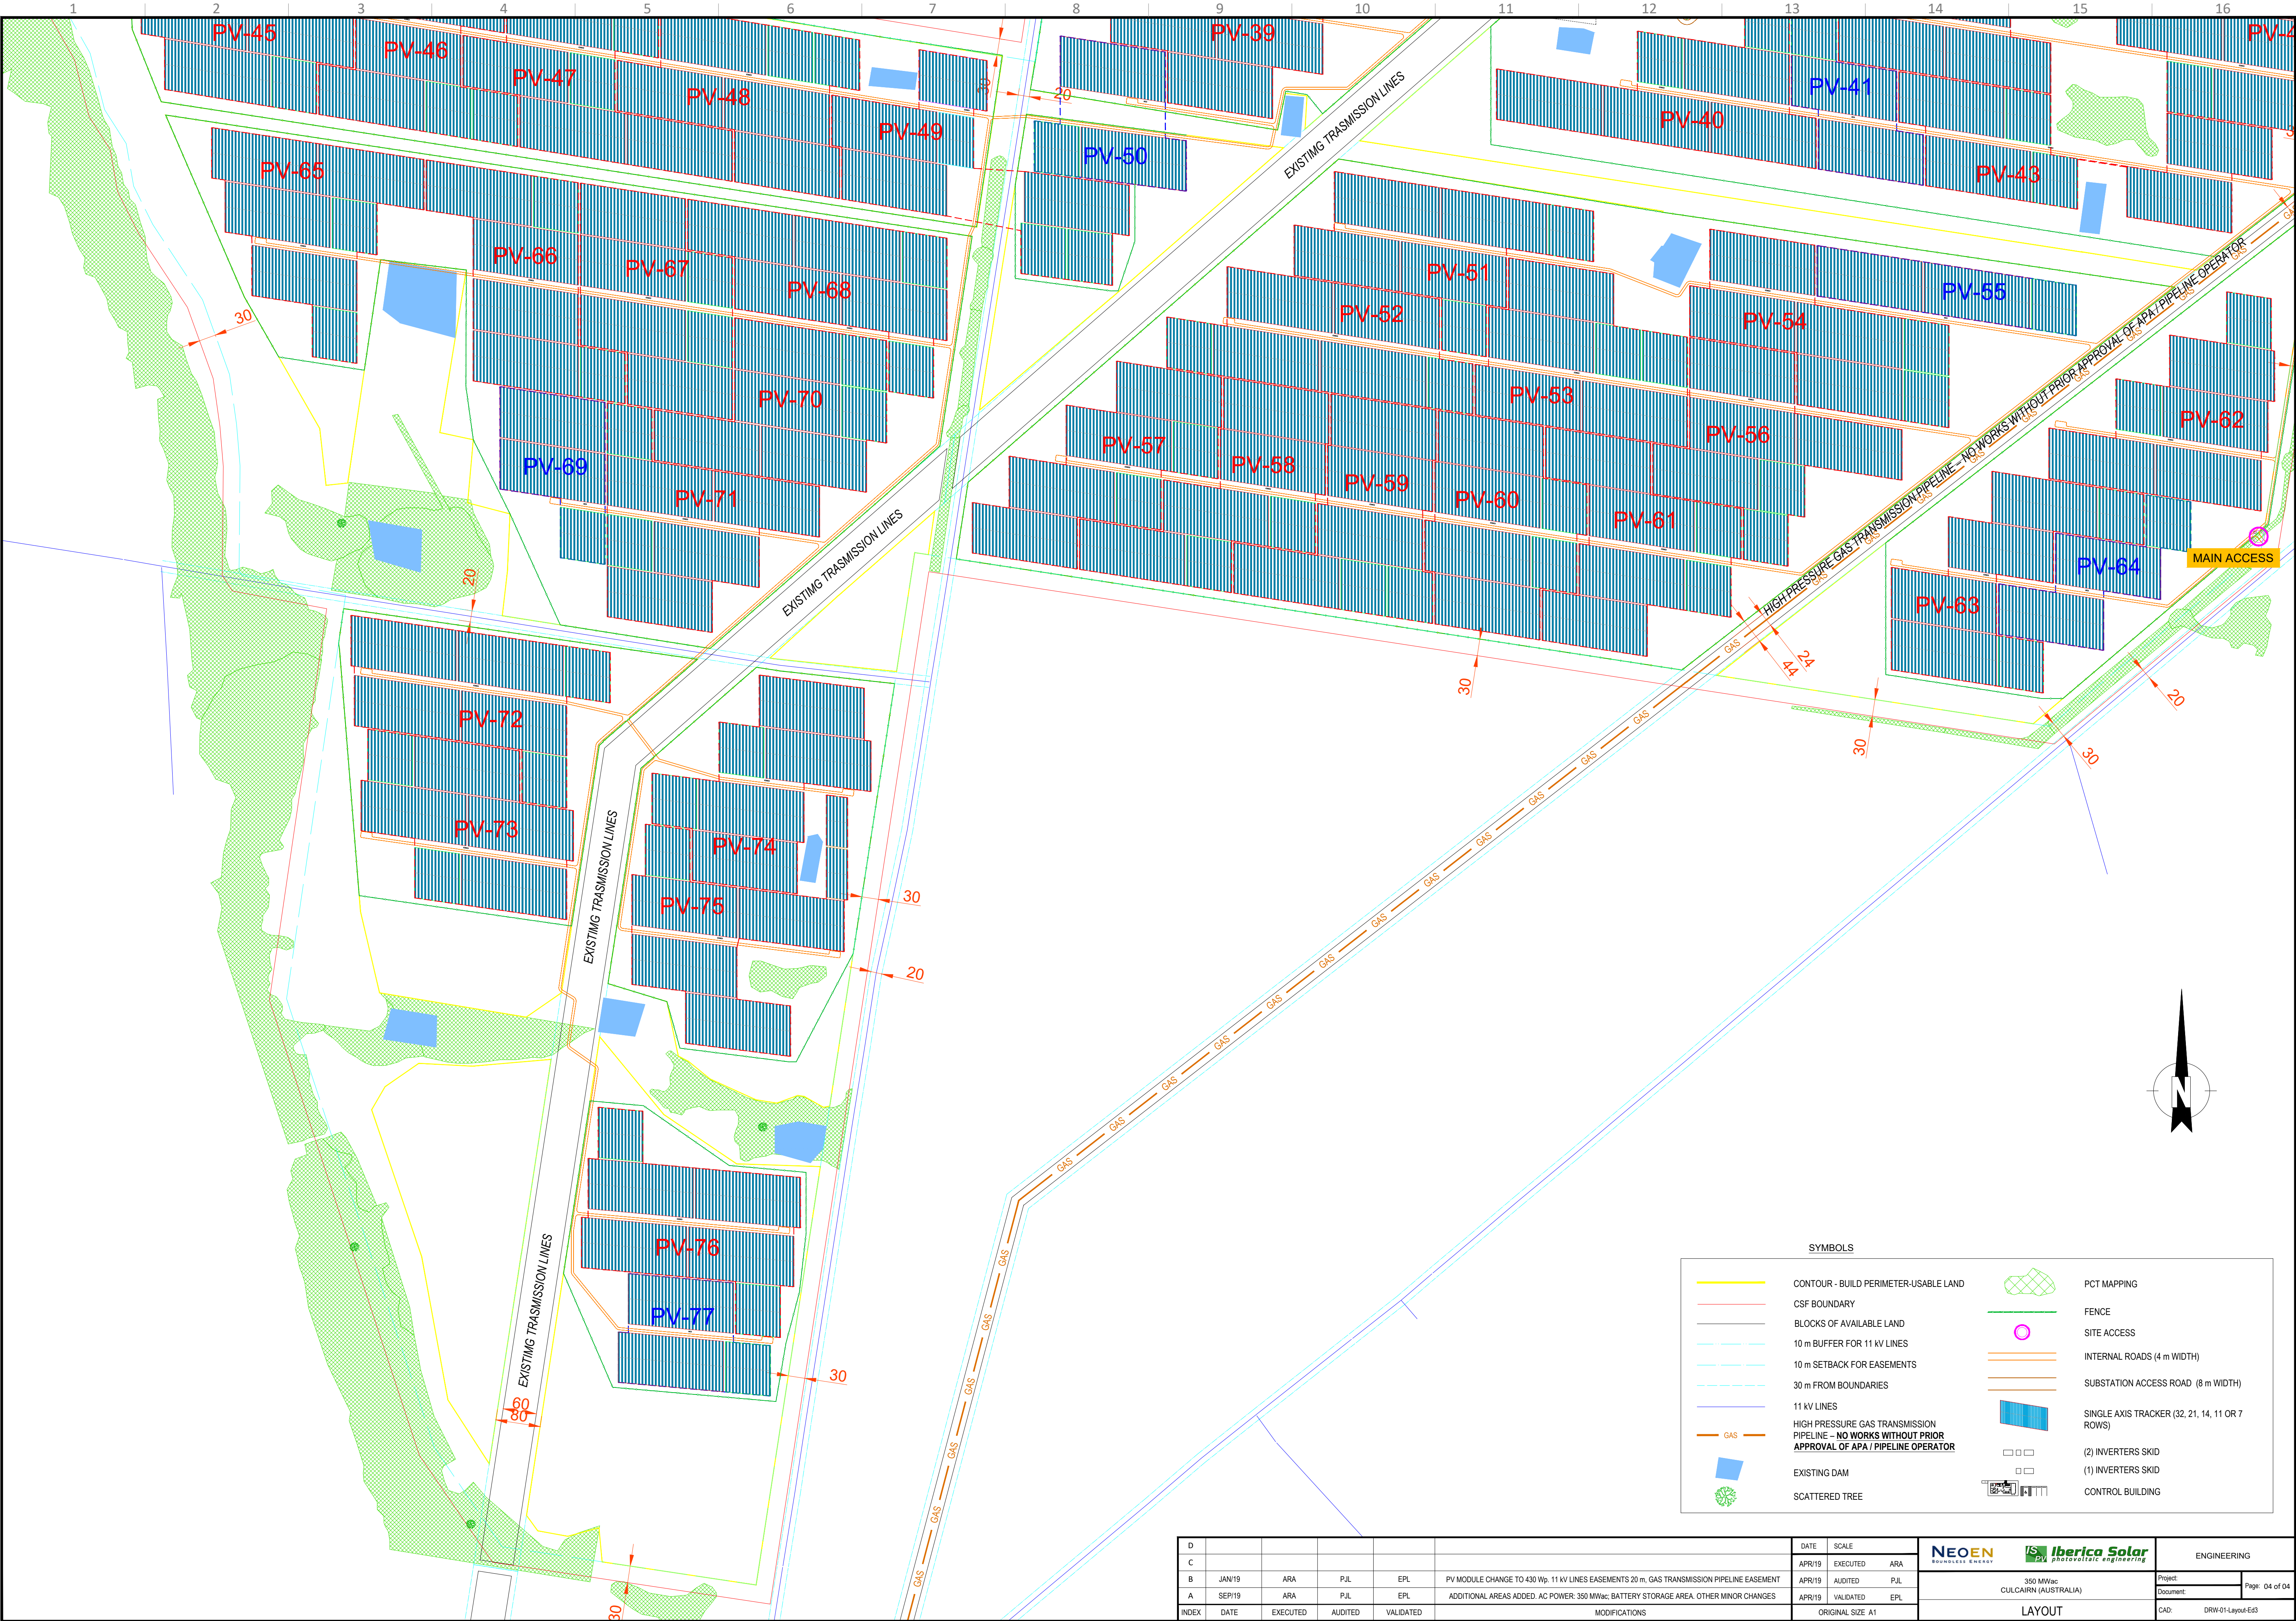

SYMBOLS			
	CONTOUR - BUILD PERIMETER-USABLE LAND		PCT MAPPING
	CSF BOUNDARY		FENCE
	BLOCKS OF AVAILABLE LAND		SITE ACCESS
	10 m BUFFER FOR 11 kV LINES		INTERNAL ROADS (4 m WIDTH)
	10 m SETBACK FOR EASEMENTS		SUBSTATION ACCESS ROAD (8 m WIDTH)
	30 m FROM BOUNDARIES		SINGLE AXIS TRACKER (32, 21, 14, 11 OR 7 ROWS)
	11 kV LINES		(2) INVERTERS SKID
	HIGH PRESSURE GAS TRANSMISSION PIPELINE - NO WORKS WITHOUT PRIOR APPROVAL OF APA / PIPELINE OPERATOR		(1) INVERTERS SKID
	EXISTING DAM		CONTROL BUILDING
	SCATTERED TREE		

						DATE	SCALE	NEOEN SOLAR ENERGY		Iberica Solar Photovoltaic engineering		ENGINEERING	
D						APR/19	EXECUTED	ARA					
C						APR/19	AUDITED	PJL					
B	JAN/19	ARA	PJL	EPL	PV MODULE CHANGE TO 430 Wp, 11 kV LINES EASEMENTS 20 m, GAS TRANSMISSION PIPELINE EASEMENT	APR/19	VALIDATED	EPL					
A	SEP/19	ARA	PJL	EPL	ADDITIONAL AREAS ADDED, AC POWER: 350 MWac, BATTERY STORAGE AREA, OTHER MINOR CHANGES	APR/19	VALIDATED	EPL					
INDEX	DATE	EXECUTED	AUDITED	VALIDATED	MODIFICATIONS	ORIGINAL SIZE A1		LAYOUT		CAD: DRW-01-Layout-Ed3		Page: 04 of 04	