FOR CONTINUATION REFER TO IN SET DETAIL 'A'

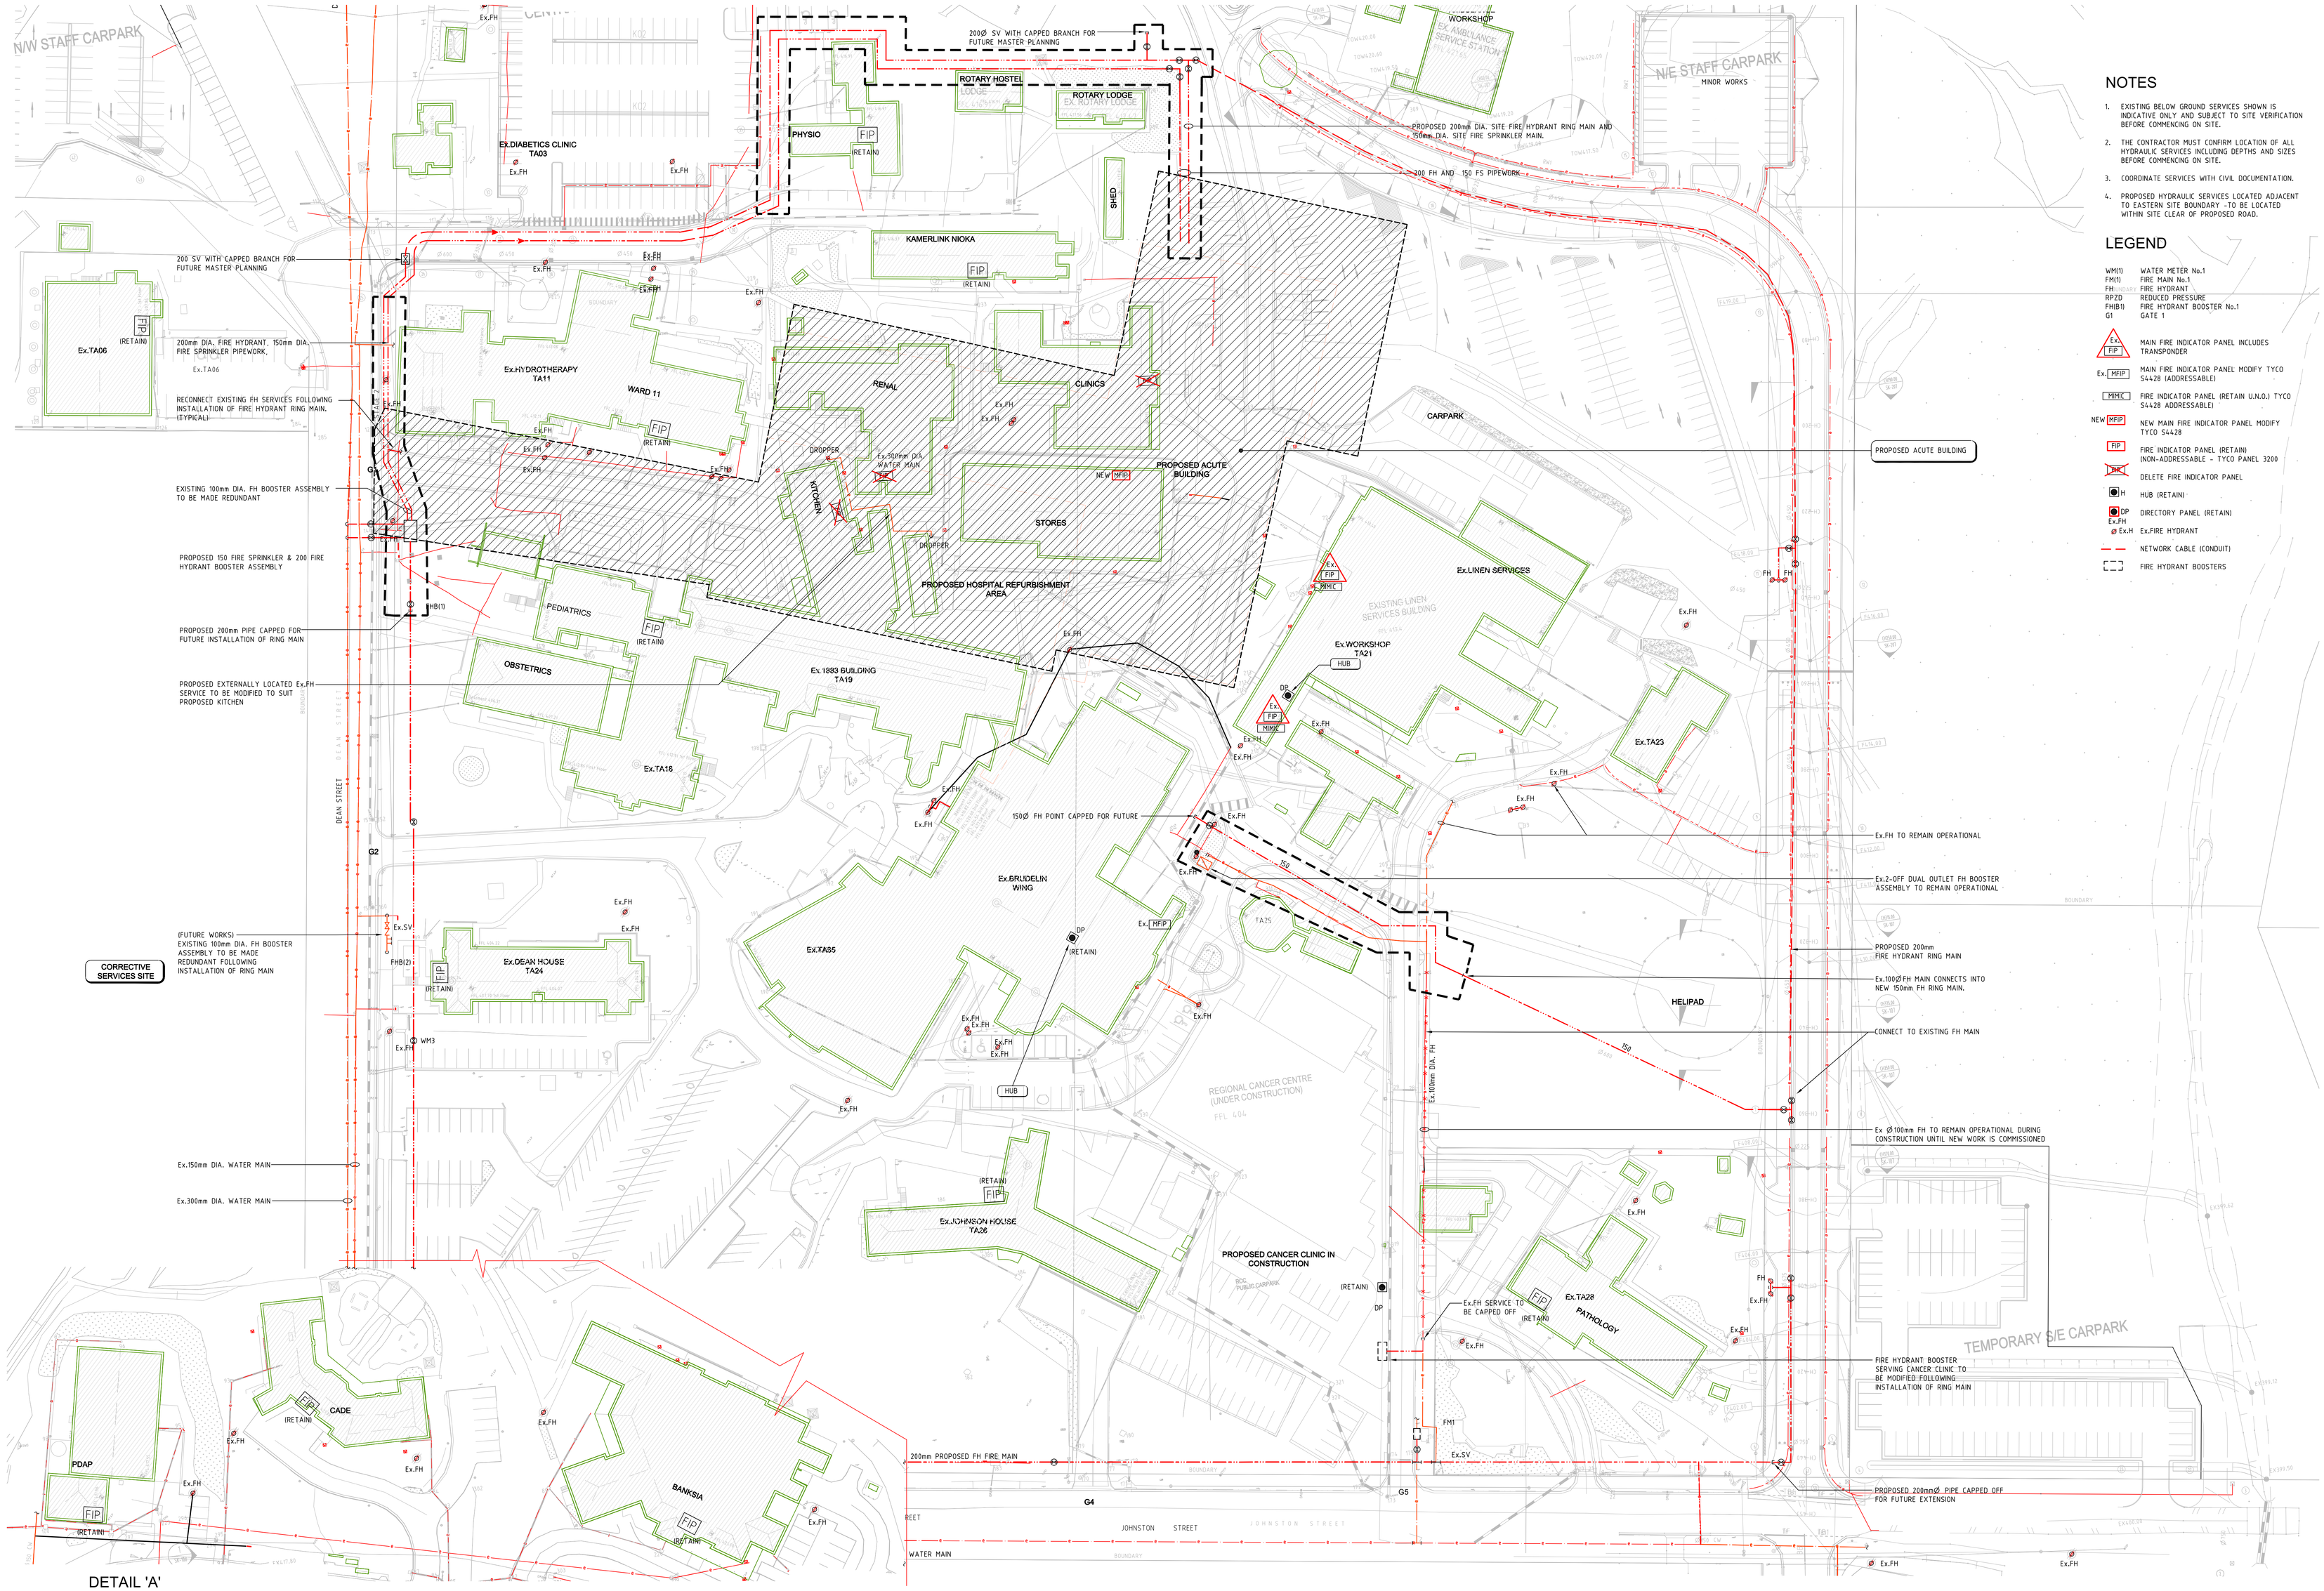

DETAIL 'A'

NOTES

1. EXISTING BELOW GROUND SERVICES SHOWN IS INDICATIVE ONLY AND SUBJECT TO SITE VERIFICATION BEFORE COMMENCING ON SITE.
2. THE CONTRACTOR MUST CONFIRM LOCATION OF ALL HYDRAULIC SERVICES INCLUDING DEPTHS AND SIZES BEFORE COMMENCING ON SITE.
3. COORDINATE SERVICES WITH CIVIL DOCUMENTATION.
4. PROPOSED HYDRAULIC SERVICES LOCATED ADJACENT TO EASTERN SITE BOUNDARY -TO BE LOCATED WITHIN SITE CLEAR OF PROPOSED ROAD.

LEGEND

WM(1)	WATER METER No.1
FM(1)	FIRE MAIN No.1
FH	FIRE HYDRANT
RPZD	REDUCED PRESSURE
FH(B1)	FIRE HYDRANT BOOSTER No.1
G1	GATE 1
Ex. FIP	MAIN FIRE INDICATOR PANEL INCLUDES TRANSPONDER
Ex. MFIP	MAIN FIRE INDICATOR PANEL MODIFY TYCO S4428 (ADDRESSABLE)
MMIC	FIRE INDICATOR PANEL (RETAIN U.N.O.) TYCO S4428 ADDRESSABLE)
NEW MFIP	NEW MAIN FIRE INDICATOR PANEL MODIFY TYCO S4428
FIP	FIRE INDICATOR PANEL (RETAIN) (NON-ADDRESSABLE - TYCO PANEL 3200
	DELETE FIRE INDICATOR PANEL
H	HUB (RETAIN)
DP	DIRECTORY PANEL (RETAIN)
Ex.FH	Ex.FIRE HYDRANT
	NETWORK CABLE (CONDUIT)
	FIRE HYDRANT BOOSTERS

Copyright of Donnelley Simpson Cleary Consulting Engineers Pty Ltd
ABN 19 050 611 427
All rights reserved.
Figured dimensions shall take precedence over to scaling. The Contractor shall check all dimensions on site before commencing work.

No.	DATE	APP'D	AMENDMENT
4	6.6.12		ISSUED FOR SCHEMATIC DESIGN
3	23.5.12		DRY FIRE SYSTEMS ADDED
2	30.4.12		FINAL SCHEMATIC ISSUE
1	13.04.12		REVIEW ISSUE

NSW GOVERNMENT Health Infrastructure

PROJECT MANAGER
aurecon
AURECON
Level 32, 116 Military Road,
Neutral Bay NSW 2089
T +612 9465 5599
F +612 9465 5598
Sydney@aurecongroup.com

STRUCTURE & CIVIL
Taylor Thomson Whitting
Level 3, 48 Chandos Street,
St Leonards, Sydney NSW 2065
T +612 9439 7288
F +612 9439 3146
ABN 24 101 643 010

ARCHITECT & PRINCIPAL CONSULTANT
McConnel Smith & Johnson ARCHITECTS
McCONNEL SMITH & JOHNSON Pty Ltd
36 Richards Avenue Surry Hills NSW 2010
T +612 8353 8888
F +612 9338 2402
ABN 45 000 929 831

Donnelley Simpson Cleary
Consulting Engineers
59 Hill Street, Roseville
N.S.W. 2069
Tel 9416 1177 Fax 9416 8251 Email mail@dsc.com.au
Mechanical
Electrical
Hydraulic
Fire
Lifts

DRAWN	DATE	SCALE @ A0
RT	APRIL 2012	1:500
DESIGNED	CHECKED	CAD REFERENCE
KA		7370_SD-HY-NZ-00-0005

TAMWORTH RURAL REFERRAL HOSPITAL
DEAN STREET, TAMWORTH NSW 2340

HYDRAULIC SERVICES
SITE FIRE HYDRANTS

No IN SET	PROJECT No	DWG No	
13	7370	SD-HY-NZ-00-0005	4