

Calala BESS

300MW - 1200MWh

Bushfire prone land
Part of Lot: 17/DP629969

Legend

-  Calala BESS extent
-  Proposed BESS layout
-  Property parcel
-  Proposed easement (for title)
-  Existing substation
-  1000m radius from centre of BESS

Proposed transmission line

-  Proposed transmission line


Existing transmission line - Capacity (kV)

-  132
-  330

Bushfire prone land

Bushfire hazard category

-  Vegetation Buffer
-  Vegetation Category 1
-  Vegetation Category 3

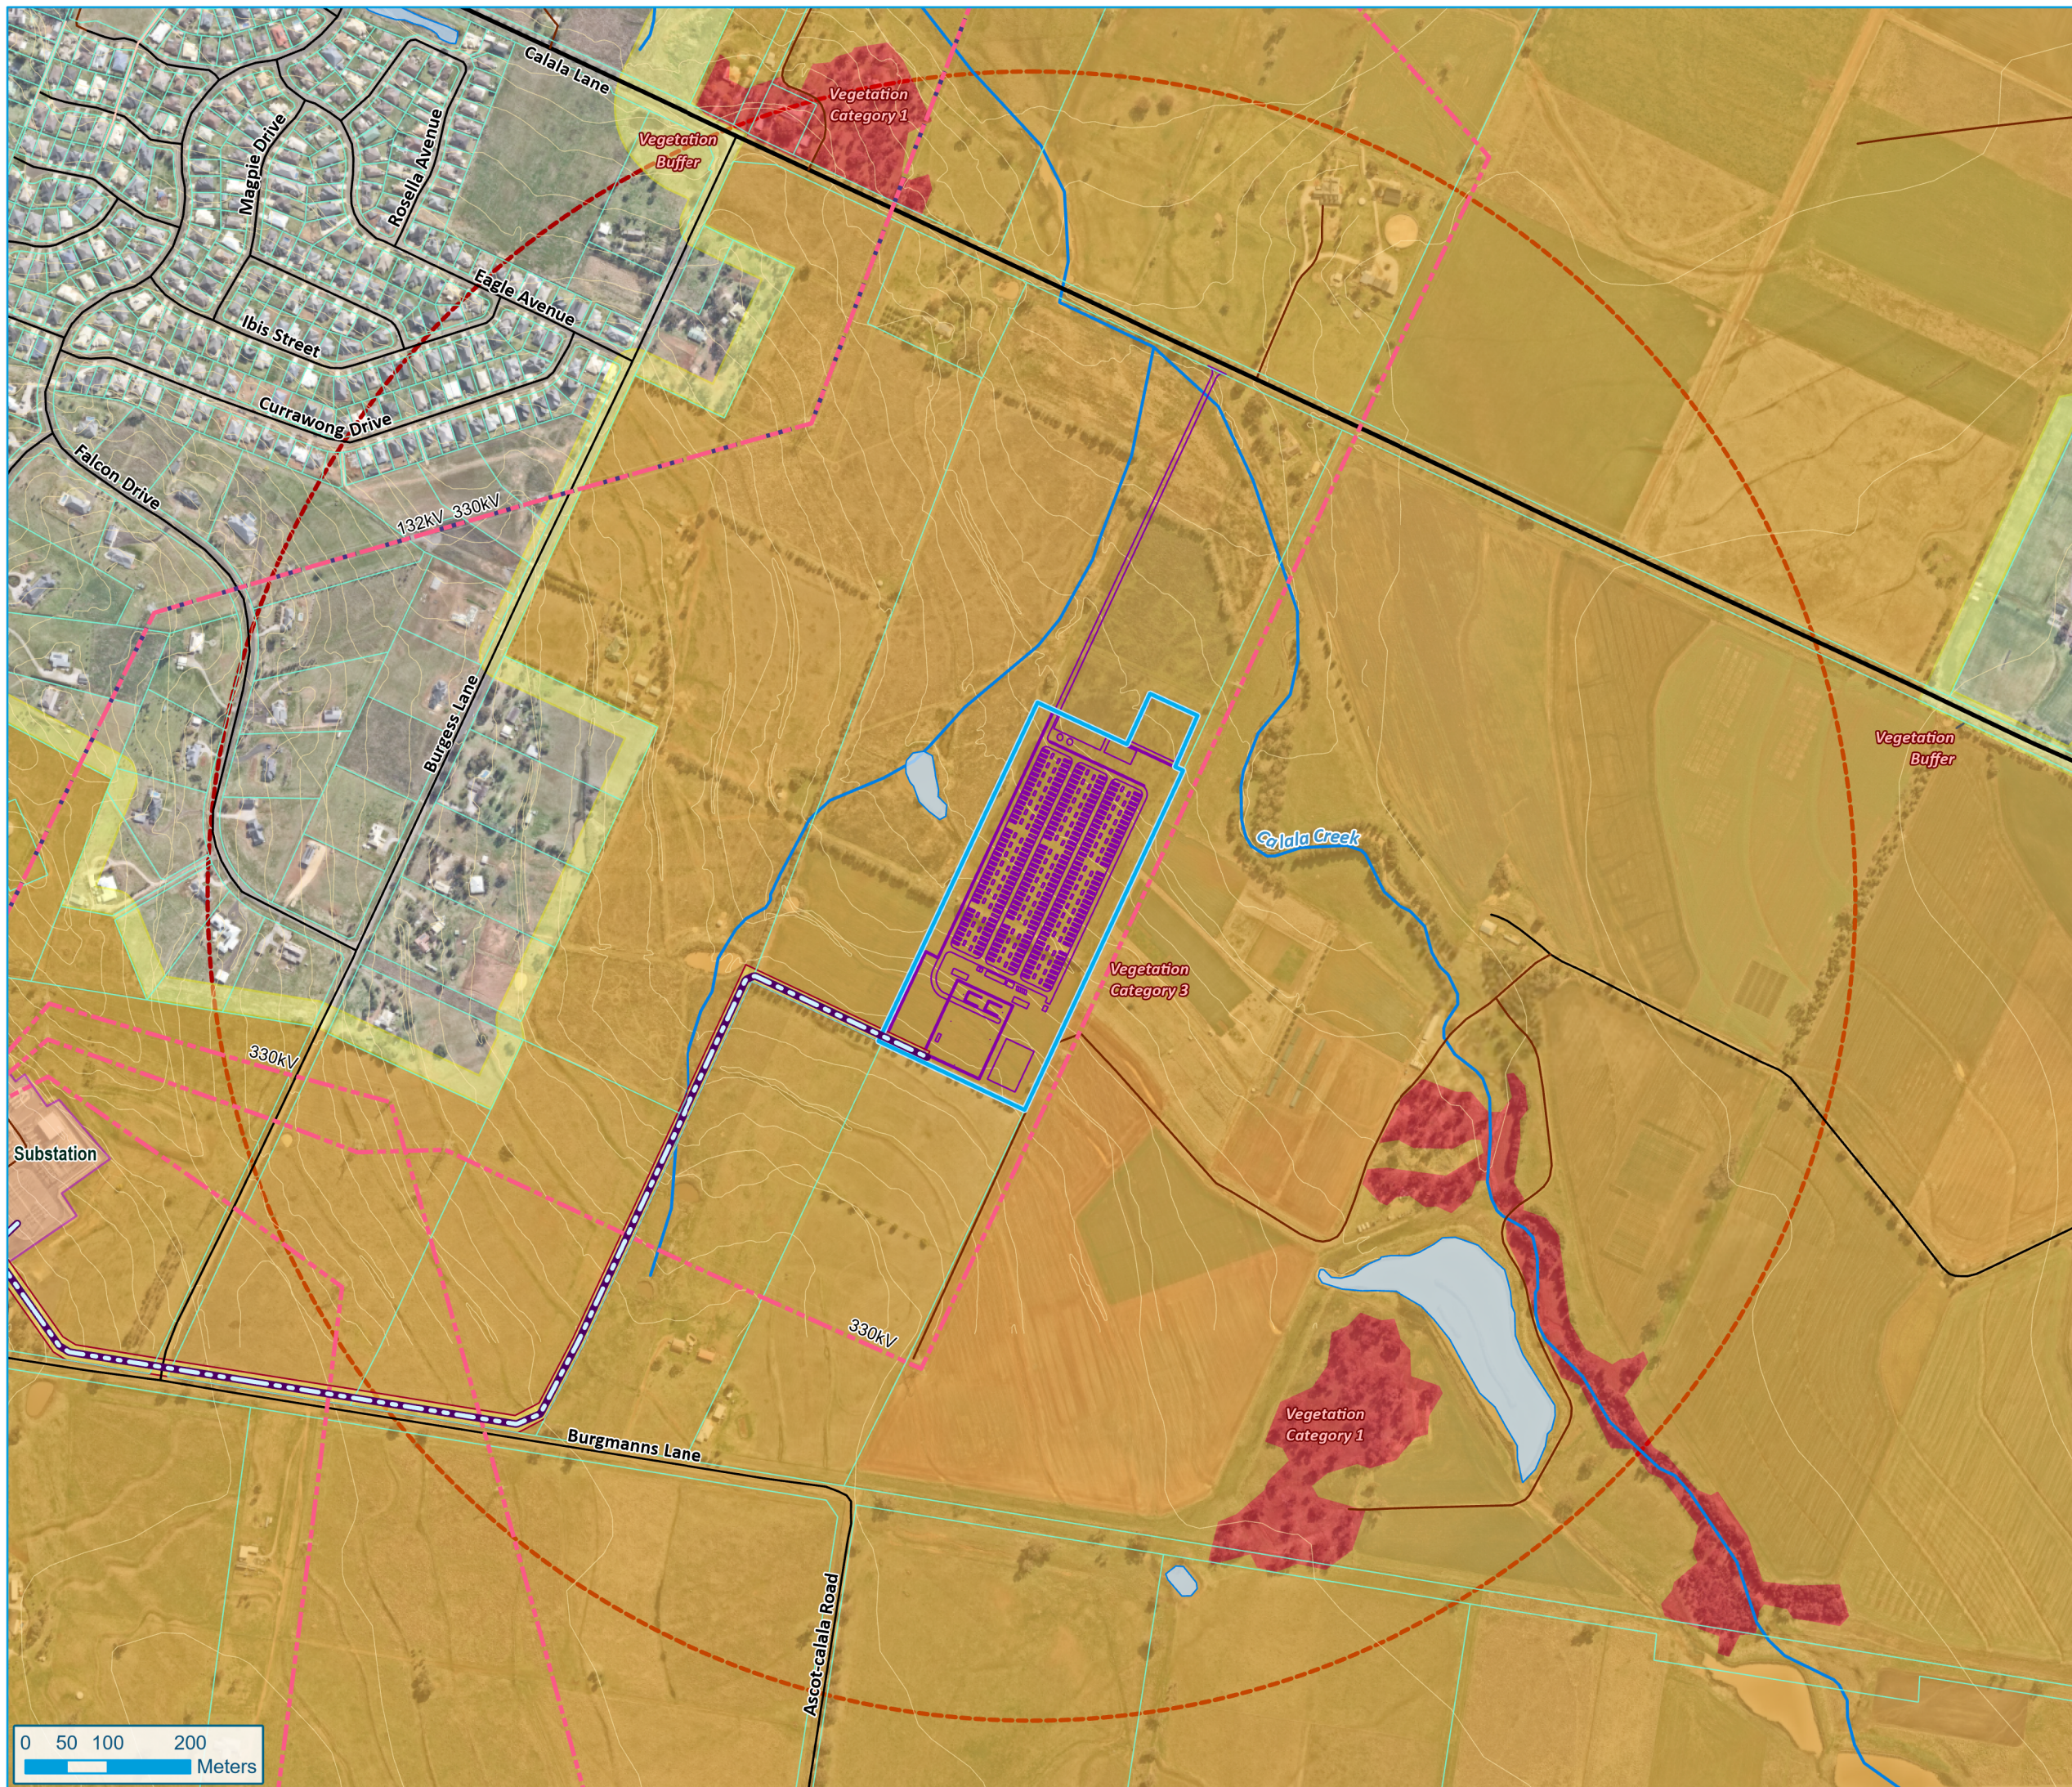

Scale: 1:7,500 @ A3
Spatial Reference: GDA2020 MGA Zone 56

Notes: This plan is indicative for development approval only and subject to detailed design changes. It contains highly confidential and proprietary information that are of independent economic value to Equis. This drawing and design shall not be reproduced, amended, disclosed or distributed to others without the express written consent of Equis.

