


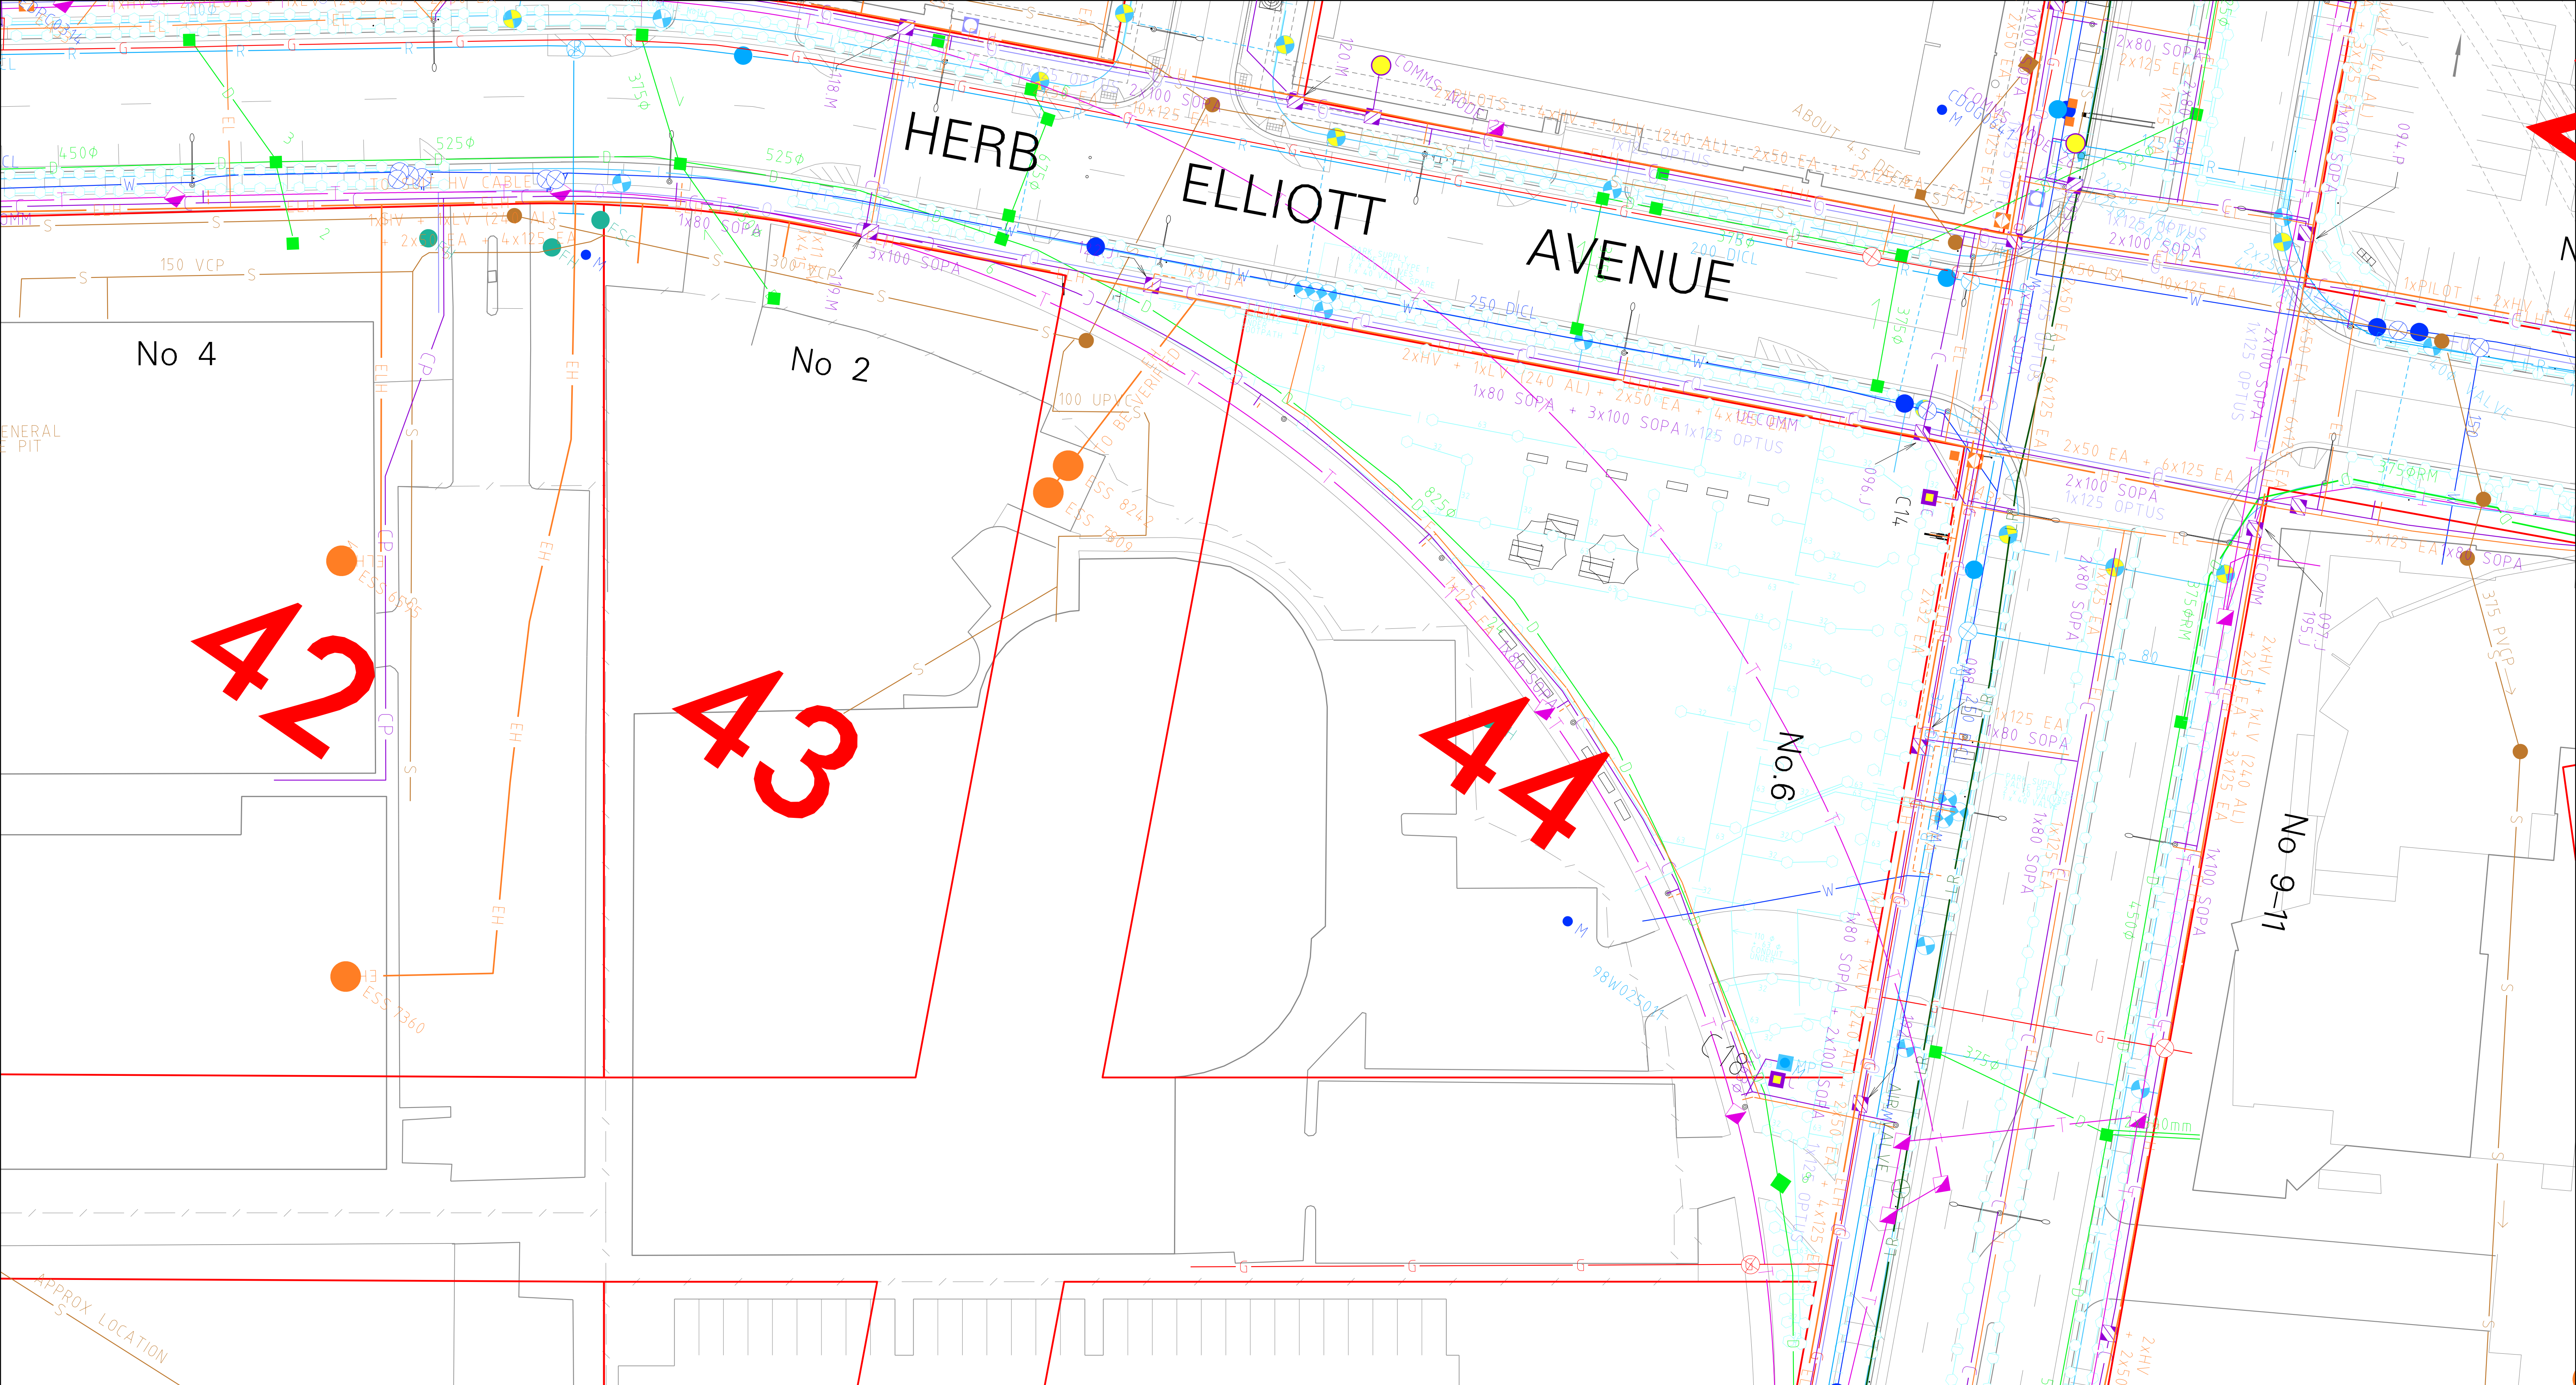

ELECTRICITY		COMMUNICATIONS		DRAINAGE		LEACHATE		SEWER		WATER		FIRE		IRRIGATION		GAS		NOTES:	
	LOW VOLTAGE		TELSTRA CONDUIT CROSSING		PIPE		DRAIN		MAIN		POTABLE		MAIN		MAIN		MAIN	THE LOCATION OF SERVICES SHOWN HAVE BEEN COMPILED FROM INFORMATION OBTAINED FROM VARIOUS SOURCES AND VARY IN COMPLETENESS AND ACCURACY. DETAILS OF ALL NON SOPA ASSETS SHOULD BE VERIFIED WITH THE RELEVANT AUTHORITY. THESE PLANS ARE FOR VERIFICATION PURPOSES AND SHOULD BE USED WITH CAUTION. IF INFORMATION SHOWN ON THIS PLAN IS FOUND TO BE INCORRECT,PLEASE INFORM THE SOPA CADD UNIT ON (02) 9714 7875.	
	HIGH VOLTAGE		TELSTRA PIT		SURFACE DRAIN		RISING MAIN		RISING MAIN		RECYCLED		STOP VALVE		ISOLATION VALVE		STOP VALVE		
	LOW-HIGH VOLTAGE		OPTUS PIT		PIT		GRAVITY MAIN		PIT		CONDUIT CROSSING		HYDRANT COVER		AIR VALVE		METER		
	TRENCH		SOPA		CDS UNIT		COMPRESSED AIR		SCOUR VALVE		STOP VALVE		HYDRANT PILLAR		FLUSH VALVE		PIT		
	CONDUIT CROSSING		CONDUIT CROSSING		FLOW ARROW		MANHOLE		VENT		AIR VALVE		HYDRANT HOSE REEL		METER PIT		REGULATOR		
	SCADA PIT		SOPA HEARING LOOP		FLUSH POINT		PUMP PIT		SEPTIC TANK		TAP		HYDRANT MAIN CONNECTION		PUMP				
	PIT		SOPA PIT				MANHOLE		PUMPING STATION		METER		SPRINKLER MAIN CONNECTION						
	PILLAR BOX		SOPA IC (IRRIG. CONTROLLER)				PIEZOMETER		UTILITY BOX						SPRINKLER CONTROLLER				
	SWITCH BOX		PRIVATE				SETTLEMENT MONUMENT		FLOW ARROW						COMMS PIT				
	SUB-STATION		PRIVATE PIT				LEACHATE MEMBRANE		TRADE WASTE						COMMS LINE				