



Preliminary Hazard Analysis

Pottinger Wind Farm

Preliminary Hazard Analysis

Pottinger Wind Farm

RPS AAP Consulting Pty Ltd

Prepared by

Riskcon Engineering Pty Ltd

37 Pogson Drive

Cherrybrook NSW 2126

www.riskcon-eng.com

ABN 74 626 753 820

© Riskcon Engineering Pty Ltd. All rights reserved.

This report has been prepared in accordance with the scope of services described in the contract or agreement between Riskcon Engineering Pty Ltd and the Client. The report relies upon data, surveys, measurements and results taken at or under the particular times and conditions specified herein. Changes to circumstances or facts after certain information or material has been submitted may impact on the accuracy, completeness or currency of the information or material. This report has been prepared solely for use by the Client. Riskcon Engineering Pty Ltd accepts no responsibility for its use by other parties without the specific authorization of Riskcon Engineering Pty Ltd. Riskcon Engineering Pty Ltd reserves the right to alter, amend, discontinue, vary or otherwise change any information, material or service at any time without subsequent notification. All access to, or use of, the information or material is at the user's risk and Riskcon Engineering Pty Ltd accepts no responsibility for the results of any actions taken on the basis of information or material provided, nor for its accuracy, completeness or currency.

Quality Management

Rev	Date	Remarks	Prepared By	Reviewed By
A	15 th December 2023	Draft issued for comment	Ezra Bagaskara	Renton Parker
B	11 th February 2023	Draft updated		
0	19 th March 2024	Final issued		

Executive Summary

Background

Riskcon Engineering Pty Ltd was engaged by RPS APP Consulting Pty Ltd (RPS) to conduct a Preliminary Hazard Assessment (PHA) of the Pottinger Wind Farm for Pottinger Renewables Pty Ltd (The Applicant).

The Secretary's Environmental Assessment Requirements (SEARs) require the risks to be assessed in the form of a Preliminary Hazard Analysis (PHA) as part of the EIS and State Significant Development Application (SSDA). The PHA is to be prepared in accordance with the Hazardous Industry Planning Advisory Papers (HIPAP) No. 6 (Ref. [1]) and No. 4 (Ref. [2]).

The Project includes the construction, operation and commissioning of a wind farm with a targeted electricity generation capacity of 1,300 MW, battery energy storage system (BESS) with a capacity of approximately 500 MW / 2,000 MWh (AC), and associated infrastructure. Some of the Project-associated infrastructure will be shared with the Pottinger Solar Farm (the subject of a separate application) The Project will supply electricity to the national electricity grid in the South West Renewable Energy Zone (REZ), and will connect to the Project EnergyConnect 330 kV transmission networks, both owned by Transgrid. The Project EnergyConnect 330 kV transmission line (EnergyConnect) in the Eastern Section was recently approved for construction and will run between Buronga to Wagga Wagga New South Wales (NSW).

This report supports a State Significant Development (SSD) Development Consent approval under Part 4, Division 4.7 of the *Environmental Planning and Assessment Act 1979* (SSD-59235464), as part of the Environmental Impact Statement (EIS) for the Project.

Conclusions

A hazard identification table was developed for the Pottinger Wind Farm & BESS Project to identify potential hazards that may be present at the site as a result of operations or storage of materials. Based on the identified hazards, scenarios were postulated that may result in an incident with the potential for offsite impacts. Postulated scenarios were discussed qualitatively and any scenarios that would not impact offsite were eliminated from further assessment. Scenarios not eliminated were then carried forward for consequence analysis.

A review of the incidents carried forward for further analysis indicates that there were no observed offsite impacts; therefore, based on the analysis conducted, it is concluded that the risks at the Project Area are not considered to exceed the acceptable risk criteria; hence, the Project would only be classified as potentially hazardous and would be permitted within the current land zoning for the site. It must be noted that the required bushfire assessment is provided under separate cover.

Recommendations

The following recommendations have been made as a result of the assessment:

- BESS must be tested in accordance with UL9540A.
- Testing to demonstrate clearances required to prevent propagation of fires between separated units.
- BESS to be installed in accordance with manufacturer and UL9540A report recommended clearances based on testing.

- BESS to be installed with fire protection systems specified by the manufacturer and UL9540A report.
- Before construction, detailed design to validate the system can be installed in the Project Area whilst meeting the recommended clearances.
- UL testing information shall be made available to the certifying authority. It is noted that a confidentiality agreement may be required.
- The vent covers of the BESS shall be constructed of non-combustible material.
- The vents shall not be located above battery packs within the BESS container.

Table of Contents

Executive Summary	i
1.0 Introduction	1
1.1 Background	1
1.2 Objectives	1
1.3 Scope of Services	2
2.0 Methodology	3
2.1 Multi-Level Risk Assessment	3
2.2 Risk Assessment Study Approach	4
3.0 Site Description	5
3.1 Project Location	5
3.2 General Description	7
3.3 Detailed Description	8
3.3.1 Medium Voltage Power Station (MVPS)	8
3.3.2 Battery Storage	9
3.4 Quantities of Dangerous Goods & SEPP-RH Screening	9
4.0 Hazard Identification	10
4.1 Introduction	10
4.2 Properties of Dangerous Goods	11
4.3 Hazard Identification	11
4.4 Li-Ion Battery Fault, Thermal Runaway and Fire	11
4.5 Victorian Big Battery Fire Review	15
4.6 Li-ion Battery Fire and Toxic Gas Dispersion	16
4.6.1 Carbon Dioxide	16
4.6.2 Carbon Monoxide	16
4.6.3 Fluoride Gases	17
4.7 Electrical Equipment Failure and Fire	17
4.8 Transformer Internal Arcing, Oil Spill, Ignition and Bund Fire	18
4.9 Transformer Electrical Surge Protection Failure and Explosion	18
4.10 Electromagnetic Field Impacts	19
4.10.1 Introduction	19
4.10.2 Existing Standards	19
4.10.3 Exposure Discussion	19
4.11 National Health and Medical Research Council review	20
5.0 Conclusion and Recommendations	22
5.1 Conclusions	22
5.2 Recommendations	22
6.0 References	23
Appendix A Hazard Identification Table	25
A1. Hazard Identification Table	26

List of Figures

Figure 2-1: The Multi-Level Risk Assessment Approach	3
Figure 3-1: Conceptual Project Layout	6
Figure 3-2: Typical MVPS	8
Figure 3-3: Typical BESS Arrangement	9
Figure 4-1: Cathode and Anode of a Battery (Source Research Gate)	12
Figure 4-2: Temperature Rise of Lithium-Ion Battery Chemistries (Ref. [6]).	14

List of Tables

Table 2-1: Level of Assessment PHA	3
Table 3-1: Maximum Quantities of Dangerous Goods Stored & Preliminary Risk Screening	9
Table 4-1: Properties* of the Dangerous Goods and Materials Stored at the Site	11
Table 4-2: EMF Sources and Magnetic Field Strength	19
Table 4-3: Sources of Noise with Associated Level	21

Abbreviations

Abbreviation	Description
AC	Alternating Current
ADG	Australian Dangerous Goods Code
AS	Australian Standard
BESS	Battery Energy Storage System
DC	Direct Current
DGs	Dangerous Goods
EIS	Environmental Impact Statement
ELF	Extra Low Frequency
EMF	Electric and Magnetic Field
ERPG	Emergency Response Planning Guideline
FCAS	Frequency Control Ancillary Services
FHA	Final Hazard Analysis
FTE	Full Time Equivalent
HF	Hydrogen Fluoride
HIPAP	Hazardous Industry Planning Advisory Paper
ICNIRP	International Commission on Non-Ionizing Radiation Protection
IDLH	Immediately Dangerous to Life and Health
LFP	LiFePO ₄ (Lithium Iron Phosphate)
MVPS	Medium Voltage Power Station
NMC	Nickel-Manganese-Cobalt
NSW	New South Wales
PHA	Preliminary Hazard Analysis
Pmpy	Per million per year
REZ	Renewable Energy Zone
SEARs	Secretary's Environmental Assessment Requirements
SEP	Surface Emissive Power
SEPP	State Environmental Planning Policy
SOC	State of Charge
SSDA	State Significant Development Application
STEL	Short Term Exposure Limit
VBB	Victorian Big Battery
WTG	Wind Turbine Generators

Terminology

Term	Definition
Applicant	Someva Pty Ltd
Application	Application for Development Consent under Part 4.7 of the EP&A Act; and Determination under Part 9 of the EPBC Act
Associated dwelling	Habitable dwelling which does have any agreement with the Project
Disturbance Footprint	Direct maximum Project-related disturbance in hectares. Largely within the Survey Area except where detailed in Section 3 of the EIS.
Due Diligence	Environmental assessment process by which minor Project components may be located within the Project Area but external to the Survey Area as stipulated in Section 3 of the EIS during the detailed design (post-approval) phase.
Non-associated Dwelling	Habitable dwelling which does not have an agreement with the Project, however, does have an agreement with another Project.
Non-associated Dwelling (associated with other Project)	Habitable dwelling which does not have an agreement with the Project.
Pottinger Energy Park	Combination of the Solar Farm and Wind Farm projects for which separate Applications are being made
Project	A wind farm to which this Application applies
Project Area	Red boundary shown on key figures to which the Application applies (unless otherwise stipulated)
Receiver	Assessment location
Survey Area	Area surveyed within the Project Area within which detailed assessment has been consistently undertaken for all field studies. The Project components may be moved and/or micrositied within this boundary during detailed design.

1.0 Introduction

1.1 Background

Riskcon Engineering Pty Ltd was engaged by RPS APP Consulting Pty Ltd (RPS) to conduct a Preliminary Hazard Assessment (PHA) of the Pottinger Wind Farm for Pottinger Renewables Pty Ltd (The Applicant).

The Secretary's Environmental Assessment Requirements (SEARs) require the risks to be assessed in the form of a Preliminary Hazard Analysis (PHA) as part of the EIS and State Significant Development Application (SSDA). The PHA is to be prepared in accordance with the Hazardous Industry Planning Advisory Papers (HIPAP) No. 6 (Ref. [1]) and No. 4 (Ref. [2]).

The Project includes the construction, operation and commissioning of a wind farm with a targeted electricity generation capacity of 1,300 MW, battery energy storage system (BESS) with a capacity of approximately 500 MW / 2,000 MWh (AC), and associated infrastructure. Some of the Project-associated infrastructure will be shared with the Pottinger Solar Farm (the subject of a separate application) The Project will supply electricity to the national electricity grid in the South West Renewable Energy Zone (REZ), and will connect to the Project EnergyConnect 330 kV transmission networks, both owned by Transgrid. The Project EnergyConnect 330 kV transmission line (EnergyConnect) in the Eastern Section was recently approved for construction and will run between Buronga to Wagga Wagga New South Wales (NSW).

This report supports a State Significant Development (SSD) Development Consent approval under Part 4, Division 4.7 of the *Environmental Planning and Assessment Act 1979* (SSD-59235464), as part of the Environmental Impact Statement (EIS) for the Project.

1.2 Objectives

The key objectives of this PHA are to:

- Complete the PHA according to the Hazardous Industry Planning Advisory Paper (HIPAP) No. 6 – Hazard Analysis (Ref. [1]);
- Assess the PHA results using the criteria in HIPAP No. 4 – Risk Criteria for Land Use Planning (Ref. [2]); and
- Demonstrate compliance of the site with the relevant codes, standards and regulations (i.e. Planning and Environment Regulation, WHS Regulation, 2017 Ref. [3]).

This PHA has been prepared in accordance with the Secretary's Environmental Assessment Requirements (SSD-59235464, dated 10 July 2023) as listed below. This assessment addresses the requirement of the SEARs, noting that a bushfire assessment is being prepared under separate cover.

Requirement	Report Section
<p>The EIS must include an assessment of the following:</p> <ul style="list-style-type: none"> • Health – consider and document any health issues having regard to the latest advice of the National Health and Medical Research Council, and identify potential hazards and risks associated with electric and magnetic fields (EMF) and demonstrate the application of the principles of prudent avoidance, including an assessment against the 'International Commission on Non-Ionizing Radiation Protection (ICNIRP) Guidelines for limiting exposure to Time-varying Electric, Magnetic and Electromagnetic Fields'; 	Section 4.0

Requirement	Report Section
<ul style="list-style-type: none"> Bushfire — identify potential hazards and risks associated with bushfires / use of bushfire prone land including the risks that a wind farm would cause bush fire and demonstrate compliance with <i>Planning for Bush Fire Protection 2019</i>. 	Provided by under separate cover
<ul style="list-style-type: none"> Dangerous Goods – a preliminary risk screening completed in accordance with the <i>State Environmental Planning Policy (Resilience and Hazards)</i>; 	Section 3.4
<ul style="list-style-type: none"> Battery Energy Storage System - a preliminary risk screening completed in accordance with the <i>State Environmental Planning Policy (Resilience and Hazards) 2021</i>; a Preliminary Hazard Analysis (PHA) must be prepared in accordance with 'Hazardous Industry Planning Advisory Paper No. 6 – Guideline for Hazard Analysis' (DoP, 2011) and Multi-Level Risk Assessment (DoP, 2011). The PHA must consider all recent standards and codes and verify separation distances to on-site and off-site receptors to prevent fire propagation and compliance with Hazardous Industry Advisory Paper No. 4, 'Risk Criteria for Land Use Safety Planning (DoP, 2011), include the key design parameters identified in the Project description. 	Section 4.0

1.3 Scope of Services

The scope of work is to complete a PHA study for the Pottinger Wind Farm BESS Project to be located 60 km south of Hay in the rural locality of Booroorban in south-western NSW, entirely within the South West REZ.

2.0 Methodology

2.1 Multi-Level Risk Assessment

The Multi-Level Risk Assessment approach (Ref. [4]) published by the NSW Department of Planning, Housing and Infrastructure, has been used as the basis for the study to determine the level of risk assessment required. The approach considered the development in context of its location, the quantity and type (i.e. hazardous nature) of Dangerous Goods (DGs) stored and used, and the Project's technical and safety management control. The Multi-Level Risk Assessment Guidelines are intended to assist industry, consultants and the consent authorities to carry out and evaluate risk assessments at an appropriate level for the Project being studied.

There are three levels of risk assessment set out in Multi-Level Risk Assessment which may be appropriate for a PHA, as detailed in **Table 2-1**.

Table 2-1: Level of Assessment PHA

Level	Type of Analysis	Appropriate If:
1	Qualitative	No major off-site consequences and societal risk is negligible
2	Partially Quantitative	Off-site consequences but with low frequency of occurrence
3	Quantitative	Where 1 and 2 are exceeded

The Multi-Level Risk Assessment approach is schematically presented in **Figure 2-1**.

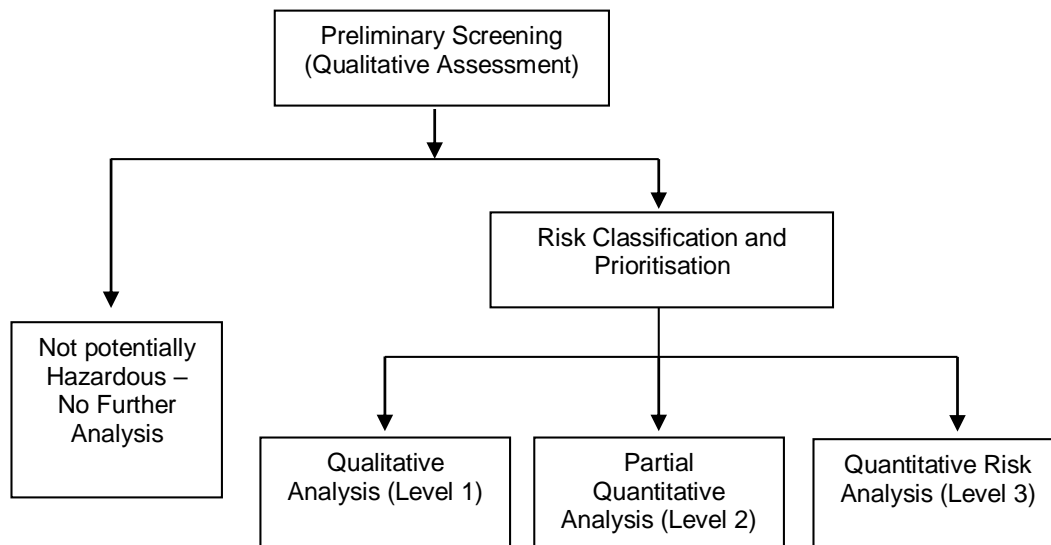


Figure 2-1: The Multi-Level Risk Assessment Approach

Based on the type of DGs to be used and handled at the Project, a **Level 2 Assessment** was selected. This approach provides a qualitative assessment of those DGs of lesser quantities and hazard, and a quantitative approach for the more hazardous materials to be used on-site. This approach is commensurate with the methodologies recommended in “Applying SEPP 33’s” Multi Level Risk Assessment approach (Ref. [4]).

2.2 Risk Assessment Study Approach

The methodology used for the PHA is as follows:

Hazard Analysis – A detailed hazard identification was conducted for the site facilities and operations. Where an incident was identified to have a potential off-site impact, it was included in the recorded hazard identification word diagram (**Appendix A**). The hazard identification word diagram lists incident type, causes, consequences and safeguards. This was performed using the word diagram format recommended in HIPAP No. 6 (Ref. [1]).

Each postulated hazardous incident was assessed qualitatively in light of proposed safeguards (technical and management controls). Where a potential offsite impact was identified, the incident was carried into the main report for further analysis. Where the qualitative review in the main report determined that the safeguards were adequate to control the hazard, or that the consequence would obviously have no offsite impact, no further analysis was performed. **Section 3.1** of this report provides details of values used to assist in selecting incidents required to be carried forward for further analysis.

Consequence Analysis – For those incidents qualitatively identified in the hazard analysis to have a potential offsite impact, a detailed consequence analysis was conducted. The analysis modelled the various postulated hazardous incidents and determined impact distances from the incident source. The results were compared to the consequence criteria listed in HIPAP No. 4 (Ref. [2]). The criteria selected for screening incidents is discussed in **Section 3.1**.

Where an incident was identified to result in an offsite impact, it was carried forward for frequency analysis. Where an incident was identified to not have an offsite impact, and a simple solution was evident (i.e. move the proposed equipment further away from the Project Area), the solution was recommended, and no further analysis was performed.

Frequency Analysis – In the event a simple solution for managing consequence impacts was not evident, each incident identified to have potential offsite impact was subjected to a frequency analysis. The analysis considered the initiating event and probability of failure of the safeguards (both hardware and software). The results of the frequency analysis were then carried forward to the risk assessment and reduction stage for combination with the consequence analysis results.

Risk Assessment and Reduction – Where incidents were identified to impact offsite and where a consequence and frequency analysis was conducted, the consequence and frequency analysis for each incident were combined to determine the risk and then compared to the risk criteria published in HIPAP No. 4 (Ref. [2]). Where the criteria were exceeded, a review of the major risk contributors was performed, and the risks reassessed incorporating the recommended risk reduction measures. Recommendations were then made regarding risk reduction measures.


Reporting – On completion of the study, a draft report was developed for review and comment. A final report was then developed, incorporating the comments received for submission to the regulatory authority.

3.0 Site Description

3.1 Project Location

The Project is located within the Hay Shire Local Government Area (LGA), approximately 60 km south of Hay. The Jerilderie Road borders the Project Area to the East, Nyangay Creek to the west, and the Edward River LGA to the south.

The conceptual Project layout has been provided in **Figure 3-1**.

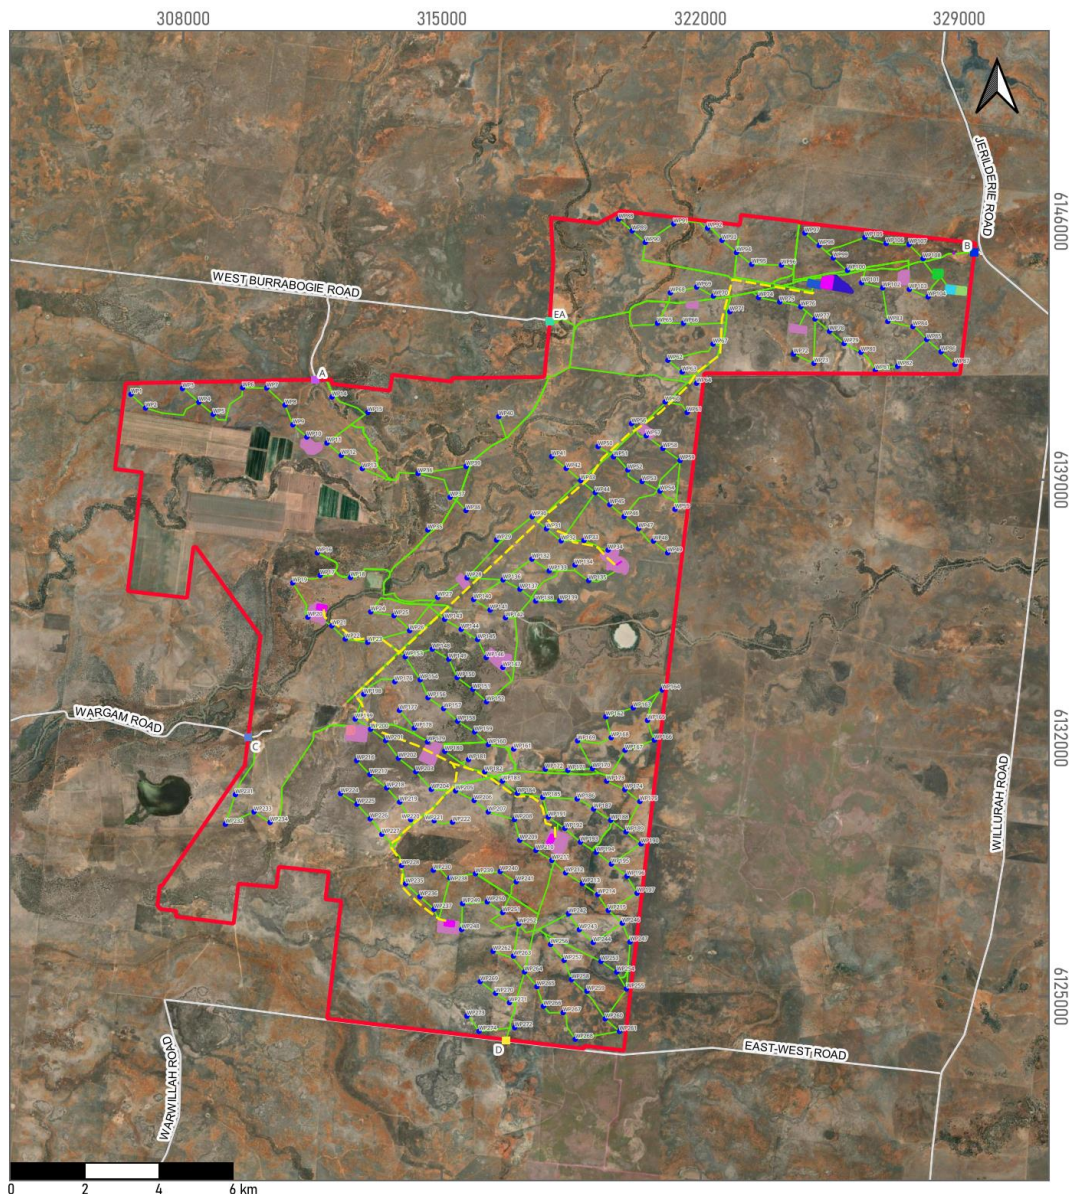

Pottinger Wind Farm

Figure 1: Conceptual Project Layout

Date: 23/10/2023

CRS: GDA2020 / MGA zone 55

Scale: 145000

Basemap: ESRI Satellite (2022)

Data Sources: Spatial Services

Prepared By: TS

Version: 1

This figure may contain third party information. This figure is provided for information purposes only and may not be to scale.

Legend

- | | |
|-------------------------------|--|
| Project Infrastructure | Collector Substation |
| Project Area | O&M |
| WTG Locations | Switching Station |
| Project Access Points | Temporary Accommodation Facilities |
| Emergency Access | Temporary Construction Compound |
| Site Entrance A | Temporary Construction, Batching and Laydown |
| Site Entrance B | Water Tank |
| Site Entrance C | Satellite O&M |
| Site Entrance D | Substation |
| BESS | Collector HV Transmission Links |
| | Access Tracks |

Figure 3-1: Conceptual Project Layout

3.2 General Description

The Project will involve the construction, operation and decommissioning of wind turbine generators (WTG), Battery Energy Storage System (BESS) and associated infrastructure. The Project will occur largely within the 26,400 ha Project Area as shown on **Figure 3-1** and generally include:

- Up to 247 Wind Turbine Generators (WTGs) of which each has a tip height of up to 280 m and capacity up to 8 MW;
- Electrical reticulation network:
 - Up to six substations and 13 transformers;
 - One BESS 33/330kV substation with three transformers;
 - Internal 33 kV, 66 kV, 132 kV, or 330 kV electrical reticulation network and infrastructure connecting to the 330 kV Project EnergyConnect line via a switchyard and collector station;
 - Approximately 500 MW / 2 gigawatt hours (GWh) Battery Energy Storage System (BESS);
- Other temporary and permanent infrastructure including:
 - Operations and Maintenance (O&M) facilities and infrastructure including site office, control room, storage facilities, car parking and fencing;
 - Accommodation facilities;
 - Construction and operational compounds;
 - Hardstands for WTGs and other infrastructure;
 - Internal access tracks and road turning head connecting Project infrastructure;
 - Meteorological masts; and
 - Concrete batching plants, crushing facilities, gravel / borrow pits, construction laydown areas;
- Ancillary activities including sourcing of materials and equipment for construction; sourcing of water for construction; subdivision and boundary adjustments, visual screening and associated ancillary works;
- Access road use via four locations and Project-required upgrades:
 - Project Area access: via the Cobb Highway from Jerilderie Road in the north east from Wargam Road in the west, from East West Road in the south and West Burrabogie Road in the west, as well as emergency access;
 - Wind farm major components transported via Port of Adelaide;
- Operational workforce of up to 50 Full Time Equivalent (FTE) and construction up to 900 FTE;
- Construction generally within standard construction hours and operations 24 hours per day 7 days per week; and
- Preliminary disturbance footprint of up to 1,066 ha.

No external transmission lines or associated easements are currently anticipated for the Project. Some of the Project-associated infrastructure will be shared with the Pottinger Solar Farm (the subject of a separate application).

3.3 Detailed Description

The purpose of the project is to provide dispatchable energy to the NSW grid and contribute towards the goals of the NSW government's NSW Electricity Infrastructure Roadmap.

The electricity will be capable of storage in a 500 MW / 2,000 MWh BESS which can be dispatched based on electricity demand fluctuations, providing the opportunity for greater supply dispatch flexibility when electricity demand is highest. This is enabled by the fast response times achievable through lithium-ion battery storage. The Project BESS will have capacity to discharge up to 500 megawatts (MW) of power for 4 hours resulting in a storage of 2,000 MWh.

3.3.1 Medium Voltage Power Station (MVPS)

The MVPS house transformers and inverters which will be sited adjacent to the BESS units. There will be 383 MVPSS installed throughout the Project Area which typically comprise:

1. 1 x transformers
2. 1 x inverters

The inverters convert the Direct Current (DC) to Alternating Current (AC), while the transformers increase the voltage from Low Voltage to a Medium or High Voltage, as required for the electricity grid connection. MPVS are a compact, containerised product, with each unit measuring approximately 2.5 metres wide by 3 metres high, with a depth of 6 metres. **Figure 3-2** provides an example of a typical MVPS.



Figure 3-2: Typical MVPS

3.3.2 Battery Storage

The BESS will be located within the site compound, laydown and substation footprint area. The BESS converts electrical energy into chemical energy and stores the energy internally. It may also provide additional network support such as Frequency Control Ancillary Services (FCAS) assisting with transmission network grid stability. A typical BESS is shown in **Figure 3-3**.



Figure 3-3: Typical BESS Arrangement

3.4 Quantities of Dangerous Goods & SEPP-RH Screening

The classes and quantities of DGs provided in **Table 3-1** are indicative and will need to be updated once disclosed. These numbers were adapted from another BESS project with a similar scale (400 MW/1600 MWh) and do not accurately represent the BESS component of the Project. Additionally, the SEPP threshold of the individual classes have been provided for the purposes of the SEARs.

Table 3-1: Maximum Quantities of Dangerous Goods Stored & Preliminary Risk Screening

Area	Class	Description	Quantity	SEPP Threshold
BESS	9	Lithium Batteries	18,450 L	N/A
PCU Transformer	C2	Transformer oils	810,000 L	N/A
Substation Transformer	C2	Transformer oils	80,000 L	N/A
Control room generator	C1	Diesel	300,000 L	N/A

*Approximately 2,111 L per transformer.

4.0 Hazard Identification

4.1 Introduction

A hazard identification table has been developed and is presented at **Appendix A**. This table has been developed following the recommended approach in Hazardous Industry Planning Advisory Paper No. 6, Hazard Analysis Guidelines (Ref. [1]). The Hazard Identification Table provides a summary of the potential hazards, consequences and safeguards at the site. The table has been used to identify the hazards for further assessment in this section of the study. Each hazard is identified in detail and no hazards have been eliminated from assessment by qualitative risk assessment prior to detailed hazard assessment in this section of the study.

In order to determine acceptable impact criteria for incidents that would not be considered for further analysis, due to limited impact offsite, the following approach has been applied:

- Fire Impacts - It is noted in Hazardous Industry Planning Advisory Paper (HIPAP) No. 4 (Ref. [2]) that a criterion is provided for the maximum permissible heat radiation at the Project Area (4.7 kW/m^2) above which the risk of injury may occur and therefore the risk must be assessed. Hence, to assist in screening those incidents that do not pose a significant risk, for this study, incidents that result in a heat radiation less than 4.7 kW/m^2 , at the Project Area, are screened from further assessment.

Those incidents exceeding 4.7 kW/m^2 at the Project Area are carried forward for further assessment (i.e. frequency and risk). This is a conservative approach, as HIPAP No. 4 (Ref. [2]) indicates that values of heat radiation of 4.7 kW/m^2 should not exceed 50 chances per million per year at sensitive land uses (e.g. residential). It is noted that the closest residential area is more than 5 km from the closest BESS, hence, by selecting 4.7 kW/m^2 as the consequence impact criteria the assessment is considered conservative.

- Explosion - It is noted in HIPAP No. 4 (Ref. [2]) that a criterion is provided for the maximum permissible explosion over pressure at the Project Area (7 kPa) above which the risk of injury may occur and therefore the risk must be assessed. Hence, to assist in screening those incidents that do not pose a significant risk, for this study, incidents that result in an explosion overpressure less than 7 kPa, at the Project Area, are screened from further assessment. Those incidents exceeding 7 kPa, at the Project Area, are carried forward for further assessment (i.e. frequency and risk). Similarly, to the heat radiation impact discussed above, this is conservative as the 7 kPa value listed in HIPAP No. 4 relates to residential areas, which are more than 5 km away from the closest BESS.
- Toxicity – Toxic bi-products of combustion may be generated by a BESS fire; hence, toxicity has been assessed.
- Property Damage and Accident Propagation - It is noted in HIPAP No. 4 (Ref. [2]) that a criterion is provided for the maximum permissible heat radiation/explosion overpressure at the Project Area ($23 \text{ kW/m}^2/14 \text{ kPa}$) above which the risk of property damage and accident propagation to neighbouring sites must be assessed. Hence, to assist in screening those incidents that do not pose a significant risk to incident propagation, for this study, incidents that result in a heat radiation less than 23 kW/m^2 and explosion over pressure less than 14 kPa, at the Project Area, are screened from further assessment. Those incidents exceeding 23 kW/m^2 at the Project Area are carried forward for further assessment with respect to incident propagation (i.e. frequency and risk).

- **Societal Risk** – HIPAP No. 4 (Ref. [2]) discusses the application of societal risk to populations surrounding the Project. It is noted that HIPAP No. 4 indicates that where a development proposal involves a significant intensification of population, in the vicinity of such a project, the change in societal risk needs to be taken into account. In the case of the project, there is currently no significant intensification of population around the proposed site; hence, societal risk has not been considered in this assessment.

4.2 Properties of Dangerous Goods

The type of DGs and quantities stored and used at the site has been described in **Section 3. Table 4-1** provides a description of the DGs to be stored and handled at the site, including the Class and the hazardous material properties of the DG Class.

Table 4-1: Properties* of the Dangerous Goods and Materials Stored at the Site

Class	Hazardous Properties
9 – Miscellaneous DGs	Class 9 substances and articles (miscellaneous dangerous substances and articles) are substances and articles which, during transport present a danger not covered by other classes. Releases to the environment may cause damage to sensitive receptors within the environment. It is noted that the Class 9s stored within this project are lithium-ion batteries which may undergo thermal runaway (i.e. escalating reaction resulting in heat which ultimately leads to failure of the battery and a fire).
Combustible Liquids	Combustible liquids are typically long chain hydrocarbons with flash points exceeding 60.5°C. Combustible liquids are difficult to ignite as the temperature of the liquid must be heated to above the flash point such that vapours are generated which can then ignite. This process requires either sustained heating or a high-energy ignition source.

* The Australian Code for the Transport of Dangerous Goods by Road and Rail (Ref. [5])

4.3 Hazard Identification

Based on the hazard identification table presented in **Appendix A**, the following hazardous scenarios have been developed:

- Li-ion battery fault, thermal runaway and fire.
- Victorian Big Battery fire review.
- Li-ion battery fire and toxic gas dispersion.
- Electrical equipment failure and fire.
- Transformer internal arcing, oil spill, ignition and bund fire.
- Transformer electrical surge protection failure and explosion
- Electromagnetic field Impacts.
- National Health and Medical Research Council review.

Each identified scenario is discussed in further detail in the following sections.

4.4 Li-Ion Battery Fault, Thermal Runaway and Fire

Lithium ion (Li-ion) batteries are composed of a metallic anode and cathode which allows for electrons released from the anode to travel to the cathode where positively charged ions in the solute migrate to the cathode and are reduced. The flow of electrons provides the source of energy

which is discharged from a battery and used for work. In a Li-ion battery, the lithium metal composites (a composite of lithium with other metals such as cobalt, manganese, nickel, or any combination of these metals) oxidises (loses an electron) becoming a positively charged ion in solution which migrates through the battery separator to the cathode. At the same time, the lost electron travels through the circuit to the cathode. The lithium ions in solution then recombine with the electron at the cathode forming lithium metal within the cathodic metal composite. This process is shown in **Figure 4-1**.

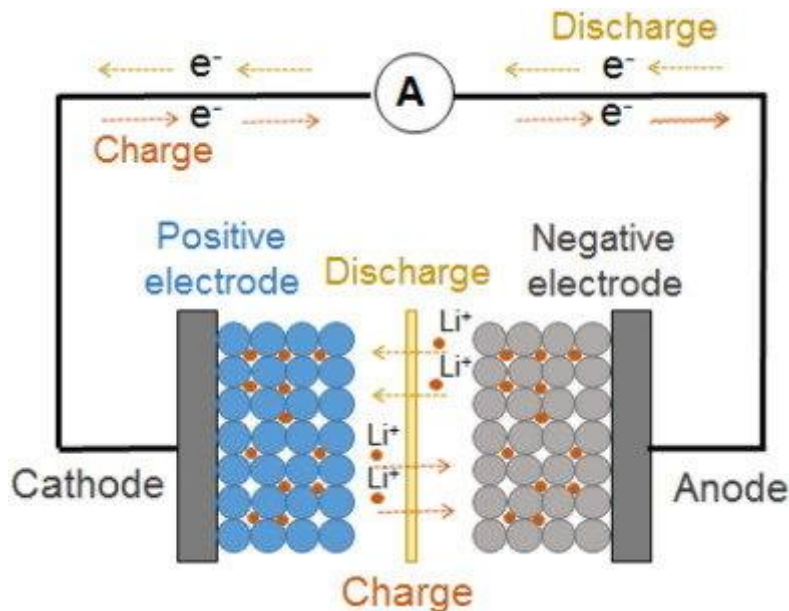


Figure 4-1: Cathode and Anode of a Battery (Source Research Gate)

Initial lithium batteries were designed around lithium metal (i.e. no composite structure) due to the high energy density yielded by the metal. However, when overcharging a battery, lithium ions can begin to plate on the anode in the form of lithium dendrites. Eventually, the dendrites pierce the separator within the battery resulting in a short of the battery which could result in heat, fire, or explosion of the battery. The technology evolved to move away from lithium metal to lithium ions (held within composite materials) which reduced the incidence of lithium dendrites forming resulting in an overall safer battery.

Despite the improvement in battery technology, there are several degradation mechanisms that are still present within the battery which can result in thermal runaway. These include:

- Chemical reduction of the electrolyte at the anode
- Thermal decomposition of the electrolyte
- Chemical reduction of the electrolyte at the cathode
- Thermal decomposition by the cathode and the anode
- Internal short circuit by charge effects

These effects arise primarily as a result of high discharge, overcharging, or water ingress into the battery which results in a host of bi-products being formed within the battery during charge and discharge cycles.

As a result, Li-ion batteries are equipped with several safety features to prevent the batteries from charging or discharging at voltages which result in battery degradation, leading to shorting of the battery and thermal runaway. Safety features generally include:

- Shut-down separator (for overheating)
- Tear-away tab (for internal pressure relief)
- Vent (pressure relief in case of severe outgassing)
- Thermal interrupt (overcurrent/overcharging/environmental exposure)

These features are designed to prevent overcharging or excessive discharge, pressurisation arising from heat generated at the anode or from battery contamination. Protection techniques for Li-ion batteries are standard; hence, the potential for thermal runaway to occur in normal operation is very low with the only exceptions being due to manufacturing faults or battery damage (i.e. battery cell is ruptured as this can short circuit the battery resulting in thermal runaway).

In terms of physical damage, the batteries are contained within modules which are located within a fenced area; therefore, there is a low potential for damage to occur to the batteries which may initiate an incident.

A review of the batteries proposed to be used as part of this project indicates the battery chemistry is Lithium-Ion phosphate (LiFePO_4 , or simply LFP) which are considered to be one of the safest battery chemistries within the industry. When exposed to external heat the thermal rise of typical lithium-ion battery chemistries is 200-400 °C/min resulting thermal run away and fire which can then propagate to adjacent batteries escalating the incident to a full container fire. For LFP batteries, the thermal rise of the batteries at peak is 1.5°C/min which results in a gradual temperature rise and does not result in fire and thus incident propagation to other batteries. The thermal rise of various battery chemistries is provided in **Figure 4-2** with a zoomed in temperature rise for LFP provided in the top right of **Figure 4-2**. The stability of the batteries is due to the cathode which does not release oxygen therefore preventing violent redox reactions resulting in rapid temperature rise as the oxygen oxidises the electrolyte.

Additional testing for shock and damage to batteries (i.e. nail puncture test) has been shown that LFP batteries when punctured through membranes which typically results in a shorting of the battery and fire does not result in ignition of the battery demonstrating that the battery chemistry is protected against shock damage.

In the event that LFP chemistries do ignite by artificial means, the combustion by products release carbon dioxide which reduces the oxygen concentration within a confined space reducing the combustion rate. Finally, the containers are fitted with a fire suppression system which will activate to suppress and control a fire preventing escalation to other battery units.

Thermal Runaway: Impact of Cell Chemistry

Accelerating rate calorimetry (ARC) of 18650 cells with different cathode materials

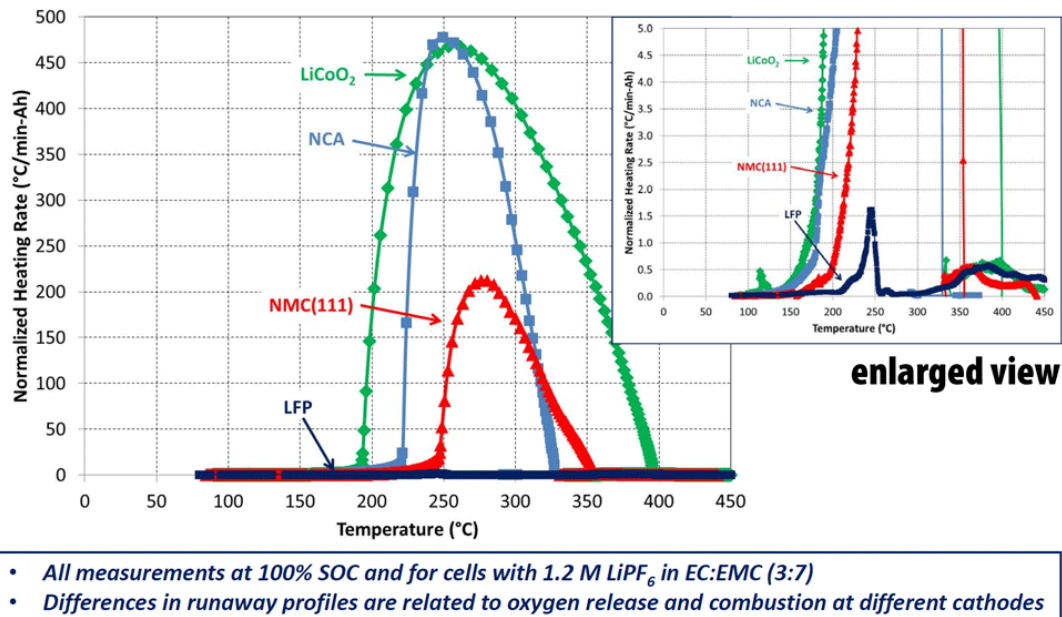


Figure 4-2: Temperature Rise of Lithium-Ion Battery Chemistries (Ref. [6]).

It is important to consider whether the batteries have been certified to UL9540A, which is the UL safety standard for non-residential battery testing, which contains requirements for electrical safety, thermal safety, mechanical safety, fire safety, system performance, system reliability, and system documentation. The preliminary battery product considered for the purposes of a preliminary hazard analysis for the project is a BESS with LFP technology. A UL9540A report has been completed for this product but is unable to be shared due to privacy reasons.

Similarly, based on data shown from UL9540A reports for similar systems, the results demonstrate that when thermal runaway is triggered in one cell in a BESS container, the heat generated would neither be transferred to all cells within one battery module, nor from the test module to adjacent ones. This is attributed to the nature of LFP technology as well as the sheer mass of the battery module (heavier objects have higher thermal capacity).

Although the LFP technology does not cause fire, there can be circumstances where battery modules catch fire due to leaking coolant or electric faults. In those cases, fire will be constrained by the stainless-steel enclosure. Similar systems show that generally the container wall remains intact after sustaining heating in a furnace to over 900°C.

Furthermore, each container should also have multiple built-in fire protection devices that work collaboratively, including smoke and thermal sensors, combustible gas detector, pressure relief system, and aerosol E-Stop buttons. Therefore, a container will automatically detect an internal fire in the first instance.

Different systems deploy different battery fire mitigation strategies depending on the solution, but in any case, the Project will implement the manufacturer's recommended fire protection systems. The assessed and final selected system will hold relevant UL and IEC certifications (i.e. UL9540, UL9540A, UL1741, UL1973, UN38.3; CE; EMC; NFPA 70; IEEE C37.32; IEC:62933, 62619, 60204, ASTM4169).

In conclusion, the LFP technology is unlikely to cause fire during thermal runaway provided the protection systems are in place and operating. Should fire be developed within one BESS container it would not transfer to nearby containers due to the fire safety design features; hence, this incident has not been carried forward for further analysis.

Notwithstanding, based on conversations with and review by NSW DPHI, the following recommendations have been made:

- BESS must be tested in accordance with UL9540A.
- Testing to demonstrate clearances required to prevent propagation of fires between separated units.
- BESS to be installed in accordance with manufacturer and UL9540A report recommended clearances based on testing.
- BESS to be installed with fire protection systems specified by the manufacturer and UL9540A report.
- Before construction, detailed design to validate the system can be installed in the Project Area whilst meeting the recommended clearances.
- UL testing information shall be made available to the certifying authority. It is noted that a confidentiality agreement may be required.

4.5 Victorian Big Battery Fire Review

Notwithstanding the findings of **Section 4.4**, it is necessary to review recent large scale BESS fires to determine whether similar incidents could occur with the Pottinger Wind Farm BESS.

The Pottinger Wind Farm BESS has thoroughly considered the separation distance considering fire safety, and operation and maintenance. The fire safety assessment is essentially around heat transfer which has been discussed in detail in **Section 4.4**.

The Victorian Big Battery (VBB) also has a back-to-back layout. According to the independent investigation report on its fire incidence, the back-to-back layout was not the cause. The main reason for fire propagation was strong wind blowing flames from one Megapack into the unprotected vent atop of an adjacent Megapack which resulted in the ignition of the plastic fan which was able to impact the battery modules directly beneath the fan.

Lessons learnt from the VBB incident results in fire safety precautions on the design of the Pottinger Wind Farm BESS. The vent atop the containers shall be made of metal instead of plastic and covered by a metallic mesh shield. Furthermore, the placement of the fans shall be such that batteries or flammable materials shall not be located directly beneath ventilation openings. To ensure the above are captured the following recommendations have been made:

- The vent covers of the BESS shall be constructed of non-combustible material.
- The vents shall not be located above battery packs within the BESS container.

Based upon the designs incorporated with the container based upon the VBB fire, the available area assessment and the separation distance assessment, it is considered that the propagation between two units is considered unlikely; hence, this incident has not been carried forward for further analysis.

4.6 Li-ion Battery Fire and Toxic Gas Dispersion

If a BESS failure occurs resulting in a fire, toxic bi-products of combustion may form. A literature review was conducted on lithium-ion battery fires to identify the toxic gases which may be generated in the event of a fire. The review identified the following gases or classes of gases can form:

- Carbon dioxide.
- Carbon monoxide.
- Fluorine gases.

Each of these have been discussed in further detail in the following subsections.

4.6.1 Carbon Dioxide

Carbon dioxide is a colourless, odourless, dense gas which is naturally forming and is present in the atmosphere at concentrations around 415 ppm (0.0415%). At low concentrations carbon dioxide is physiologically impotent and at low concentrations does not appear to have any toxicological effects. However, as the concentration grows it increases the respiration rate with short term Exposure Limit (STEL) occurring at 30,000 ppm (3%), above 50,000 ppm (5%) a strong respiration effect is observed along with dizziness, confusion, headaches, and shortness of breath. Concentrations in excess of 100,000 ppm (10%) may result in coma or death.

Carbon dioxide is a by-product of combustion where hydrocarbon or carbon-based materials are involved. A typical combustion reaction producing carbon from a hydrocarbon has been provided in **Equation 4-1**. This reaction proceeds when there is an excess of oxygen to the fuel being consumed and is known as complete combustion as it is the most efficient reaction pathway.




The lithium-ion batteries are predominantly composed of metal structures. However, during a fire event ancillary equipment and materials within the batteries will be involved in the fire including wiring, plastics, anodes, etc. which will liberate carbon dioxide. However, a review of the toxicological impacts indicates high concentrations would be required to result in injury or fatality. Based upon a review of the sensitive areas, and the similar BESS fires (i.e. Victoria BESS fire), it is not considered that the formation of carbon dioxide in a fire would be sufficient to result in downwind impacts sufficient to cause injury or fatality. In other words, there would be insufficient production of carbon dioxide to generate a plume of sufficient concentration to displace the required oxygen for a significant downwind consequence to occur. Therefore, this incident has not been carried forward for further analysis.

4.6.2 Carbon Monoxide

Carbon monoxide is an odourless, colourless gas which is slightly denser than air and occurs naturally in the atmosphere at concentrations around 80 ppb. Carbon monoxide is a toxic gas as it irreversibly binds with haemoglobin which prevents these molecules from carrying out the function of oxygen / carbon dioxide exchange. The loss of 50% of the haemoglobin may result in seizures, coma or death which can occur at concentration exposures of approximately 600 ppm (0.06%).

Carbon monoxide is by-product of combustion if there is insufficient oxygen to enable complete combustion. The reaction pathway for the formation of carbon monoxide is provided in **Equation 4-2**.




Equation 4-2

As noted, in **Section 4.6.1** there is the potential for a fire to occur with the BESS units which could form carbon monoxide if there is insufficient oxygen to sustain complete combustion. However, it is noted that the combustible load within the BESS which could result in the formation of carbon monoxide is relatively low compared to the available oxygen in the surrounding atmosphere. Therefore, it is considered that the formation of carbon monoxide at levels which would result in a substantial downwind impact are not considered credible and subsequent analysis of, this incident is not required.


4.6.3 Fluoride Gases

The electrolyte used in Li-ion batteries typically is lithium hexafluorophosphate (LiPF₆) or other li-salts containing fluorine. In the event of a thermal runaway, the electrolyte will expand and be vented from the battery. In the event of a fire, the vented gas and other components such as the polyvinylidene fluoride binders may form gases such as hydrogen fluoride (HF), phosphorous pentafluoride (PF₅) and phosphoryl fluoride (POF₃) (Ref. [7]).

The decomposition of LiPF₆ can be promoted by the presence of water / humidity according to reactions **Equation 4-3** to **Equation 4-5**.



Equation 4-3



Equation 4-4



Equation 4-5

Of the fluorine gases formed, PF₅ is a short-lived gas while POF₃ is a reactive intermediate. Thermal destruction of a several battery chemistry, configurations and State of Charge (SOC) indicated the vast majority of these did not produce observable POF₃ with the only observance occurring in a specific battery chemistry at 0% SOC (Ref. [7]). Therefore, the main fluorine gas of concern in a Li-ion battery fire is HF.

HF gas is hygroscopic readily dissolving into water vapour / humidity or moisture in airways forming hydrofluoric acid. Hydrofluoric acid is a weak acid although is highly corrosive and may result in chemical burns. In addition, it is calcium scavenging. Hence, it will readily bind with calcium in cells and tissues disrupting the nerve signalling. The immediately dangerous to life or Health (IDLH) for HF is 30 ppm and the 10-minute lethal concentration is 170 ppm.

For a toxic gas dispersion, a battery container fire is necessary as the initiating event. As discussed in **Section 4.4** the potential for a fire to occur is considered unlikely provided the protection systems are installed and operating. As the potential for the initiating event is considered unlikely, this incident has not been carried forward for further analysis.

4.7 Electrical Equipment Failure and Fire

Electrical equipment is located within the switch room which may fail resulting in overheating, arcing, etc. which could initiate a fire. In the event of a fire, it may begin to propagate to adjacent combustible materials (i.e. wiring). It is noted that electrical equipment fires typically start by smouldering before flame ignition occurs resulting in a slow fire development.

The type of equipment used within the Project is ubiquitous throughout the world and across industry segments and is therefore not a unique fire scenario. Based upon fire development within

switch rooms the fire would be considered to be relatively slow in growth and would be unlikely to result in substantial impacts in terms of offsite impact or incident propagation. Therefore, this incident has not been carried forward for further analysis.

4.8 Transformer Internal Arcing, Oil Spill, Ignition and Bund Fire

Transformers contain oil which is used to insulate the transformers during operation. If arcing occurs within the transformer (e.g. due to a low oil level), the high energy passing through the coolant vaporises the oil into light hydrocarbons (methane, ethane, acetylene, etc.) resulting in rapid pressurisation within the reservoir.

Notwithstanding the protection systems, if the pressure rise exceeds the structural integrity of the reservoir, and the installed pressure relief devices, the reservoir can rupture allowing the release of oil into the bund. The rupture also allows oxygen to enter the reservoir. The temperature of the gases is above the auto ignition point, but this does not occur until oxygen is present. When oxygen enters the reservoir, the gases auto ignite which generates sufficient heat to ignite the oil in the bund.

Notwithstanding this, transformers are ubiquitous units with a low potential for failure and the separation distance to the Project Area and other adjacent units would be unlikely to result in incident propagation and offsite impacts. Therefore, this incident has not been carried forward for further analysis.

4.9 Transformer Electrical Surge Protection Failure and Explosion

Transformers generate large amounts of heat as a result of the high electrical currents that pass through them; hence, oil is used as an insulating material within the transformers to protect the mechanical components. However, if the transformer gets an extreme surge of energy, such as that which could occur due to a lightning strike, and the electrical surge protection measures fail, the mineral oil may start to decompose and vapourise, resulting in gas bubbles of hydrogen and methane (Ref. [8]) as temperatures above the autoignition of the gases.

The formation of gases will increase the pressure within the transformer which can result in the transformer structure rupturing which allows the ingress of oxygen. As the oxygen enters, the concentration of flammable gases falls within the explosive limits which are above their autoignition temperatures which ignite resulting in increased formation of hot gaseous products resulting in an explosion. The explosion may generate significant overpressure, sparks and fire and would result in a whole transformer fire, as discussed in **Section 4.8**.

In order to protect against overheating and explosions, transformers generally have surge protection devices which shunt electrical surges safely to ground. However, this surge detection and protection devices are not universally installed nor do they protect against all events such as in the case of a major lightning strike or significant oil deterioration, leakage of water into the transformer, and physical damage such as a fallen tree (Ref. [9]). Therefore, there is the potential for an explosion to occur which may result in offsite impacts; however, as previously noted, these units are ubiquitous and have a low potential for failure. Therefore, this incident has not been carried forward for further analysis.

4.10 Electromagnetic Field Impacts

4.10.1 Introduction

Electric and Magnetic Fields (EMFs) are associated with a wide range of sources and occur both naturally as well as man-made. Naturally occurring EMFs, occurring during lightning storms, are generated from Earth's magnetic field. Man-made EMFs are present wherever there is electricity; hence, EMFs are present in almost all built environments where electricity is used.

Extremely low frequency (ELF) electric and magnetic fields (EMF) occupy the lower part of the electromagnetic spectrum in the frequency range 0-3,000 Hz which is the current will change direction 0-3,000 times a second. ELF EMF result from electrically charged particles. Artificial sources are the dominant sources of ELF EMF and are usually associated with the generation, distribution and use of electricity at the frequency of 50 Hz in Australia. The electric field is produced by the voltage whereas the magnetic field is produced by the current.

BESS create EMFs from operational electrical equipment, such as transmission lines, transformers and the electrical components found within BESS units, inverters, etc. This equipment has the potential to produced ELF EMF's in the range of 30 to 300 Hz.

4.10.2 Existing Standards

There are currently no existing standards in Australia for governing the exposure limits to ELF EMFs; however, the International Commission on Non-Ionizing Radiation Protection (ICNIRP) has provided some guidelines around exposure limits for prolonged exposure which limits the exposure to 2,000 milligauss (mG) for members of the public in a 24 hour period (Ref. [10]).

Table 4-2 provides typical magnetic field measurements and ranges associated with EMF sources. It is noted that electric fields around devices are generally close to 0 due to the shielding provided around the equipment. In addition, EMF levels drop away quickly with distance; hence, while a value may be measurable at the source, within a short distance the EMF is undetectable.

Table 4-2: EMF Sources and Magnetic Field Strength

Source	Typical Measurement (mG)	Measurement Range (mG)
Television	1	0.2 – 2
Refrigerator	2	2 – 5
Kettle	3	2 – 10
Personal computer	5	2 – 20
Electric blanket	20	5 – 30
Hair dryer	25	10 – 70
Distribution powerline (under the line)	10	2 – 20
Transmission power line (under the line)	20	10 – 200
Edge of easement	10	2 – 50

4.10.3 Exposure Discussion

A review of the site indicates that the closest residential receiver is over 1 km away from the area where the wind farm or BESS will be developed providing substantial distance for attenuation of EMFs. Based upon the typical levels which may be generated by transmission equipment the

cumulative effect would not exceed the 2,000 mG limit for prolonged exposure. In addition, the closest residence is over 1 km away from the EMF generating sources at the BESS; hence, the potential for the EMF to exceed the accepted levels is considered negligible.

The Australian Radiation Protection and Nuclear Safety Agency (ARPANSA) advises that the strength of radiation decreases exponentially with distance from the source, and it will become indistinguishable from background radiation within 50 m of a high voltage power line and within 5 to 10 m of a substation. (Ref. [11]).

A field study was undertaken to characterise the EMF between the frequencies of 0 – 3 GHz at two large scale facilities operated by the Southern California Edison Company in Porterville and San Bernardino, (Ref. [12]).

The field study findings were adopted to estimate the EMF measurements for the Project. The findings are as follows:

- The highest DC magnetic fields were measured adjacent to the inverter (277 μ T) and transformer (258 μ T). These fields were lower than the ICNIRP's occupational exposure limit.
- The highest AC magnetic fields were measured adjacent to the inverter (110 μ T) and transformer (177 μ T). These fields were lower than the ICNIRP's occupational exposure limit.
- The strength of the magnetic field attenuated rapidly with distance (i.e. within 2-3 metres away, the fields drop to background levels).
- Electric fields were negligible to non-detectable. This is mostly likely attributed to the enclosures provided for the electricity generating equipment.

As the strengths of EMF attenuate rapidly with distance, the ICNIRP reference level for exposure to the general public will not be exceeded and impact to the general public in surrounding land uses is negligible.

As the potential for exposure to EMF exceeding the international guidelines is negligible, this incident has not been carried forward for further analysis.

4.11 National Health and Medical Research Council review

The National Health and Medical Research Council (NHMRC) has released an information paper containing independent research on the relationship between wind farms and human health (Ref. [13]). Three main concerns stemming from the operation of wind farms were identified and investigated in the research paper, which are: (1) noise generated by the WTGs, (2) shadow flicker from the turning of the wind blades, and (3) electromagnetic radiation. However, it should be noted that the paper particularly focuses on noise rather than the other two issues.

According to the NHMRC paper, exposure to noise from WTGs may have adverse impacts on the human health. Results show that the effect of noise on human health from wind farms are associated with hearing loss, disturbed sleep, and annoyance. Furthermore, a prolonged exposure may lead to health complications involving high blood pressure and heart disease; some health experts have reported a condition referred to “vibroacoustic disease” in individuals exposed to high levels of low-frequency sound and infrasound. From surveys, the main source of noise emission from WTGs has been described as a “swishing” noise, or “aerodynamic noise” resulting from the interaction of wind fluid flow and the surface of the rotor blades. However, throughout the paper, NHMRC has noted that there is a lack of strong evidence that supports causation between the

noise generated from WTGs and human health. For perspective, a summary of noise generated from WTGs and other similar sources has been provided in **Table 4-3**.

Table 4-3: Sources of Noise with Associated Level

Source	Approximate noise levels (dBA)
Whisper	30
Wind farm beyond 1,500 m	35
Wind farm 500 m to 1,500 m	45
Rain	50
Normal conversation	60
Traffic	80
Unhealthy threshold for prolonged exposure	90
Aircraft on take off	120

The methodology employed in the study faced challenges related to the ambiguity surrounding the causes of reported health concerns, such as annoyance and sleep disturbance, within the sample size. It remained unclear whether these issues stemmed solely from the noise emissions of wind turbine generators (WTGs) or if other factors were contributing. The National Health and Medical Research Council (NHMRC) conducted research and ultimately concluded that there was no consistent or direct evidence linking exposure to wind farm noise to adverse effects on physical or mental health. The NHMRC findings suggest that any observed impact on human health may be attributed to chance rather than a direct correlation with WTG noise emissions. Moreover, parallel evidence supports the assertion that there are unlikely to be significant effects on physical or mental health beyond distances greater than 1,500 meters from wind farms. Given that the closest residential receiver in the studied wind farm is over 1 km away, the anticipated impact of noise from wind farms is expected to be negligible.

The impacts of EMF from wind farms have been thoroughly discussed in **Section 4.10.3** in accordance with thresholds postulated by the ICNIRP; however, the information paper lacks a comprehensive exploration of shadow flicker, despite a high-risk study revealing that individuals residing within a 5 km radius of a wind turbine are more likely to experience annoyance compared to those living farther away. Recognising the existing gap in current literature, there is a need for additional research on shadow flicker. It must be noted that, being a visual stimulus, the potential effects may be less pronounced than those of noise or EMF, owing to inherent limitations in the sense of vision. Factors such as the inability to perceive wind turbines during nighttime, obstructed views indoors, and other contextual constraints may contribute to the perceived reduced impact of shadow flicker in comparison to other environmental stimuli. Further investigation is warranted to comprehensively understand the potential health implications of shadow flicker in proximity to wind farms.

In accordance with the findings of NHMRC's information paper and the location of residential receivers in the vicinity of the Project Area, the effects of emission from WTGs is considered to be negligible to nearby sensitive receivers. As the potential for adverse health impacts is considered negligible, this incident has not been considered for further analysis.

5.0 Conclusion and Recommendations

5.1 Conclusions

A hazard identification table was developed for the Pottinger Wind Farm & BESS Project to identify potential hazards that may be present at the site as a result of operations or storage of materials. Based on the identified hazards, scenarios were postulated that may result in an incident with the potential for offsite impacts. Postulated scenarios were discussed qualitatively and any scenarios that would not impact offsite were eliminated from further assessment. Scenarios not eliminated were then carried forward for consequence analysis.

A review of the incidents carried forward for further analysis indicates that there were no observed offsite impacts; therefore, based on the analysis conducted, it is concluded that the risks at the Project Area are not considered to exceed the acceptable risk criteria; hence, the Project would only be classified as potentially hazardous and would be permitted within the current land zoning for the site. It must be noted that the required bushfire assessment is provided under separate cover.

5.2 Recommendations

The following recommendations have been made as a result of the assessment:

- BESS must be tested in accordance with UL9540A.
- Testing to demonstrate clearances required to prevent propagation of fires between separated units.
- BESS to be installed in accordance with manufacturer and UL9540A report recommended clearances based on testing.
- BESS to be installed with fire protection systems specified by the manufacturer and UL9540A report.
- Before construction, detailed design to validate the system can be installed in the Project Area whilst meeting the recommended clearances.
- UL testing information shall be made available to the certifying authority. It is noted that a confidentiality agreement may be required.
- The vent covers of the BESS shall be constructed of non-combustible material.
- The vents shall not be located above battery packs within the BESS container.

6.0 References

- [1] Department of Planning, Housing and Infrastructure, “Hazardous Industry Planning Advisory Paper No. 6 - Guidelines for Hazard Analysis,” Department of Planning, Housing and Infrastructure, Sydney, 2011.
- [2] Department of Planning, Housing and Infrastructure, “Hazardous Industry Planning Advisory Paper No. 4 - Risk Criteria for Land Use Safety Planning,” Department of Planning, Housing and Infrastructure, Sydney, 2011.
- [3] SafeWork NSW, “Work Health and Safety Regulation,” SafeWork NSW, Lisarow, 2017.
- [4] Department of Planning, Housing and Infrastructure, Multi-Level Risk Assessment, Sydney: Department of Planning, Housing and Infrastructure, 2011.
- [5] National Transport Commission (NTC), “Australian Code for the Transport of Dangerous Goods by Road & Rail, 7th Edition,” 2011.
- [6] Power Tech Systems, “Safety of Lithium-Ion batteries,” Power Tech Systems, 2022. [Online]. Available: <https://www.powertechsystems.eu/home/tech-corner/safety-of-lithium-ion-batteries/>. [Accessed 13 April 2022].
- [7] F. Larson, P. Andersson, P. Blomqvist and B.-E. Mellander, “Toxic fluoride gas emissions from lithium ion battery fires,” *Nature: Scientific Reports*, 2017.
- [8] J. Demos, “What Causes Transformer Explosions and Burns?,” Durabarrier USA Fire Barrier Experts, 26 July 2021. [Online]. Available: <https://firebarrierexperts.com/what-causes-transformer-explosions-and-burns>. [Accessed 2 February 2022].
- [9] P. Hoole, S. Rufus, N. Hashim, M. Saad, S. Abdullah, A. Othman, K. Piralaharan, A. CV and S. Hoole, “Power Transformer Fire and Explosion: Causes and Control,” *International Journal of Control Theory and Applications*, vol. 10, no. 16, pp. 211-219, 2017.
- [10] International Commission on Non-Ionizing Radiation Protection, “ICNIRP Guideline for Limiting Exposure to Time-Varying Electric and Magnetic Fields (1-100 Hz),” International Commission on Non-Ionizing Radiation Protection, 2010.
- [11] EMM Consulting Pty Ltd, “Planning Permit Application Mornington Battery Energy Storage System,” EMM Consulting, Sydney, 2021.
- [12] R. Tell, H. A., S. H. C., M. G. G., H. G. and R. Kavet, “Electromagnetic Fields Associated with Commercial Solar Photovoltaic Electric Power Generating Facilities,” *Journal of occupational and environmental hygiene*, vol. 12, no. 11, pp. 795-803, 2015.
- [13] National Health and Medical Research Council, “Information Paper - Evidence on Wind Farms on Human Health,” Department of Health, Canberra, 2015.

[14] Standards Australia, “AS/NZS 3000:2007 - Wiring Rules,” Standards Australia, Sydney, 2007.

Appendix A

Hazard Identification Table

Appendix A

A1. Hazard Identification Table

Area/Operation	Hazard Cause	Hazard Consequence	Safeguards
Battery Storage	<ul style="list-style-type: none"> Failure of Li-ion battery protection systems 	<ul style="list-style-type: none"> Thermal runaway resulting in fire or explosion Incident propagation through battery cells Toxic smoke dispersion 	<ul style="list-style-type: none"> Batteries are tested by manufacturer prior to sale / installation Overcharging and electrical circuit protection Battery monitoring systems Batteries composed of subcomponents (i.e. BBU, cells) reducing risk of substantial component failure Batteries are not located in areas where damage could easily occur (i.e. within the fenced property) Electrical systems designed per AS/NZS 3000:2007 (Ref. [14]) UL9540A testing Manned facility Water supply (>20,000 L) is provided for emergency activities in consultation with NSW RFS.
Switch rooms, communications, etc.	<ul style="list-style-type: none"> Arcing, overheating, sparking, etc. of electrical systems 	<ul style="list-style-type: none"> Ignition of processors and other combustible material within servers and subsequent fire 	<ul style="list-style-type: none"> Fires tend to smoulder rather than burn Isolated location Switch room separation from other sources of fire
Substation	<ul style="list-style-type: none"> Arcing within transformer, vaporisation of oil and rupture of oil reservoir 	<ul style="list-style-type: none"> Transformer oil spill into bund and bund fire 	<ul style="list-style-type: none"> Bunded Isolated location
	<ul style="list-style-type: none"> Power surge to transformers (e.g. from lightning) 	<ul style="list-style-type: none"> Major failure of surge protection in transformer, vapourisation of mineral oil, ignition and explosion 	<ul style="list-style-type: none"> Transformers have surge protection system to shut down upon detection of extreme energy input Lightning protection to prevent lightning strikes impacting transformers Control of ignition sources – no smoking / open flames around the transformers

Area/Operation	Hazard Cause	Hazard Consequence	Safeguards
EMF	<ul style="list-style-type: none"> Electric and magnetic equipment 	<ul style="list-style-type: none"> Generation of ELF EMF and injury / nuisance to surrounding area 	<ul style="list-style-type: none"> Large separation distances allow for attenuation of EMFs Cumulative impacts from equipment below acceptable thresholds. Low occupancy density within vicinity of the development