



A Jensen Hughes Company

Deicorp Projects  
(Showground East) Pty Ltd

Showground Precinct East  
Lots 3, 4 & 5, Castle Hill NSW

**Access Review –  
Revision 1**

(Job Number 00386)

9 February 2024



REPORT REVISIONS		
Date	Version	Drawing No / Revision
21.11.23	Draft	Pre-DA drawing set – Issued For Review (14.11.23)
21.12.23	Final	Final DA drawings issued 11.12.23 (Adaptable units layout plans issued 15.12.23)
09.02.24	Revision 1	Revised DA drawings issued 07.02.24

Prepared by

DocuSigned by:  
*Daniel Wong*  
602B2553CAFB43F...

Daniel Wong  
Snr Access Consultant

Reviewed by

DocuSigned by:  
*Jeremy Tagle*  
0772758E2FF1493...

Jeremy Tagle  
Associate



## Table of contents


1. Executive Summary	4
2. Introduction	5
2.1 Background	5
2.2 Objectives	5
2.3 Limitations	5
2.4 Accessibility of Design	6
2.5 Statutory Requirements	6
3. General Access Planning Considerations	8
4. Ingress & Egress	10
4.1 External Linkages	10
4.2 Entrances	10
4.3 Emergency Egress	11
5. Paths of Travel	12
5.1 Circulation Areas	12
5.2 Passenger Lifts	12
5.3 Stairs & Ramps	12
6. Adaptable Units	14
6.1 Adaptable Unit Provision	14
6.2 Adaptable Unit Design	15
7. SEPP 65 Silver Livable Units	19
7.1 Silver Livable Unit Provision	19
7.2 Silver Livable Unit Design	20
8. Facilities & Amenities	21
8.1 Sanitary Facilities	21
8.2 Common Areas	21
8.3 Car Parking	21
9. Conclusion	23

## 1. Executive Summary

The Access Review Report is a key element in the design development of the proposed residential apartments development located at Lots 3, 4 and 5, Showground Precinct East, within the Hills Showground Station Precinct, NSW and an appropriate response to the AS1428 series, Building Code of Australia (BCA), DDA Access to Premises Standards (including DDA Access Code) and ultimately the Commonwealth Disability Discrimination Act (DDA).

Morris-Goding Accessibility Consulting has prepared the Access Report to provide advice and strategies to maximise reasonable provisions of access for people with disabilities.

The review will ensure that ingress and egress, paths of travel, circulation areas, and sanitary facilities comply with relevant statutory guidelines, and in addition, compliance with a higher level of accessibility and inclusiveness benchmarks set by the project.

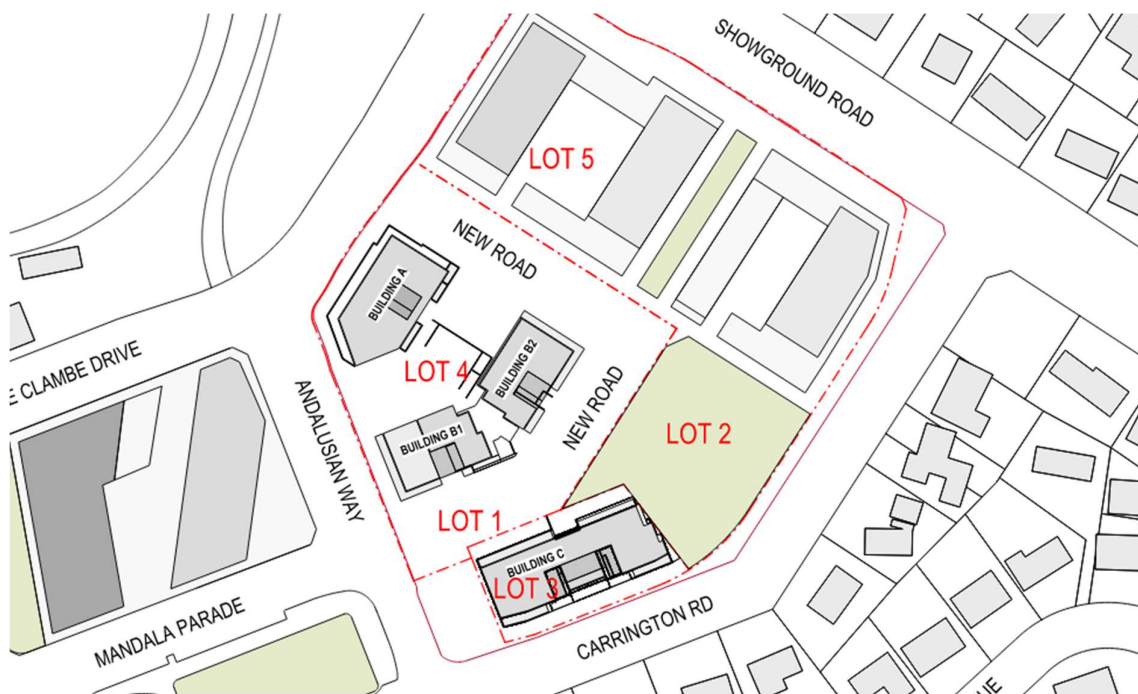

*Overall site plan comprising Lots 3, 4 and 5, being the subject lots of this development.*



## 2. Introduction

### 2.1 Background

Deicorp has engaged Morris-Goding Accessibility Consulting, to provide a design review of the proposed residential apartments development Showground Precinct East, within the Hills Showground Station Precinct located at Lots 3, 4 and 5, Andalusian Way Castle Hill NSW. The development comprises of

- 7 residential towers (3-16 storeys) consisting of a total of 873 apartment units;
- 4 levels of shared basement parking associated with the apartments;
- common area spaces within the landscaping part of the infrastructure and civil upgrades.

The proposed development falls under a number of BCA classifications:

- Class 2 (residential)
- Class 7a (carpark)

The requirements of the investigation are to:

- Review supplied drawings of the proposed development;
- Provide a report that will analyse the provisions of disability design of the development, and
- Recommend solutions that will ensure the design complies with the Disability Discrimination Act (DDA), Building Code of Australia (BCA), relevant Australian Standards, and enhanced benchmark requirements set by the project.

### 2.2 Objectives

The Report seeks to ensure compliance with statutory requirements and enhanced benchmark requirements set by the project. The Report considers user groups, who include students, staff, and members of the public. The Report attempts to deliver equality, independence and functionality to people with a disability inclusive of:

- People with a mobility impairment (ambulant and wheelchair);
- People with a sensory impairment (hearing and vision); and
- People with a dexterity impairment

The Report seeks to provide compliance the Disability Discrimination Act 1992. In doing so, the report attempts to eliminate, as far as possible, discrimination against persons on the ground of disability.

### 2.3 Limitations

This report is limited to the accessibility provisions of the building in general. It does not provide comment on detailed design issues, such as: internals of accessible/ambulant toilet, fit-out, lift specification, slip resistant floor finishes, door schedules, hardware and controls, glazing, luminance contrast, stair nosing, TGSIs, handrail design, signage etc. that will be included in construction documentation.



## 2.4 Accessibility of Design

The proposed design will utilise the Federal Disability Discrimination Act (DDA), Disability (Access to Premises – Buildings) Standards 2010, BCA/DDA Access Code, Universal Design principles, the AS 1428 Series, and other design guidelines, to develop appropriate design documentation, to provide reasonable access provisions for people with disabilities.

The Project Architect and an appropriately qualified accessibility consultant will examine key physical elements during design development stage, to identify physical barriers and incorporate solutions as a suitable response to disability statutory regulations and other project objectives.

The design will be developed to ensure the principles of the DDA are upheld. Under the DDA, it is unlawful to discriminate against people with disabilities in the provision of appropriate access, where the approach or access to and within a premise, makes it impossible or unreasonably difficult for people with disabilities to make use of a particular service or amenity.

The design will comply with the requirements of the DDA Access to Premises Standards and include requirements for accessible buildings, linkages and the seamless integration of access provisions compliant with AS1428.1. The developed design will consider all user groups, who include members of the public, visitors, students and staff members.

## 2.5 Statutory Requirements

The statutory and regulatory guidelines to be encompassed in the developed design to ensure effective, appropriate and safe use by all people including those with disabilities will be in accordance with:

- Federal Disability Discrimination Act (DDA);
- Disability (Access to Premises – Buildings) Standards 2010;
- Building Code of Australia 2022 (BCA) Part D4, F4, E3;
- AS 1428.1:2009 - (General Requirement of Access);
- AS 1428.4.1:2009 - (Tactile Ground Surface Indicators);
- AS 2890.6:2009 - (Parking for People with Disabilities);
- AS 1735.12:1999 - (Lift Facilities for Persons with Disabilities);
- Hills Shire DCP 2012

Please note that there are also additional advisory standards (not currently referenced by BCA or DDA Premises Standards) as well as other relevant guidelines that will be considered, as relevant to promote equity and dignity in line with over-arching DDA principles and aspirational objectives. These include:

- Universal Design Principles;
- Human Rights Commission (EREOC)



- Advisory Note February 2013 on streetscape, public, outdoor areas, fixtures, fittings and furniture;
- AS1428.2:1992 Enhanced and Additional requirements;
- AS3745:2010 – Planning for Emergencies in Facilities (to assist with design strategies for provision for escape for people with disability that may require assistance)



### 3. General Access Planning Considerations

The Disability Discrimination Act 1992 (DDA) is a legislative law that protects the rights of all people. The Act makes disability discrimination unlawful and promotes equal rights, equal opportunity and equal access for people with disabilities. The Australian Human Right Commission is the governing body who control and enforce DDA compliance.

Nevertheless, building elements that provide insufficient accessible provisions for people with disabilities remain subject to the DDA. The improvement of non-compliant building elements and areas to meet current access requirements will mitigate the risk of a DDA complaint be made against the building owner.

Since the 1st May 2011, the Commonwealth's Disability (Access to Premises – Buildings) Standards 2010 (DDA Premises Standards) apply to all new building works and to affected parts of existing buildings.

The DDA Premises Standards' requirements (DDA Access Code) are mirrored in the access provisions of the BCA. New building work and affected parts must comply with the DDA Premises Standards and AS1428.1-2009 in the same manner as they would comply with the BCA by meeting deemed-to-satisfy provisions or by adopting an alternative solution that achieves the relevant performance requirements.

By utilizing AS 1428 suite of Standards, the overall aim is to provide continuous accessible paths of travel to connect the proposed development to and through public domain areas and between associated accessible buildings in accordance with the DDA Access Code.

MGAC supports the use and consideration of universal design (UD) principles into the design to maximize access for all people. We will assist the design team to incorporate UD principles where possible within the project, while still meeting mandatory compliance requirements.

A UD approach has numerous benefits for the client as an education provider, for businesses within the building, for individual users and for society in general. An inclusive environment that can be accessed, understood and used by as many people as possible, is good business sense, is more sustainable and is socially progressive, in line with the aims of the DAP.

Universal design principles consider the needs of a broad range of people including older people, families with children and pushing prams, people from other cultures and language groups, visitors in transit and people with disability. By considering the diversity of users, the design will embed access into and within it, so that benefits can be maximized, without adding on specialized 'accessible' features that can be costly, visually unappealing and may perpetuate exclusion and potential stigma.

The seven key Universal design principles to consider in the on-going design include:

- Principle 1: Equitable Use
- Principle 2: Flexibility in Use
- Principle 3: Simple and Intuitive Use



- Principle 4: Perceptible Information
- Principle 5: Tolerance for Error
- Principle 6: Low Physical Effort
- Principle 7: Size and Space for Approach and use



## 4. Ingress & Egress

### 4.1 External Linkages

The BCA and DDA Premises Standards contain requirements for site approaches for the use of persons with disabilities. These requirements can be summarised as follows:

- It will be necessary to provide an accessible path of travel from main pedestrian entry points at the site allotment boundary to all building entrances compliant with AS1428.1:2009.
- An accessible path of travel between buildings (or parts of buildings) that are connected by a pedestrian linkage, within the site allotment boundary, compliant with AS1428.1:2009 is also required.
- An accessible path of travel to building entrances (required to be accessible) from associated accessible car-parking bays, compliant with AS1428.1:2009 is required.

#### *Assessment*

MGAC has reviewed the drawings and documentation in relation to the aforementioned requirements. On the basis of the current level of detail all access requirements appear capable of achieving compliance. Further work will be required during design development stage to ensure appropriate outcomes are achieved.

### 4.2 Entrances

The BCA and DDA Premises Standards contain requirements for building entry for the use of persons with disabilities. These requirements can be summarised as follows:

- Access is required through at least 50% of entrances, including the principal pedestrian entrance/s to all buildings or parts of buildings (ie. when they have a separate function and/or use eg. external retail tenancy). Note it is preferred that all entrances are accessible.
- A non-accessible entry cannot be located more than 50m distance from an accessible entry (for buildings greater than 500m<sup>2</sup>).
- All accessible doors to have 850mm min. clear width opening and suitable door circulation area, compliant with AS1428.1:2009. Note: Manual doors require lightweight door forces to be operable by people with disabilities (20N max.). We recommend that main entrances include automated sliding doors to be used where possible. Revolving doors are not accessible, if maintained an alternate accessible door is required adjacent.
- An accessible path of travel eg. ramp or lift needs to be provided adjacent (or in reasonable proximity) to any stair access. Note: providing choice of access route directly adjacent so that people can start and finish in the same location/travel similar route promotes inclusion and UD principles.

#### *Assessment*



MGAC has reviewed the drawings and documentation in relation to the aforementioned requirements. On the basis of the current level of detail all access requirements appear capable of achieving compliance. Further work will be required during design development stage to ensure appropriate outcomes are achieved.

### **4.3 Emergency Egress**

BCA 2022 Part D3D22 has requirements for all fire-isolated egress stairs from areas required to be accessible (not communication stairs) to include at least one continuous handrail designed to be compliant with AS1428.1 Clause 12. Provision of an off-set tread at the base of stair flights or an extended mid-landing that will allow a 300mm extension clear of egress route is considered appropriate for achieving a consistent height handrail (without vertical or raked sections). Such an off-set tread configuration has been shown at the majority of stairs and would appear to be possible elsewhere, subject to further detail design.

Where fire-isolated egress stairs will also be used for communication stair purposes between levels, they should be designed to meet AS1428.1:2009. Confirmation is required on the likely use of certain stairs for this purpose.

There is currently no mandatory requirement within BCA or DDA Premises Standards for provision of independent accessible egress for people with a disability in accordance AS1428.1 and this remains an important DDA issue. Consideration of an accessible egress strategy with emergency evacuation plan will be needed as a minimum starting point.

Consideration of waiting spaces within fire-stairs should be strongly considered for people with mobility impairment. The current configuration of stairs suggests the spatial requirements would not be incorporated without layout amendments, but if provided with future design development these would generally require:

- 850mm min. clear width egress door and 510mm min. external door circulation area, compliant with AS1428.1:2009;
- Wheelchair space (800mm W x 1300mm L min. dimensions) within fire-isolated stair, outside of the required egress path, that can be accessed on a continuous path of travel.
- Alternative evacuation means eg. emergency passenger lift/s could be provided instead of/only in addition to 'waiting spaces' in line with ABCB Handbook and/or consideration of stair evacuation devices (with appropriate storage and staff training) within fire stairs.



## 5. Paths of Travel

### 5.1 Circulation Areas

The BCA and DDA Premises Standards contain requirements for circulation areas for the use of persons with disabilities. These requirements can be summarised as follows:

- Wheelchair passing bays (1800mm width x 2000 length) are also required when a direct line of sight is not available and are to be provided at 20m max. intervals along access-ways.
- Turning spaces (at least 1540mm W x 2070mm L) are required within 2m of every corridor end and at 20m.max intervals along all access-ways. This is needed for wheelchairs to make a 180 degree turn, compliant with AS1428.1:2009.
- All common-use doors (ie. not excluded under Part D4D5) to have 850mm min. clear width opening (each active door leaf) and suitable door circulation area, compliant with AS1428.1:2009.
- All common-use corridors and accessible paths of travel to be at least 1000mm min. width when travelling in linear direction. Note: Increased clear width paths of travel required for doorway circulation, turning areas etc.

#### *Assessment*

MGAC has reviewed the drawings and documentation in relation to the aforementioned requirements. On the basis of the current level of detail all access requirements appear capable of achieving compliance. Further work will be required during design development stage to ensure appropriate outcomes are achieved.

### 5.2 Passenger Lifts

The BCA and DDA Premises Standards contain requirements for passenger lifts and circulation areas for the use of persons with disabilities. These requirements can be summarised as follows:

- Passenger lifts to have min. internal size at floor of 1400mm width x 1600mm depth, compliant with BCA 2022 Part E3D7, E3D8, DDA Access Code and AS1735.12.
- All lift lobbies and main corridors on each level to have 1800mm min. clear width to allow two wheelchairs ability to space pass each other.

#### *Assessment*

MGAC has reviewed the drawings and documentation in relation to the aforementioned requirements. On the basis of the current level of detail all access requirements appear capable of achieving compliance. Further work will be required during design development stage to ensure appropriate outcomes are achieved.

### 5.3 Stairs & Ramps

The BCA and DDA Premises Standards contain requirements for stairs and ramps for the use of persons with disabilities. These requirements can be summarised as follows:



- Ramps are to have maximum 1:14 gradient with landings at no more than 9 metre intervals
- Ramps are to have handrails on both sides with minimum 1 metre clearance in accordance with AS1428.1
- Landings are to have 1200mm length with 1500mm length at 90 degree turns
- Stairs are to have handrails on both sides in accordance with AS1428.1
- Stairs and ramps are to be offset to ensure no encroachment of handrail extensions into from transverse path of travel at top and bottom of stair/ramp

#### *Assessment*

MGAC has reviewed the drawings and documentation in relation to the aforementioned requirements. On the basis of the current level of detail all access requirements appear capable of achieving compliance. Further work will be required during design development stage to ensure appropriate outcomes are achieved.



## 6. Adaptable Units

### 6.1 Adaptable Unit Provision

The concept of adaptable housing is to design units with provisions in place from the outset (pre-adaptation) so they can be easily adapted to meet changing needs of residents in the future (post-adaptation) in accordance with AS4299.

The following requirements are to be satisfied in the provision of adaptable units

- A total of 88 adaptable units are required based on Hills Shire Council DCP 2012 Part B Section 5 Clause 3.21.
- The adaptable units are to be designed in accordance with AS4299 Class B as required by the above Clause in the DCP.

#### *Assessment*

A total of 873 dwellings have been proposed throughout the development. There are 88 apartments (10.08% of total) designed to be adaptable, which satisfies Council DCP 2012.

The adaptable units have been nominated as per the table below, which are a mixture of 1 and 2 bed types.

A	B	C	D1	D2	E1	E2
A.124	B.G07	C.G08	D1.G28	D2.G21		E2.LG03
A.224	B.112	C.110	D1.G30	D2.G23		E2.102
A.324	B.212	C.210	D1.128	D2.116		E2.202
A.417	B.310	C.301	D1.229	D2.122		
A.517	B.408	C.402	D1.130	D2.123		
A.617	B.508	C.502	D1.231	D2.216		
A.717	B.608	C.602	D1.323	D2.223		
A.817	B.708	C.702		D2.224		
A.917	B.808	C.802		D2.312		
A.1017	B.908	C.902		D2.317		
A.1117	B.1008	C.1002		D2.318		
A.1217	B.1108	C.1102		D2.415		
A.1316	B.1208	C.1202		D2.418		
	B.1308	C.1302		D2.420		
	B.1408			D2.520		
	B.1505			D2.620		
				D2.715		
				D2.815		
				D2.915		
				D2.1110		
				D2.1015		
				D2.1114		



				D2.1115			
				D2.1208			
				D2.1212			
				D2.1213			
				D2.1308			
				D2.1312			
				D2.1314			
				D2.1408			
				D2.1412			
				D2.1413			
				D2.1507			
				D2.1511			
				D2.1512			
<b>13</b>	<b>16</b>	<b>14</b>	<b>7</b>	<b>35</b>	<b>0</b>	<b>3</b>	<b>88</b>

## 6.2 Adaptable Unit Design

The following requirements are to be satisfied in the provision of adaptable unit design at pre-adaptation stage.

### 6.2.1 Class C essential features required:

- The entry door of the unit achieves 850mm clear width opening (920 door leaf). Latch side clearance of 530mm needs to be achieved at pre adaptation, externally and internally of the door in accordance with AS4299.
- The kitchen needs 1550mm circulation space outside of the kitchen work spaces
- The bathroom needs to be of an adequate size to achieve an AS1428.1 compliant bathroom of shower, WC and basin with required circulation spaces. Capped off service can be provided for the relocation of basin at post adaptation. The shower recess will require review during design development.
- The living area needs to be large enough to achieve a circulation space of 2250mm min diameter after furniture placement, compliant with AS4299.
- The bedroom needs to achieve 1 metre either side of queen size bed and 1550 x 2070mm at the base of bed or similar configuration
- The laundry area requires 1500mm in front of laundry appliances in accordance with AS4299.
- All doors need to achieve 850mm clear opening width from the outset and easily achievable latch side clearances at post adaptation, compliant with AS1428.1:2009.

### 6.2.2 Class B additional features required:

#### Siting:



- 1) A level or gently sloping site with up to 1:14 gradient
- 2) Within a residential estate development, common use facilities to be accessible
- 3) Within a residential estate development, internal roadways to be separate from pedestrian walkways

**Security:**

- 4) Pathway lighting shall be positioned at low height to avoid glare and to provide min 50 lux at ground level
- 5) Clear line of sight from a well-lit vehicle drop-off point to safe pedestrian entry point

**Letterboxes:**

- 6) Within residential estate developments, letterboxes centrally located adjacent to street entry. Lockable.
- 7) Letterbox area roofed and in a well lit location
- 8) Parcel rack included with letterboxes

**Private car accommodation:**

- 9) Roof to car parking space
- 10) Internal clearance of garage or carport 2.5m min.
- 11) Covered access to dwelling unit
- 12) Illumination level min 50 lux

**Accessible entry:**

- 13) Provision for combined door/security door
- 14) Potential min illumination level 300 lux

**Exterior general:**

- 15) Provision for security screen to exterior opening or sliding windows and doors

**Living room and dining room**

- 16) Min 4 double GPOs
- 17) Two TV antenna outlets adjacent to GPO (positioned so viewing from dining and kitchen is achievable)

**Kitchen**

- 18) Installation of thermostatic mixing valve
- 19) Central light with second light over sink. Potential illumination level min 300 lux with 550 lux over work surfaces



- 20) Locate handles towards the top of below bench cupboards and towards the bottom of overhead cupboards. Provide 'D' pull handles.

### **Main bedroom**

- 21) Two double GPOs on wall where bedhead is likely to be
- 22) Telephone outlet next to bed on the side closest to door (with GPO adjacent to telephone outlet)
- 23) TV antenna point and double GPO on opposite wall to bedhead
- 24) 2-way light switches, one located above bed. 1000mm high above floor
- 25) Potential illumination level 300 lux

### **Other bedrooms**

- 26) Two double GPOs on one wall. Minimum of one GPO on opposite wall
- 27) Two-way light switch
- 28) Telephone outlet next to double GPO
- 29) TV antenna point adjacent to one GPO
- 30) Potential illumination level 300 lux

### **Bathroom**

- 31) Provision for additional grabrail
- 32) Installation of thermostatic mixing valve
- 33) Wall cabinet with light over or similar
- 34) Potential illumination level 300 lux generally with 600 lux task lighting

### **Laundry**

- 35) Provision for drier
- 36) Installation of thermostatic mixing valve
- 37) Potential illumination level 300 lux generally with 550 lux task lighting

### **Storage**

- 38) Linen cupboard min 600mm wide with adjustable shelving

### **Floor coverings**

- 39) Slip resistant surfaces – balconies and external paved areas.

### **Ancillary items**

- 40) Switches located 900-1100mm above the floor inline with door handles



41) GPOs located not less than 600mm above fgloor

**Garbage**

42) Provision for bin in an accessible location

*Assessment*

MGAC has reviewed the drawings and documentation in relation to the aforementioned requirements. On the basis of the current level of detail all access requirements appear capable of achieving compliance. Further work will be required during design development stage to ensure appropriate outcomes are achieved.



## 7. SEPP 65 Silver Livable Units

### 7.1 Silver Livable Unit Provision

The following requirements are to be satisfied in the provision of visitable units

- A total of 20% units are required to satisfy SEPP 65 (including referenced Apartment Design Guide) requirements to incorporate Liveable Housing Guidelines Silver Level Universal design features.
- Note the 10% adaptable units can be counted in the 20% calculation if the apartment also meets the following requirements.

#### *Assessment*

A total of 873 dwellings have been proposed throughout the development. There are 178 apartments (20% of total) designed to be visitable and to meet the above requirements.

The Livable housing units have been nominated as per the table below, some LHA units are the also nominated as adaptable units:

A	B	C	D1	D2	E1	E2
A.G16	B.G07	C.G04	D1.424	D2.122	E1.109	E2.406
A.G17	B.112	C.G08	D1.425	D2.223	E1.110	E2.407
A.119	B.212	C.106	D1.524	D2.317	E1.209	E2.506
A.121	B.310	C.110	D1.525	D2.418	E1.210	E2.507
A.124	B.403	C.206	D1.624	D2.518	E1.213	E2.606
A.219	B.408	C.210	D1.625	D2.618	E1.307	E2.607
A.221	B.503	C.301	D1.719	D2.713	E1.308	E2.706
A.224	B.508	C.306	D1.720	D2.813	E1.311	E2.707
A.319	B.603	C.402	D1.819	D2.913	E1.408	E2.806
A.321	B.608	C.405	D1.820	D2.1013	E1.409	E2.807
A.324	B.703	C.502	D1.919	D2.1113	E1.412	E2.906
A.416	B.708	C.505	D1.920	D2.1114	E1.508	E2.907
A.417	B.803	C.602	D1.1019	D2.1115	E1.509	E2.1006
A.516	B.808	C.605	D1.1020	D2.1211	E1.512	E2.1007
A.517	B.903	C.702	D1.1119	D2.1212	E1.608	E2.1106
A.616	B.908	C.705	D1.1120	D2.1213	E1.609	E2.1107
A.617	B.1003	C.802	D1.1216	D2.1311	E1.612	E2.1206
A.716	B.1008	C.805	D1.1217	D2.1312		E2.1207
A.717	B.1103	C.902	D1.1317	D2.1314		E2.1304
A.816	B.1108	C.905	D1.1318	D2.1411		E2.1305
A.817	B.1203	C.1002	D1.1416	D2.1412		E2.1404
A.916	B.1208	C.1005	D1.1417	D2.1413		E2.1405
A.917	B.1303	C.1102	D1.1515	D2.1510		E2.1503
A.1016	B.1308	C.1105	D1.1516	D2.1511		E2.1504



A.1017	B.1403	C.1202		D2.1512			
A.1116	B.1408	C.1205					
A.1117	B.1505	C.1302					
A.1216		C.1305					
A.1217							
A.1315							
A.1316							
A.1415							
A.1515							
<b>33</b>	<b>27</b>	<b>28</b>	<b>24</b>	<b>25</b>	<b>17</b>	<b>24</b>	<b>178</b>

## 7.2 Silver Livable Unit Design

The following requirements are to be satisfied in the design of these units

- The entry door into the units are to be detailed to achieve suitable clear width of at least 820mm during detailed design development stage to be compliant with Silver Level rating requirements in accordance with Livable Housing Design Guideline 2017:
- From the unit entry, there needs to be appropriate 1m clearances throughout the unit to allow suitable accessible paths of travel within accordance with Silver Level rating requirements in accordance with Livable Housing Design Guideline 2017.
- All internal doorways into bathroom, bedroom and out to balcony are required to achieve at least 820mm clear open widths in accordance with Silver Level rating requirements in accordance with Livable Housing Design Guideline 2017. This can be achieved during detailed design development.
- The silver levels units require bathrooms that can accommodate the required 900mm wide by 1200mm long clear visitable toilet circulation space in front of the leading edge of the pan compliant with Silver Level rating requirements in accordance with Livable Housing Design Guideline 2017.
- The walls surrounding the shower and toilet pan require sufficient reinforcements for the provision of grab rails in the future when required.

### *Assessment*

MGAC has reviewed the drawings and documentation in relation to the aforementioned requirements. On the basis of the current level of detail all access requirements appear capable of achieving compliance. Further work will be required during design development stage to ensure appropriate outcomes are achieved.



## 8. Facilities & Amenities

### 8.1 Sanitary Facilities

The BCA and DDA Premises Standards contain requirements for sanitary facilities suitable for the use of persons with disabilities. These requirements can be summarised as follows:

- An even number of left hand (LH) and right hand (RH) transfer WC pans (accessible toilets) is required within the building. Alternating LH/RH layouts on each subsequent level is the most appropriate and inclusive approach.
- Accessible WC requires 2300mm x 1900mm around the pan with the basin to sit outside this area in accordance with AS1428.1.
- An ambulant cubicle is required within every standard toilet bank adjacent to an accessible toilet under DDA Access Code Part F2.4 (BCA 2022 F4D5, F4D6, F4D7) compliant with AS1428.1:2009.

#### Assessment

MGAC has reviewed the drawings and documentation in relation to the aforementioned requirements. On the basis of the current level of detail all access requirements appear capable of achieving compliance. Further work will be required during design development stage to ensure appropriate outcomes are achieved.

### 8.2 Common Areas

The BCA and DDA Premises Standards contain requirements for common use areas suitable for the use of persons with disabilities. These requirements can be summarised as follows:

- For class 2 buildings, access is required to a unique common use facility such as swimming pool, sauna, common laundry, entertainment rooms.
- For swimming pools, a means of access is required into the pool in accordance with DDA Premises Standards
- Accessibility is required to common use courtyards within buildings
- Mailboxes and garbage rooms within residential buildings require appropriate accessibility.
- Wheelchair access is required to any external and outdoor terrace areas including roof terraces compliant with AS1428.1.

#### Assessment

MGAC has reviewed the drawings and documentation in relation to the aforementioned requirements. On the basis of the current level of detail all access requirements appear capable of achieving compliance. Further work will be required during design development stage to ensure appropriate outcomes are achieved.

### 8.3 Car Parking



The BCA and DDA Premises Standards contain requirements for parking which are applicable to this project. These requirements can be summarised as follows:

- Accessible car bays require 2.4 metre with 2.4 metre shared area.
- Class 2 residential. Provide an adaptable unit car bay for each adaptable unit. These car bays can have 3.8 metre width or 2.4 m width with 2.4 wide metre shared zone.
- All accessible car bays to be located near relevant lifts and/or associated building entry points to minimise distance to relevant lift and ensure accessible path of travel between these areas.
- Ensure 2.5m min. height clearance, compliant with AS2890.6 fig 2.7 over accessible car bays with 2.2 m min. vertical clearance leading to the accessible and adaptable unit car bays (Note: consideration for 2.3 or 2.4m min. height preferred for higher vans/adapted vehicles is recommended as good practice).

#### *Assessment*

MGAC has reviewed the drawings and documentation in relation to the aforementioned requirements. On the basis of the current level of detail all access requirements appear capable of achieving compliance. Further work will be required during design development stage to ensure appropriate outcomes are achieved.



## 9. Conclusion

MGAC has assessed the proposed scheme for Showground Precinct East. The proposed drawings indicate that accessibility requirements, pertaining to external site linkages, building access, common area access, sanitary facilities and parking can be readily achieved. It is advised that MGAC will work with the project team as the scheme progresses to ensure appropriate outcomes are achieved in building design and external domain design.