


LEGEND	
Site boundary	Proposed underground reticulation (up to 33kV)
Proposed wind turbine	Proposed overhead reticulation (up to 33kV)
Proposed access track	Proposed substation
O&M building	Proposed overhead 330kV powerline
Construction Compound	Alternative overhead 132 kV powerline
Batch plant	Existing 330 kV transmission line
	Existing 132 kV transmission line

**EPURON**

PROJECT  
Yass Valley Wind Farm

TITLE		
Proposed Coppabella Construction Compound, O&M Building & Batch Plant		
SCALE	DATE	DRAWN
1:10,000 at A4	25/03/14	MK

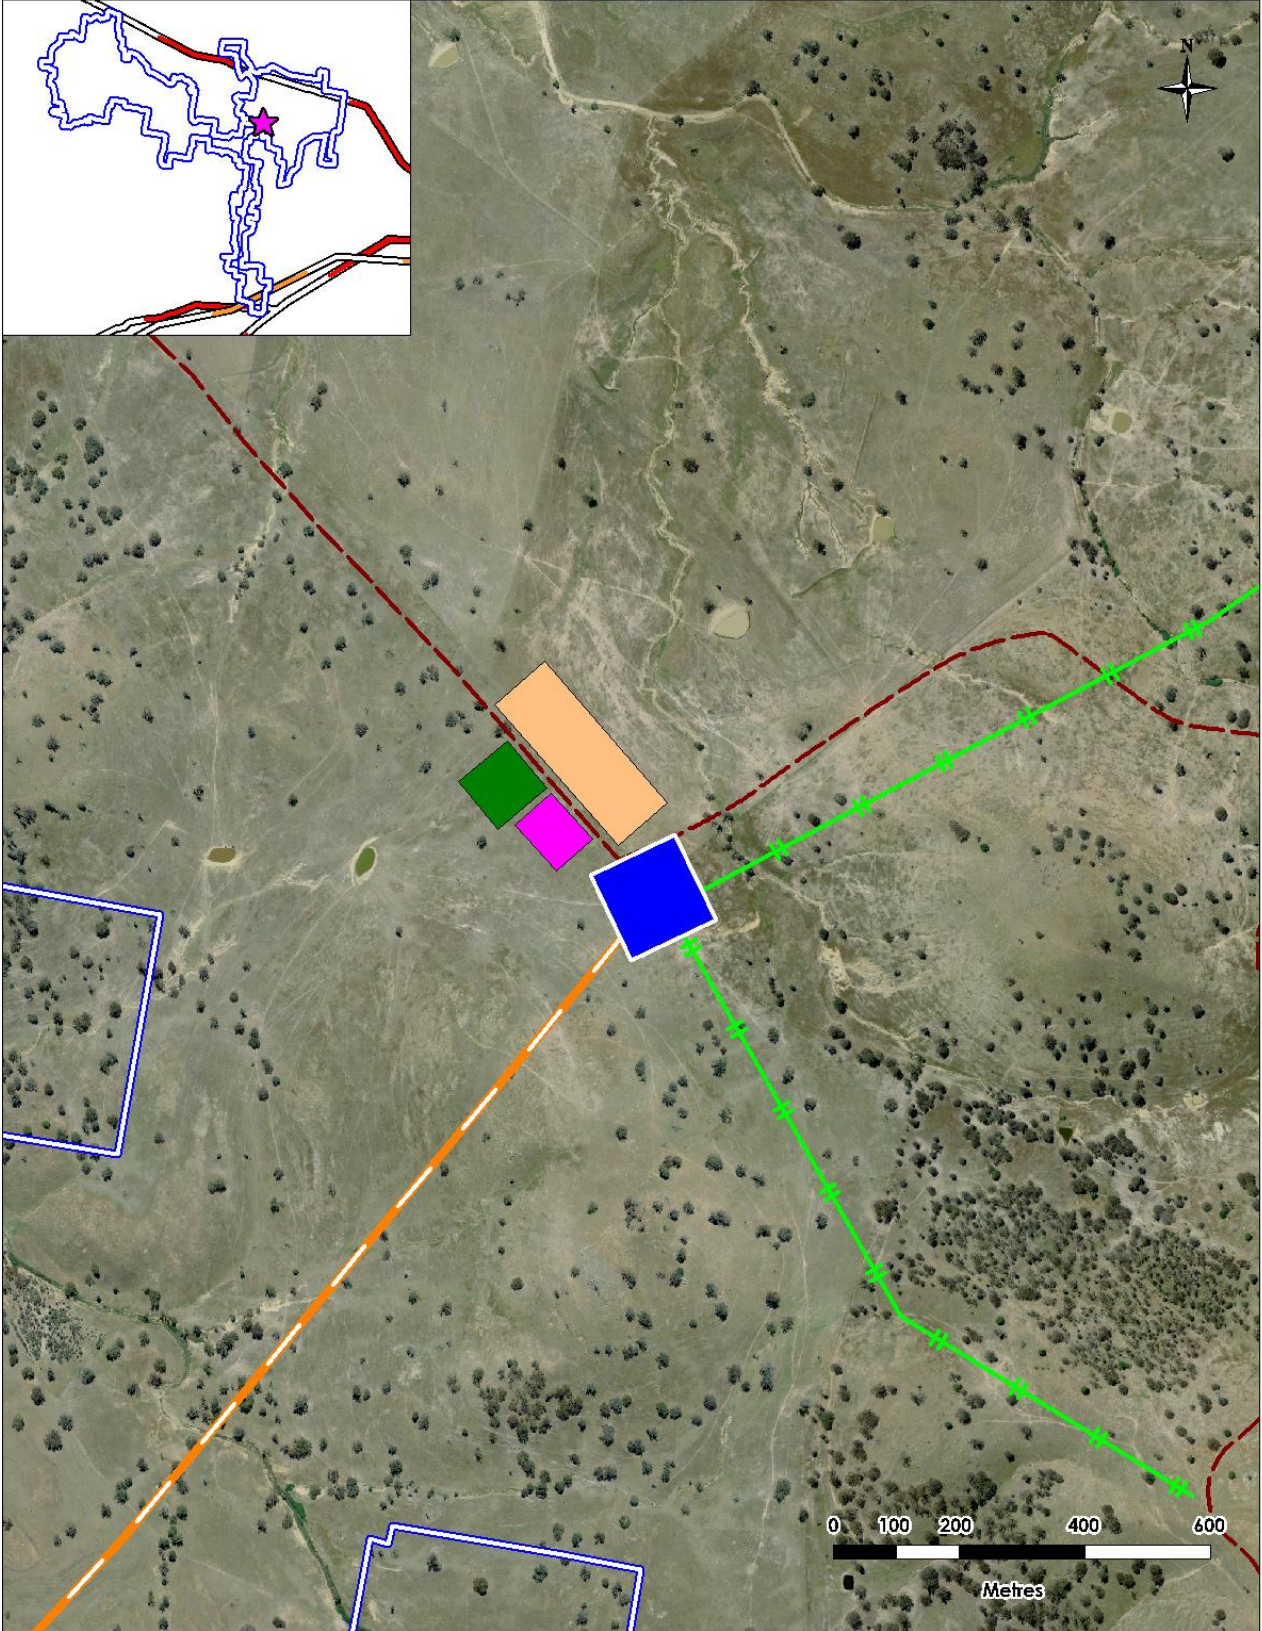


LEGEND	
Site boundary	Proposed overhead reticulation (up to 33kV)
Proposed wind turbine	Proposed substation
Proposed access track	Proposed overhead 330kV powerline
O&M building	Existing 330 kV transmission line
Construction Compound	Existing 132 kV transmission line
Batch plant	


**EPURON**

PROJECT  
Yass Valley Wind Farm


TITLE		
Proposed Marilba Construction Compound, O&M Building & Batch Plant		
SCALE	DATE	DRAWN
1:10,000 at A4	25/03/14	MK

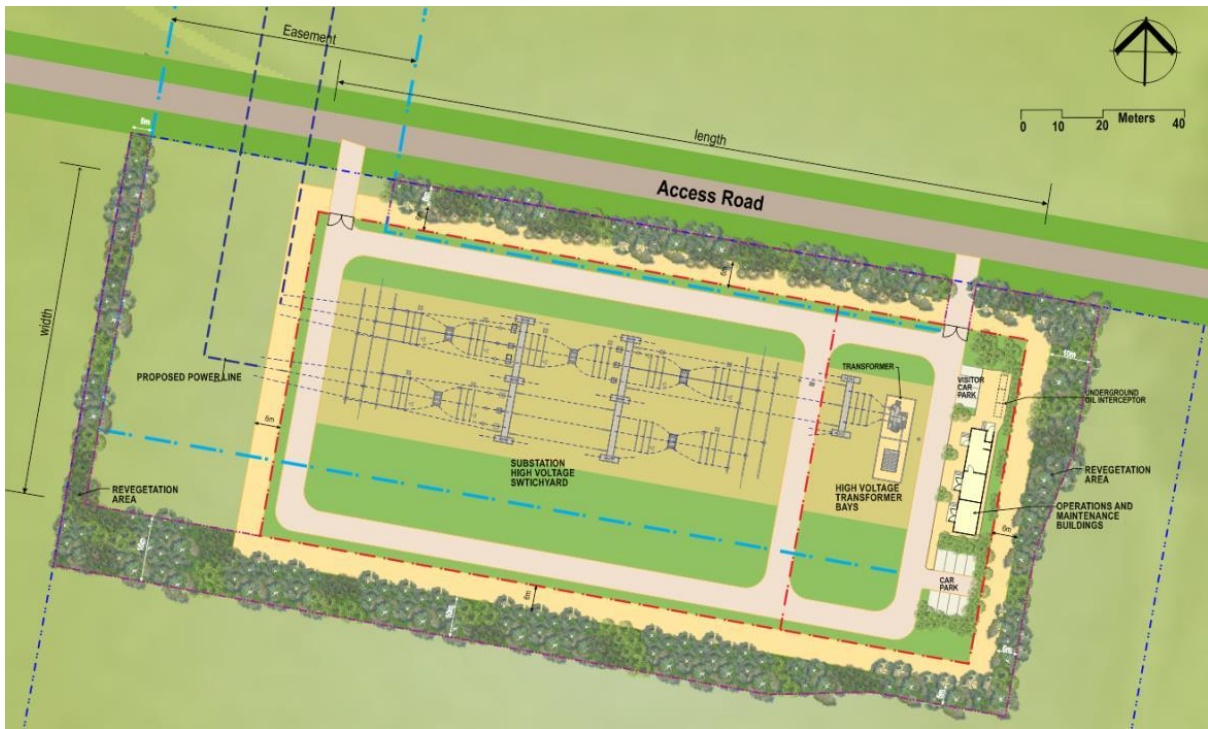

*Indicative substation layout*

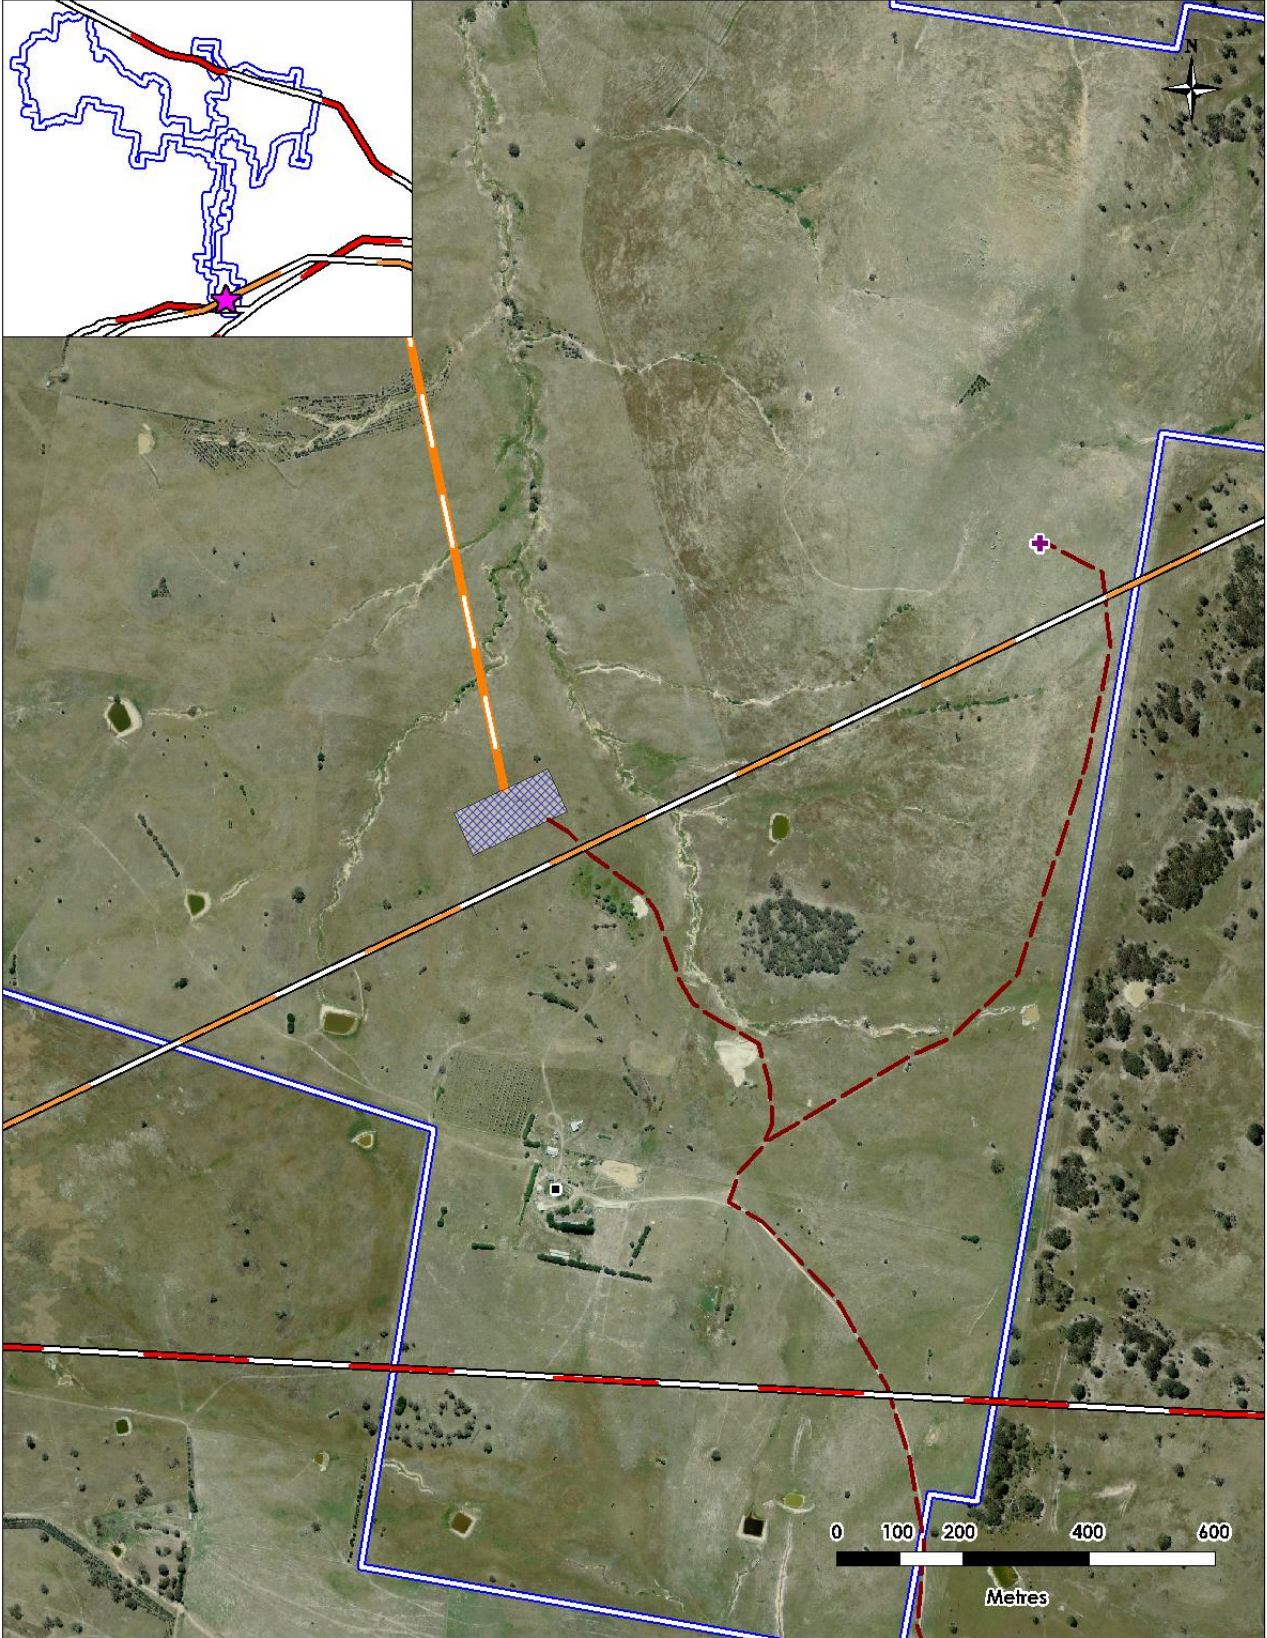

<b>LEGEND</b> <ul style="list-style-type: none"> <li>■ Involved residence</li> <li>— Proposed access track</li> <li>— Proposed overhead 330 kV powerline</li> <li>□ Project boundary</li> <li>▨ Proposed switchyard</li> <li>✚ Proposed transmission communications tower</li> <li>— Existing 330 kV transmission line</li> <li>— Existing 132 kV transmission line</li> </ul>			<b>TITLE</b> Proposed Switchyard & Communications Mast Location		
PROJECT Yass Valley Wind Farm			SCALE 1:10,000 at A4	DATE 25/03/14	DRAWN MK

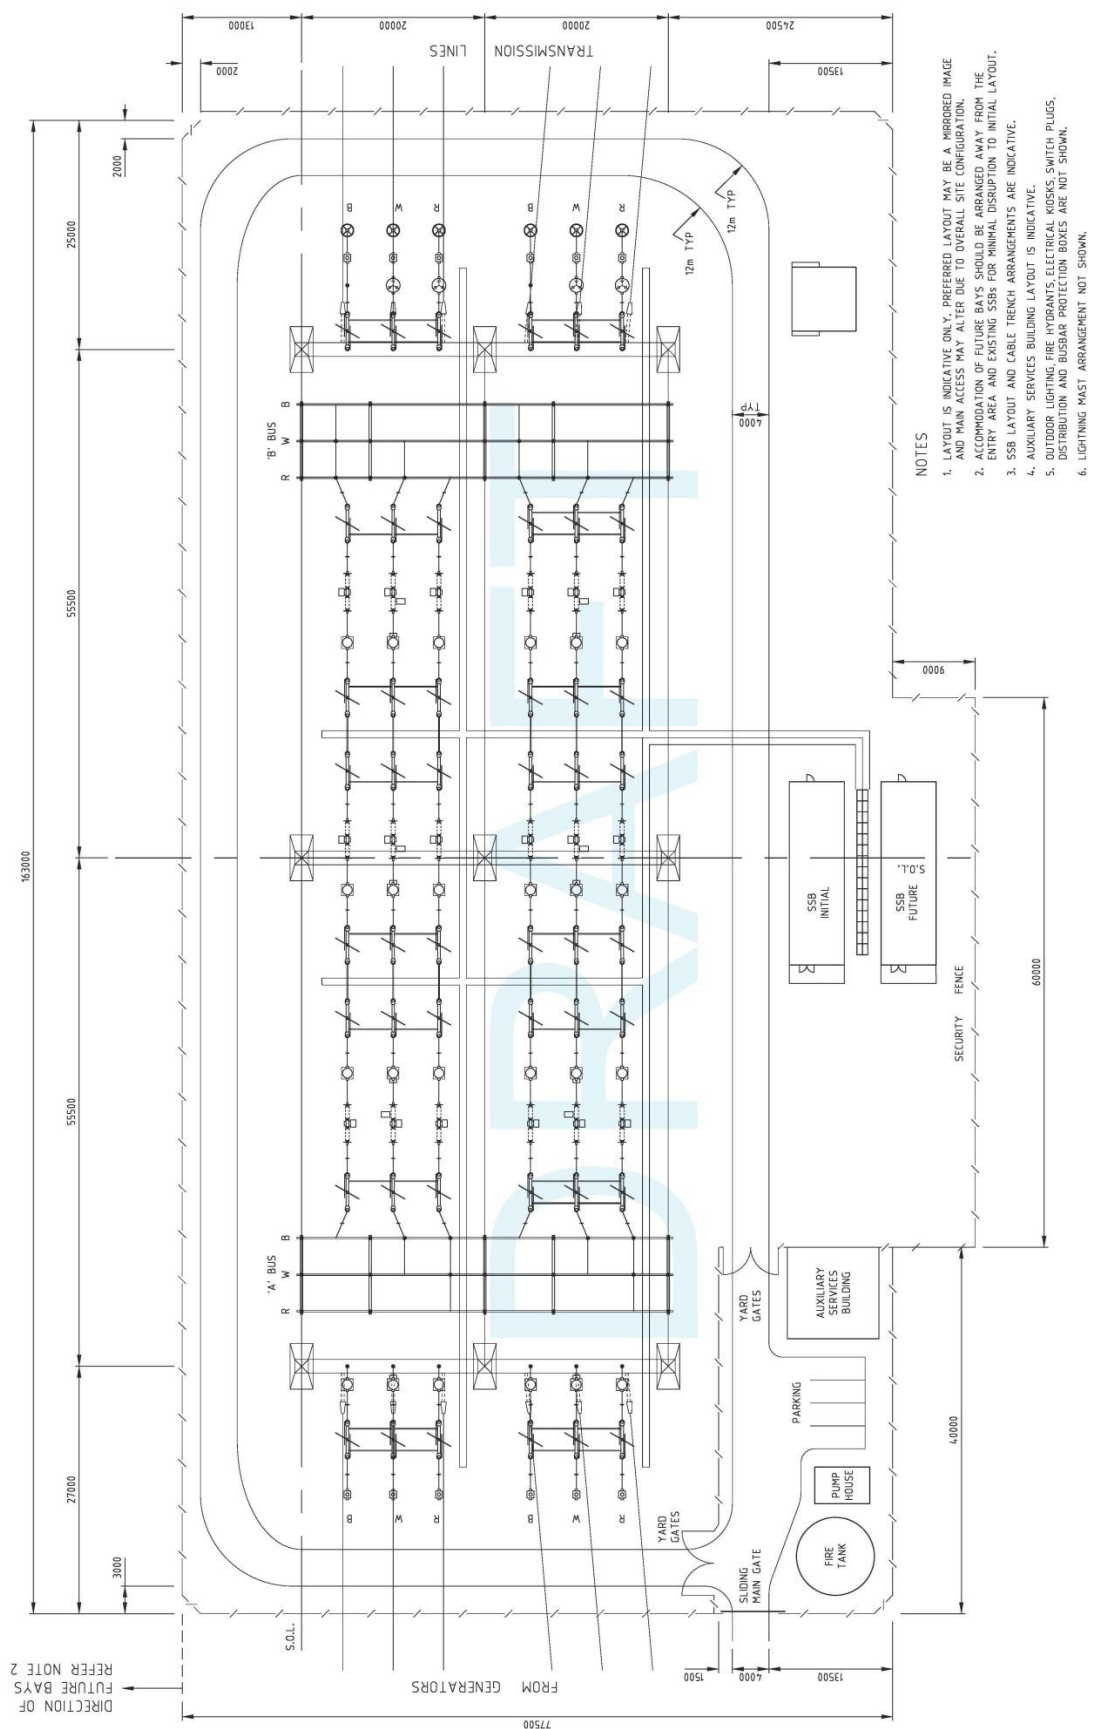


- NOTES**
1. LAYOUT IS INDICATIVE ONLY. PREFERRED LAYOUT MAY BE A MODIFIED IMAGE AND MAIN ACCESS MAY VARY DUE TO OVERALL SITE CONFIGURATION.
  2. ACCOMMODATION OF FUTURE BAYS SHOULD BE AVOIDED AWAY FROM THE ENTRY AREA AND EXISTING SSB FOR MINIMAL DISRUPTION TO INITIAL LAYOUT.
  3. SSB LAYOUT AND CABLE TRENCH ARRANGEMENTS ARE INDICATIVE.
  4. AUXILIARY SERVICES BUILDING LAYOUT IS INDICATIVE.
  5. OUTDOOR LIGHTING, FIRE HYDRANTS, ELECTRICAL KIOSKS, SWITCH PLUGS, DISTRIBUTION AND BUSBAR PROTECTION BOXES ARE NOT SHOWN.
  6. LIGHTNING MAST ARRANGEMENT NOT SHOWN.


**Indicative 330kV switchyard layout**




*Example microwave communication tower*

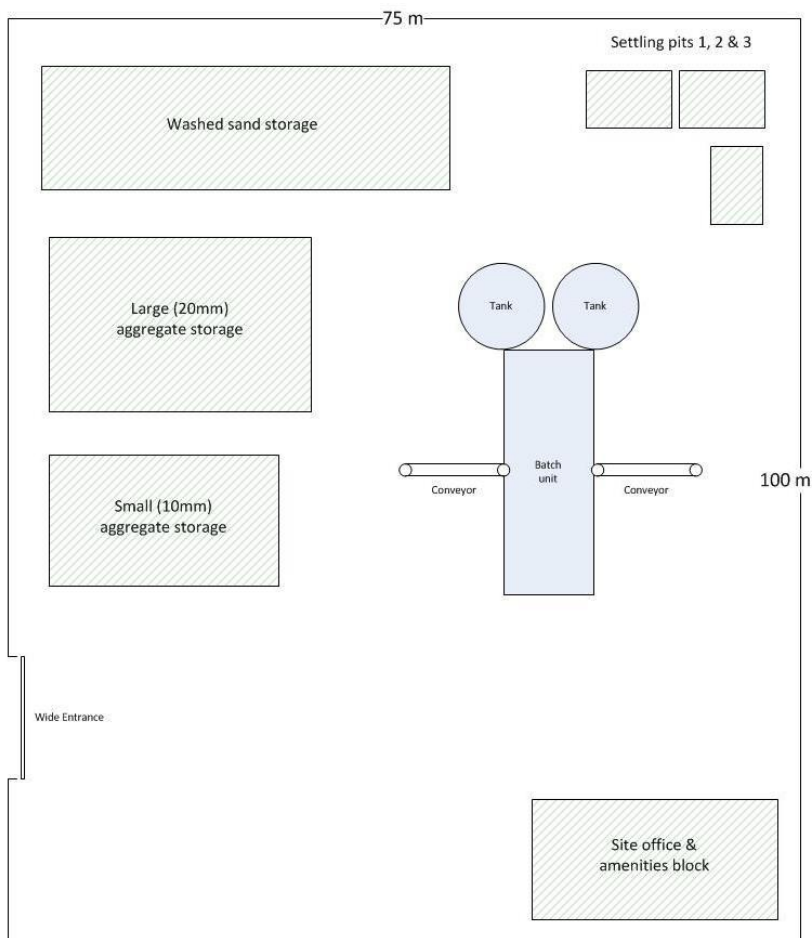

*Indicative batch plant layout*

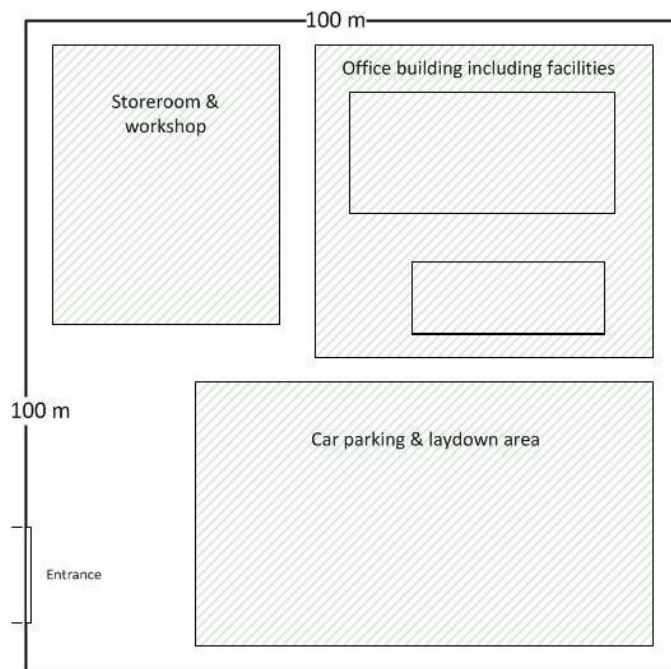

*Indicative operation & maintenance facility layout*

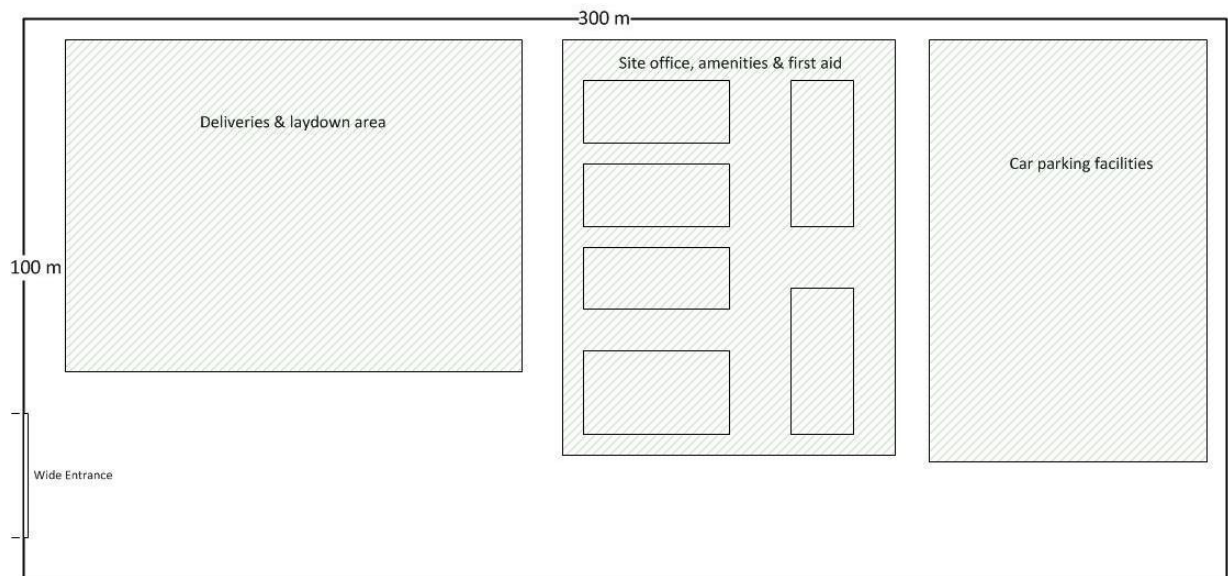

*Indicative construction compound layout*