

2-4 Burleigh St & 20-24 Railway Parade, Burwood

Noise and Vibration Impact Assessment

Project ID	20240136.1
Document Title	Noise and Vibration Impact Assessment
Attention To	NSW Housing Corporation Pty Ltd

Revision	Date	Document Reference	Prepared By	Checked By	Approved By
0	12/04/2024	20240136.1/1204A/R0/JW	JW		
1	13/11/2024	20240136.1/1311A/R1/JW	JW		SN
2	17/12/2024	20240136.1/1712A/R2/JW	JW		SN
3	28/03/2025	20240136.1/2803A/R3/JW	WY		WY

TABLE OF CONTENTS

1	EXECUTIVE SUMMARY.....	5
2	INTRODUCTION	6
3	RESPONSE TO SEARS	6
4	REFERENCED DOCUMENTS.....	7
4.1	BACKGROUND INFORMATION USED.....	7
4.2	GUIDELINES.....	7
5	SITE DESCRIPTION AND THE PROPOSAL	8
5.1	SITE DESCRIPTION.....	8
5.2	PROJECT DESCRIPTION.....	8
5.3	NOISE RECEIVERS IDENTIFIED.....	9
6	ABBREVIATIONS AND DEFINITIONS.....	11
7	NOISE AND VIBRATION INTRUSION CRITERIA	12
7.1	BURWOOD 2023 DCP ASSESSMENT CRITERIA.....	12
7.1.1	NSW Department of Planning and Environment document – ‘State Environmental Planning Policy (Transport and Infrastructure)’ (SEPP) 2022.....	12
7.1.2	NSW Department of Planning – <i>Development near Rail Corridors or Busy Roads – Interim Guideline</i>	12
7.1.3	Australian Standard 2107:2016.....	14
7.2	ADOPTED PROJECT SPECIFIC CRITERIA	15
8	NOISE AND VIBRATION ASSESSMENT	16
8.1	EXTERNAL NOISE LEVELS.....	16
8.2	RAILWAY GROUND VIBRATION.....	16
9	COMPLYING MITIGATION.....	17
9.1	BUILDING ENVELOPE.....	17
9.1.1	Glazed Windows and Doors.....	17
9.1.2	External Roof and Ceiling Construction.....	18
9.1.3	External Walls.....	18
10	NOISE EMISSION CRITERIA.....	19
10.1	BURWOOD DEVELOPMENT CONTROL PLAN 2023	19
10.2	NSW EPA NOISE POLICY FOR INDUSTRY (NPI) 2017.....	19
10.3	SUMMARISED NOISE EMISSION CRITERIA	20
11	NOISE EMISSION ASSESSMENT.....	21
11.1	MECHANICAL PLANT NOISE.....	21
11.2	NOISE FROM THE LOADING DOCK AND CARPARK	21
11.3	GENERAL	22
11.4	RECOMMENDATIONS.....	23
11.4.1	Acoustic Barrier	24
12	CONSTRUCTION NOISE AND VIBRATION	25
12.1	CONSTRUCTION NOISE MANAGEMENT LEVELS	25
12.1.1	Residential Receivers.....	25
12.1.2	Other Land Uses.....	26
12.1.3	Receiver Noise Management Levels.....	26
12.2	CONSTRUCTION VIBRATION MANAGEMENT LEVELS	27
12.2.1	Amenity Management.....	27
12.2.2	Structure Damage Risk Criteria	28
12.3	CONSTRUCTION NOISE ASSESSMENT.....	30
12.3.1	Preliminary Proposed Construction Activities	30

12.3.2	Predictions.....	30
12.3.3	Site Specific Recommendations.....	31
12.4	ASSESSMENT OF VIBRATION	32
12.4.1	Vibration Producing Activities	32
12.4.2	Vibration Management.....	32
13	CONCLUSION.....	33
APPENDIX A	AMBIENT NOISE MONITORING.....	34
A.1	UNATTENDED LONG TERM NOISE MONITORING	34
A.1.1	Ambient Noise Descriptors.....	34
A.1.2	Equipment Used.....	35
A.1.3	Weather Affected and Extraneous/Outlying Data.....	35
A.2	CALCULATION OF REPRESENTATIVE AMBIENT NOISE LEVELS	36
A.2.1	Rating Background Noise Levels	36
A.3	ATTENDED MONITORING.....	37
A.3.1	Equipment Used.....	37
A.3.2	Locations Monitored.....	37
A.3.3	Results.....	38
A.3.4	Summarised Traffic Noise Levels	38
A.4	UNATTENDED MONITORING CHARTS.....	39
A.4.1	Location 1 – Traffic Monitor	39
A.4.2	Location 1 – Traffic Monitor	49
APPENDIX B	EPA NOISE POLICY FOR INDUSTRY TRIGGER LEVELS	59
B.1	NPI TRIGGER LEVELS	59
B.1.1	Intrusiveness.....	59
B.1.2	Amenity	59
B.1.3	Maximum Noise Level Assessment.....	61
B.2	PROJECT SPECIFIC TRIGGER LEVELS	62
APPENDIX C	VIBRATION MEASUREMENTS	63
C.1	EQUIPMENT USED	63
C.2	RESULTS.....	63
C.2.1	TACTILE VIBRATION	63
APPENDIX D	CONSTRUCTION PLANT NOISE AND VIBRATION EMISSION LIMITS.....	64
D.1	NOISE.....	64
APPENDIX E	ARCHITECTURAL DRAWINGS.....	68

1 EXECUTIVE SUMMARY

This report has been prepared to assess the impact of noise generated by nearby transportation and commercial sources on the occupant amenity of the proposed mixed-use development at 2-4 Burleigh St & 20-24 Railway Parade, Burwood.

The following noise sources potentially impacting the proposed development have been identified:

- Traffic noise from Burleigh Avenue and Railway Parade.
- Train Noise from Burwood Station and associated rail line.

NSW planning instruments, guidelines and local authority planning guidelines (where applicable) have been used to develop project specific assessment criteria.

Noise impacts have been predicted at the subject development based on site measurements. The predicted impacts have been assessed against the project specific criteria. Measures needed to mitigate any identified potential impacts have been determined and are presented in the report. Section 9 of the report summarises the complying mitigation and development controls determined.

The assessment has demonstrated that the proposed development is able to provide an adequate level of amenity in respect on noise impact from nearby road and commercial premises provided with the incorporation of the mitigation indicated in this assessment.

Apart from above, a noise and vibration emission assessment has been conducted for the potential noise impacts associated demolition, construction and operation of the development.

The assessment includes:

- Establishment of assessment criteria for noise impacts. The criteria are based on planning instruments, guidelines and standards relevant to the potential impacts identified.
- The predicted likely operational noise emission impacts have been assessed against the assessment criteria to determine whether adverse impacts on surrounding properties are likely.
- The predicted likely construction noise and vibration impacts have been assessed against the assessment criteria to determine whether impacts on surrounding properties are likely and the proposed mitigation measures.
- An assessment of whether ambient noise levels on the site generated by local environmental noise sources (road and rail) are likely to adversely impact occupant amenity.
- Physical and management controls to mitigate any adverse impacts indicated by the analysis have been identified.

2 INTRODUCTION

This Acoustic Logic report is in support of a State Significant Development Application (SSD-77260958) for a 39 storey mixed use tower located at 2-4 Burleigh St and 20-24 Railway Parade, Burwood.

The proposal will deliver a mixed use development containing a hotel with 120 rooms, commercial office premises and a residential flat building with 48 dual key residential apartments. The development also includes 5 storey basement parking.

The following surrounding sources have been assessed in this report:

- Local roads: Vehicle travelling on Railway Parade and Burleigh Street, and
- Train and Station Noise: Resultant from Burwood Station.
- Noise emissions from mechanical plant to service the project site (in principle).
- Preliminary construction noise and vibration impacts including mitigation measures.

The subject site and local context are indicated in Figure 1.

This assessment has been conducted using the architectural plans provided by PTI architecture dated 30/10/2024.

3 RESPONSE TO SEARS

The assessment addresses the project Secretary’s Environment Assessment Requirements (SEARs) in the following table.

12. Noise and Vibration Provide a noise and vibration impact assessment prepared in accordance with the relevant NSW Environment Protection Authority (EPA) guidelines. The assessment must detail construction and operational noise and vibration impacts on nearby sensitive receivers and structures and outline the proposed management and mitigation measures that would be implemented.	• Noise and Vibration Impact Assessment
--	---

4 REFERENCED DOCUMENTS

4.1 BACKGROUND INFORMATION USED

The assessment is based on architectural drawings prepared by PTI architecture. Refer to Appendix E.

4.2 GUIDELINES

The following planning instruments and guidelines have been used in the assessment:

- NSW Department of Planning document – “*State Environmental Planning Policy (SEPP) (TRANSPORT & INFRASTRUCTURE) 2021*”.
- NSW Department of Planning document – “*Development near Rail Corridors and Busy Roads – Interim Guideline*” (**DNRCBR**) 2009.
- Australian Standard 2107:2016 Acoustics – Recommended design sound levels and reverberation times for building interiors (“**AS2107:2016**”)
- EPA Interim Construction Noise Guideline (“**ICNG**”)
- Burwood Development Control Plan 2023 (“**DCP**”).
- NSW EPA – ‘Noise Policy for Industry’ (“**NPI**”) October 2017.

5 SITE DESCRIPTION AND THE PROPOSAL

5.1 SITE DESCRIPTION

The site is located within Burwood, a suburb of the Burwood Local Government Area located approximately 10km west of the Sydney CBD.

The site is located on the southern side of Railway Parade and to the south of the Main Suburban railway line, and sits at the corner of Burleigh Street and Railway Parade. This site comprises of 5 parcels of land identified as follows:

- 20 Railway Parade – Lot C in DP 438222;
- 22 Railway Parade – Lot B in DP 438222;
- 24 Railway Parade – Lot A in DP 438222.
- 2 Burleigh Street – Lot D in DP 438222; and
- 4 Burleigh Street – Lot E in DP 438222.

The site is located within the Burwood Town Centre which contains a number of mixed use developments comprising commercial, retail, medical and residential land uses. The locality is characterised by a diverse range of developments, ranging from single storey dwellings to 30 storey commercial and residential buildings

The immediate locality is to support high density development given its location within close proximity to Burwood Railway Station, as evidenced by the applicable built form controls which allow for building heights of 70m, and up to 140m on some sites.

Existing on the site are single storey buildings, both detached and attached, occupied by various small businesses, including a family medical practice, tutoring business and a hearing clinic. Shared vehicle access is provided on Burleigh Street to a small carpark shared by all of the existing buildings.

The site is relatively flat with a fall of approximately 1m from the Railway Parade frontage to the southern boundary.

The site is almost entirely built over with the only vegetation existing on the site limited to small areas of grass and three small trees along the Railway Parade frontage.

5.2 PROJECT DESCRIPTION

The SSD Application will seek consent for the construction of a 39 storey mixed use development containing a hotel with 120 rooms, commercial office premises and a residential flat building with 48 dual key residential apartments and 5 levels of basement car parking.

It should be noted that demolition of the existing buildings across the site will be completed under an existing Complying Development Certificate, and as such will not form part of this application.

The proposed development is described in detailed in the Architectural Plans prepared by PTI Architecture and the Environmental Impact Statement prepared by Planning Ingenuity.

5.3 NOISE RECEIVERS IDENTIFIED

The nearest noise receivers around the site include:

- **R1:** Residential Receiver 1 – Two storey residential development located on the sites eastern boundary.
- **R2:** Mixed-Use Receiver 1 – Mixed use tower located south east of the site at 16 Railway Parade, Burwood.
- **R3:** Residential Receiver 2 – Two storey residential dwellings located south of the site on Burleigh Street.
- **R4:** Place of Worship Receiver 1 – Orthodox Church located west of the site at 26 Railway Parade, Burwood.



Figure 1 – Site Plan Showing Local Context and Noise Monitoring Locations (Source: Six Map)

- - Site
- - Residential
- - Mixed Use
- - Place of Worship
- - Unattended Measurement

6 ABBREVIATIONS AND DEFINITIONS

The following Abbreviations and definitions are used in this noise impact assessment.

dB	Decibels - unit for the measurement of sound
dB(A)	A-weighted decibels. Unit of measurement for broadband sound with the A-frequency weighting applied to approximate human loudness perception to sounds of different pitch.
L_{eq}	Energy, time averaged sound level
L_{max}	Maximum sound pressure level, fast response
L₉₀	Sound level exceeded for 90% of the measurement period
R_w	Frequency weighted sound reduction index.
NRC	Average absorption co-efficient for the octave bands with centre frequencies of 250Hz to 2 kHz inclusive.
Day*	For noise emissions assessment - the period from 7 am to 6 pm (Monday to Saturday) and 8 am to 6 pm (Sundays and public holidays). For transportation noise - the period from 7 am to 10 pm
Evening*	Refers to the period from 6 pm to 10 pm.
Night*	The period from 10 pm to 7 am (Monday to Saturday), and 10 pm to 8 am (Sundays and public holidays). For transportation noise - the period from 10 pm to 7am
Project Trigger Level	Target receiver noise levels for a particular noise-generating facility.
Assessment Background Level (ABL)	A-weighted background noise level representative of a single period. (Calculated in accordance with NPI unless noted otherwise)
Rating Background Level (RBL)	The overall, single-figure A-weighted background level representing each assessment period (day/evening/night) over the whole monitoring period. (Calculated in accordance with NPI unless noted otherwise)

* Unless nominated otherwise.

7 NOISE AND VIBRATION INTRUSION CRITERIA

7.1 BURWOOD 2023 DCP ASSESSMENT CRITERIA

The Burwood DCP 2023 requirement is a general requirement and does not provide numerical assessment criteria. The development is within close proximity of a rail corridor therefore further reference is made to the **SEPP 2022**.

7.1.1 NSW Department of Planning and Environment document – ‘State Environmental Planning Policy (Transport and Infrastructure)’ (SEPP) 2022

“This section applies to development for any of the following purposes that is on land in or adjacent to the road corridor for a freeway, a tollway or a transitway or any other road with an annual average daily traffic volume of more than 20,000 vehicles (based on the traffic volume data published on the website of TfNSW) and that the consent authority considers is likely to be adversely affected by road noise or vibration—

(a) residential accommodation,

(b) a place of public worship,

(c) a hospital,

(d) an educational establishment or centre-based childcare facility.

If the development is for the purposes of residential accommodation, the consent authority must not grant consent to the development unless it is satisfied that appropriate measures will be taken to ensure that the following L_{Aeq} levels are not exceeded—

(a) in any bedroom in the residential accommodation—35 dB(A) at any time between 10 pm and 7 am,

(b) anywhere else in the residential accommodation (other than a garage, kitchen, bathroom, or hallway)—40 dB(A) at any time.”

7.1.2 NSW Department of Planning – **Development near Rail Corridors or Busy Roads – Interim Guideline**

This guideline provides general and specific advice for the planning and assessment of noise sensitive development impacted by roads and railways, and in particular those uses required to be addressed under the TI SEPP and ADG. The assessment criteria broadly mirror those in the TI SEPP.

7.1.2.1 Internal Noise Criteria – Airborne Noise

Table 3.1 of the guideline (repeated below) summarises the internal noise levels that should be achieved in noise sensitive developments. The $L_{eq,15hr}$ descriptor is recommended to assess noise levels in habitable rooms of non-residential development.

Table 1 – DNRCBR Airborne Noise Criteria

Building Use	Room	Noise Level dB(A) L_{eq}
Residential	Sleeping Area (Bedroom)	35 (10pm to 7am)
	Other habitable rooms (excl. garages, kitchens, bathrooms & hallways)	40 (7am to 10pm)

7.1.2.2 Railway Ground Vibration and Regenerated Noise

Trains induce ground borne vibration that is transmitted through the subsoil. These vibrations can be perceptible close to railways as tactile vibrations and as ground borne (regenerated) noise.

Tactile Vibration

Intermittent vibration generated by train movements should comply with the criteria in *Assessing Vibration: a Technical Guideline (DECC 2006)*. The guideline is based on British Standard BS 6472:1992 "Evaluation of Human Exposure to Vibration in Buildings (1Hz to 80Hz)". This standard includes guidance for the assessment of human response to building vibration, including intermittent vibrations such as those caused by trains.

Human response to vibration has been shown to be related to:

- The number and duration of events.
- Sensitivity of the human activity occurring.
- Human response to vibration at different frequencies. Humans are more sensitive to vibrational frequencies less than 80Hz.
- The orientation of the person (sitting/standing).

To account for the different sensitivity of humans to different frequencies, the standard includes curves of equal annoyance for various orientations and vibration frequency. These curves are applied as correction filters to obtain a single number (frequency weighted) vibration level that reflects human response to vibration the range of frequencies and vibration magnitudes present in the disturbing vibration.

To account for the time variance in vibration level, the standard assesses the annoyance of intermittent vibration by using the Vibration Dose Value (VDV). Alternatively, the VDV may be estimated by the eVDV which is derived by a simpler calculation using an empirical factor. Table 2 indicates the “preferred” values in the **Assessing Vibration Guideline**. For this project, the aim will be to not exceed the “Preferred Values”.

Table 2 – Intermittent Vibration Dose Values (m/s^{1.75})

Place	Day	Night
Residential	0.20	0.13
Commercial/ Function/ Lobby/ Café (conservatively assessed as “office” space)	0.40	0.40

Ground Borne Noise

DNRCBR recommends that ground borne noise in residential buildings should not exceed 40 dB(A) (daytime) and 35 dB(A) (night-time) (95 percentile of the maximum noise level measured on slow time response).

DNRCBR does not require structure radiated ground borne vibration to be assessed when ground borne noise is likely to be masked by airborne noise. Assessment is typically only needed if the building is located over a railway tunnel or is otherwise significantly screened from a surface railway so there is no or minimal airborne noise.

For the proposed buildings, ground borne noise will be masked by airborne noise and an assessment of ground borne noise is not required.

7.1.2.3 Ventilation

The DNRCBR recommends that when “windows open” noise levels are excessive, that is when that “windows open” noise level exceeds the “windows closed” criterion by more than 10 dB(A), the occupants should be able to *“leave their windows closed, if they so desire, and also meet the ventilation requirements of the Building Code of Australia (BCA).”*

7.1.3 Australian Standard 2107:2016

AS2107-2016 recommends design criteria for internal spaces within various types of spaces/occupancies to ensure a healthy, comfortable and productive environment for the occupant.

Table 3– Recommended Design Sound Level

Occupancy/Activity Type	Recommended Design Sound Level
Restaurants	40-50 dB(A) _{Leq}
General office areas	40-45 dB(A) _{Leq}
Function areas	40-45 dB(A) _{Leq}

7.2 ADOPTED PROJECT SPECIFIC CRITERIA

The following table provides the criteria adopted for this assessment based on the applicable instruments and guidelines.

Table 4 – Noise Assessment Criteria

Building Use	Room	Noise Level dB(A) L_{eq}
Residential	Sleeping Area (Bedroom)	35 dB(A) L_{eq} (nighttime)
	Other habitable rooms (excl. garages, kitchens, bathrooms & hallways)	40 dB(A) L_{eq} (anytime)
Non-Residential Spaces	All Rooms	45 dB(A) L_{eq} (anytime)

Table 5 – Intermittent Vibration Dose Values ($m/s^{1.75}$)

Place	Day	Night
Residential	0.20	0.13
Commercial/ Function/ Lobby/ Café (conservatively assessed as "office" space)	0.40	0.40

8 NOISE AND VIBRATION ASSESSMENT

An assessment of noise impact has been undertaken using the following methodology:

Internal noise levels were calculated to the centre of the room using the predicted octave band façade incident external noise levels and, for each façade element, correcting for the exposed area, octave band sound transmission loss and room sound power to pressure correction. The room noise level was calculated by accumulating all significant noise paths.

Envelope performance requirements to comply with the noise criteria stipulated in Section 0 have been assessed and are provided in Section 9.

8.1 EXTERNAL NOISE LEVELS

Existing noise levels from the transportation and retail sources have been measured using the methodology outlined in Appendix B3 of the RNP as a basis, and representative noise levels determined from analysis of the data. Appendix A summarises the measurements and data obtained, and the calculated noise descriptors. These are summarised in the following table.

Table 6 – Rating Background Noise Level

Location	RBL (dB(A) L _{90,period})	
Northern Facade	Day (7am to 6pm)	50
	Evening (6pm-10pm)	48
	Night (10pm to 7am)	40
Southern Facade	Day (7am to 6pm)	47
	Evening (6pm-10pm)	46
	Night (10pm to 7am)	40

Table 7 – Ambient Noise Level

Location	Ambient Noise Level (dB(A) L _{eq,period})	
	Day (7am to 10pm)	Night (10pm to 7am)
Northern Facade facing Railway Parade	60	57
Southern Facade	54	51

8.2 RAILWAY GROUND VIBRATION

The impact of tactile vibration and ground borne (regenerated) noise have been assessed using the vibration levels measured at the site (refer Appendix C). Floor vibration has been predicted taking into account:

- Predicted ground vibration levels at the building based on the measured vibration levels.
- Ground to building losses and other natural attenuation through the building,
- Amplification/floor resonance effects.

The predicted vibration dose values within the proposed development will remain compliant with the “low probability” tactile vibration assessment criterion.

9 COMPLYING MITIGATION

Assessment of façade requirements to achieve required indoor noise levels has been undertaken. Dimensions of rooms, setbacks from roadways, window openings and floor areas have been used.

The following treatment is indicated for the proposed development to comply with the nominated assessment criteria.

9.1 BUILDING ENVELOPE

The assessment indicates that the building envelope is required to be upgraded beyond what is considered to be a "standard" form of construction to comply with the internal noise criteria.

9.1.1 Glazed Windows and Doors

Acoustically rated external windows and doors are required. Aluminium framed/sliding glass doors and windows will be satisfactory provided they meet the following criteria.

All external windows and doors listed are required to be fitted with Q-Ion type (or equal) acoustic seals. (**Mohair Seals are unacceptable**). The suitability of alternative seal types should be determined to an appropriately qualified acoustic expert.

The complying constructions are listed below.

Table 8 – Complying Glazing Constructions

Building Use	Rooms	Glazing Construction	Acoustic Seals
Residential	L3 to L6 Facing Railway Parade	10mm Float	Yes
	L6 to L9 Facing Railway Parade	6.38mm Laminated	
	L9 and above Facing Railway Parade	6mm Float	
	L3 to L6 Facing Burleigh Ave	6.38mm Laminated	
	Remaining (incl. communal areas)	6mm Float	
Commercial	All	6mm Float	

Thicker glazing may be required for structural, safety or other purposes. Where it is required to use thicker glazing than scheduled, this will also be acoustically acceptable.

It is recommended that only window systems having test results indicating compliance with the required ratings obtained in a certified laboratory be used where windows with acoustic seals have been recommended.

In addition to complying with the minimum scheduled glazing thickness, the R_w rating of the glazing fitted into open-able frames and fixed into the building opening should not be lower than the values listed in Table 9 below. This will require the use of acoustic seals around the full perimeter of open-able frames and the frame will need to be sealed into the building opening using a flexible sealant.

Table 9 – Minimum R_w of Glazing (with Acoustic Seals)

Glazing Assembly	Minimum R_w of Installed Window
6mm Float	29
6.38mm Laminated	31
10mm float	33

9.1.2 External Roof and Ceiling Construction

The roof is proposed to be of concrete construction and is acoustically acceptable without any further treatment. In the event any penetrations are required through the external lining of any of the system for other building services, gaps should be filled with acoustic sealant to ensure compliance with acoustic criteria stipulated within this report.

9.1.3 External Walls

External walls are to be of precast concrete construction and is acoustically acceptable without any further treatment. In the event any penetrations are required through the external lining of any of the system for other building services, gaps should be filled with acoustic sealant to ensure compliance with acoustic criteria stipulated within this report. Should light weight constructions be utilised a detailed analysis of the wall construction should be completed by an appropriately qualified acoustic consultant.

10 NOISE EMISSION CRITERIA

The noise emission from the project site shall comply with the requirements of the following documents:

- Burwood Development Control Plan 2023 ("**DCP**")
- NSW EPA – 'Noise Policy for Industry' ("**NPI**") October 2017

10.1 BURWOOD DEVELOPMENT CONTROL PLAN 2023

The Burwood DCP 2023 does not provide numerical assessment criteria for noise emissions. Therefore, the **NPI** will be adopted to assess emissions.

10.2 NSW EPA NOISE POLICY FOR INDUSTRY (NPI) 2017

Criteria to assess noise emissions from the operation of the proposed development have been developed using the NPI. This policy was primarily developed to assess noise impacts from industrial development, but can also be adapted to assess other types of development such as commercial buildings and air conditioning plant.

For each receiver type:

- Receivers have been grouped into "catchments". These are receivers that have been assessed as having similar characteristics (receiver type and ambient noise level). These are shown in Figure 1.
- For each catchment, representative noise assessment trigger levels have been determined based on NPI guidelines. The trigger levels have been adopted in this assessment as criteria. These will be used to indicate whether additional mitigation is needed to manage noise emissions.
- For each catchment, noise emissions have been assessed to the most impacted receiver. This means that impacts at all other receivers within that catchment will be less. Compliance at the most impacted receiver will therefore also result in compliance at all other receivers within the catchment.

For residential receivers, three criteria are assessed:

- Intrusive assessment– that is, how audible is the emitted noise compared to ambient, background noise). Criteria are determined relative to the measured rating background noise level.
- Amenity assessment – that is, how loud is the absolute level of industrial noise, including cumulative noise from other industrial sources. The NPI nominates appropriate amenity noise levels depending on the receiver type and prevailing noise environment/zoning.
- Maximum Noise assessment – will high-level, short-term noise events cause adversely impact sleep at night? Trigger levels are determined relative to the measured night rating background, and assessed outside rooms where sleep is likely to occur.

For residential receivers, noise emissions are assessed against the trigger levels to determine the likely extent of impacts. The lower of the relevant intrusiveness and amenity trigger levels are adopted. Noise emissions lower than the trigger levels indicate there is no adverse impact. A maximum noise level assessment is separately undertaken if night time emissions occur.

For other receiver types, only an "amenity" assessment is required.

Appendix A summarises the results of ambient noise monitoring. Appendix B provides the derivation of NPI trigger levels for each of the receivers. These are summarised in the following table.

10.3 SUMMARISED NOISE EMISSION CRITERIA

Table 10 – Project Specific Trigger Levels

Location/Receiver Type	Time	RBL dB(A) L_{90}	Trigger Noise Level (dB(A) $L_{eq,15min}$)		
			Intrusiveness	Amenity	Max Event
R1, R2 & R3 Residential	Day	47	52	58	N/A
	Evening	46	51	48	N/A
	Night	40	45	43	45 L_{eq} 55 L_{max}
R2 Commercial	When in use	N/A	N/A	63	N/A
R4 Place of Worship	When in use	N/A	N/A	63	N/A

The project noise trigger levels are indicated by the bolded values in the table above.

11 NOISE EMISSION ASSESSMENT

11.1 MECHANICAL PLANT NOISE

Detailed plant selection and location has not been undertaken at this stage. Satisfactory levels will be achievable through appropriate plant selection, location and if necessary, standard acoustic treatments such as duct lining, acoustic silencers and enclosures.

Noise emissions from all mechanical services to the closest receivers should comply with the requirements of Section 10.3.

11.2 NOISE FROM THE LOADING DOCK AND CARPARK

Accessibility to the loading dock is located on Burleigh Avenue and access to the underground carpark via Railway Parade. Operational noise levels from the proposed loading dock/carpark facilities have been predicted and assessed against the NSW EPA Noise Policy for Industry criteria detailed in Section 10.2 based on the information provided in the traffic report prepared by Solution Traffic Engineers.

Operational noise emissions are predicted based on the following sound power levels.

Table 11 – Source Sound Power Levels

Noise Source	Sound Power Level
Truck Manoeuvring @ 10km/h (MRV/delivery truck under 14.7 metres)	100dB(A)
Smaller Delivery Truck travelling at up to 10km/h	90dB(A)
Car/Van travelling at up to 10km/h	84dB(A)

Based on the information above, predicted noise levels from the loading dock and car park access have been summarised in the tables below.

Acoustic Logic assume that the loading dock will only be utilised throughout the daytime period and peak basement carpark movements will be throughout the evening period.

Table 12 – Predicted Cumulative Noise Levels from the Use of Loading Dock

Worst Affected Receiver	Predicted Noise Level dB(A) $L_{eq(15min)}^{(1,2)}$	Criteria Noise Level dB(A) $L_{eq(15min)}$	Complies
R1 (Residential Receiver)	52 (external)	52 (external)	Yes
R4 (Place of Worship)	38 (internal)	45 (internal)	

Table Notes:

- Based on up to 1 large trucks, 1 small delivery truck, and up to 2 car/van deliveries in any given 15min period. Each vehicle is assumed to travel at 10km/h, and have their engines on for up to 1 minute while manoeuvring within the loading dock.
- Acoustic Logic assumes a 10dB(A) noise reduction occurs through a window open for natural ventilation.

Table 13 – Predicted Cumulative Noise Levels from the Use of Basement Car Park

Worst Affected Receiver	Predicted Noise Level dB(A)_{Leq(15min)}⁽¹⁾	Criteria Noise Level dB(A)_{Leq(15min)}	Complies
Nearest residential receiver R1	45	48	Yes

1. Based on up to 35 vehicles accessing the basement carpark in any given 15 min period. Each vehicle is assumed to travel at 10km/h.

11.3 GENERAL

Residential apartments are proposed to be located above and below commercial/retail use spaces within the development. We note the following:

- General retail outlets are expected to have a minimal impact on proposed residential uses.
- Licensed tenancies (especially those which are proposed to operate during the night time period) will have a higher potential acoustic impact, pending their capacity and siting.
- Noise from internal spaces are typically controlled through management controls to ensure internal noise levels are not excessive, and to ensure the façade is not open during noise sensitive periods of the day (i.e. after 10pm, and before 7am).
- In the event any tenancies were to incorporate liquor licensing or an outdoor dining area, this would likely be subject to a separate approval, at which time the proposal would need to demonstrate compliance with the relevant noise emission criteria. With respect to noise transmission through the floor slab (internal/external noise transmission), the construction of an appropriate ceiling may be required, depending on the level of noise expected to be generated by the proposed use.

11.4 RECOMMENDATIONS

Predicted noise levels from operation of the proposed development show that it is capable of meeting the noise emission requirements at all times.

It is recommended that a review and detailed design of all mechanical plant associated with the site be undertaken prior to the issue of a construction certificate to ensure plant noise levels meet the noise emission requirements detailed in Section 10. Any review of mechanical plant noise should take into consideration the operational noise levels from the site, such that the cumulative noise does not exceed the PNTL's.

All feasible and reasonable noise mitigation measures have been applied to reduce noise levels and the following recommendations are presented:

- Engines should be turned off during loading and unloading movements, thus effectively having no idling noise during the loading and unloading operations.
- Only 4 truck movements (MRV/delivery truck under 14.7 metres) are to be allowed in any given 1-hour period. Deliveries shall be managed accordingly.
- Loading Dock is only to operate throughout the daytime period (7:00am to 6:00pm).
- Acoustic barrier is to be implemented as per Section 11.4.1.

Noise modelling predicts that noise emissions will comply to all sensitive receivers. If an increase of the loading dock usage is expected, additional acoustic review will be required.

11.4.1 Acoustic Barrier

Acoustic Logic note that due to the close proximity of residential receiver 1 to the loading dock, an acoustic barrier is required.

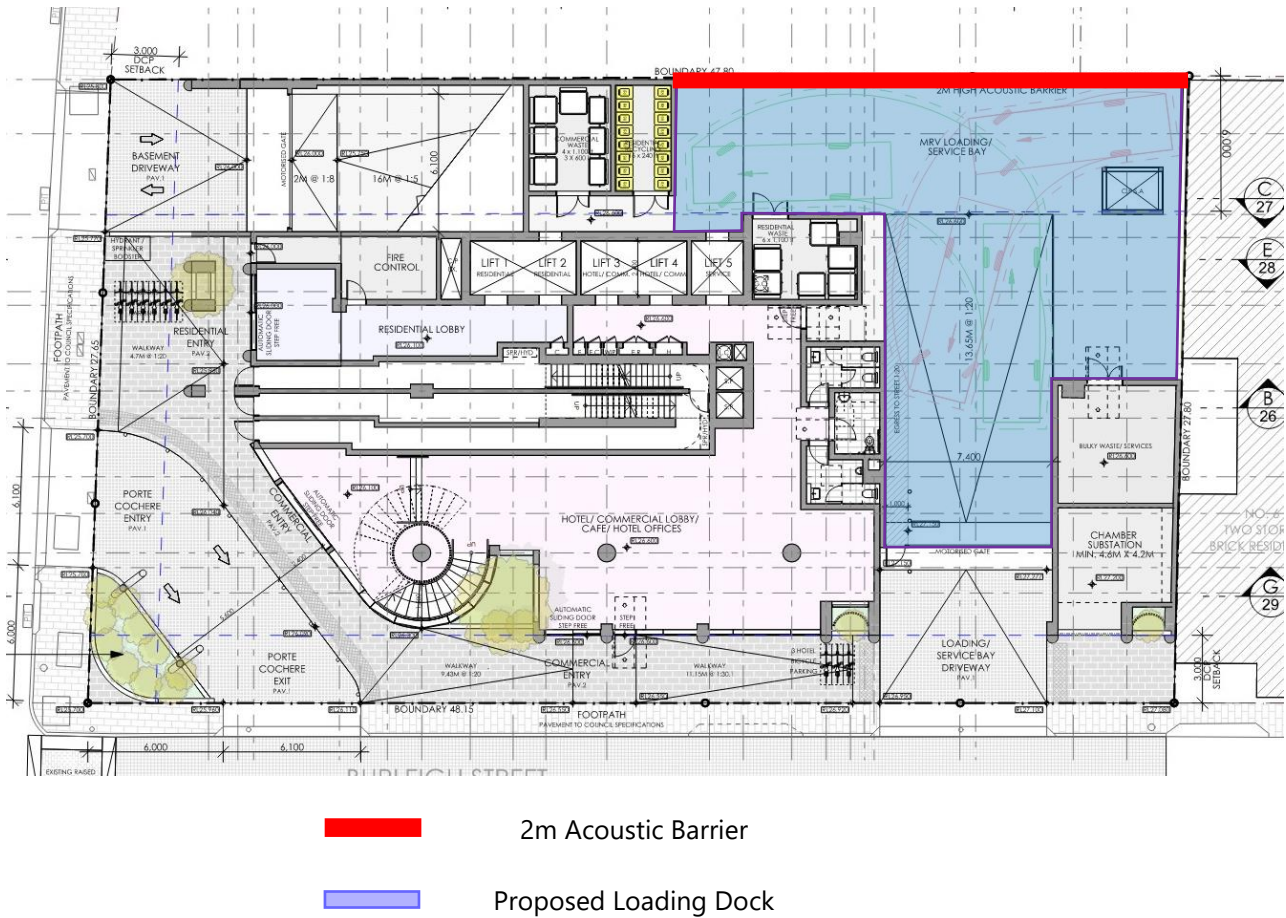


Figure 2 – Proposed Acoustic Barrier

- Recommended acoustic barrier around the loading dock is presented in the figure above. Barriers are to be constructed to the minimum height outlined from the RL as presented in the ground floor plan.
- Install The barrier is to be constructed of lapped and capped timber, plexiglass, 4mm Perspex, Colorbond, 9mm fibrous cement sheet or equivalent, installed with no gaps between the panels, and maximum of a 20mm gap at the bottom to allow water flow if required.

12 CONSTRUCTION NOISE AND VIBRATION

A quantitative evaluation of the proposed works has been undertaken to identify those activities that have the potential to adversely impact nearby properties.

The assessment uses site specific noise and vibration management levels developed using the EPA ICNG. The predicted, receiver noise and vibration levels will be compared to the management levels to identify those activities that are likely to require additional management, above what is considered to be normal good practice.

12.1 CONSTRUCTION NOISE MANAGEMENT LEVELS

12.1.1 Residential Receivers

Residential noise management levels are based on the “rating background noise level” (“**RBL**”) applicable to the receivers. RBL’s are typically determined by measuring the ambient noise environment using the methodology in the EPA NPfl. The measurements, analysis and RBL’s determined for this project are summarised in Appendix A.

The ICNG construction noise management levels are summarised in the following table, along with how they should be used to manage impacts.

Table 14 – Construction Noise Management Levels

Management Level L_{Aeq}(15min) *	How to Apply
Noise affected Management Level (“ NML ”) RBL + 10dB	The noise affected level represents the point above which there may be some community reaction to noise. Where the predicted or measured L _{Aeq} (15 min) is greater than the noise affected level, the proponent should apply all feasible and reasonable work practices to meet the noise affected level. The proponent should also inform all potentially impacted residents of the nature of works to be carried out, the expected noise levels and duration, as well as contact details.
Highly noise affected 75 dB(A)	The highly noise affected level represents the point above which there may be strong community reaction to noise. Where noise is above this level, the relevant authority (consent, determining or regulatory) may require respite periods by restricting the hours that the very noisy activities can occur.

*** Noise levels apply at the property boundary that is most exposed to construction noise, and at a height of 1.5 m above ground level. If the property boundary is more than 30 m from the residence, the location for measuring or predicting noise levels is at the most noise-affected point within 30 m of the residence. Noise levels may be higher at upper floors of the noise affected residence.**

The ICNG recommended standard hours are as follows:

- Monday to Friday – 7:00am to 6:00pm
- Saturday – 8:00am to 1:00pm
- No work on Sundays or public holidays

12.1.2 Other Land Uses

For other land uses, the management levels are absolute noise levels, independent of the prevailing noise environment, so monitoring of the prevailing environment is not generally required for these uses. The ICNG construction noise management levels for uses other than residential dwellings are summarised in the following table.

Table 15 – Construction Noise Management Levels – Non Residential Uses

Land Use	Management Level, L_{Aeq} (15min) (applies for times when properties are being used)
Commercial and Retail Outlets	70 (external)
Places of worship	45 (internal)

12.1.3 Receiver Noise Management Levels

The project specific NML's for the most impacted receivers are summarised in the following table using the objectives tabled above and the adopted RBL's.

Table 16 – Noise Management Levels for Most Impacted Receivers

Location/Receiver	RBL dB(A) L_{90}	NML dB(A) L_{eq}	HANML dB(A) L_{eq}
R1	50	60	75
R2	50	60	75
R3	47	57	75
R4	-	45 (internal)	-

12.2 CONSTRUCTION VIBRATION MANAGEMENT LEVELS

12.2.1 Amenity Management

Vibration goals for the amenity of nearby land users are those recommended by the EPA document *Assessing Vibration: A technical guideline*. These levels (extracted from Tables 2.2 and 2.4 of the guideline) are presented in the following table for various types of vibration:

Table 17 -(Table 2.2 Assessing Vibration: A Technical Guideline) – Preferred and Maximum Weighted RMS Values for Continuous and Impulsive Vibration Acceleration (m/s²) 1-80Hz

Location	Assessment Period ¹	Preferred values		Maximum Values	
		z-axis	x- and y- axes	z-axis	x- and y-axes
Continuous Vibration					
Critical areas ²	Day or night-time	0.0050	0.0036	0.010	0.0072
Residences	Daytime	0.010	0.0071	0.02	0.014
	Night-time	0.007	0.005	0.014	0.010
Offices, schools, educational institutions and places of worship	Day or night-time	0.020	0.014	0.040	0.028
Workshops	Day or night-time	0.04	0.029	0.080	0.058
Impulsive Vibration					
Critical areas ²	Day or night-time	0.0050	0.0036	0.010	0.0072
Residences	Daytime	0.30	0.21	0.60	0.42
	Night-time	0.10	0.071	0.20	0.14
Offices, schools, educational institutions and places of worship	Day or night-time	0.64	0.46	1.28	0.92
Workshops	Day or night-time	0.64	0.46	1.28	0.92

¹ Daytime is 7:00am to 10:00pm and night-time is 10:00pm to 7:00am.

² Examples include hospital operating theatres and precision laboratories where sensitive operations are occurring. There may be cases where sensitive equipment or delicate task require more stringent criteria than the human comfort criteria specified above. Stipulation of such criteria is outside the scope of this policy, and other guidance documents (e.g. relevant standards) should be referred to. Source: BS6472-1992.

Table 18 -(Table 2.4 Assessing Vibration: A technical guideline) – Acceptable Vibration Dose Values for Intermittent Vibration (m/s^{1.75})

Location	Daytime ¹		Night-time ¹	
	Preferred value	Maximum Value	Preferred value	Maximum Value
Critical areas ²	0.10	0.20	0.10	0.20
Residences	0.20	0.40	0.13	0.26
Offices, schools, educational institutions and places of worship	0.40	0.80	0.40	0.80
Workshops	0.80	1.60	0.80	1.60

1 Daytime is 7:00am to 10:00pm and night-time is 10:00pm to 7:00am.

2 Examples include hospital operating theatres and precision laboratories where sensitive operations are occurring. These criteria are only indicative, and there may be a need to assess intermittent values against the continuous or impulsive criteria for critical areas. Source: BS6472-1992.

12.2.2 Structure Damage Risk Criteria

12.2.2.1 Generally

German Standard DIN 4150-3 (2016) provides a guideline for acceptable levels of vibration velocity in building foundations, to assess the effects of vibration on structures. The table give guidance on the maximum accepted values of velocity at the foundation and in the plane of the highest floor of various types of buildings, to prevent any structural damage.

The table following lists the peak particle velocity, which is the maximum absolute value of the velocity signals for the three orthogonal components. This is measured as a maximum value of any of the three orthogonal component particle velocities when measured at the foundation, and the maximum levels measured in the x- and y-horizontal directions in the plane of the floor of the uppermost storey.

It is noted that if measured vibration levels do not exceed the guidelines listed in the following table, damage that will reduce the serviceability of the building will not occur, and if damage to the building does occur, it is assumed that the damage is related to other causes. Furthermore, the DIN4150-3 guideline states the following regarding the limits presented in Table 1 of the standard:

“Exceeding the guideline values does not necessarily lead to damage. Should they be exceeded, however, further investigations may be necessary, such as determining and evaluating the stresses as detailed in 4.3 and 4.4.”

Table 19 -(Table 1 – DIN 4150-3 (2016)) – Guideline Values for Vibration Velocity, $v_{i,max}$, for Evaluating the Effects of Short-Term Vibration on Structures

	TYPE OF STRUCTURE	Guideline values for $v_{i,max}$ in mm/s				
		Foundation, all directions, $i = x, y, z$, at a frequency of			Topmost floor, horizontal direction, $i = x, y$	Floor slabs, vertical direction, $i = z$
		1Hz to 10Hz	10Hz to 50Hz	50Hz to 100Hz ^(a)	All Frequencies	All Frequencies
L/C	1	2	3	4	5	6
1	Buildings used for commercial purposes, industrial buildings, and buildings of similar design	20	20 to 40	40 to 50	40	20
2	Residential buildings and buildings of similar design and/or occupancy	5	5 to 15	15 to 20	15	20
3	Structures that, because of their particular sensitivity to vibration, cannot be classified under lines 1 and 2 and are of great intrinsic value (e.g. listed buildings) buildings that are under a preservation order)	3	3 to 8	8 to 10	8	20 ^(b)

NOTE Even if guideline values as in line 1, columns 2 to 5, are complied with, minor damage cannot be excluded.

a At frequencies above 100 Hz, the guideline values for 100 Hz can be applied as minimum values.

b It may be necessary to lower the guideline value markedly to prevent minor damage

12.3 CONSTRUCTION NOISE ASSESSMENT

12.3.1 Preliminary Proposed Construction Activities

Preliminary review of typical construction activities has been conducted. Noise impacts from construction activities on the amenity of the surrounding identified sensitive receivers, will be predicted in this section. Typically, the most significant sources of noise or vibration generated during a construction project will be the demolition, excavation and civil works for the site.

The A-weighted sound power levels for the expected loudest equipment/processes for each stage of development are outlined in the table below.

Table 20 – Sound Power Level of Loudest Proposed Equipment

Construction Stage	Loudest Equipment /Process	Typical Sound Power Level dB(A)
Shoring and Bulk Excavation	Excavator	110
Civil Works	Crane - Fixed	113

12.3.2 Predictions

Construction noise emissions to nearby development depend on the activities being undertaken at the time, and where on the site the activities occur.

Construction noise levels at the surrounding receivers have been predicted based on the following inputs.

- The plant sound power levels indicated in Appendix D. These have been corrected for estimated typical operation duty indicated in the table using $10 \times \log(\% \text{ duty}/100)$.
- Corrections for source to receiver distance attenuation including air absorption (20°C , 70% RH, neutral wind conditions).
- Barrier or directivity attenuation where present.
- Source heights – 1.5m above the ground/building level of the noise source location, unless noted otherwise.
- Source locations are indicated in the Site Management Plan provided by Conquest

Table 21 – Predicted Noise Impacts for Shoring and Bulk Excavation

Location/Receiver	Highest Predicted Level dB(A) L_{eq}	NML dB(A) L_{eq}	HANML dB(A) L_{eq}	Requires Assessment of Additional Management
R1	67-77	57	75	Yes
R2	62-67	57	75	
R3	60-69	57	75	
R4	53-63 (internal)*	45 (internal)	-	

*Acoustic Logic assume a 10dB(A) noise reduction occurs through a window open for natural ventilation.

Table 22 – Predicted Noise Impacts for Civil Works

Location/Receiver	Highest Predicted Level dB(A) L_{eq}	NML dB(A) L_{eq}	HANML dB(A) L_{eq}	Requires Assessment of Additional Management
R1	70-80	57	75	Yes
R2	65-70	57	75	
R3	63-72	57	75	
R4	56-65 (internal)*	45 (internal)	-	

*Acoustic Logic assume a 10dB(A) noise reduction occurs through a window open for natural ventilation.

The analysis indicated that:

- All receivers will be subject to noise exceeding the NML.
- Some receivers will be subject to noise exceeding the HANML.
- The distance separation between the sensitive noise receivers is minimal.

12.3.3 Site Specific Recommendations

In light of the above, we recommend:

- The scheduling of construction activities should be undertaken to reasonably minimise noise impacts to all surrounding land uses.
 - In this regard, highly noise intrusive works such as hammering should not take place prior to 8am.
- Materials handling/vehicles:
 - Trucks to use a non-tonal reversing beacon (subject to OH&S requirements) to minimise potential disturbance of neighbours.
 - Avoid careless dropping of construction materials into empty trucks.
 - Trucks, trailers and concrete trucks (if feasible) should turn off their engines during idling to reduce noise impacts (unless truck ignition needs to remain on during concrete pumping).
- High Noise Generating Demolition:
 - Where high noise generating demolition are proposed to be undertaken, respite hours should be implemented to reduce the impact on surrounding receivers.
- Complaints handling:
 - An after hours contact number is to be displayed outside of the building site, so that in the event that surrounding developments believe that a noise breach is occurring, they may contact the site.

12.4 ASSESSMENT OF VIBRATION

12.4.1 Vibration Producing Activities

Demolition of the existing structures has the potential to produce significant ground vibration.

12.4.2 Vibration Management

The following principles should be considered to manage adverse vibration impacts:

- Obtaining separate structural or specialist advice for critical or fragile structures as to the level of damage risk.
- Selection of processes that minimise structure and ground vibration – generally avoiding percussive methods.
- Use smallest plant that is able to efficiently undertake the work activity.
- Lay vibration absorbing mats to cushion impacts from falling debris.
- Application of vibration dampening pads to metal surfaces subject to impacts.
- When demolishing, cut control joints in structures to form vibration “breaks”, or work away from sensitive receiver locations to form natural vibration breaks in propagation path.
- Monitoring of structures using attended and/or unattended monitors with alarms.
- Time scheduling works to minimise amenity impacts.
- Communicating with affected receivers.

13 CONCLUSION

This report presents an acoustic assessment of noise impacts associated with the proposed mixed use building to be located at 2-4 Burleigh St & 20-24 Railway Parade, Burwood. Based on our assessment the following has been concluded.

Provided that the recommendations set out in Section 9.1 of this report are employed, internal noise levels shall satisfy the requirements outlined in:

- NSW Department of Planning document – “*State Environmental Planning Policy (SEPP) (TRANSPORT & INFRASTRUCTURE) 2021*”; and
- NSW Department of Planning document – “*Development near Rail Corridors and Busy Roads – Interim Guideline*” (**DNRCBR**) 2009.
- Australian Standard 2107:2016 Acoustics – Recommended design sound levels and reverberation times for building interiors (“**AS2107:2016**”)

Provided that recommendations set out in Section 1 of this report are employed, external noise emissions shall satisfy the requirements outlined in:

- Burwood Development Control Plan 2023 (“**DCP**”)
- NSW EPA – ‘Noise Policy for Industry’ (“**NPI**”) October 2017

Construction Noise and Vibration impacts have been assessed using the EPA Interim Construction Noise Guideline (“**ICNG**”).

We trust this information is satisfactory. Please contact us should you have any further queries.

Yours faithfully,



Acoustic Logic Pty Ltd
Justine Wade

APPENDIX A AMBIENT NOISE MONITORING

This appendix summarises the ambient noise data measured near the subject site, and the calculated noise level descriptors adopted to characterise the existing noise environment.

Monitoring has been undertaken to provide the following ambient data:

- Traffic & train noise levels surrounding the site, and
- Background noise levels for the project site.

A.1 UNATTENDED LONG TERM NOISE MONITORING

A.1.1 Ambient Noise Descriptors

Ambient noise constantly varies in level from moment to moment, so it is not possible to accurately determine prevailing noise conditions by measuring a single, instantaneous noise level.

To quantify ambient noise, a 15-minute measurement interval is typically utilised. Noise levels are monitored on a continuous basis over this period, and statistical and integrating techniques are used to characterise the noise being measured.

The principal measurement parameters are:

L_{eq} - represents the average noise energy during a measurement period. This parameter is derived by integrating the noise levels measured over the measurement period. L_{eq} is important in the assessment of noise impact as it closely corresponds with how humans perceive the loudness of steady state and quasi-steady state noise sources (such as traffic noise).

L₉₀ – This is commonly used as a measure of the background noise level as it represents the noise level heard in the quieter periods during the measurement interval. The L₉₀ parameter is used to set noise emission criteria for potentially intrusive noise sources since the disturbance caused by a noise source will depend on how audible it is above the pre-existing noise environment, particularly during quiet periods, as represented by the L₉₀ level.

L₁₀ is used in some guidelines to measure noise produced by an intrusive noise source since it represents the average of the loudest noise levels produced at the source. Typically, this is used to assess noise from licenced venues.

L_{max} is the highest noise level produced during a noise event, and is typically used to assess sleep arousal impacts from short term noise events during the night. It is also used to assess internal noise levels resulting from aircraft and railway ground vibration induced noise.

L₁ is sometimes used in place of L_{max} to represent a typical noise level from a number of high-level, short-term noise events.

A.1.2 Equipment Used

Unattended noise monitoring was conducted using the following equipment:

- Rion NL-42 (Type 2)
- Rion Sound Level calibrator Type NC 74

The monitoring was continuous, with statistical noise levels recorded at 15-minute intervals throughout the monitoring period. Measurements were taken on "A" frequency weighting and fast time response, unless noted otherwise.

All monitoring equipment used retains current calibration - either manufacturers' calibration or NATA certified calibration. The monitors were field calibrated at the beginning and the end of the measurement with no significant drift in calibration noted.

A.1.3 Weather Affected and Extraneous/Outlying Data

Periods affected by adverse weather conditions are indicated on the following data graphs. Weather data was obtained from records provided by the Bureau of Meteorology for the Canterbury weather station.

- 14/03/2024 Night
- 16/03/2024 Evening/Night

As the Bureau of Meteorology wind data is typically obtained at an exposed location at 10m above ground level, and the monitoring locations were at a more sheltered locations a wind multiplying factor of 0.3 has been applied to the BOM data to estimate the wind speed at the microphone location.

A.2 CALCULATION OF REPRESENTATIVE AMBIENT NOISE LEVELS

The ambient, assessment and rating background levels have been determined from the unattended, long-term noise monitoring data based on the methodology in the Noise Policy for Industry Fact Sheet B.

A.2.1 Rating Background Noise Levels

The following tables summarise the assessment background noise levels (ABL) for each location. Note that where no ABL is indicated, this is because that period was significantly affected by adverse weather or other extraneous noise.

In accordance with the NPI, if the calculated:

- evening rating background noise level is higher than the day level, the day rating background noise level has been adopted for the evening period.
- night rating background noise level is higher than the evening level, the evening rating background noise level has been adopted for the evening period.
- day rating background noise level was less than 35 dB(A), a “default” background of 35 dB(A) has been adopted.
- evening or night rating background noise level was less than 30 dB(A), a “default” background of 30 dB(A) has been adopted.

Table 23 – RBL – Location 1 Traffic Monitor

Date	Noise Level dB(A) L ₉₀ , period		
	Day	Evening	Night
13/03/2024	-	48	39
14/03/2024	49	49	0
15/03/2024	50	48	39
16/03/2024	47	-	-
17/03/2024	49	46	38
18/03/2024	50	50	40
19/03/2024	50	49	42
20/03/2024	51	48	40
Adopted RBL	50	48	40

Table 24 – RBL – Location 2 Background Monitor

Date	Noise Level dB(A) L ₉₀ , period		
	Day	Evening	Night
13/03/2024	-	44	40
14/03/2024	47	47	-
15/03/2024	47	45	40
16/03/2024	44	-	-
17/03/2024	46	44	39
18/03/2024	47	46	41
19/03/2024	48	46	42
20/03/2024	48	46	40
Adopted RBL	47	46	40

A.3 ATTENDED MONITORING

A.3.1 Equipment Used

Attended noise monitoring was conducted using:

- Rion NL-42 (Type 2) sound level meter

The sound level meter equipment used retain current calibration - either manufacturers' calibration or NATA certified calibration, and were field calibrated at the beginning and the end of the measurement with no significant drift in calibration noted.

A.3.2 Locations Monitored

The attended monitoring locations are described below.

- Attended 1 – Train Arriving and Departing at closest Railway Platform 6 of Burwood Station. Taken on the property boundary.
- Attended 2 – Traffic Noise Measurement of Railway Parade, 3m from curb.
- Attended 3 – Traffic Noise Measurement of Burleigh Street.

A.3.3 Results

Table 25 – Attended Monitoring Results

Measurement Location	Time of Measurement	Measured Noise Level
Attended 1 (Train)	02:00pm	62 dB(A) L_{Aeq}
Attended 2 (Traffic)	04:00pm	63 dB(A) L_{Aeq}
Attended 3 (Traffic)	04:15pm	56 dB(A) L_{Aeq}

A.3.4 Summarised Traffic Noise Levels


The following noise levels for the site have been established based on long term monitoring of the development site.


Table 26 – Traffic Noise Levels


Location	Time of Day	Summarised Traffic Noise Levels – dB(A) L_{eq}
Railway Parade	Daytime 7am – 10pm	63 dB(A) L_{eq} (15hr)
	Night-time 10pm – 7am	60 dB(A) L_{eq} (9hr)
Burleigh Street	Daytime 7am – 10pm	56 dB(A) L_{eq} (15hr)
	Night-time 10pm – 7am	53 dB(A) L_{eq} (9hr)

A.4 UNATTENDED MONITORING CHARTS

A.4.1 Location 1 – Traffic Monitor

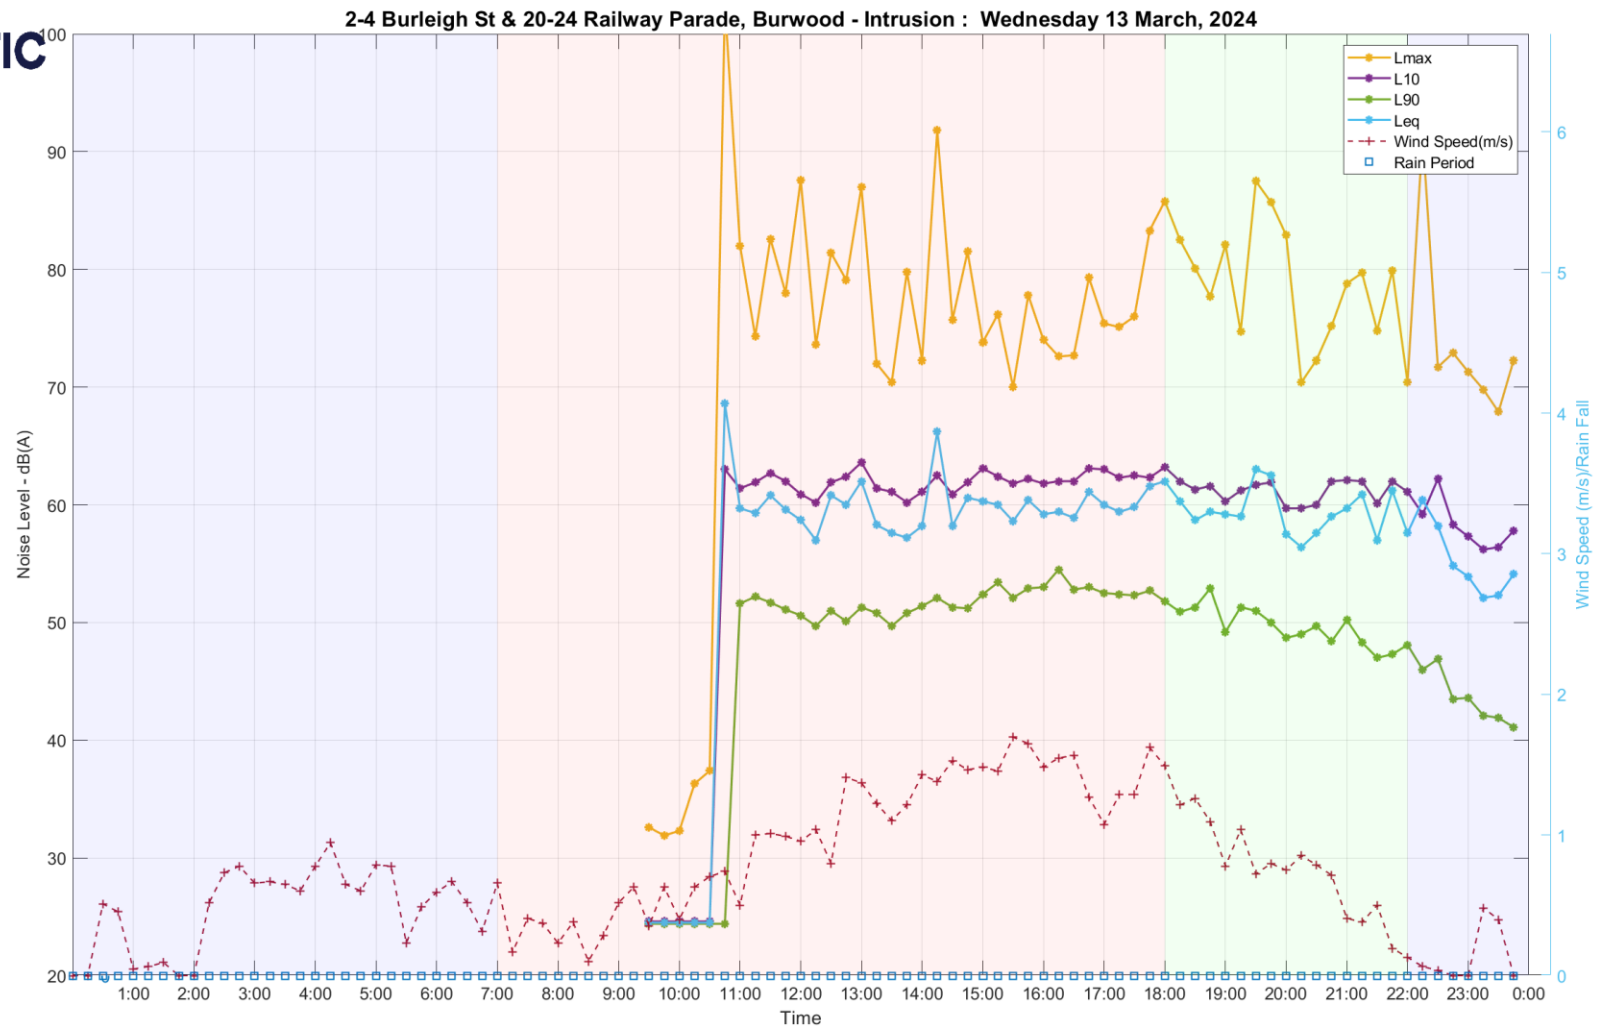


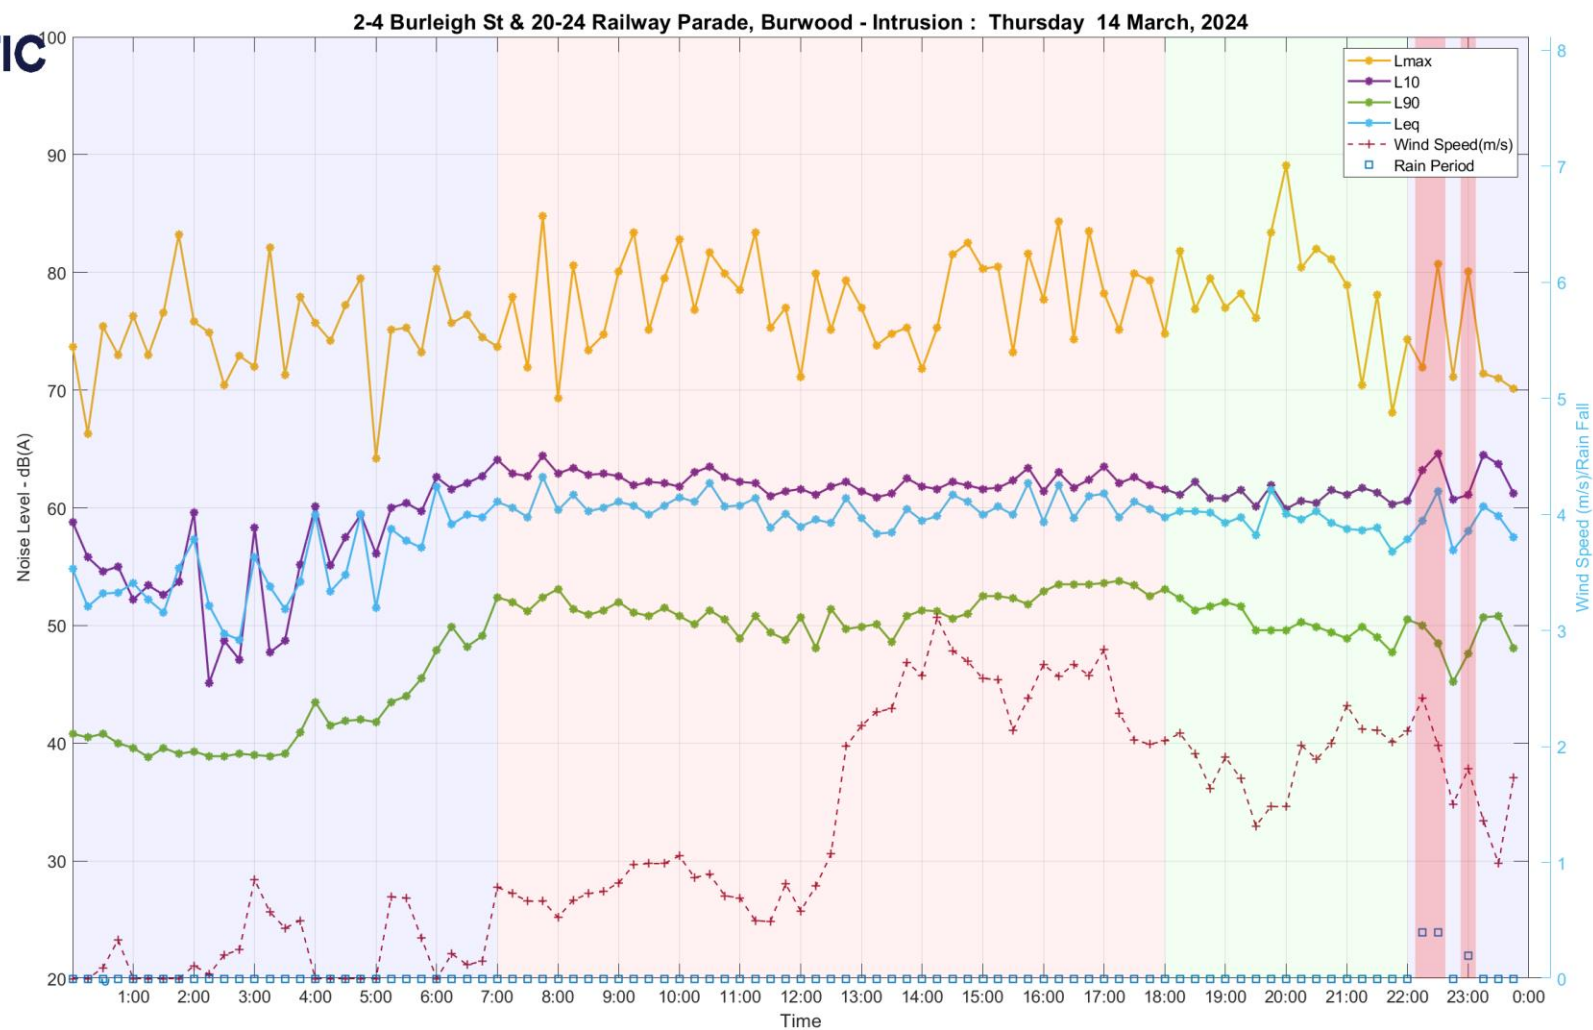

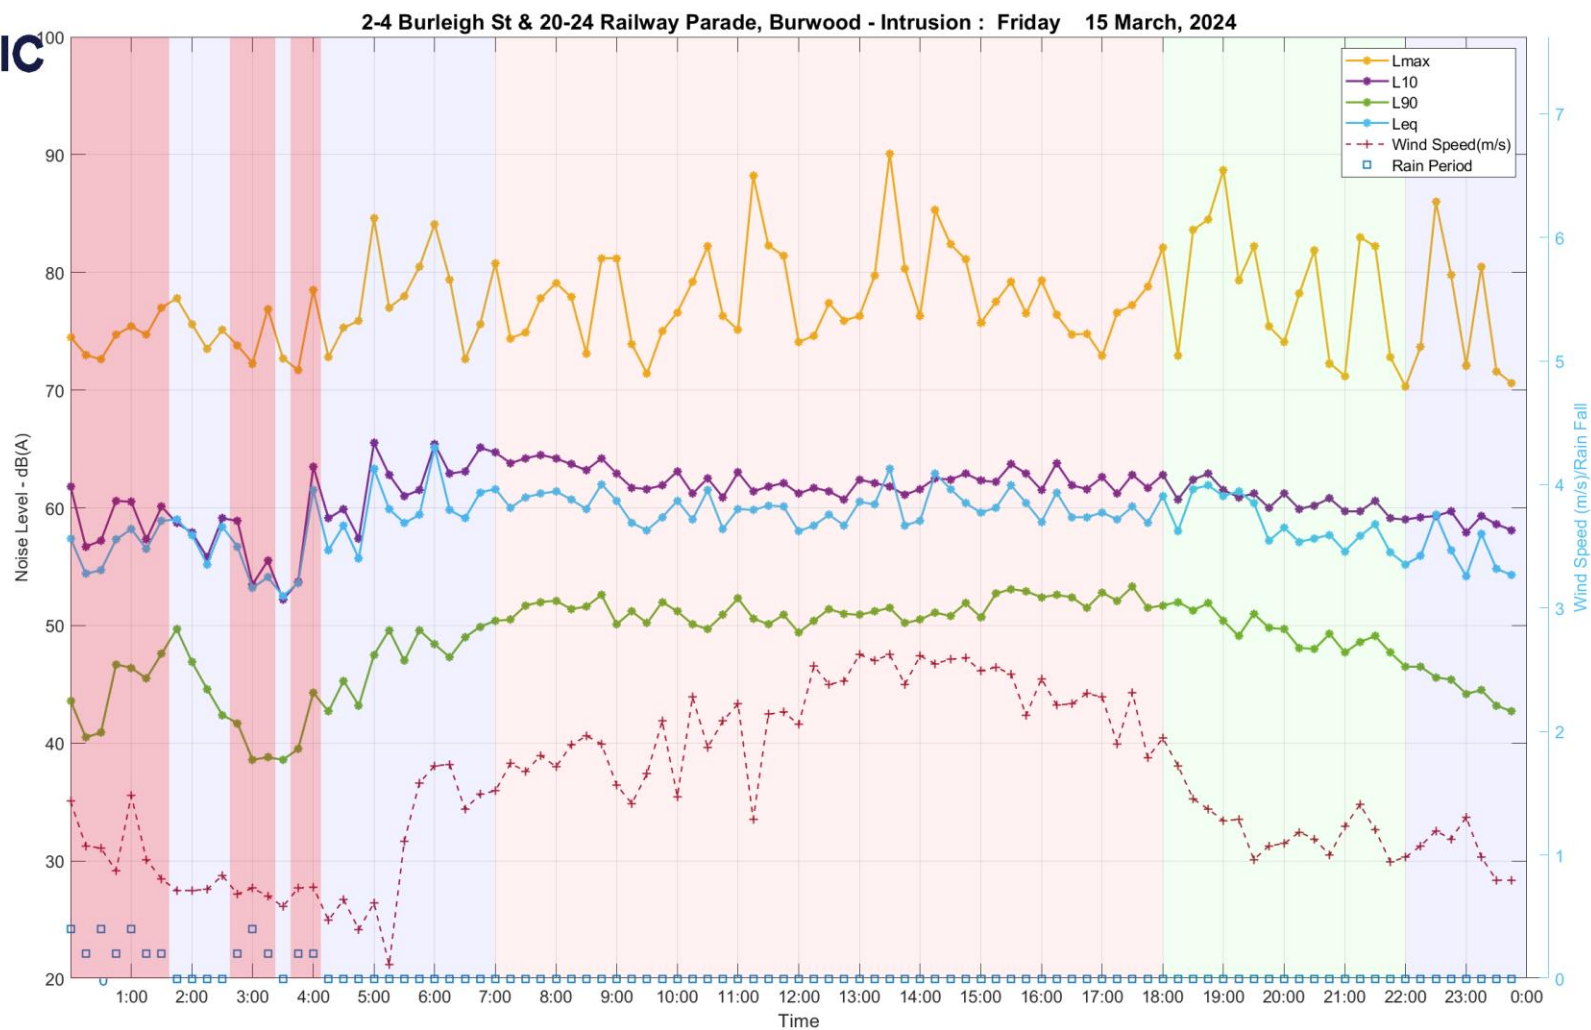





ACOUSTIC
LOGIC

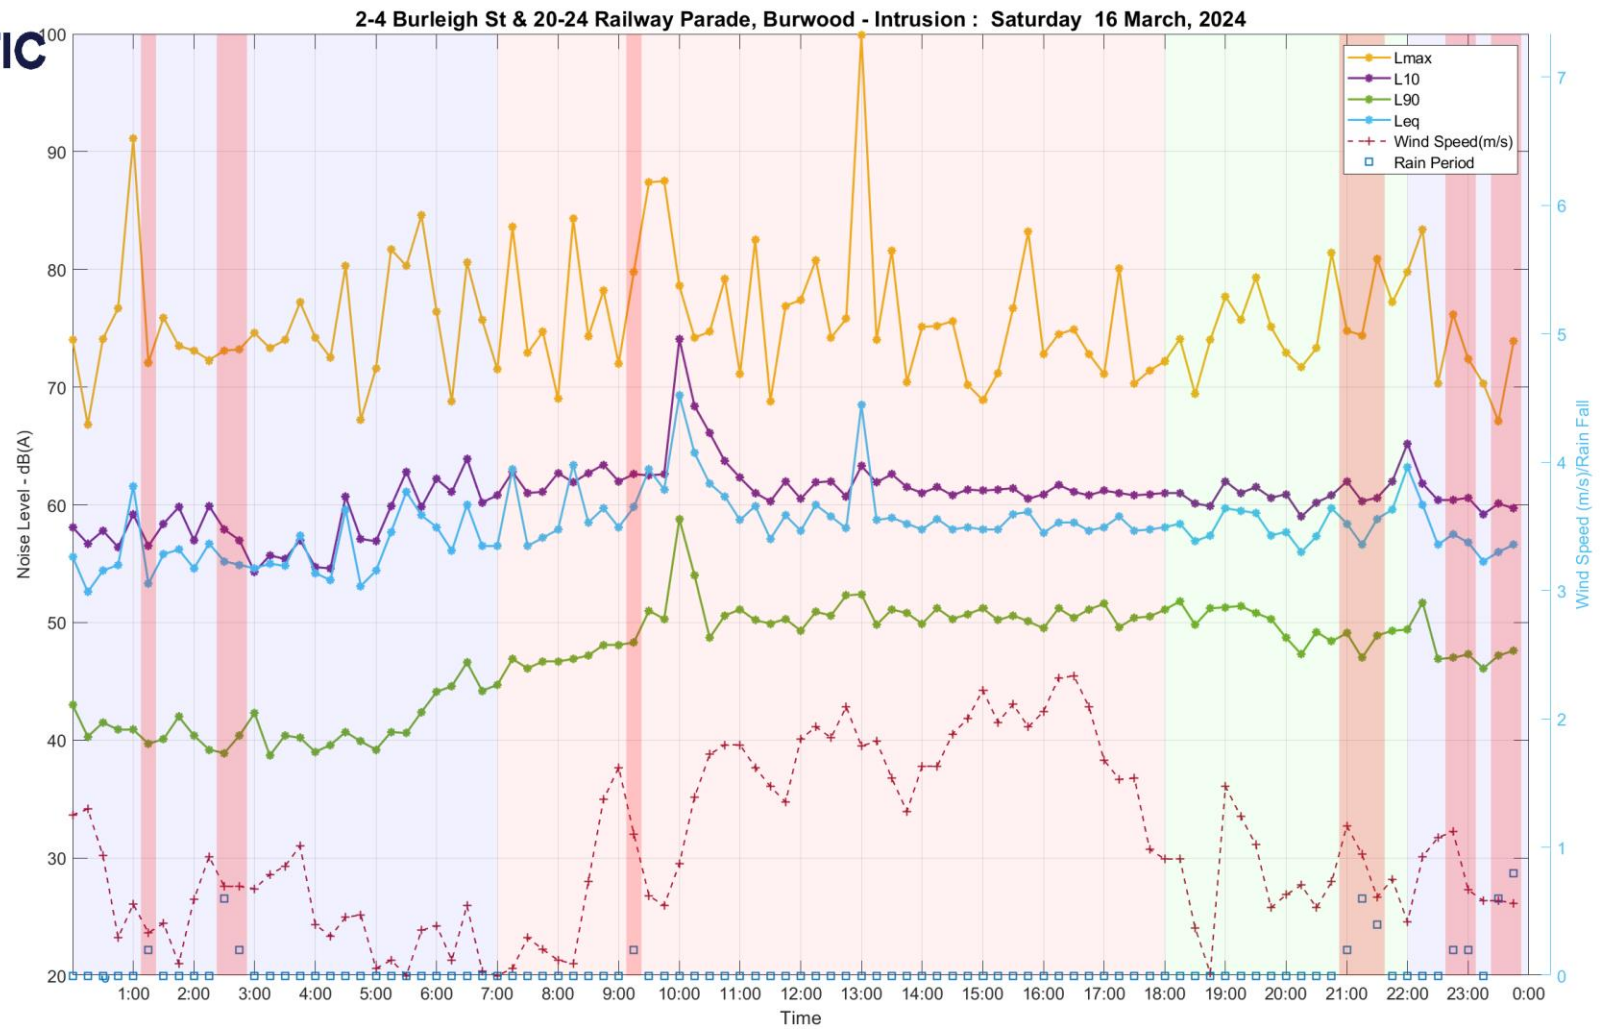





ACOUSTIC
LOGIC

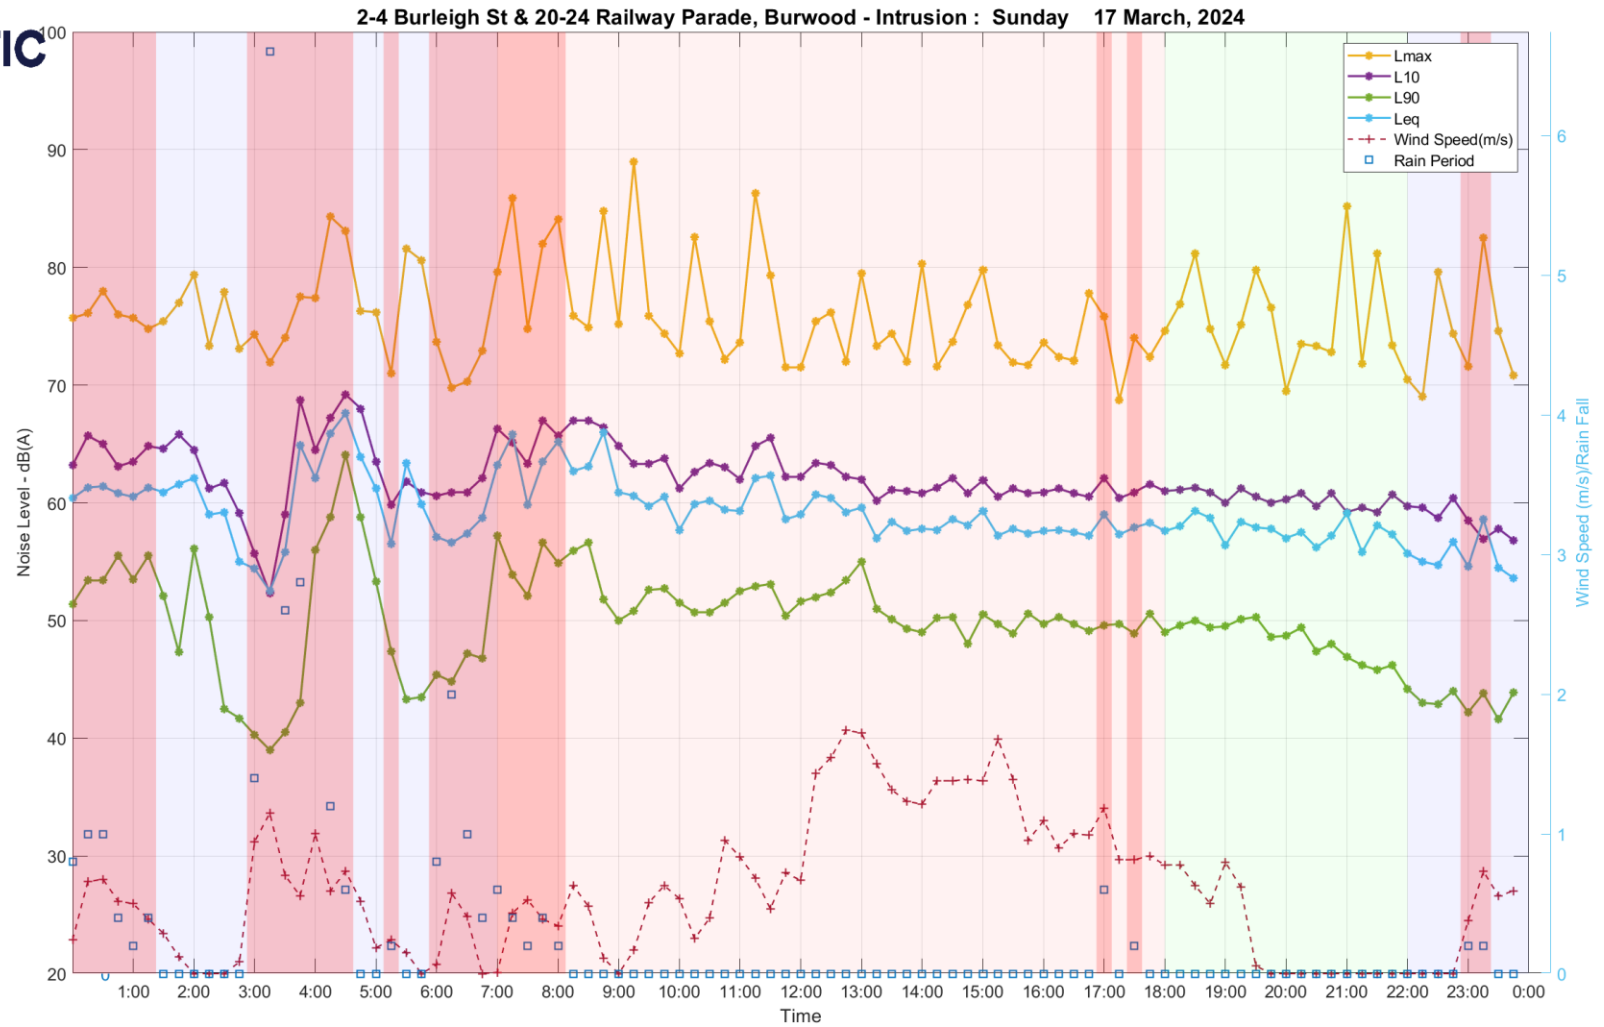

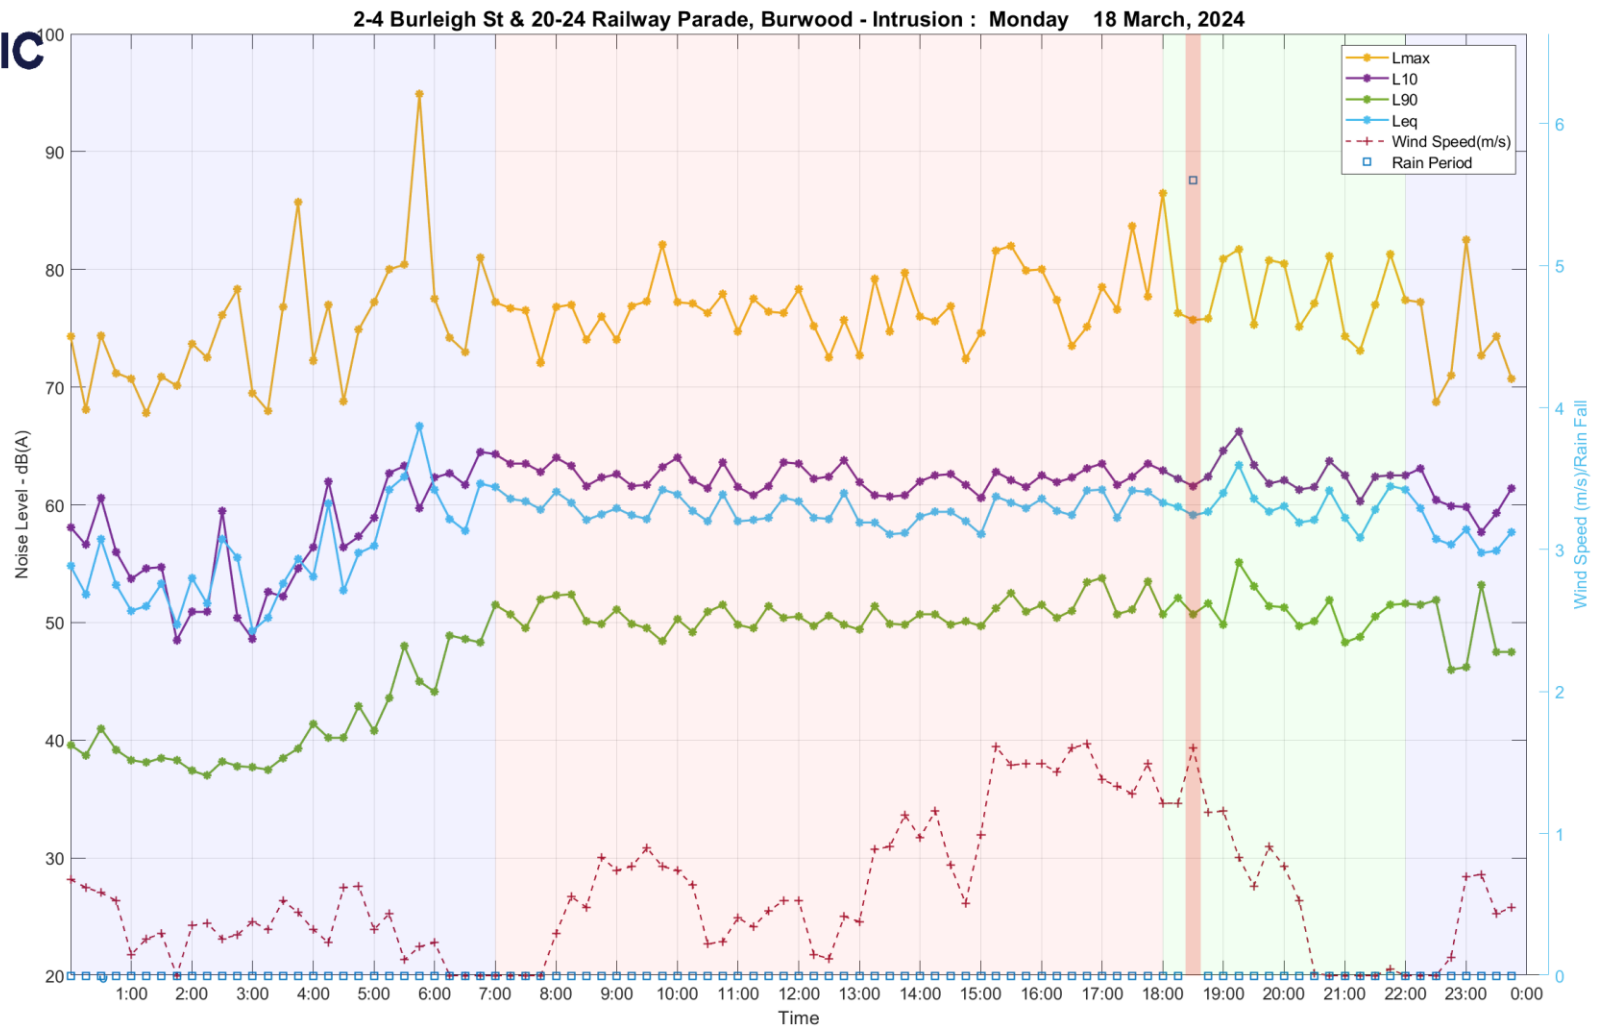


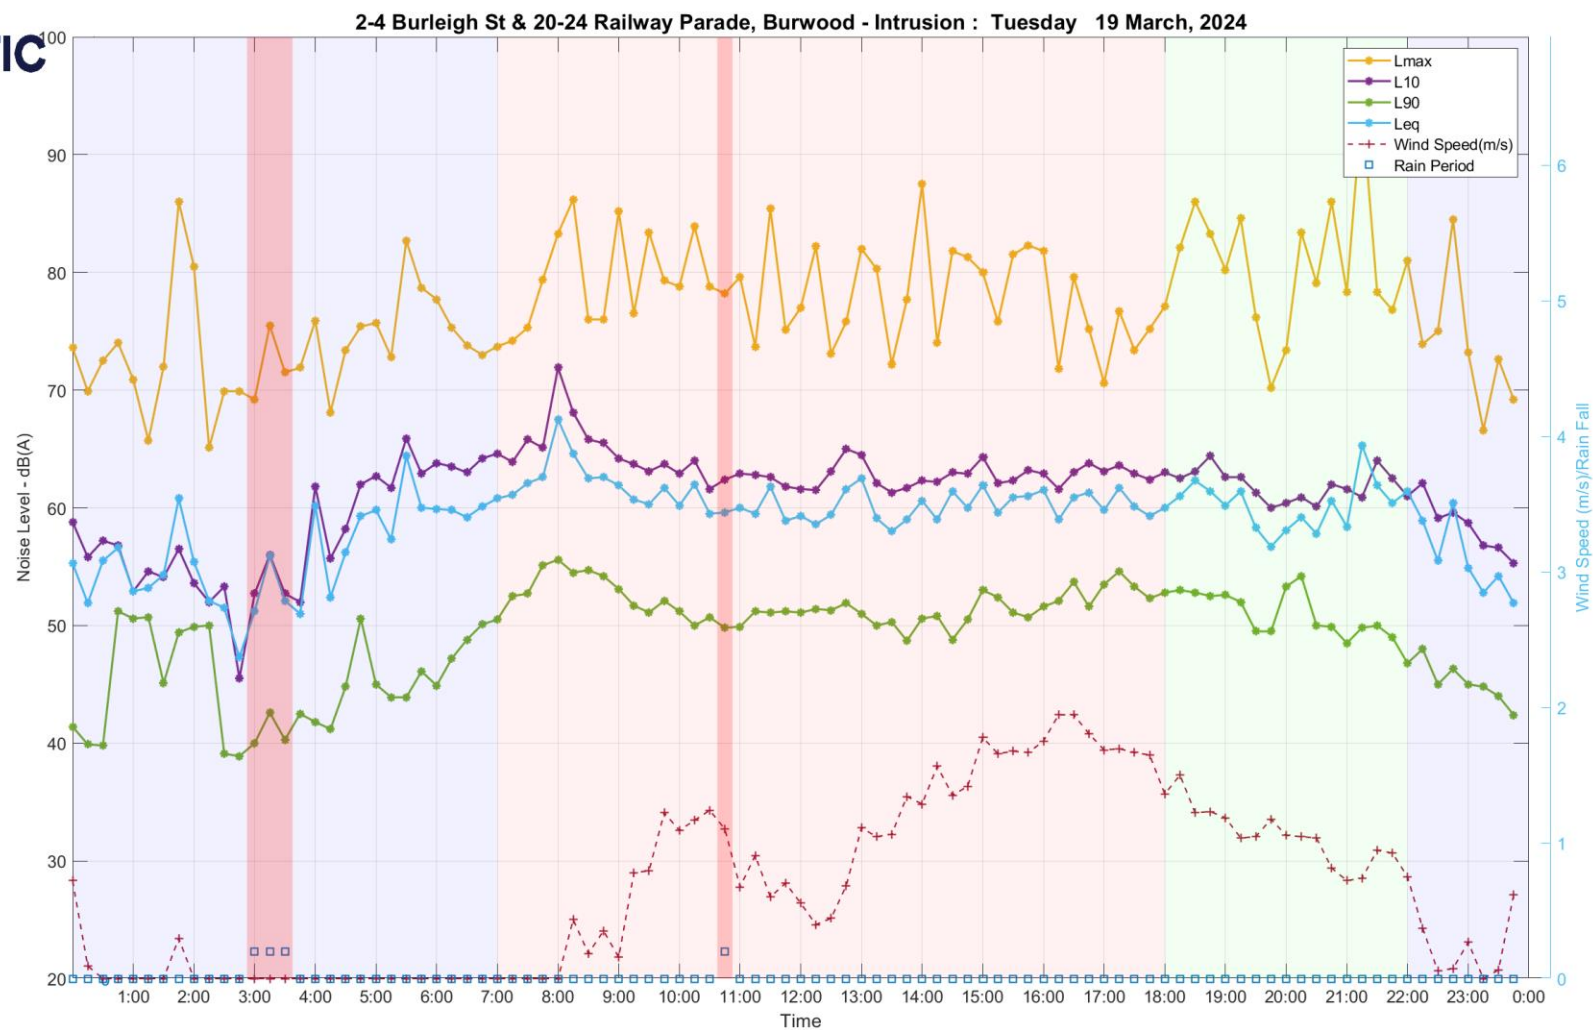

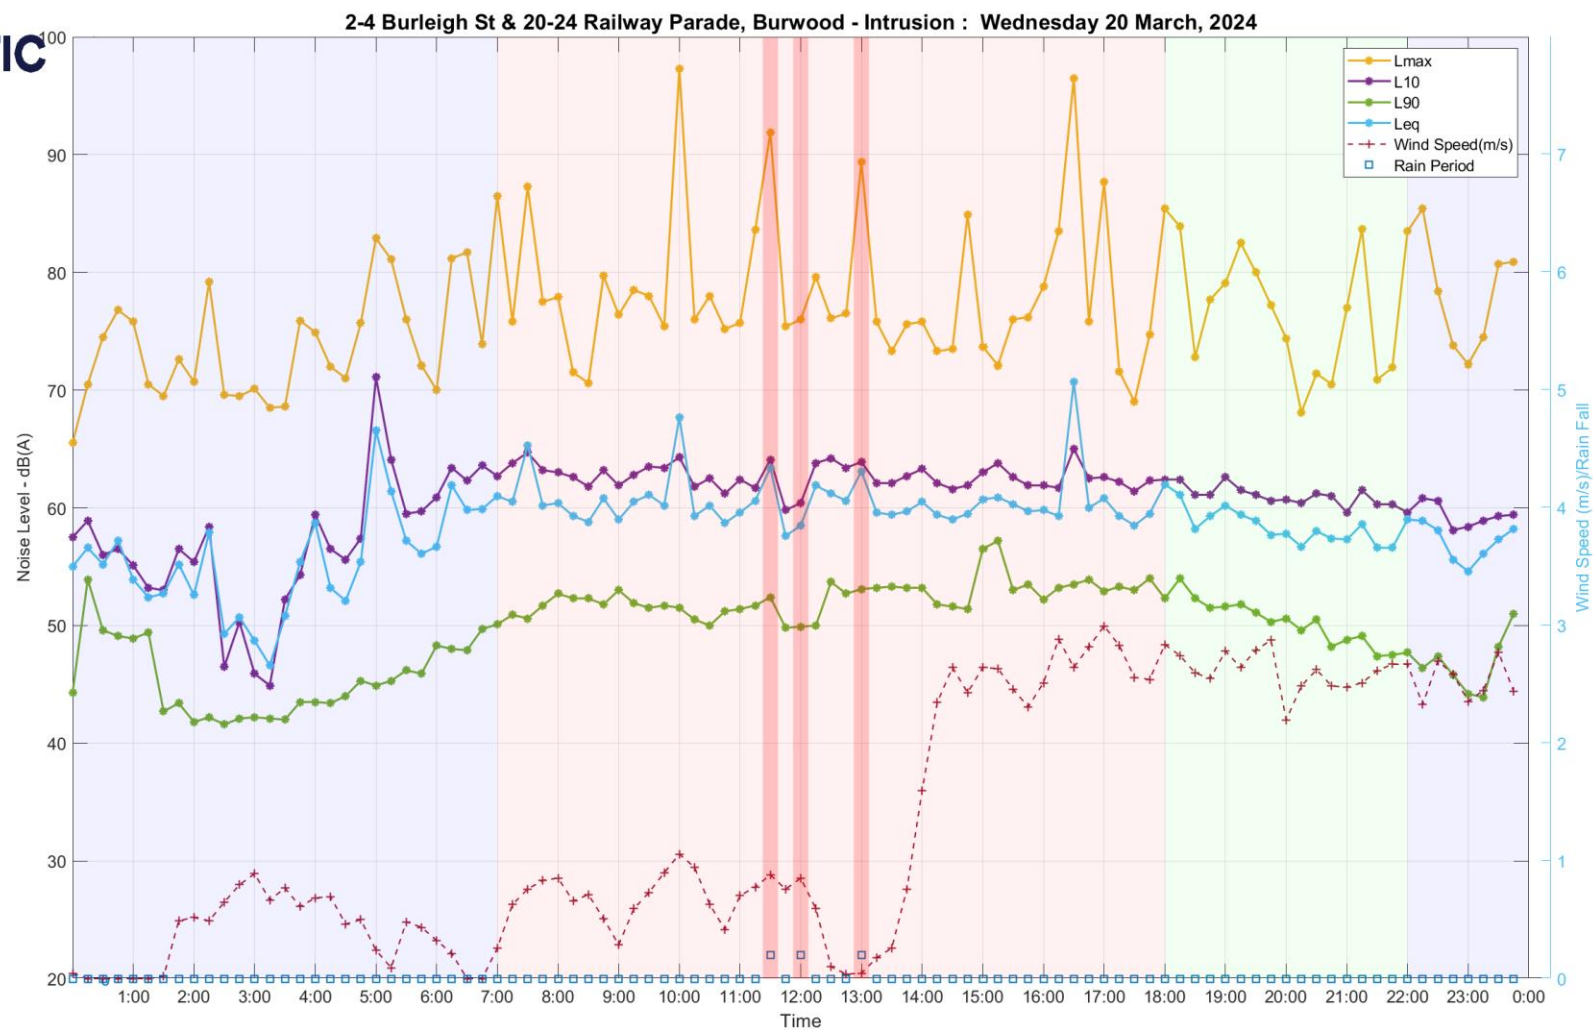



ACOUSTIC
LOGIC

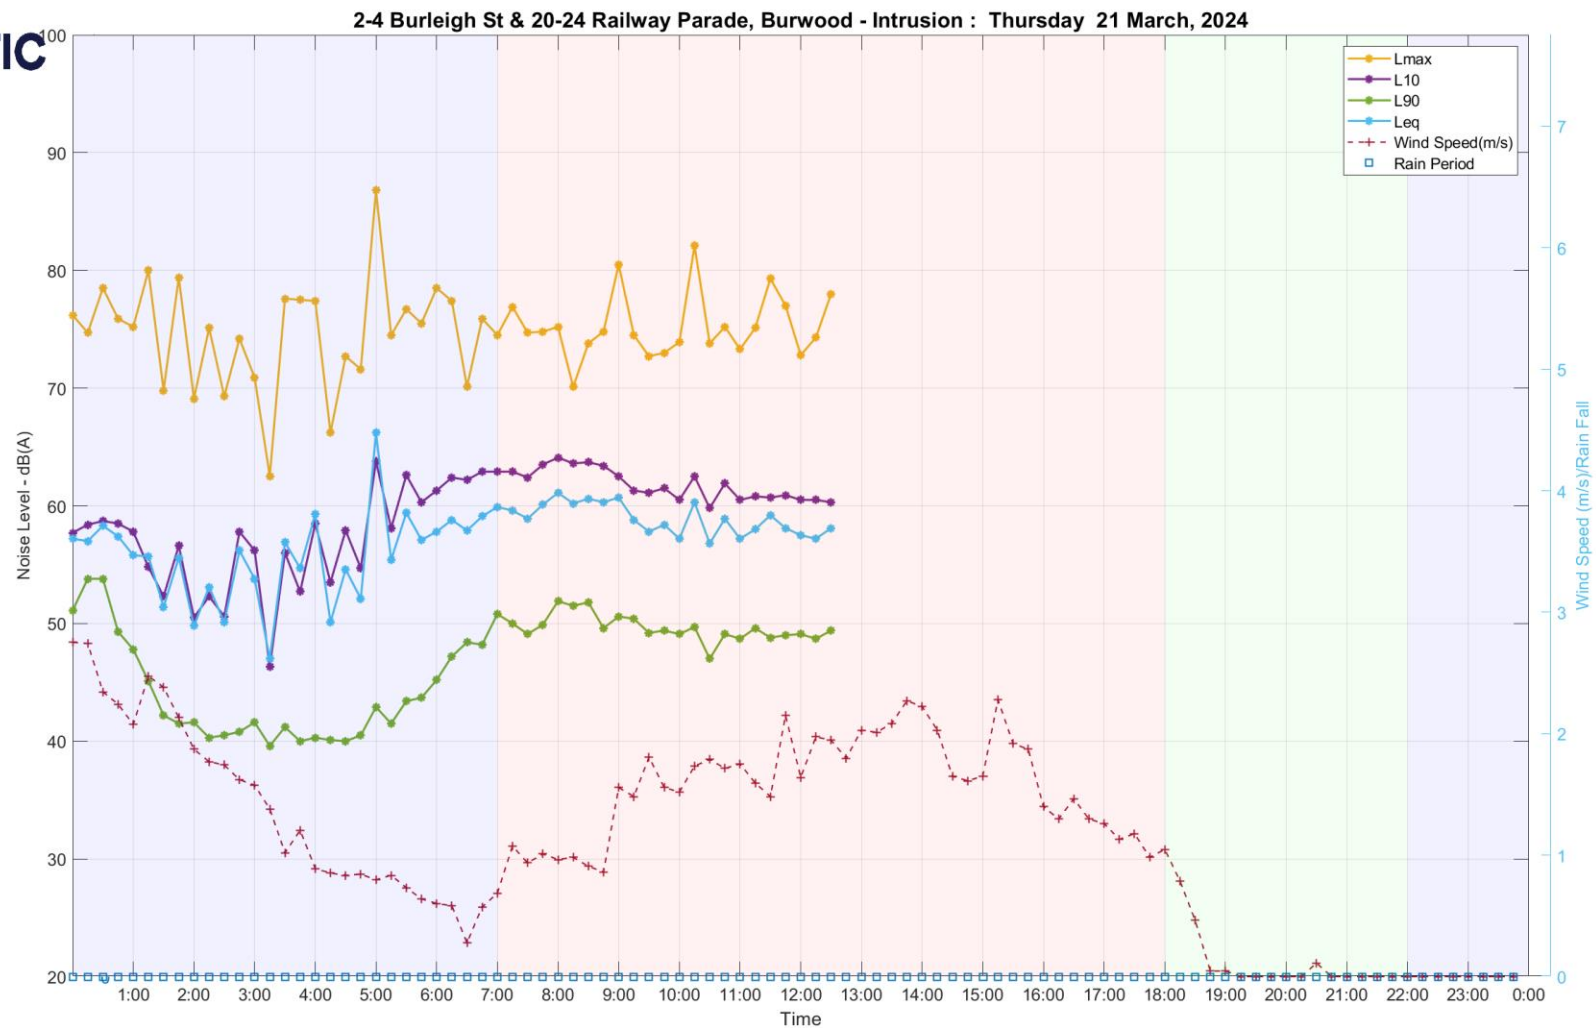


Wind Speed is corrected using factor 0.3333 based on logger location

A.4.2 Location 1 – Traffic Monitor




**ACOUSTIC
LOGIC**

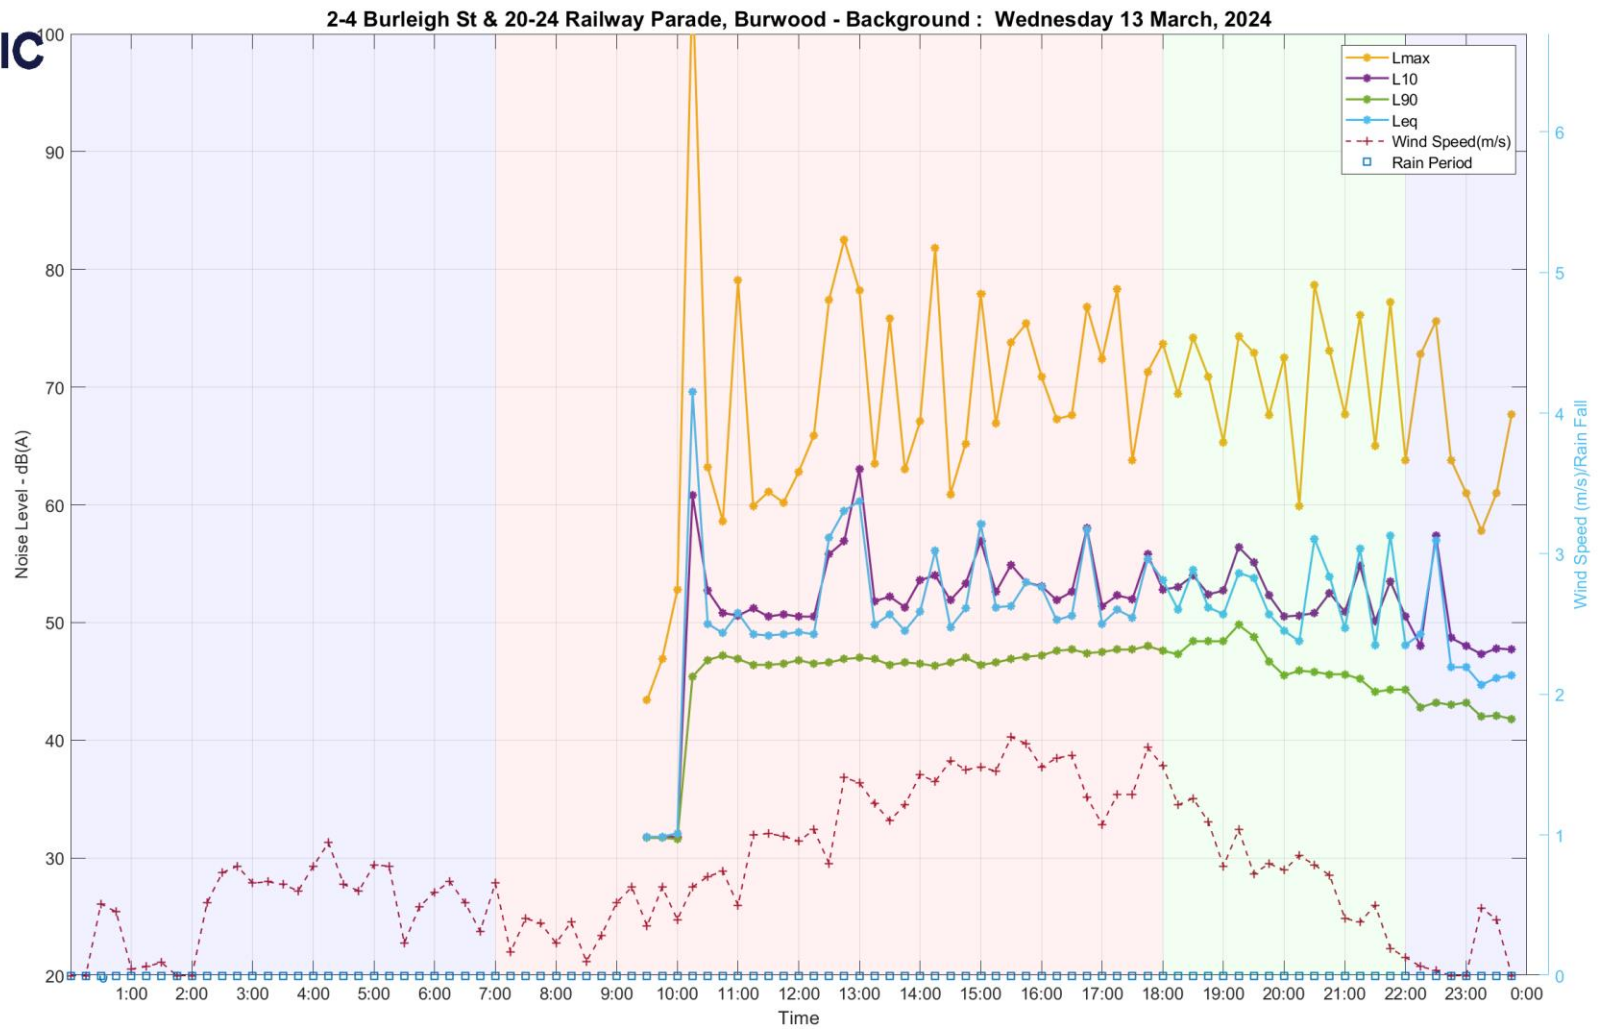




ACOUSTIC
LOGIC

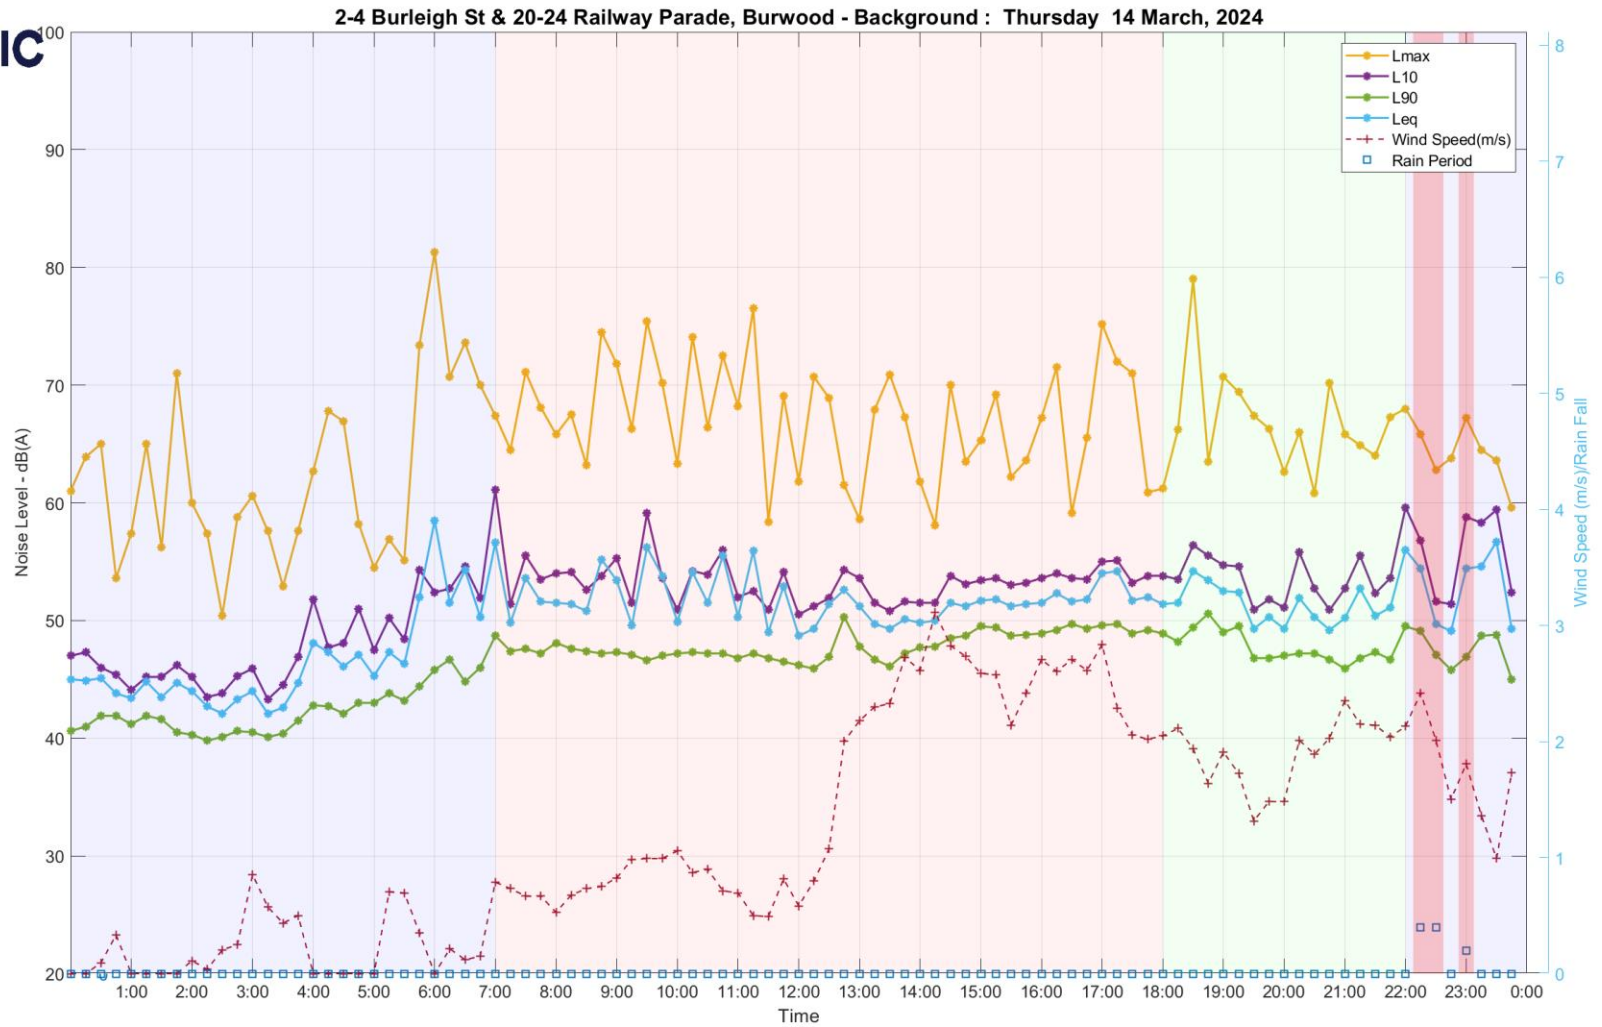




ACOUSTIC
LOGIC

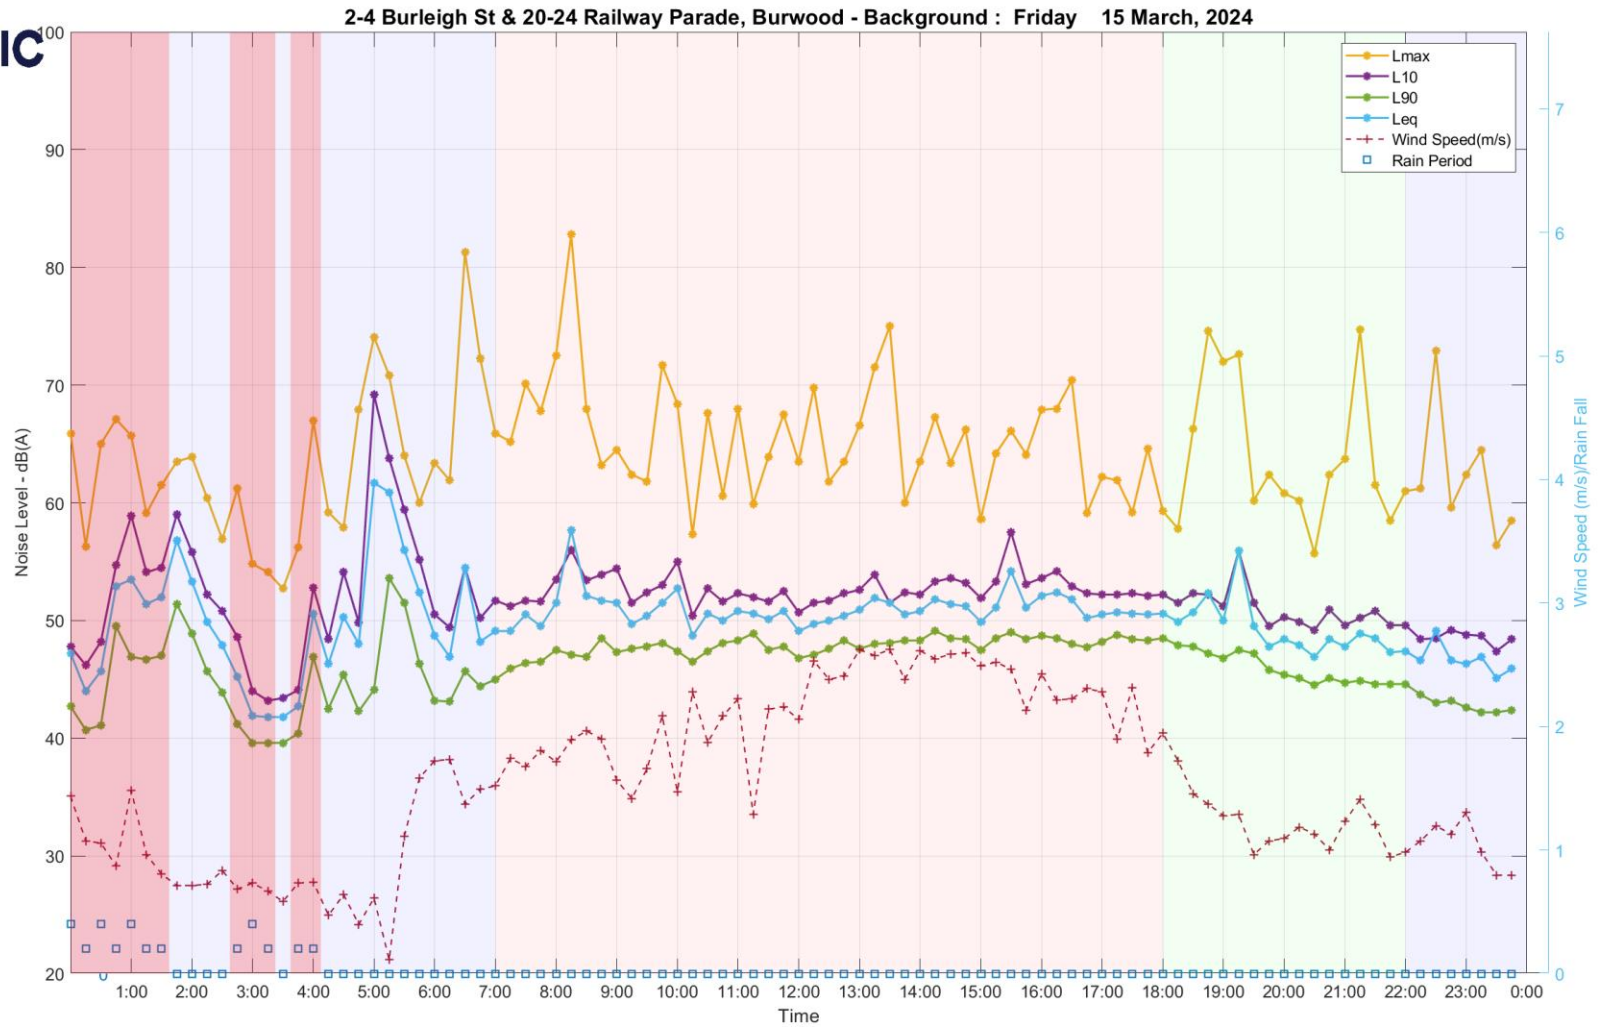




ACOUSTIC
LOGIC

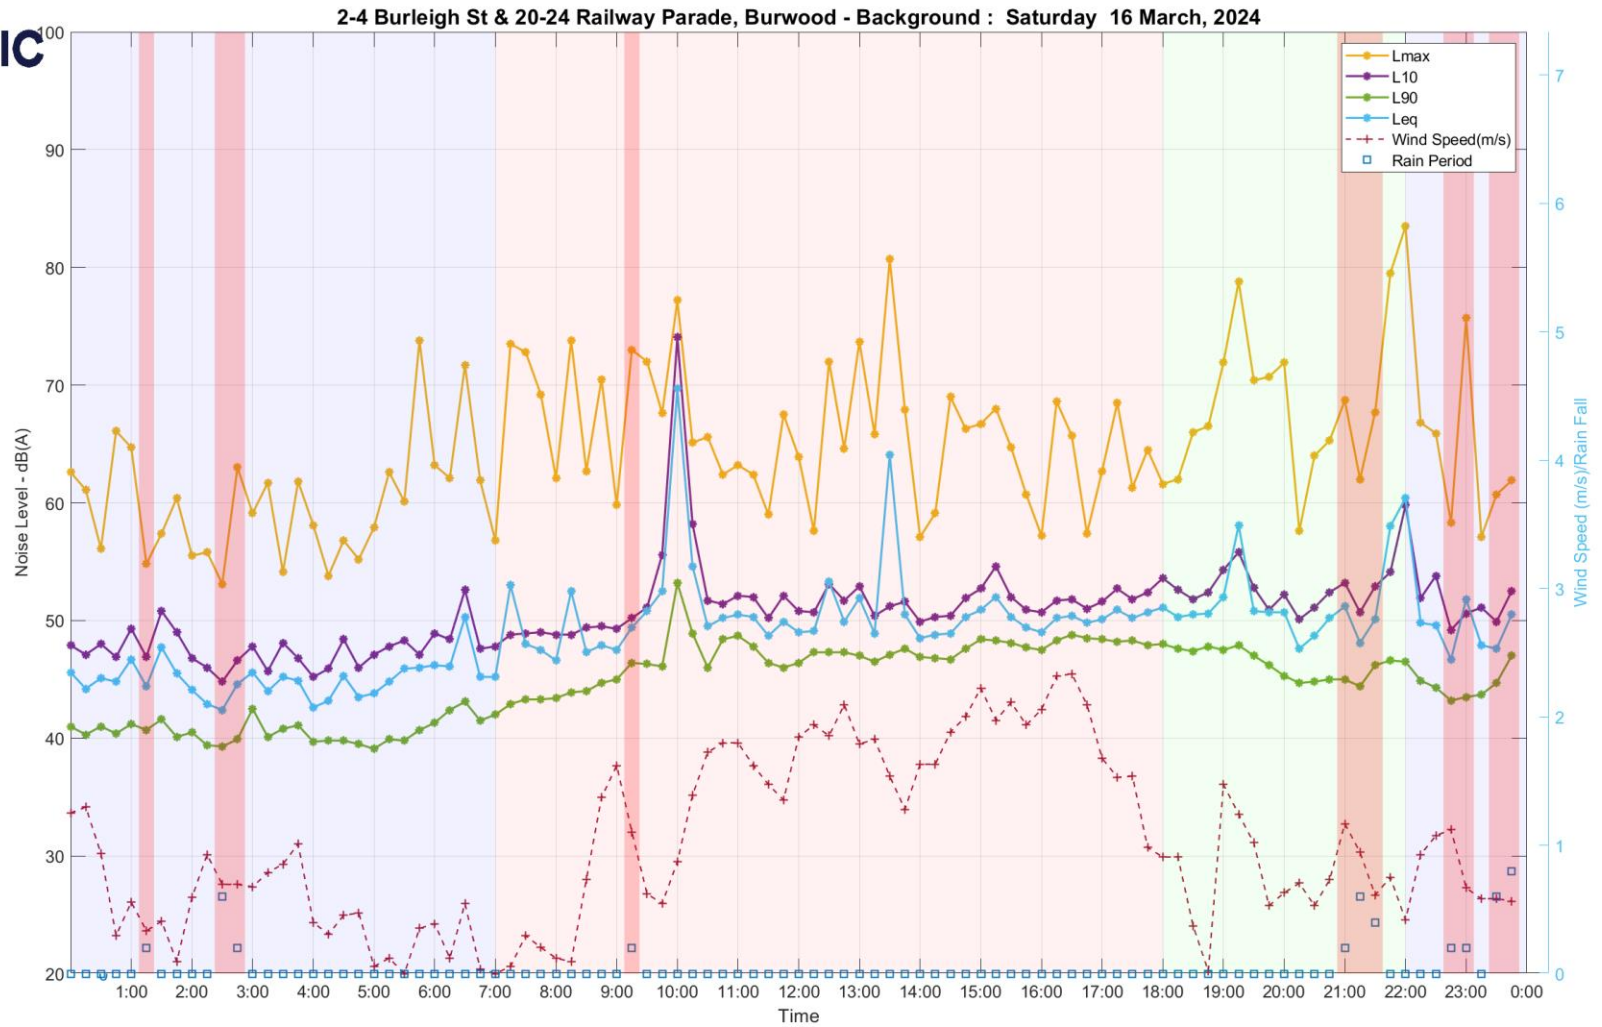




ACOUSTIC
LOGIC

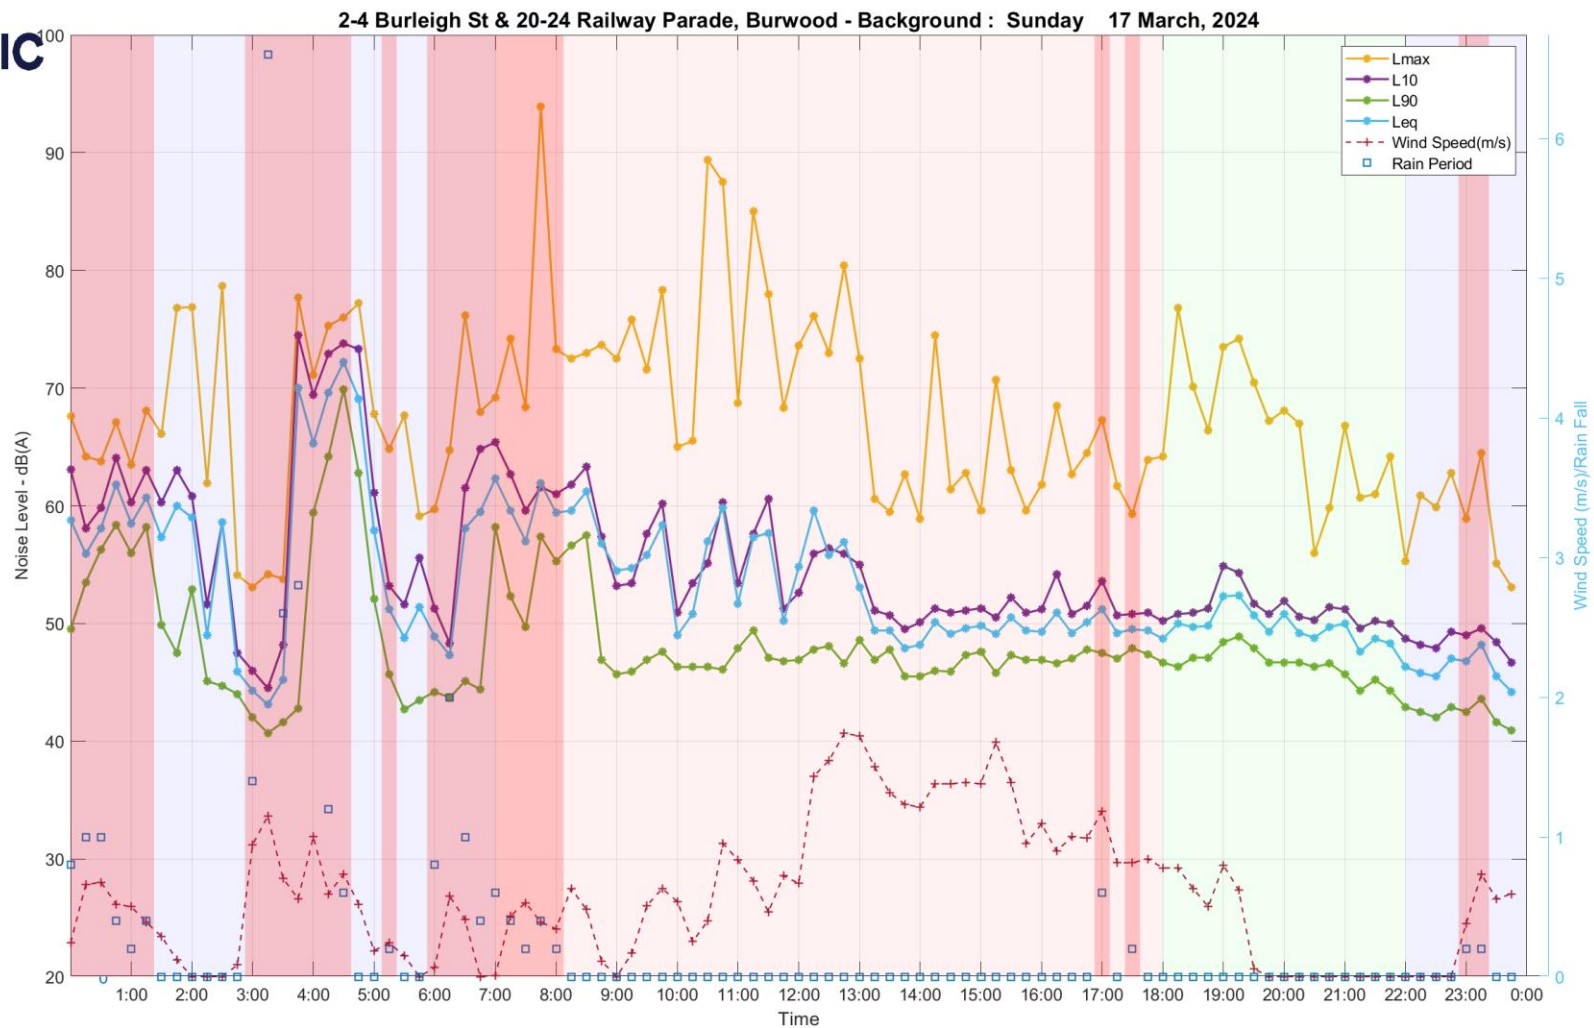





ACOUSTIC
LOGIC

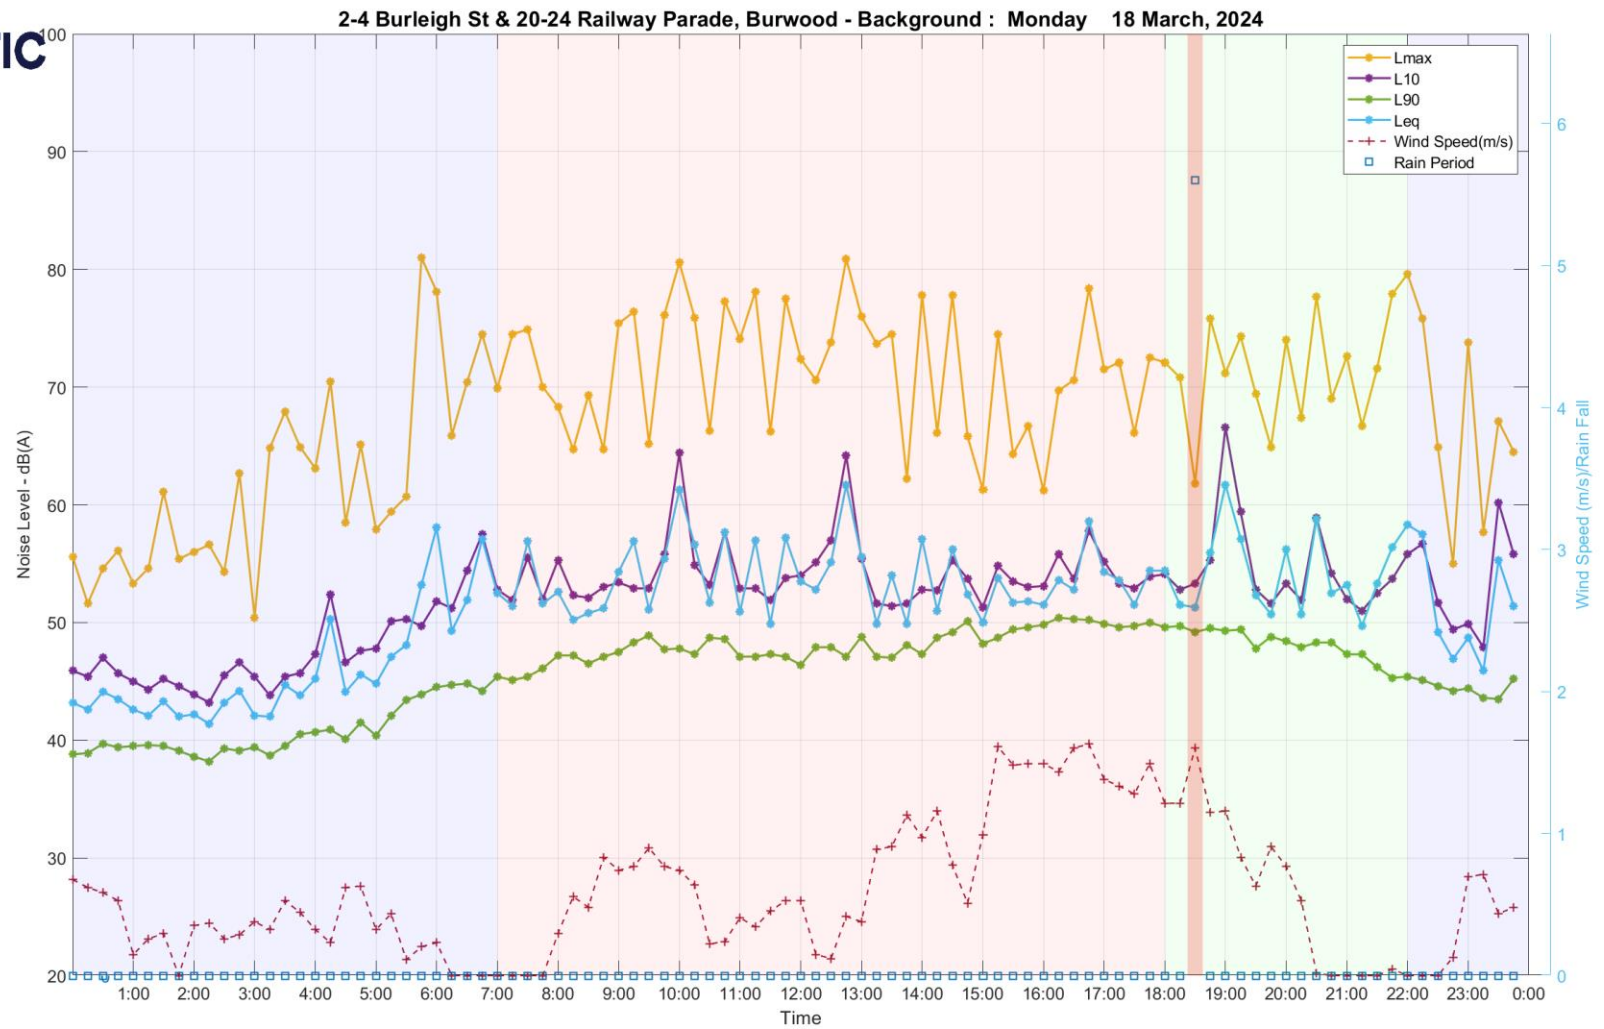




ACOUSTIC
LOGIC

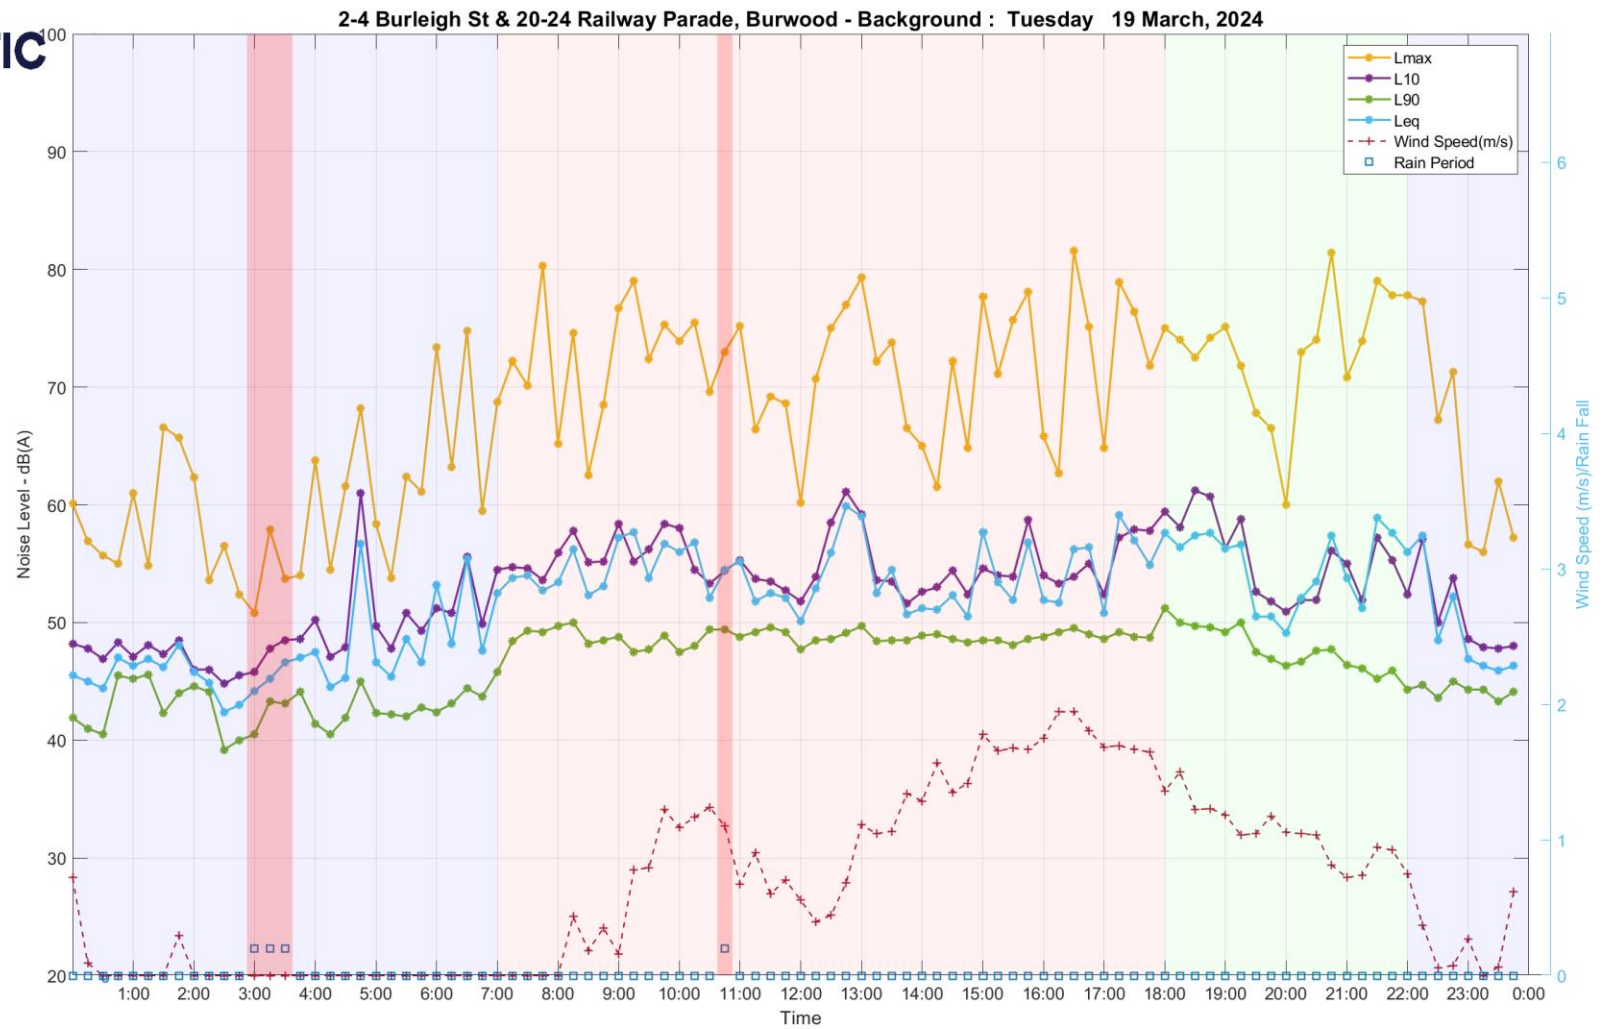

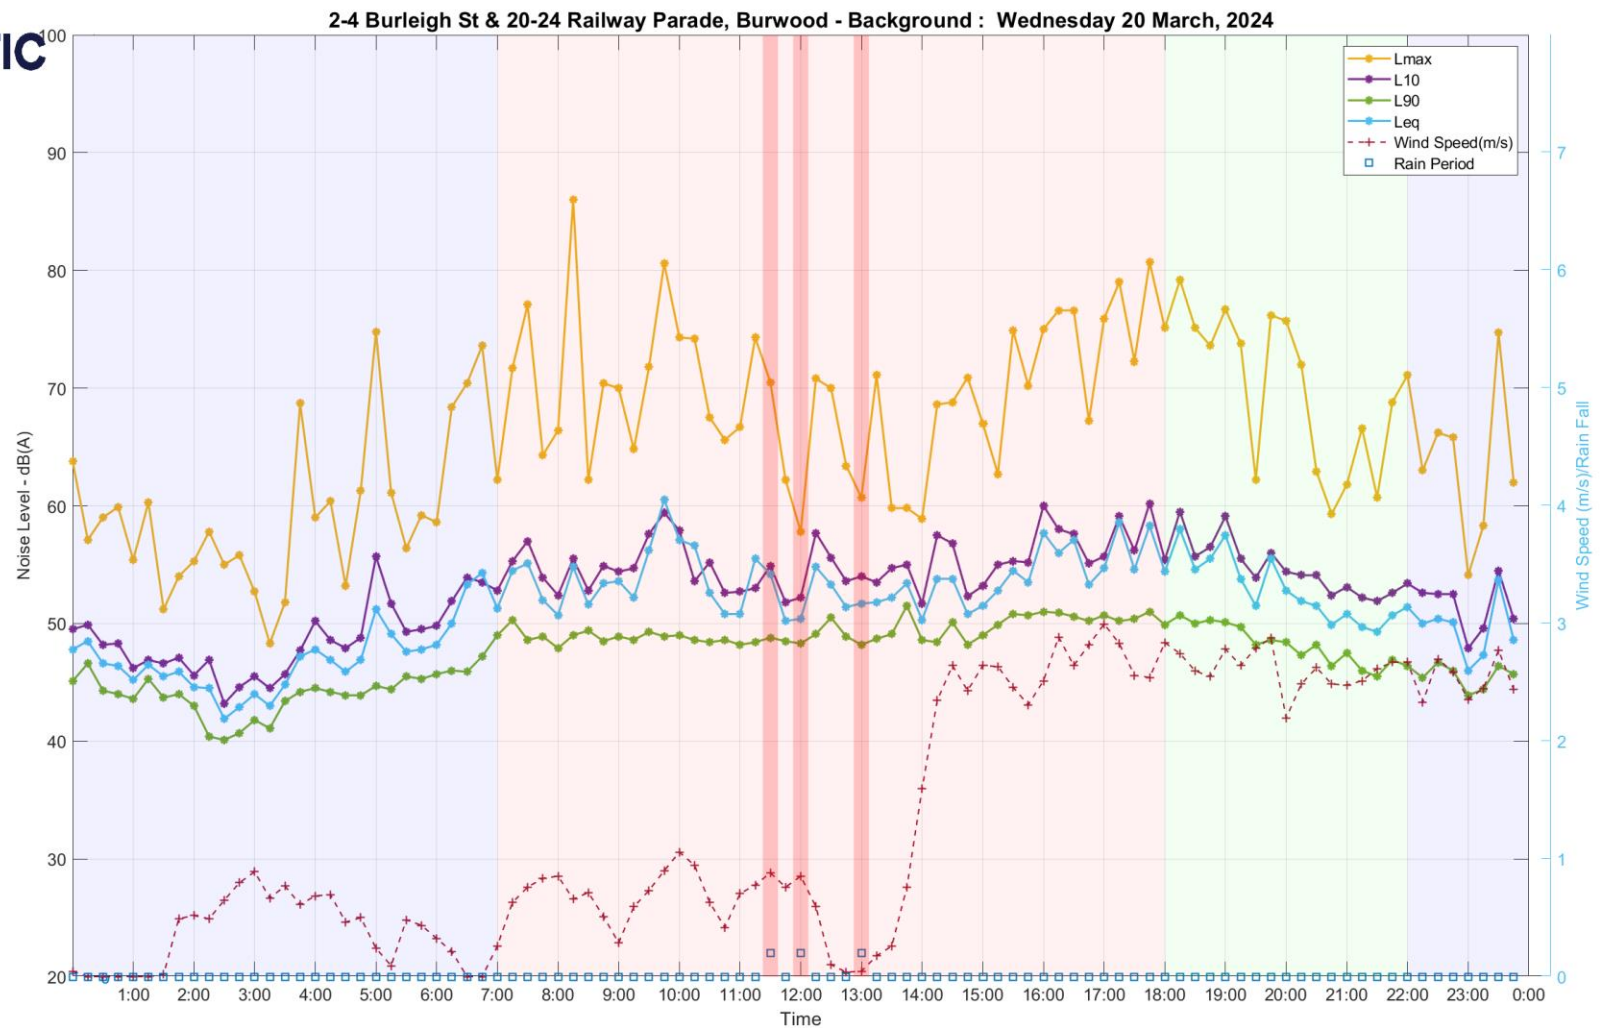



ACOUSTIC
LOGIC

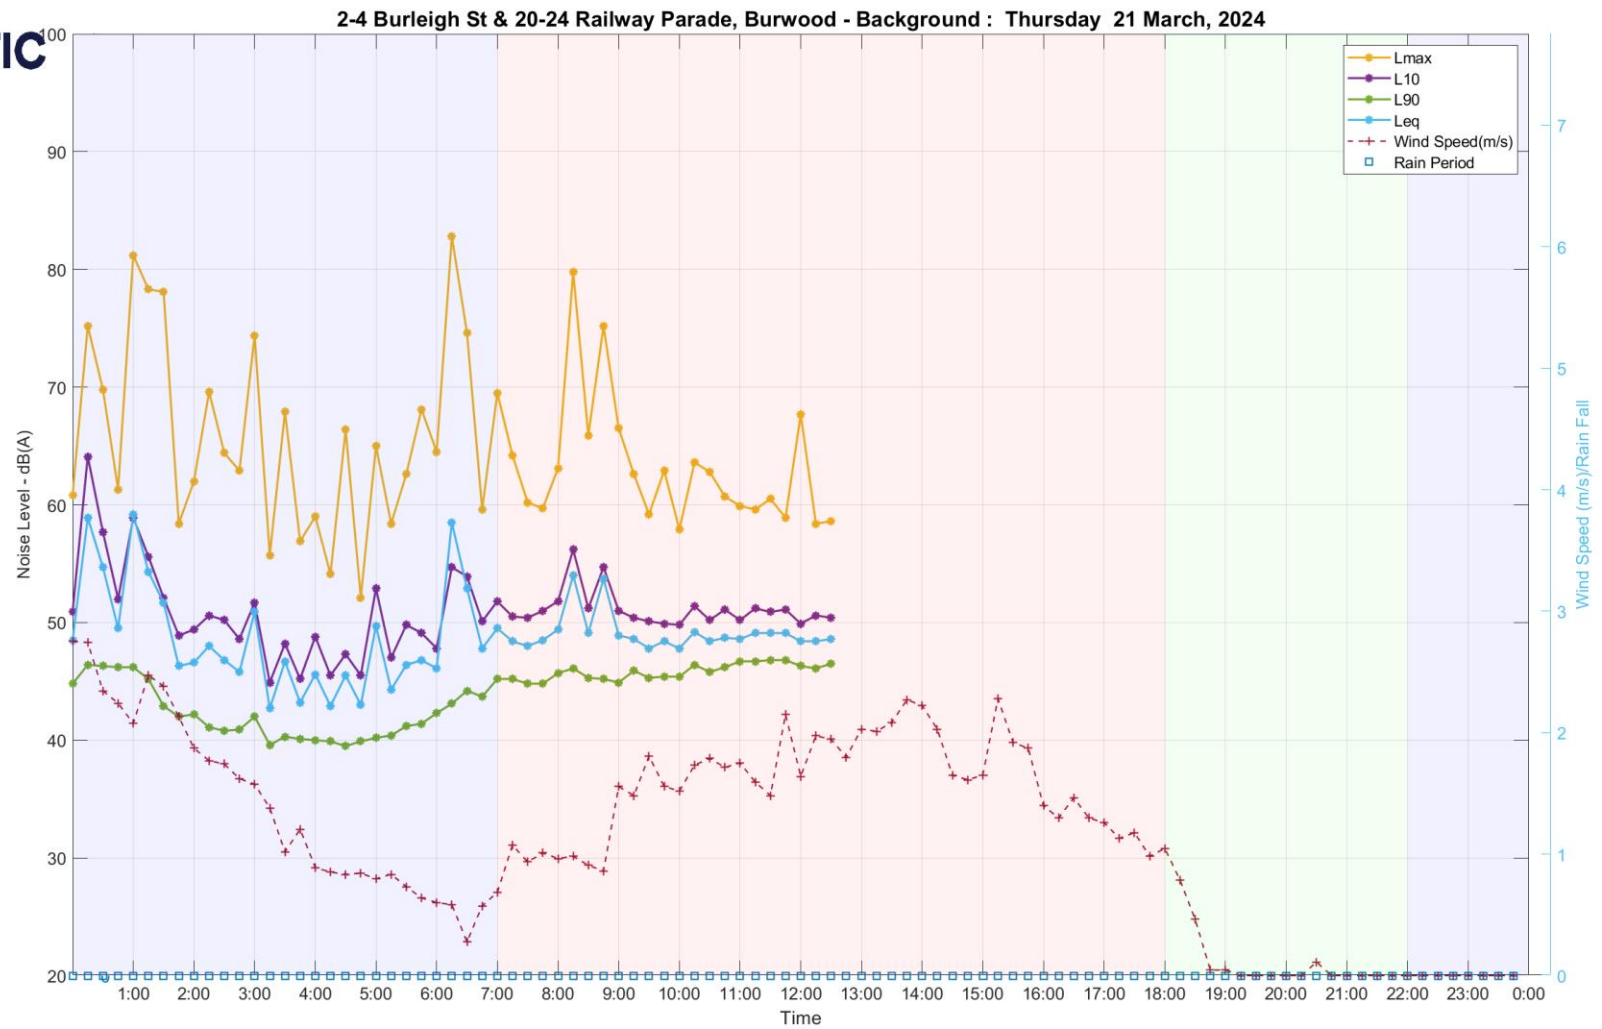

Wind Speed is corrected using factor 0.3333 based on logger location

APPENDIX B EPA NOISE POLICY FOR INDUSTRY TRIGGER LEVELS

Project specific assessment trigger levels have been determined for each noise source applying at the identified potentially most impacted receivers.

B.1 NPI TRIGGER LEVELS

The NPI requires noise impacts at residential receivers to be assessed in 3 ways:

- Whether the emitted noise is unreasonably loud relative to ambient background noise. (which the EPA calls the “intrusiveness” trigger level).
- Whether the noise emitted is unreasonably loud in an absolute sense, and consistent with surrounding land use and environment. (“amenity” trigger level)
- For night noise emissions, whether discrete noise events are likely to adversely impact sleep (“maximum noise level” trigger levels).

For other receiver types only the amenity trigger level is relevant.

B.1.1 Intrusiveness

The $L_{eq,15min}$ descriptor is used for the intrusiveness trigger level, and is set at a level that is 5dB(A) above the rating background noise level for the relevant period.

B.1.2 Amenity

Table 2.2 of the NPI (repeated below) sets out acceptable noise levels for various receiver types.

There are 3 categories of residential receivers - rural, suburban, urban. The nearest residential receivers to the subject site are categorised as “urban” receivers. Categories for non-residential uses are also indicated in the table.

The NPI typically requires project amenity noise levels to be calculated in the following manner:

$$L_{Aeq,15min} = \text{Recommended Amenity Noise Level} - 5 \text{ dB(A)} + 3 \text{ dB(A)}$$

NPI Table 2.2: Amenity Noise Levels

Receiver	Noise Amenity Area	Time of Day	Recommended Amenity Noise Level <i>L_{Aeq}</i>
Residential	Rural	Day	50
		Evening	45
		Night	40
	Suburban	Day	55
		Evening	45
		Night	40
	Urban	Day	60
		Evening	50
		Night	45
Hotels motels caretakers' quarters holiday accommodation permanent resident caravan parks	See column 4	See column 4	5 dB(A) above the recommended amenity noise level for a residence for the relevant noise amenity area and time of day
School classroom – internal	All	Noisiest 1-hour period when in use	35 (see notes for table)
Hospital ward internal external	All All	Noisiest 1-hour Noisiest 1-hour	35 50
Place of worship – internal	All	When in use	40
Area specifically reserved for passive recreation (e.g. national park)	All	When in use	50
Active recreation area (e.g. school playground golf course)	All	When in use	55
Commercial premises	All	When in use	65
Industrial premises	All	When in use	70
Industrial interface (applicable only to residential noise amenity areas)	All	All	Add 5 dB(A) to recommended noise amenity area

Notes: The recommended amenity noise levels refer only to noise from industrial sources. However, they refer to noise from all such sources at the receiver location, and not only noise due to a specific project under consideration. The levels represent outdoor levels except where otherwise stated.

Types of receivers are defined as follows:

- rural residential – see Table 2.3
- suburban residential – see Table 2.3
- urban residential – see Table 2.3
- industrial interface – an area that is in close proximity to existing industrial premises and that extends out to a point where the existing industrial noise from the source has fallen by 5 dB or an area defined in a planning instrument. Beyond this region the amenity noise level for the applicable category applies. This category may be used only for existing situations (further explanation on how this category applies is outlined in Section 2.7)
- commercial – commercial activities being undertaken in a planning zone that allows commercial land uses
- industrial – an area defined as an industrial zone on a local environment plan; for isolated residences within an industrial zone the industrial amenity level would usually apply.

Time of day is defined as follows:

- day – the period from 7 am to 6 pm Monday to Saturday or 8 am to 6 pm on Sundays and public holidays
- evening – the period from 6 pm to 10 pm
- night – the remaining periods.

(These periods may be varied where appropriate, for example, see A3 in Fact Sheet A.)

In the case where existing schools are affected by noise from existing industrial noise sources, the acceptable L_{Aeq} noise level may be increased to 40 dB $L_{Aeq}(1hr)$.

B.1.3 Maximum Noise Level Assessment

The purpose of this assessment is to identify whether discrete, night time noise events have the potential to produce adverse sleep impacts.

Section 2.5 of NPI recommends the following procedure to assess the potential for adverse sleep disturbance.

Where the subject development/ premises night -time noise levels at a residential location exceed:

- $L_{eq(15min)}$ 40 dB(A) or the prevailing RBL (L_{90}) plus 5 dB, whichever is the greater, and/or
- L_{max} 52 dB(A) or the prevailing RBL (L_{90}) plus 15 dB, whichever is the greater,

a detailed maximum noise level event assessment should be undertaken.

The detailed assessment should cover the maximum noise level, the extent to which the maximum noise level exceeds the rating background noise level, and the number of times this happens during the night-time period. Some guidance on possible impact is contained in the review of research results in the NSW Road Noise Policy.

Other factors that may be important in assessing the extent of impacts on sleep include:

- *how often high noise events will occur*
- *the distribution of likely events across the night-time period and the existing ambient maximum events in the absence of the subject development*
- *whether there are times of day when there is a clear change in the noise environment (such as during early-morning shoulder periods)*
- *current scientific literature available at the time of the assessment regarding the impact of maximum noise level events at night.*

Maximum noise level event assessments should be based on the L_{AFmax} descriptor on an event basis under 'fast' time response. The detailed assessment should consider all feasible and reasonable noise mitigation measures with a goal of achieving the above trigger levels.

B.2 PROJECT SPECIFIC TRIGGER LEVELS

The following table summarises the trigger levels applying at each of the identified “most impacted” receivers. These have been determined based on the NPI methodology described above and the measured rating background noise levels.

The trigger levels in bold indicate the most stringent trigger level at each location.

Table 27 – Project Specific Trigger Levels

Location/Receiver Type	Time	RBL dB(A) L_{90}	Trigger Noise Level (dB(A) $L_{eq,15min}$)		
			Intrusiveness	Amenity	Max Event
R1, R2 & R3 Residential	Day	47	52	58	N/A
	Evening	46	51	48	N/A
	Night	40	45	43	45 L_{eq} 55 L_{max}
R2 Commercial	When in use	N/A	N/A	63	N/A
R4 Place of Worship	When in use	N/A	N/A	63	N/A

APPENDIX C VIBRATION MEASUREMENTS

C.1 EQUIPMENT USED

Vibration measurements were conducted using a SV958A 4 channel sound and vibration analyser with an external Tri axial accelerometer. The accelerometer was screwed to a metal spike which was hammered into the soil.

C.2 RESULTS

C.2.1 TACTILE VIBRATION

Table 28 summarise the measurements including passby vibration levels, train type and track location.

Table 28 – Predicted Ground Borne Vibration Levels

Train Number	Measurement Location	Time	Track	Train Type	Direction of Travel	Tactile Vibration VDV
1	New façade line facing railway	2:25pm	Near	Electric Passenger	Arriving	0.0004
2		2:25pm	Far		Departing	0.0007
3		2:39pm	Near		Arriving and Departing	0.001
4		2:43pm	Near		Departing	0.001
5		2:45pm	Far		Departing	0.0009
For Period (eVDV)*						<0.006

*Vibration total VDV. Day period is 7am to 10pm and night is 10pm to 7am. Based on a minimum of 1000 trains passing through in any given day/night period.

Tactile vibration within the buildings have been predicted based on the measured ground vibration levels taking into account (where applicable) ground to building losses, structure amplification and floor to floor losses between ground floor and the affected level. The floor vibration levels and the number of rail movements based on available timetable data were used to determine the estimated overall vibration dose (eVDV) at the proposed development. The results are presented the table below.

Table 29 – Vibration Dose Values

Time Period	Calculated eVDV m/s ^{1.75}
Day	< 0.2
Night	< 0.13

APPENDIX D CONSTRUCTION PLANT NOISE AND VIBRATION EMISSION LIMITS

This section provides the plant noise and vibration levels adopted in the assessment.

D.1 NOISE

The following table presents typical sound power levels for construction plant used in this assessment.

The following have been considered to establish typical plant A-weighted sound power levels:

- Transport for NSW Construction Noise and Vibration Strategy (April 2018).
- Previous measurements undertaken by Acoustic Logic.
- AS 2436-2010 "Guide to noise and vibration control on construction, demolition and maintenance sites (Appendix A).

The equipment sound power spectra are based on information in the DEFRA database, and when not available from that source, from manufacturer's data or from measured spectra taken by this office of similar machinery.

Items identified as having annoying characteristics have been penalised by adding 5dB to the levels in the Transport for NSW's noise data base.

The emission levels in the table assume that machinery operates continuously (i.e. 100% duty), which is not always be the case. For example, excavators may load trucks intermittently for 5 minutes in every 15-minute assessment period so their duty would be 33%. The duty correction used in the assessment is indicated in the table.

Construction, Demolition and Civil works Machinery Effective Sound Power Levels based on Continuous operation (100% duty)

Equipment	Approx. Size/ Weight/Model	Sound Power Level (dBA) 100% Duty (inc Penalties)	Duty	Unweighted Octave Band Sound Power Levels, dB (includes Applicable Penalties)							
				63	125	250	500	1000	2000	4000	8000
Asphalt - Truck & Sprayer	-	106	100%	112	110	104	102	99	97	100	92
Backhoe	-	111	66%	113	107	103	111	104	103	98	94
Chainsaw – petrol*	4-5hp	114	50%	92	106	103	111	113	114	112	109
Compactor	-	106	100%	99	101	97	100	100	100	96	93
Compressor	-	109	25%	127	116	107	102	100	98	101	90
Crane - Fixed	-	113	50%	120	115	116	112	106	99	93	87
Crane - Franna	20 tonne	98	50%	108	104	99	91	92	91	84	78
Crane - Mobile	-	113	25%	115	114	108	109	108	108	99	90
Crane - Truck mounted	20 to 60 tonne	108	25%	112	109	107	105	103	100	95	87
Crusher – Rock*	-	118	100%	135	128	121	123	117	113	108	101
Dozer	CAT D9	116	75%	112	116	114	114	111	108	102	94
Dozer	CAT D10	121	75%	130	131	122	114	115	111	109	105
Elevated work platform - scissor lift	-	98	10%	100	97	94	94	94	91	85	83
Elevated work platform	-	97	10%	108	106	92	93	90	89	88	79
Excavator - tracked	3 tonne	90	75%	101	91	88	88	85	83	78	72
Excavator - tracked	6 tonne	95	75%	102	104	95	89	89	87	82	77
As above + hydraulic hammer*	6 tonne	115	75%	110	113	110	114	117	113	111	106
Excavator - tracked	10 tonne	100	100%	104	100	99	97	95	92	86	81
As above + hydraulic hammer*	10 tonne	118	75%	124	124	121	116	118	116	114	109
Excavator - tracked	20 tonne	105	75%	107	114	106	101	98	97	93	90
Excavator - tracked	30 tonne	110	75%	113	113	107	107	105	102	97	91
As above + hydraulic hammer*	-	122	75%	125	123	119	123	121	121	118	114
Excavator - tracked	40 tonne	115	75%	111	114	113	110	110	109	104	97
Grader	-	113	100%	114	113	109	105	110	104	100	91

Equipment	Approx. Size/ Weight/Model	Sound Power Level (dBA) 100% Duty (inc Penalties)	Duty	Unweighted Octave Band Sound Power Levels, dB (includes Applicable Penalties)							
				63	125	250	500	1000	2000	4000	8000
Generator - diesel/petrol	6kW	103	100%	115	110	102	98	97	95	92	80
Generator - attenuated	30kW	92	100%	95	95	93	86	85	86	82	79
Grinder*	-	105	50%	86	80	81	89	99	106	102	102
Jackhammer	-	113	75%	108	97	93	96	96	101	109	110
Lighting Tower	-	80	100%	73	73	73	73	73	73	73	73
Lighting - Daymakers	-	98	100%	110	105	97	93	92	90	87	75
Light Vehicle - 4WD	-	103	10%	96	96	96	96	96	96	96	96
Line Marking Truck	-	108	100%	114	112	106	104	101	99	102	94
Loader - Front-end (wheeled)	23 tonne	112	75%	118	118	107	109	105	103	102	94
Loader - Skidsteer	1/2 tonne	107	75%	112	115	104	106	101	98	92	92
Loaders - Skidsteer	1 tonne	110	75%	113	104	108	108	104	103	97	91
Loader - Tracked	0 to 50 kW	115	75%	108	108	108	108	108	108	108	108
Loaders- Tracked	200 to 300 kW	121	75%	114	114	114	114	114	114	114	114
Pavement Laying Machine	-	114	100%	117	114	111	110	109	106	104	95
Pavement Profiler	-	117	100%	116	122	114	112	112	109	105	102
Pile Driver – Vibratory*	-	121	50%	121	120	117	120	122	120	115	105
Piling Rig - Bored	-	112	100%	112	120	109	108	106	104	96	89
Piling Rig Lmax – Impact*	-	151	n/a	137	138	143	152	152	148	143	138
Piling Rig Leq- Impact*	-	134	100%	124	125	128	135	135	132	127	121
Pump - Concrete	-	109	100%	115	107	101	102	104	104	97	89
Rattle gun (hand held)	-	104	50%	82	81	81	87	96	98	98	98
Roller - smooth drum	-	107	100%	114	112	102	100	102	100	96	90
Roller - large pad foot	-	109	100%	120	111	103	107	105	98	95	89
Roller – Vibratory*	10 tonne	109	100%	125	116	108	112	110	103	100	94
Saw – Concrete*	-	118	75%	120	122	114	114	113	114	118	116
Scraper/Grader	-	113	100%	120	122	113	107	107	105	100	95

Equipment	Approx. Size/ Weight/Model	Sound Power Level (dBA) 100% Duty (inc Penalties)	Duty	Unweighted Octave Band Sound Power Levels, dB (includes Applicable Penalties)							
				63	125	250	500	1000	2000	4000	8000
Truck - Concrete	-	109	100%	112	103	95	98	99	107	89	84
Truck - Dump	15 tonne	110	10%	114	111	111	107	104	103	97	90
Truck - Medium rigid	20 tonne	103	10%	109	107	101	99	96	94	97	89
Truck - road truck/ truck and dog	30 tonne	108	10%	123	109	101	100	104	99	98	91
Truck - Vacuum (NDD or non-destructive digger)	-	109	75%	111	112	97	102	101	104	103	96
Tub Grinder/Mulcher	40-50hp	116	100%	105	106	110	110	112	111	105	96
Vibrator – Concrete*	-	113	100%	122	120	120	113	109	112	110	105
Water Cart	-	107	100%	106	107	101	105	99	100	96	91
Welding equipment	-	110	50%	104	105	106	105	106	103	98	93
Wrench - Impact	-	111	50%	81	84	89	91	95	101	107	107

APPENDIX E ARCHITECTURAL DRAWINGS

The following drawings provided by PTI Architecture has been reproduced below.

DRAWING LIST

00	COVER SHEET
01	PROJECT SUMMARY
02	APARTMENT SCHEDULE
03	GFA & FSR CALCULATIONS
04	GFA & FSR CALCULATIONS
05	LOCATION PLAN
06	SITE PLAN
07	STREETSCAPE & BURWOOD HEIGHT PLANE
08	BASEMENTS 4-5 PLAN
09	BASEMENT 3 PLAN
10	BASEMENT 2 PLAN
11	BASEMENT 1 PLAN
12	GROUND FLOOR PLAN
13	LEVEL 1 FLOOR PLAN- HOTEL FACILITIES
14	LEVEL 2 FLOOR PLAN- HOTEL FACILITIES
15	LEVELS 3-8 FLOOR PLAN- RESIDENTIAL
16	LEVELS 9-18 FLOOR PLAN- RESIDENTIAL
17	LEVEL 19 FLOOR PLAN- PLANT
18	LEVELS 20-25 FLOOR PLAN- HOTEL ROOMS
19	LEVELS 26-31 FLOOR PLAN- HOTEL ROOMS
20	LEVEL 32 FLOOR PLAN- PLANT
21	LEVELS 33- 35 FLOOR PLAN- COMMERCIAL OFFICES
22	LEVEL 36 FLOOR PLAN- HOTEL FACILITIES
23	LEVEL 37 FLOOR PLAN- HOTEL FACILITIES
24	LEVEL 38 FLOOR PLAN- RESIDENTIAL C.O.S
25	ROOF PLAN
26	SECTIONS A & B
27	SECTIONS C & D
28	SECTIONS E & F
29	SECTION G

30	ELEVATIONS- NORTH & WEST
31	ELEVATIONS- SOUTH & EAST
32	SHADOW DIAGRAMS- JUNE 21 9AM-10AM
33	SHADOW DIAGRAMS- JUNE 21 11AM-12PM
34	SHADOW DIAGRAMS- JUNE 21 1PM-3PM
35	SHADOW DIAGRAMS- JAN 21 9AM & FEB 21 9AM
36	SHADOW DIAGRAMS- MAR 21 9AM & APR 21 9AM
37	SHADOW DIAGRAMS- MAY 21 9AM & JUN 21 9AM
38	SHADOW DIAGRAMS- JUL 21 9AM & AUG 21 9AM
39	SHADOW DIAGRAMS- SEP 21 9AM & OCT 21 9AM
40	SHADOW DIAGRAMS- NOV 21 9AM DEC 21 9AM
41	SOLAR ACCESS AND NATURAL CROSS VENTILATION
42	ACCESSIBLE LAYOUTS
43	FACADE CONCEPT SECTIONS
44	FACADE CONCEPT SECTIONS
45	FACADE CONCEPT SECTIONS
46	POTENTIAL SURROUNDING DEVELOPMENT
47	POTENTIAL SURROUNDING DEVELOPMENT
48	POTENTIAL SURROUNDING DEVELOPMENT
49	PERSPECTIVE 1
50	PERSPECTIVE 2
51	PERSPECTIVE 3
52	BASIX COMMITMENTS- SHEET 1
53	BASIX COMMITMENTS- SHEET 2
54	BASIX COMMITMENTS- SHEET 3
55	BASIX COMMITMENTS- SHEET 4
56	BASIX COMMITMENTS- SHEET 5



RESIDENTIAL/ AFFORDABLE HOUSING, HOTEL & COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24 RAILWAY PDE, BURWOOD
 PREPARED FOR
 NSW HOUSING CORPORATION PTY LTD

GFA & FSR CALCULATIONS			
PROJECT NO: P709			
ADDRESS: 2-4 BURRELEIGH ST & 20-24 RAILWAY PD, BURWOOD			
REVISION/ DATE: 11.12.24			

RESIDENTIAL UNITS (qby)										HOTEL ROOMS (qby)									
	2 BED DUAL KEY	2 BED AFFORDABLE HOUSING	TOTAL APART.	TYPE A5 (25sqm-27sqm)	TYPE A6 (25sqm-27sqm)	TYPE A7 (25sqm-27sqm)	TYPE B1 (30sqm-35sqm)	TYPE B2 ACC. (30sqm-35sqm)	TOTAL HOTEL ROOM										
GF	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
L1	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
L2	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
L3	-	3	3	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
L4	-	3	3	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
L5	-	3	3	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
L6	-	3	3	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
L7	-	3	3	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
L8	-	3	3	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
L9	3	-	3	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
L10	3	-	3	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
L11	3	-	3	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
L12	3	-	3	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
L13	3	-	3	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
L14	3	-	3	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
L15	3	-	3	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
L16	3	-	3	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
L17	3	-	3	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
L18	3	-	3	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
L19	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
L20	-	-	-	-	4	2	2	1	1	10	-	-	-	-	-	-	-	-	-
L21	-	-	-	-	4	2	2	1	1	10	-	-	-	-	-	-	-	-	-
L22	-	-	-	-	4	2	2	1	1	10	-	-	-	-	-	-	-	-	-
L23	-	-	-	-	4	2	2	1	1	10	-	-	-	-	-	-	-	-	-
L24	-	-	-	-	4	2	2	1	1	10	-	-	-	-	-	-	-	-	-
L25	-	-	-	-	4	2	2	1	1	10	-	-	-	-	-	-	-	-	-
L26	-	-	-	-	4	2	2	2	-	10	-	-	-	-	-	-	-	-	-
L27	-	-	-	-	4	2	2	2	-	10	-	-	-	-	-	-	-	-	-
L28	-	-	-	-	4	2	2	2	-	10	-	-	-	-	-	-	-	-	-
L29	-	-	-	-	4	2	2	2	-	10	-	-	-	-	-	-	-	-	-
L30	-	-	-	-	4	2	2	2	-	10	-	-	-	-	-	-	-	-	-
L31	-	-	-	-	4	2	2	2	-	10	-	-	-	-	-	-	-	-	-
L32	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
L33	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
L34	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
L35	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
L36	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
L37	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
L38	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
TOTAL UNIT (qby)	30	18	48	48	24	24	18	6	120	-	-	-	-	-	-	-	-	-	-
UNIT MIX (%)	63%	38%	100%	40%	20%	20%	15%	5%	100%	-	-	-	-	-	-	-	-	-	-

UNITS (qby)		
UNIT TYPE	UNIT COUNT	YIELD
2 BED	30	63%
2 BED (AFFORDABLE HOUSING)	18	38%
TOTAL	48	100%

CAR PARKING REQUIRED				
RESIDENTIAL (AFFORDABLE HOUSING)				
UNIT TYPE	RATES (x/unit)	UNITS (no.)	TOTAL (no.)	
2 BED (DUAL KEY)	0.5	18	9	
MIN. REQUIREMENT (no.)			9	
RESIDENTIAL (NON-AFFORDABLE HOUSING)				
UNIT TYPE	RATES (x/unit)	UNITS (no.)	TOTAL (no.)	
2 BED (DUAL KEY)	1.0	30	30	
MIN. REQUIREMENT (no.)			30	
HOTEL				
UNIT TYPE	RATE	PER ROOM	ROOMS (no.)	TOTAL (no.)
HOTEL ROOM	0.3		120	36
STAFF				2
MIN. REQUIREMENT (no.)			38	
COMMERCIAL OFFICES				
UNIT TYPE	RATES		GFA (sqm)	
FIRST 400 sqm	1.0	400	400	1
ABOVE 400 sqm	1.0	120	598	5
MIN. REQUIREMENT FOR (no.)			6	
TOTAL MINIMUM CAR SPACES REQUIRED (no.)			83	

CAR PARKING PROPOSED									
LEVEL	RESIDENTIAL	ACCESSIBLE	VISITORS	ACCESSIBLE	HOTEL	ACCESSIBLE	COMMERCIAL	ACCESSIBLE	TOTAL (no)
GF	-	-	-	-	-	-	-	-	-
B1	-	-	-	-	-	-	5	1	18
B2	-	-	-	-	26	4	-	-	30
B3	26	2	-	2	-	-	-	-	30
B4	26	4	-	-	-	-	-	-	30
B5	26	4	-	-	-	-	-	-	30
SUB TOTAL (no.)	78	10	-	2	26	6	5	1	138
PROPOSED TOTAL (no.)	88	-	2	-	42	-	6	-	138

PLANNING CONTROL CALCULATIONS				
DESCRIPTION	PLANNING INSTRUMENT	BONUS (%)	(m/ X:1/ sqm/ %)	COMPLIANCE Y/N
SITE AREA				
MIN. SITE AREA (sqm)	LEP			
SUBJECT SITE AREA (sqm)			1,329	Y
HEIGHT OF BUILDING				
PERMISSIBLE HOB (m)	LEP BHP		0.0	
TOTAL MAX. HOB (m)			0.0	
STREET WALL INCLUSIVE IN MAX. HEIGHT (m)			15.0	Y
PROPOSED HOB (m)			143.9	Y
FLOOR SPACE RATIO				
PERMISSIBLE FSR (X:1)	LEP		6.40	
BONUS FSR (X:1)		0%	0.00	
SUBTOTAL FSR (X:1)			6.40	
BONUS FSR (X:1)	AH BONUS	30%	1.98	
TOTAL MAXIMUM FSR PERMISSIBLE (X:1)			8.38	
PROPOSED RESIDENTIAL FSR (X:1)			3.68	
PROPOSED COMMERCIAL FSR (X:1)			4.90	
PROPOSED TOTAL FSR (X:1)			8.58	Y
GROSS FLOOR AREA				
PERMISSIBLE GFA (sqm)			8,771	
SUBTOTAL GFA (sqm)			8,771	
BONUS GFA (sqm)	AH BONUS	30%	2,631	
TOTAL MAXIMUM PERMISSIBLE GFA (sqm)			11,403	
PROPOSED RESIDENTIAL GFA (sqm)			4,887	
PROPOSED COMMERCIAL GFA (sqm)			6,515	
PROPOSED TOTAL GFA (sqm)			11,402	Y
AFFORDABLE HOUSING GROSS FLOOR AREA				
REQUIRED AFFORDABLE HOUSING (sqm)	INCLUSIVE IN MAX. GFA	15%	1,710	
PROPOSED AFFORDABLE HOUSING (sqm)		16%	1,800	Y
LANDSCAPING AREA				
MIN. REQUIREMENT (%)			25%	
TOTAL REQUIREMENT (sqm)			332	
PROPOSED (%)			25%	Y
PROPOSED (sqm)			332	Y
COMMUNAL OPEN SPACE				
MIN. REQUIREMENT (%)			25%	
MIN. REQUIREMENT (sqm)			332	
PROPOSED (%)			34%	Y
PROPOSED (sqm)			450	Y

SSDA SUBMISSION

A	SSDA SUBMISSION	VD	13.12.24
REV	DESCRIPTION	BY	DATE



Office: Level 2, 18 Epsom Street, Surry Hills NSW (201)
+61 2 9261 0000 | www.prtarchitecture.com.au
Not a Notified Registered Architect (Refer to 10000)
485 100 000 002

CLIENT
NSW HOUSING CORPORATION
PTY LTD

PROJECT
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURRELEIGH ST & 20-24
RAILWAY PDE, BURWOOD

DRAWING TITLE
PROJECT SUMMARY

SCALE	1:1 AT A3	NUMBER	FORM
DRAWN BY	VD/JR		
CHECKED BY	PI		
PROJECT NO.	P709		
SSDA	01	A	
stage	draw no.	revision	

UNIT SCHEDULE (sqm)							ADDITIONAL INFORMATION (sqm)			AREA SCHEDULE (m ²)			STORAGE SCHEDULE (m ³)			
SUB KEY UNIT NO.	2 BED	TOTAL	RENTAL	SUBNO	1 BED	TOTAL	AFFORDABLE HOUSING UNITS	POST ADAPTABLE ACCESSIBLE UNITS	USA SILVER LEVEL UNITS	UNIT	PRIVATE OPEN SPACE	TOTAL	WHEEL UNIT	OUTSIDE OF UNIT	TOTAL	% WITHIN UNIT
301	1		101A	1	1		1	-	-	50	8	58	4	2	6	67%
302	1	3	101A	1			1	-	1	55	4	59	4	0	4	68%
303	1		101B	1			1	1	1	54	7	61	5	1	6	73%
304	1		101B	1			1	-	-	50	8	58	4	2	6	67%
305	1		101B	1			1	-	-	51	4	55	2	2	4	55%
401	1		101A	1	1		1	-	-	50	8	58	4	2	6	67%
402	1	3	102A	1			1	-	-	55	4	59	4	0	4	70%
403	1		102B	1			1	1	1	50	8	58	5	1	6	69%
404	1		102B	1			1	-	-	50	8	58	4	2	6	67%
405	1		102B	1			1	-	-	51	4	55	2	2	4	55%
501	1		101A	1	1		1	-	-	50	8	58	4	2	6	67%
502	1	3	102A	1			1	-	1	55	4	59	4	0	4	70%
503	1		102B	1			1	1	1	50	8	58	5	1	6	69%
504	1		102B	1			1	-	-	50	8	58	4	2	6	67%
505	1		102B	1			1	-	-	51	4	55	2	2	4	55%
601	1		101A	1	1		1	-	-	50	8	58	4	2	6	67%
602	1	3	102A	1			1	-	1	55	4	59	4	0	4	70%
603	1		102B	1			1	1	1	50	8	58	5	1	6	69%
604	1		102B	1			1	-	-	50	8	58	4	2	6	67%
605	1		102B	1			1	-	-	51	4	55	2	2	4	55%
701	1		101A	1	1		1	-	-	50	8	58	4	2	6	67%
702	1	3	102A	1			1	-	1	55	4	59	4	0	4	70%
703	1		102B	1			1	1	1	50	8	58	5	1	6	69%
704	1		102B	1			1	-	-	50	8	58	4	2	6	67%
705	1		102B	1			1	-	-	51	4	55	2	2	4	55%
801	1		101A	1	1		1	-	-	50	8	58	4	2	6	67%
802	1	3	102A	1			1	-	1	55	4	59	4	0	4	70%
803	1		102B	1			1	1	1	50	8	58	5	1	6	69%
804	1		102B	1			1	-	-	50	8	58	4	2	6	67%
805	1		102B	1			1	-	-	51	4	55	2	2	4	55%
901	1		101A	1	1		1	-	-	50	8	58	4	2	6	67%
902	1	3	102A	1			1	-	1	55	4	59	4	0	4	70%
903	1		102B	1			1	1	1	50	8	58	5	1	6	69%
904	1		102B	1			1	-	-	50	8	58	4	2	6	67%
905	1		102B	1			1	-	-	51	4	55	2	2	4	55%
1001	1		102A	1	1		1	-	-	50	8	58	4	2	6	67%
1002	1	3	102A	1			1	-	1	55	4	59	4	0	4	70%
1003	1		102B	1			1	1	1	50	8	58	5	1	6	69%
1004	1		102B	1			1	-	-	50	8	58	4	2	6	67%
1005	1		102B	1			1	-	-	51	4	55	2	2	4	55%
1101	1		1101A	1	1		1	-	-	50	8	58	4	2	6	67%
1102	1	3	1102A	1			1	-	1	55	4	59	4	0	4	70%
1103	1		1102B	1			1	1	1	50	8	58	5	1	6	69%
1104	1		1102B	1			1	-	-	50	8	58	4	2	6	67%
1105	1		1102B	1			1	-	-	51	4	55	2	2	4	55%
1201	1		1201A	1	1		1	-	-	50	8	58	4	2	6	67%
1202	1	3	1202A	1			1	-	1	55	4	59	4	0	4	70%
1203	1		1202B	1			1	1	1	50	8	58	5	1	6	69%
1204	1		1202B	1			1	-	-	50	8	58	4	2	6	67%
1205	1		1202B	1			1	-	-	51	4	55	2	2	4	55%
1301	1		1301A	1	1		1	-	-	50	8	58	4	2	6	67%
1302	1	3	1302A	1			1	-	1	55	4	59	4	0	4	70%
1303	1		1302B	1			1	1	1	50	8	58	5	1	6	69%
1304	1		1302B	1			1	-	-	50	8	58	4	2	6	67%
1305	1		1302B	1			1	-	-	51	4	55	2	2	4	55%
1401	1		1401A	1	1		1	-	-	50	8	58	4	2	6	67%
1402	1	3	1402A	1			1	-	1	55	4	59	4	0	4	70%
1403	1		1402B	1			1	1	1	50	8	58	5	1	6	69%
1404	1		1402B	1			1	-	-	50	8	58	4	2	6	67%
1405	1		1402B	1			1	-	-	51	4	55	2	2	4	55%
1501	1		1501A	1	1		1	-	-	50	8	58	4	2	6	67%
1502	1	3	1502A	1			1	-	1	55	4	59	4	0	4	70%
1503	1		1502B	1			1	1	1	50	8	58	5	1	6	69%
1504	1		1502B	1			1	-	-	50	8	58	4	2	6	67%
1505	1		1502B	1			1	-	-	51	4	55	2	2	4	55%
1601	1		1601A	1	1		1	-	-	50	8	58	4	2	6	67%
1602	1	3	1602A	1			1	-	1	55	4	59	4	0	4	70%
1603	1		1602B	1			1	1	1	50	8	58	5	1	6	69%
1604	1		1602B	1			1	-	-	50	8	58	4	2	6	67%
1605	1		1602B	1			1	-	-	51	4	55	2	2	4	55%
1701	1		1701A	1	1		1	-	-	50	8	58	4	2	6	67%
1702	1	3	1702A	1			1	-	1	55	4	59	4	0	4	70%
1703	1		1702B	1			1	1	1	50	8	58	5	1	6	69%
1704	1		1702B	1			1	-	-	50	8	58	4	2	6	67%
1705	1		1702B	1			1	-	-	51	4	55	2	2	4	55%
1801	1		1801A	1	1		1	-	-	50	8	58	4	2	6	67%
1802	1	3	1802A	1			1	-	1	55	4	59	4	0	4	70%
1803	1		1802B	1			1	1	1	50	8	58	5	1	6	69%
1804	1		1802B	1			1	-	-	50	8	58	4	2	6	67%
1805	1		1802B	1			1	-	-	51	4	55	2	2	4	55%
TOTAL (Units)	48	48					36	12	12	36	12	48	36	12	48	
UNIT MIX (%)							75%	25%	25%	75%	25%	75%	75%	25%	75%	

SSDA SUBMISSION

A	SSDA SUBMISSION	VD	13/12/24
REV	DESCRIPTION	BY	DATE




CLIENT
**NSW HOUSING CORPORATION
PTY LTD**

PROJECT
**RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURREIGH ST & 20-24
RAILWAY PDE, BURWOOD**


DRAWING TITLE:
APARTMENT SCHEDULE

SCALE	1:1 AT A3	NO. OF PAGES	
DRAWN BY	VD/JR		
CHECKED BY	PI		
PROJECT NO.	P709		


SSDA	02	A
stage	dwg no.	revision

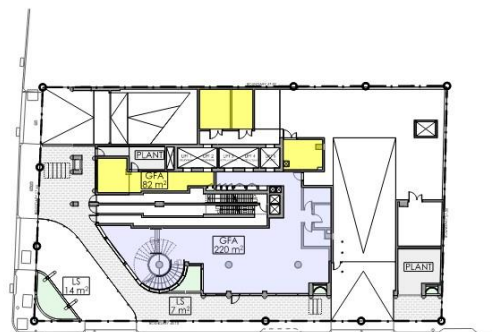


1 GROUND FLOOR
1:500

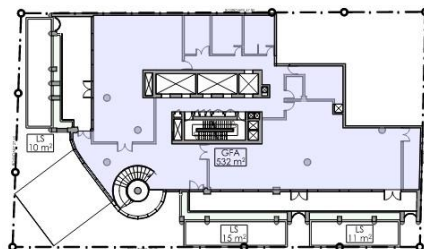


2 LEVEL 1
1:500

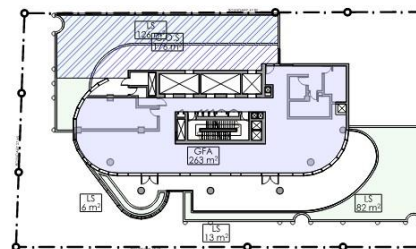


3 LEVEL 2
1:500




SSDA SUBMISSION

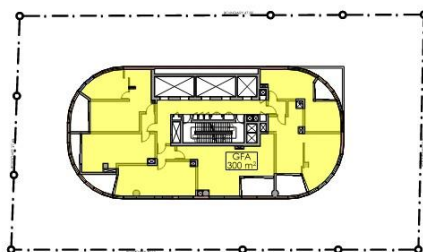


4 LEVEL 3-18 (AH LEVEL 3-8)
1:500

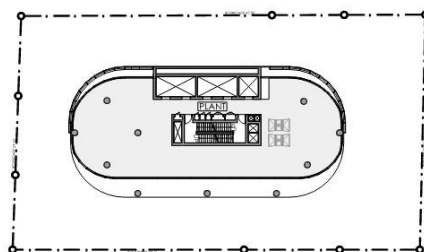


5 LEVEL 19
1:500

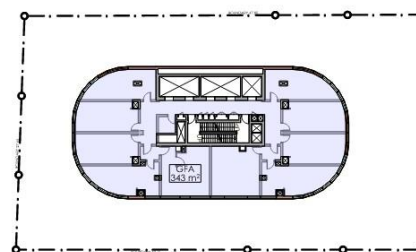


6 LEVELS 20-31
1:500

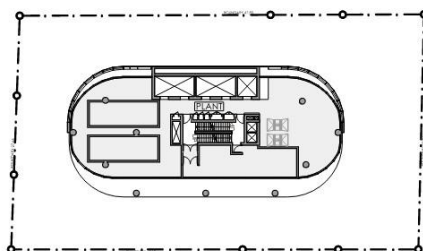

7 LEVEL 32
1:500

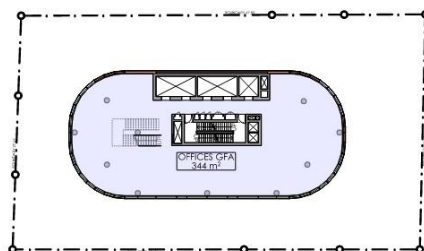

8 LEVEL 33
1:500

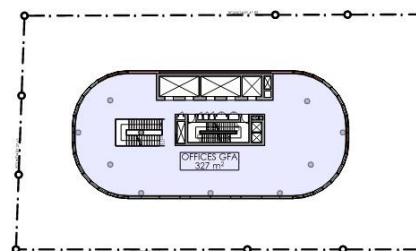

9 LEVEL 34
1:500



A	SSDA SUBMISSION	VD	13/12/24
REV	DESCRIPTION	BY	DATE



Office Level 2, 18 East Street, Surry Hills NSW 2011
+61 2 9250 0000 | info@ptiarchitect.com.au
Not a Notified Registered Architect (Preliminary Stage) (NSW) 10/0000
NSW 10/0000 (20/02)


CLIENT:
NSW HOUSING CORPORATION
PTY LTD


PROJECT:
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD


DRAWING TITLE:
GFA & FSR CALCULATIONS

SCALE	1:500 AT A3	NORTH POINT
DRAWN BY	VD/JR	
CHECKED BY	PI	
PROJECT NO.	P709	

SSDA 03 A
stage draw no revision

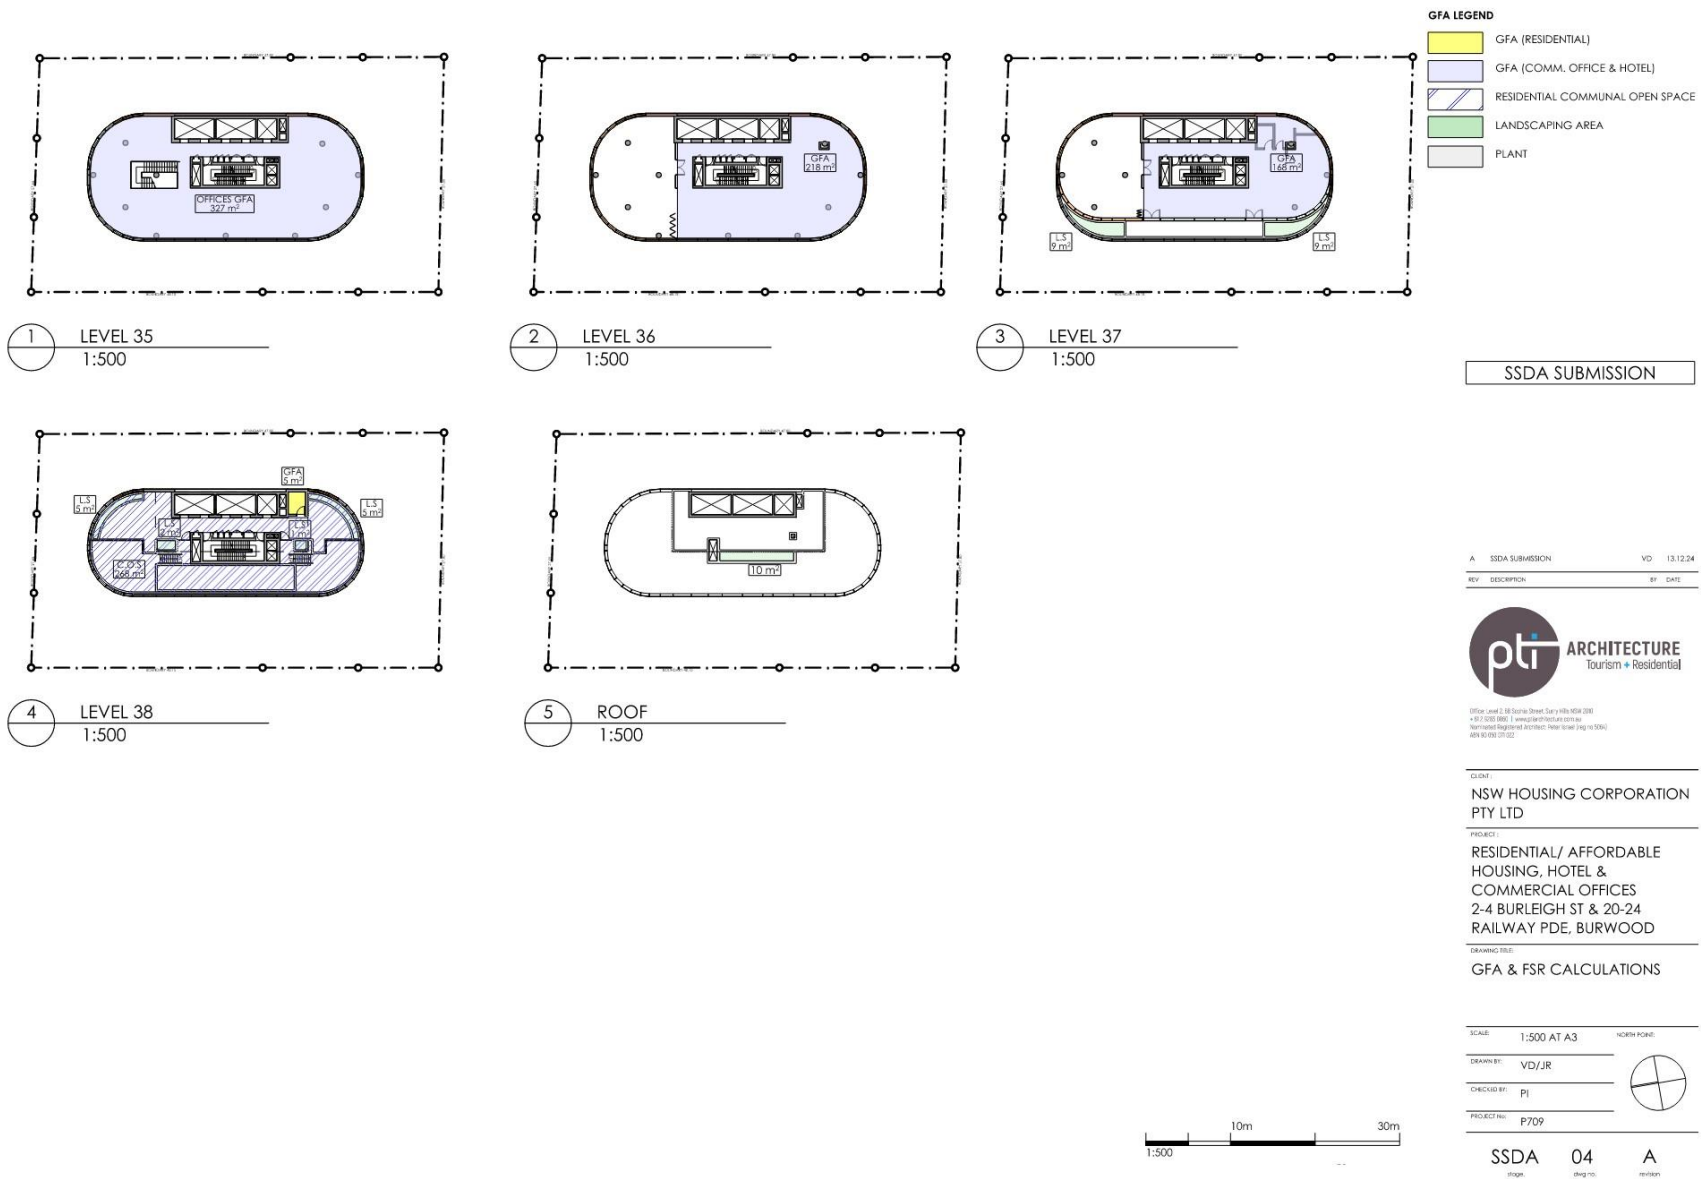

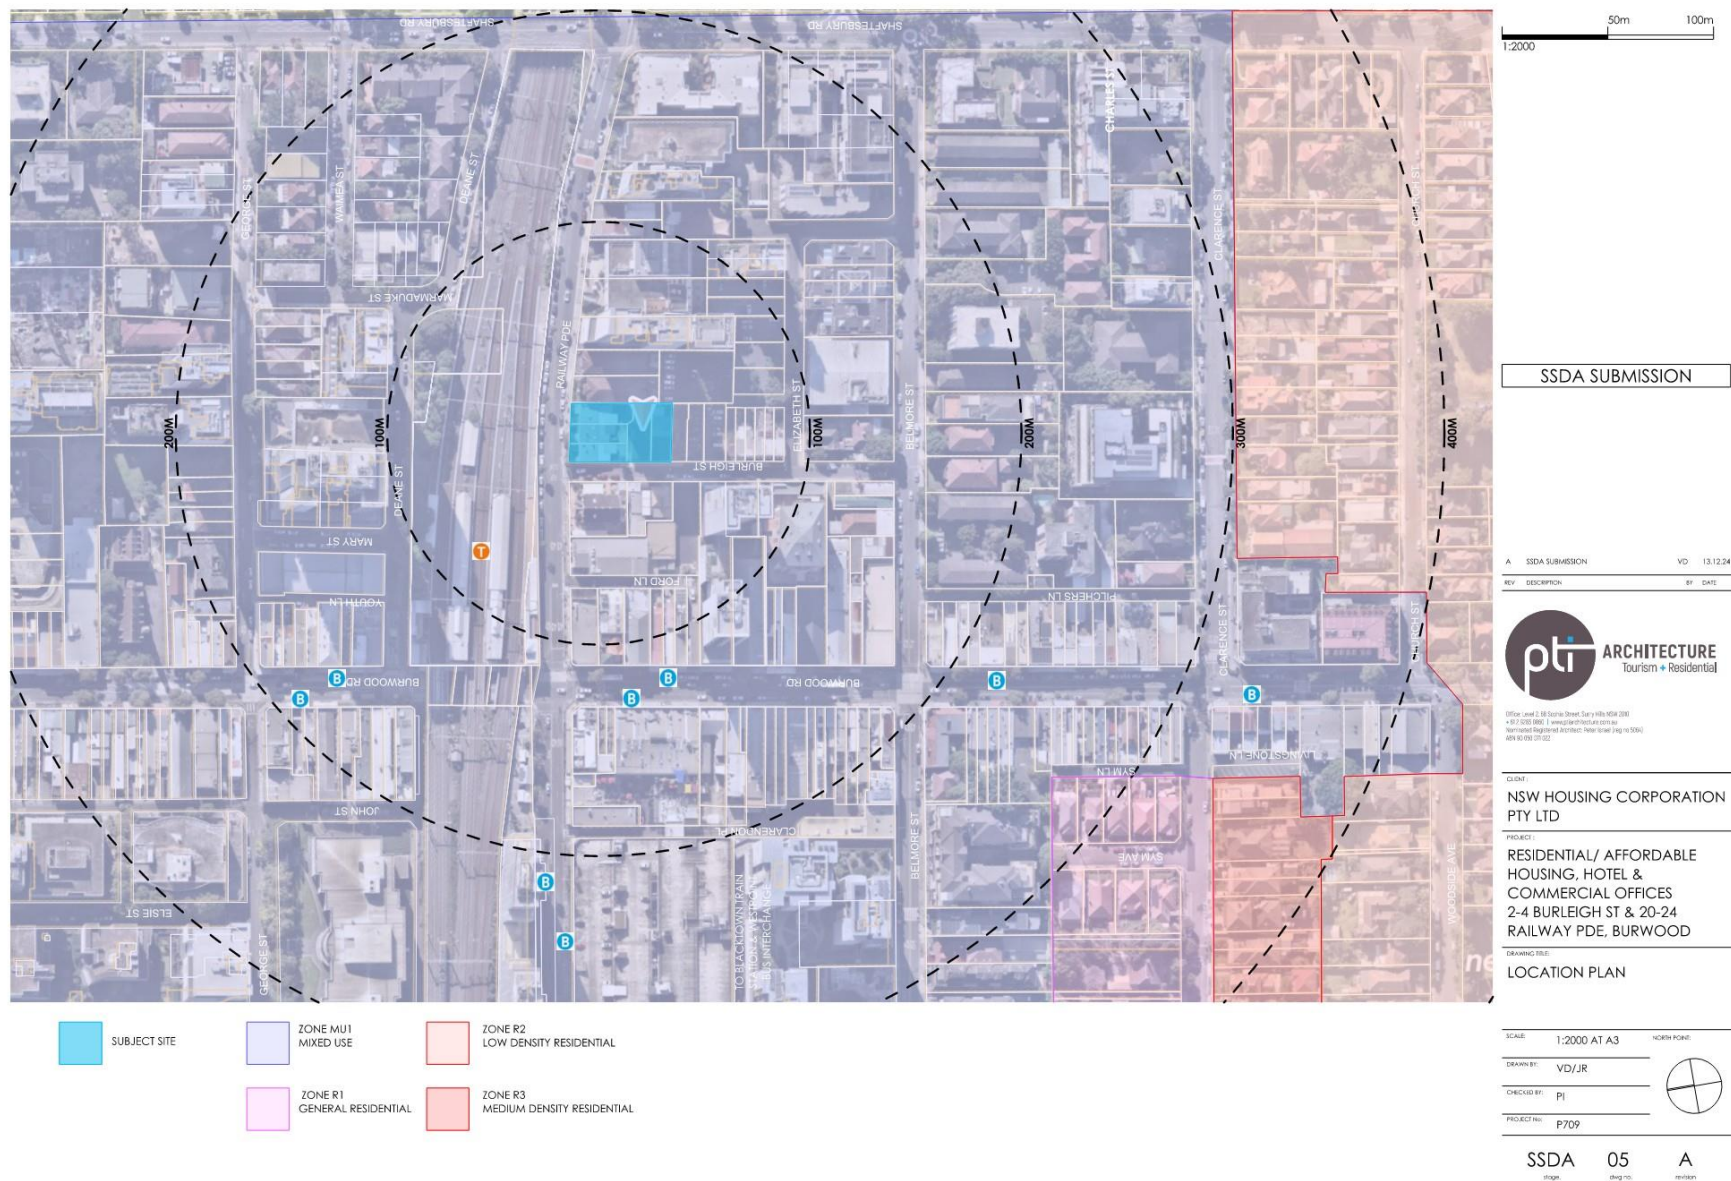

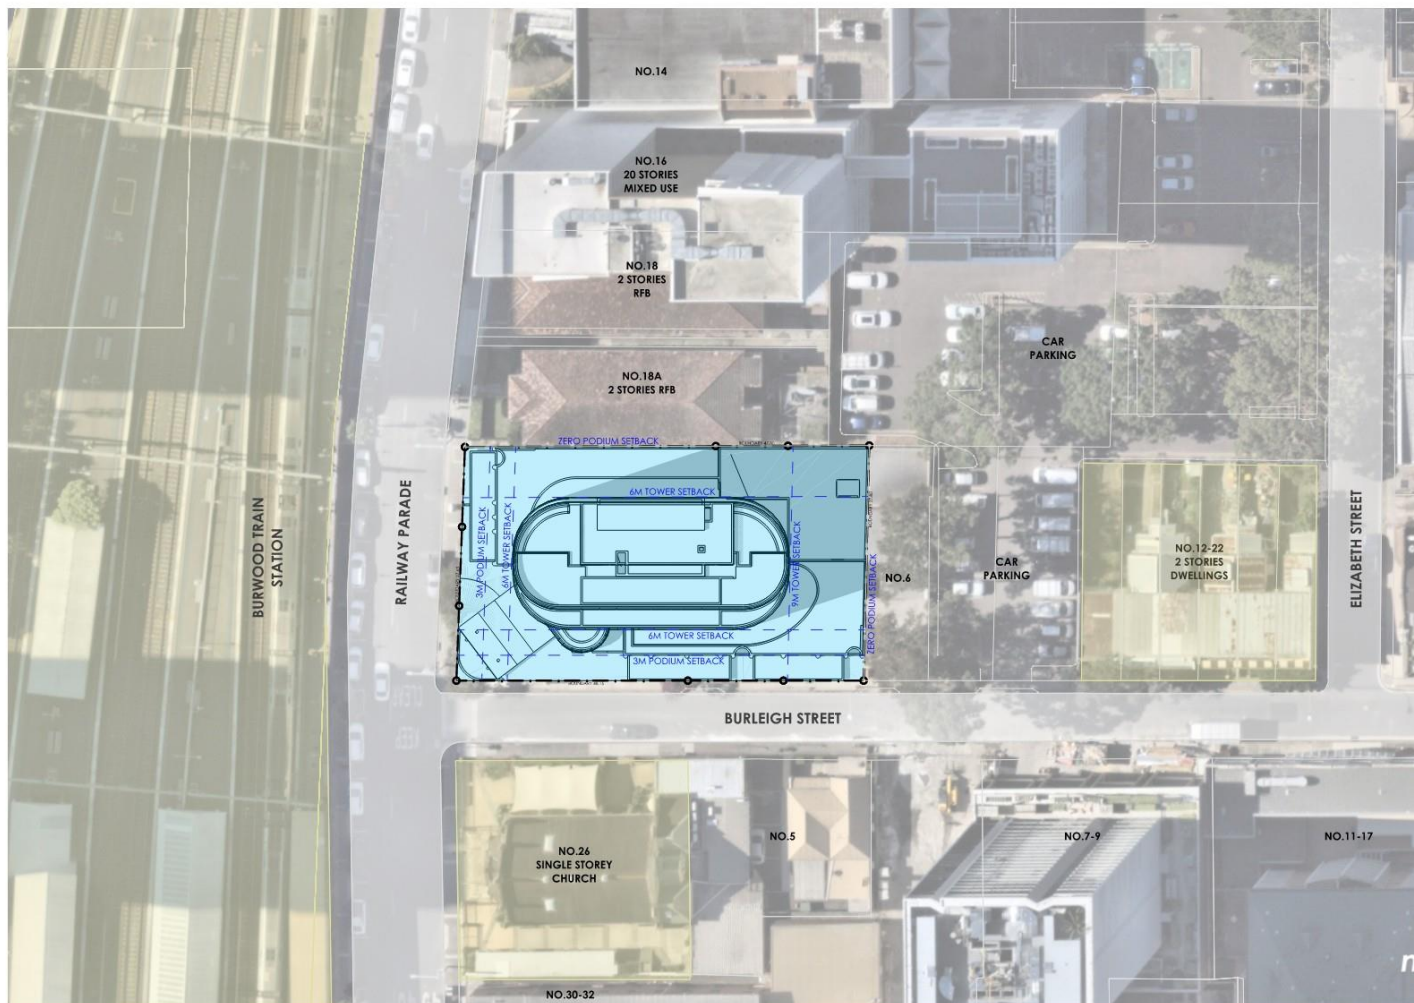

10m 30m
1:500

SSDA SUBMISSION

A SSDA SUBMISSION VO 13/12/24
REV DESCRIPTION BY DATE



Office Level 2, 18 East Street, Surry Hills NSW 2010
+61 2 9250 0000 | www.ptiarchitect.com.au
Not a Not a Registered Architect (No. 149160000)
405 405 000 000

CLIENT
NSW HOUSING CORPORATION
PTY LTD

PROJECT
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD


DRAWING TITLE
SITE PLAN

SCALE 1:500 AT A3 NORTH POINT
DRAWN BY: VD/JR
CHECKED BY: PJ
PROJECT NO: P709

SSDA 06 A
stage dwg no revision

1 SITE/ SITE ANALYSIS PLAN
1:500




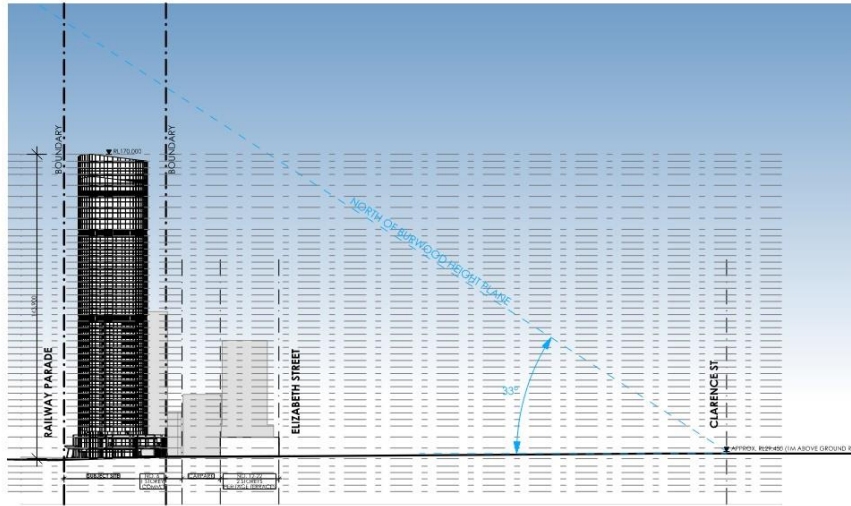

1 BURLEIGH ST- HEIGHT PLANE D
1:2000



SSDA SUBMISSION

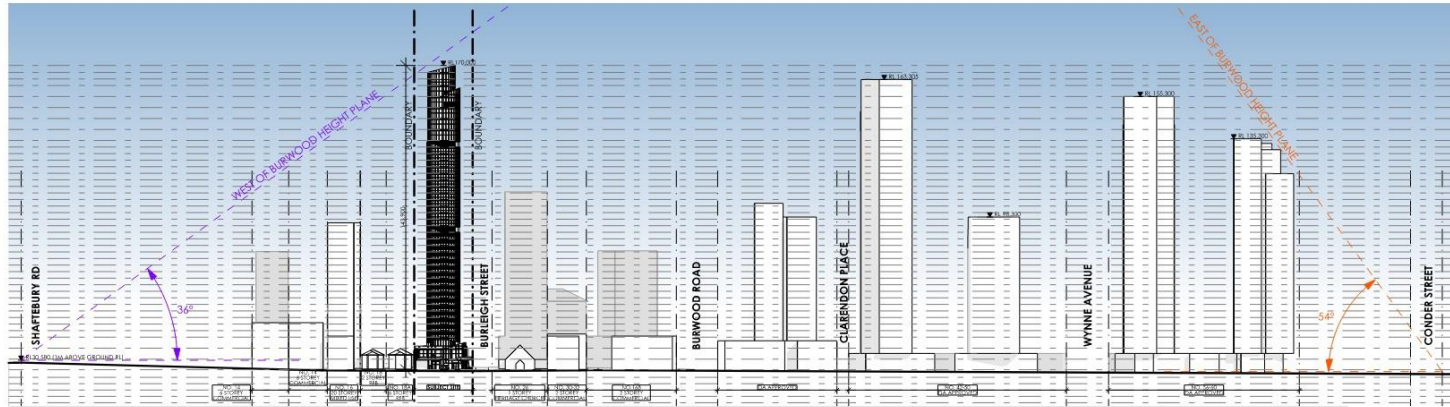

2 RAILWAY PDE- HEIGHT PLANE A & C
1:2000

A	SSDA SUBMISSION	VD	13.12.24
REV	DESCRIPTION	BY	DATE



Office Level 2, 18 East Street, Surry Hills NSW 2011
+61 2 9250 0881 | www.ptiarchitecture.com.au
Not a Not a Registered Architect (Preliminary) (Preliminary)
400 000 000 000

CLIENT:
NSW HOUSING CORPORATION
PTY LTD

PROJECT:
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD



DRAWING TITLE:
STREETSCAPE & BURWOOD
HEIGHT PLANE

SCALE:	1:2000 AT A3	NORTH POINT:
DRAWN BY:	VD/JR	
CHECKED BY:	PI	
PROJECT NO.:	P709	

SSDA	07	A
stage	draw no.	revision



SSDA 08 A
stage, dwg no, revision

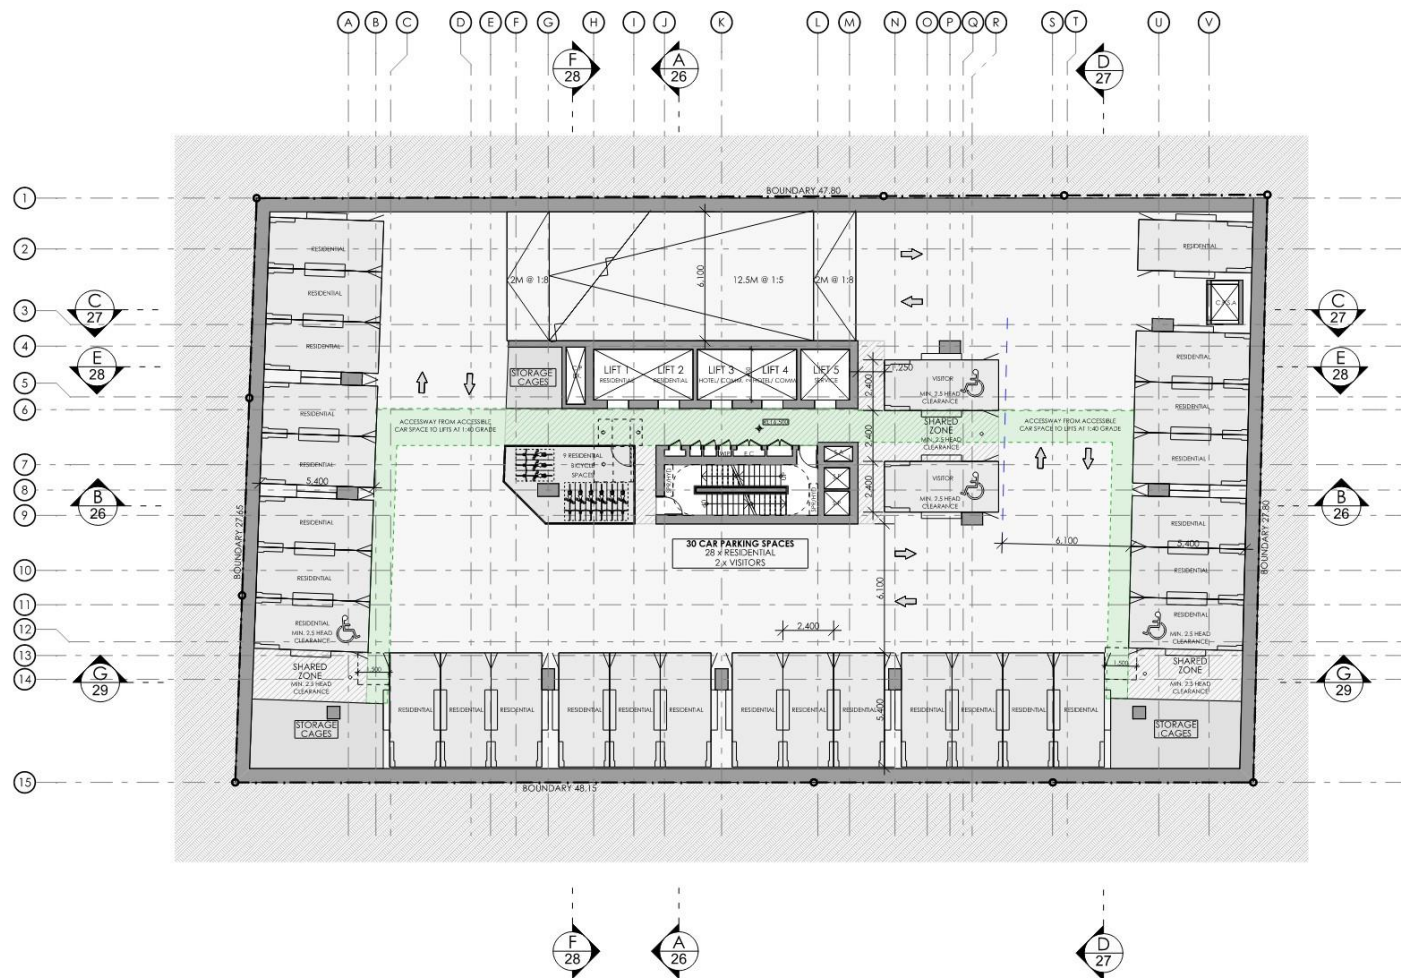

1 BASEMENT LEVEL 3 - RESIDENTIAL PARKING
1:200

SSDA SUBMISSION

A	SSDA SUBMISSION	VD	13/12/24
REV	DESCRIPTION	BY	DATE



Office Level 2, 18 East Street, Surry Hills NSW 2010
+61 2 9250 0000 | info@ptiarchitect.com.au
Not a registered architect. Project No: P709 (13/12/24)
489 10 100 100 100



CLIENT:
NSW HOUSING CORPORATION
PTY LTD

PROJECT:
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD

DRAWING TITLE:
BASEMENT 3 PLAN

SCALE	1:200 AT A3	NORTH POINT
DRAWN BY	VD/JR	
CHECKED BY	PI	
PROJECT NO	P709	

SSDA 09 A
stage dwg no revision

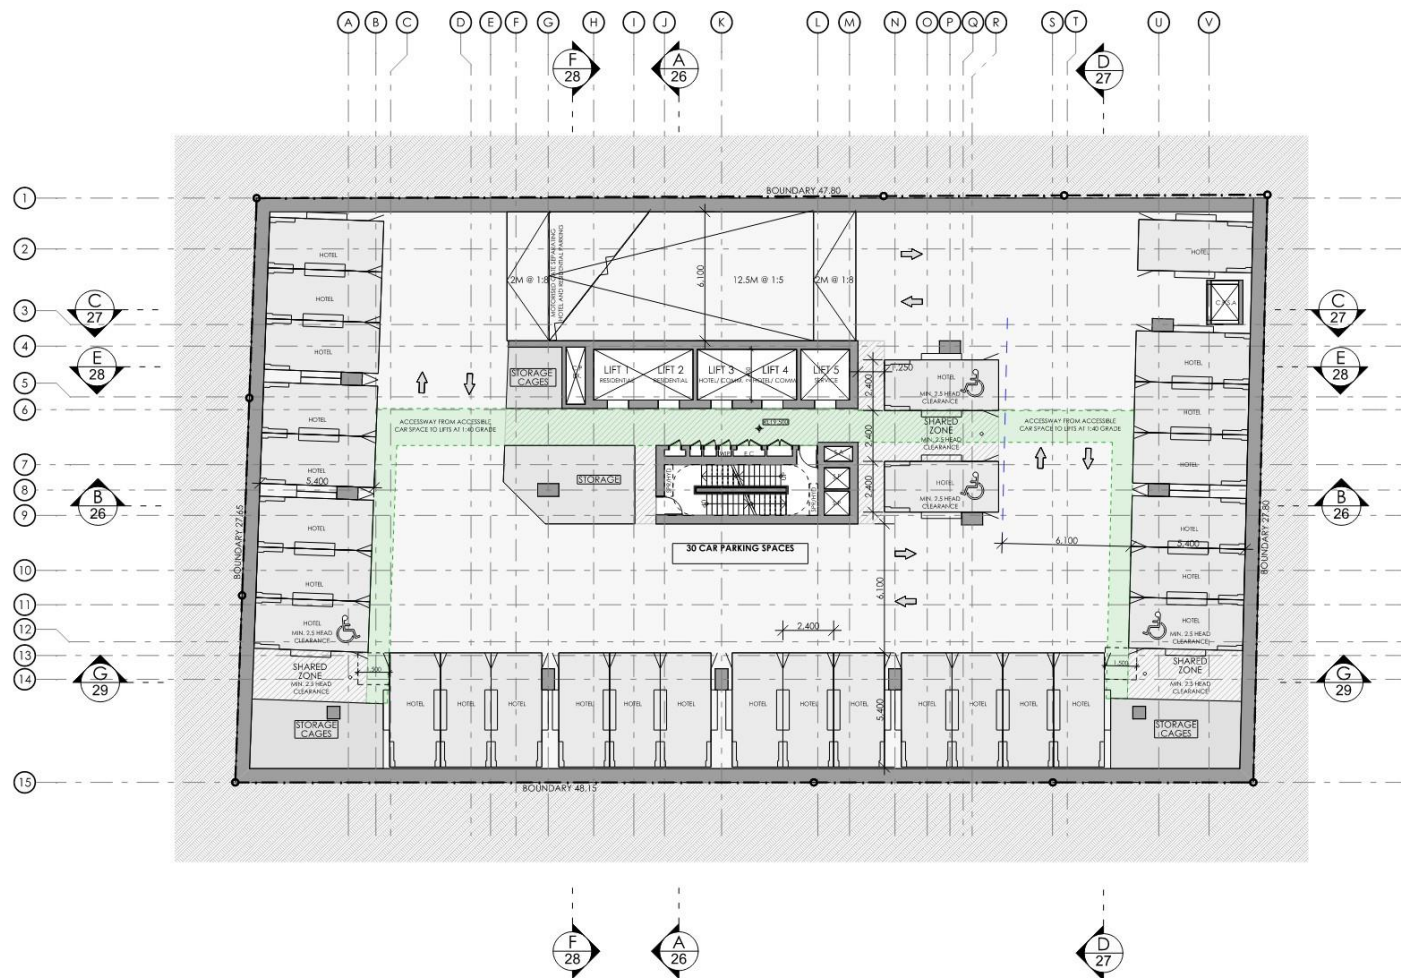

1 BASEMENT LEVEL 2 - HOTEL PARKING
1:200

SSDA SUBMISSION

A SSDA SUBMISSION VO 13.12.24
REV DESCRIPTION BY DATE



Office Level 2, 18 East Street, Surry Hills NSW 2011
+61 2 9250 0000 | www.ptiarchitect.com.au
Not a registered architect. Prior to 2000.
400 00 000 000

CLIENT
NSW HOUSING CORPORATION
PTY LTD

PROJECT
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD


DRAWING TITLE
BASEMENT 2 PLAN

SCALE 1:200 AT A3 NORTH POINT
DRAWN BY: VD/JR
CHECKED BY: PJ
PROJECT NO: P709

SSDA 10 A
stage dwg no revision



SSDA 11 A
stage, dwg no, revision

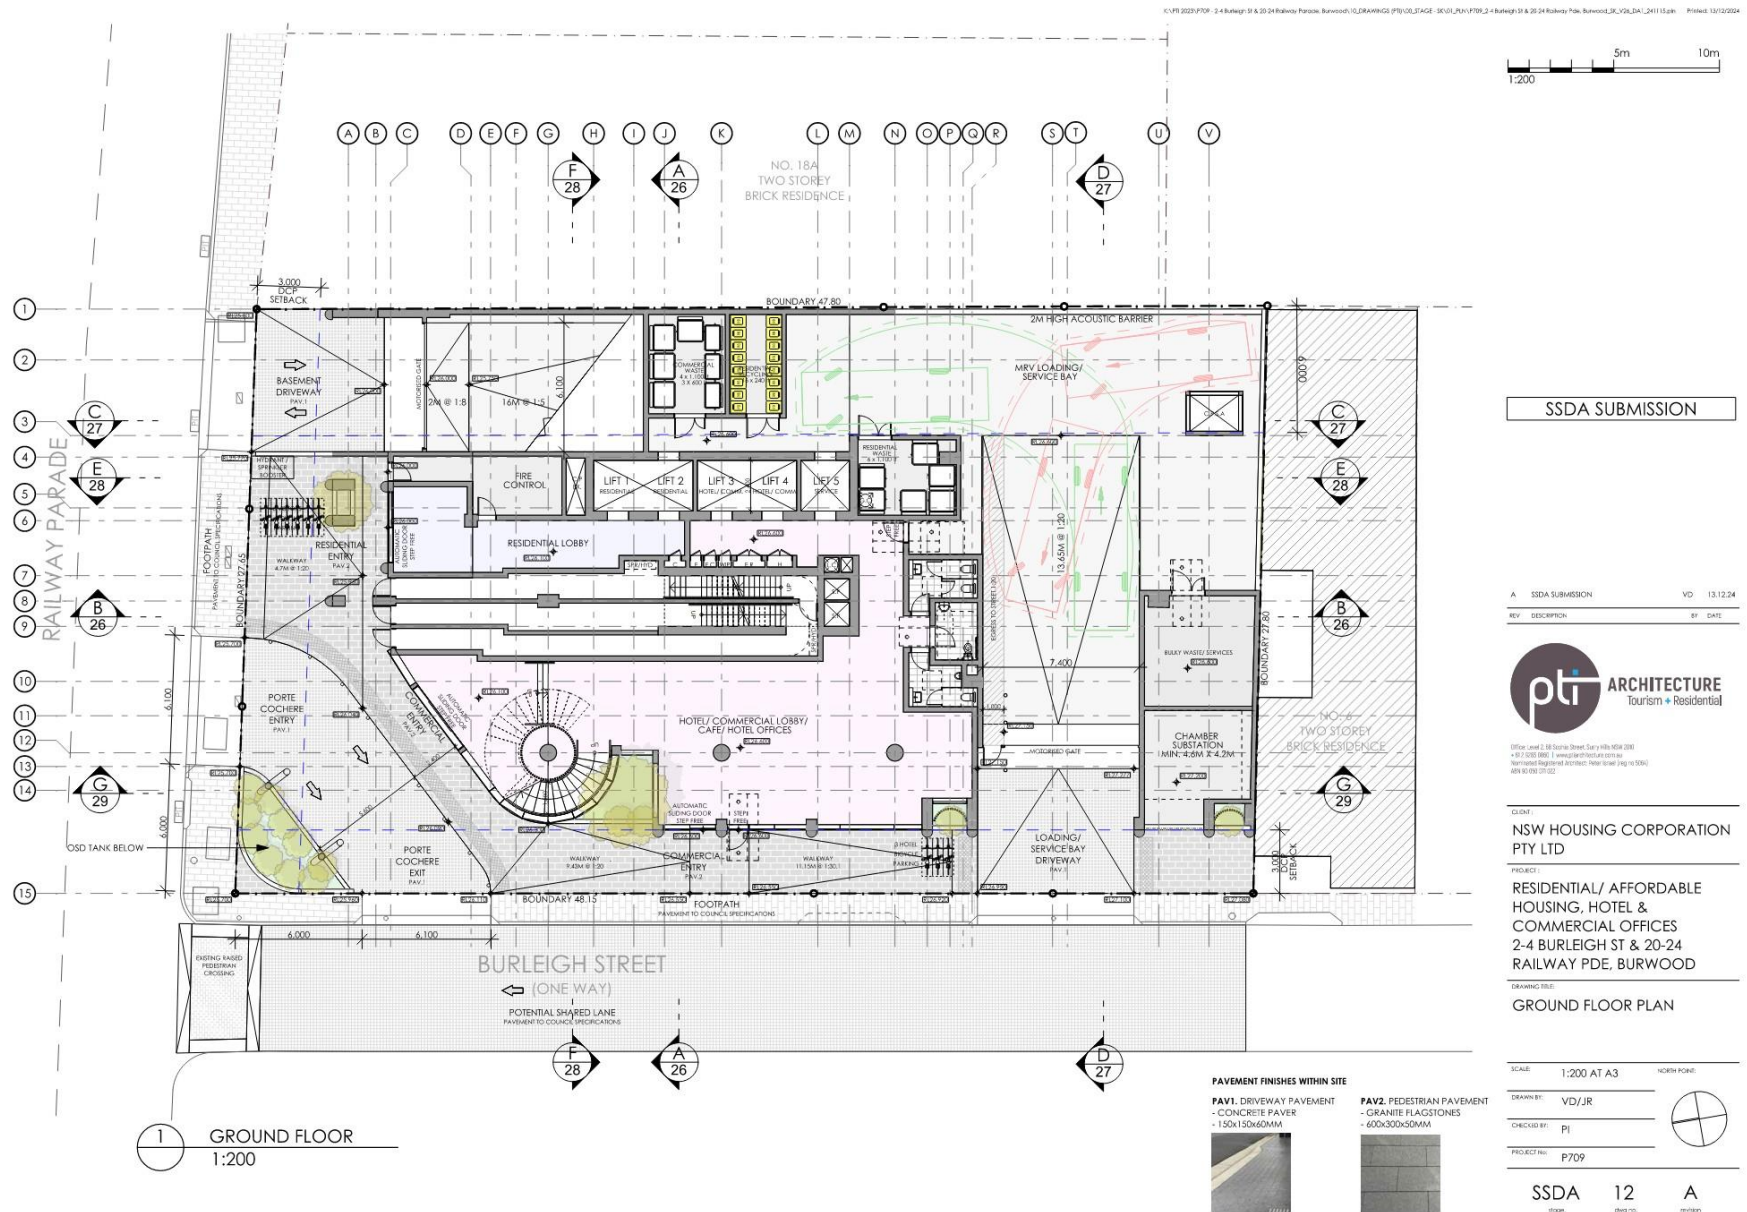



SSDA



13

A

stage

dwg no.

revision

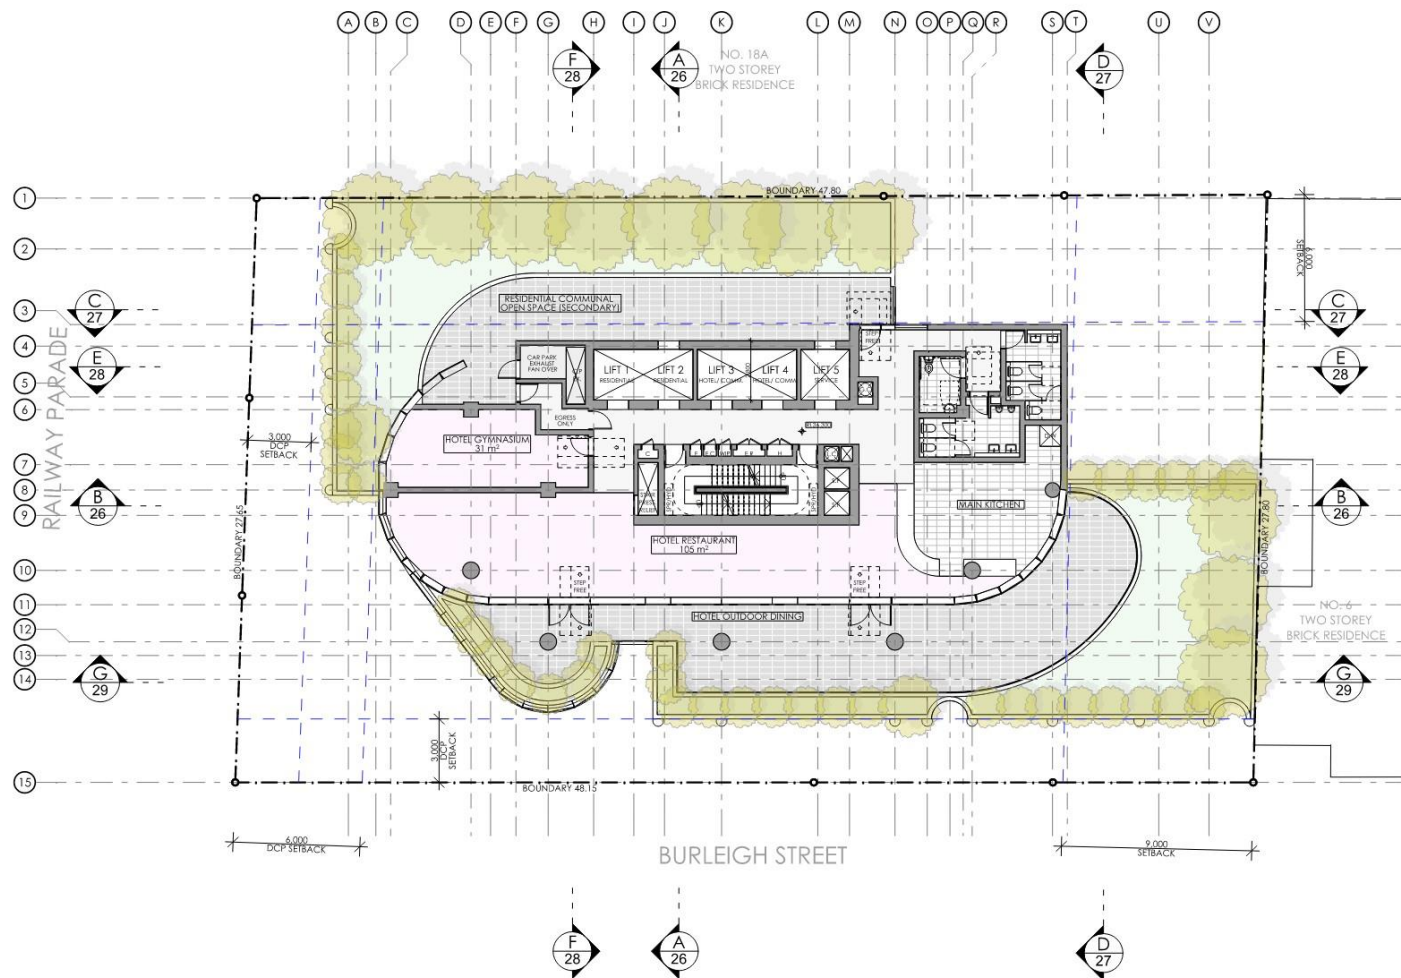

1 HOTEL FACILITIES LEVEL 2
1:200

SSDA SUBMISSION

A SSDA SUBMISSION VO 13/12/24
REV DESCRIPTION BY DATE



Office Level 2, 18 East St, Sydney NSW 2011
+61 2 9250 8888 | www.ptiarchitect.com.au
New South Wales Registered Architect (No. 14916) (No. 14916)
485 KOLINS ST, SYDNEY

CLIENT
NSW HOUSING CORPORATION
PTY LTD

PROJECT
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD

DRAWING TITLE
LEVEL 2 FLOOR PLAN- HOTEL
FACILITIES

SCALE 1:200 AT A3 NORTH POINT

DRAWN BY VD/JR

CHECKED BY PJ


PROJECT NO. P709



SSDA 14 A
stage dwg no revision

ADG MINIMUM AREAS

	3M X 3M IN BEDROOM
	3.6M X 3.6M IN LIVING ROOM
	0.9M X 1.2M IN LHA SILVER LEVEL BATHROOM
	2M X 2M IN BALCONY
	1M X 1M IN BALCONY

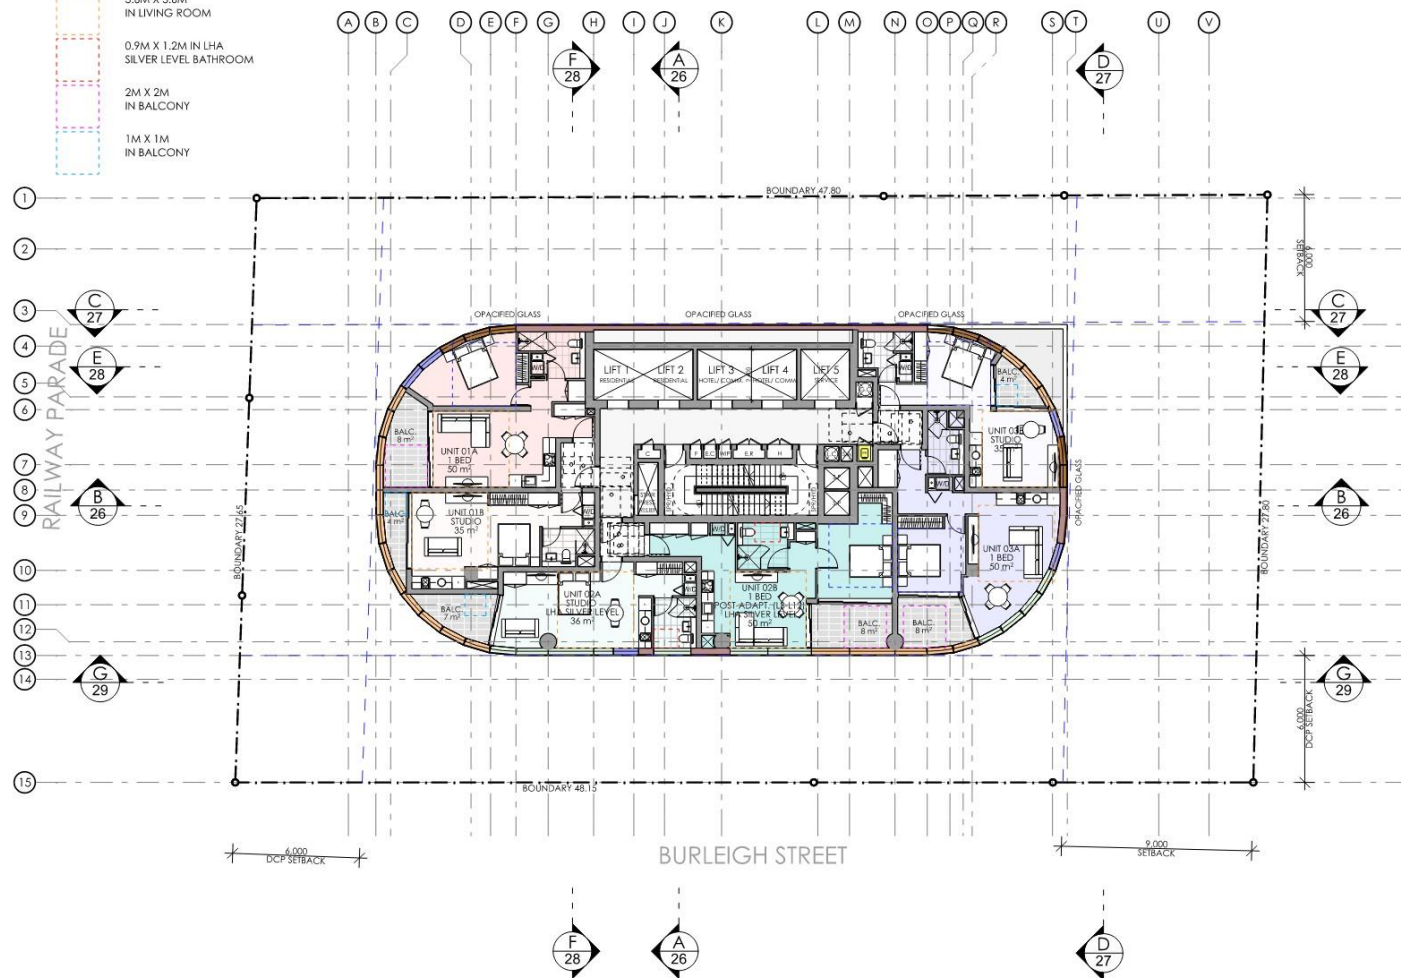

1 RESIDENTIAL APARTMENTS LEVELS 3- 8 (AFFORDABLE HOUSING)
1:200



CURTAIN WALL LEGEND

	TYPE A VISION GLASS LOUVRES - FIXED OPEN AT EXTERNAL SPACES
	TYPE B VISION GLASS LOUVRES - OPERABLE AT INTERNAL SPACES
	TYPE C FIXED VISION GLASS
	TYPE D FIXED OPACIFIED GLASS
	TYPE E FIXED OPACIFIED GLASS OVER SOLID WALL

SSDA SUBMISSION

A	SSDA SUBMISSION	VD	13/12/24
REV	DESCRIPTION	BY	DATE



Office Level 2, 18 East St, Sydney NSW 2011
+61 2 9250 8888 | enquiries@ptiarch.com.au
Not a Registered Architect (Preliminary Design Only)
4000 9000 20102

CLIENT
NSW HOUSING CORPORATION
PTY LTD

PROJECT
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD


DRAWING TITLE
LEVELS 3-8 FLOOR PLAN-
RESIDENTIAL

SCALE	1:200 AT A3	NORTH POINT
DRAWN BY	VD/JR	
CHECKED BY	PI	
PROJECT NO.	P709	


SSDA	15	A
stage	dwg no.	revision

ADG MINIMUM AREAS

	3M X 3M IN BEDROOM
	3.6M X 3.6M IN LIVING ROOM
	0.9M X 1.2M IN LHA SILVER LEVEL BATHROOM
	2M X 2M IN BALCONY
	1M X 1M IN BALCONY

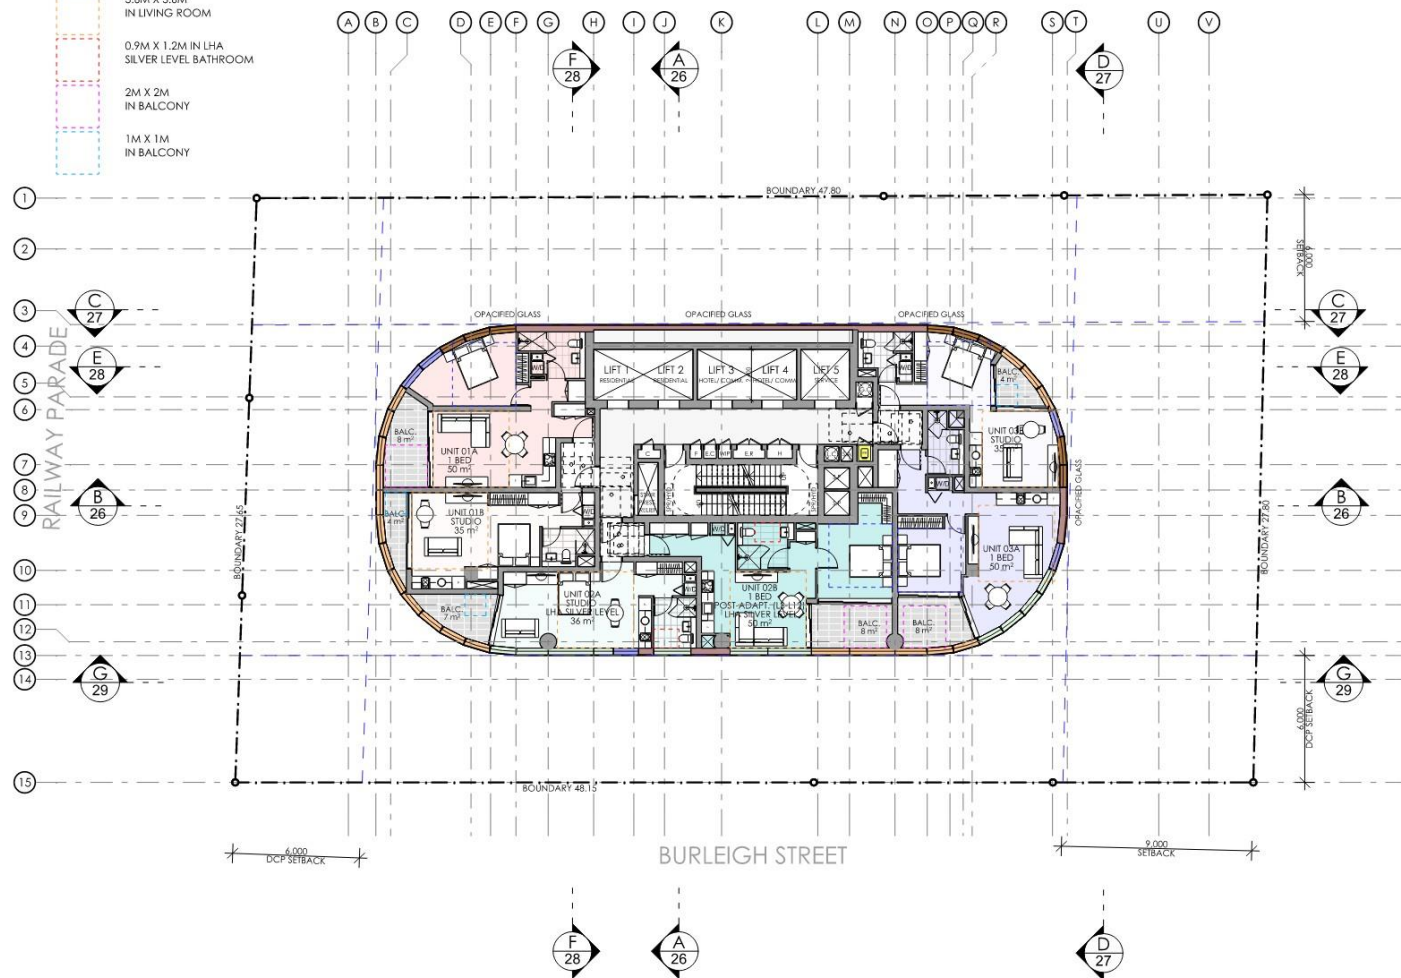

1 RESIDENTIAL APARTMENT LEVELS 9-18
1:200



CURTAIN WALL LEGEND

	TYPE A VISION GLASS LOUVRES - FIXED OPEN AT EXTERNAL SPACES
	TYPE B VISION GLASS LOUVRES - OPERABLE AT INTERNAL SPACES
	TYPE C FIXED VISION GLASS
	TYPE D FIXED OPACIFIED GLASS
	TYPE E FIXED OPACIFIED GLASS OVER SOLID WALL

SSDA SUBMISSION

A	SSDA SUBMISSION	VD	13/12/24
REV	DESCRIPTION	BY	DATE



Office Level 2, 18 Esplanade, Surry Hills NSW 2011
+61 2 9250 8888 | www.ptiarchitect.com.au
Not a Notified Registered Architect (No. 149160000)
4054 NSW REG. 271102

CLIENT
NSW HOUSING CORPORATION
PTY LTD

PROJECT
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD


DRAWING TITLE
LEVELS 9-18 FLOOR PLAN-
RESIDENTIAL

SCALE	1:200 AT A3	NORTH POINT
DRAWN BY	VD/JR	
CHECKED BY	PI	
PROJECT NO.	P709	


SSDA	16	A
stage	dwg no.	revision



SSDA 17 A
stage, dwg no, revision

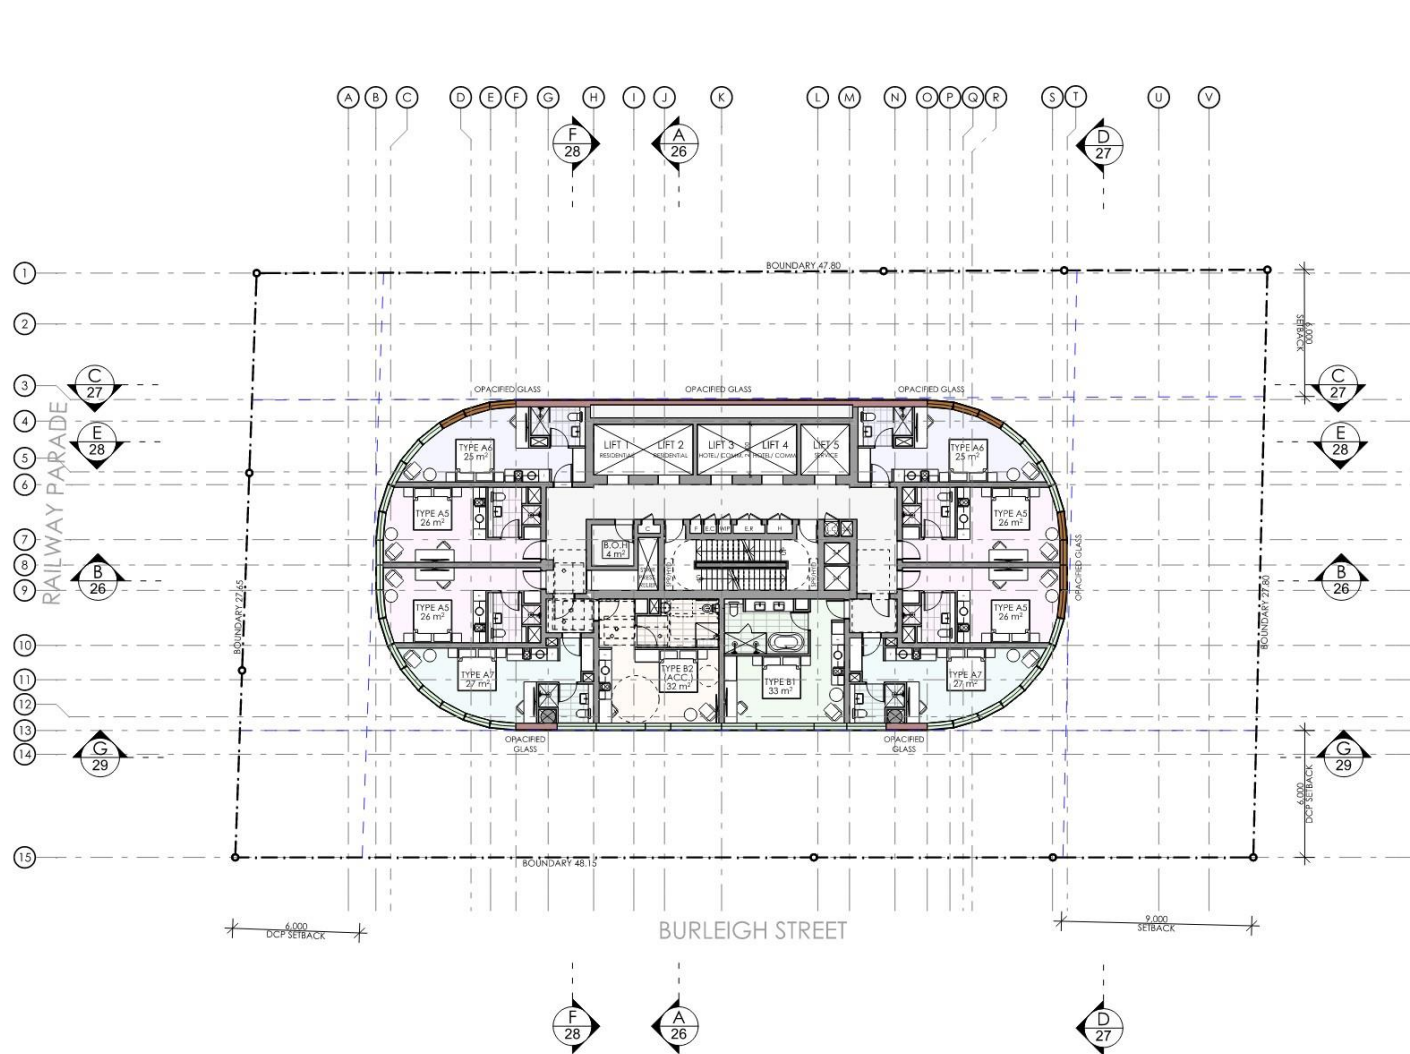

1 HOTEL ROOMS LEVELS 20-25
1:200



CURTAIN WALL LEGEND

- TYPE A**
VISION GLASS LOUVRES- FIXED OPEN
AT EXTERNAL SPACES
- TYPE B**
VISION GLASS LOUVRES- OPERABLE
AT INTERNAL SPACES
- TYPE C**
FIXED VISION GLASS
- TYPE D**
FIXED OPACIFIED GLASS
- TYPE E**
FIXED OPACIFIED GLASS OVER
SOLID WALL

SSDA SUBMISSION

A SSDA SUBMISSION VO 13/12/24
REV DESCRIPTION BY DATE



Office Level 2, 18 East St, Sydney NSW 2011
+61 2 9250 0000 | www.ptiarchitect.com.au
Not a Notified Body (NBS) under the ISO 9001:2015
4854 9001:2015


CLIENT
NSW HOUSING CORPORATION
PTY LTD

PROJECT
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD

DRAWING TITLE
LEVELS 20-25 FLOOR PLAN-
HOTEL ROOMS

SCALE 1:200 AT A3 NORTH POINT
DRAWN BY: VD/JR
CHECKED BY: PJ
PROJECT NO: P709

SSDA 18 A
stage dwg no revision

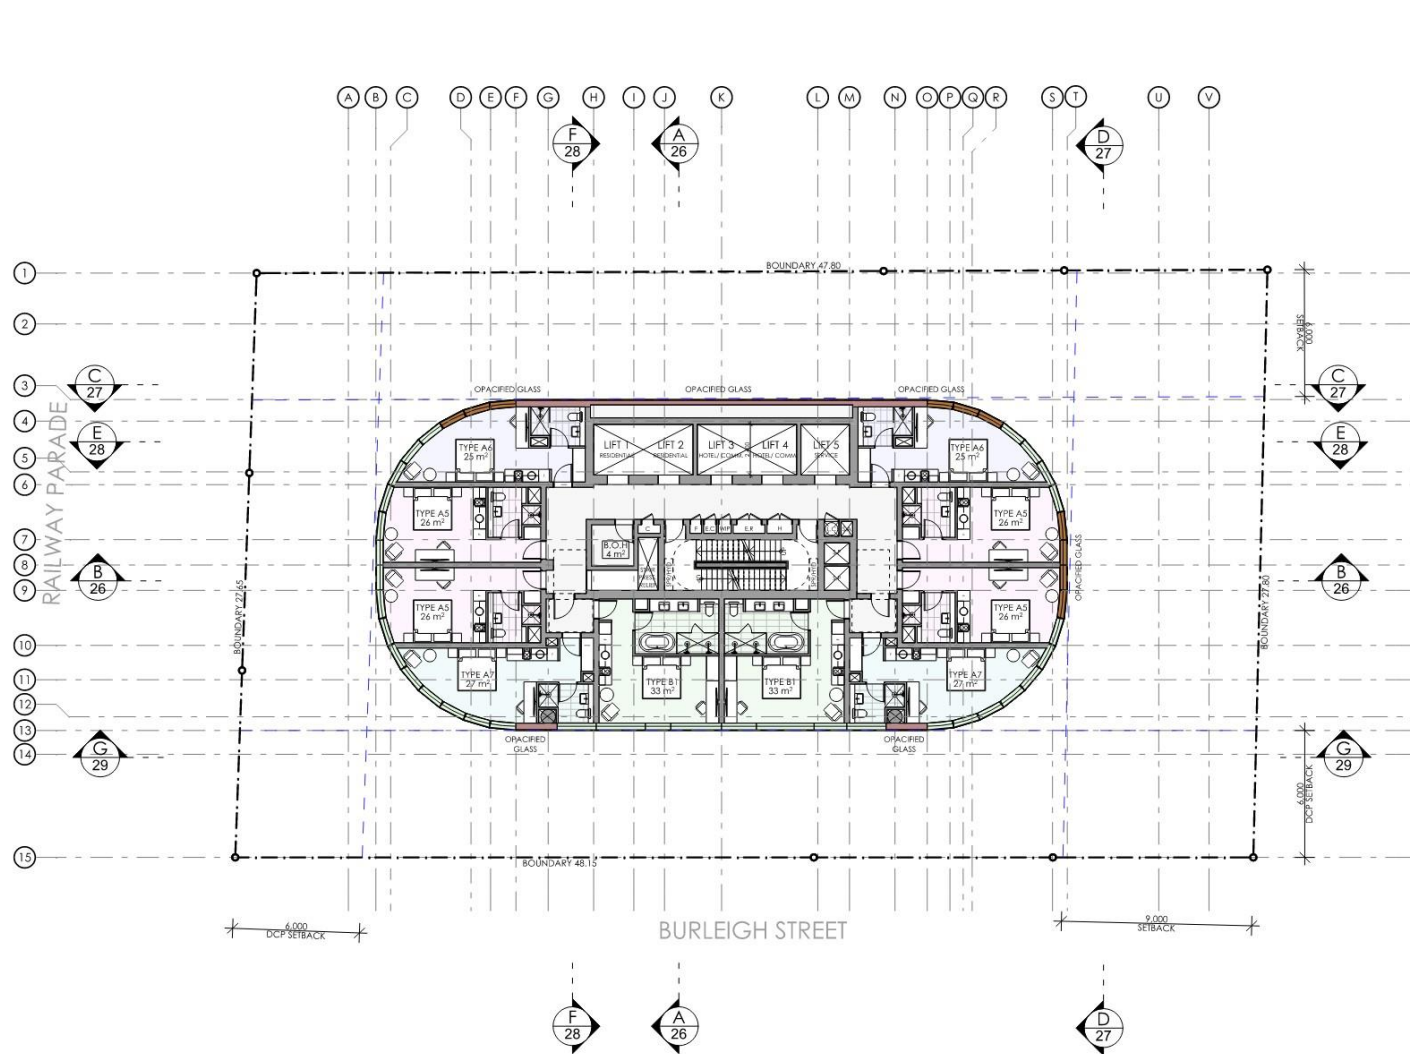

1 HOTEL ROOMS LEVELS 26-31
1:200



CURTAIN WALL LEGEND

- TYPE A**
VISION GLASS LOUVRES- FIXED OPEN
AT EXTERNAL SPACES
- TYPE B**
VISION GLASS LOUVRES- OPERABLE
AT INTERNAL SPACES
- TYPE C**
FIXED VISION GLASS
- TYPE D**
FIXED OPACIFIED GLASS
- TYPE E**
FIXED OPACIFIED GLASS OVER
SOLID WALL

SSDA SUBMISSION

A SSDA SUBMISSION VO 13/12/24
REV DESCRIPTION BY DATE



Office Level 2, 18 East St Street, Surry Hills NSW 2010
+61 2 9250 0000 | www.ptiarchitect.com.au
Not a Not a Registered Architect (No. 100000)
400 000 000 000

CLIENT
NSW HOUSING CORPORATION
PTY LTD

PROJECT
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD


DRAWING TITLE
LEVELS 26-31 FLOOR PLAN-
HOTEL ROOMS

SCALE 1:200 AT A3 NORTH POINT
DRAWN BY: VD/JR
CHECKED BY: PJ
PROJECT NO: P709

SSDA 19 A
stage draw no revision



SSDA 20 A
stage, div. no. revision

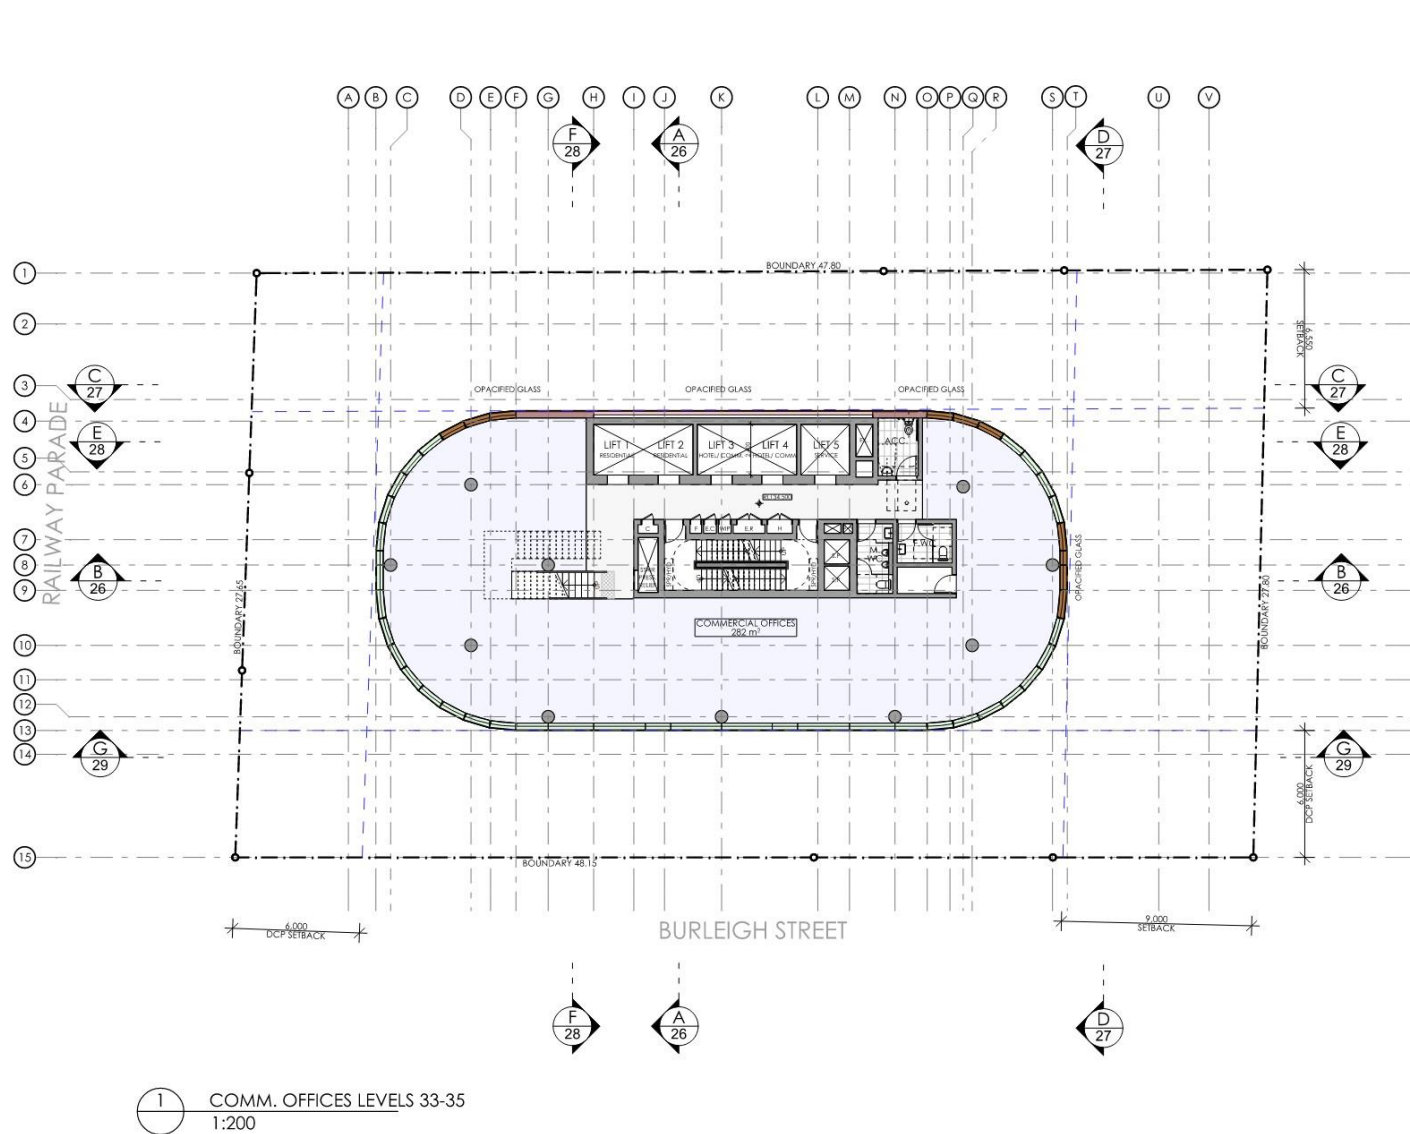

CURTAIN WALL LEGEND

- TYPE A**
VISION GLASS LOUVRES- FIXED OPEN
AT EXTERNAL SPACES
- TYPE B**
VISION GLASS LOUVRES- OPERABLE
AT INTERNAL SPACES
- TYPE C**
FIXED VISION GLASS
- TYPE D**
FIXED OPACIFIED GLASS
- TYPE E**
FIXED OPACIFIED GLASS OVER
SOLID WALL

SSDA SUBMISSION

A	SSDA SUBMISSION	VD	13/12/24
REV	DESCRIPTION	BY	DATE



Office Level 2, 18 East St, Sydney NSW 2011
+61 2 9250 0000 | info@ptiarchitect.com.au
Not a Not a Registered Architect: Peter Smith (Reg No 50040)
405 NSW 201102

CLIENT:
**NSW HOUSING CORPORATION
PTY LTD**

PROJECT:
**RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD**

DRAWING TITLE:
**LEVELS 33- 35 FLOOR PLAN-
COMMERCIAL OFFICES**

SCALE: 1:200 AT A3 NORTH POINT:


DRAWN BY: VD/JR

CHECKED BY: PJ

PROJECT NO: P709



SSDA	21	A
stage	dwg no	revision

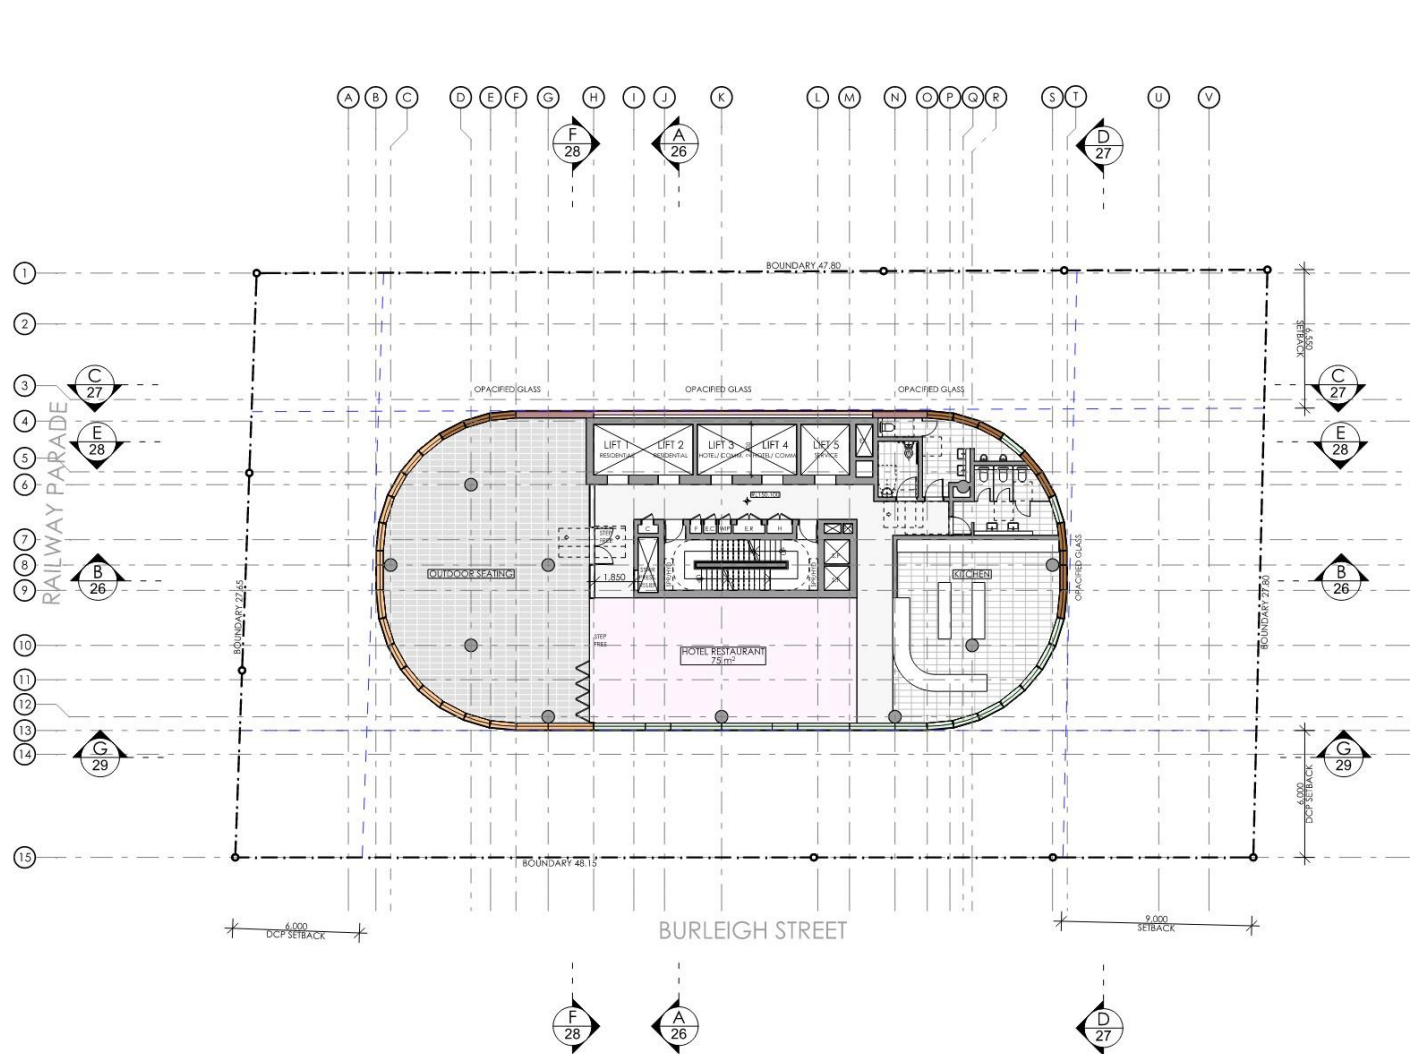

1 HOTEL FACILITIES LEVEL 36
1:200



CURTAIN WALL LEGEND

- TYPE A**
VISION GLASS LOUVRES- FIXED OPEN
AT EXTERNAL SPACES
- TYPE B**
VISION GLASS LOUVRES- OPERABLE
AT INTERNAL SPACES
- TYPE C**
FIXED VISION GLASS
- TYPE D**
FIXED OPACIFIED GLASS
- TYPE E**
FIXED OPACIFIED GLASS OVER
SOLID WALL

SSDA SUBMISSION

A SSDA SUBMISSION VO 13/12/24
REV DESCRIPTION BY DATE



Office Level 2, 181 East St, Sydney NSW 2011
+61 (0)2 9261 8881 | www.ptiarchitecture.com.au
Not a Not a Registered Architect (No. 149160000)
485 901 000 (01/02)

CLIENT
NSW HOUSING CORPORATION
PTY LTD

PROJECT
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD


DRAWING TITLE
LEVEL 36 FLOOR PLAN- HOTEL
FACILITIES

SCALE 1:200 AT A3 NORTH POINT


DRAWN BY: VD/JR
CHECKED BY: PJ
PROJECT NO: P709



SSDA 22 A
stage draw no revision

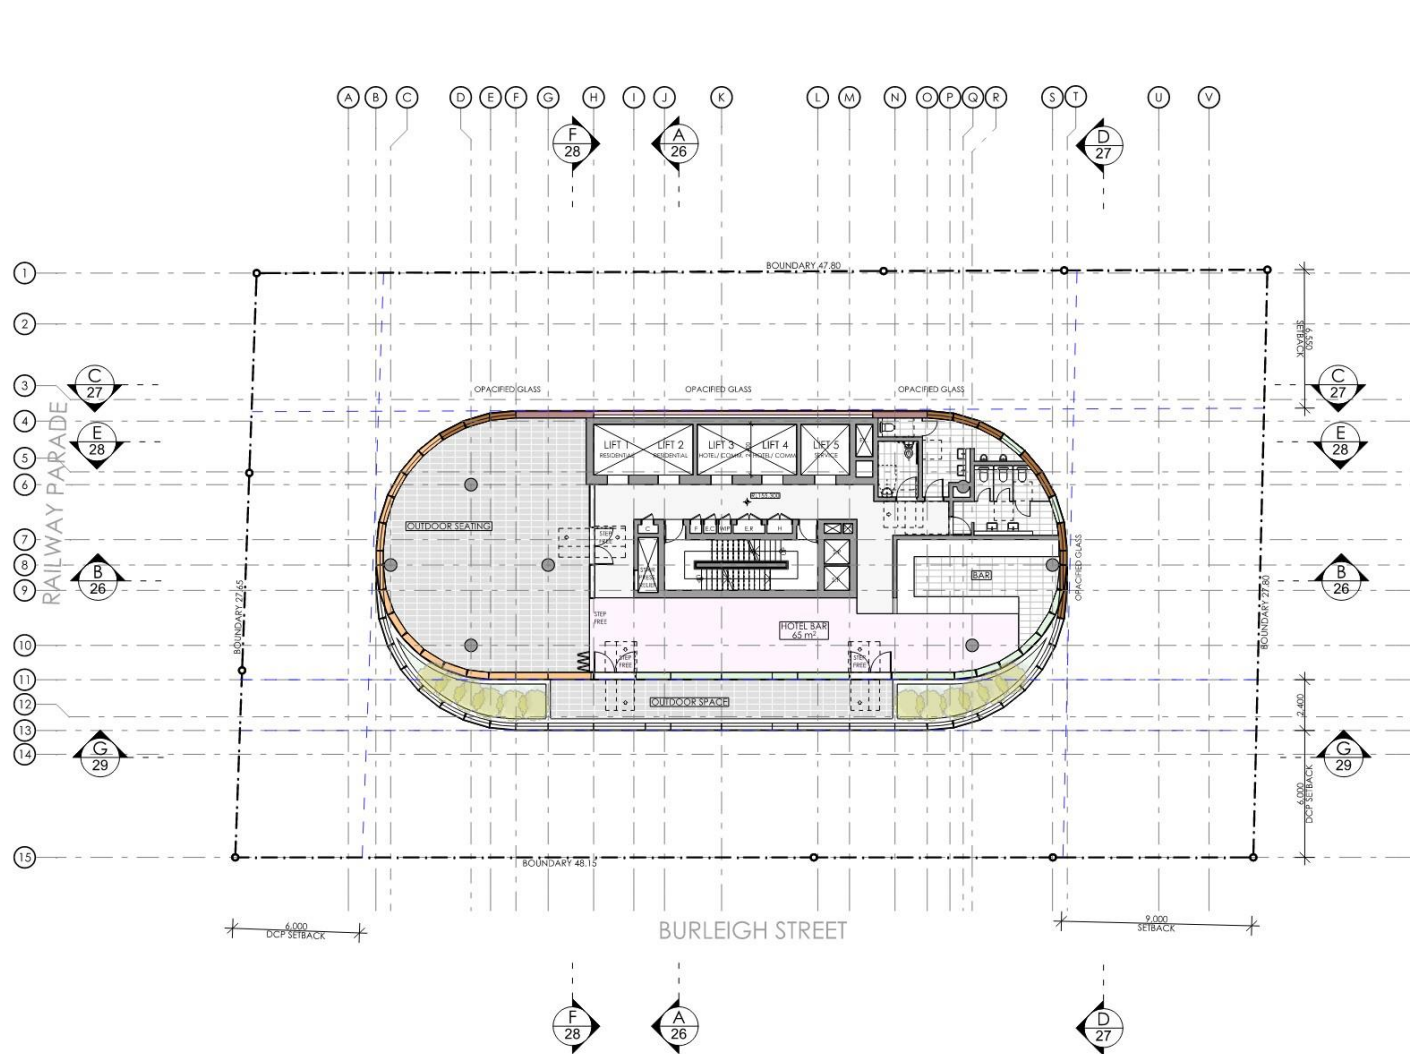

1 HOTEL FACILITIES LEVEL 37
1:200



CURTAIN WALL LEGEND

- TYPE A**
VISION GLASS LOUVRES- FIXED OPEN
AT EXTERNAL SPACES
- TYPE B**
VISION GLASS LOUVRES- OPERABLE
AT INTERNAL SPACES
- TYPE C**
FIXED VISION GLASS
- TYPE D**
FIXED OPACIFIED GLASS
- TYPE E**
FIXED OPACIFIED GLASS OVER
SOLID WALL

SSDA SUBMISSION

A SSDA SUBMISSION VO 13/12/24
REV DESCRIPTION BY DATE



Office Level 2, 88 East St, Sydney NSW 2011
+61 (0)2 9261 8881 | www.ptiarchitecture.com.au
Not a Not a Registered Architect (No Reg No 0000)
485 NSW 2011

CLIENT
NSW HOUSING CORPORATION
PTY LTD

PROJECT
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD

DRAWING TITLE
LEVEL 37 FLOOR PLAN- HOTEL
FACILITIES

SCALE 1:200 AT A3 NORTH POINT

DRAWN BY: VD/JR

CHECKED BY: PJ



PROJECT NO: P709



SSDA 23 A
stage dwg no revision



SSDA 24 A
stage div. no. revision

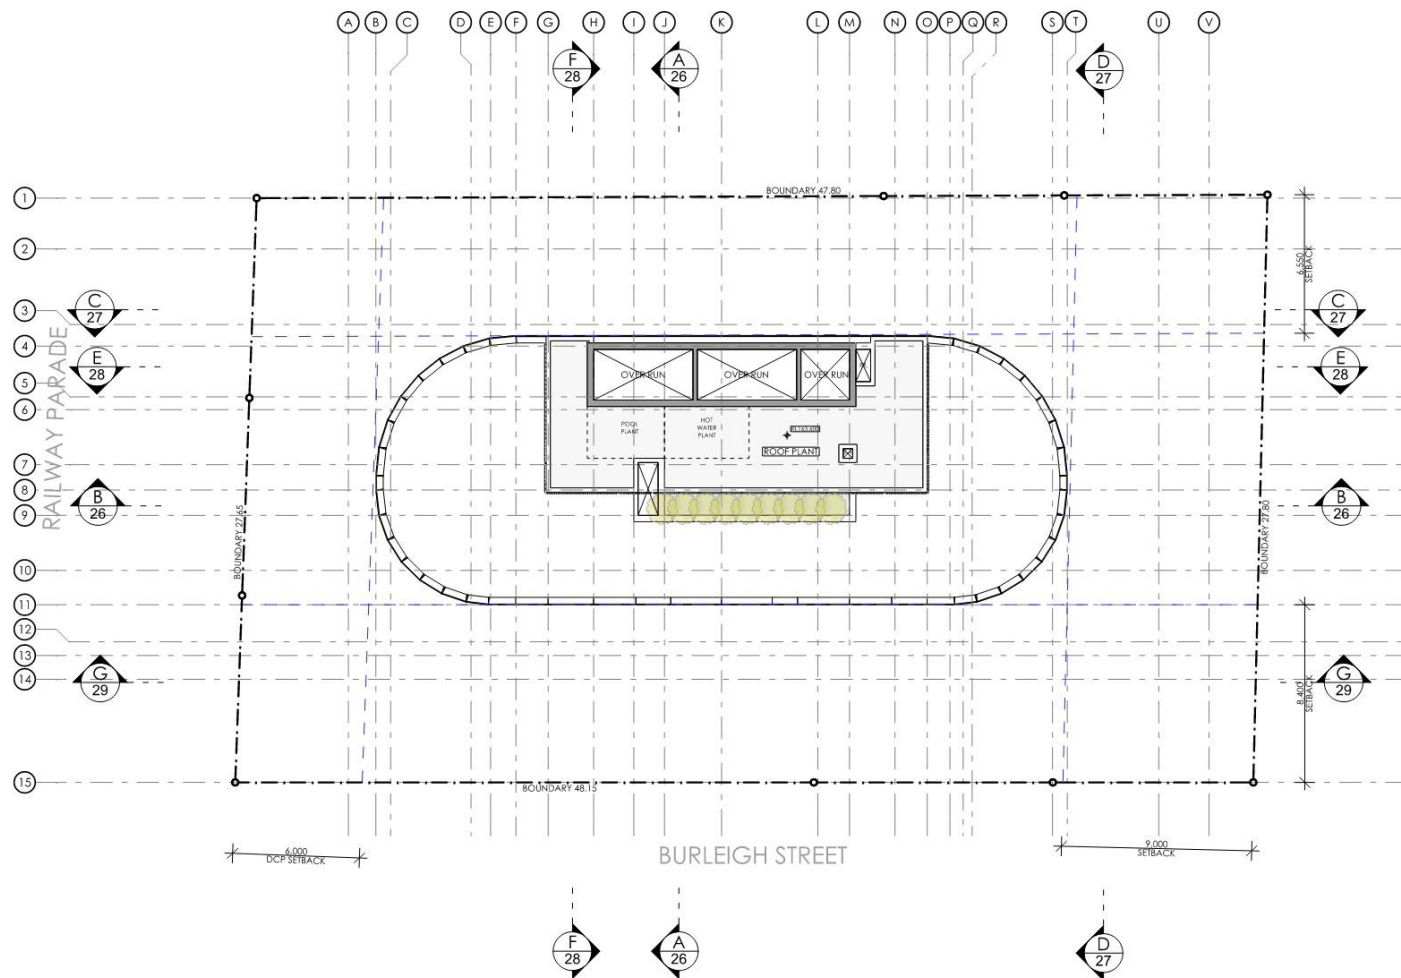

1 ROOF PLANT
1:200

SSDA SUBMISSION

A SSDA SUBMISSION VO 13/12/24
REV DESCRIPTION BY DATE



Office Level 2, 18 East St, Sydney NSW 2011
+61 2 9250 9888 | www.ptiarchitecture.com.au
New South Wales Registered Architect (Licence No 50040)
488 KOLINS ST, SYDNEY



CLIENT
NSW HOUSING CORPORATION
PTY LTD

PROJECT
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD

DRAWING TITLE
ROOF PLAN

SCALE 1:200 AT A3 NORTH POINT
DRAWN BY: VD/JR
CHECKED BY: PJ
PROJECT NO: P709

SSDA 25 A
stage dwg no revision

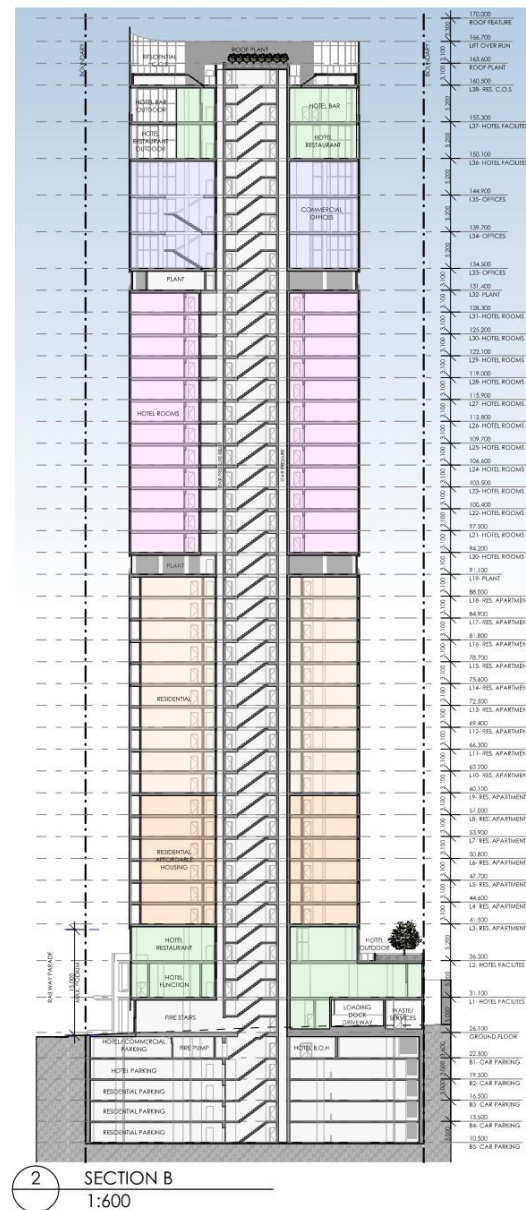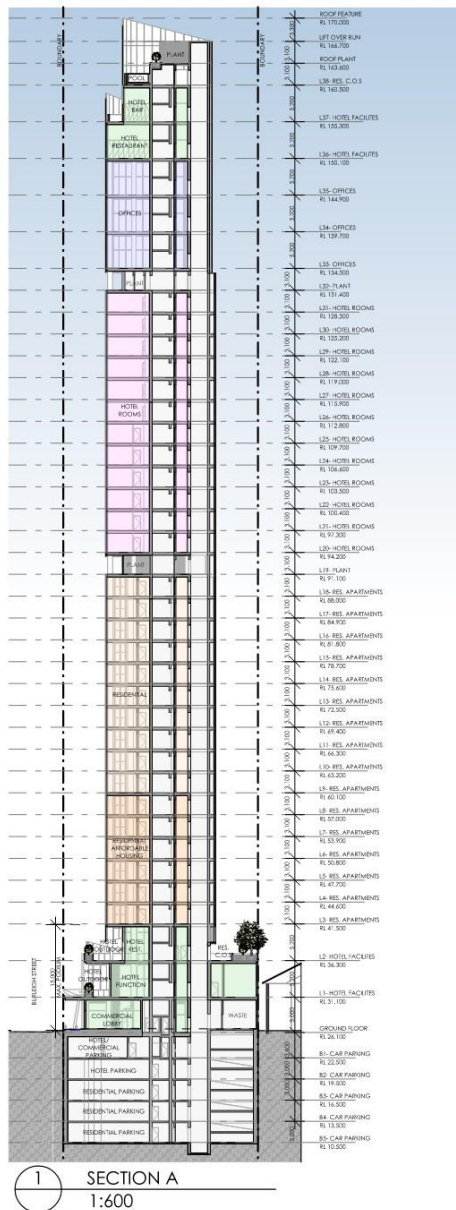

Buteigh St & 20-24 Railway Parade, Burwood; 10_DRAWINGS (PFI)00_STAGE - SK01_RUN.P109_2-4 Buteigh St & 20-24 Railway Pde, Burwood_SK_V2s_DAI_241113.dgn Printed: 13/12/2024

USE LEGEND

	COMMERCIAL OFFICES
	HOTEL ROOM LEVELS
	RESIDENTIAL APARTMENT LEVELS
	HOTEL FACILITY LEVELS
	BACK OF HOUSE/ SERVICES

SSDA SUBMISSION

A	SSDA SUBMISSION	VD	13.12.24
---	-----------------	----	----------

REV	DESCRIPTION	BY	DATE
-----	-------------	----	------



Office: Level 2, 68 Scotch Street, Surry Hills NSW 2010
 • 61 2 9285 0895 | www.gstarchitecture.com.au
 Nominated Registered Architect: Peter Israel (reg no 50594)
 ABN 93 033 011 022

CLIENT :
NSW HOUSING CORPORATION
PTY LTD

PROJECT :
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD

DRAWING TITLE:

SECTIONS A & B

SCALE: 1:600 AT A3 NORTH POINT:


DRAWN BY: VD/IR

CHECKED BY: DL


PROJECT NO. 6300

SSDA 26 A
stage, dwg no, revision



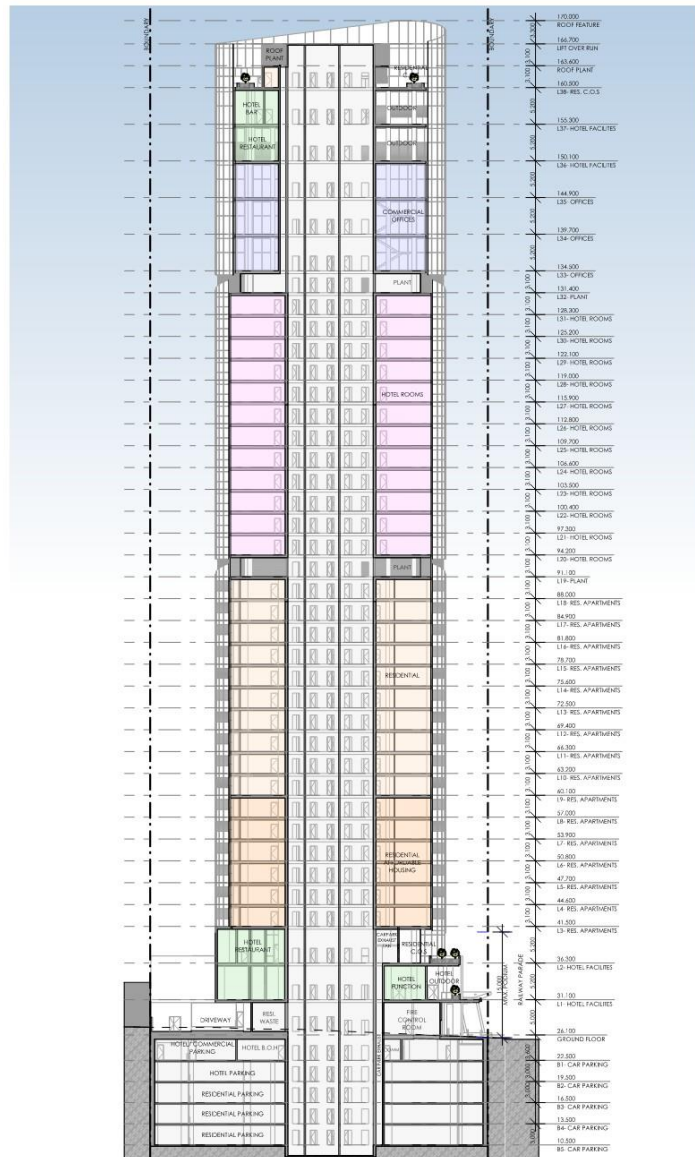

1 SECTION E
1:600

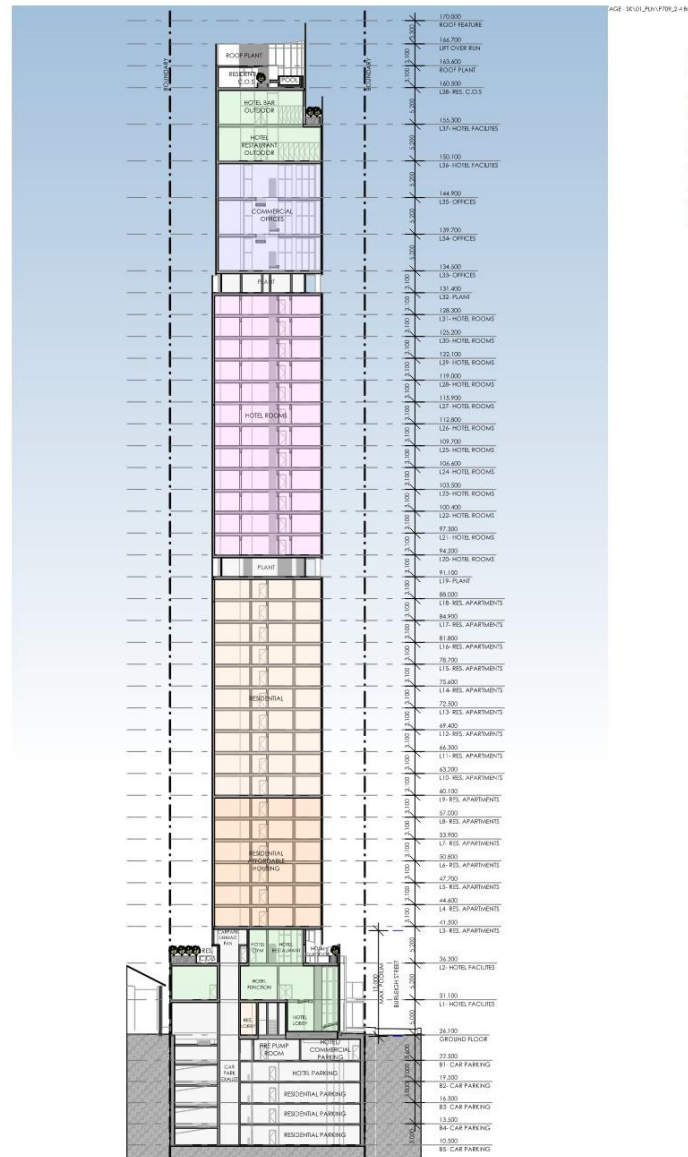

2 SECTION F
1:600

FACE: SEC01_P011_P709_2 - Burleigh St & 20-24 Railway Pde, Burwood_LK_V26_DIA_121112.dwg P:\dwg\13\12\2024

- USE LEGEND**
- COMMERCIAL OFFICES
 - HOTEL ROOM LEVELS
 - RESIDENTIAL APARTMENT LEVELS
 - HOTEL FACILITY LEVELS
 - BACK OF HOUSE/ SERVICES

SSDA SUBMISSION

A SSDA SUBMISSION VO 13.12.24
REV DESCRIPTION BY DATE

pti ARCHITECTURE
Tourism + Residential
Office Level 2, 18 Esplanade, Surry Hills NSW 2011
+61 2 9250 0881 | enquiries@ptiarch.com.au
Not a Not a Registered Architect. Refer to 100000
400 000 000 000


CLIENT
NSW HOUSING CORPORATION
PTY LTD

PROJECT
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD

DRAWING TITLE:
SECTIONS E & F

SCALE: 1:600 AT A3 NORTH POINT
DRAWN BY: VD/JR
CHECKED BY: PJ
PROJECT NO: P709

SSDA stage 28 A
revision





SSDA SUBMISSION

A	SSDA SUBMISSION	VD	13.12.24
REV	DESCRIPTION	BY	DATE



SCALE: 1:600 AT A3 NORTH POINT:
DRAWN BY: VD/JR
CHECKED BY: PI
PROJECT NO: P709



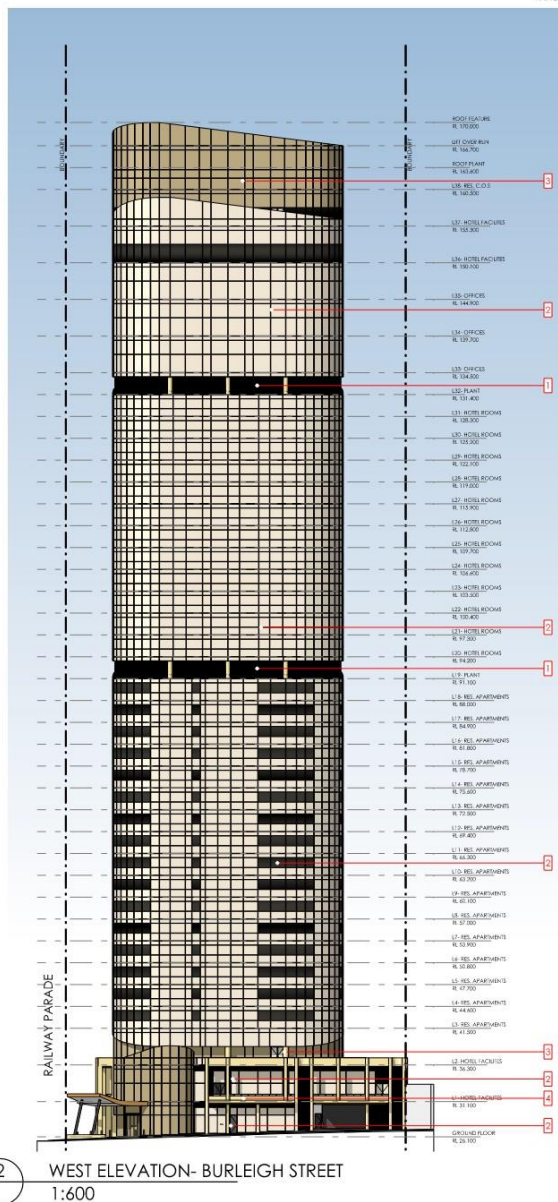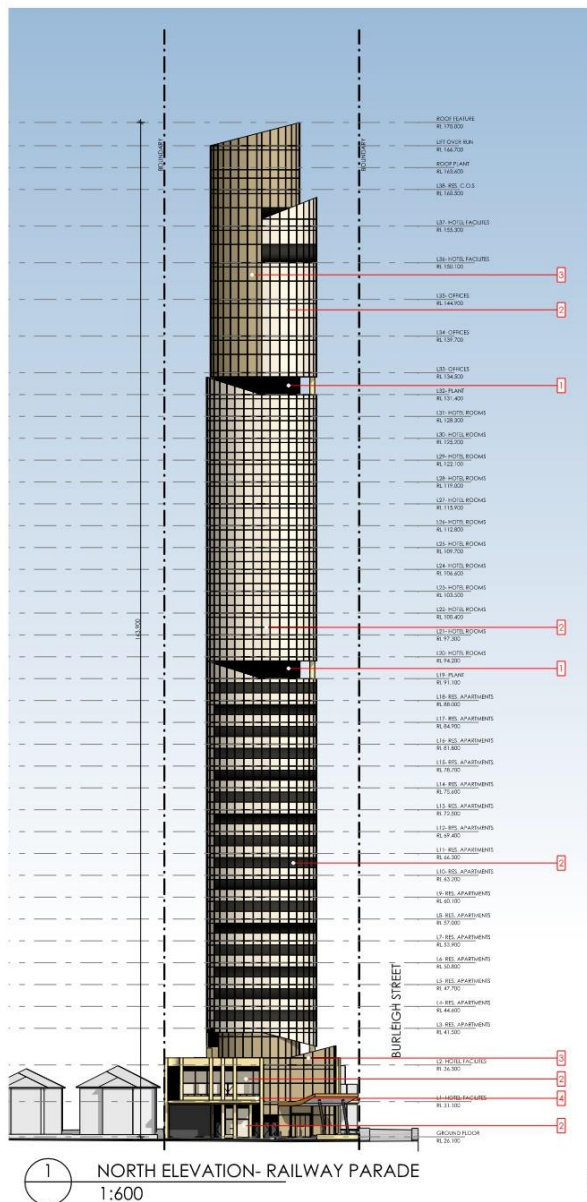

SSDA SUBMISSION

A	SSDA SUBMISSION	VD	13/12/24
REV	DESCRIPTION	BY	DATE



Office Level 2, 18 Esplanade, Surry Hills NSW 2011
 +61 2 9250 0000 | info@ptiarchitect.com.au
 Not a Registered Architect (Reg No 5004)
 ABN 60 605 271 022

CLIENT
 NSW HOUSING CORPORATION
 PTY LTD

PROJECT
 RESIDENTIAL/ AFFORDABLE
 HOUSING, HOTEL &
 COMMERCIAL OFFICES
 2-4 BURLEIGH ST & 20-24
 RAILWAY PDE, BURWOOD

DRAWING TITLE
 ELEVATIONS- NORTH & WEST

SCALE
 1:600 AT A3 NORTH POINT

DRAWN BY
 VD/JR

CHECKED BY
 PJ

PROJECT NO
 P709

SSDA
 stage 30 A
 revision


1. POWDER COATED ALUMINIUM
 DOOR AND WINDOW FRAME/
 LOUVRES, COLOUR: BLACK



2. TINTED GLASS
 LIGHT BRONZE





3. TINTED GLASS
 DARK BRONZE



4. SANDSTONE CLADDING



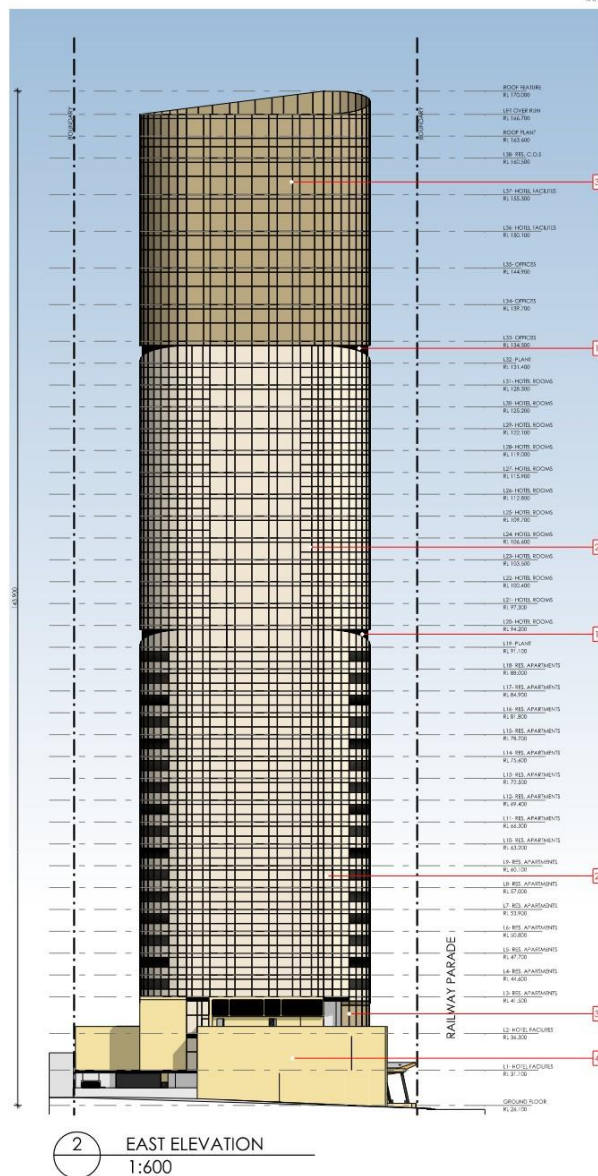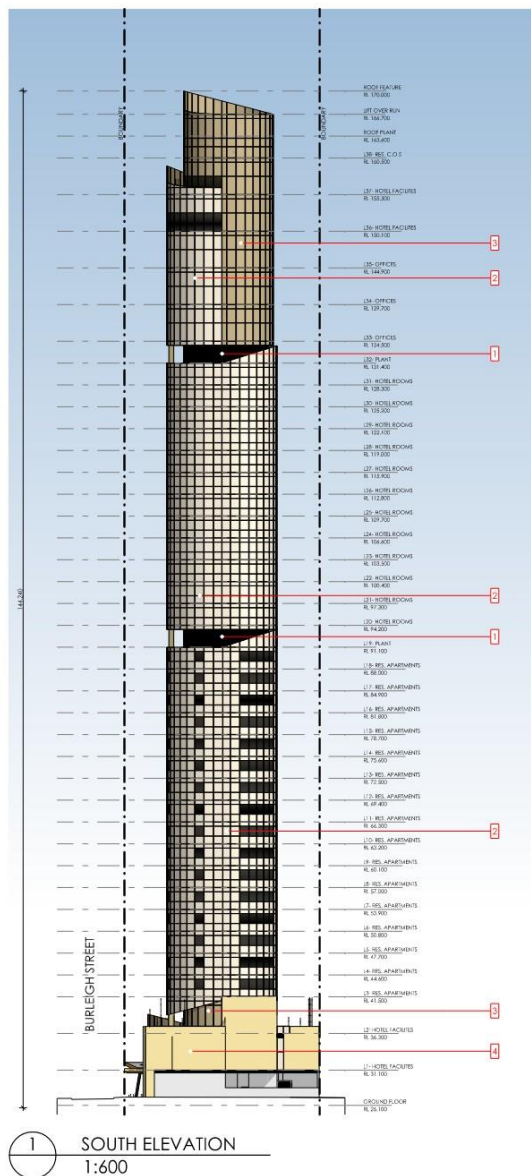

SSDA SUBMISSION

A	SSDA SUBMISSION	VD	13.12.24
REV	DESCRIPTION	BY	DATE



Office Level 2, 18 Esplanade Street, Surry Hills NSW 2010
+61 2 9250 0881 | www.ptiarchitect.com.au
Not a Notified Registered Architect (Reg No 5004)
4051 901 000 271 002

CLIENT:
NSW HOUSING CORPORATION
PTY LTD

PROJECT:
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURREIGH ST & 20-24
RAILWAY PDE, BURWOOD

DRAWING TITLE:
ELEVATIONS- SOUTH & EAST


SCALE: 1:600 AT A3 NORTH POINT

DRAWN BY: VD/JR

CHECKED BY: PJ

PROJECT NO: P709

SSDA	31	A
stage	dwg no	revision

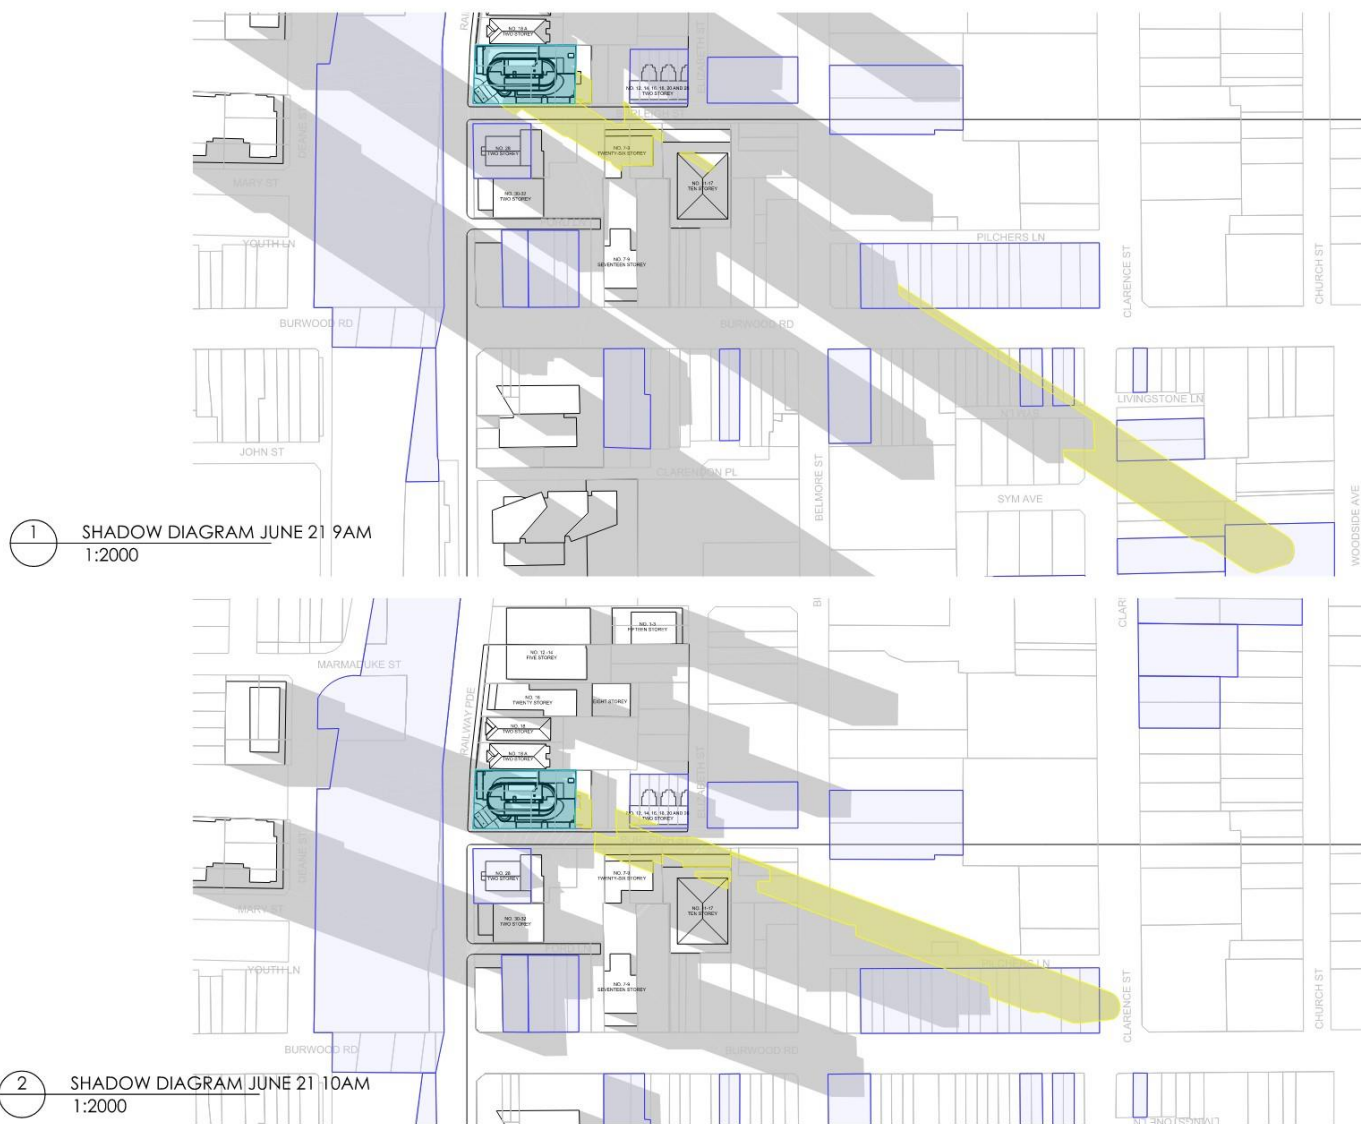

SHADOW IMPACT LEGEND

- EXISTING SHADOWS
- ADDITIONAL SHADOW CAST BY PROPOSED BUILDING
- SUBJECT SITE
- HERITAGE ITEM

SSDA SUBMISSION

A	SSDA SUBMISSION	VD	13/12/24
REV	DESCRIPTION	BY	DATE



Office Level 2, 18 East St, Sydney NSW 2011
+61 2 9250 0881 | www.ptiarchitecture.com.au
Not a Not a Registered Architect (No Reg No 5004)
488 90 000 271 022

CLIENT:
NSW HOUSING CORPORATION
PTY LTD

PROJECT:
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD


DRAWING TITLE:
SHADOW DIAGRAMS- JUNE 21
9AM-10AM

SCALE: 1:2000 AT A3 NORTH POINT:

DRAWN BY: VD/JR
CHECKED BY: PJ
PROJECT NO: P709




SSDA 32 A
stage dwg no revision

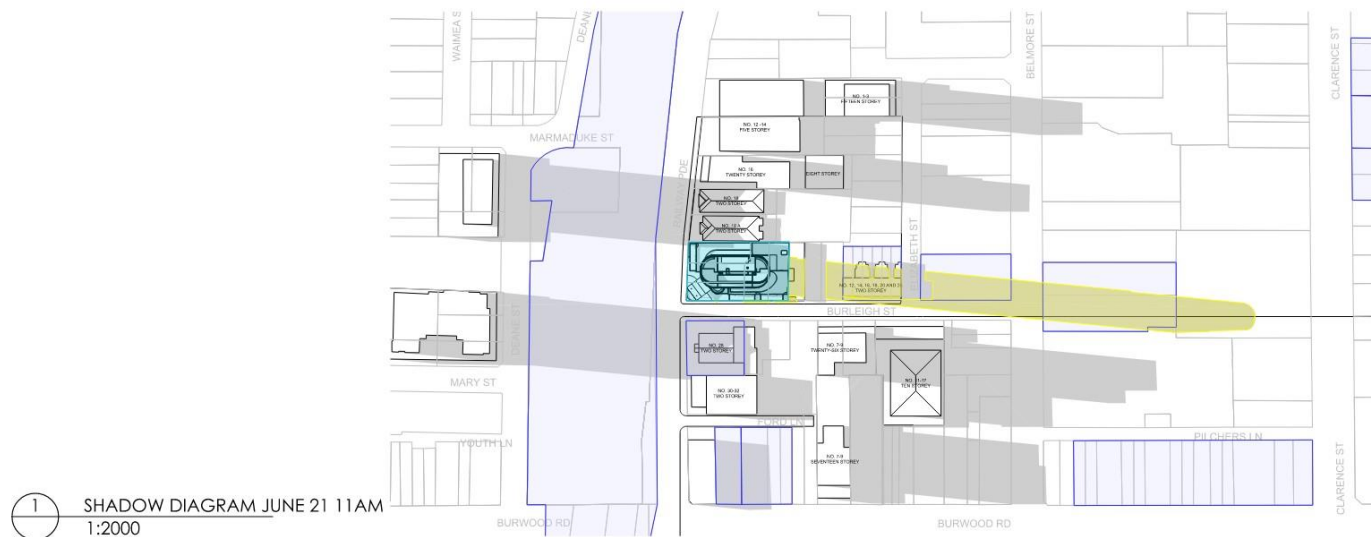

- SHADOW IMPACT LEGEND**
- EXISTING SHADOWS
 - ADDITIONAL SHADOW CAST BY PROPOSED BUILDING
 - SUBJECT SITE
 - HERITAGE ITEM

SSDA SUBMISSION

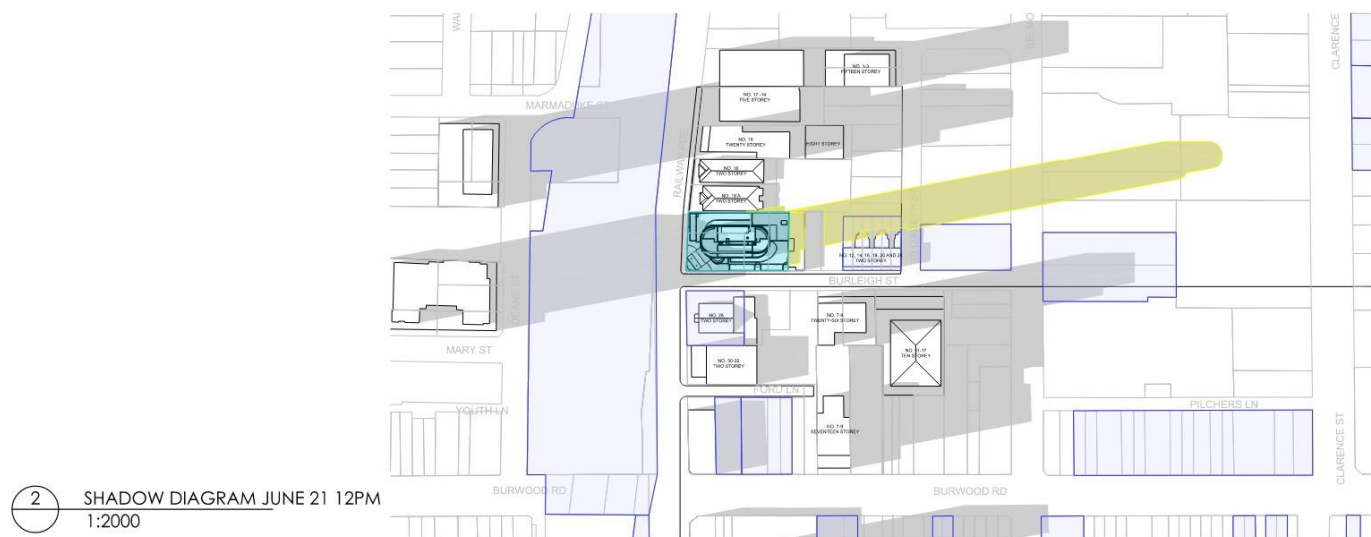

A	SSDA SUBMISSION	VD	13/12/24
REV	DESCRIPTION	BY	DATE



Office Level 2, 18 East Street, Surry Hills NSW 2010
+61 2 9250 0861 | enquiries@ptiarch.com.au
Not a Not a Registered Architect (No Reg No 50040)
485 KOLINSKI ST


CLIENT:
NSW HOUSING CORPORATION
PTY LTD

PROJECT:
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD


DRAWING FILE:
SHADOW DIAGRAMS- JUNE 21
11AM-12PM

SCALE	1:2000 AT A3	NORTH POINT
DRAWN BY	VD/JR	
CHECKED BY	PI	
PROJECT NO	P709	


SSDA 33 A
stage dwg no revision

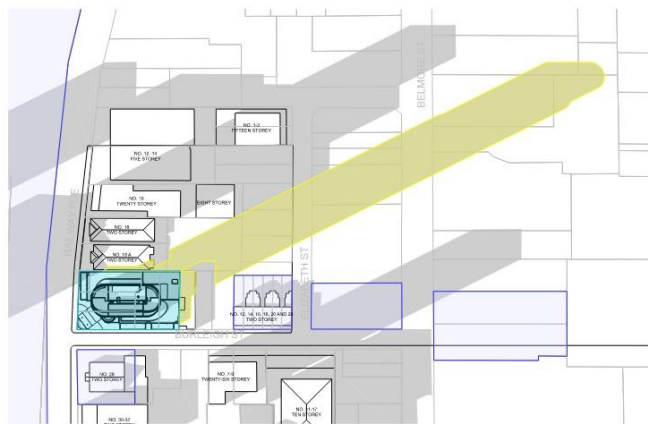

1 SHADOW DIAGRAM JUNE 21 1PM
1:2000

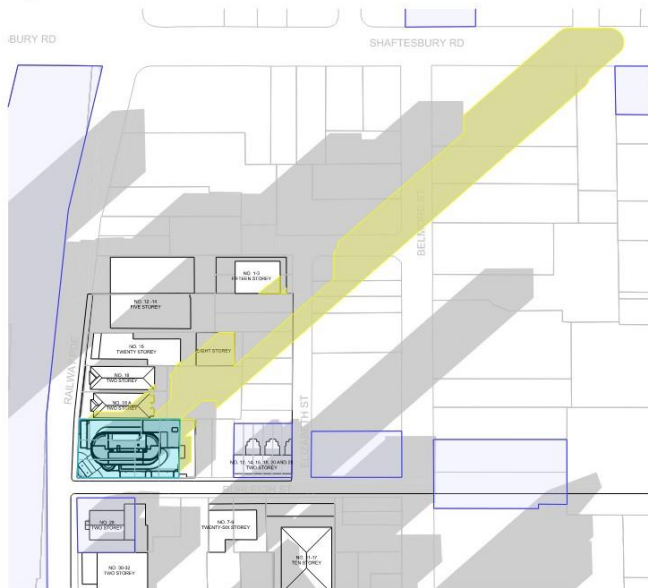

2 SHADOW DIAGRAM JUNE 21 2PM
1:2000

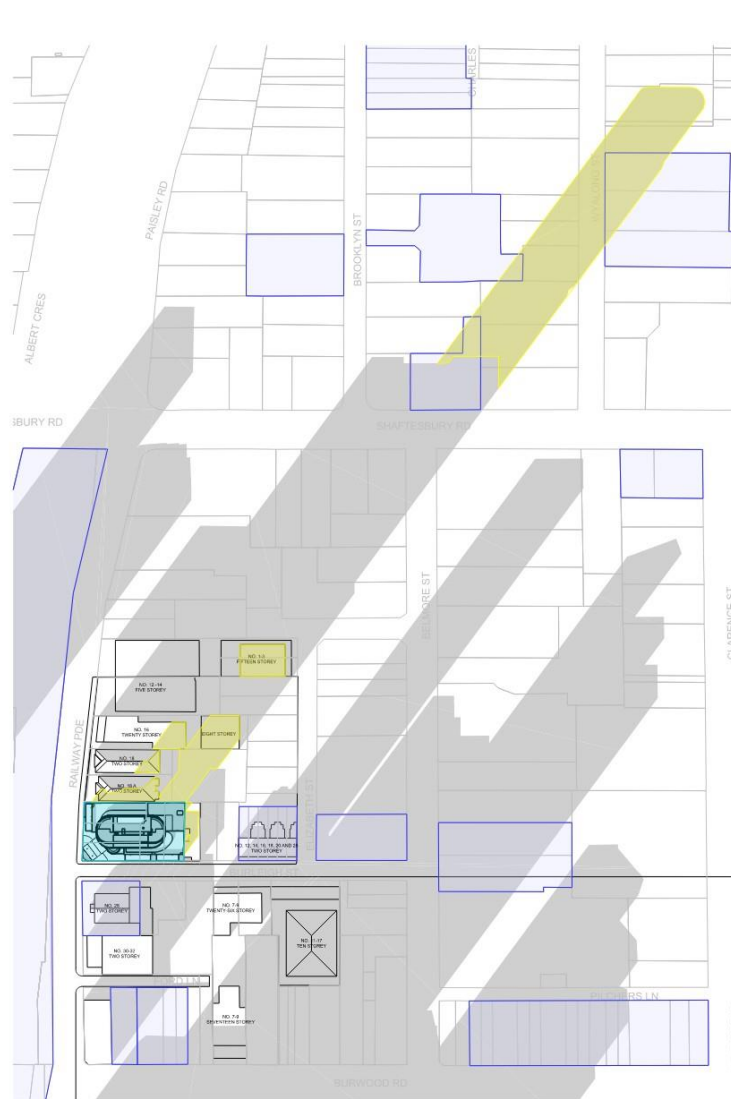

3 SHADOW DIAGRAM JUNE 21 3PM
1:2000

50m 100m
1:2000

SHADOW IMPACT LEGEND

- EXISTING SHADOWS
- ADDITIONAL SHADOW CAST BY PROPOSED BUILDING
- SUBJECT SITE
- HERITAGE ITEM

SSDA SUBMISSION

REV	DESCRIPTION	BY	DATE
A	SSDA SUBMISSION	VD	13/12/24

pti ARCHITECTURE
Tourism + Residential

Office Level 2, 18 East St, Surry Hills NSW 2010
+61 (0)2 9261 8866 | hannah@ptiarchitect.com.au
Not a Notified Registered Architect (Pty Ltd No 50046)
ABN 92 616 271 022

CLIENT:
NSW HOUSING CORPORATION
PTY LTD

PROJECT:
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURRELL ST & 20-24
RAILWAY PDE, BURWOOD


DRAWING FILE:
SHADOW DIAGRAMS- JUNE 21
1PM-3PM

SCALE: 1:2000 AT A3 **NORTH POINT:**

DRAWN BY: VD/JR **CHECKED BY:** PJ

PROJECT NO: P709


SSDA **34** **A**
stage draw no revision

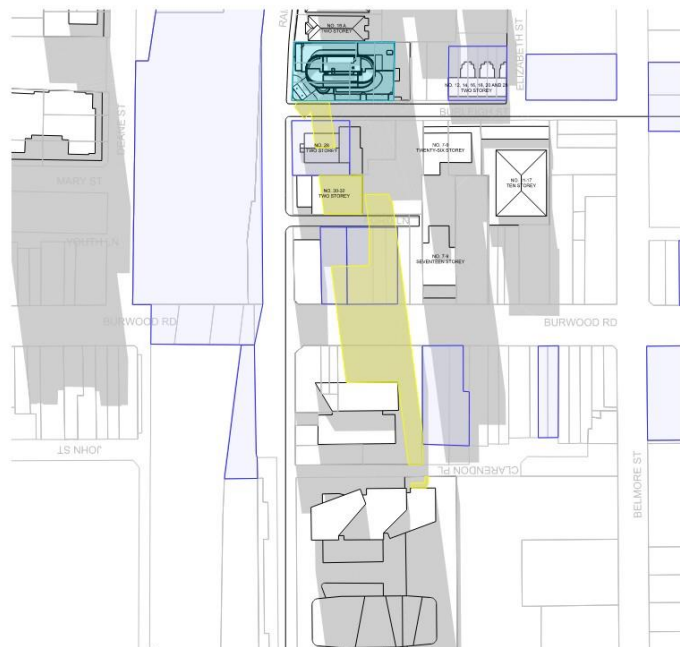

1 SHADOW DIAGRAM JAN 21 9AM
1:2000



2 SHADOW DIAGRAM FEB 21 9AM
1:2000



SHADOW IMPACT LEGEND

- EXISTING SHADOWS
- ADDITIONAL SHADOW CAST BY PROPOSED BUILDING
- SUBJECT SITE
- HERITAGE ITEM

SSDA SUBMISSION

A	SSDA SUBMISSION	VD	13/12/24
REV	DESCRIPTION	BY	DATE



Office Level 2, 88 East Street, Surry Hills NSW 2010
+61 2 9250 0860 | www.ptiarchitect.com.au
Not a Not a Registered Architect (Reg No 50040)
405 90 000 271 022

CLIENT:
NSW HOUSING CORPORATION
PTY LTD

PROJECT:
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD

DRAWING TITLE:
SHADOW DIAGRAMS- JAN 21
9AM & FEB 21 9AM

SCALE: 1:2000 AT A3 NORTH POINT:


DRAWN BY: VD/JR


CHECKED BY: PJ

PROJECT NO: P709



SSDA 35 A
stage dwg no revision

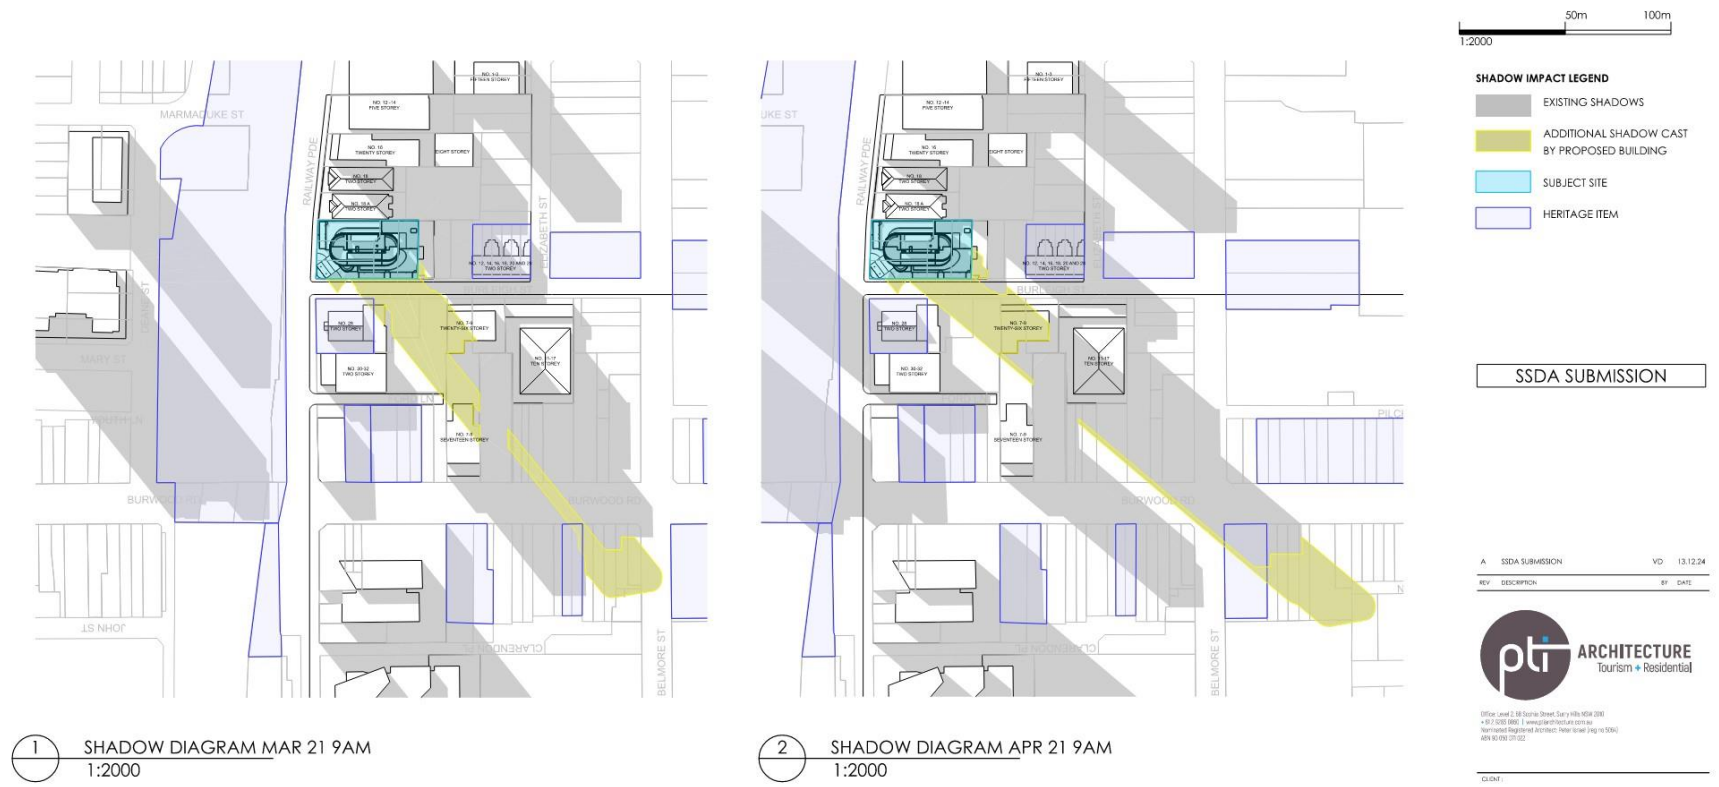


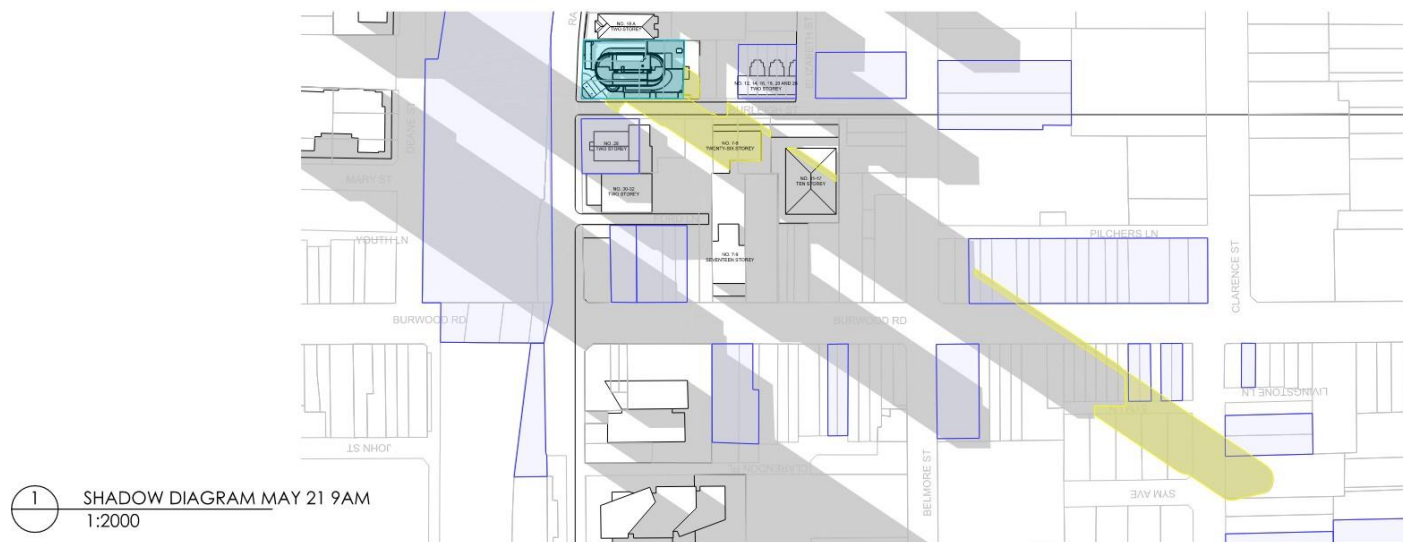

SHADOW IMPACT LEGEND

- EXISTING SHADOWS
- ADDITIONAL SHADOW CAST BY PROPOSED BUILDING
- SUBJECT SITE
- HERITAGE ITEM

SSDA SUBMISSION

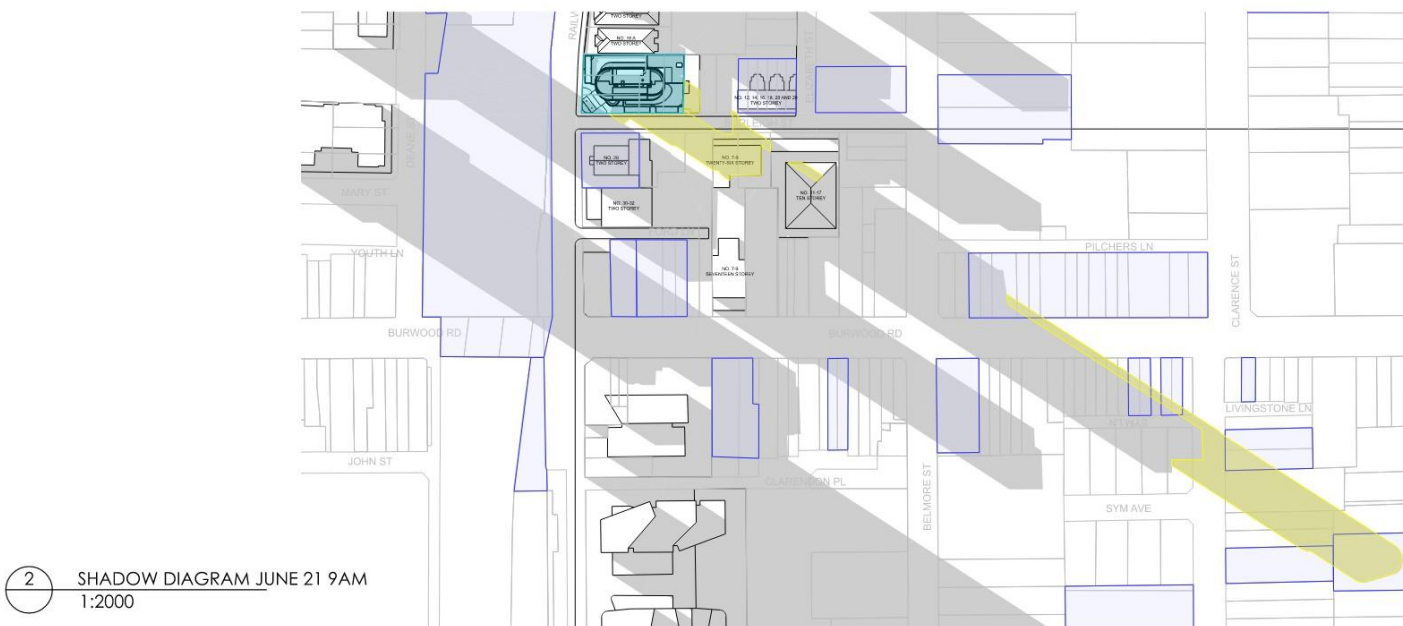

A	SSDA SUBMISSION	VD	13/12/24
REV	DESCRIPTION	BY	DATE



Office Level 2, 88 East St, Sydney NSW 2011
+61 (0)2 9251 8881 | www.ptiarchitecture.com.au
Not a registered architect. Paper scale 1/4000
400 80 000 271 022

CLIENT
NSW HOUSING CORPORATION
PTY LTD

PROJECT
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD

DRAWING TITLE
SHADOW DIAGRAMS- MAY 21
9AM & JUN 21 9AM

SCALE 1:2000 AT A3 NORTH POINT


DRAWN BY VD/JR

CHECKED BY PJ

PROJECT NO. P709

SSDA 37 A
stage dwg no revision

1 SHADOW DIAGRAM JUL 21 9AM
1:2000

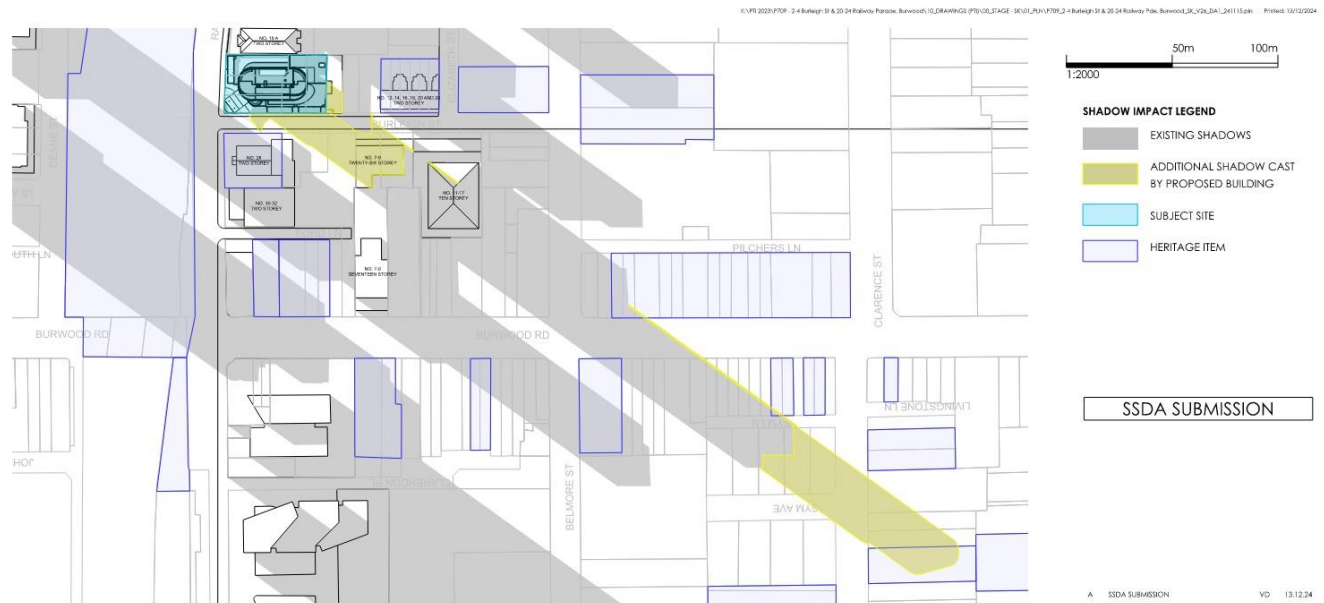

2 SHADOW DIAGRAM AUG 21 9AM
1:2000





1 SHADOW DIAGRAM SEP 21 9AM
1:2000



2 SHADOW DIAGRAM OCT 21 9AM
1:2000



SHADOW IMPACT LEGEND

- EXISTING SHADOWS
- ADDITIONAL SHADOW CAST BY PROPOSED BUILDING
- SUBJECT SITE
- HERITAGE ITEM

SSDA SUBMISSION

A	SSDA SUBMISSION	VD	13.12.24
REV	DESCRIPTION	BY	DATE



Office Level 2, 180 East Street, Surry Hills NSW 2010
+61 2 9250 0000 | www.ptiarchitecture.com.au
Not a Not a Registered Architect (P709) (P709)
400 000 000 000

CLIENT:
NSW HOUSING CORPORATION
PTY LTD

PROJECT:
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD

DRAWING TITLE:
SHADOW DIAGRAMS- SEP 21
9AM & OCT 21 9AM

SCALE: 1:2000 AT A3 NORTH POINT:

DRAWN BY: VD/JR

CHECKED BY: PJ


PROJECT NO: P709



SSDA 39 A
stage dwg no revision



1 SHADOW DIAGRAM NOV 21 9AM
1:2000

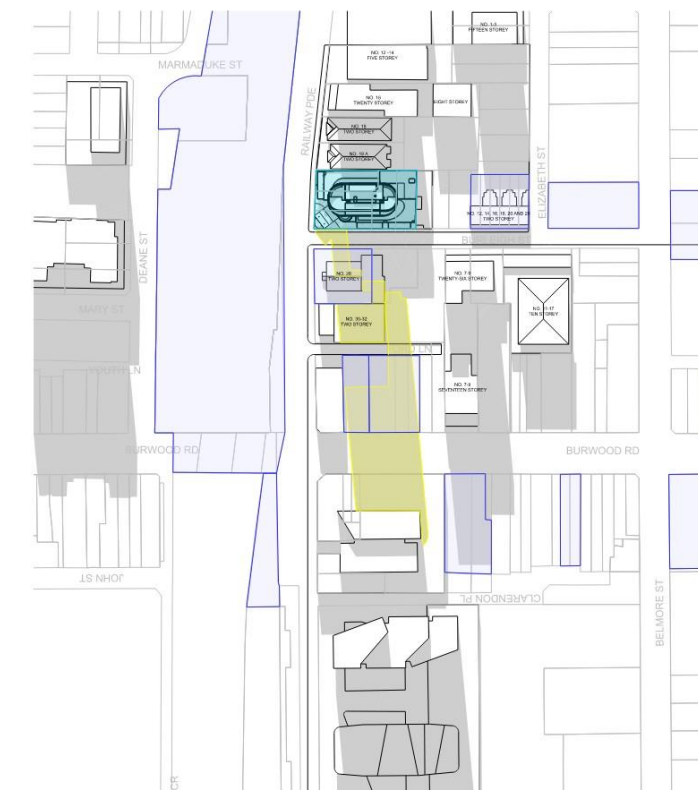

2 SHADOW DIAGRAM DEC 21 9AM
1:2000



SHADOW IMPACT LEGEND

- EXISTING SHADOWS
- ADDITIONAL SHADOW CAST BY PROPOSED BUILDING
- SUBJECT SITE
- HERITAGE ITEM

SSDA SUBMISSION

A	SSDA SUBMISSION	VD	13/12/24
REV	DESCRIPTION	BY	DATE



Office Level 2, 88 East St, Sydney NSW 2000
+61 2 9250 0888 | enquiries@ptiarch.com.au
Not a Not a Registered Architect. Paper Scale (A3) 10/10/00
40% 10/10/00 10/10/00



CLIENT
NSW HOUSING CORPORATION
PTY LTD

PROJECT
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD

DRAWING TITLE
SHADOW DIAGRAMS- NOV 21
9AM DEC 21 9AM

SCALE	1:2000 AT A3	NORTH POINT
DRAWN BY	VD/JR	
CHECKED BY	PI	
PROJECT NO.	P709	

SSDA 40 A
stage dwg no revision

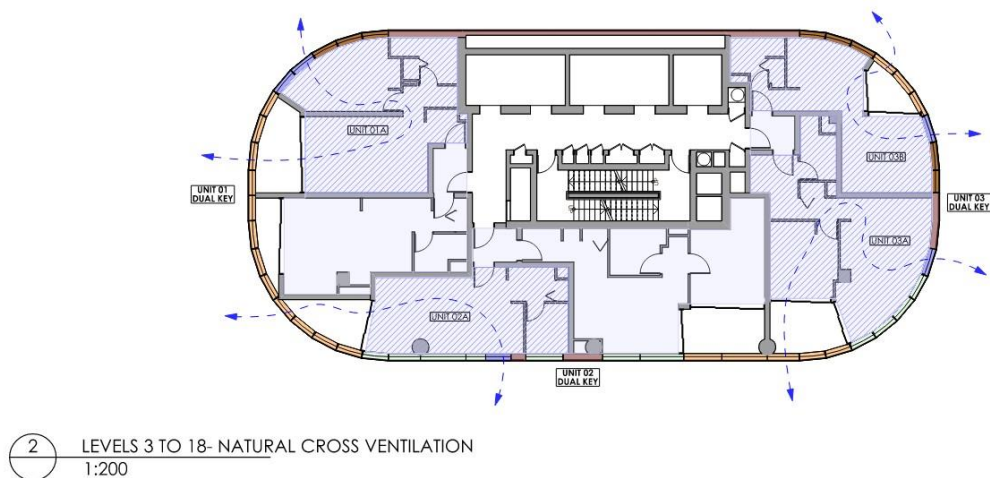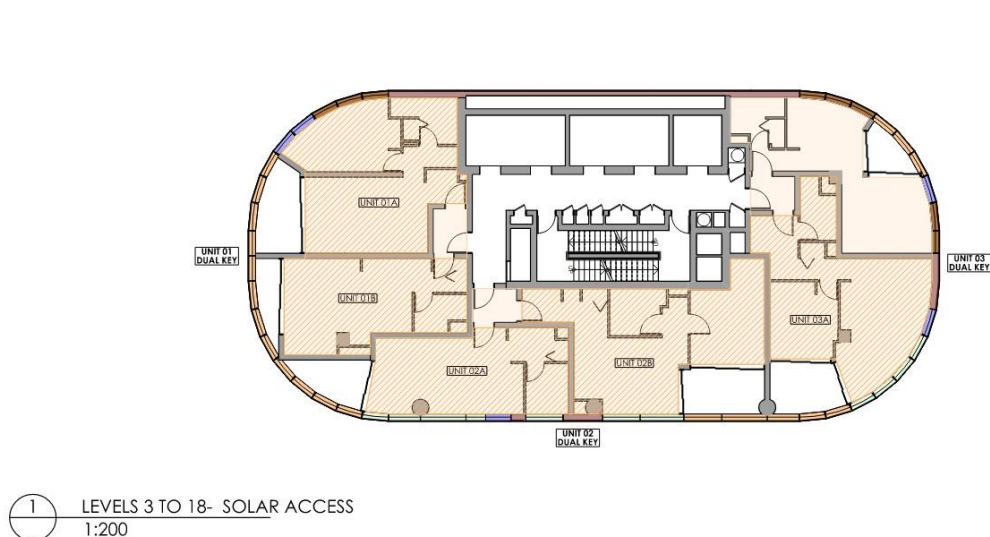

SOLAR ACCESS & CROSS VENTILATION LEGEND


- DUAL KEY UNITS CAPABLE OF ACHIEVING 3 HOURS SOLAR ACCESS
- INDIVIDUAL KEY UNITS CAPABLE OF ACHIEVING 3 HOURS SOLAR ACCESS
- DUAL KEY UNITS CAPABLE OF ACHIEVING NATURAL CROSS VENTILATION
- INDIVIDUAL KEY UNITS CAPABLE OF ACHIEVING NATURAL CROSS VENTILATION

SOLAR ACCESS (48 x DUAL KEY UNITS)
AFFORDABLE HOUSING (LEVELS 3 TO 8) - 18/18 (100%)
NON-AFFORDABLE HOUSING (LEVELS 9 TO 18) - 30/30 (100%)

NATURAL CROSS VENTILATION (48 x DUAL KEY UNITS)
AFFORDABLE HOUSING (LEVELS 3 TO 8) - 18/18 (100%)
NON-AFFORDABLE HOUSING (LEVELS 9 TO 18) - 30/30 (100%)

SOLAR ACCESS (96 x INDIVIDUAL KEY UNITS)
AFFORDABLE HOUSING (LEVELS 3 TO 8) - 30/36 (83%)
NON-AFFORDABLE HOUSING (LEVELS 9 TO 18) - 50/60 (83%)

NATURAL CROSS VENTILATION (96 x INDIVIDUAL KEY UNITS)
AFFORDABLE HOUSING (LEVELS 3 TO 8) - 24/36 (67%)
NON-AFFORDABLE HOUSING (LEVELS 9 TO 18) - 40/60 (67%)



CURTAIN WALL LEGEND

- TYPE A**
VISION GLASS LOUVRES- FIXED OPEN AT EXTERNAL SPACES
- TYPE B**
VISION GLASS LOUVRES- OPERABLE AT INTERNAL SPACES
- TYPE C**
FIXED VISION GLASS
- TYPE D**
FIXED OPACIFIED GLASS
- TYPE E**
FIXED OPACIFIED GLASS OVER SOLID WALL

SSDA SUBMISSION

A	SSDA SUBMISSION	VD	13/12/24
REV	DESCRIPTION	BY	DATE



Office Level 2, 18 East Street, Surry Hills NSW 2010
+61 2 9250 0880 | enquiries@ptiarchitect.com.au
Not a Notified Registered Architect (No. 149160000)
4054 901 000 271 022

CLIENT
NSW HOUSING CORPORATION
PTY LTD

PROJECT
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD

DRAWING TITLE
SOLAR ACCESS AND NATURAL
CROSS VENTILATION



SCALE 1:200 AT A3 NORTH POINT

DRAWN BY	VD/JR	
CHECKED BY	PI	
PROJECT NO.	P709	
DATE		

SSDA 41 A
stage dwg no revision


ADG MINIMUM AREAS

3M X 3M IN BEDROOM
3.6M X 3.6M IN LIVING ROOM
0.9M X 1.2M IN LHA SILVER LEVEL BATHROOM
2M X 2M IN BALCONY
1M X 1M IN BALCONY

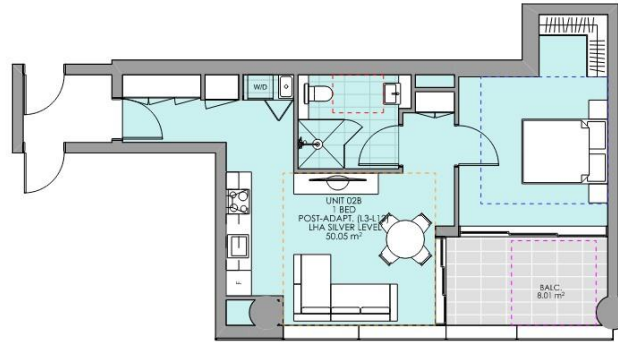


SSDA SUBMISSION

1 PRE-ADAPTABLE LAYOUT
1:100

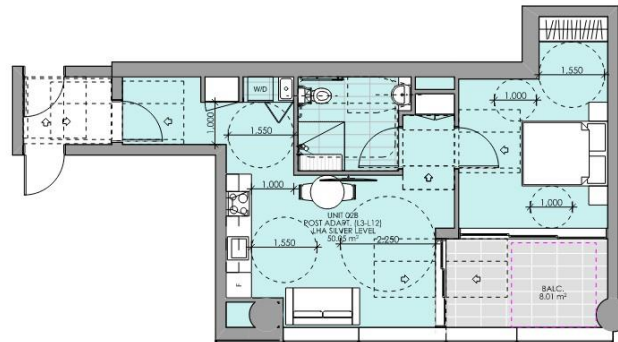

2 POST-ADAPTABLE LAYOUT
1:100

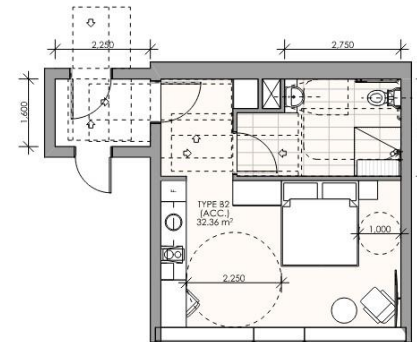

3 ACCESSIBLE HOTEL ROOM
1:100

A	SSDA SUBMISSION	VD	13/12/24
REV	DESCRIPTION	BY	DATE



Office Level 2, 88 Easton Street, Surry Hills NSW 2010
+61 2 9250 9888 | enquiries@ptiarch.com.au
Not a Registered Architect. Peter Scuse (Reg No 50045)
40% NCD (201/22)


CLIENT
NSW HOUSING CORPORATION
PTY LTD


PROJECT
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD

DRAWING TITLE
ACCESSIBLE LAYOUTS


SCALE	1:100 AT A3	NORTH POINT
DRAWN BY	VD/JR	
CHECKED BY	PI	
PROJECT NO.	P709	

SSDA	42	A
stage	dwg no.	revision

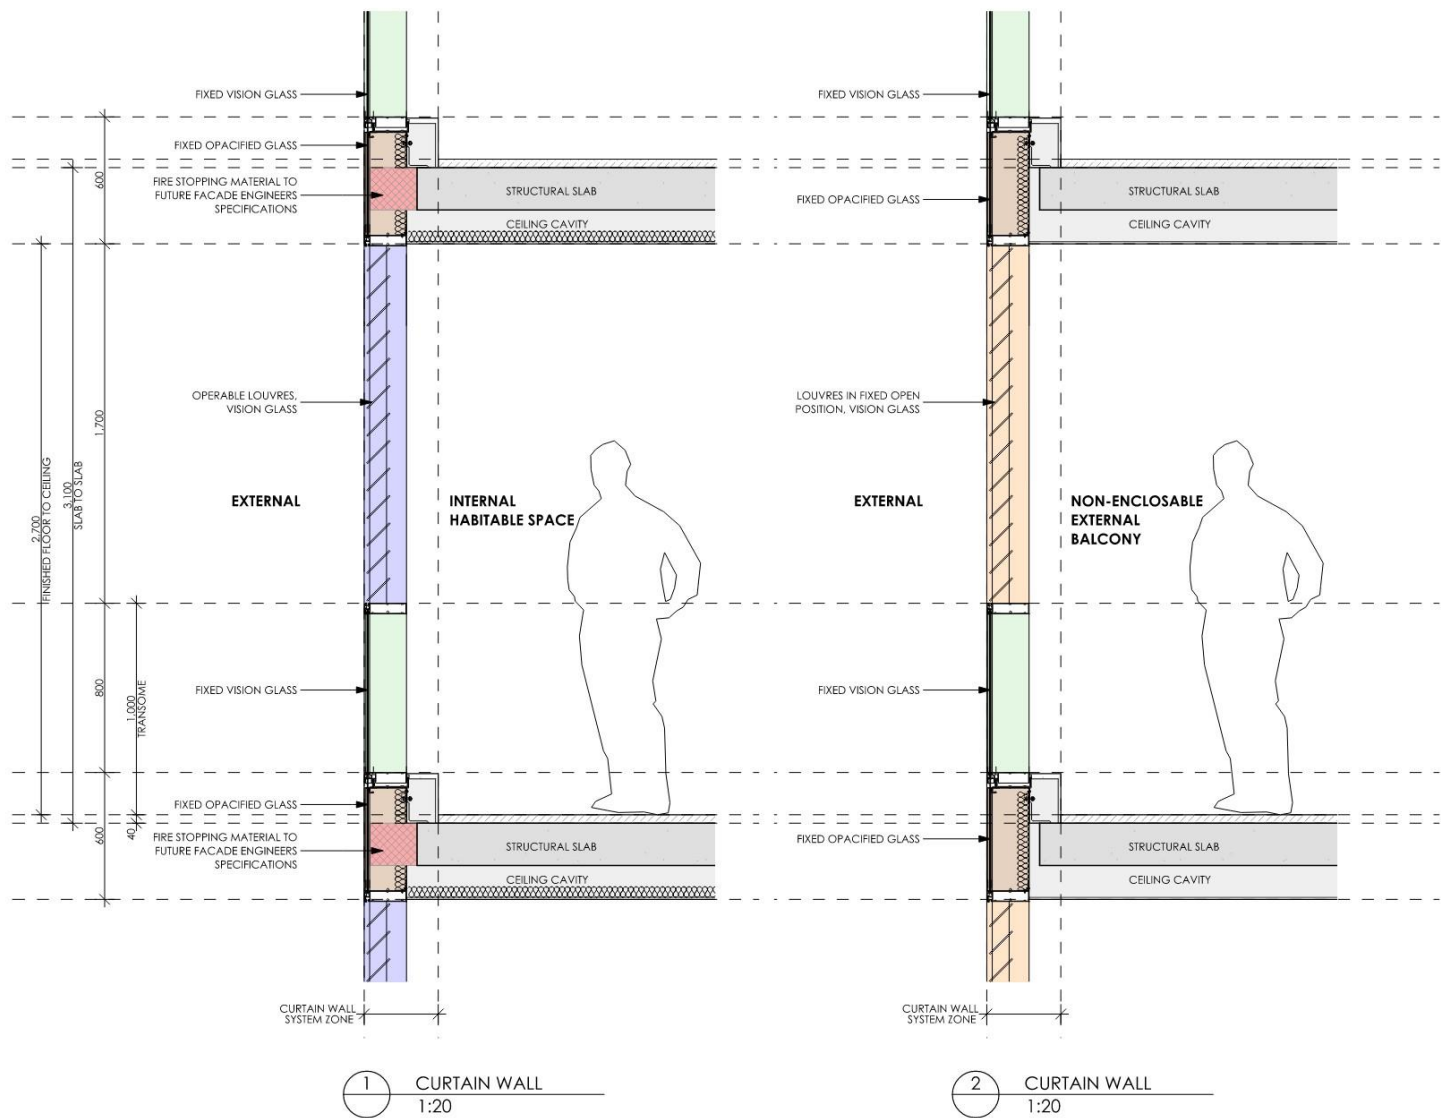

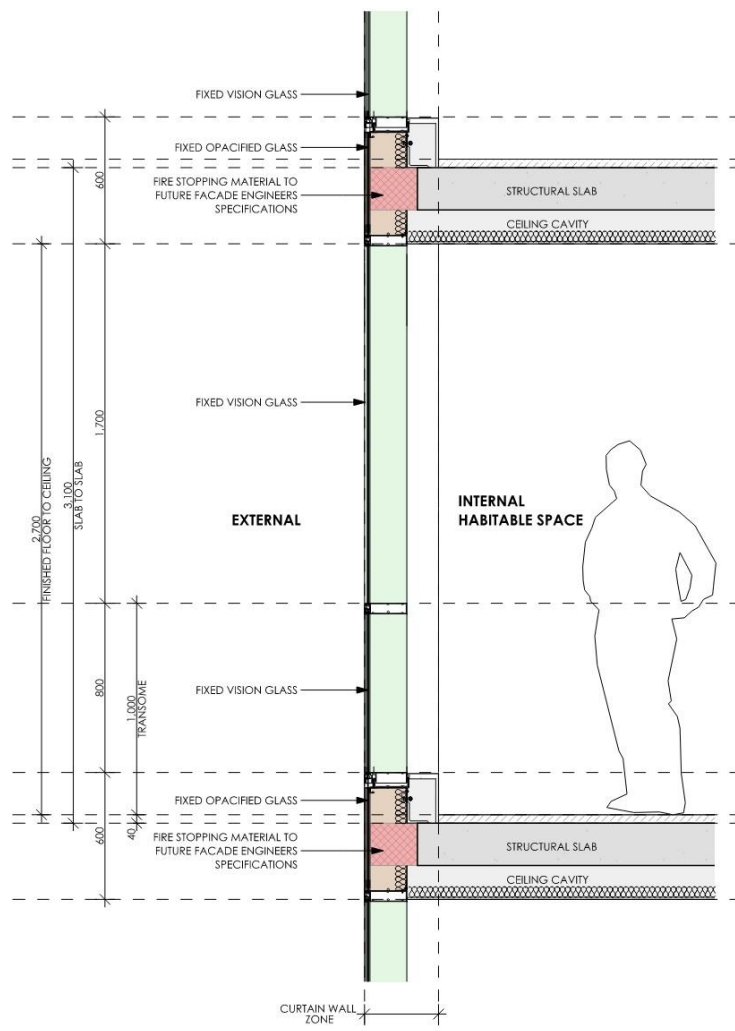

1 CURTAIN WALL
1:20

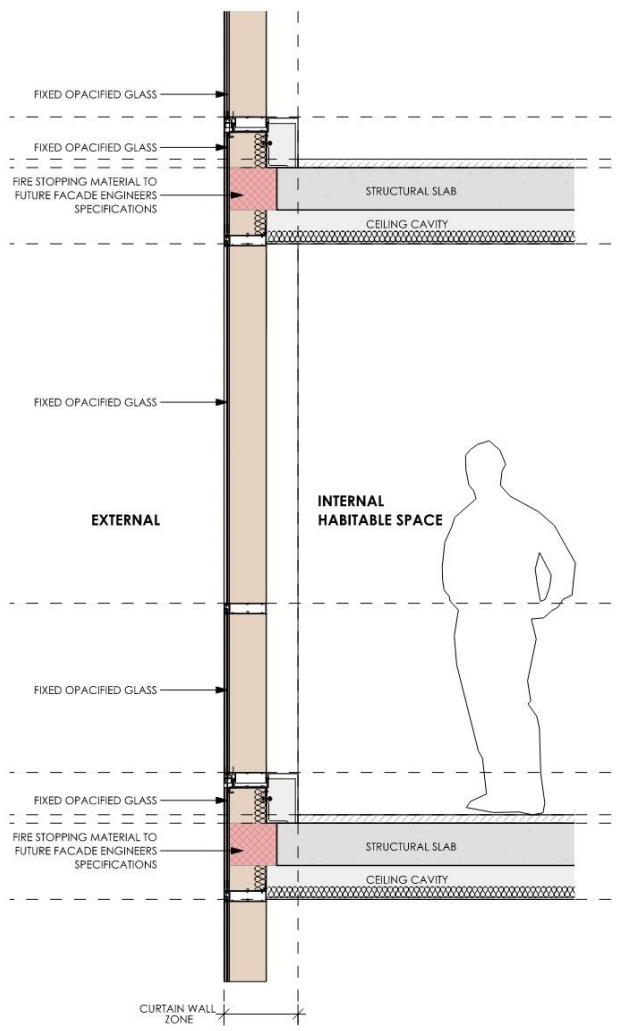

2 CURTAIN WALL
1:20



CURTAIN WALL LEGEND

- TYPE A**
VISION GLASS LOUVRES- FIXED OPEN
AT EXTERNAL SPACES
- TYPE B**
VISION GLASS LOUVRES- OPERABLE
AT INTERNAL SPACES
- TYPE C**
FIXED VISION GLASS
- TYPE D**
FIXED OPACIFIED GLASS
- TYPE E**
FIXED OPACIFIED GLASS OVER
SOLID WALL

SSDA SUBMISSION

A	SSDA SUBMISSION	VD	13/12/24
REV	DESCRIPTION	BY	DATE



Office Level 2, 18 East Street, Surry Hills NSW 2010
+61 2 9250 0880 | enquiries@ptiarchitect.com.au
Not a Not a Registered Architect (No Reg No 50040)
ABN 90 610 271 022


CLIENT
**NSW HOUSING CORPORATION
PTY LTD**

PROJECT
**RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD**

DRAWING TITLE
FACADE CONCEPT SECTIONS

SCALE	1:20 AT A3	NORTH POINT
DRAWN BY	VD/JR	
CHECKED BY	PI	
PROJECT NO.	P709	

SSDA	44	A
stage	dwg no.	revision

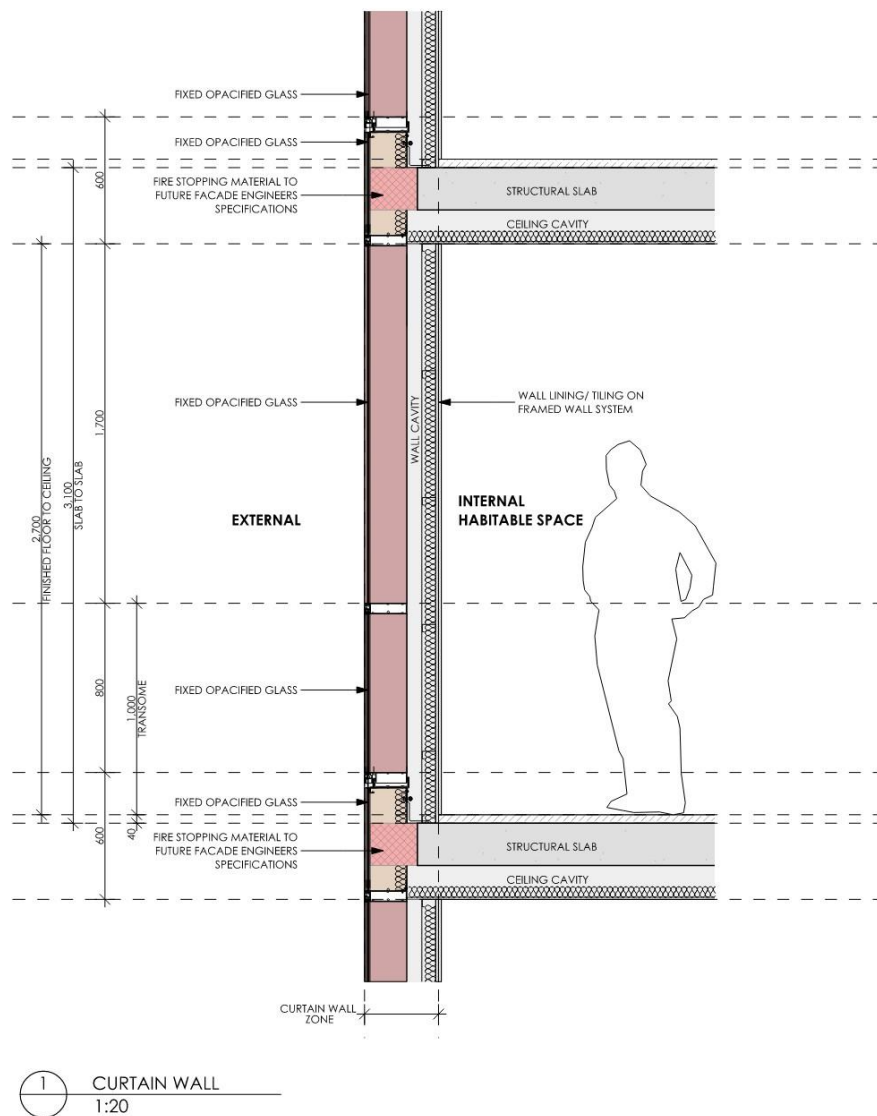

CURTAIN WALL LEGEND

- TYPE A**
VISION GLASS LOUVRES- FIXED OPEN
AT EXTERNAL SPACES
- TYPE B**
VISION GLASS LOUVRES- OPERABLE
AT INTERNAL SPACES
- TYPE C**
FIXED VISION GLASS
- TYPE D**
FIXED OPACIFIED GLASS
- TYPE E**
FIXED OPACIFIED GLASS OVER
SOLID WALL

SSDA SUBMISSION

A	SSDA SUBMISSION	VD	13/12/24
REV	DESCRIPTION	BY	DATE



Office Level 2, 18 East St Street, Surry Hills NSW 2010
+61 2 9250 9966 | enquiries@ptiarch.com.au
Not a registered architect. Peter Scallan (Reg No 50040)
4054 901 000 271 022

CLIENT:
**NSW HOUSING CORPORATION
PTY LTD**

PROJECT:
**RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD**

DRAWING TITLE:
FACADE CONCEPT SECTIONS

SCALE: 1:20 AT A3 NORTH POINT


DRAWN BY: VD/JR

CHECKED BY: PJ


PROJECT NO: P709

SSDA	45	A
stage	dwg no	revision




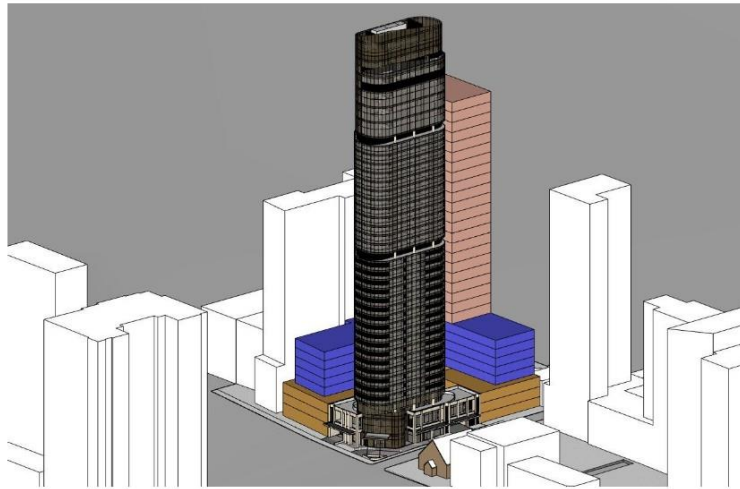


1 POTENTIAL SURROUNDING DEVELOPMENT LOOKING SOUTH-EAST

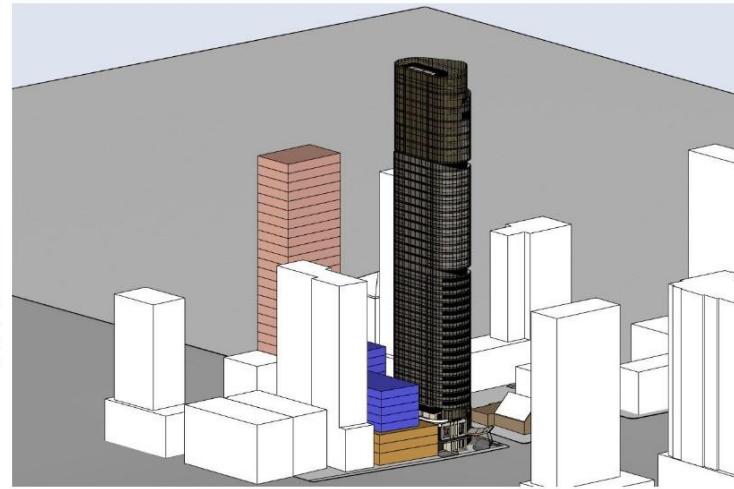

2 POTENTIAL SURROUNDING DEVELOPMENT LOOKING SOUTH-WEST

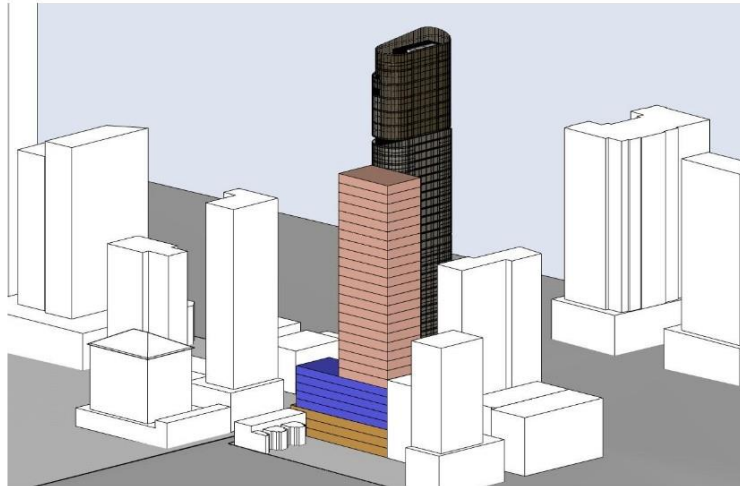

3 POTENTIAL SURROUNDING DEVELOPMENT LOOKING NORTH-WEST

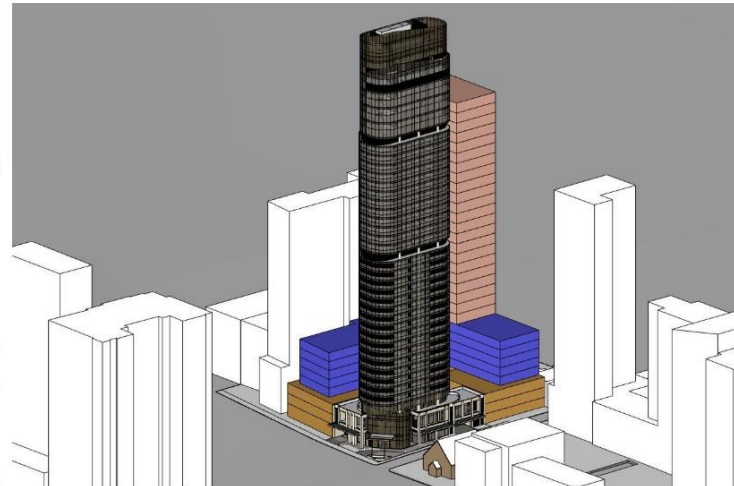

4 POTENTIAL SURROUNDING DEVELOPMENT LOOKING SOUTH-EAST

- COMMERCIAL PODIUM
3M STREET SETBACK
3 STOREYS IN HEIGHT
- RESIDENTIAL PODIUM
6M STREET SETBACK
8 STOREYS IN HEIGHT
- COMMERCIAL TOWER
30 STOREYS IN HEIGHT

SSDA SUBMISSION

REV	DESCRIPTION	BY	DATE
pti ARCHITECTURE Tourism + Residential Office Level 2, 180 East Street, Surry Hills NSW 2010 +61 2 9250 0880 www.ptiarchitect.com.au New South Wales Registered Architect Peter Scobie (Reg No 50040) Architects 127102			
CLIENT: NSW HOUSING CORPORATION PTY LTD			
PROJECT: RESIDENTIAL/ AFFORDABLE HOUSING, HOTEL & COMMERCIAL OFFICES 2-4 BURLEIGH ST & 20-24 RAILWAY PDE, BURWOOD			
DRAWING TITLE: POTENTIAL SURROUNDING DEVELOPMENT			
SCALE: 1:1 AT A3 NORTH POINT			
DRAWN BY: VD/JR			
CHECKED BY: PJ			
PROJECT NO: P709			
SSDA 47 A stage dwg no revision			

APPROXIMATE GFA EFFICIENCY	
GROUND FLOOR	33%
COMMERCIAL	85%
RESIDENTIAL	75%

APPROXIMATE GFA CALCULATION							
LEVEL	USE	BUILDING ENVELOPE AREA (sqm)	RESIDENTIAL EFFICIENCY (%)	RESIDENTIAL GFA (sqm)	COMMERCIAL EFFICIENCY (%)	COMMERCIAL GFA (sqm)	TOTAL GFA (sqm)
GF	COMMERCIAL	2,265	0%	-	33%	747	747
L1	COMMERCIAL	2,265	0%	-	85%	1,925	1,925
L2	COMMERCIAL	2,265	0%	-	85%	1,925	1,925
L3	RESIDENTIAL	1,310	75%	983	0%	-	983
L4	RESIDENTIAL	1,310	75%	983	0%	-	983
L5	RESIDENTIAL	1,310	75%	983	0%	-	983
L6	RESIDENTIAL	1,310	75%	983	0%	-	983
L7	RESIDENTIAL	1,310	75%	983	0%	-	983
L8	COMMERCIAL	424	0%	-	85%	360	360
L9	COMMERCIAL	424	0%	-	85%	360	360
L10	COMMERCIAL	424	0%	-	85%	360	360
L11	COMMERCIAL	424	0%	-	85%	360	360
L12	COMMERCIAL	424	0%	-	85%	360	360
L13	COMMERCIAL	424	0%	-	85%	360	360
L14	COMMERCIAL	424	0%	-	85%	360	360
L15	COMMERCIAL	424	0%	-	85%	360	360
L16	COMMERCIAL	424	0%	-	85%	360	360
L17	COMMERCIAL	424	0%	-	85%	360	360
L18	COMMERCIAL	424	0%	-	85%	360	360
L19	COMMERCIAL	424	0%	-	85%	360	360
L20	COMMERCIAL	424	0%	-	85%	360	360
L21	COMMERCIAL	424	0%	-	85%	360	360
L22	COMMERCIAL	424	0%	-	85%	360	360
L23	COMMERCIAL	424	0%	-	85%	360	360
L24	COMMERCIAL	424	0%	-	85%	360	360
L25	COMMERCIAL	424	0%	-	85%	360	360
L26	COMMERCIAL	424	0%	-	85%	360	360
L27	COMMERCIAL	424	0%	-	85%	360	360
L28	COMMERCIAL	424	0%	-	85%	360	360
L29	ROOF C.O.S	-	100%	-	0%	-	-
LIFT OVER RUN							
TOTAL (sqm)		22,249		4,913		12,166	17,079
USE MIX (%)				29%		71%	100%

HEIGHT OF BUILDING	
FLOOR TO FLOOR (m)	REDUCED LEVEL (rl)
4.50	26.20
3.50	30.70
3.50	34.20
3.50	37.70
3.50	41.20
3.50	44.70
3.50	48.20
3.50	51.70
3.50	55.20
3.50	58.70
3.50	62.20
3.50	65.70
3.50	69.20
3.50	72.70
3.10	76.20
3.10	79.30
3.10	82.40
3.10	85.50
3.10	88.60
3.10	91.70
3.10	94.80
3.10	97.90
3.10	101.00
3.10	104.10
3.10	107.20
3.10	110.30
3.10	113.40
3.10	116.50
3.10	119.60
3.10	122.70
3.10	125.80
102.70	128.90

PLANNING CONTROL CALCULATIONS				
DESCRIPTION	PLANNING INSTRUMENT	BONUS (%)	(m/ X:1/ sqm/ %)	COMPLIANCE Y/N
SITE AREA				
MIN. SITE AREA (sqm)	LEP		-	
SUBJECT SITE AREA (sqm)			2,618	Y
HEIGHT OF BUILDING				
PERMISSIBLE HOB (m)	LEP BHP		0.00	
BONUS HOB (m)		0.0%	0.00	
BONUS HOB (m)		0.0%	0.00	
TOTAL MAX. HOB (m)			0.00	
PROPOSED TOTAL HOB (m)			102.70	Y
FLOOR SPACE RATIO				
PERMISSIBLE FSR (X:1)	BASE LEP		6.00	
BONUS FSR (%)	VPA	10.0%	0.60	
BONUS FSR (%)		0.0%	0.00	
MIN. COMMERCIAL INCLUSIVE IN MAX. (X:1)		-	0.00	
MAX. TOTAL PERMISSIBLE (X:1)			6.60	
PROPOSED TOTAL FSR (X:1)			6.52	Y
GROSS FLOOR AREA				
PERMISSIBLE GFA (sqm)	BASE LEP		15,708	
BONUS GFA (sqm)	VPA	10.0%	1,571	
BONUS GFA (sqm)		0.0%	-	
MIN. COMMERCIAL INCLUSIVE IN MAX. (sqm)			-	
MAX. TOTAL GFA (sqm)			17,279	
PROPOSED TOTAL GFA (sqm)			17,079	Y

SSDA SUBMISSION

A	SSDA SUBMISSION	VO	13/12/24
REV	DESCRIPTION	BY	DATE



pti ARCHITECTURE
Tourism + Residential

Office Level 2, 18 Esplanade, Surry Hills NSW 2010
+61 2 9250 0060 | www.potentialresidential.com.au
Not a Not a Registered Architect - Peter Scahill (Reg No 50040)
405 90 000 271 002

CLIENT
NSW HOUSING CORPORATION
PTY LTD

PROJECT
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD

DRAWING TITLE
POTENTIAL SURROUNDING
DEVELOPMENT

SCALE	1:1 AT A3	NORTH POINT
DRAWN BY	VD/JR	
CHECKED BY	PI	
PROJECT NO.	P709	

SSDA	48	A
stage	dwg no.	revision



SSDA SUBMISSION

A	SSDA SUBMISSION	VD	13/12/24
REV	DESCRIPTION	BY	DATE



Office Level 2, 88 East St Street, Surry Hills NSW 2010
+61 2 9250 0880 | info@ptiarchitecture.com.au
Not a registered architect. Registered Architect Peter Scobie (Reg No 50040)
4854 90 000 221 022

CLIENT
NSW HOUSING CORPORATION
PTY LTD

PROJECT
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD

DRAWING TITLE
PERSPECTIVE 1

SCALE	AT A3	NORTH POINT
DRAWN BY	VD/JR	
CHECKED BY	PI	
PROJECT NO.	P709	

SSDA	49	A
stage	dwg no.	revision



K:\PS 2023\PTOP - 2-4 Burleigh St & 20-24 Railway Parade, Burwood\10_DRAWINGS\PTP\02_STAGE - SEC\01_P01\PTOP_2 - Burleigh St & 20-24 Railway Pde, Burwood_LK_V02_DIA_241115.dwg - P10.dwg 13/12/2024

SSDA SUBMISSION

A	SSDA SUBMISSION	VD	13.12.24
REV	DESCRIPTION	BY	DATE



CLIENT:
NSW HOUSING CORPORATION
PTY LTD

PROJECT:
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD

DRAWING TITLE:
PERSPECTIVE 2

SCALE	AT A3	NORTH POINT
DRAWN BY:	VD/JR	
CHECKED BY:	PI	
PROJECT NO:	P709	

SSDA	50	A
stage	dwg no	revision



SSDA SUBMISSION

A	SSDA SUBMISSION	VD	13.12.24
REV	DESCRIPTION	BY	DATE



Office Level 2, 88 East St Street, Surry Hills NSW 2010
+61 2 9250 0880 | enquiries@ptiarch.com.au
New South Wales Registered Architect: Peter Scammell (Reg No 50046)
ABA No 10193 271 022

CLIENT:
NSW HOUSING CORPORATION
PTY LTD

PROJECT:
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD

DRAWING TITLE:
PERSPECTIVE 3

SCALE	AT A3	NORTH POINT
DRAWN BY	VD/JR	
CHECKED BY	PI	
PROJECT NO	P709	

SSDA	51	A
stage	dwg no	revision

Schedule of BASIX commitments

The commitments set out below regulate how the proposed development is to be carried out. It is a condition of any development consent granted, or complying development certificate issued, for the proposed development, that BASIX commitments be complied with.

1. Commitments for Residential flat buildings - Building 1

(a) Buildings

(i) Materials

(a) The details of the proposed development on the Assessor Certificate must be consistent with the details shown in this BASIX Certificate, including the details shown in the "Floor types", "External wall types", "Internal wall types", "Ceiling and roof types", "Frames" and "Glazing" tables below.

(b) The applicant must show on the plans accompanying the application for a construction certificate (or complying development certificate, if applicable), all specifications included in the tables below.

(c) The applicant must construct the floors, walls, roof, ceiling and roof, windows, glazed doors and skylights of the development in accordance with the specifications listed in the tables below. In the case of glazing, a 5% variance from the area values listed in the "Frames" and "Glazing" tables is permitted.

(d) The applicant must show through receipts that the materials purchased for construction are consistent with the specifications listed in the below tables.

Floor types

Floor type

Area (m2)

Insulation

Low emissions option

-

-

-

-

External wall types

External wall type

Construction type

Area (m2)

Low emissions option

Insulation

-

-

-

-

-

Internal wall types

Internal wall type

Construction type

Area (m2)

Insulation

-

-

-

-

This is not a valid certificate

Version: 4.03 / EUCALYPTUS_03_01_0

page 8/24

Reinforcement concrete frames-columns

Building has reinforced concrete frame-columns?

Volume (m³)

Low emissions option

-

-

-

Ceiling and roof types

Ceiling and roof type

Area (m²)

Roof insulation

Ceiling insulation

-

-

-

-

Glazing types

Single glazing (m²)

Double glazing (m²)

Triple glazing (m²)

Aluminium frames (m²)

Timber frames (m²)

uPVC frames (m²)

Steel frames (m²)

Composite frames (m²)

-

-

-

-

-

-

-

-

Frame types

Single glazing (m²)

Double glazing (m²)

Triple glazing (m²)

Aluminium frames (m²)

Timber frames (m²)

uPVC frames (m²)

Steel frames (m²)

Composite frames (m²)

-

-

-

-

-

-

-

-

This is not a valid certificate

Version: 4.03 / EUCALYPTUS_03_01_0

page 8/24

SSDA SUBMISSION

A SSDA SUBMISSION VD 13.12.24
REV DESCRIPTION BY DATE

(b) Dwellings

(i) Water

(a) The applicant must comply with the commitments listed below in carrying out the development of a dwelling listed in a table below.

(b) The applicant must plant indigenous or low water use species of vegetation throughout the area of land specified for the dwelling in the "Indigenous species" column of the table below, an private landscaping for that dwelling. (This area of indigenous vegetation is to be contained within the "Area of garden and lawn" for the dwelling specified in the "Description of Project" table).

(c) If a rating is specified in the table below for a future or appliance to be installed in the dwelling, the applicant must ensure that each such future and appliance meets the rating specified for it.

(d) The applicant must install an on demand hot water recirculation system which regulates all hot water use throughout the dwelling, where indicated for a dwelling in the "HW recirculation or diversion" column of the table below.

(e) The applicant must install:

(aa) a hot water diversion system to all showers, kitchen sinks and all basins in the dwelling, where indicated for a dwelling in the "HW recirculation or diversion" column of the table below; and

(bb) a separate diversion tank (or tanks) connected to the hot water diversion systems of at least 100 litres. The applicant must connect the hot water diversion tank to all toilets in the dwelling.

(f) The applicant must not install a private swimming pool or spa for the dwelling, with a volume exceeding that specified for it in the table below.

(g) If specified in the table, that pool or spa (or both) must have a pool cover or shading (or both).

(h) The pool or spa must be located as specified in the table.

(i) The applicant must install, for the dwelling, each alternative water supply system, with the specified size, listed for that dwelling in the table below. Each system must be configured to collect run-off from the area specified (excluding any area which supplies any other alternative water supply system), and to divert overflow as specified. Each system must be connected as specified.

Fixtures

Dwelling no.

All shower-heads

All toilet flushing systems

All kitchen taps

All bathroom taps

HW recirculation or diversion

All clothes washers

All dish washers

Volume (max volume)

Pool cover

Pool location

Pool shaded

Volume (max volume)

Spa cover

Spa shaded

All dwellings

4 star (> 4.5 but <= 6 L/min)

4 star

5 star

5 star

not specified

4.5 star

This is not a valid certificate

Version: 4.03 / EUCALYPTUS_03_01_0

page 9/24

Alternative water source

Dwelling no.

Alternative water supply systems

Size

Configuration

Landscape connection

Toilet connection (A)

Laundry connection

Pool top-up

Spa top-up

All dwellings

No alternative water supply

-

(i) Energy

(a) The applicant must comply with the commitments listed below in carrying out the development of a dwelling listed in a table below.

(b) The applicant must install each hot water system specified for the dwelling in the table below, so that the dwelling's hot water is supplied by that system. If the table specifies a central hot water system for the dwelling, then the applicant must connect that central system to the dwelling, so that the dwelling's hot water is supplied by that central system.

(c) The applicant must install, in each bathroom, kitchen and laundry of the dwelling, the ventilation system specified for that room in the table below. Each such ventilation system must have the operation control specified for it in the table.

(d) The applicant must install the cooling and heating system/s specified for the dwelling under the "Living areas" and "Bedroom areas" headings of the "Cooling" and "Heating" columns in the table below, in for at least 1 living/bedroom area of the dwelling. If no cooling or heating system is specified in the table for "Living areas" or "Bedroom areas", then no systems may be installed in any such areas. If the term "zoned" is specified beside an air conditioning system, then the system must provide for day/night zoning between living areas and bedrooms.

(e) This commitment applies to each room or area of the dwelling which is referred to in a heading to the "Artificial lighting" column of the table below (but only to the extent specified for that room or area). The applicant must ensure that the "primary type of artificial lighting" for each such room in the dwelling is fluorescent lighting or light emitting diode (LED) lighting. If the term "dedicated" is specified for a particular room or area, then the light fittings in that room or area must only be capable of being used for fluorescent lighting or light emitting diode (LED) lighting.

(f) This commitment applies to each room or area of the dwelling which is referred to in a heading to the "Natural lighting" column of the table below (but only to the extent specified for that room or area). The applicant must ensure that each such room or area is fitted with a window and/or skylight.

(g) This commitment applies if the applicant installs a water heating system for the dwelling's pool or spa. The applicant must:

(aa) install the system specified for the pool in the "Individual Pool" column of the table below (or alternatively must not install any system for the pool). If specified, the applicant must install a timer, to control the pool's pump; and

(bb) install the system specified for the spa in the "Individual Spa" column of the table below (or alternatively must not install any system for the spa). If specified, the applicant must install a timer to control the spa's pump.

(h) The applicant must install in the dwelling:

(aa) the kitchen cook top and oven specified for that dwelling in the "Appliances & other efficiency measures" column of the table below;

This is not a valid certificate

Version: 4.03 / EUCALYPTUS_03_01_0

page 10/24

pti ARCHITECTURE
Tourism + Residential

Office Level 2, 88 East Street, Surry Hills NSW 2010
+61 2 9250 0860 | www.ptiarchitecture.com.au
New South Wales Registered Architect: Peter Spence (Reg No 50046)
ABA No 000 271 022

CLIENT:
NSW HOUSING CORPORATION
PTY LTD

PROJECT:
RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURREIGH ST & 20-24
RAILWAY PDE, BURWOOD

DRAWING FILE:
BASIX COMMITMENTS- SHEET 1

SCALE: AT A3 NORTH POINT:
DRAWN BY: VD/JR
CHECKED BY: PJ
PROJECT No: P709

SSDA 52 A
stage revision revision

I:\Jobs\2024\20240136\20240136.1\20250328\JWA_R3_Noise_and_Vibration_Impact_Assessment.docx

121

(i) Energy		Show on DA plans	Show on CC-CDC plans & specs	Certifier check
(b) each appliance for which a rating is specified for that dwelling in the "Appliances & other efficiency measures" column of the table, and ensure that the appliance has that minimum rating; and			✓	✓
(c) any clothes drying line specified for the dwelling in the "Appliances & other efficiency measures" column of the table.			✓	
(i) If specified in the table, the applicant must carry out the development so that each refrigerator space in the dwelling is "well ventilated".			✓	

Dwelling No.	Hot water	Bathroom ventilation system		Kitchen ventilation system		Laundry ventilation system	
	Hot water system	Each bathroom	Operation control	Each kitchen	Operation control	Each laundry	Operation control
All dwellings	Central hot water system (No. 1)	central ducted	-	central ducted	-	central ducted	-

Dwelling no.	Cooling		Heating		Natural lighting	
	living areas	bedroom areas	living areas	bedroom areas	No. of bathrooms or toilets	Main kitchen
All dwellings	Central cooling system (No. 1)	Central cooling system (No. 1)	Central heating system (No. 1)	Central heating system (No. 1)	0	yes

Dwelling no.	Individual pool		Individual spa		Appliances other efficiency measures					
	Pool heating system	Pool Pump	Timer	Spa heating system	Timer	Kitchen cooktop/oven	Dishwasher	Clothes dryer	Indoor or sheltered clothes drying line	Private outdoor or unsheltered clothes drying line
All dwellings	-	-	-	-	-	electric cooktop & electric oven	4.5 star	not specified	no	no

This is not a valid certificate.

Version: 4.03 / EUCALYPTUS_03_01_5

page 11/24

(ii) Thermal Performance		Show on DA plans	Show on CC-CDC plans & specs	Certifier check
(a) The applicant must attach the certificate referred to under "Assessor details" on the front page of this BASIX certificate (the "Assessor Certificate") to the development application and construction certificate application for the proposed development (or, if the applicant is applying for a complying development certificate for the proposed development, to that application). The applicant must also attach the Assessor Certificate to the application for a final occupation certificate for the proposed development.				
(b) The Assessor Certificate must have been issued by an Accredited Assessor in accordance with the Thermal Comfort Protocol.				
(c) The details of the proposed development on the Assessor Certificate must be consistent with the details shown in this BASIX Certificate, including the details shown in the "Thermal Loads" table below.				
(d) The applicant must show on the plans accompanying the development application for the proposed development, all matters which the Thermal Comfort Protocol requires to be shown on those plans. Those plans must bear a stamp of endorsement from the Accredited Assessor, to certify that this is the case.		✓		
(e) The applicant must show on the plans accompanying the application for a construction certificate (or complying development certificate, if applicable), all thermal performance specifications set out in the Assessor Certificate, and all aspects of the proposed development which were used to calculate those specifications.			✓	
(f) The applicant must construct the development in accordance with all thermal performance specifications set out in the Assessor Certificate, and in accordance with those aspects of the development application or application for a complying development certificate which were used to calculate those specifications.			✓	✓
(g) Where there is an in-slab heating or cooling system, the applicant must:		✓	✓	✓
(aa) Install insulation with an R-value of not less than 1.0 around the vertical edges of the perimeter of the slab; or				
(bb) On a suspended floor, install insulation with an R-value of not less than 1.0 underneath the slab and around the vertical edges of the perimeter of the slab.				
(h) The applicant must construct the floors and walls of the development in accordance with the specifications listed in the table below:		✓	✓	✓
(i) The applicant must show on The plans accompanying The development application for The proposed development, The locations of ceiling fans set out in The Assessor Certificate.		✓		
(j) The applicant must show on the plans accompanying the application for a construction certificate (or complying development certificate, if applicable), the locations of ceiling fans set out in the Assessor Certificate.			✓	

Thermal loads			
Dwelling no.	Area adjusted heating load (in MJ/m ² /yr)	Area adjusted cooling load (in MJ/m ² /yr)	Area adjusted total load (in MJ/m ² /yr)
All dwellings	12	17.5	29.500

This is not a valid certificate.

Version: 4.03 / EUCALYPTUS_03_01_5

page 12/24

SSDA SUBMISSION

A	SSDA SUBMISSION	VD	13/12/24
REV	DESCRIPTION	BY	DATE



PROJECT: NSW HOUSING CORPORATION PTY LTD

RESIDENTIAL/ AFFORDABLE HOUSING, HOTEL & COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24 RAILWAY PDE, BURWOOD

DRAWING FILE: BASIX COMMITMENTS- SHEET 2

SCALE:	AT A3	NORTH POINT:
DRAWN BY:	VD/JR	
CHECKED BY:	PI	
PROJECT No:	P709	

SSDA
stage

53
dwg no.

A
revision

(c) Common areas and central systems/facilities				
(i) Water		Show on DA plans	Show on CC-CDC plans & specs	Certifier check
(a) If, in carrying out the development, the applicant installs a showerhead, toilet, tap or clothes washer into a common area, then that item must meet the specifications listed for it in the table.			✓	✓
(b) The applicant must install (or ensure that the development is serviced by) the alternative water supply system(s) specified in the "Central systems" column of the table below. In each case, the system must be sized, be configured, and be connected, as specified in the table.		✓	✓	✓
(c) A swimming pool or spa listed in the table must not have a volume (in kL/s) greater than that specified for the pool or spa in the table.		✓	✓	
(d) A pool or spa listed in the table must have a cover or shading it specified for the pool or spa in the table.			✓	
(e) The applicant must install each fire sprinkler system listed in the table so that the system is configured as specified in the table.			✓	✓
(f) The applicant must ensure that the central cooling system for a cooling tower is configured as specified in the table.			✓	✓

Common area	Showerheads rating	Toilets rating	Taps rating	Clothes washers rating
All common areas	4 star (> 6 but <= 7.5 L/min)	4 star	4 star	no common laundry facility

Central systems	Size	Configuration	Connection (to allow for...)
Swimming pool (No. 1)	Volume: 75 kLs	Location: Building 1 Pool shaded: no	-
Fire sprinkler system (No. 1)	-	-	-
Central cooling system (No. 1)	-	Private water meter on make-up line connected to building management system. Conductivity controller installed in the cooling tower.	-

(ii) Energy		Show on DA plans	Show on CC-CDC plans & specs	Certifier check
(a) If, in carrying out the development, the applicant installs a ventilation system to service a common area specified in the table below, then that ventilation system must be of the type specified for that common area, and must meet the efficiency measure specified.			✓	✓

This is not a valid certificate.

Version: 4.03 / EUCALYPTUS_03_01_5

page 13/24

(i) Energy		Show on DA plans	Show on CC-CDC plans & specs	Certifier check
(b) In carrying out the development, the applicant must install, as the "primary type of artificial lighting" for each common area specified in the table below, the lighting specified for that common area. This lighting must meet the efficiency measure specified. The applicant must also install a centralised lighting control system or Building Management System (BMS) for the common area, where specified.			✓	✓
(c) The applicant must install the systems and fixtures specified in the "Central energy systems" column of the table below. In each case, the system or fixture must be of the type, and meet the specifications, listed for it in the table.		✓	✓	✓

Common area	Common area ventilation system		Common area lighting		
	Ventilation system type	Ventilation efficiency measure	Primary type of artificial lighting	Lighting efficiency measure	Lighting control system BMS
Gym area	air conditioning system	time clock or BMS controlled	light-emitting diode	manual on / manual off	no
Basement Car Parks	ventilation (supply + exhaust)	carbon monoxide monitor + 2 speed fan	light-emitting diode	motion sensors	no
MSB	no mechanical ventilation	-	light-emitting diode	manual on / manual off	no
Bulky Goods	ventilation exhaust only	-	light-emitting diode	motion sensors	no
Resi Waste	ventilation exhaust only	-	light-emitting diode	motion sensors	no
Comm Waste	ventilation exhaust only	-	light-emitting diode	motion sensors	no
Storage	no mechanical ventilation	-	light-emitting diode	motion sensors	no
Comms	no mechanical ventilation	-	light-emitting diode	manual on / manual off	no
Fire Pump	no mechanical ventilation	-	light-emitting diode	manual on / manual off	no
Cold Water Pump	no mechanical ventilation	-	light-emitting diode	manual on / manual off	no
Fire Control	no mechanical ventilation	-	light-emitting diode	manual on / manual off	no
Dry Linen	ventilation exhaust only	time clock or BMS controlled	light-emitting diode	motion sensors	no
Bike Storage	no mechanical ventilation	-	light-emitting diode	motion sensors	no
Pool Community Lobby Toilets	air conditioning system	time clock or BMS controlled	light-emitting diode	manual on / manual off	no
Ground floor lobby	no mechanical ventilation	none i.e., continuous	light-emitting diode	motion sensors	no
All Resi Firestairs	no mechanical ventilation	-	light-emitting diode	motion sensors	no
All Comm Firestairs	no mechanical ventilation	-	light-emitting diode	motion sensors	no
All Resi Lift Foyers	no mechanical ventilation	-	light-emitting diode	motion sensors	no
Comm. Lift Foyers	no mechanical ventilation	-	light-emitting diode	motion sensors	no
Lift bank (No. 1)	-	-	light-emitting diode	none	no

This is not a valid certificate.

Version: 4.03 / EUCALYPTUS_03_01_5

page 14/24

Central energy systems	Type	Specification
Swimming pool (No. 1)	Heating source: electric heat pump	Pump controlled by timer: yes
Lift bank (No. 1)	gearless traction with V V F motor and regenerative drive	Number of levels (including basement): 16 number of levels from the bottom of the lift shaft to the top of the lift shaft: 45 number of lifts: 5 lift load capacity: <1001 kg
Central hot water system (No. 1)	electric heat pump – gas boosted	Piping insulation (ringsman & supply risers): (a) Piping external to building: R1.0 (~36 mm); (b) Piping internal to building: R0.75 (~32 mm)
Central cooling system (No. 1)	chilled water fan coil units	Energy source: gas driven compressor Heat rejection method: cooling tower Unit efficiency (min): high – COP > 1.8
Central heating system (No. 1)	fan coil – heater water	Energy source: gas boiler

This is not a valid certificate

Version: 4.03 / EUCALYPTUS_03_01_0

page 16/24

2. Commitments for multi-dwelling housing

(i) Dwellings	Show on DA plans	Show on CC/CDC plans & specs	Certifier check
(a) The applicant must comply with the commitments listed below in carrying out the development of a dwelling listed in a table below.			
(b) The applicant must plant indigenous or low water use species of vegetation throughout the area of land specified for the dwelling in the "Indigenous species" column of the table below, as private landscaping for that dwelling. (This area of indigenous vegetation is to be contained within the "Area of garden and lawn" for the dwelling specified in the "Description of Project" table).	✓	✓	
(c) If a rating is specified in the table below for a future or appliance to be installed in the dwelling, the applicant must ensure that each such future and appliance meets the rating specified for it.		✓	✓
(d) The applicant must install an on demand hot water recirculation system which regulates all hot water use throughout the dwelling, where indicated for a dwelling in the "HW recirculation or diversion" column of the table below.		✓	✓
(e) The applicant must install: (aa) a hot water diversion system to all showers, kitchen sinks and all basins in the dwelling, where indicated for a dwelling in the "HW recirculation or diversion" column of the table below; and (bb) a separate diversion tank (or tanks) connected to the hot water diversion systems of at least 100 litres. The applicant must connect the hot water diversion tank to all toilets in the dwelling.		✓	✓
(f) The applicant must not install a private swimming pool or spa for the dwelling, with a volume exceeding that specified for it in the table below.	✓	✓	
(g) If specified in the table, that pool or spa (or both) must have a pool cover or shading (or both).		✓	
(h) The pool or spa must be located as specified in the table.	✓		
(i) The applicant must install, for the dwelling, each alternative water supply system, with the specified size, listed for that dwelling in the table below. Each system must be configured to collect run-off from the areas specified (excluding any area which supplies any other alternative water supply system), and to divert overflow as specified. Each system must be corrected as specified.	✓	✓	✓
(ii) Energy	Show on DA plans	Show on CC/CDC plans & specs	Certifier check
(a) The applicant must comply with the commitments listed below in carrying out the development of a dwelling listed in a table below.			
(b) The applicant must install each hot water system specified for the dwelling in the table below, so that the dwelling's hot water is supplied by that system. If the table specifies a central hot water system for the dwelling, then the applicant must connect that central system to the dwelling, so that the dwelling's hot water is supplied by that central system.	✓	✓	✓
(c) The applicant must install, in each bathroom, kitchen and laundry of the dwelling, the ventilation system specified for that room in the table below. Each such ventilation system must have the operation control specified for it in the table.		✓	✓

This is not a valid certificate

Version: 4.03 / EUCALYPTUS_03_01_0

page 16/24

SSDA SUBMISSION

A	SSDA SUBMISSION	VD	13/12/24
REV	DESCRIPTION	BY	DATE

(i) Energy	Show on DA plans	Show on CC/CDC plans & specs	Certifier check
(a) The applicant must install the cooling and heating systems specified for the dwelling under the "Living areas" and "Bedroom areas" headings of the "Cooling" and "Heating" columns in the table below, or/for at least 1 living/bedroom area of the dwelling. If no cooling or heating system is specified in the table for "Living areas" or "Bedroom areas", then no systems may be installed in any such areas. If the term "zoned" is specified beside an air conditioning system, then the system must provide for daylight zoning between living areas and bedrooms.		✓	✓
(b) This commitment applies to each room or area of the dwelling which is referred to in a heading to the "Artificial lighting" column of the table below (but only to the extent specified for that room or area). The applicant must ensure that the "primary type of artificial lighting" for each such room in the dwelling is fluorescent lighting or light emitting diode (LED) lighting. If the term "dedicated" is specified for a particular room or area, then the light fittings in that room or area must only be capable of being used for fluorescent lighting or light emitting diode (LED) lighting.		✓	✓
(c) This commitment applies to each room or area of the dwelling which is referred to in a heading to the "Natural lighting" column of the table below (but only to the extent specified for that room or area). The applicant must ensure that each such room or area is fitted with a window and/or daylight.	✓	✓	✓
(d) This commitment applies if the applicant installs a water heating system for the dwelling's pool or spa. The applicant must: (aa) install the system specified for the pool in the "Individual Pool" column of the table below (or alternatively must not install any system for the pool). If specified, the applicant must install a timer, to control the pool's pump; and (bb) install the system specified for the spa in the "Individual Spa" column of the table below (or alternatively must not install any system for the spa). If specified, the applicant must install a timer to control the spa's pump.		✓	✓
(e) The applicant must install in the dwelling: (aa) the kitchen cook-top and oven specified for that dwelling in the "Appliances & other efficiency measures" column of the table below; (bb) each appliance for which a rating is specified for that dwelling in the "Appliances & other efficiency measures" column of the table, and ensure that the appliance has that minimum rating; and (cc) any clothes drying line specified for the dwelling in the "Appliances & other efficiency measures" column of the table.		✓	✓
(f) If specified in the table, the applicant must carry out the development so that each refrigerator space in the dwelling is "well ventilated".		✓	
(ii) Thermal Performance and Materials	Show on DA plans	Show on CC/CDC plans & specs	Certifier check
(a) The applicant must attach the certificate referred to under "Assessor details" on the front page of this BASIX certificate (the "Assessor Certificate") to the development application and construction certificate application for the proposed development (or, if the applicant is applying for a complying development certificate for the proposed development, to that application). The applicant must also attach the Assessor Certificate to the application for a final occupation certificate for the proposed development.			
(b) The Assessor Certificate must have been issued by an Accredited Assessor in accordance with the Thermal Comfort Protocol.			

This is not a valid certificate

Version: 4.03 / EUCALYPTUS_03_01_0

page 17/24

(ii) Thermal Performance and Materials	Show on DA plans	Show on CC/CDC plans & specs	Certifier check
(a) The details of the proposed development on the Assessor Certificate must be consistent with the details shown in this BASIX Certificate, including the details shown in the "Thermal Loads" table below.			
(b) The applicant must show on the plans accompanying the development application for the proposed development, all matters which the Thermal Comfort Protocol requires to be shown on those plans. Those plans must bear a stamp of endorsement from the Accredited Assessor, to certify that this is the case.	✓		
(c) The applicant must show on the plans accompanying the application for a construction certificate (or complying development certificate, if applicable), all thermal performance specifications set out in the Assessor Certificate, and all aspects of the proposed development which were used to calculate those specifications.		✓	
(d) The applicant must construct the development in accordance with all thermal performance specifications set out in the Assessor Certificate, and in accordance with those aspects of the development application or application for a complying development certificate which were used to calculate those specifications.		✓	✓
(e) Where there is an in-slab heating or cooling system, the applicant must: (aa) install insulation with an R-value of not less than 1.0 around the vertical edges of the perimeter of the slab; or (bb) On a suspended floor, install insulation with an R-value of not less than 1.0 underneath the slab and around the vertical edges of the perimeter of the slab.	✓	✓	✓
(f) The applicant must construct the floors and walls of the development in accordance with the specifications listed in the table below.	✓	✓	✓
(g) The applicant must show on The plans accompanying The development application for The proposed development, The locations of ceiling fans set out in The Assessor Certificate.	✓		
(h) The applicant must show on the plans accompanying the application for a construction certificate (or complying development certificate, if applicable), the locations of ceiling fans set out in the Assessor Certificate.		✓	

This is not a valid certificate

Version: 4.03 / EUCALYPTUS_03_01_0

page 18/24



pti ARCHITECTURE
Tourism + Residential

Office: Level 2, 18 East St, Sydney NSW 2011
+61 2 9260 0860 | enquiries@ptiarchitect.com.au
Not a member of the Institute of Architects (No. 10000)
ABA No. 10000 (2012)

CLIENT

NSW HOUSING CORPORATION
PTY LTD

PROJECT

RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURELIGH ST & 20-24
RAILWAY PDE, BURWOOD

DRAWING FILE

BASIX COMMITMENTS- SHEET 3

SCALE

AT A3

NOTED POINT

DRAWN BY

VD/JR

CHECKED BY

PI

PROJECT NO.

P709

SSDA

stage

54

dwg no.

A

revision

3. Commitments for single dwelling houses

(i) Dwellings

	Show on DA plans	Show on CC/CDC plans & specs	Certifier check
(a) The applicant must comply with the commitments listed below in carrying out the development of a dwelling listed in a table below.	✓	✓	
(b) The applicant must plant indigenous or low water use species of vegetation throughout the area of land specified for the dwelling in the "Indigenous species" column of the table below, as private landscaping for that dwelling. (This area of indigenous vegetation is to be contained within the "Area of garden and lawn" for the dwelling specified in the "Description of Project" table).		✓	
(c) If a rating is specified in the table below for a future or appliance to be installed in the dwelling, the applicant must ensure that each such future and appliance meets the rating specified for it.		✓	✓
(d) The applicant must install an on demand hot water recirculation system which regulates all hot water use throughout the dwelling, where indicated for a dwelling in the "HW recirculation or diversion" column of the table below.		✓	✓
(e) The applicant must install: (aa) a hot water diversion system to all showers, kitchen sinks and all basins in the dwelling, where indicated for a dwelling in the "HW recirculation or diversion" column of the table below; and (bb) a separate diversion tank (or tanks) connected to the hot water diversion systems of at least 100 litres. The applicant must connect the hot water diversion tank to all toilets in the dwelling.		✓	✓
(f) The applicant must not install a private swimming pool or spa for the dwelling, with a volume exceeding that specified for it in the table below.	✓	✓	
(g) If specified in the table, that pool or spa (or both) must have a pool cover or shading (or both).		✓	
(h) The pool or spa must be located as specified in the table.	✓		
(i) The applicant must install, for the dwelling, each alternative water supply system, with the specified size, listed for that dwelling in the table below. Each system must be configured to collect run-off from the areas specified (excluding any area which supplies any other alternative water supply system), and to divert overflow as specified. Each system must be corrected as specified.	✓	✓	✓

(ii) Energy

	Show on DA plans	Show on CC/CDC plans & specs	Certifier check
(a) The applicant must comply with the commitments listed below in carrying out the development of a dwelling listed in a table below.	✓	✓	
(b) The applicant must install each hot water system specified for the dwelling in the table below, so that the dwelling's hot water is supplied by that system. If the table specifies a central hot water system for the dwelling, then the applicant must connect that central system to the dwelling, so that the dwelling's hot water is supplied by that central system.		✓	✓
(c) The applicant must install, in each bathroom, kitchen and laundry of the dwelling, the ventilation system specified for that room in the table below. Each such ventilation system must have the operation control specified for it in the table.		✓	✓

This is not a valid certificate. Version: 4.03 / EUCALYPTUS_03_01_0 page 19/24

(ii) Energy

	Show on DA plans	Show on CC/CDC plans & specs	Certifier check
(d) The applicant must install the cooling and heating systems specified for the dwelling under the "Living areas" and "Bedroom areas" headings of the "Cooling" and "Heating" columns in the table below, (or at least 1 living/bedroom area of the dwelling, if no cooling or heating system is specified in the table for "Living areas" or "Bedroom areas", then no systems may be installed in any such areas. If the term "zoned" is specified beside an air conditioning system, then the system must provide for daylight zoning between living areas and bedrooms.		✓	✓
(e) This commitment applies to each room or area of the dwelling which is referred to in a heading to the "Artificial lighting" column of the table below (but only to the extent specified for that room or area). The applicant must ensure that the "primary type of artificial lighting" for each such room in the dwelling is fluorescent lighting or light emitting diode (LED) lighting. If the term "dedicated" is specified for a particular room or area, then the light fittings in that room or area must only be capable of being used for fluorescent lighting or light emitting diode (LED) lighting.		✓	✓
(f) This commitment applies to each room or area of the dwelling which is referred to in a heading to the "Natural lighting" column of the table below (but only to the extent specified for that room or area). The applicant must ensure that each such room or area is fitted with a window and/or daylight.	✓	✓	✓
(g) This commitment applies if the applicant installs a water heating system for the dwelling's pool or spa. The applicant must: (aa) install the system specified for the pool in the "Individual Pool" column of the table below (or alternatively must not install any system for the pool). If specified, the applicant must install a timer, to control the pool's pump; and (bb) install the system specified for the spa in the "Individual Spa" column of the table below (or alternatively must not install any system for the spa). If specified, the applicant must install a timer to control the spa's pump.		✓	
(h) The applicant must install in the dwelling: (aa) the kitchen cook top and oven specified for that dwelling in the "Appliances & other efficiency measures" column of the table below; (bb) each appliance for which a rating is specified for that dwelling in the "Appliances & other efficiency measures" column of the table, and ensure that the appliance has that minimum rating; and (cc) any clothes drying line specified for the dwelling in the "Appliances & other efficiency measures" column of the table.		✓	✓
(i) If specified in the table, the applicant must carry out the development so that each refrigerator space in the dwelling is "well ventilated".		✓	

(iii) Thermal Performance and Materials

	Show on DA plans	Show on CC/CDC plans & specs	Certifier check
(a) The applicant must attach the certificate referred to under "Assessor details" on the front page of this BASIX certificate (the "Assessor Certificate") to the development application and construction certificate application for the proposed development (or, if the applicant is applying for a complying development certificate for the proposed development, to that application). The applicant must also attach the Assessor Certificate to the application for a final occupation certificate for the proposed development.			
(b) The Assessor Certificate must have been issued by an Accredited Assessor in accordance with the Thermal Comfort Protocol.			

This is not a valid certificate. Version: 4.03 / EUCALYPTUS_03_01_0 page 20/24

SSDA SUBMISSION

A	SSDA SUBMISSION	VD	13/12/24
REV	DESCRIPTION	BY	DATE

(iii) Thermal Performance and Materials

	Show on DA plans	Show on CC/CDC plans & specs	Certifier check
(c) The details of the proposed development on the Assessor Certificate must be consistent with the details shown in this BASIX Certificate, including the details shown in the "Thermal Loads" table below.			
(d) The applicant must show on the plans accompanying the development application for the proposed development, all matters which the Thermal Comfort Protocol requires to be shown on those plans. Those plans must bear a stamp of endorsement from the Accredited Assessor, to certify that this is the case.	✓		
(e) The applicant must show on the plans accompanying the application for a construction certificate (or complying development certificate, if applicable), all thermal performance specifications set out in the Assessor Certificate, and all aspects of the proposed development which were used to calculate those specifications.		✓	
(f) The applicant must construct the development in accordance with all thermal performance specifications set out in the Assessor Certificate, and in accordance with those aspects of the development application or application for a complying development certificate which were used to calculate those specifications.		✓	✓
(g) Where there is an in-slab heating or cooling system, the applicant must: (aa) install insulation with an R-value of not less than 1.0 around the vertical edges of the perimeter of the slab; or (bb) On a suspended floor, install insulation with an R-value of not less than 1.0 underneath the slab and around the vertical edges of the perimeter of the slab.	✓	✓	✓
(h) The applicant must construct the floors and walls of the development in accordance with the specifications listed in the table below.	✓	✓	✓
(i) The applicant must show on The plans accompanying The development application for The proposed development, The locations of ceiling fans set out in The Assessor Certificate.	✓		
(j) The applicant must show on the plans accompanying the application for a construction certificate (or complying development certificate, if applicable), the locations of ceiling fans set out in the Assessor Certificate.		✓	

This is not a valid certificate. Version: 4.03 / EUCALYPTUS_03_01_0 page 21/24

4. Commitments for common areas and central systems/facilities for the development (non-building specific)

(b) Common areas and central systems/facilities

	Show on DA plans	Show on CC/CDC plans & specs	Certifier check
(i) Water			
(a) If, in carrying out the development, the applicant installs a showerhead, toilet, tap or clothes washer into a common area, then that item must meet the specifications listed for it in the table.		✓	✓
(b) The applicant must install (or ensure that the development is serviced by) the alternative water supply system(s) specified in the "Central systems" column of the table below. In each case, the system must be sized, be configured, and be connected, as specified in the table.	✓	✓	✓
(c) A swimming pool or spa listed in the table must not have a volume (in kL) greater than that specified for the pool or spa in the table.	✓	✓	
(d) A pool or spa listed in the table must have a cover or shading if specified for the pool or spa in the table.			
(e) The applicant must install each fire sprinkler system listed in the table so that the system is configured as specified in the table.		✓	✓
(f) The applicant must ensure that the central cooling system for a cooling tower is configured as specified in the table.		✓	✓

Common area	Showerheads rating	Toilets rating	Taps rating	Clothes washers rating
All common areas	4 star (> 6 but <= 7.5 L/min)	4 star	4 star	no common laundry facility

(ii) Energy

	Show on DA plans	Show on CC/CDC plans & specs	Certifier check
(a) If, in carrying out the development, the applicant installs a ventilation system to service a common area specified in the table below, then that ventilation system must be of the type specified for that common area, and must meet the efficiency measure specified.		✓	✓
(b) In carrying out the development, the applicant must install, as the "primary type of artificial lighting" for each common area specified in the table below, the lighting specified for that common area. This lighting must meet the efficiency measure specified. The applicant must also install a centralised lighting control system or Building Management System (BMS) for the common area, where specified.		✓	
(c) The applicant must install the systems and fixtures specified in the "Central energy systems" column of the table below. In each case, the system or fixture must be of the type, and meet the specifications, listed for it in the table.	✓	✓	✓

This is not a valid certificate. Version: 4.03 / EUCALYPTUS_03_01_0 page 22/24

pti

ARCHITECTURE

Tourism + Residential

Office: Level 2, 18 Esplanade Street, Surry Hills NSW 1501
+61 2 9250 0860 | enquiries@ptiarchitect.com.au
Not a member of the Institute of Architects (No. 10000)
ABN 92 602 271 022

CLIENT

NSW HOUSING CORPORATION
PTY LTD

PROJECT

RESIDENTIAL/ AFFORDABLE
HOUSING, HOTEL &
COMMERCIAL OFFICES
2-4 BURLEIGH ST & 20-24
RAILWAY PDE, BURWOOD

DRAWING TITLE

BASIX COMMITMENTS- SHEET 4

SCALE

AT A3

NCBEN FORM

DRAWN BY

VD/JR

CHECKED BY

PI

PROJECT NO.

P709

SSDA

stage

55

dwg no.

A

revision

Central energy systems	Type	Specification
Alternative energy supply	Photovoltaic system	Rated electrical output (min): 100 peak kW
Other	Building management system installed?: yes Active power factor correction installed?: yes	-

This is not a valid certificate. Version: 4.03 - EUCALVPTUR_03_01_0 page 29/34

Notes
1. In these commitments, "applicant" means the person carrying out the development.
2. The applicant must identify each dwelling, building and common area listed in this certificate, on the plans accompanying any development application, and on the plans and specifications accompanying the application for a construction certificate / complying development certificate, for the proposed development, using the same identifying letter or reference as is given to that dwelling, building or common area in this certificate.
3. This note applies if the proposed development involves the erection of a building for both residential and non-residential purposes (or the change of use of a building for both residential and non-residential purposes). Commitments in this certificate which are specified to apply to a "common area" of a building or the development, apply only to that part of the building or development to be used for residential purposes.
4. If this certificate lists a central system as a commitment for a dwelling or building, and that system will also service any other dwelling or building within the development, then that system need only be installed once (even if it is separately listed as a commitment for that other dwelling or building).
5. If a star or other rating is specified in a commitment, this is a minimum rating.
6. All alternative water systems to be installed under these commitments (if any), must be installed in accordance with the requirements of all applicable regulatory authorities. NOTE: NSW Health does not recommend that stormwater, recycled water or private dam water be used to irrigate edible plants which are consumed raw, or that rainwater be used for human consumption in areas with potable water supply.
Legend
1. Commitments identified with a  in the "Show on DA plans" column must be shown on the plans accompanying the development application for the proposed development (if a development application is to be lodged for the proposed development).
2. Commitments identified with a  in the "Show on CO-DOC plans and specs" column must be shown in the plans and specifications accompanying the application for a construction certificate / complying development certificate for the proposed development.
3. Commitments identified with a  in the "Certifier check" column must be certified by a certifying authority as having been fulfilled. (Note: a certifying authority must not issue an occupation certificate (either interim or final) for a building listed in this certificate, or for any part of such a building, unless it is satisfied that each of the commitments whose fulfillment it is required to monitor in relation to the building or part, has been fulfilled).

This is not a valid certificate. Version: 4.03 - EUCALVPTUR_03_01_0 page 24/34

SSDA SUBMISSION

SUMMARY
THERMAL PERFORMANCE SPECIFICATIONS: (23827 – Railway Pde) The following specifications take precedence over other plan notations for the construction of this building. NOTE: In addition to BASIX commitments, building compliance is required to comply with the 'New South Wales Additions' in the current edition of the NCC, at the time of building. This includes New South Wales : - Building Thermal construction - For metal frames, thermal breaks - Floor edging - Sealing of rooflights, windows and doors 3 - Any new A/C or mechanical ventilation system - Any new heated water system - Energy monitoring equipment WINDOWS (total product specification – glass + frame) Louvre & FG in each Unit – Single glazed Low-e with bronze tint (SHGC=0.40) Sliding Doors in each Unit – Double glazed argon filled Clear Low-e/Clear thermally broken AL frame EXTERNAL WALL (Medium colour) 100mm concrete – R2.0 bulk insulation Cavity Panel/Opacified glass – R2.5 – 90mm thick Bulk insulation with vapour barrier INTERNAL WALL Concrete or Shaft Liner – Partition walls (as per HERS Certificates) Cavity Panel – No Insulation (generally) EXTERNAL FLOOR Suspended Concrete (Neighbour below) – R1.0 bulk insulation CEILING SPACE with Apartment above Plasterboard – R1.0 bulk insulation RATED either with NO DOWNLIGHTS or with LED downlights which do not penetrate ceiling insulation (ie: IC rated) Refer to current HERS Certificate to validate these thermal specification details.

A	SSDA SUBMISSION	VD	13.12.24
REV	DESCRIPTION	BY	DATE
 Office Level 2, 18 East St Street, Surry Hills NSW 2010 +61 2 9262 0866 enquiries@ptiarch.com.au Not a valid Registered Architect: Peter Scuse (Reg No 5004) 405 90 000 271 022 CLIENT: NSW HOUSING CORPORATION PTY LTD PROJECT: RESIDENTIAL/ AFFORDABLE HOUSING, HOTEL & COMMERCIAL OFFICES 2-4 BURLEIGH ST & 20-24 RAILWAY PDE, BURWOOD DRAWING TITLE: BASIX COMMITMENTS- SHEET 5			
SCALE	AT A3	NORTH POINT	
DRAWN BY:	VD/JR		
CHECKED BY:	PI		
PROJECT No:	P709		
SSDA	56	A	
stage	dwg no	revision	