



COMBINED OSD / RW / TREATMENT TANK LAYOUT PLAN

1:50

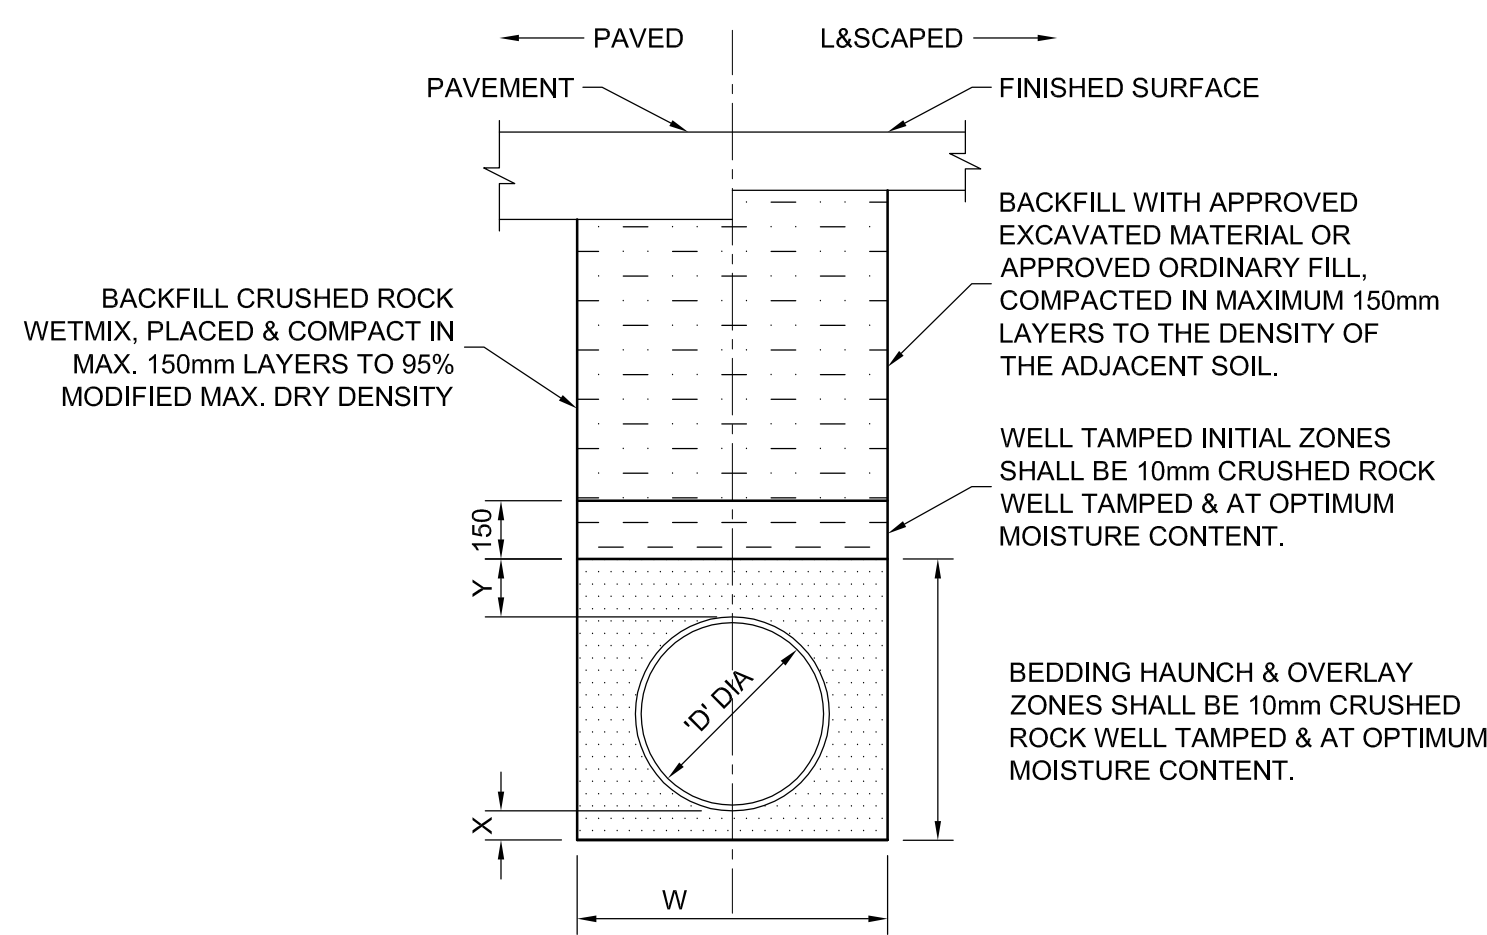

NOTE:
1 REFER TO PIPE LAYING SPECIFICATION FOR DETAILS.

PIPE DIA D	W	X MIN	Y
100-150	300	75	75
225-300	600	75	75

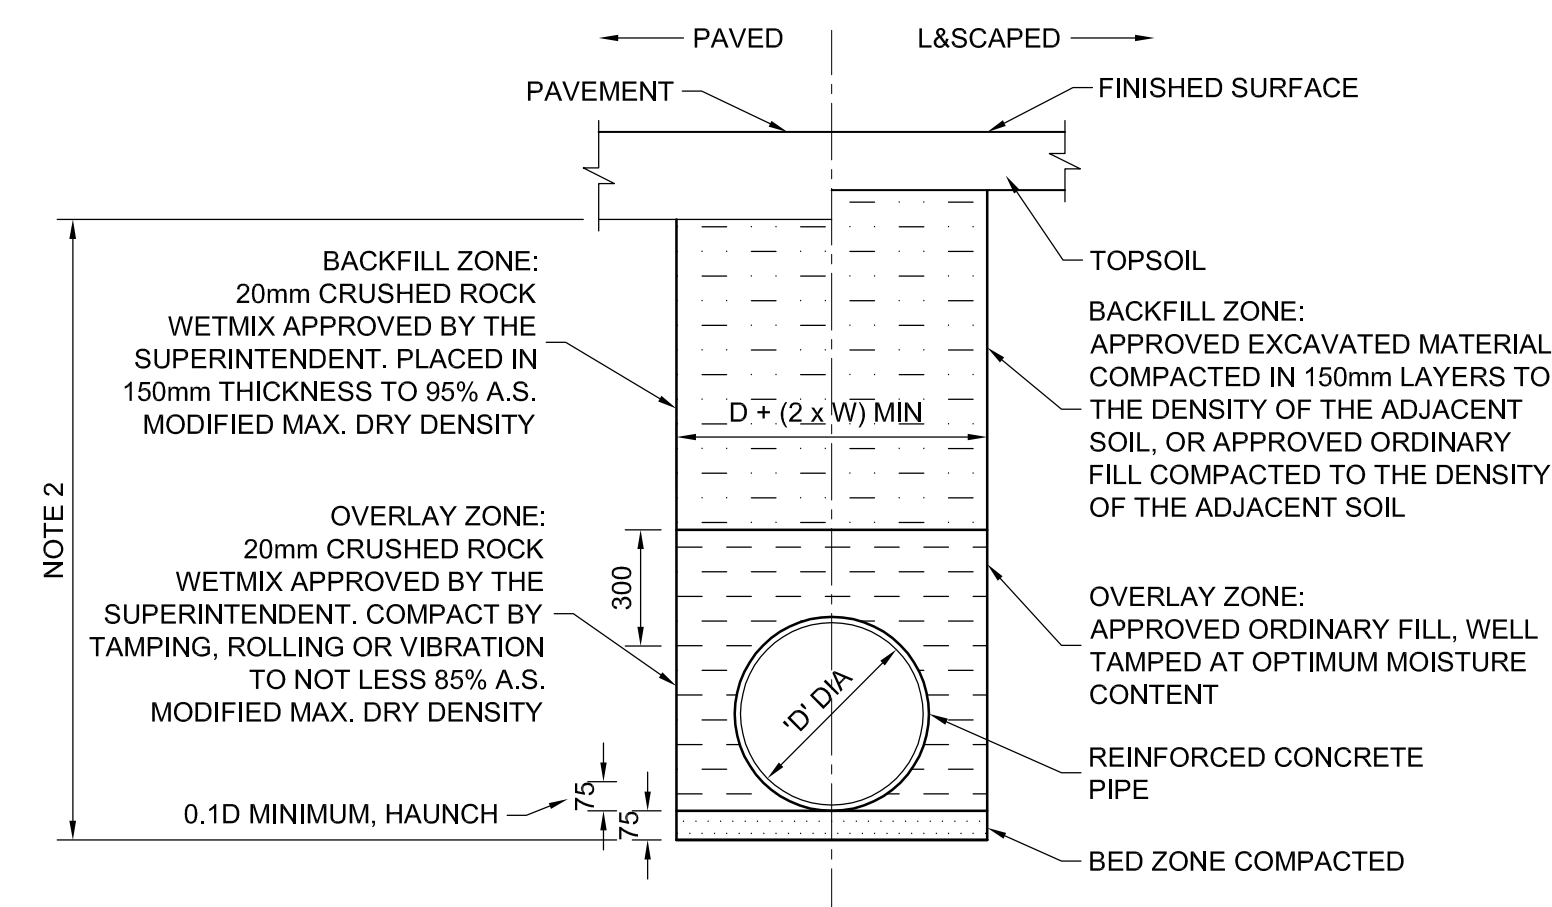

NOTE:
1 REFER TO PIPE LAYING SPECIFICATION FOR DETAILS.
2 BACKFILL OVERLAY & BEDDING ZONES 20mm CRUSHED ROCK COMPACT BY TAMPING ROLLING OR VIBRATION TO NOT LESS THAN 85% A.S. STD. MAX. DRY DENSITY.


D	W
150-300	150
375-750	300
+750	600

UPVC PIPE

TYPICAL PIPE LAYING DETAIL



1:20

REINFORCED CONCRETE PIPE

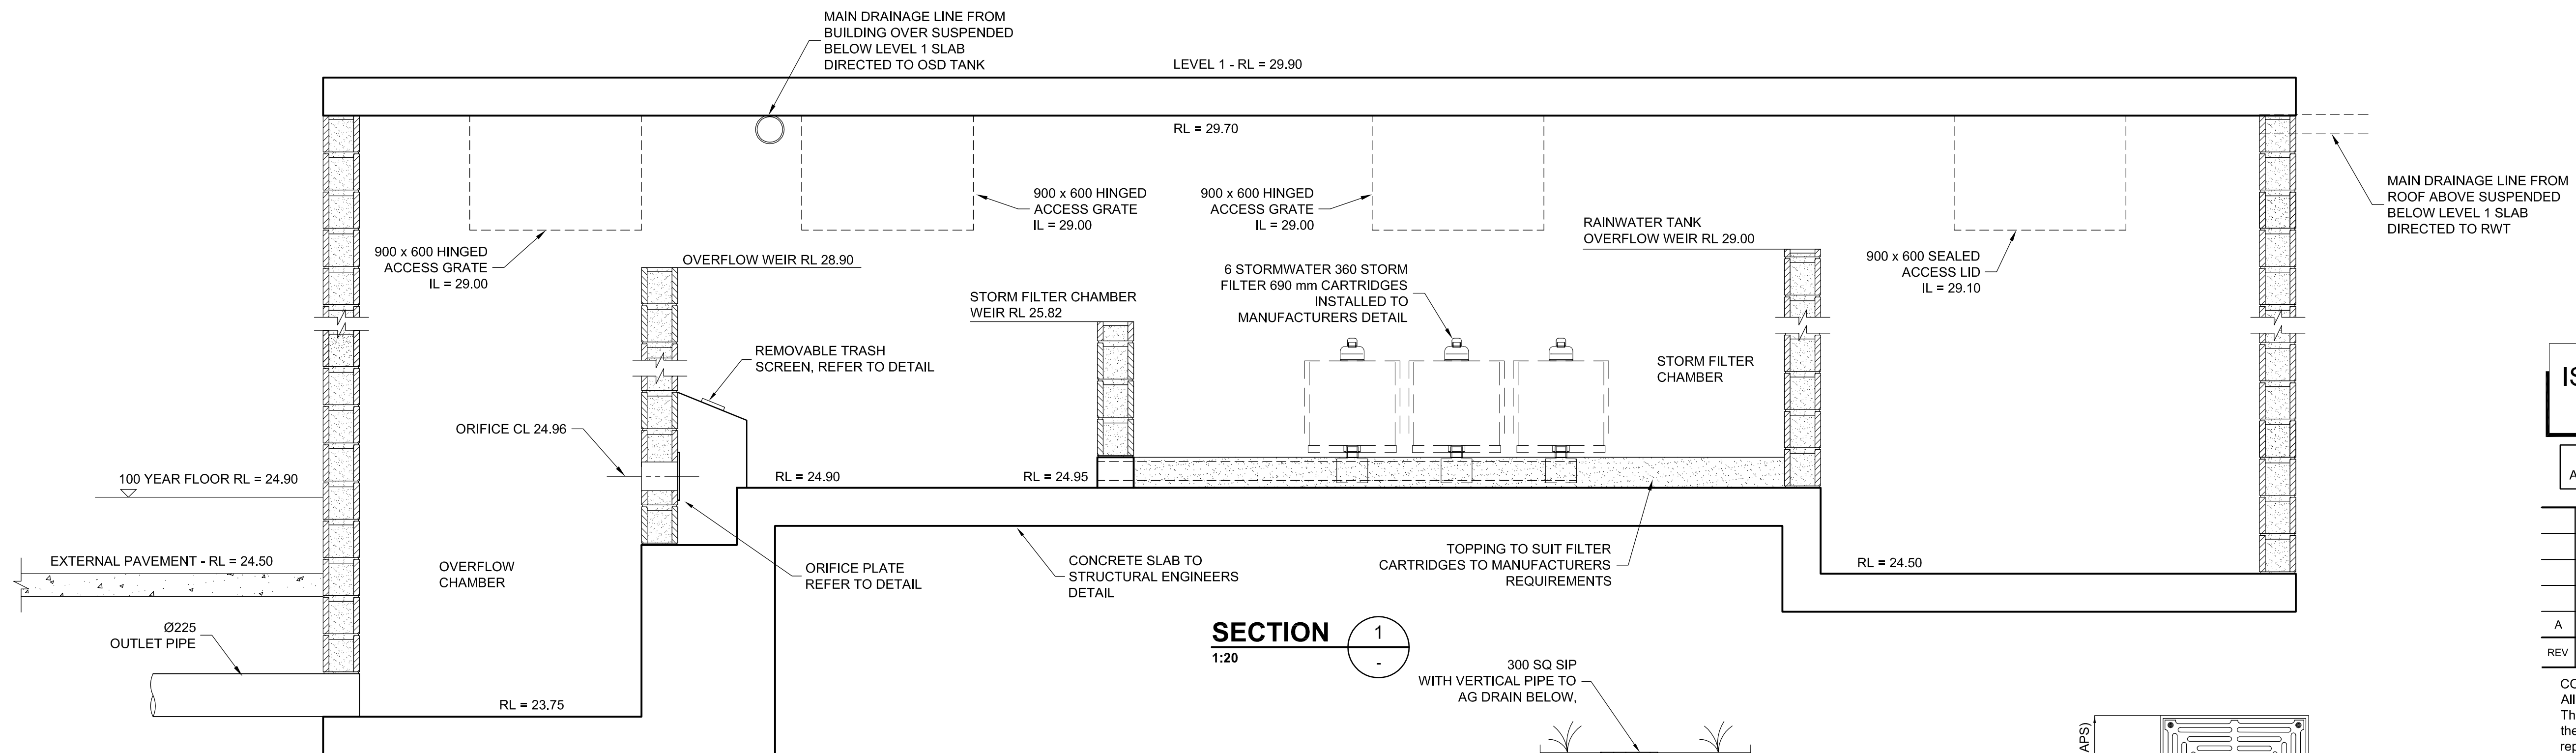


SECTION 1

1:20

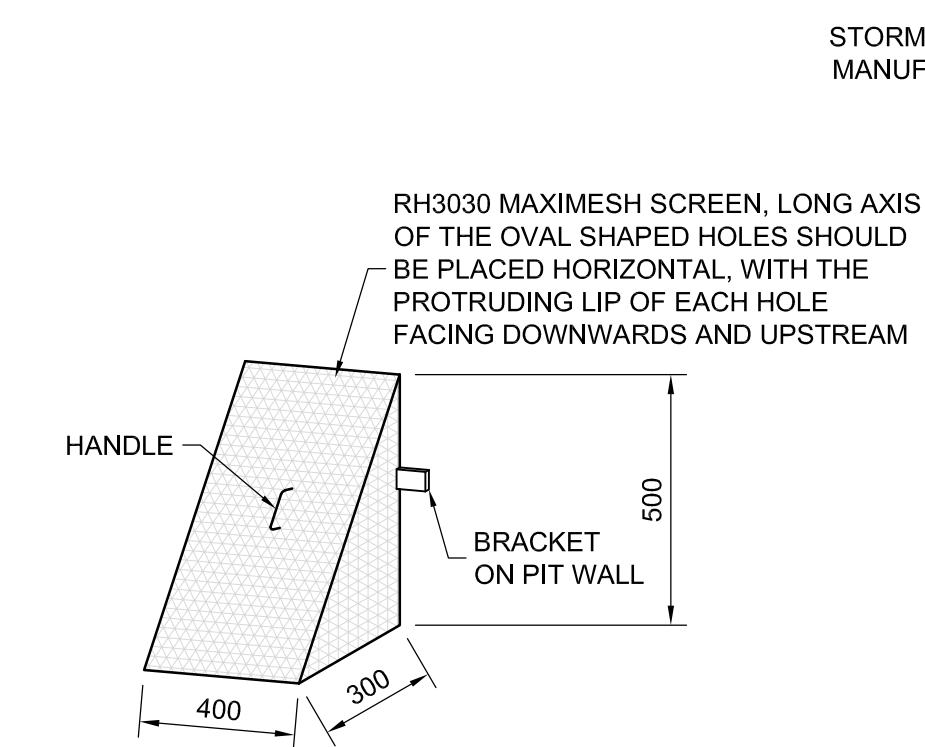


STANDARD TRASH SCREEN

NTS

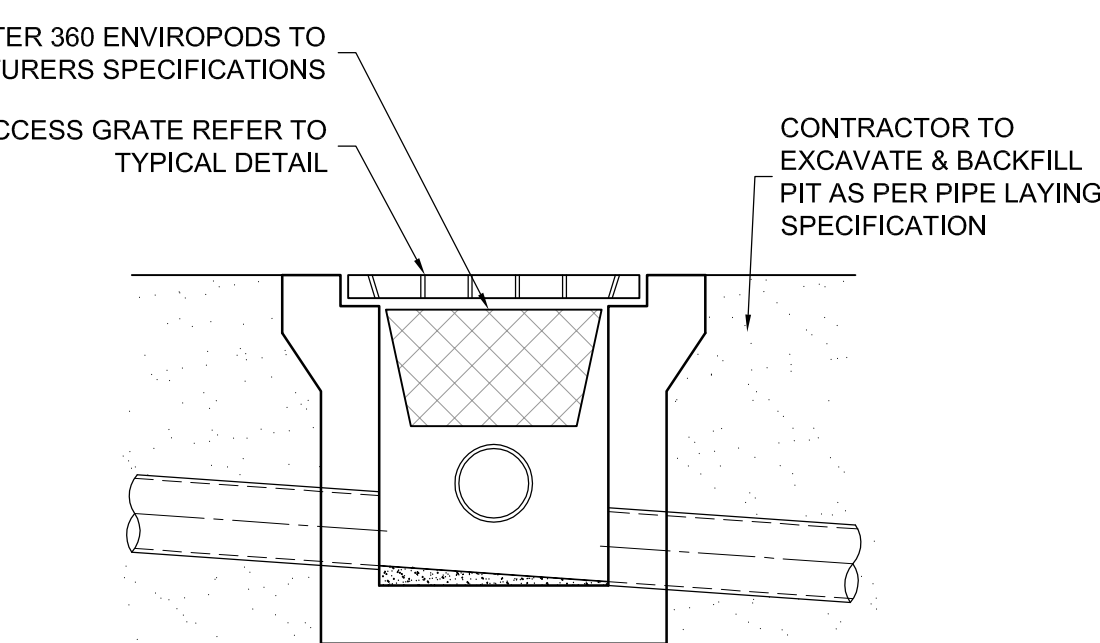


TYPICAL SURFACE INLET PIT DETAILS

1:20

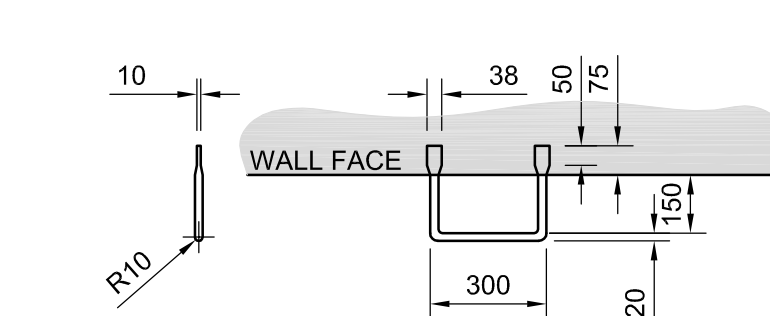


STEP IRONS FOR DRAINAGE PITS

1:20

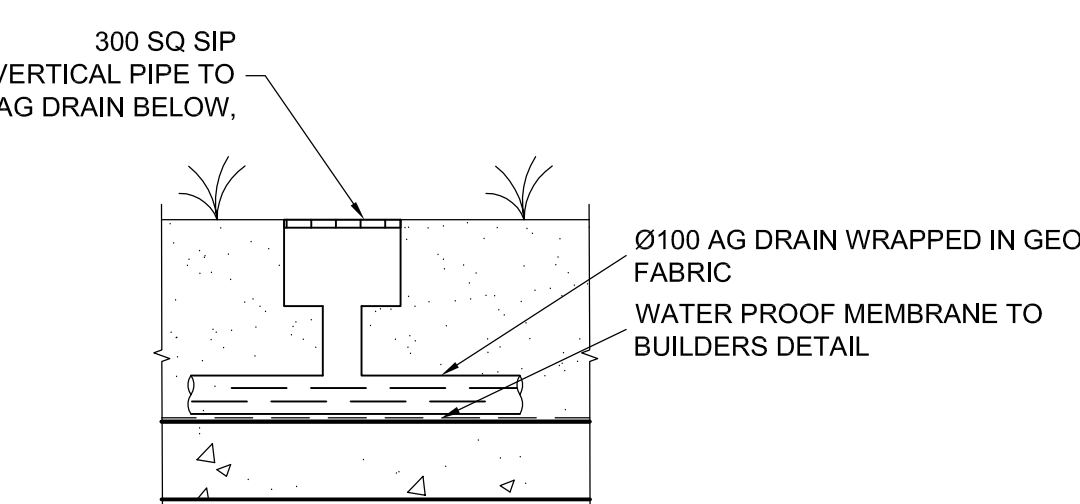



PLANTER DRAIN DETAIL

1:20

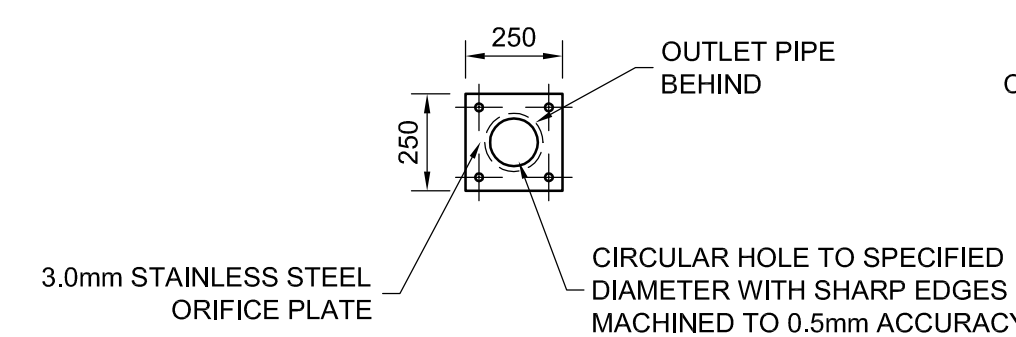

ORIFICE PLATE DETAIL

1:20

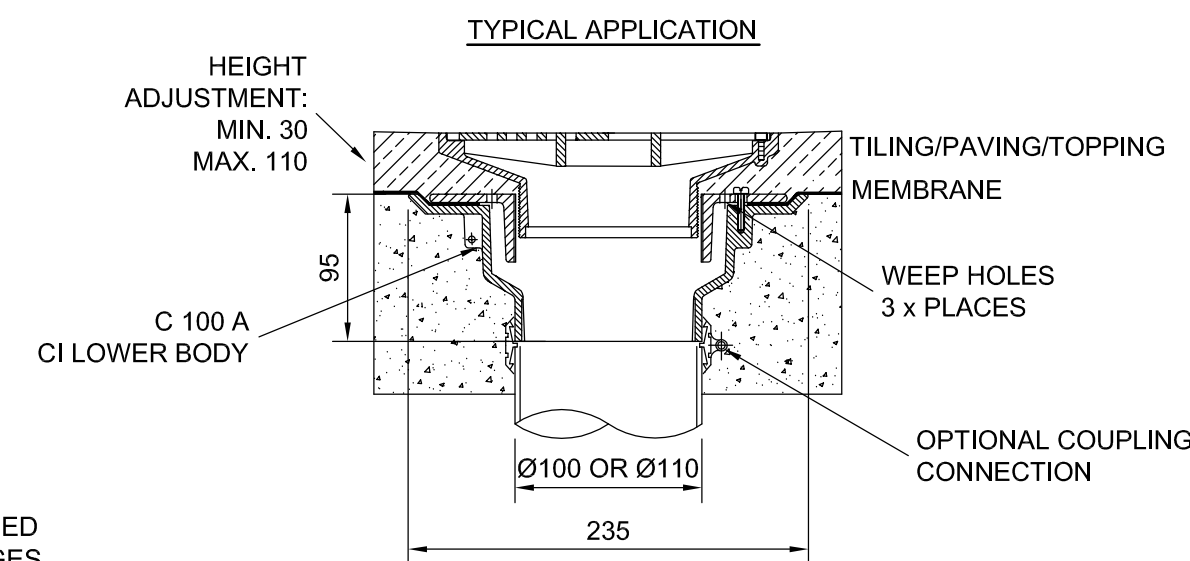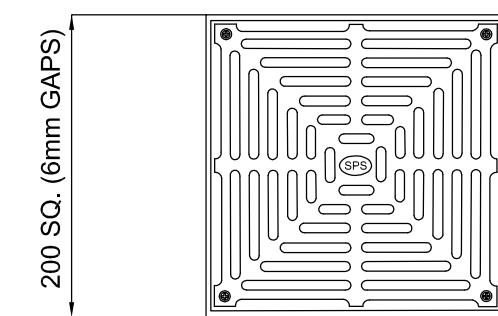

TYPICAL BO DETAIL

1:5

ISSUED FOR D.A. APPROVAL
NOT FOR CONSTRUCTION

NOTE: DO NOT SCALE OFF DRAWINGS. REFER TO ARCHITECTURAL PLANS. VERIFY DIMENSIONS ON SITE

REV	DATE	DESCRIPTION	BY
A	03.09.18	ISSUED FOR D.A. APPROVAL	MP

COPYRIGHT
All rights reserved.
These drawings, plans and specifications and the copyright are the property of ABC Consultants and must not be used, reproduced or copied wholly or in part without the written permission of ABC Consultants.



abc CONSULTANTS
structural & civil engineers

Phone: (02) 9748 9001
Fax: (02) 9748 9007
Email: info@abc-consultants.com.au
Web: www.abc-consultants.com.au
Street address: Suite 2, Level 1, Building C
1 Humeview Way Drive
RHODES NSW 2138
Postal Address: PO Box 3339
NORTH STRATHFIELD NSW 2137

MIXED USED DEVELOPMENT
AT No. 11 GIBBONS STREET, REDFERN
FOR ST GEORGE COMMUNITY HOUSING

GROUND STORMWATER DETAILS

JOB NUMBER:	DWG NUMBER:	ORIGINAL SIZE:
18032	C03.020	A1
DESIGNED BY:	DATE:	
R.K.	AUG 2018	
DRAWN BY:	SCALE:	
M.P.	AS NOTED	