

MIXED USED DEVELOPMENT AT 11 GIBBONS STREET, REDFERN

GENERAL

- G01** These drawings shall be read in conjunction with all architectural and other consultants drawings and specifications and with such other written instructions and notices as may be issued during the course of the Contract. Any discrepancies shall be referred to the Superintendent before proceeding with any related works. Construction from these drawings, and their associated consultant's drawings is not to commence until approved by the Local Authorities.
- G02** All materials and workmanship shall be in accordance with the relevant and current standards Australia codes and with the By-Laws and Ordinances of the relevant building authorities except where varied by the project specification.
- G03** All set out dimensions shall be obtained from Architect's and Engineer's details. All discrepancies shall be referred to the Architect and Engineer for decision before proceeding with related work.
- G04** During construction the structure shall be maintained in a stable condition and no part shall be over-stressed. Temporary shoring shall be provided by the builder/contractor to keep the works and excavations stable at all times.
- G05** Unless noted otherwise levels are in metres and dimensions are in millimetres.
- G06** The alignment and level of all services shown are approximate only. The contractor shall confirm the position and level of all services prior to commencement of construction. Any damage to services shall be rectified at the contractor's expense.
- G07** Any substitution of materials shall be approved by the Engineer and included in any tender.
- G08** All services, or conduits for servicing shall be installed prior to commencement of pavement construction.
- G09** Subsoil drainage, comprising 100 agriculture pipe in geo-stocking to be placed as shown and as may be directed by the superintendent. Subsoil drainage shall be constructed in accordance with the relevant local authority construction specification.
- G10** The structural components detailed on these drawings have been designed in accordance with the relevant Standards Australia codes and Local Government Ordinances for the following loadings. Refer to the Architectural drawings for proposed floor usage. Refer to drawings for live loads and superimposed dead loads.


DRAINAGE NOTES

- D01** All drainage levels to be confirmed on site, prior to any construction commencing.
- D02** All pipes within the property to be a minimum of 100 dia upvc @ 1% minimum grade upvc.
- D03** All pits within the property are to be fitted with "weldika" or approved equivalent grate:
- Light duty for landscaped areas
- Heavy duty where subjected to vehicular traffic
- D04** All pits within the property to be constructed as one of the following:
1) Precast stormwater pit
2) Cast in situ mass concrete
3) Cement rendered 220mm brickwork subject to the relevant local authority construction specification.
- D05** Ensure all grates to pits are set below finished surface level within the property. Top of all RL's are approximate only and may be varied subject to approval of the engineer. All invert levels are to be achieved.
- D06** Any pipes beneath relevant local authority road to be rubber ring jointed RCP, upvc.
- D07** All pits in roadways are to be fitted with heavy duty grates with locking bolts and continuous hinge.
- D08** Provide step irons to stormwater pits greater than 1200 in depth.
- D09** Trench back fill in roadways shall comprise sharp, clean granular back fill in accordance with the relevant local authority specification to non-trafficked areas to be compacted by rodding and tamping using a flat plate vibrator.
- D10** Where a high early discharge (hed) pit is provided all pipes are to be connected to the hed pit, upvc.
- D11** Down pipes shall be a minimum of dn100 sw grade upvc or 100 x 100 colorbond/zincalume steel, upvc.
- D12** Colorbond or zincalume steel box gutters shall be a minimum of 450 wide x 150 deep.
- D13** Eaves gutters shall be a minimum of 125 wide x 100 deep (or equivalent area) colorbond or zincalume steel, upvc.
- D14** Subsoil drainage shall be provided to all retaining walls & embankments, with the lines feeding into the stormwater drainage system, upvc.


EROSION AND SEDIMENT CONTROL NOTES

- E01** These notes are to be read in conjunction with erosion and sediment control details in this drawing set.
- E02** The contractor shall implement all soil erosion and sediment control measures as necessary and to the satisfaction of the relevant local authority prior to the commencement of and during construction. No disturbance to the site shall be permitted other than in the immediate area of the works and no material shall be removed from the site without the relevant local authority approval. All erosion and sediment control devices to be installed and maintained in accordance with standards outlined in new department of housing's "managing urban stormwater - rules and construction".
- E03** Place straw bales length ways in a row as parallel as possible to the site contours, upvc. Bale ends to be slightly butted. Bales are to be placed so that straws are parallel to the row. Bales are to be placed 1.5m to 2m down slope from the toe of the disturbed batter, upvc.
- E04** Council approved filter fabric to be entrenched 150mm deep up slope towards disturbed surface. Fabric to be a minimum SF2000 or better. Fix fabric to posts with wire ties or as recommended with manufacturer's specifications. Fabric joints to have a minimum of 150mm overlap. Wire to be strong between posts with filter fabric overlap to prevent sagging.
- E05** Stabilised entry/exit points to remain intact until finished driveway is complete. Construction of entry/exit points to be maintained and repaired as required so that its function is not compromised. Construction of entry/exit point to be in accordance with the detail contained within the drawing set.
- E06** All drainage pipe inlets to be capped until:
- downpipes connected
- pits constructed and protected with all barrier
- E07** Provide and maintain all traps around all surface inlet pits until catchment is revegetated or paved.
- E08** The contractor shall regularly maintain all erosion and sediment control devices and remove accumulated dirt from such devices such that more than 60% of their capacity is lost. All the dirt is to be placed outside the limit of works. The period for maintaining these devices shall be at least until all disturbed areas are revegetated and further as may be directed by the superintendent or council.
- E09** The contractor shall implement dust control by regularly wetting down (but not saturating) disturbed areas.
- E10** Topsoil shall be shipped and stockpiled outside hazard areas such as drainage lines. This topsoil shall be reserved later on areas to be revegetated and stabilised only. (i.e. all footpaths, batters, all regarding areas, basins and catchtraps). Topsoil shall not be re-used on any other areas unless specifically instructed by the superintendent. If they are to remain for longer than one month stockpiles shall be protected from erosion by covering them with a mesh and hydroseeding and, if necessary, by locking banks or drains downstream of a stockpile to start all backfill.
- E11** Lay 300 wide minimum turf strip on 100 topsoil behind all kerb and gutter with 1000 long turfs every 6000 and around structures immediately after backfilling as per the relevant local authority specification.
- E12** The contractor shall grass seed all disturbed areas with an approved mix as soon as practicable after completion of earthworks and grading.
- E13** Revegetate all trenches immediately upon completion of backfilling.
- E14** When any devices are to be handed over to council they shall be in clean and stable condition.

STANDARD LINE TYPES AND SYMBOLS

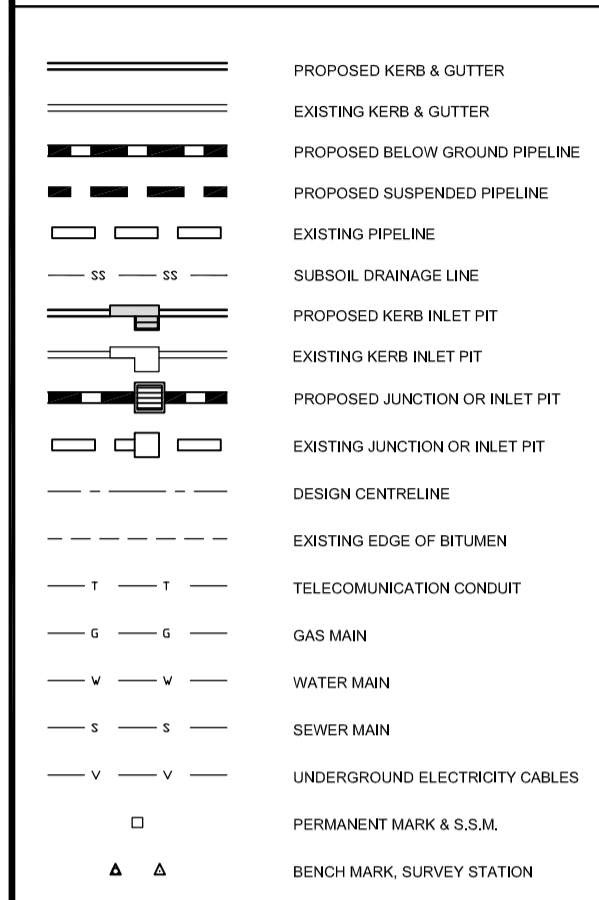

STANDARD LINE TYPES AND SYMBOLS

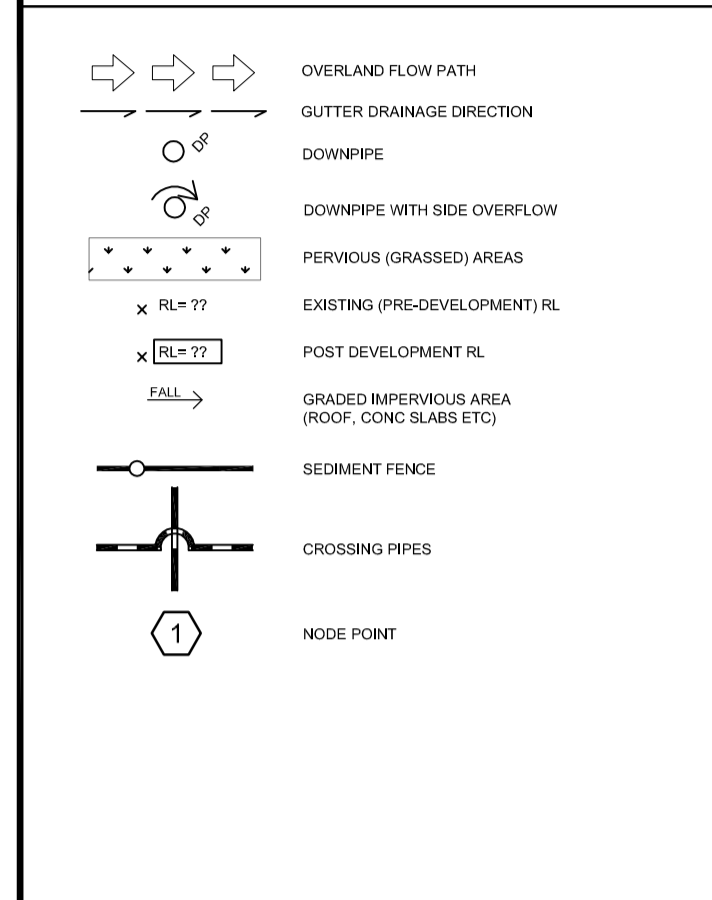

LEGEND

AHD	Australian height datum	SS	Stainless steel
AG	Apron (Sub soil drainage)	SU	Box gutter sump
AS	Average recurrence interval	TW	Top of wall
BG	Box Gutter	TWL	Top water level
BWL	Bottom water level	US	Underside of slab
CL	Cover level	VG	Vally gutter
CO	Clean out inspection opening	UND	Unless noted otherwise
DCP	Discharge control pit		
DP	Down pipe		
DRP	Drainage pipe		
EDG	Existing box gutter		
EDP	Existing down pipe		
EEG	Existing eaves gutter		
EG	Eaves gutter		
FR	Fiber reinforced concrete		
FRC	Floor waste		
FW	Grated drain		
GO	Grated surface inlet pit		
GSP	Grated surface inlet pit		
HED	High early discharge		
HP	High point of gutter		
IL	Invert level		
IO	Inspection opening		
OF	Overflow		
OSD	On-site detention		
OSD	Permeable site discharge		
PCP	Pipe 1		
RCP	Reinforced concrete pipe		
RHS	Rectangular hollow section		
RL	Reduced level		
RRJ	Rubber ring joint		
RET	Rainwater reuse tank		
RWH	Rain water head		
RWO	Rain water outlet		
SLAP	Sealed kit access pit		
SP	Sprinkler pipe		
SPR	Sprinkler		

SCHEDULE OF DRAWINGS

C00.01	GENERAL NOTES
C01.001	BULK EXCAVATION PLAN
C01.002	BULK EXCAVATION SECTIONS
C01.010	SEDIMENT AND EROSION CONTROL PLAN
C02.010	ROOF STORMWATER DRAINAGE PLAN
C02.010	GROUND STORMWATER DETAILS
C03.020	GROUND STORMWATER DETAILS

RECOMMENDED MAINTENANCE SCHEDULE

DISCHARGE CONTROL PIT (DCP)	FREQUENCY	RESPONSIBILITY	PROCEDURE
Inspect flap valve and remove any blockage.	Six monthly	Owner	Remove grate. Ensure flap valve moves freely and remove any blockages or debris.
Inspect screen and clean.	Six monthly	Owner	Remove grate and screen if required and clean it.
Inspect & remove any blockage of orifice.	Six monthly	Owner	Remove grate & screen to inspect orifice, see plan for location of dip.
Inspect dip pump & remove any sediment/sudge.	Six monthly	Owner	Remove grate and screen. Remove sediment/sudge build-up and check orifice and flap valve clear.
Inspect grate for damage or blockage.	Six monthly	Owner	Check both sides of grate for corrosion, (especially corners and welds) damage or blockage.
Inspect return pipe from storage and return any blockage.	Six monthly	Owner	Remove grate and screen, ventilate underground storage if present, open flap valve and remove any blockages in return line. Check for sludge/debris on upstream side of return line.
Inspect outlet pipe and remove any blockage.	Six monthly	Maintenance Contractor	Remove grate and screen, ventilate underground storage if present, check orifice and remove any blockages in outlet pipe. Flush outlet pipe to confirm it drains freely. Check for sludge/debris on upstream side of return line.
Check fitting of step irons is secure.	Six monthly	Maintenance Contractor	Remove grate and ensure fittings secure prior to placing weight on step iron.
Inspect overflow well & remove any blockage.	Six monthly	Maintenance Contractor	Remove grate and open cover to ventilate underground storage if required, ensure well clear of blockages.
Empty basket at overflow well (if present).	Six monthly	Maintenance Contractor	Remove grate and ventilate underground storage chamber if present. Empty basket, check fittings secure and not corroded.
Check attachment of orifice plate to wall of pit (gaps less than 5mm).	Annually	Maintenance Contractor	Remove grate and screen, ensure plate mounted securely, tighten fittings if required, seal gaps as required.
Check attachment of screen to wall of pit.	Annually	Maintenance Contractor	Remove grate and screen, ensure screen fittings secure, repair as required.
Check screen for corrosion.	Annually	Maintenance Contractor	Remove grate and examine screen for rust or corrosion, especially at corners or welds.
Check attachment of flap valve to wall of .	Annually	Maintenance Contractor	Remove grate. Ensure fittings of valve are secure.
Check flap valve seals against wall of pit.	Annually	Maintenance Contractor	Remove grate. Fill pit with water and check that flap seals against side of pit with minimal leakage.
Check any hinges of flap valve move freely.	Annually	Maintenance Contractor	Remove grate. Test valve hinge by moving flap to full extent.
Inspect dip walls (internal and external, if appropriate) for cracks or spalling.	Annually	Maintenance Contractor	Remove grate to inspect internal walls. Repair as required. Clear vegetation from external walls if necessary and repair as required.
Check step irons for corrosion.	Annually	Maintenance Contractor	Remove grate. Examine step irons and repair any corrosion or damage.
Check orifice diameter correct and retains sharp edge.	Five yearly	Maintenance Contractor	Compare diameter to design (see work-as-executed) and ensure edge is not pitted or damaged.
STORAGE			
Inspect & remove any blockage of orifice.	Six monthly	Owner	Remove grate and screen, remove sediment/sudge build-up.
Check orifice diameter correct and retains sharp edge.	Six monthly	Owner	Remove blockages from grate and check if pit blocked.
Inspect screen and clean.	Six monthly	Owner	Remove debris and suitable material likely to be carried to grate.
Check attachment of orifice plate to wall of pit (gaps less than 5mm).	Annually	Maintenance Contractor	Remove grate to inspect internal walls, repair as required, clear vegetation from external walls if necessary and repair as required.
Check attachment of screen to wall of pit.	Five yearly	Maintenance Contractor	Compare actual storage available with work-as-executed plans. If volume loss is greater than 5%, arrange for reconstruction to replace the volume lost. Council to be notified of the proposal.
Check attachment of screen to wall of pit.	Five yearly	Maintenance Contractor	Check along drainage lines and at pits for subsidence likely to indicate leakages.

ISSUED FOR D.A. APPROVAL
NOT FOR CONSTRUCTION

NOTE: DO NOT SCALE OFF DRAWINGS. REFER TO ARCHITECTURAL PLANS. VERIFY DIMENSIONS ON SITE

A	03.09.18	ISSUED FOR D.A. APPROVAL	MP
P1	27.06.18	ISSUED FOR PRELIMINARY	MP
REV	DATE	DESCRIPTION	BY

COPYRIGHT
All rights reserved.
These drawings, plans and specifications and the copyright are the property of ABC Consultants and must not be used, reproduced or copied wholly or in part without the written permission of ABC Consultants.



Phone: (02) 9748 9091
Fax: (02) 9748 9007
Email: info@abc-consultants.com.au
Web: www.abc-consultants.com.au

Street address
Suite 2, Level 1, Building C
1 Hercules Bay Drive
RHODES NSW 2138

Postal Address
PO Box 3339
NORTH STRATHFIELD NSW 2137

MIXED USED DEVELOPMENT
AT No. 11 GIBBONS STREET, REDFERN
FOR ST GEORGE COMMUNITY HOUSING

GENERAL NOTES

JOB NUMBER:	DWG NUMBER:	ORIGINAL SIZE:
18032	C00.000	A1
DESIGNED BY:	DATE:	
R.K.	JUNE 2018	
DRAWN BY:	SCALE:	
M.P.	AS NOTED	