

PEDESTRIAN WIND ENVIRONMENT STATEMENT

SITE A, LARKIN STREET, ROSEVILLE

WJ384-01AF01 (REV2)- WS REPORT

APRIL 11, 2025

Prepared for:

Aqualand Prestige 1 Pty Ltd

Level 37/264 George Street Sydney, NSW, 2000



WINDTECH CONSULTANTS

www.windtechconsult.com

reception@windtechglobal.com

Sydney | Singapore | London | Melbourne | Mumbai | New York | Hong Kong | Dubai | Miami | Toronto

DOCUMENT CONTROL

Date	Revision History	Issued Revision	Prepared By (initials)	Instructed By (initials)	Reviewed & Authorised by (initials)
March 14, 2025	Initial.	0	PM	SWR	KA
April 4, 2025	Updated introduction to include project description.	1	PM	SWR	KA
April 11, 2025	Update ground level for new drawings and landscaping.	2	KA	SWR	TR

The work presented in this document was carried out in accordance with the Windtech Consultants Quality Assurance System, which is based on International Standard ISO 9001.

This document is issued subject to review and authorisation by the Team Leader noted by the initials printed in the last column above. If no initials appear, this document shall be considered as preliminary or draft only and no reliance shall be placed upon it other than for information to be verified later.

This document is prepared for our Client's particular requirements which are based on a specific brief with limitations as agreed to with the Client. It is not intended for and should not be relied upon by a third party and no responsibility is undertaken to any third party without prior consent provided by Windtech Consultants. The information herein should not be reproduced, presented or reviewed except in full. Prior to passing on to a third party, the Client is to fully inform the third party of the specific brief and limitations associated with the commission.

EXECUTIVE SUMMARY

This report presents an opinion on the likely impact of the Site A development, located at 2 & 4 Larkin Street and 1,3 & 5 Pockley Ave, Roseville, on the local wind environment at the critical outdoor areas within and around the subject site. This report addresses the Secretary's Environmental Assessment Requirements (SEARs) Item 5 (App. No.: SSD-77829461).

The effect of wind activity has been examined for the three predominant wind directions for the region, namely the north-easterly, southerly, and westerly winds. The analysis of the wind effects relating to the proposed development have been carried out in the context of the local wind climate, building morphology and land topography.

The conclusions of this report are drawn from our extensive experience in this field and are based on an examination of the latest architectural drawings. No wind tunnel testing has been undertaken for the subject development, and hence this report addresses only the general wind effects and any localised effects that are identifiable by visual inspection of the architectural drawings provided (received 8 April 2025). The landscape masterplan for this development has also been assessed as part of this report and has been included in Appendix B. Any recommendations in this report are made only in-principle and are based on our extensive experience in the study of wind environment effects.

The results of this assessment indicate that the development has incorporated an extensive landscape strategy. This, in addition with a mixture of soft landscaping as well as hard landscaping throughout the western and northern communal areas are expected to result in wind conditions that are suited for the intended activities across the ground plane.

CONTENTS

1	Introduction	1
2	Description of Development and Surroundings	3
3	Regional Wind	5
4	Wind Effects on People	6
5	Results and Discussion	7
	5.1 Ground Level Areas along the Site Perimeter	7
	5.2 Lobby Entrance	7
	5.3 Communal Areas	8
6	References	9

Appendix A Wind Effects Glossary

Appendix B Landscape Masterplan

INTRODUCTION

The applicant seeks development consent under Division 4.7 State Significant Development of the Environmental Planning & Assessment Act 1979 (EP&A Act) for a new residential flat building development which includes the provision of in-fill affordable housing on the site at 2 & 4 Larkin Street and 1,3 & 5 Pockley Avenue, Roseville.

Specifically, this SSDA seeks approval for:

- Site preparation including demolition, excavation and tree removal of the site;
- Construction of one part 9-, part 10-storey residential flat building consisting of:
 - 3-level combined basement parking with the provision of 150 car parking spaces,
 - 111 dwellings including 29 affordable housing dwellings above carpark;
- Ground level and on-building landscaping works including communal open spaces at ground level.
- Augmentation of, and connection to, existing utilities as required.

An opinion on the likely impact of the proposed design on the local wind environment affecting pedestrians within the critical outdoor areas at the ground level within and around the subject development is presented in this report. The analysis of wind effects relating to the proposed development has been carried out in the context of the predominant wind directions for the region, building morphology of the development and nearby buildings, and local land topography. The conclusions of this report are drawn from our extensive experience in the field of wind engineering and studies of wind environment effects.

No wind tunnel testing has been undertaken for this assessment. Hence this report addresses only the general wind effects and any localised effects that are identifiable by visual inspection, and any recommendations in this report are made only in-principle.

This report also addresses the Secretary's Environmental Assessment Requirements (SEARs) for the project described in Table 1.

Table 1: Secretary's Environment Assessments Requirements

Declaration		
Name	Kiel Allen	
Qualifications	BEng(Hons) – Aerospace, Member of Engineers Australia	
The undersigned declares that this Pedestrian Wind Environment Statement has been prepared in response to the following SEARs requirements issued for the Project on 15/11/2024 for SSD-77829461:		
SEARs item no.	SEARs Requirement	Relevant Section of this Report
5	Environmental Amenity Assess amenity impacts on the surrounding locality, including lighting impacts, reflectivity, solar access, visual privacy, visual amenity, view loss and view sharing, overshadowing and wind impacts. A high level of environmental amenity for any surrounding residential or other sensitive land uses must be demonstrated.	Section 5
Signed	<i>Kiel Allen</i>	
Dated	March 14, 2025	

DESCRIPTION OF DEVELOPMENT AND SURROUNDINGS

The site is located at 2 & 4 Larkin Street and 1,3 & 5 Pockley Ave, Roseville, and is bounded by Larkin Street to the east, Pockley Avenue to the south and low rise residential to the north and west. The buildings surrounding the subject development are predominately low-rise residential buildings, with some mid-rise residential buildings to the south.

A survey of the land topography indicates a gradual slope on Larkin Street, towards the north-west and a significant slope on Pockley Avenue towards the south-west.

An aerial image of the subject site and the local surroundings is shown in Figure 1, with the frequency and magnitude of the prevailing winds is superimposed for each wind direction.

The existing site consists of 1-2 storey residential buildings. The proposed development is two building that are 10 storeys high with adjoining walkway corridors up to level 08.

The critical outdoor trafficable areas associated with the proposed development, which are the focus of this assessment with regards to wind effects, are listed as follows:

- Ground level areas along the Site Perimeter.
- Lobby Entrance.
- Communal Areas.

Legend

- Line thickness represents the magnitude of the regional wind from that direction
- Line length represents the frequency that the regional wind occurs for that direction



Figure 1: Aerial Image of the Site Location and Prevailing Wind Directions

3 REGIONAL WIND

The Sydney region is governed by three principal wind directions that can potentially affect the subject development. These winds prevail from the north-east, south, and west. These wind directions were determined from an analysis undertaken by Windtech Consultants of recorded directional wind speeds obtained from the meteorological station located at Kingsford Smith Airport by the Bureau of Meteorology (recorded from 1995 to 2016). The data has been corrected to represent winds over standard open terrain at a height of 10m above ground level. The results of this analysis are presented in Figure 2 in the form of a directional plot of the annual and 5% exceedance mean winds for the region. The frequency of occurrence of these winds is also shown in Figure 2.

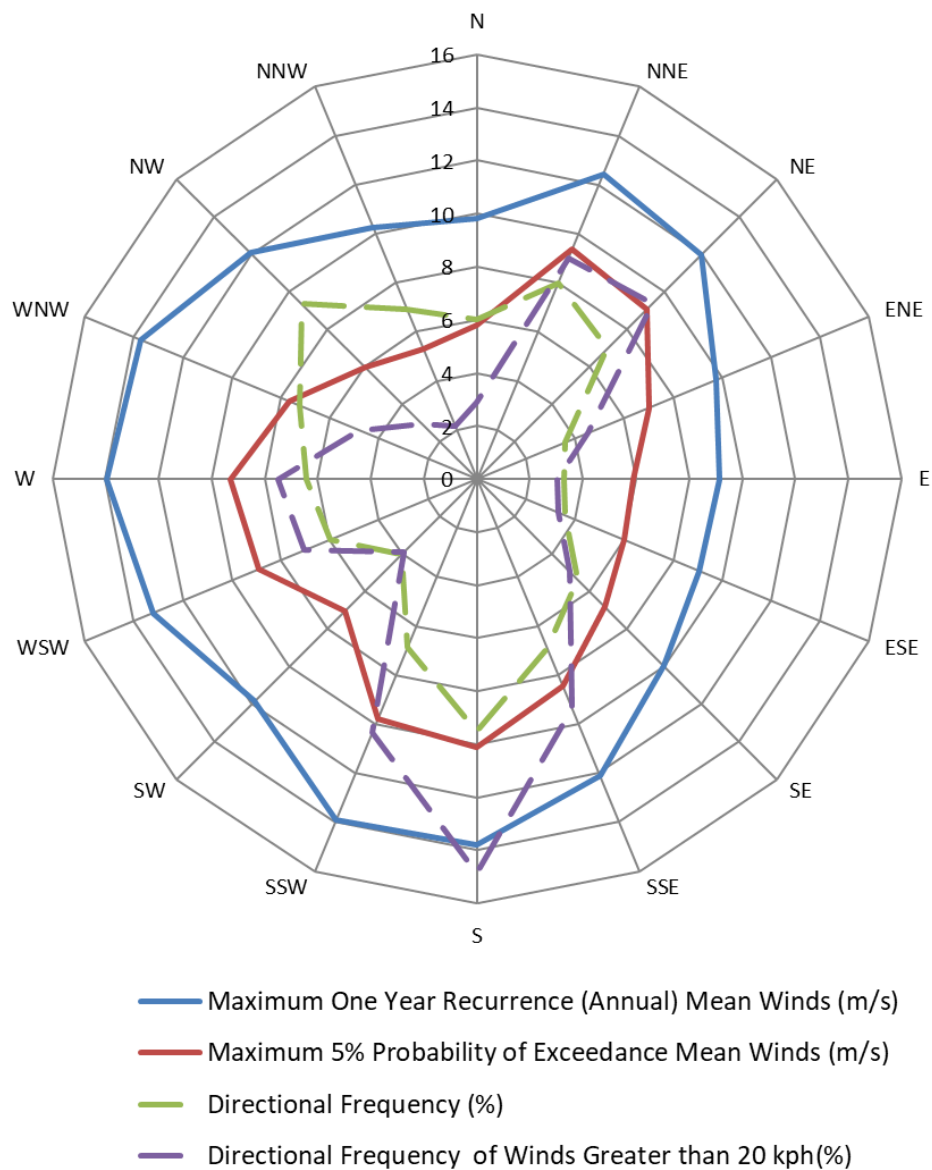


Figure 2: Directional Annual and 5% Exceedance Hourly Mean Wind Speeds (referenced to 10m height in standard open terrain), and Frequencies of Occurrence, for the Sydney Region

4 WIND EFFECTS ON PEOPLE

The acceptability of wind in any area is dependent upon its use. For example, people walking, or window-shopping will tolerate higher wind speeds than those seated at an outdoor restaurant. Various other researchers, such as A.G. Davenport, T.V. Lawson, W.H. Melbourne, and A.D. Penwarden, have published criteria for pedestrian comfort for pedestrians in outdoor spaces for various types of activities. Some Councils and Local Government Authorities have adopted elements of some of these into their planning control requirements.

For example, A.D. Penwarden (1973) developed a modified version of the Beaufort scale which describes the effects of various wind intensities on people. Table 2 presents the modified Beaufort scale. Note that the effects listed in this table refers to wind conditions occurring frequently over the averaging time (a probability of occurrence exceeding 5%). Higher ranges of wind speeds can be tolerated for rarer events.

Table 2: Summary of Wind Effects on People (A.D. Penwarden, 1973)

Type of Winds	Beaufort Number	Mean Wind Speed (m/s)	Effects
Calm	0	Less than 0.3	Negligible.
Calm, light air	1	0.3 – 1.6	No noticeable wind.
Light breeze	2	1.6 – 3.4	Wind felt on face.
Gentle breeze	3	3.4 – 5.5	Hair is disturbed, clothing flaps, newspapers difficult to read.
Moderate breeze	4	5.5 – 8.0	Raises dust, dry soil and loose paper, hair disarranged.
Fresh breeze	5	8.0 – 10.8	Force of wind felt on body, danger of stumbling
Strong breeze	6	10.8 – 13.9	Umbrellas used with difficulty, hair blown straight, difficult to walk steadily, wind noise on ears unpleasant.
Near gale	7	13.9 – 17.2	Inconvenience felt when walking.
Gale	8	17.2 – 20.8	Generally impedes progress, difficulty balancing in gusts.
Strong gale	9	Greater than 20.8	People blown over.

It should be noted that wind speeds affecting this particular development can only be accurately quantified with a wind tunnel study. This assessment addresses only the general wind effects and any localised effects that are identifiable by visual inspection and the acceptability of the conditions for outdoor areas are determined based on their intended use. Any recommendations in this report are made only in-principle and are based on our extensive experience in the study of wind environment effects.

RESULTS AND DISCUSSION

The expected wind conditions affecting the development are discussed in the following sub-sections of this report for the various outdoor areas within and around the subject development. The interaction between the wind and the building morphology in the area is considered and important features taken into account including the distances between the surrounding buildings and the proposed building form, as well as the surrounding landform. Note that only the potentially critical wind effects are discussed in this report. A glossary of the different wind effects described in this report included in Appendix A.

For this assessment, the wind speed criteria for pedestrian comfort that are considered are listed as follows:

- Walking Criterion (8m/s with a 5% probability of exceedance) for general circulation and pedestrian thoroughfares, e.g. footpaths, private balconies/terraces, through-site links etc.
- Standing (Short Exposure) Criterion (6m/s with a 5% probability of exceedance) for stationary activities generally less than an hour, e.g. waiting areas, communal terraces, main entries, café seating etc. This criterion was adopted when assessing the entrances to the Ground lobbies and communal spaces.

Note that the above wind comfort levels are derived from the Lawson (1975) criteria. Although this assessment is qualitative in nature, the abovementioned criteria for pedestrian comfort are considered when assessing the wind environment impacts. However, all areas are also assessed with consideration to a pedestrian safety criterion of 23m/s for the annual maximum gust.

The results of this assessment indicate that the development has incorporated an extensive landscape strategy. This, in addition with a mixture of soft landscaping as well as hard landscaping throughout the western and northern communal areas are expected to result in wind conditions that are suited for the intended activities across the ground plane.

5.1 Ground Level Areas along the Site Perimeter

The pedestrian footpaths along Larkin Street, Pockley Avenue and The Rifleway are primarily exposed to the north-easterly, southerly and westerly prevailing winds which have the potential to sidestream and accelerate around the corners of the buildings. Due to the setback of the building form, existing tree planting around the development and the proposed planting on the site, it is expected that the wind conditions will remain suitable. In addition, the proposed development of Site B on Pockley Avenue will assist in providing shielding of the southerly winds further ameliorating these winds.

5.2 Lobby Entrance

The pedestrian entry to the development located on Larkin Street are primarily exposed to the prevailing north-easterly. The north-easterly winds have the potential to directly impact and funnel between the two buildings of the development. The recessed design of the entrance, which links Buildings A1 and A2 at the Ground Level, as well as the proposed landscaping at the entrance and Larkin Street are expected to assist in ameliorating the north-easterly winds.

5.3 Communal Areas

The communal areas located along the western edge of the site and around the north-west corner of Building A1 are primarily exposed to the prevailing north-easterly, southerly and westerly winds. The southerly winds have the potential to sidestream along the western building façade and accelerate around the north-western corner of the development. The north-easterly winds have the potential to sidestream along the northern and southern façades of the development and accelerate around the western corners into the communal area. The westerly winds have the potential to sidestream along the northern and southern façade as well as directly impact the communal areas. The proposed landscaping along the western and northern perimeter of the development in addition to the retained trees on Pockley Avenue, Larkin Street and The Rifleway are expected to assist in ameliorating the potentially adverse wind conditions caused by these winds. The impact of the southerly winds on the proposed communal areas is likely to be significantly mitigated by the effect of the proposed development at Site B.

Davenport, A.G., 1972, "An approach to human comfort criteria for environmental conditions". Colloquium on Building Climatology, Stockholm.

Lawson, T.V., 1973, "The wind environment of buildings: a logical approach to the establishment of criteria". Bristol University, Department of Aeronautical Engineering.

Lawson, T.V., 1975, "The determination of the wind environment of a building complex before construction". Bristol University, Department of Aeronautical Engineering.

Lawson, T.V., 1980, "Wind Effects on Buildings - Volume 1, Design Applications". Applied Science Publishers Ltd, Ripple Road, Barking, Essex, England.

Melbourne, W.H., 1978, "Criteria for Environmental Wind Conditions". *Journal of Wind Engineering and Industrial Aerodynamics*, vol. 3, pp241-249.

Penwarden, A.D. (1973). "Acceptable Wind Speeds in Towns", *Building Science*, vol. 8: pp259-267.

Penwarden, A.D., Wise A.F.E., 1975, "Wind Environment Around Buildings". Building Research Establishment Report, London.

APPENDIX A WIND EFFECTS GLOSSARY

A.1 Downwash and Upwash Effects

The downwash wind effect occurs when wind is deflected down the windward face of a building, causing accelerated winds at pedestrian level. This can lead to other adverse effects as corner acceleration as the wind attempts to flow around the building, as seen in Figure A.1.

This can also lead to recirculating flow in the presence of a shorter upstream building, causing local ground level winds to move back into the prevailing wind.

The upwash effect occurs near upper level edge of a building form as the wind flows over the top of the building. This has the potential to cause acceleration of winds near the leading edge, as well as potentially reattaching onto the roof area. This effect causes wind issues particularly near the leading edges of tall building and on the rooftop areas if there is sufficient depth along the wind direction. Upwash is more apparent in taller towers and podia.

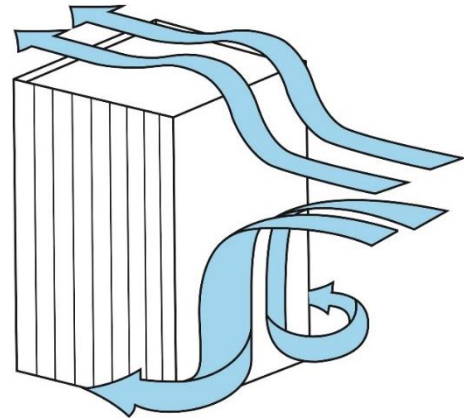


Figure A.1: Downwash Leading to Corner Wind Effect, and Upwash Effects

A.2 Funnelling/Venturi Effect

Funnelling occurs when the wind interacts with two or more buildings which are located adjacent to each other, which results in a bottleneck, as shown in Figure A.2. This causes the wind to be accelerated through the gap between the buildings, resulting in adverse wind conditions and pedestrian discomfort within the constricted space. Funnelling effects are common along pedestrian links and thoroughfares generally located between neighbouring buildings that have moderate gaps between them.

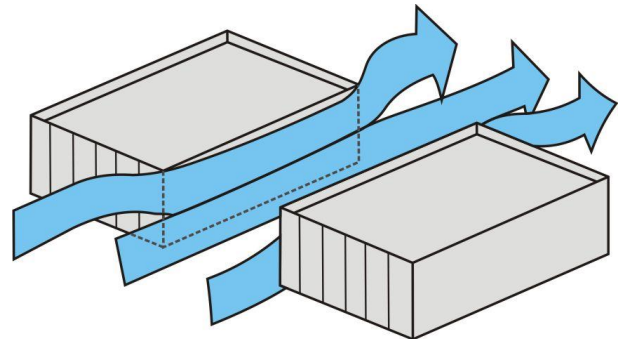


Figure A.2: Funnelling/Venturi Wind Effect

A.3 Gap Effect

The gap effect occurs in small openings in the façade that are open to wind on opposite faces, as seen in Figure A.3. This can involve a combination of funnelling and downwash effects. Presenting a small gap in the façade on the windward aspect as the easiest means through which the wind can flow through can result in wind acceleration through this gap. The pressure difference between the windward façade and the leeward façade also tends to exacerbate the wind flow through this gap.

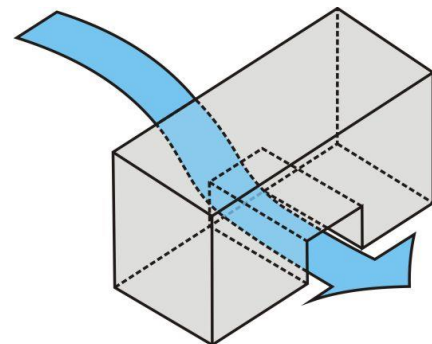


Figure A.3: Gap Wind Effect

A.4 Sidestream and Corner Effects

The sidestream effect is due to a gradual accumulation of wind shearing along the building façade that eventuates in an acceleration corner effect. The flow is parallel to the façade and can be exacerbated by downwash effects as well, or due to corner effect winds reattaching on the façade.

This is shown in Figure A.4. The corner refers to the acceleration of wind at the exterior vertical edge of a building, caused by the interaction of a large building massing with the incident wind, with the flow at the corner being accelerated due to high pressure differentials sets up between the windward façade and the orthogonal aspects. It can be further exacerbated by downwash effects that build up as the flow shears down the façade.

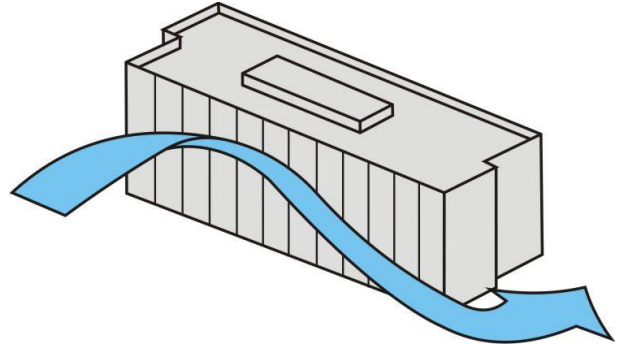


Figure A.4: Sidestream and Corner Wind Effect

A.5 Stagnation

Stagnation in a region refers to an area where the wind velocity is significantly reduced due to the effect of the flow being impeded by the bluff body. For a particular prevailing wind direction, this is typically located near the middle of the windward face of the building form or over a short distance in front of the windward face of a screen or fence. Concave building shapes tend to create an area of stagnation within the cavity, and wind speeds are generally low in these areas.

APPENDIX B LANDSCAPE MASTERPLAN

3.1 Landscape Masterplan



Site A

Figure B.1: Landscape Masterplan.