
COUNCIL REF:

REV.

1-5 NELSON ROAD LINDFIELD STORMWATER DRAINAGE SSDA CONCEPT DESIGN

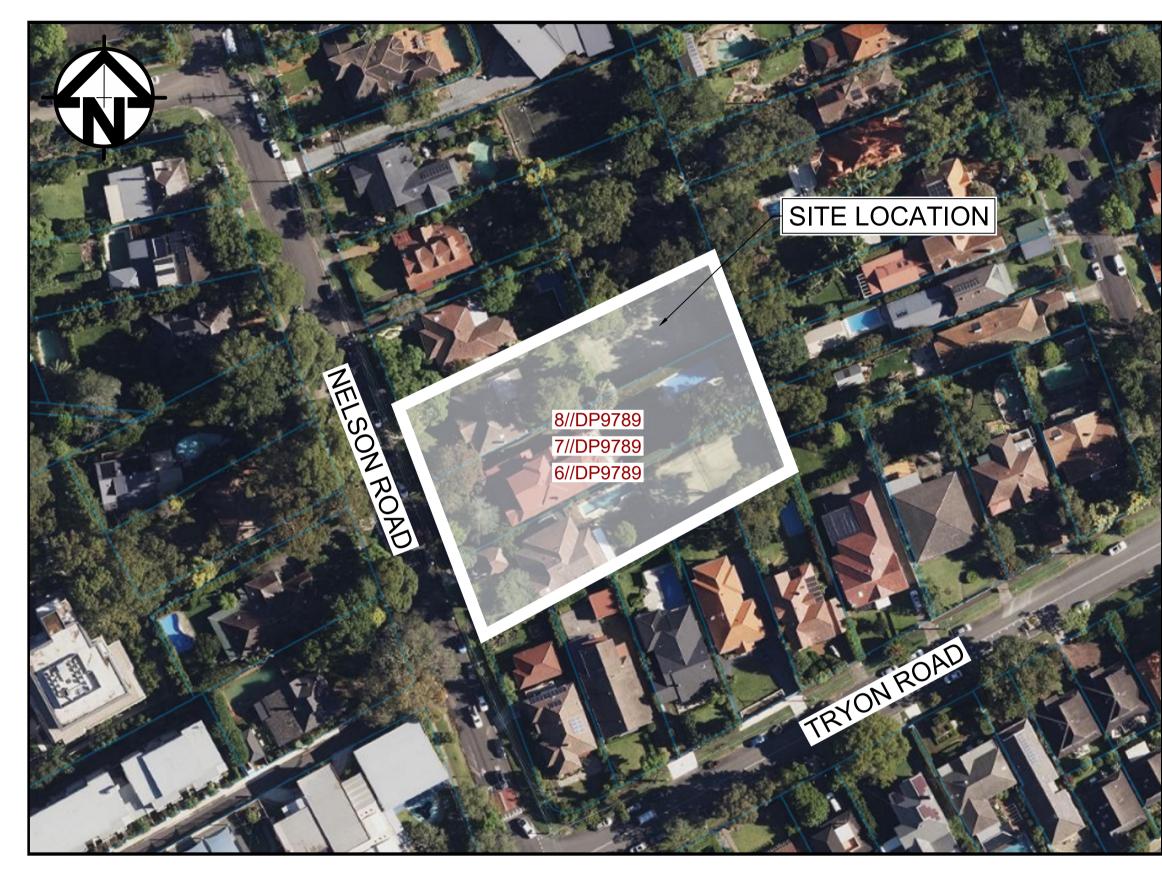

NOT TO SCALE
COPYRIGHT OF NEARMAP

ARCHITECT

CLIENT

SHEET No. DWG. No.

S01-SW100

S01-SW101 S01-SW301 DRAWING INDEX

DRAWING TITLE

COVER SHEET & DRAWING INDEX

NOTES & LEGEND

STORMWATER CONCEPT DESIGN BASEMENT 02 PLAN STORMWATER CONCEPT DESIGN BASEMENT 01 PLAN

LGA

LANDMARK GROUP



PREPARED BY



S&G CONSULTANTS PTY LTD SUITE 311, LEVEL 3 480 PACIFIC HIGHWAY ST. LEONARDS, N.S.W. 2065 T: +61 2 8883 4239

Email: office@sgce.com.au Web: www.sgce.com.au

Project No. 20250

20250078


Drawing No.

S01-SW100

Revision No. A

ISSUED FOR APPROVAL NOT FOR CONSTRUCTION

SITEWORKS LEGEND

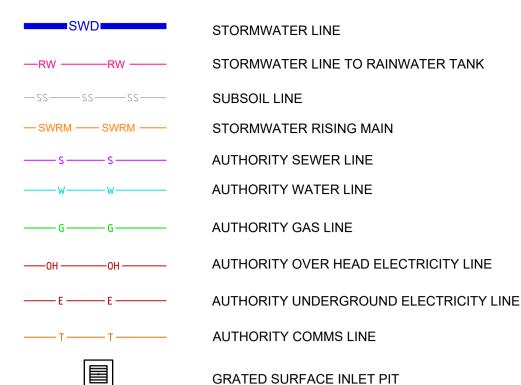

WITH ENVIROPOD INSERT

JUNCTION PIT

GRATED SURFACE INLET PIT

© RWO

RAINWATER OUTLET

CLEAR OUT POINT

DISH DRAIN OUTLET

GRATED TRENCH DRAIN

○ CO○ DDO

PD PLANTER DRAINDOWNPIPE DROP

-`_-

WARNING LIGHT

DOWNPIPE

◆ 00.00

FINISH SURFACE LEVEL

ABBREVIATIONS:

Ø or DIA DIAMETER **CLEAR OUT** DDO DISH DRAIN OUTLET DOWNPIPE EXISTING FFL FINISHED FLOOR LEVEL **GSIP** GRATED SURFACE INLET PIT INVERT LEVEL KERB INLET PIT NGL NATURAL GROUND LEVEL OFP OVERLAND FLOWPATH OSD ON-SITE DETENTION RCP REINFORCED CONCRETE PIPE REDUCED LEVEL RWT RAINWATER TANK SW STORMWATER SWP STORMWATER PIT STORMWATER RISING MAIN SWRM SWS STORMWATER SUMP TOK TOP OF KERB TOW TOP OF WALL UPVC



4-tender

5-construction

GENERAL

- G1. ALL WORK SHALL BE CARRIED OUT IN ACCORDANCE WITH COUNCIL'S REQUIREMENTS, BUILDING CODE OF AUSTRALIA, NSW CODE OF PRACTICE AND THE TO THE RELEVANT SERVICE CODES.
- G2. THESE DRAWINGS SHALL BE READ IN CONJUNCTION WITH ALL ARCHITECTURAL AND OTHER CONSULTANTS' DRAWINGS AND SPECIFICATIONS AND WITH SUCH OTHER WRITTEN INSTRUCTIONS AS MAY BE ISSUED DURING THE COURSE OF THE CONTRACT. ALL DISCREPANCIES SHALL BE REFERRED TO THE SUPERINTENDENT FOR DECISION BEFORE PROCEEDING WITH THE WORK.
- G3. ALL DIMENSIONS SHOWN ON THE DRAWINGS ARE IN MILLIMETERS (U.N.O.). DIMENSIONS SHALL NOT BE OBTAINED BY SCALING OF THESE DRAWINGS. USE FIGURED DIMENSIONS ONLY.
- G4. BENCHMARKS HAVE BEEN ESTABLISHED WHERE INDICATED ON THE DRAWINGS. ALL LEVELS ARE TO AUSTRALIAN HEIGHT DATUM (A.H.D.). THE CONTRACTOR SHALL UNDERTAKE ALL NECESSARY SURVEY WORK TO ENSURE THAT THE WORKS ARE CONSTRUCTED TO DESIGN LINE AND LEVEL.
- G5. SETTING OUT DIMENSIONS AND LEVELS SHOWN ON THE DRAWINGS SHALL BE VERIFIED BY THE CONTRACTOR.
- G6. ALL MATERIALS SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF THE RELEVANT SZZ CODES AND THE BY-LAWS AND ORDINANCES OF THE RELEVANT BUILDING AUTHORITIES.
- G7. IT IS THE CONTRACTOR'S RESPONSIBILITY TO PROVIDE ALL SAFETY FENCES, WARNING SIGNS, TRAFFIC DIVERSIONS AND THE LIKE DURING CONSTRUCTION. ALL WORKS TO COMPLY WITH WORK HEALTH AND SAFETY REQUIREMENTS AND OTHER RELEVANT AUTHORITY SAFETY REQUIREMENTS.
- G8. NO TREES SHALL BE REMOVED, CUTBACK OR RELOCATED WITHOUT THE WRITTEN INSTRUCTION FROM THE SUPERINTENDENT.
- G9. WHERE NEW WORKS ABUT EXISTING THE CONTRACTOR SHALL ENSURE THAT A SMOOTH EVEN PROFILE, FREE FROM ABRUPT CHANGES IS OBTAINED.
- G10. ALL WORKS SHALL BE CARRIED OUT IN ACCORDANCE WITH THE DETAILS SHOWN ON THE DRAWINGS AND THESE SPECIFICATIONS.
- G11. DESIGN LEVELS GIVEN ARE TO FINISHED SURFACE LEVEL AND INCLUSIVE OF TOPSOIL. (TOPSOIL DEPTH VARIES).
- G12. THE CONTRACTOR SHALL ARRANGE ALL SURVEY SETOUT TO BE CARRIED OUT BY A N.A.T.A. REGISTERED SURVEYOR.
- G13. CARE IS TO BE TAKEN WHEN EXCAVATING NEAR EXISTING SERVICES. NO MECHANICAL EXCAVATIONS ARE TO BE UNDERTAKEN OVER TELECOMMUNICATIONS OR ELECTRICAL SERVICES. HAND EXCAVATE IN THESE AREAS.
- G14. THE LOCATIONS OF UNDERGROUND SERVICES SHOWN ON THE DRAWING HAVE BEEN PLOTTED FROM DIAGRAMS PROVIDED BY SERVICE AUTHORITIES. THIS INFORMATION HAS BEEN PREPARED SOLELY FOR THE AUTHORITIES OWN USE AND MAY NOT NECESSARILY BE UPDATED OR ACCURATE.
- G15. THE POSITION OF SERVICES AS RECORDED BY THE AUTHORITY AT THE TIME OF INSTALLATION MAY NOT REFLECT CHANGES IN THE PHYSICAL ENVIRONMENT SUBSEQUENT TO INSTALLATION.
- G16. S&G CONSULTANTS DOES NOT GUARANTEE THAT THE SERVICES INFORMATION SHOWN ON THE DRAWING SHOWS MORE THAN THE PRESENCE OR ABSENCE OF SERVICES, AND WILL ACCEPT NO LIABILITY FOR INACCURACIES IN THE SERVICES INFORMATION SHOWN FROM ANY CAUSE WHATSOEVER.
- G17. IT IS THE CONTRACTOR'S RESPONSIBILITY TO OBTAIN FROM THE UTILITY SERVICES AUTHORITIES A CURRENT COPY OF UNDERGROUND SERVICES SEARCH FOR THE LOCATION OF ALL EXISTING SERVICES PRIOR TO COMMENCEMENT OF ANY WORK AND NOTIFY ANY CONFLICT WITH THE DRAWINGS IMMEDIATELY. CLEARANCE SHALL BE OBTAINED FROM THE RELEVANT REGULATORY AUTHORITY. CONTRACTOR TO KEEP COPY OF UNDERGROUND SERVICES SEARCH ON SITE AT ALL TIMES. ANY DAMAGES TO SERVICES OR SERVICES ADJUSTMENTS SHALL BE CARRIED OUT BY THE CONTRACTOR OR RELEVANT AUTHORITY AT THE CONTRACTOR'S EXPENSE.
- G18. VISIT THE SITE BEFORE SUBMITTING THE FINAL TENDER PRICE TO ASSESS 'ON SITE' CONDITIONS. FAILURE TO DO SO WILL FORFEIT ANY CLAIM FOR NOT BEING AWARE OF CONDITIONS AFFECTING THE TENDER.
- G19. THE CONTRACTOR SHALL PREPARE ACCURATE WORK-AS-EXECUTED DRAWINGS FOLLOWING THE COMPLETION OF ALL WORKS.
- G20. IT IS THE CONTRACTOR'S RESPONSIBILITY TO HAVE IN PLACE & MAINTAIN TRAFFIC FACILITIES AT ALL TIMES DURING CONSTRUCTION.
- G21. CONTRACTOR TO PROVIDE WORKSHOP COORDINATED DRAWINGS PRIOR TO COMMENCING WORKS ON SITE. WORKSHOP DRAWINGS TO BE REVIEWED AND APPROVED BY DESIGN ENGINEER.

STORMWATER

- S1. ALL WORK SHALL BE CARRIED OUT IN ACCORDANCE AS3500.3-2003: 'STORMWATER DRAINAGE'.
- S2. FOR STORMWATER DRAINAGE PIPES THAT EXCEED 1:5 GRADE, REINFORCED CONCRETE ANCHOR BLOCKS SHALL BE INSTALLED. ANCHOR BLOCKS TO BE CONSTRUCTED TO SPECIFICATIONS SET OUT IN AS3500.3-2018 SECTION 8.10.
- S3. EXISTING SERVICES SHOWN IN APPROXIMATE LOCATIONS ONLY.
 CONFIRM EXACT LOCATIONS ON SITE PRIOR TO COMMENCING WORK
- S4. COORDINATE THE INSTALLATION OF NEW SERVICES WITH ALL NEW & EXISTING SERVICES & STRUCTURAL PROVISIONS AS DETERMINED ON SITE.
- S5. ALL PIPEWORK TO BE SUPPORTED IN ACCORDANCE WITH AS3500.3-2018.
- S6. ALL PIPEWORK IS TO BE TESTED IN ACCORDANCE WITH THE REQUIREMENTS AS SET DOWN IN AS3500.3-2003. ALL IN-GROUND PIPEWORK TO BE INSPECTED BY THE SUPERINTENDENT UNDER TEST CONDITIONS PRIOR TO BACKFILLING. BACKFILLING AND BEDDING TO AS3500.3-2018.
- S7. PIPES SHALL BE TRUE TO GRADES SHOWN AND ALIGNED SO THAT THE CENTRE OF THE INLET PIPE INTERSECTS WITH THE CENTRE OF THE OUTLET PIPE AT THE DOWNSTREAM FACE OF THE PIT.
- S8. BED ALL PIPES FIRMLY AND EVENLY WITH IMPORTED FILL ONLY. THICKNESS OF BEDDING LAYER SHALL BE 75mm IN SOIL AND 200mm IN ROCK.
- S9. LAY AND JOINT ALL PIPES IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS AND AS3725-2007: DESIGN FOR INSTALLATION OF BURIED CONCRETE PIPES.
- S10. ALLOW TO TEST ALL PIPES AND PITS TO LOCAL AUTHORITY'S REQUIREMENTS.
- S11. EXCAVATE TRENCHES AND STOCKPILE ALL MATERIAL FOR INSPECTION WITH REGARD TO REUSE FOR TRENCH BACKFILL. REMAINING MATERIAL TO BE REMOVED FROM SITE.
- S12. BACKFILL PIPES WITH IMPORTED FILL. PROVIDE 200mm SIDE SUPPORT AND 150mm OVERLAY ABOVE PIPE CROWN. TRENCH FILL ABOVE THE EMBEDMENT ZONE TO THE UNDERSIDE OF THE ROAD PAVEMENT OR THE FOOTWAY SHALL BE AS FOLLOW:

UNDER ROADWAY
TRENCH FILL MATERIAL SHALL CONSIST OF IMPORTED FILL AS
SPECIFIED HEREIN OF EITHER HIGH GRADE COMPACTION SAND
OR APPROVED CRUSHED ROAD GRAVEL CONFORMING TO RMS
QA SPECIFICATION 3051 OR SIMILAR.

OTHER THAN ROADWAY
TRENCH MATERIAL EXCAVATED SHALL CONSIST OF SELECT FILL
AS SPECIFIED HEREIN AND SHALL NOT CONTAIN MORE THAN
20% OF STONES OF SIZE BETWEEN 25mm AND 75mm AND NONE
LARGER THAN 75mm. PRIOR TO USE OF THE EXCAVATED
MATERIAL IT SHALL BE INSPECTED AND APPROVED BY THE
ENGINEER.

S13. COMPACT BEDDING. EMBEDMENT AND TRENCH FILL MATERIALS AS FOLLOW:

FOR GRANULAR FILL MATERIAL (NON-COHESIVE SOIL) e.g.
COARSE AGGREGATE FILL, THE DENSITY INDEX (ID) SHALL BE

FOR GRANULAR MATERIAL (NON COHESIVE SOILS). THE DENSITY INDEX (ID) SHALL BE NOT LESS THAN 70%. FOR NON-GRANULAR FILL MATERIAL (COHESIVE SOILS), THE DRY

DENSITY RATIO (RD) SHALL BE NOT LESS THAN 95%.

S14. EXISTING SERVICES
UTILITY INFORMATION SHOWN ON THE PLANS IS NOT INTENDED TO DEPICT MORE THAN THE PRESENCE OF ANY SERVICES. ACTUAL

LOCATIONS SHOULD BE VERIFIED BY HAND EXCAVATION PRIOR TO

CONSTRUCTION.

S15. THE CONTRACTOR SHALL ALLOW FOR THE CAPPING OFF,
EXCAVATION AND REMOVAL (IF REQUIRED) OF ALL EXISTING

SERVICES IN AREAS AFFECTED BY THE WORKS.

- S16. THE CONTRACTOR SHALL ENSURE THAT SERVICES TO ALL BUILDINGS NOT AFFECTED BY THE WORKS ARE NOT DISRUPTED AT ALL TIMES. THE CONTRACTOR SHALL CONSTRUCT TEMPORARY SERVICES TO MAINTAIN EXISTING SUPPLY TO BUILDINGS REMAINING WHERE REQUIRED. ONCE THE WORKS ARE COMPLETE AND COMMISSIONED THE CONTRACTOR SHALL REMOVE ALL SUCH TEMPORARY SERVICES AND MAKE GOOD ALL DISTURBED AREAS.
- S17. DRAINAGE PIPES

 EXISTING PIPES WHICH FORM NO PART OF THE DRAINAGE SYSTEM

 SHALL BE REMOVED OR SEALED AS INDICATED ON THE PLANS. PIPES

 UP TO 300mm DIAMETER SHALL BE SEWER GRADE uPVC WITH

 SOLVENT WELDED JOINTS (U.N.O.). ALL PIPE JUNCTIONS AND TAPERS

 SHALL BE VIA PURPOSE MADE FITTINGS.
- S18. WHERE DOWNPIPES PASS UNDER FLOOR SLABS, SEWER GRADE uPVC WITH RUBBER RING JOINTS ARE TO BE USED.
- S19. MINIMUM GRADE TO DRAINAGE PIPES TO BE 1% (U.N.O.), MIN. SIZE 100mm DIAMETER (U.N.O.).

STORMWATER (CONTINUED)

- S20. PIPES EQUAL TO AND LARGER THAN 375mm DIAMETER TO BE REINFORCED CONCRETE RUBBER RING JOINTED TYPE (CLASS 2) MANUFACTURED TO AS4058 (U.N.O.).
- S21. PIPE INSTALLATION UNDER TRAFFICABLE AREAS SHALL BE IN ACCORDANCE WITH CONCRETE PIPE ASSOCIATION OF AUSTRALIA PUBLICATION "CONCRETE PIPE SELECTION & INSTALLATION" TYPE

S22. EQUIVALENT STRENGTH FRC PIPES MAY BE USED SUBJECT TO

- PUBLICATION "CONCRETE PIPE SELECTION & INSTALLATION" TYPE HS3 SUPPORT.
- S23. MINIMUM PIPE COVER TO BE 600mm UNDER TRAFFICABLE AREAS AND
- S24. CONTRACTOR TO SUPPLY AND INSTALL ALL FITTINGS AND SPECIALS INCLUDING VARIOUS PIPE ADAPTORS TO ENSURE PROPER
- S25. PROVIDE CLEANING EYES TO ALL DOWNPIPES NOT DIRECTLY CONNECTED TO PITS.

CONNECTION BETWEEN DISSIMILAR PIPEWORK.

- S26. STORMWATER DRAINAGE CONNECTIONS TO COUNCIL'S SYSTEM SHALL BE TO THE REQUIREMENTS AND THE SATISFACTION OF LOCAL COUNCIL.
- S27. DRAINAGE PITS

AUTHORITY APPROVAL.

300mm ELSEWHERE (U.N.O.).

- PITS DEEPER THAN 1200mm TO BE FITTED WITH STEP IRONS AT 300 CENTRES TO AS1657-2013: FIXED PLATFORMS, WALKWAYS, STAIRWAYS AND LADDERS DESIGN, CONSTRUCTION AND INSTALLATION'.
- S28. ALL EXPOSED EDGES TO BE ROUNDED WITH 20mm RADIUS, OR CHAMFERED 20mm x 20mm.
- S29. PIT REINFORCEMENT MESH SL82 LAP TO BE 400mm MIN. CLEAR COVER 40 MIN. CAST AGAINST BLINDING OR FORMWORK. CORNER RETURNS MAY BE FABRIC OR EQUIVALENT BARS.
- S30. BENCHING TO BE HALF OUTGOING PIPE DEPTH. CONCRETE FOR BENCHING TO BE 20MPa MASS CONCRETE.
- S31. APPROVED PRECAST PITS MAY BE USED.
- S32. 100mm DIAMETER HOLE FOR SUBSOIL DRAINAGE OUTLET TO BE LOCATED 100mm ABOVE INVERT OF ALL INLET PIPES. SUBSOIL DRAINAGE TO EXTEND FOR A DISTANCE OF 3m UPSTREAM OF PIT (AT EACH INLET TRENCH) WITH THE UPSTREAM END SEALED.
- S33. ALL CONNECTIONS TO EXISTING DRAINAGE PITS SHALL BE MADE IN TRADESMAN-LIKE MANNER AND THE INTERNAL WALL OF THE PIT AT THE POINT OF ENTRY SHALL BE CEMENT RENDERED TO ENSURE A SMOOTH FINISH.
- S34. PIT GRATE, FRAMES AND SOLID COVERS SHALL BE CLASS B IN NON TRAFFIC AREAS AND CLASS D IN TRAFFICABLE AREAS IN ACCORDANCE WITH AS3996.
- S35. ALL GRATES SHALL BE PROVIDED WITH A LOCKING CLIP.
- S36. MAXIMUM FRONT ENTRY PIPE:-STRAIGHT ENTRY - Ø750 SKEW ENTRY 45° - Ø525
- S37. PIT GRATING TO BE GALVANISED STEEL TYPE 'WELDLOK' OR APPROVED EQUIVALENT.
- S38. SUBSOIL DRAINAGE SUBSOIL PIPES SHALL BE LAID AT A MIN GRADE OF 0.5% (U.N.O.).
- S39. ADDITIONAL SUBSOIL DRAINAGE SHALL BE LAID TO SUIT SITE CONDITIONS AND GROUNDWATER PRESENCE AS DIRECTED.
- S40. SUBSOIL PIPES SHALL BE LAID BEHIND KERBS IN CUT AREAS OF THE
- S41. SUBSOIL DRAINAGE SHALL CONSIST OF A SLOTTED 100mm DIAMETER PLASTIC PIPE WRAPPED IN GEOTEXTILE AND PLACED A MINIMUM OF 600mm BELOW THE SUBGRADE LEVEL AND COVERED WITH 500mm OF 20mm GRAVEL. PROVIDE A MINIMUM OF 150mm GRAVEL AROUND SUBSOIL PIPE. TRENCH TO BE LINED WITH GEOTEXTILE FABRIC TYPE BIDIM A24.
- S42. GRATES TO PITS IN FOOTPATH AREAS SHALL BE HEEL SAFE COMPLYING WITH THE DISABLED ACCESS CODE.
- S43. CONTRACTOR TO PROVIDE WORKSHOP COORDINATED DRAWINGS PRIOR TO COMMENCING WORKS ON SITE. WORKSHOP DRAWINGS TO BE REVIEWED AND APPROVED BY DESIGN ENGINEER.
- S44. ALL EXTERNAL AREA TO HAVE A MINIMUM 1% FALL TO OUTLETS PROVIDED
- S45. PROVIDE OVERFLOWS TO ALL AREAS TO ARCHITECT'S SPECIFICATIONS.
- S46. ALL RAINWATER OUTLETS TO OPEN AREAS SHALL BE SPS TRUFLO TYPE TIA100F UNLESS NOTED OTHERWISE. DO NOT INSTALL BALCONY OUTLETS OR SIMILAR IN AREAS SUBJECT TO DIRECT RAINFALL.
- S47. ALL PVC PIPES TO HAVE EXPANSION JOINTS IN ACCORDANCE WITH AS/NZS2032.
- S48. CONNECT ALL TUNDISHES FROM MECHANICAL A/C UNITS INTO STORMWATER ONLY IF ACCEPTABLE BY THE LOCAL COUNCIL BUILDER TO VERIFY AND OBTAIN CONSENT.
- S49. ALL GRATED TRENCH DRAINS IN FRONT OF FIRE EXIT DOORS TO BE SET 100mm AWAY FROM DOOR (TYPICAL).

EROSION CONTROL

- EC1. BEFORE EARTHWORKS CAN COMMENCE THE EROSION & SEDIMENT CONTROL MEASURES MUST BE IN PLACE.
- EC2. DURING THE CONSTRUCTION PERIOD, THESE CONTROL MEASURES WILL NEED TO BE INSPECTED & MAINTAINED REGULARLY, ESPECIALLY AFTER STORM EVENTS, BY THE CONTRACTOR.
- EC3. ALL WORK IS TO BE CARRIED OUT TO PREVENT EROSION, CONTAMINATION & SEDIMENTATION OF THE STORAGE SITE, SURROUNDING AREAS & DRAINAGE SYSTEMS.
- EC4. MINIMIZE DISTURBED AREA COVERED WITH NATURAL VEGETATION.
 ONLY THOSE AREAS DIRECTLY REQUIRED FOR CONSTRUCTION ARE TO BE DISTURBED.
- EC5. INSTALL EROSION/SEDIMENT CONTROL MEASURES PRIOR TO COMMENCEMENT OF CONSTRUCTION OR EXCAVATION OPERATIONS.
- EC6. PROVIDE SILT FENCE/STRAW BAIL BARRIERS TO THE LOW SIDE OF ALL EXPOSED EARTH EXCAVATIONS. TIE SEDIMENT FENCING MATERIAL TO CYCLONE WIRE SECURITY FENCE. SEDIMENT CONTROL FABRIC SHALL BE AN APPROVED MATERIAL (EG. HUMES PROPEX SILT STOP) STANDING 300mm ABOVE GROUND & EXTENDING 150mm BELOW GROUND.
- EC7. ISOLATE EXISTING STORMWATER PITS WITH STRAW BALES OR SILT TRAPS TO FILTER ALL INCOMING FLOWS.
- EC8. DO NOT STOCKPILE EXCAVATED MATERIAL ON THE ROAD WAY.
- EC9. DIVERT CLEAN WATER FROM UNDISTURBED AREAS AROUND THE WORKING AREAS.
- EC10. CONSTRUCTION ENTRY/EXIT SHALL BE VIA THE LOCATION NOTED ON THE DRAWING. CONTRACTOR SHALL ENSURE ALL DROPPABLE SOIL & SEDIMENT IS REMOVED PRIOR TO CONSTRUCTION TRAFFIC EXITING SITE. CONTRACTOR SHALL ENSURE ALL CONSTRUCTION TRAFFIC ENTERING AND LEAVING THE SITE DO SO IN A FORWARD DIRECTION.
- EC11. TREAT THE STORMWATER RUNOFF WITH SUSPENDED SOLIDS SO THE DISCHARGE WATER QUALITY TO COUNCIL STORMWATER DRAINAGE SYSTEM HAS A MAXIMUM CONCENTRATION OF SUSPENDED SOLIDS THAT DOES NOT EXCEED 50 MILLIGRAMS PER LITRE IN ACCORDANCE WITH THE PROTECTION OF THE ENVIRONMENT OPERATION ACT (POEO 1997) AND SHALL BE APPROVED BY LOCAL COUNCIL
- EC12. ADOPT TEMPORARY MEASURES AS MAY BE NECCESSARY FOR EROSION & SEDIMENT CONTROL, INCLUDING BUT NOT LIMITED TO THE FOLLOWING:

DRAINS:

TEMPORARY DRAINS AND CATCH DRAINS.

SPREADER BANKS OR OTHER

TO DISPERSE CONCENTRATED RUNOFF.

CONSTRUCTION AND MAINTENANCE OF SILT

TRAPS TO PREVENT DISCHARGE OF SCOURED

MATERIAL TO DOWNSTREAM AREAS.

- EC13. AFTER RAIN, INSPECT, CLEAN, AND REPAIR IF REQUIRED, TEMPORARY EROSION & SEDIMENT CONTROL MEASURES.
- EC14. REMOVE TEMPORARY EROSION &SEDIMENT CONTROL MEASURES
 WHEN THEY ARE NO LONGER REQUIRED.
- EC15. COMPLY WITH THE REQUIREMENTS OF LANDCOM'S MANAGING URBAN STORMWATER SOIL AND CONSTRUCTION 'THE BLUE BOOK' LATEST
- EC16. THE EROSION & SEDIMENT CONTROL PLAN PROVIDED IS ONLY INDICATIVE. THE CONTRACTOR SHOULD PREPARE A DETAILED ESCP SUITABLE FOR THE SPECIFIC SITE CONDITIONS.

Reference Coordination Drawing Quality Control Discipline Drawing Title and Number Date Rev DRAWN ARCH 12.06.28 **STRUCT** CHECKED DATE MECH 12.06.28 ELEC DATE DESIGNED 12.06.28 | 06 | HYD SSUED FOR APPROVA 12.06.28 | Status | FIRE Issue | Last revision title Date LANDS 12.06.28 Issuer internal sequence and revision history I-preliminary 3-construction certificate CIVIL APPROVED 2-development application

SURVEY

6-other

ENGINEERS
AUSTRALIA
Chartered Professional Engineer
MEMBER
WARNING: THE DESIGNS DRAWINGS SPEC

MEMBER

WARNING: THE DESIGNS, DRAWINGS, SPECIFICATIONS AND THE
COPYRIGHT HEREIN REMAIN THE SOLE INTELLECTUAL PROPERTY OF
S&G CONSULTANTS PTY LTD AND MUST NOT BE USED, COPIED,
ALTERED OR REPRODUCED WHOLLY OR IN PART IN ANY FORM
WITHOUT THE WRITTEN CONSENT OF S&G CONSULTANTS PTY LTD

DIMENSIONS NOT SHOWN TO BE CHECKED ON SITE. DO NOT SCALE
OF THIS DRAWING. POSITIONS OF AUTHORITIES MAINS AND/OR
EXISTING SERVICES ARE TO BE CHECKED PRIOR TO COMMENCEMENT
OF WORK. REPORT ANY DISCREPANCIES TO THE CONSULTING

ENGINEER FOR DECISION/CLARIFICATION REFORE PROCEEDING WITH

THE WORK. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE

SPECIFICATIONS AND OTHER CONSULTANTS' DRAWINGS.

Scales

Client

LANDMARK GROUP

Architect



S&G CONSULTANTS PTY LTD
SUITE 311, LEVEL 3
480 PACIFIC HIGHWAY
ST. LEONARDS, N.S.W. 2065
T: +61 2 8883 4239
Email: office@sgce.com.au
Web: www.sgce.com.au
SEDA COL

1-5 NELSON ROAD
LINDFIELD
STORMWATER DRAINAGE


SSDA CONCEPT DESIGN


Drawing Title
NOTES & LEGEND

A.B.N. 21 118 222 530

Datum Shee A.H.D. 02 Project No. Set No. - Drg No. Revision No. 20250078 S01-SW101 A




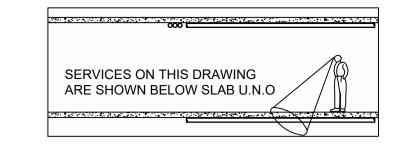


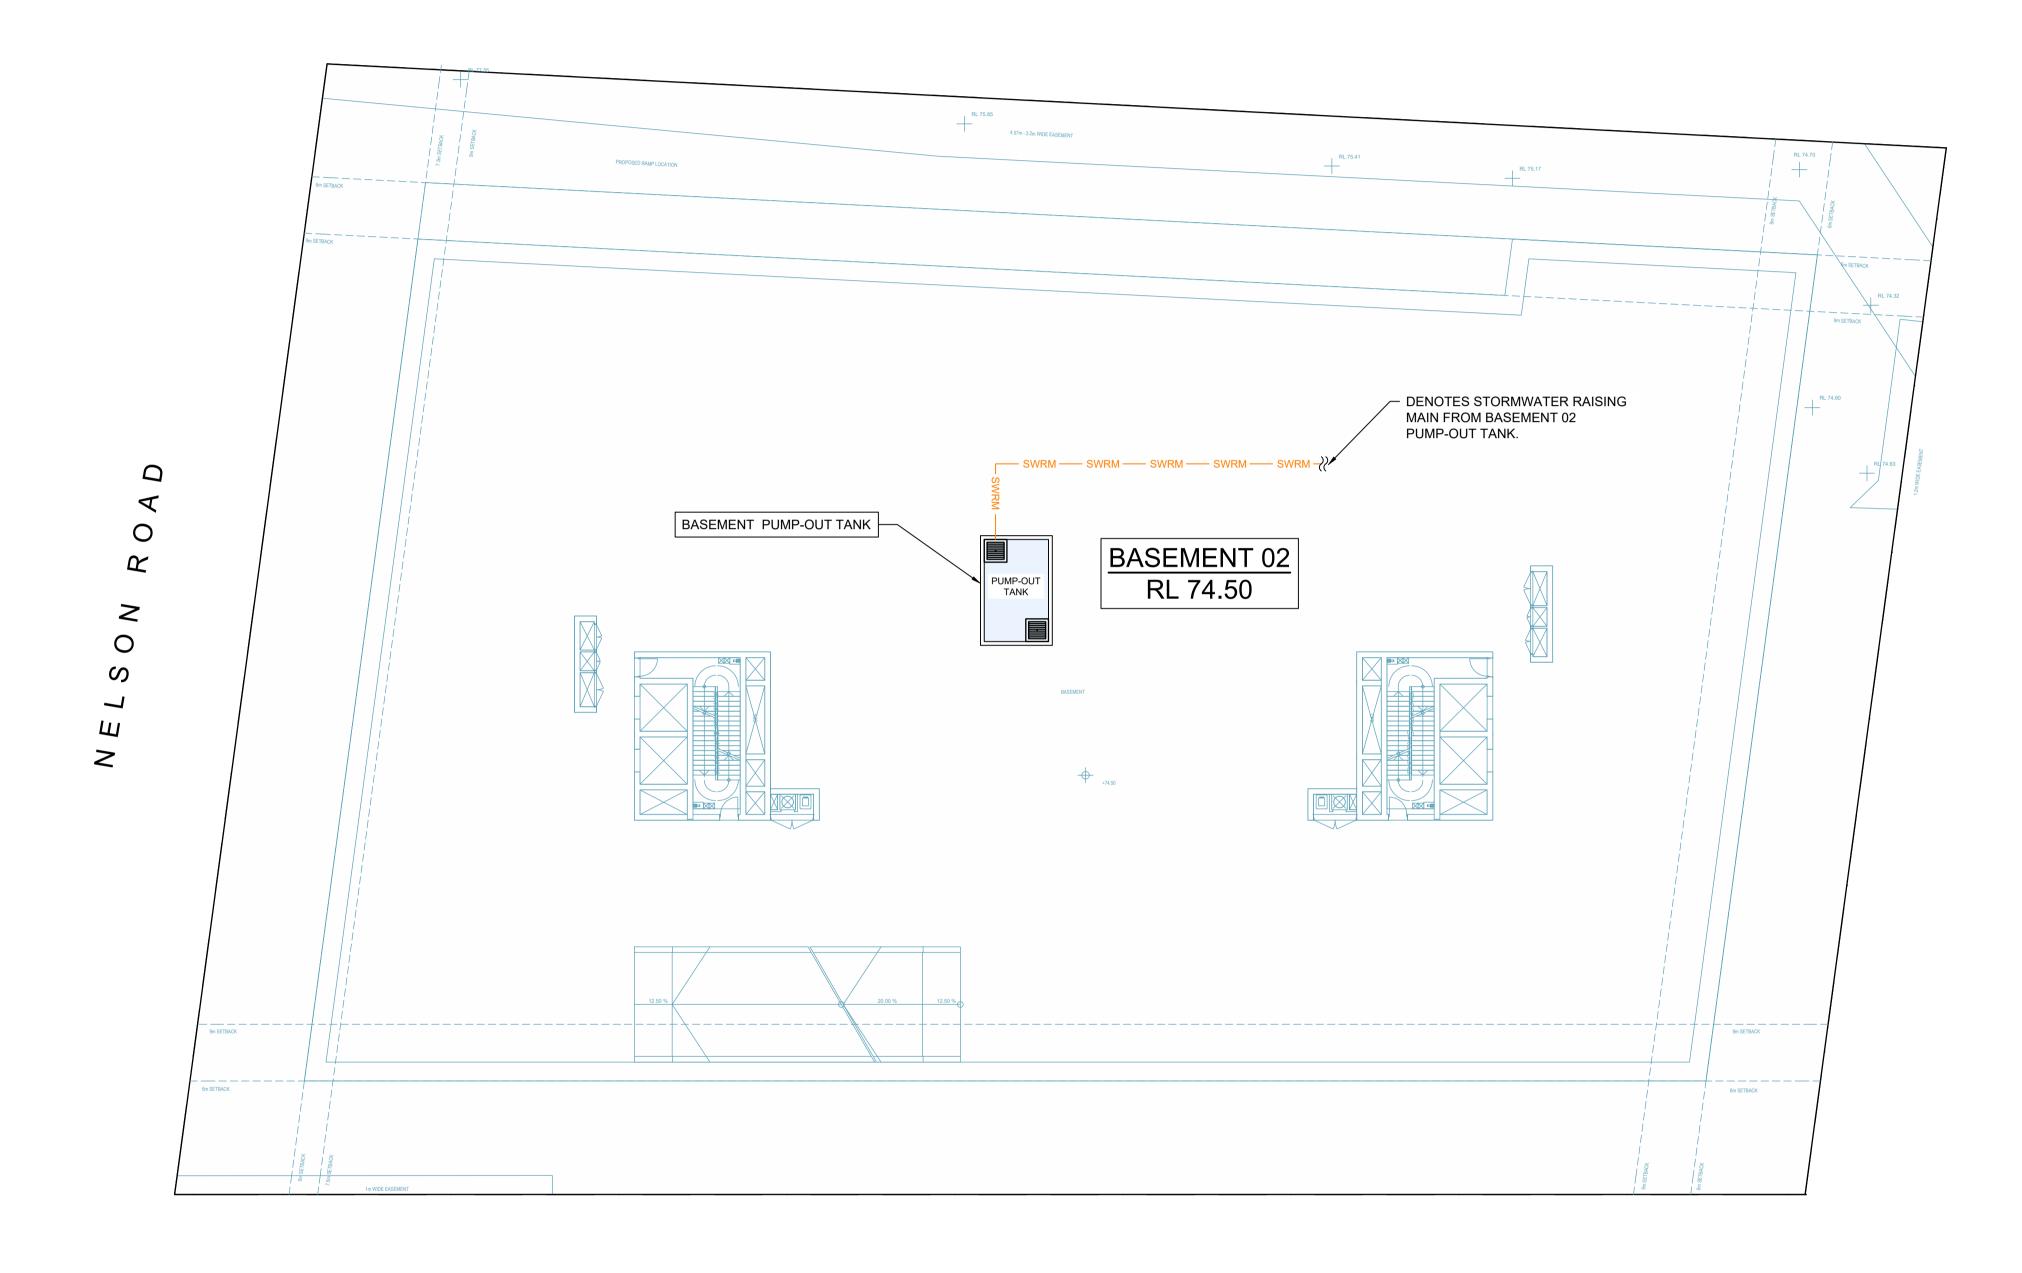

Reference Coordination Drawing Discipline Drawing Title and Number Date Re	Quality Control	ENGINEERS AUSTRALIA Chartered Professional Engineer	Scales	Client	Architect		SHITE 311 LEVEL 3	PROJECT	Status ISSUED FOR APPROVAL NOT FOR CONSTRUCTION
ARCH	DRAWN DATE 12.06.28	MEMBER WARNING: THE DESIGNS, DRAWINGS, SPECIFICATIONS AND THE	0m <u>2 4 6 8 1</u> 0				180 PACIFIC HIGHWAY	1-5 NELSON ROAD	Drawing Title STORMWATER CONCEPT DESIGN
STRUCT MECH	CHECKED DATE 12.06.28	S&G CONSULTANTS PTY LTD AND MUST NOT BE USED, COPIED, ALTERED OR REPRODUCED WHOLLY OR IN PART IN ANY FORM	SCALE 1:200 ON ORIGINAL SIZE	LANDMARK GROUP			maile affice @ages com ou	LINDFIELD	BASEMENT 02 PLAN
A ISSUED FOR APPROVAL MS 12.06.28 06 HYD	DESIGNED DATE 12.06.28	WITHOUT THE WRITTEN CONSENT OF S&G CONSULTANTS PTY LTD DIMENSIONS NOT SHOWN TO BE CHECKED ON SITE. DO NOT SCALE		LANDWARK GROUP			Web. www.sgce.com.au	STORMWATER DRAINAGE	
Issue Last revision title By Date Status FIRE	VERIFIED DATE	OF THIS DRAWING. POSITIONS OF AUTHORITIES MAINS AND/OR EXISTING SERVICES ARE TO BE CHECKED PRIOR TO COMMENCEMENT OF WORK REPORT ANY DISCREPANCIES TO THE CONSULTING				SGC		SSDA CONCEPT DESIGN	Project No. Set No Drg No. Revision No.
Issuer internal sequence and revision history 1-preliminary 2-development application 3-construction certificate 4-tender 5-construction 6-other SURVEY	APPROVED DATE 12.06.28	ENGINEER FOR DECISION/CLARIFICATION BEFORE PROCEEDING WITH THE WORK. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE SPECIFICATIONS AND OTHER CONSULTANTS' DRAWINGS.				500	A.B.N. 21 118 222 530	Grid Datum Sheet A.H.D. 03	20250078 S01-SW301 A



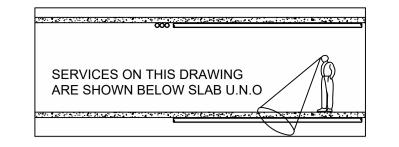

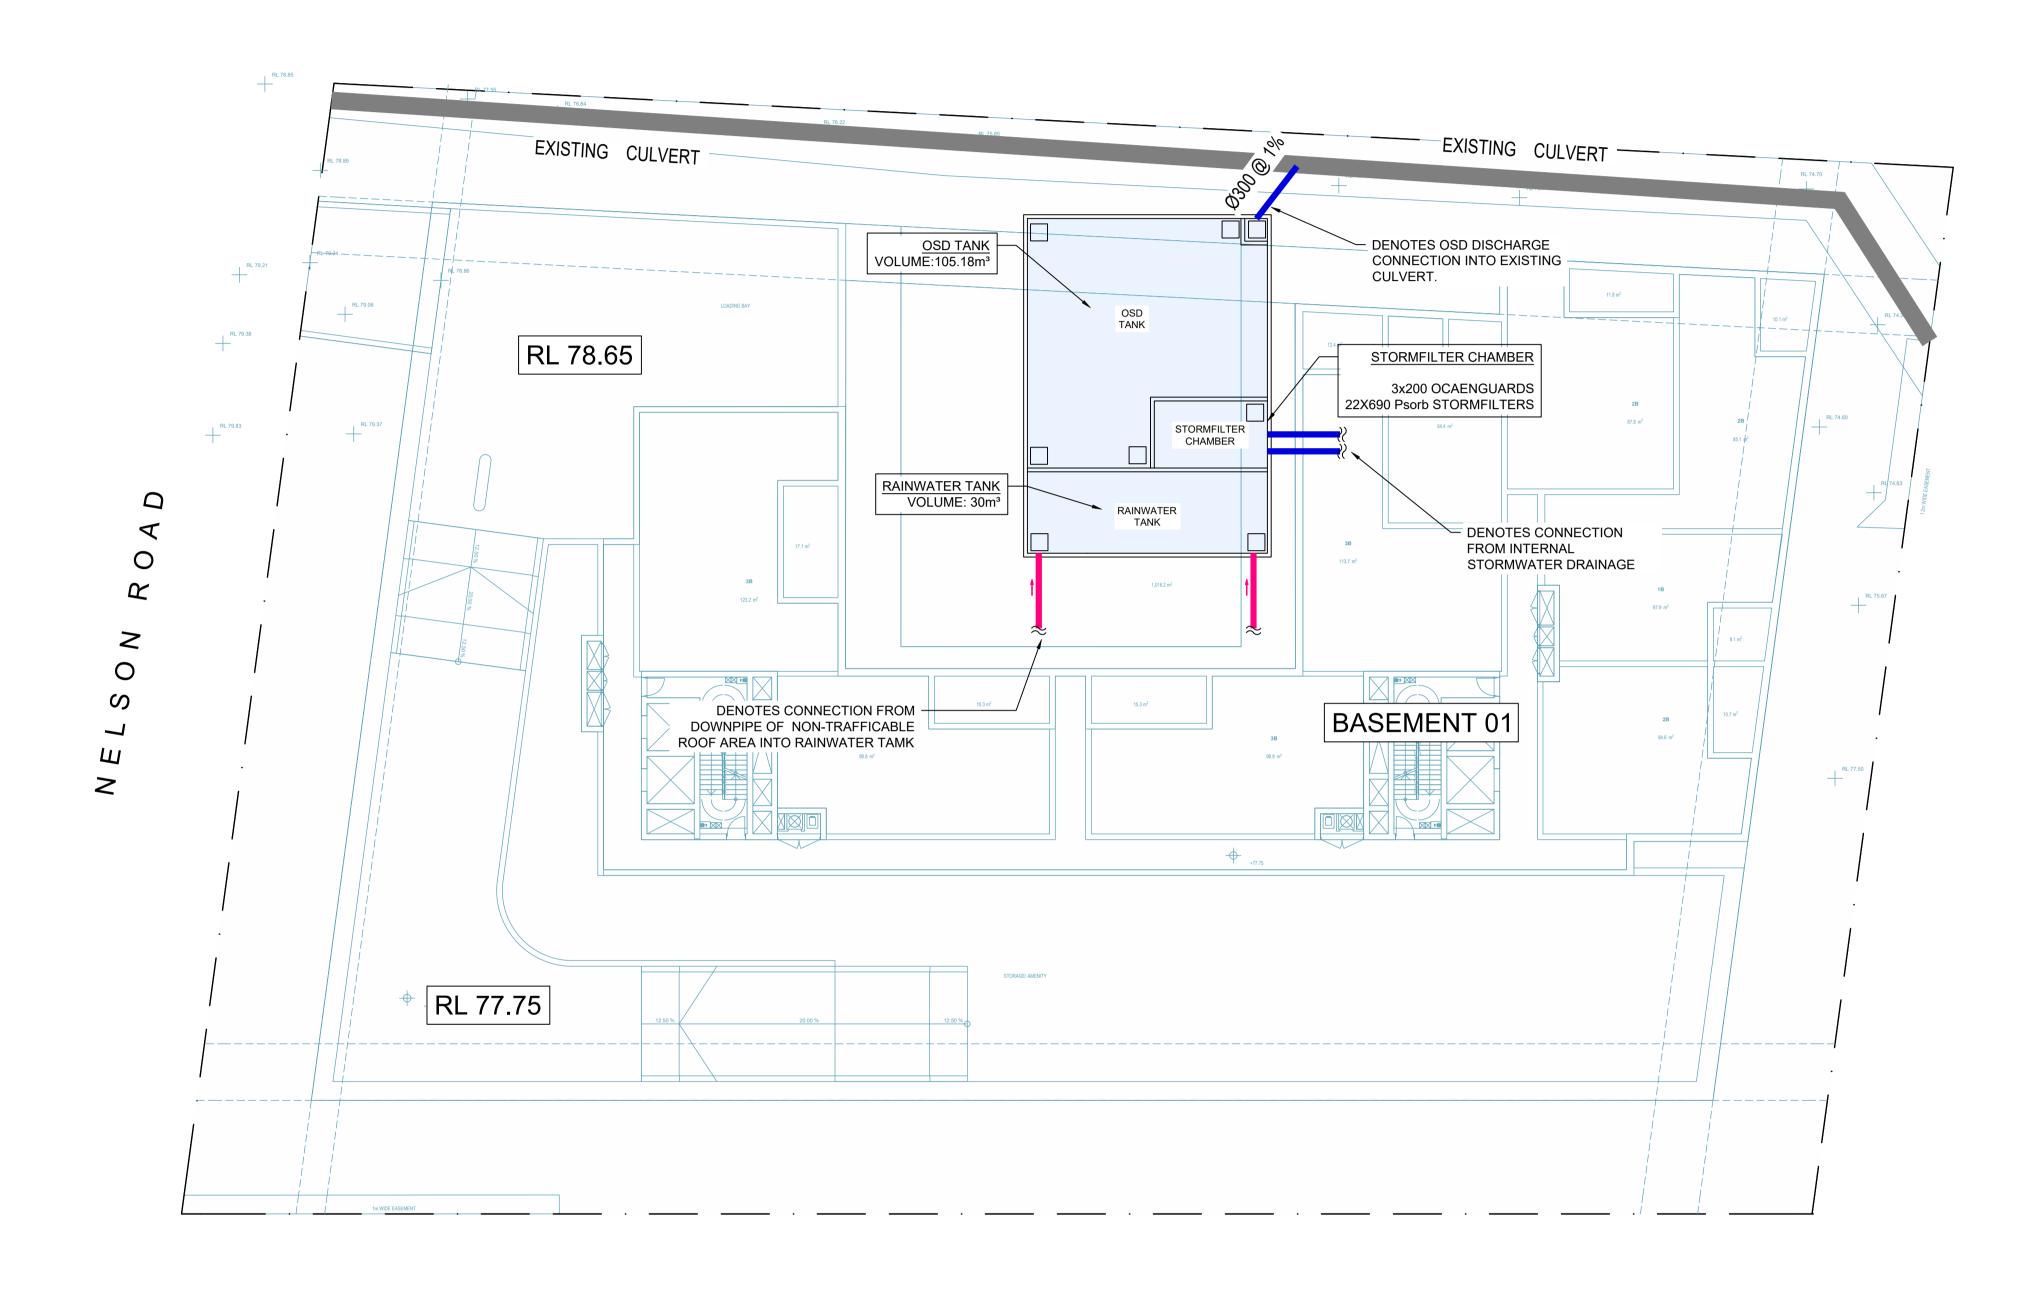

Reference Coordination Drawing Discipline Drawing Title and Number Date	Rev. DRAWN DATE ENGINEERS AUSTRALIA Chartered Professional Engineer MEMBER	Scales	Client	Architect	S&G CONSULTANTS PTY LTD SUITE 311, LEVEL 3 480 PACIFIC HIGHWAY PROJECT 1-5 NELSON ROAD Status ISSUED FOR APPROVAL NOT FOR CONSTRUCTION Drawing Title
ARCH STRUCT MECH ELEC	Table 12.06.28 CHECKED DATE 12.06.28 CHECKED DATE 12.06.28 DESIGNED DATE DESIGNED DATE 12.06.28 WARNING: THE DESIGNS, DRAWINGS, SPECIFICATIONS AND THE COPYRIGHT HEREIN REMAIN THE SOLE INTELLECTUAL PROPERTY OF S&G CONSULTANTS PTY LTD AND MUST NOT BE USED, COPIED, ALTERED OR REPRODUCED WHOLLY OR IN PART IN ANY FORM WITHOUT THE WRITTEN CONSENT OF S&G CONSULTANTS PTY LTD	0m 2 4 6 8 10 SCALE 1:200 ON ORIGINAL SIZE	LANDMARK GROUP	N K N	480 PACIFIC HIGHWAY ST. LEONARDS, N.S.W. 2065 T: +61 2 8883 4239 Email: office@sgce.com.au Web: www.sgce.com.au Web: www.sgce.com.au
A ISSUED FOR APPROVAL MS 12.06.28 06 HYD	T2.06.28 VERIFIED DATE 12.06.28 VERIFIED DATE 12.06.28 APPROVED DATE 12.06.28 DIMENSIONS NOT SHOWN TO BE CHECKED ON SITE. DO NOT SCALE OF THIS DRAWING. POSITIONS OF AUTHORITIES MAINS AND/OR EXISTING SERVICES ARE TO BE CHECKED PRIOR TO COMMENCEMENT OF WORK. REPORT ANY DISCREPANCIES TO THE CONSULTING ENGINEER FOR DECISION/CLARIFICATION BEFORE PROCEEDING WITH THE WORK. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE SPECIFICATIONS AND OTHER CONSULTANTS' DRAWINGS.			D IV U	SSDA CONCEPT DESIGN Grid Datum Sheet A.H.D. O4 20250078 S01-SW302 A