Luminaire Schedule					
Symbol	Qty	Label	Lum. Lumens	LLF	Description
	1	P-3	27493	0.800	LSI HAMILTON-XLCM-3-LED-HO-CW-270W LED AREA LIGHT ON 10m POLE
	15	P-5	31142	0.800	LSI HAMILTON-XLCM-5-LED-HO-CW 276W LED AREA LIGHT ON 10m POLE
	15	P-4	30937	0.800	LSI HAMILTON-XLCM-FT-LED-HO-CW 275W LED AREA LIGHT ON 10m POLE
	5	P-4A	30937	0.800	LSI HAMILTON-XLCM-FT-LED-HO-CW 275W LED AREA LIGHT ON WALL MOUNT BRACKET

Calculation Summary						
Project: Project__1						
Label	Units	Avg	Max	Min	Min/Avg	Min/Max
site	Lux	35.36	187.8	5.5	0.16	0.03

THE PROPOSED LIGHTING SCHEME COMPLIES WITH THE AUSTRALIAN STANDARDS 1158.3.1 CATEGORY P-PEDESTRIAN AREAS.

1158.3.1 CAT P 11 (B) CAR PARK AND ACCESS

-THESE LUMINAIRES ARE FIXED TO THE HORIZONTAL AND DO NOT EMIT LIGHT ABOVE THE HORIZONTAL PLANE AND HAVE NO UPWARD AIMING.
-PHOTOMETRIC FIILES SUPPLIED BY LSI-HAMMITON AND SUPPORTING AGENTS.
-DESIGN SOFTWARE USED FOR CALCULATIONS AND LAYOUTS IS AGI-32.
-ANY CHANGES TO THE CALCULATION/PROJECT PARAMETERS WILL AFFECT THE FINAL ILLUMINATION LEVELS.
-CALCULATIONS ARE SUBJECT TO ACCURACIES AND TOLERANCES NOMINATED IN AS/NZS 3827.1:1998 AND 3827.2.1998.

NOTE:
SITE CONDITIONS ARE BASED ON **SURVEY:**
SY07316 Cadence WSPT Eastern Creek survey rev5 26 June 2012.dwg

BOUNDARIES ARE BASED ON **SUBDIVISION PLAN:**
SY07316 WSPT Eastern Creek PROPOSED SUBDIV AMDTs July 2014.pdf

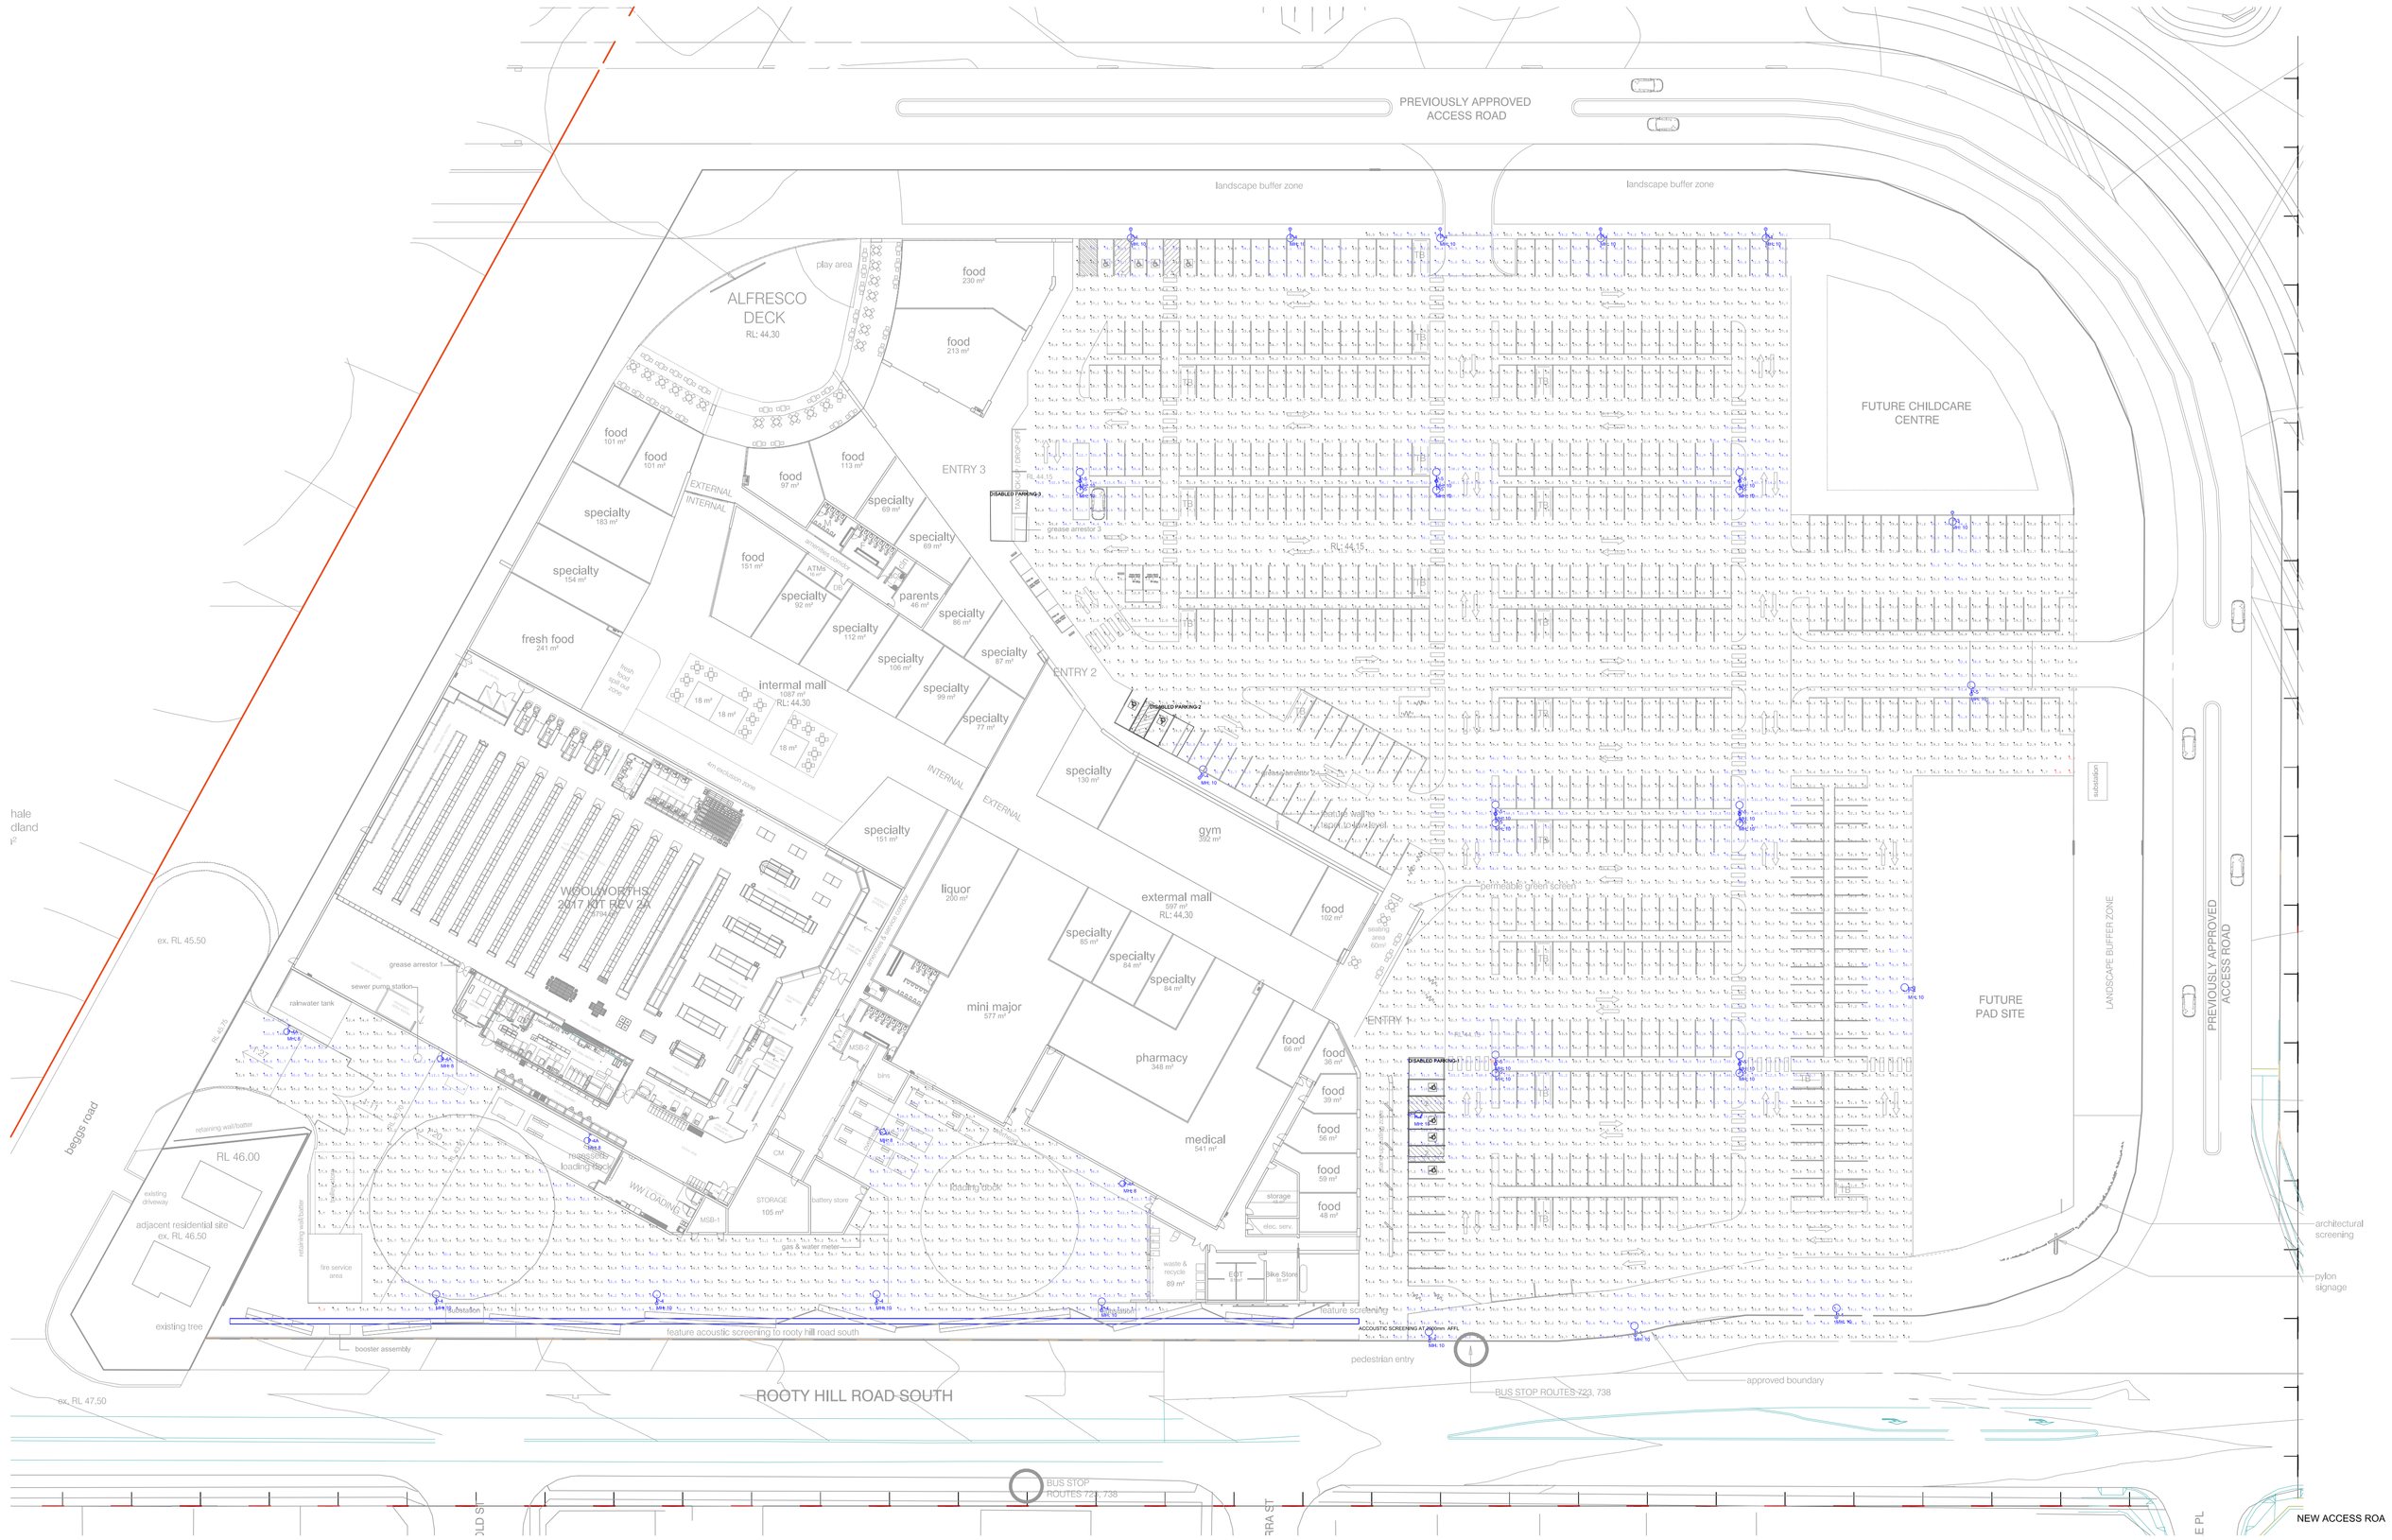

D.A. ISSUE

"A place where people can be proud of and feel completely comfortable".

CONSULTANT

D. CATTERSON & ASSOCIATES
CONSULTING ENGINEERS
ACN: 080 996 961
88 ARTHUR STREET, CROYDON PARK NSW 2133
PH: (02) 9799-6088 E-MAIL: david@catterson.com.au

FRASERS PROPERTY

EASTERN CREEK RC
NSW 2766

STAGE 1:
PROPOSED CAR PARKING & LOADING DOCKS LUX PLOT

2015-088

ELUX-01 A

1 : 500 DCTL

All dimensions in millimetres unless noted otherwise.
Do not scale these drawings.-Figured dimensions take precedence.
This drawing and its contents are subject to copyright laws and protection.
Do not reproduce in full or in part without approval. ©Copyright

i2C

8/09/2017 6:58:01 PM