




**9 HOWARD ROAD,
MINTO HIEGHTS NSW
2566**
PROPOSED PRIVATE COLLEGE
LOT 1, DP 10092
TOTAL SITE AREA: 3.58 ha

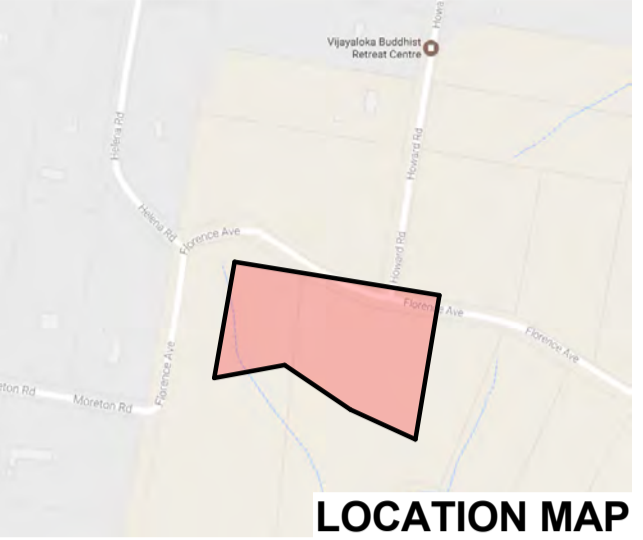

ZONE LEGEND
ZONE A - CLASSES
ZONE B - ENTRY, OFFICE & LIBRARY
ZONE C - HALL & LIBRARY

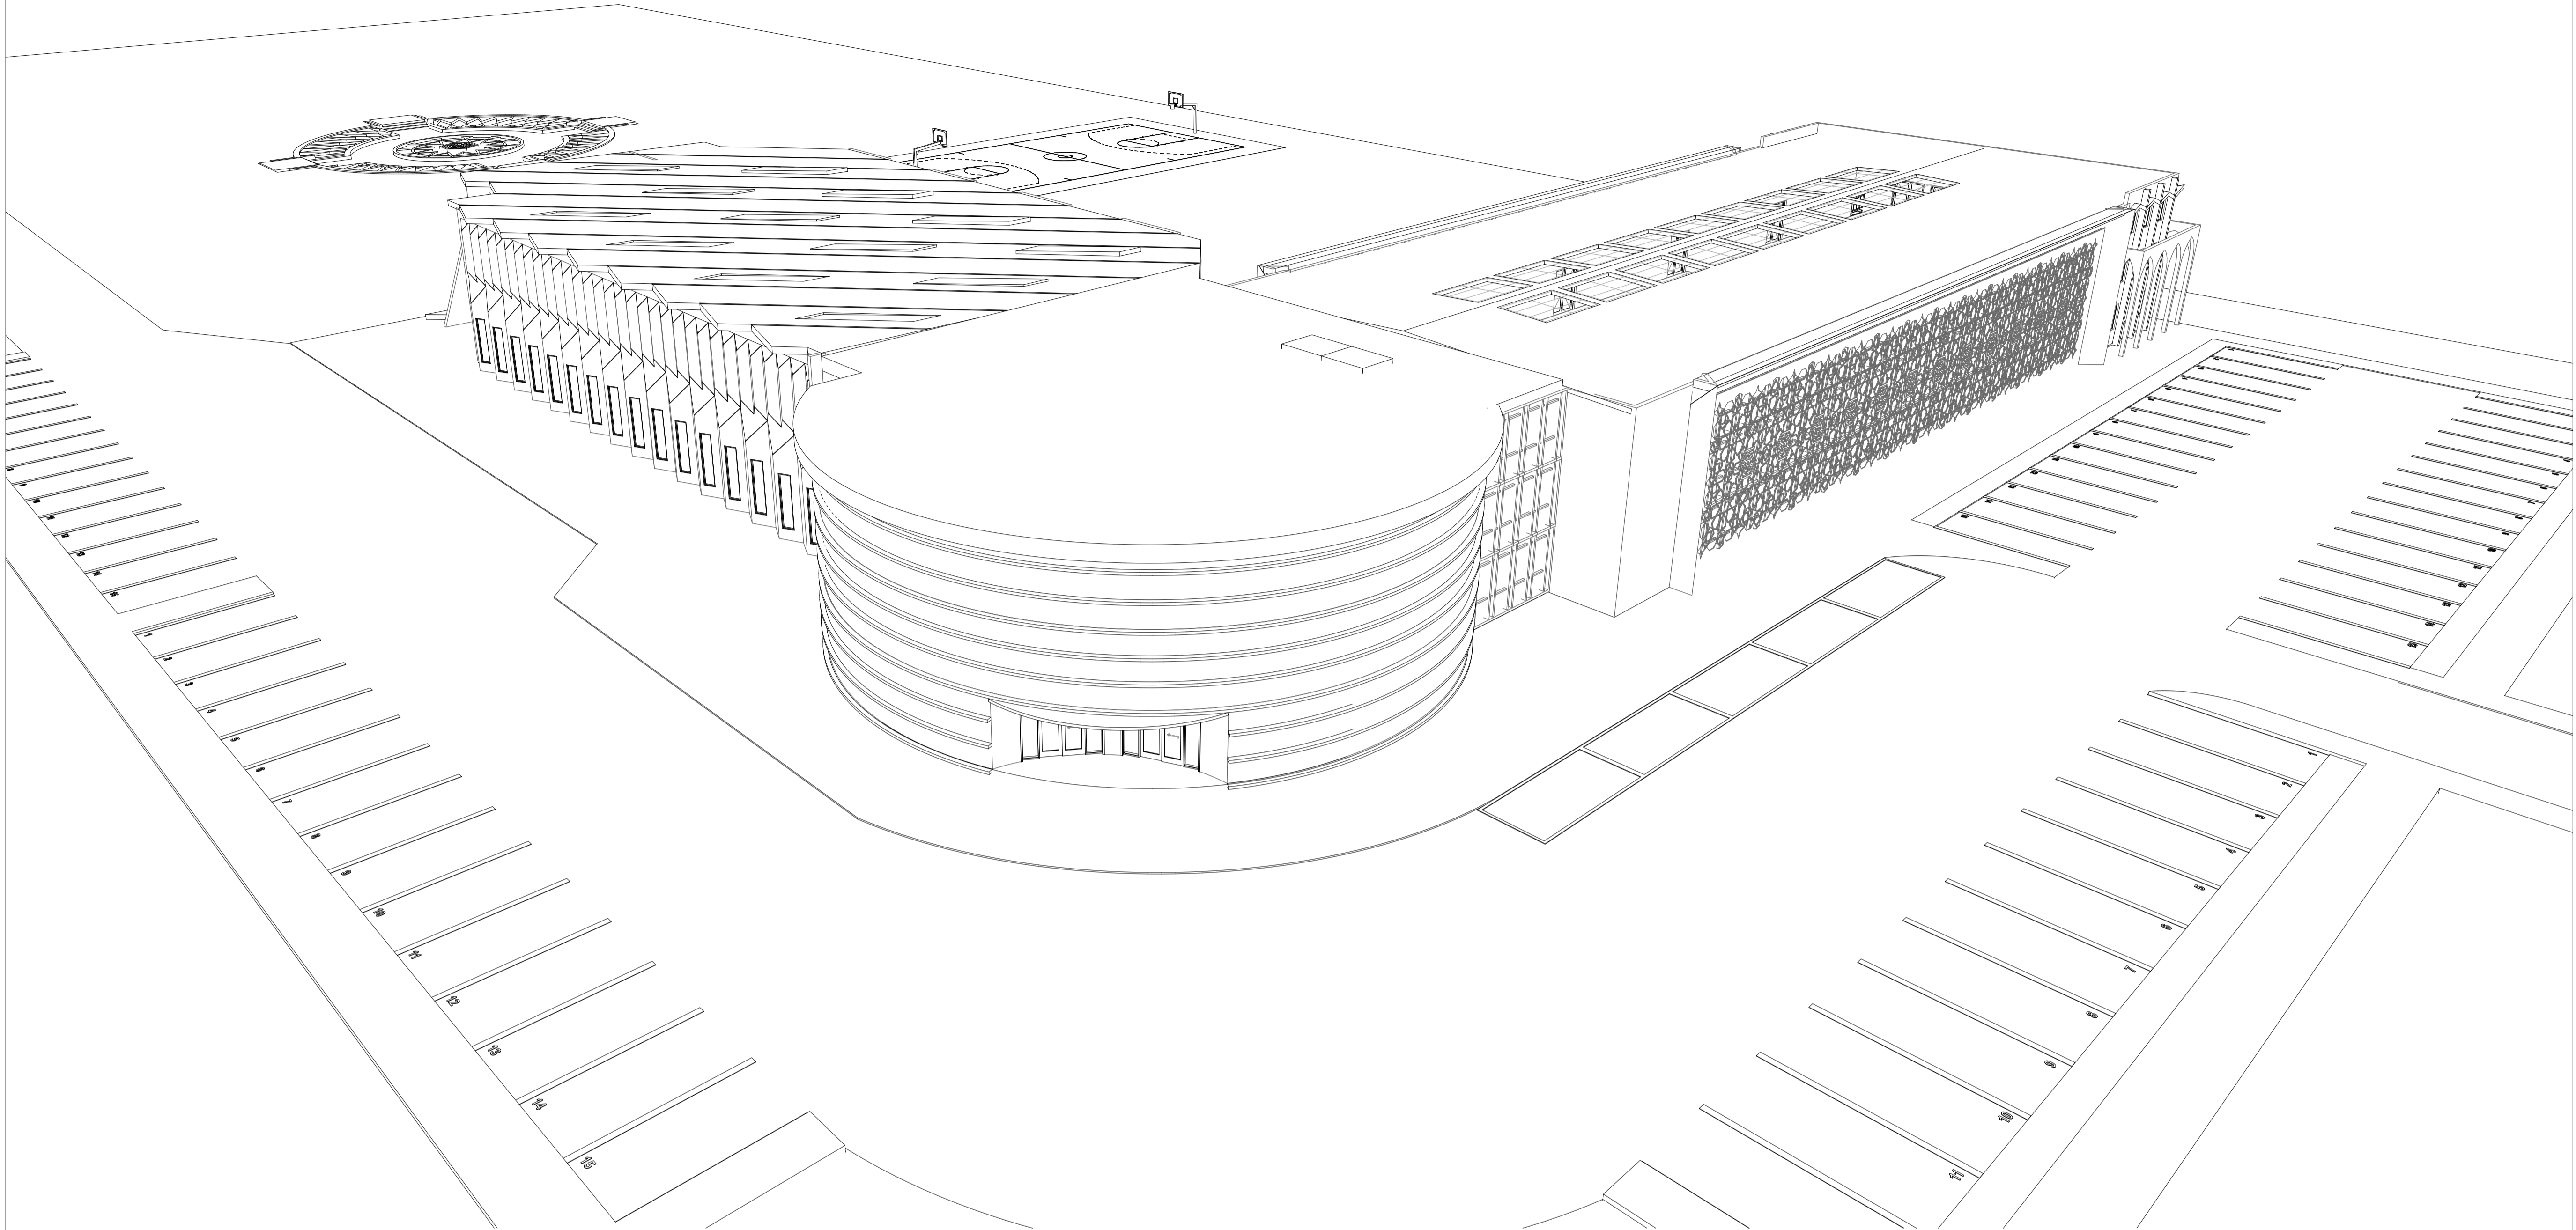

3D PERSPECTIVE

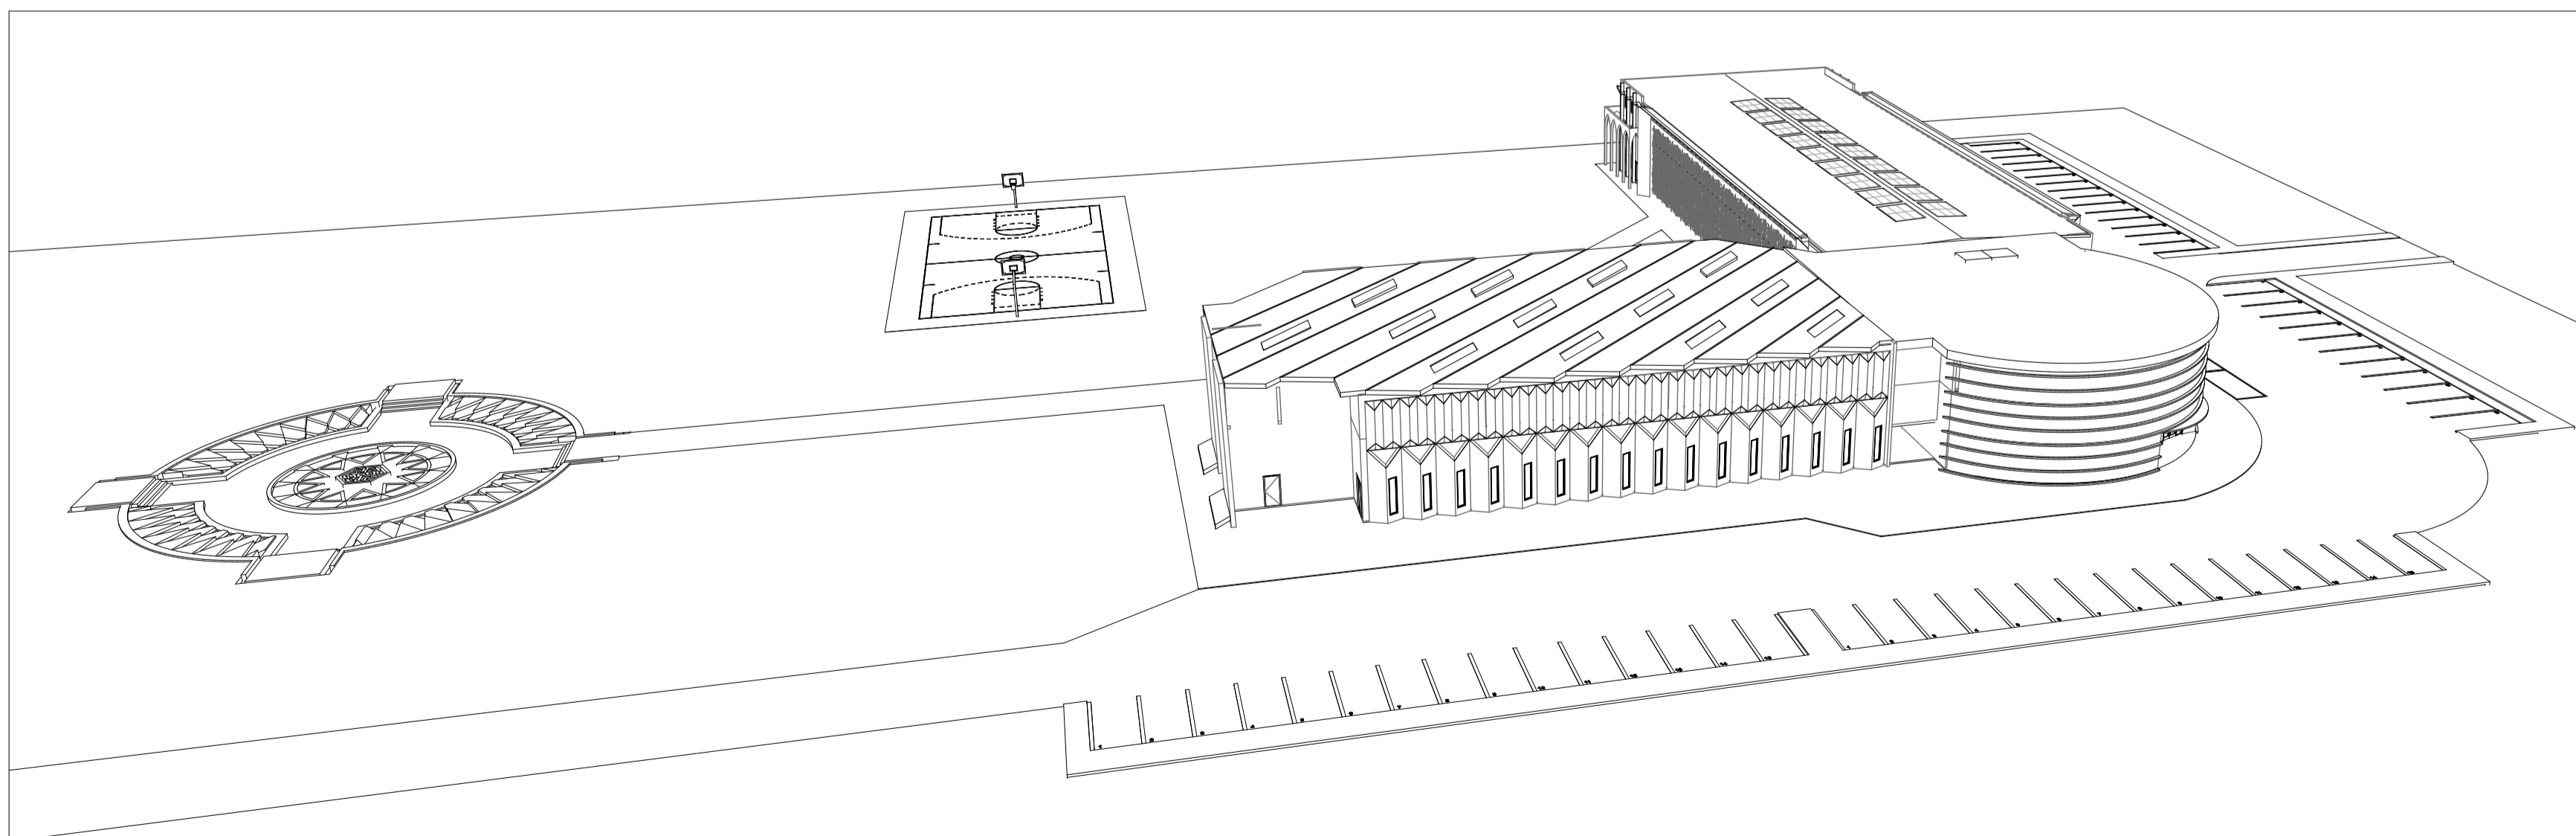

3D PERSPECTIVE

IMAM ALI COLLEGE

INDEX TABLE

- 01 3D PERSPECTIVES
- 02 SITE ANALYSIS
- 03 SITE PLAN
- 04 COLLEGE LAYOUT
- 05 FLOORS LAYOUT & ELEVATIONS
- 06 1:200 SCALE - GROUND FLOOR PLAN
- 07 1:200 SCALE - FIRST FLOOR PLAN
- 08 1:200 SCALE - SECOND FLOOR PLAN
- 09 1:200 SCALE - ROOF PLAN
- 10 WATER FOUNTAIN AND SECTIONS
- 11 SAFE ZONE LAYOUT
- 12 SHADOWS DIAGRAM


NOTE:

- THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ARCHITECTURAL DRAWINGS AND SPECIFICATIONS AND OTHER WRITTEN INSTRUCTIONS.
- DIMENSIONS SHALL NOT BE OBTAINED BY SCALING FROM DRAWINGS.
- REFER TO ARCHITECTS FINAL DRAWINGS.
- BUILDER SHALL CHECK ALL RELEVANT DIMENSIONS ON SITE.
- REFER ANY DISCREPANCY TO THE ENGINEER/ARCHITECT.
- IF IN DOUBT - ASK.
- MATERIALS AND WORKMANSHIP SHALL COMPLY WITH THE APPROPRIATE SAA SPECIFICATIONS OR CODE AND WITH THE REQUIREMENTS OF THE RELEVANT LOCAL AUTHORITY.
- DURING CONSTRUCTION THE STRUCTURE SHALL BE MAINTAINED IN A STABLE CONDITION AND NO PART SHALL BE OVERSTRESSED. THE BUILDER SHALL BE RESPONSIBLE FOR ANY DAMAGE TO THE WORKS.
- ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED.
- CONCRETE QUALITY SHALL BE :-
F_c - SLUMP - Max Agg - CEMENT
SLABS - 20 MPa - 80 mm - 20 mm - 2"
PIERS - 20 MPa - N/A - 20 mm - 2"
- REINFORCEMENT LAPS - MESH - 2 CROSSWIRES + 25 mm BARS - Y12-450 mm / Y16-550 mm
- COVER TO REINFORCEMENT - SLAB ABOVE GROUND - TOP : 30 mm
- BOTTOM : 30 mm
- SLAB ON GROUND - 40 mm (ALL ROUND)
- ALL REINFORCEMENT SHALL BE ADEQUATELY SUPPORTED IN ITS REQUIRED POSITION
- CONSTRUCTION JOINTS WHERE NOT SHOWN SHALL BE LOCATED TO THE APPROVAL OF THE ENGINEER.
- NO HOLES OR CHASES OTHER THAN THOSE SHOWN ON THE STRUCTURAL DRAWINGS SHALL BE MADE IN CONCRETE MEMBERS WITHOUT PRIOR APPROVAL OF THE ENGINEER.
- INTERNAL AND EDGE BEAMS ARE DESIGNED TO REST ON NATURAL GROUND OR CONTROLLED FILL WITH A SAFE BEARING CAPACITY OF 100 KPa U.N.O.
- PRIOR TO CONSTRUCTION OF THE SLAB OR FORMATION OF A CONTROLLED CUT/FILL BUILDING PLATFORM :-
(a) AN AREA EXTENDING AT LEAST 1.0 m BEYOND THE EDGE OF THE SLAB AND TO THE TOE OF ANY FILL BATTERS SHALL BE STRIPPED OF ALL ORGANIC MATTER AND ASSOCIATED TOPSOIL.
(b) THE SUBGRADE SHALL BE THOROUGHLY TRIMMED AND CONSOLIDATED.
- THE SLAB SHALL BE LAID ON MAX 50 mm THICKNESS OF CONSOLIDATED LEVELLING SAND COVERED WITH A 0.2 mm THICK POLYTHENE VAPOUR BARRIER WITH ALL JOINTS PROPERLY LAPPED AND TAPED.
- THE SLAB SHALL BE CURED BY ONE OF THE FOLLOWING METHODS :-
(a) WETTING TWICE DAILY FOR THE FIRST THREE DAYS.
(b) USING AN APPROVED CURING COMPOUND.
- ALL CONCRETE SHALL BE MECHANICALLY VIBRATED AND SHALL BE CAREFULLY WORKED AROUND THE REINFORCEMENT AND INTO CORNERS OF FORMWORK.
- THE OWNER'S ATTENTION IS DRAWN TO APPENDIX A OF AS2870-2:1998 "PERFORMANCE REQUIREMENTS AND FOUNDATION MAINTENANCE".
- SLAB AND FOOTING DESIGN HAS BEEN BASED ON PRINCIPLES AS SET OUT IN AS2870-1:1998 "RESIDENTIAL SLABS AND FOOTINGS".
- ALL DEMOLITION WORK TO BE SUPERVISED BY THE STRUCTURAL ENGINEER AT ALL TIMES.

ALLOW + or - 200 mm ON ALL RL(S) ON PLANS. ALL LEVELS ARE SUBJECT TO FINAL DETERMINATION ON SITE.
All work on this drawing must not be used or altered in anyway without the consent from A&H Eco Group pty ltd copyright ©

ISSUE	REVISION	DATE	ISSUE	REVISION	DATE	PROJECT:	DRAWING No:
A	INITIAL SUBMISSION	24/03/18				9 Howard road, Minto Height NSW 2566	1 OF 12
						CLIENT:	SCALE: AS
						Imam Ali College	SHOWN @A1
						PROJECT No. 039/16	DRAWN: AL
							Paper size A1

**9 HOWARD ROAD,
MINTO HIEGHTS NSW
2566**
PROPOSED PRIVATE COLLEGE
LOT 1, DP 10092
TOTAL SITE AREA: 3.58 ha

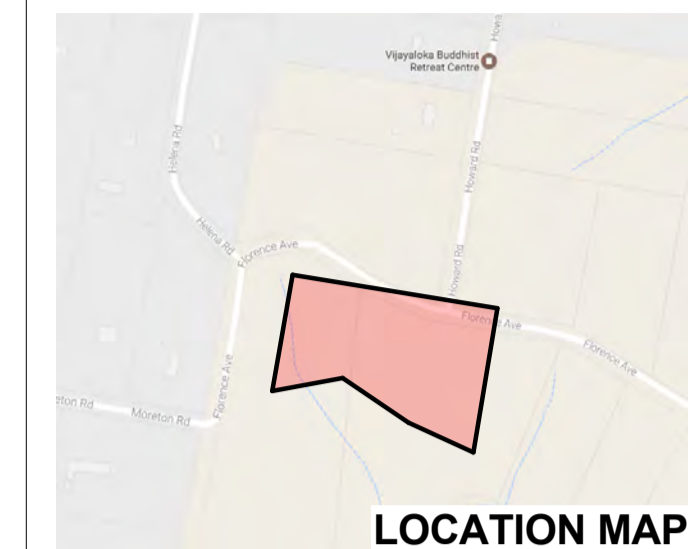


ZONE LEGEND
ZONE A - CLASSES
ZONE B - ENTRY, OFFICE & LIBRARY
ZONE C - HALL & LIBRARY

NOTE:


- THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ARCHITECTURAL DRAWINGS AND SPECIFICATIONS AND OTHER WRITTEN INSTRUCTIONS.
- DIMENSIONS SHALL NOT BE OBTAINED BY SCALING FROM DRAWINGS.
- REFER TO ARCHITECTS FINAL DRAWINGS.
- BUILDER SHALL CHECK ALL RELEVANT DIMENSIONS ON SITE.
- REFER ANY DISCREPANCY TO THE ENGINEER/ARCHITECT.
- IF IN DOUBT - ASK.
- MATERIALS AND WORKMANSHIP SHALL COMPLY WITH THE APPROPRIATE SAA SPECIFICATIONS OR CODE AND WITH THE REQUIREMENTS OF THE RELEVANT LOCAL AUTHORITY.
- DURING CONSTRUCTION THE STRUCTURE SHALL BE MAINTAINED IN A STABLE CONDITION AND NO PART SHALL BE OVERSTRESSED. THE BUILDER SHALL BE RESPONSIBLE FOR ANY DAMAGE TO THE WORKS.
- DURING CONSTRUCTION
- ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED.
- CONCRETE QUALITY SHALL BE :-
FC - SLUMP - Max Agg CEMENT
SLABS - 20 MPa N/A 20 mm "A"
PIERS - 20 MPa N/A 20 mm "A"
REINFORCEMENT LAPS - MESH - 2 CROSSWIRES + 25 mm BARS - Y12-450 mm / Y16-550 mm
- COVER TO REINFORCEMENT - SLAB ABOVE GROUND - TOP : 30 mm - BOTTOM : 30 mm
SLAB ON GROUND - 40 mm (ALL ROUND)
- ALL REINFORCEMENT SHALL BE ADEQUATELY SUPPORTED IN ITS REQUIRED POSITION
- CONSTRUCTION JOINTS WHERE NOT SHOWN SHALL BE LOCATED TO THE APPROVAL OF THE ENGINEER
- NO HOLES OR CHASES OTHER THAN THOSE SHOWN ON THE STRUCTURAL DRAWINGS SHALL BE MADE IN CONCRETE MEMBERS WITHOUT PRIOR APPROVAL OF THE ENGINEER
- INTERNAL AND EDGE BEAMS ARE DESIGNED TO REST ON NATURAL GROUND OR CONTROLLED FILL WITH A SAFE BEARING CAPACITY OF 100 KPa U.N.O.
- PRIOR TO CONSTRUCTION OF THE SLAB OR FORMATION OF A CONTROLLED CUT/FILL BUILDING PLATFORM :-
(a) AN AREA EXTENDING AT LEAST 1.0 m BEYOND THE EDGE OF THE SLAB AND TO THE TOE OF ANY FILL BATTERS SHALL BE STRIPPED OF ALL ORGANIC MATTER AND ASSOCIATED TOPSOIL.
(b) THE SUBGRADE SHALL BE THOROUGHLY TRIMMED AND CONSOLIDATED
- THE SLAB SHALL BE LAID ON MAX 50 mm THICKNESS OF CONSOLIDATED LEVELING SAND COVERED WITH A 0.2 mm THICK POLYTHENE VAPOUR BARRIER WITH ALL JOINTS PROPERLY LAPPED AND TAPED.
- THE SLAB SHALL BE CURED BY ONE OF THE FOLLOWING METHODS :-
(a) WETTING TWICE DAILY FOR THE FIRST THREE DAYS.
(b) USING AN APPROVED CURING COMPOUND.
- ALL CONCRETE SHALL BE MECHANICALLY VIBRATED AND SHALL BE CAREFULLY WORKED AROUND THE REINFORCEMENT AND INTO CORNERS OF FORMWORK
- THE OWNER'S ATTENTION IS DRAWN TO APPENDIX A OF AS2870-2:1996
- PERFORMANCE REQUIREMENTS AND FOUNDATION MAINTENANCE :-
SLAB AND FOOTING DESIGN HAS BEEN BASED ON PRINCIPLES AS SET OUT IN AS2870-1:1996 "RESIDENTIAL SLABS AND FOOTINGS".
- ALL DEMOLITION WORK TO BE SUPERVISED BY THE STRUCTURAL ENGINEER AT ALL TIMES.

ALLOW +/- or - 200 mm ON ALL RL(S) ON PLANS. ALL LEVELS ARE SUBJECT TO FINAL DETERMINATION ON SITE.
All work on this drawing must not be used or altered in anyway without the consent from A&H Eco Group Pty Ltd copyright ©

SHEET 1 OF 1

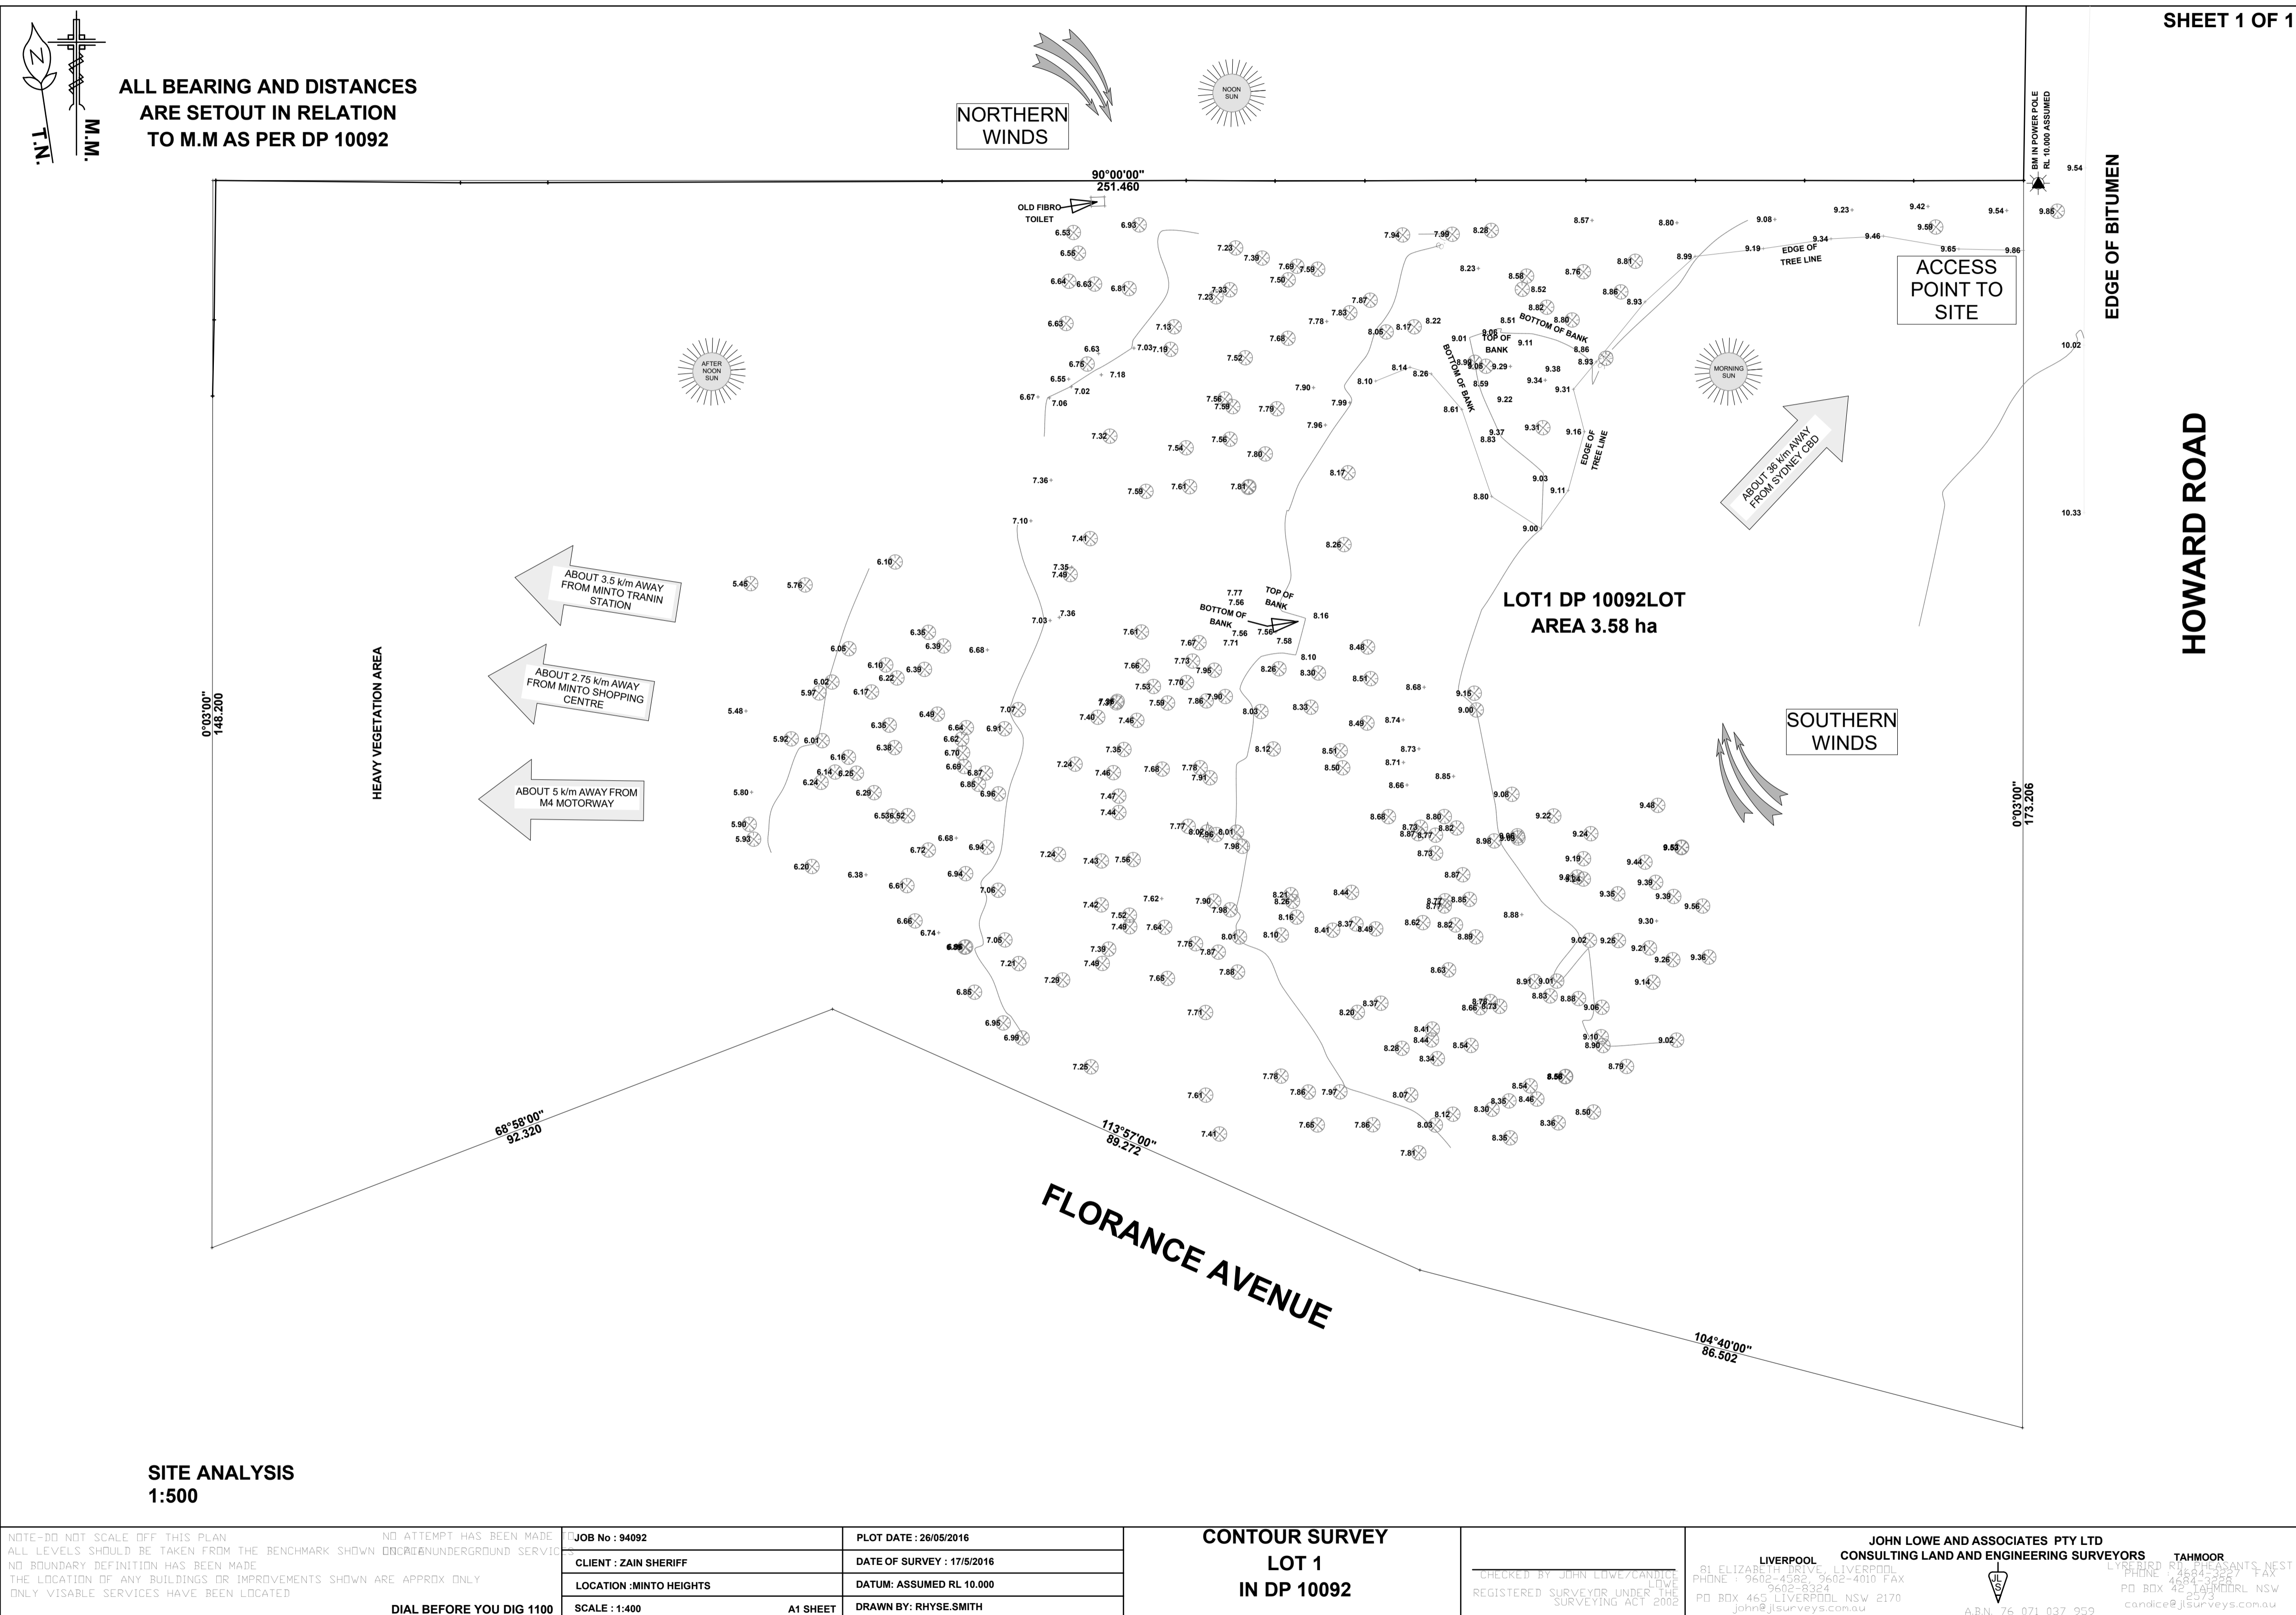

ALL BEARING AND DISTANCES ARE SET OUT IN RELATION TO M.M AS PER DP 10092

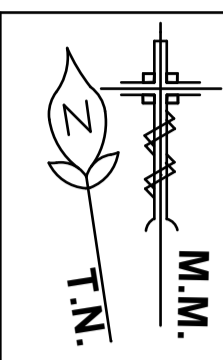

**SITE ANALYSIS
1:500**

**CONTOUR SURVEY
LOT 1
IN DP 10092**

NOTE-DO NOT SCALE OFF THIS PLAN. ALL LEVELS SHOULD BE TAKEN FROM THE BENCHMARK SHOWN ON DRAWING UNLESS OTHERWISE STATED. NO ATTEMPT HAS BEEN MADE TO LOCATE UNDERGROUND SERVICES. THE LOCATION OF ANY BUILDINGS OR IMPROVEMENTS SHOWN ARE APPROX ONLY. ONLY VISIBLE SERVICES HAVE BEEN LOCATED.

JOB No : 94092	PLOT DATE : 26/05/2016
CLIENT : ZAIN SHERIFF	DATE OF SURVEY : 17/5/2016
LOCATION : MINTO HEIGHTS	DATUM : ASSUMED RL 10.000
SCALE : 1:400	DRAWN BY : RHYSE SMITH
A1 SHEET	

REGISTERED SURVEYORS UNDER THE SURVEYING ACT 2005
LIVERPOOL
JOHN LOWE AND ASSOCIATES PTY LTD
CONSULTING LAND AND ENGINEERING SURVEYORS
TAMMOOR
101 CLIZARD ST, LIVERPOOL
PHONE 9602-4382, 9602-4010 FAX 9602-824
PO BOX 465 LIVERPOOL NSW 2170
john@jlsurveys.com.au A.B.N. 76 071 032 959
LIVERPOOL BUSINESS CENTRE
PHONE 9602-3887 FAX 9602-3887
PO BOX 465 LIVERPOOL NSW
candice@jlsurveys.com.au




ISSUE	REVISION	DATE	ISSUE	REVISION	DATE
A	INITIAL SUBMISSION	24/03/18			


PROJECT: 9 Howard road, Minto Height NSW 2566
DRAWING No: 2 OF 12
DATE: 24/03/18
SCALE: AS SHOWN @A1
DRAWN: AL
Paper size: A1

CLIENT: Imam Ali College
PROJECT No. 039/16

**9 HOWARD ROAD,
MINTO HIEGHTS NSW
2566**
PROPOSED PRIVATE COLLEGE
LOT 1, DP 10092
TOTAL SITE AREA: 3.58 ha

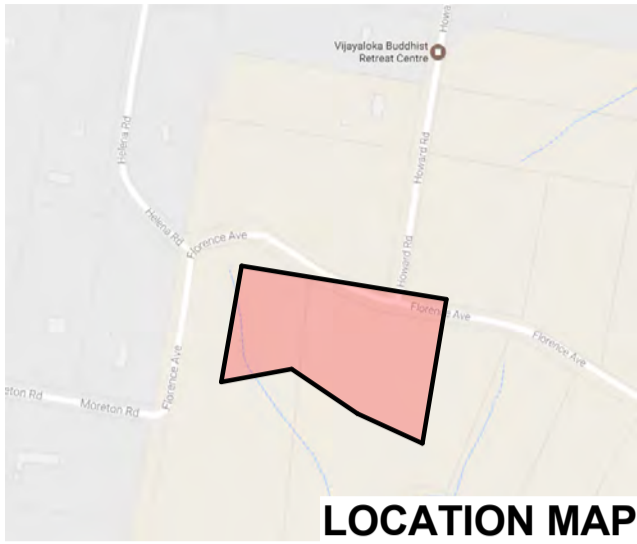

ZONE LEGEND
 ZONE A - CLASSES
 ZONE B - ENTRY, OFFICE & LIBRARY
 ZONE C - HALL & LIBRARY

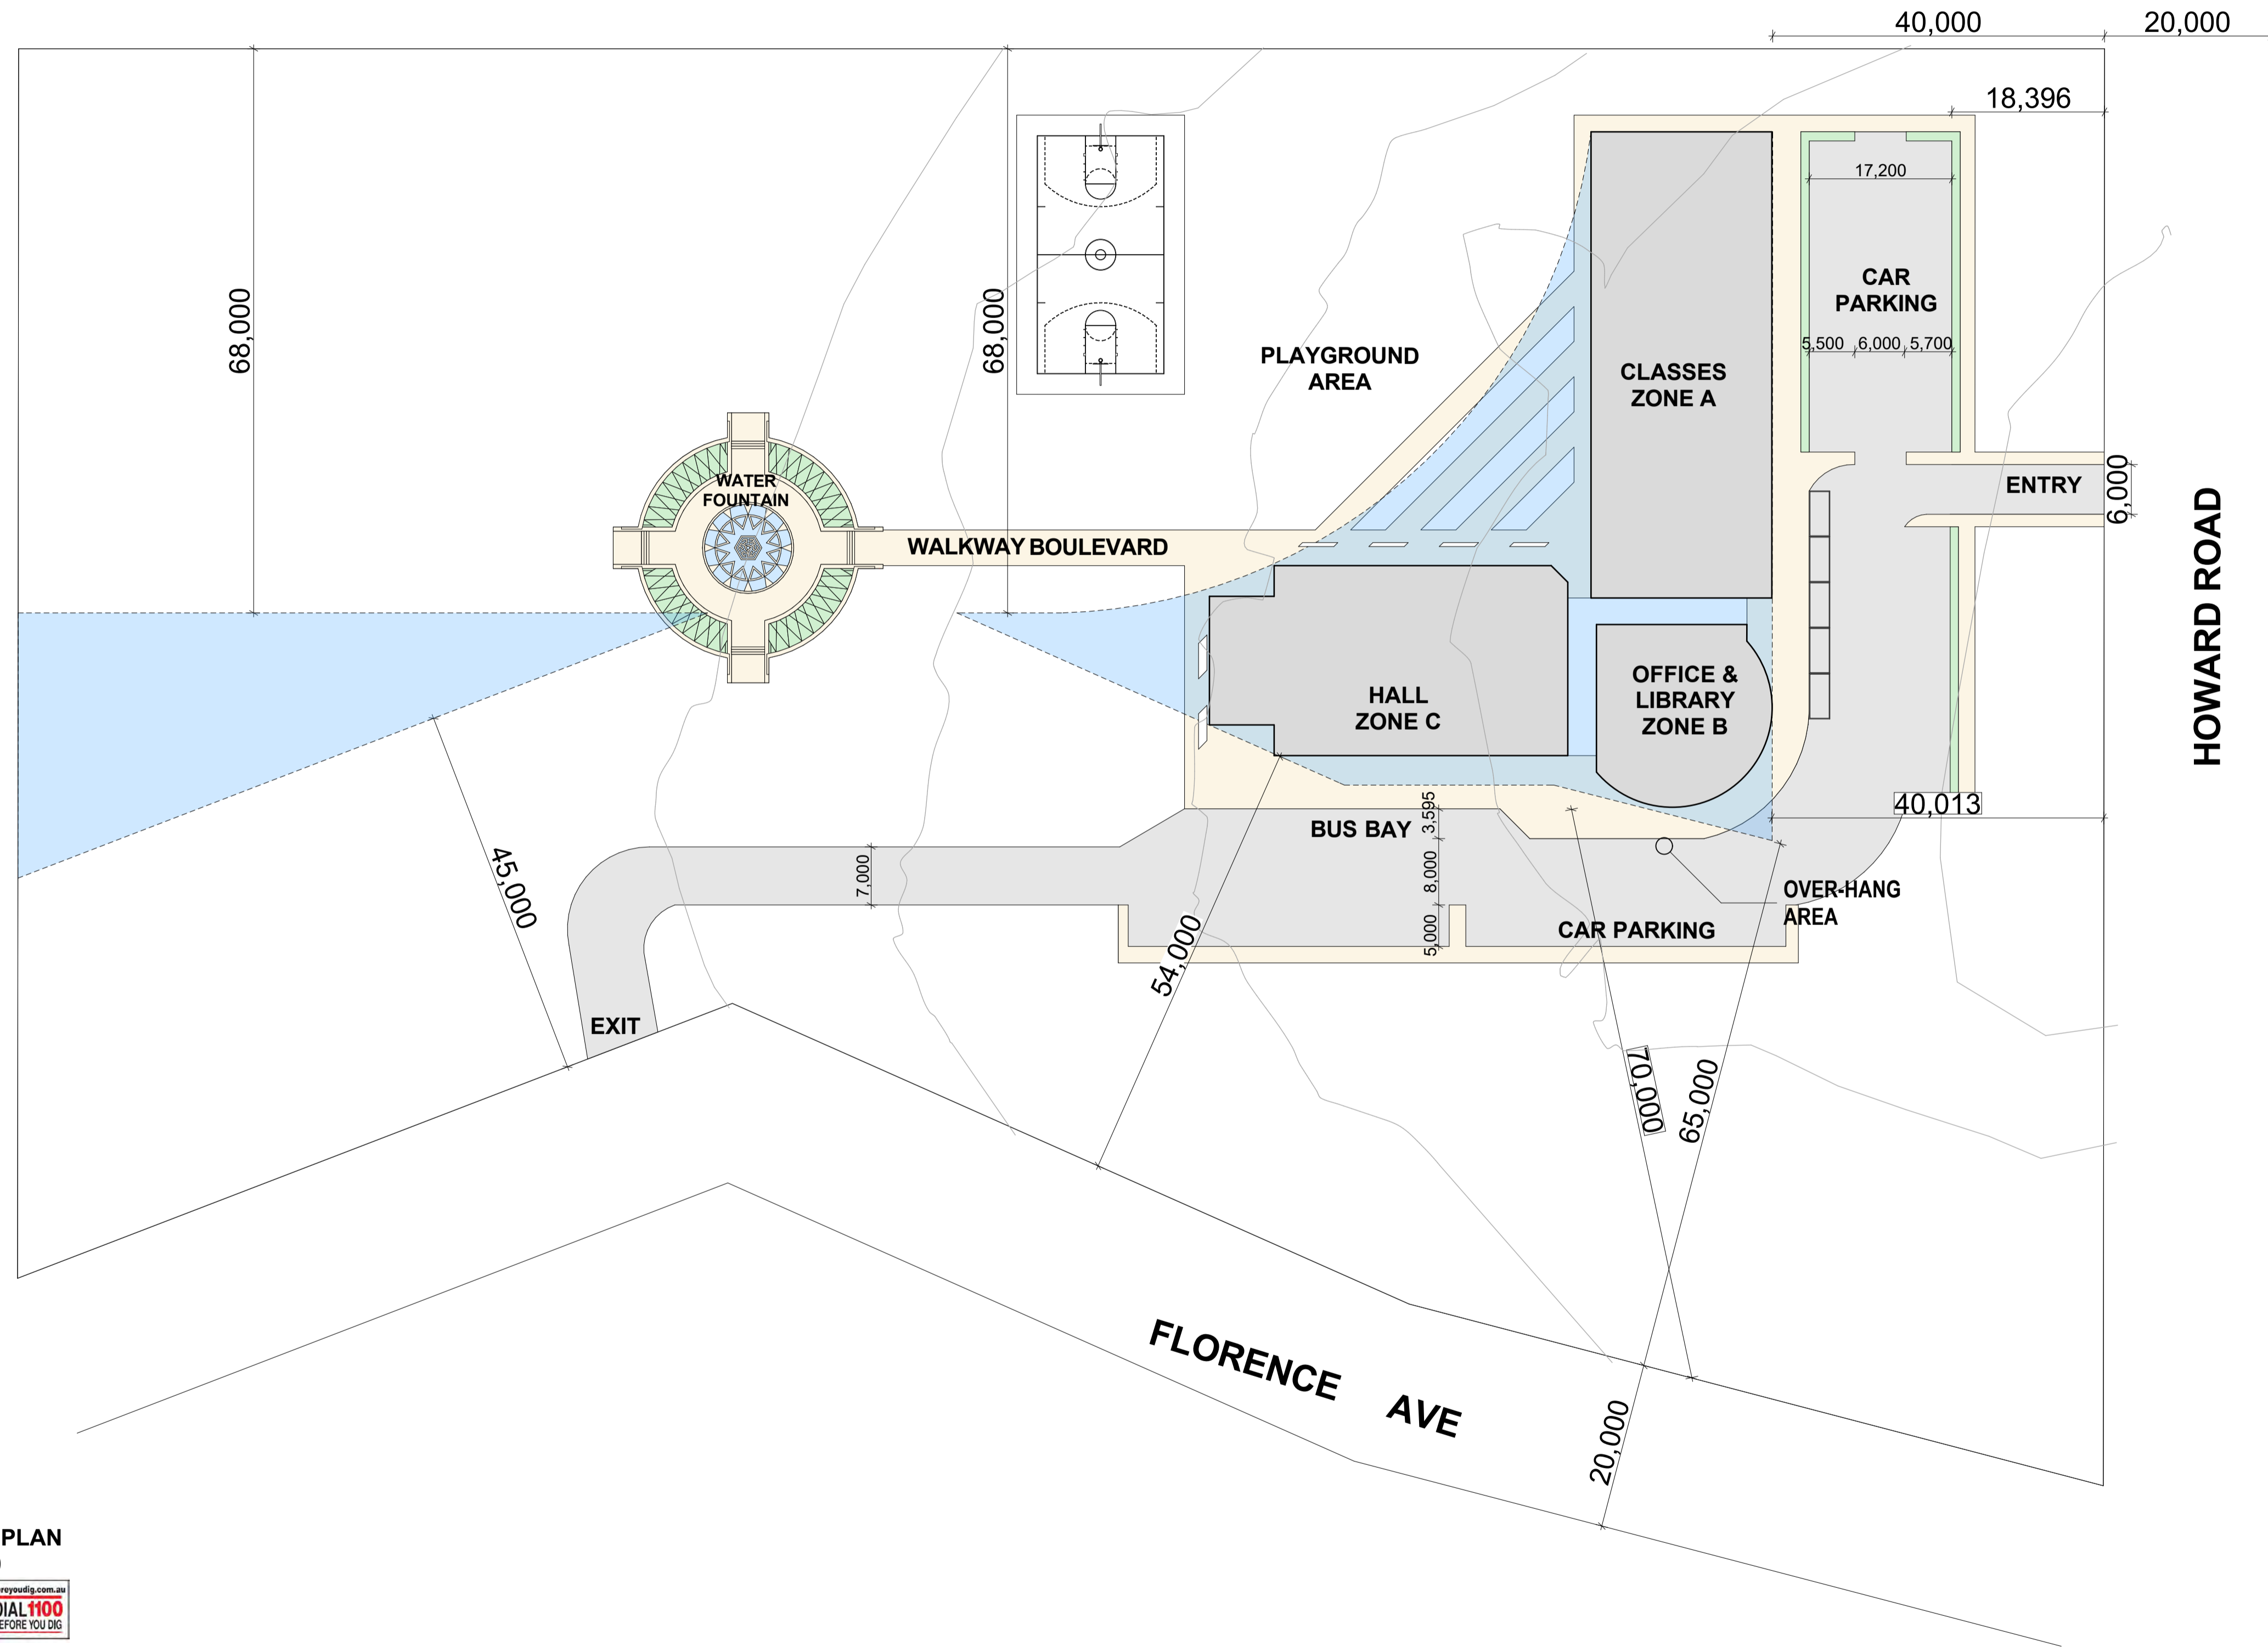

NOTE:

- THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ARCHITECTURAL DRAWINGS AND SPECIFICATIONS AND OTHER WRITTEN INSTRUCTIONS.
- DIMENSIONS SHALL NOT BE OBTAINED BY SCALING FROM DRAWINGS.
- REFER TO ARCHITECTS FINAL DRAWINGS.
- BUILDER SHALL CHECK ALL RELEVANT DIMENSIONS ON SITE.
- REFER ANY DISCREPANCY TO THE ENGINEER/ARCHITECT.
- IF IN DOUBT - ASK.
- MATERIALS AND WORKMANSHIP SHALL COMPLY WITH THE APPROPRIATE SAA SPECIFICATIONS OR CODE AND WITH THE REQUIREMENTS OF THE RELEVANT LOCAL AUTHORITY.
- DURING CONSTRUCTION THE STRUCTURE SHALL BE MAINTAINED IN A STABLE CONDITION AND NO PART SHALL BE OVERSTRESSED. THE BUILDER SHALL BE RESPONSIBLE FOR ANY DAMAGE TO THE WORKS.
- DURING CONSTRUCTION:
- ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED.
- CONCRETE QUALITY SHALL BE :-
- FC - SLUMP - Max Agg - CEMENT
- SLABS - 20 MPa - 80 mm - 20 mm - 4"
- PIERS - 20 MPa - N/A - 20 mm - 4"
- REINFORCEMENT LAPS - MESH - 2 CROSSWIRES + 25 mm
- BARS - Y12-450 mm / Y16-550 mm
- COVER TO REINFORCEMENT - SLAB ABOVE GROUND - TOP : 30 mm
- BOTTOM : 30 mm
- SLAB ON GROUND - 40 mm (ALL ROUND)
- ALL REINFORCEMENT SHALL BE ADEQUATELY SUPPORTED IN ITS REQUIRED POSITION
- CONSTRUCTION JOINTS WHERE NOT SHOWN SHALL BE LOCATED TO THE APPROVAL OF THE ENGINEER.
- NO HOLES OR CHASES OTHER THAN THOSE SHOWN ON THE STRUCTURAL DRAWINGS SHALL BE MADE IN CONCRETE MEMBERS WITHOUT PRIOR APPROVAL OF THE ENGINEER.
- INTERNAL AND EDGE BEAMS ARE DESIGNED TO REST ON NATURAL GROUND OR CONTROLLED FILL WITH A SAFE BEARING CAPACITY OF 100 KPa U.N.O.
- PRIOR TO CONSTRUCTION OF THE SLAB OR FORMATION OF A CONTROLLED CUT/FILL BUILDING PLATFORM :-
- (a) AN AREA EXTENDING AT LEAST 1.0 m BEYOND THE EDGE OF THE SLAB AND TO THE TOE OF ANY FILL BATTERS SHALL BE STRIPPED OF ALL ORGANIC MATTER AND ASSOCIATED TOPSOIL.
- (b) THE SUBGRADE SHALL BE THOROUGHLY TRIMMED AND CONSOLIDATED.
- THE SLAB SHALL BE LAID ON MAX 50 mm THICKNESS OF CONSOLIDATED LEVELING SAND COVERED WITH A 0.2 mm THICK POLYTHENE VAPOUR BARRIER WITH ALL JOINTS PROPERLY LAPPED AND TAPED.
- THE SLAB SHALL BE CURED BY ONE OF THE FOLLOWING METHODS :-
- (a) WETTING TWICE DAILY FOR THE FIRST THREE DAYS.
- (b) USING AN APPROVED CURING COMPOUND.
- ALL CONCRETE SHALL BE MECHANICALLY VIBRATED AND SHALL BE CAREFULLY WORKED AROUND THE REINFORCEMENT AND INTO CORNERS OF FORMWORK.
- THE OWNER'S ATTENTION IS DRAWN TO APPENDIX A OF AS2870.2-1996
- PERFORMANCE REQUIREMENTS AND FOUNDATION MAINTENANCE:-
- SLAB AND FOOTING DESIGN HAS BEEN BASED ON PRINCIPLES AS SET OUT IN AS2870.1-1996 "RESIDENTIAL SLABS AND FOOTINGS".
- ALL DEMOLITION WORK TO BE SUPERVISED BY THE STRUCTURAL ENGINEER AT ALL TIMES.

ALLOW + or - 200 mm ON ALL RL(S) ON PLANS. ALL LEVELS ARE SUBJECT TO FINAL DETERMINATION ON SITE.
 All work on this drawing must not be used or altered in anyway without the consent from A&H Eco Group pty ltd copyright ©


**SITE PLAN
1:500**



 	ISSUE	REVISION	DATE	ISSUE	REVISION	DATE	PROJECT: 9 Howard road, Minto Height NSW 2566	DRAWING No: 3 OF 12 DATE: 24/03/16 SCALE: AS SHOWN @A1 DRAWN: AL
	A	INITIAL SUBMISSION	24/03/18					
							CLIENT: Imam Ali College PROJECT No. 039/16	Paper size: A1

**9 HOWARD ROAD,
MINTO HIEGHTS NSW
2566**

PROPOSED PRIVATE COLLEGE
LOT 1, DP 10092
TOTAL SITE AREA: 3.58 ha

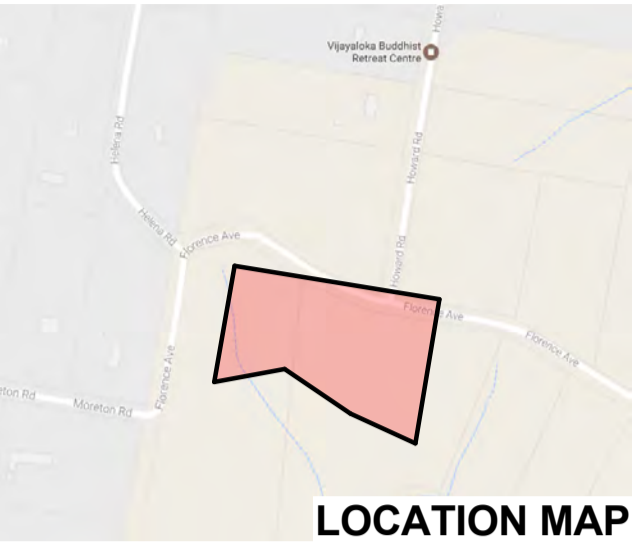


ZONE LEGEND


- ZONE A - CLASSES
- ZONE B - ENTRY, OFFICE & LIBRARY
- ZONE C - HALL & LIBRARY




**GROUND FLOOR LAYOUT
1:500**

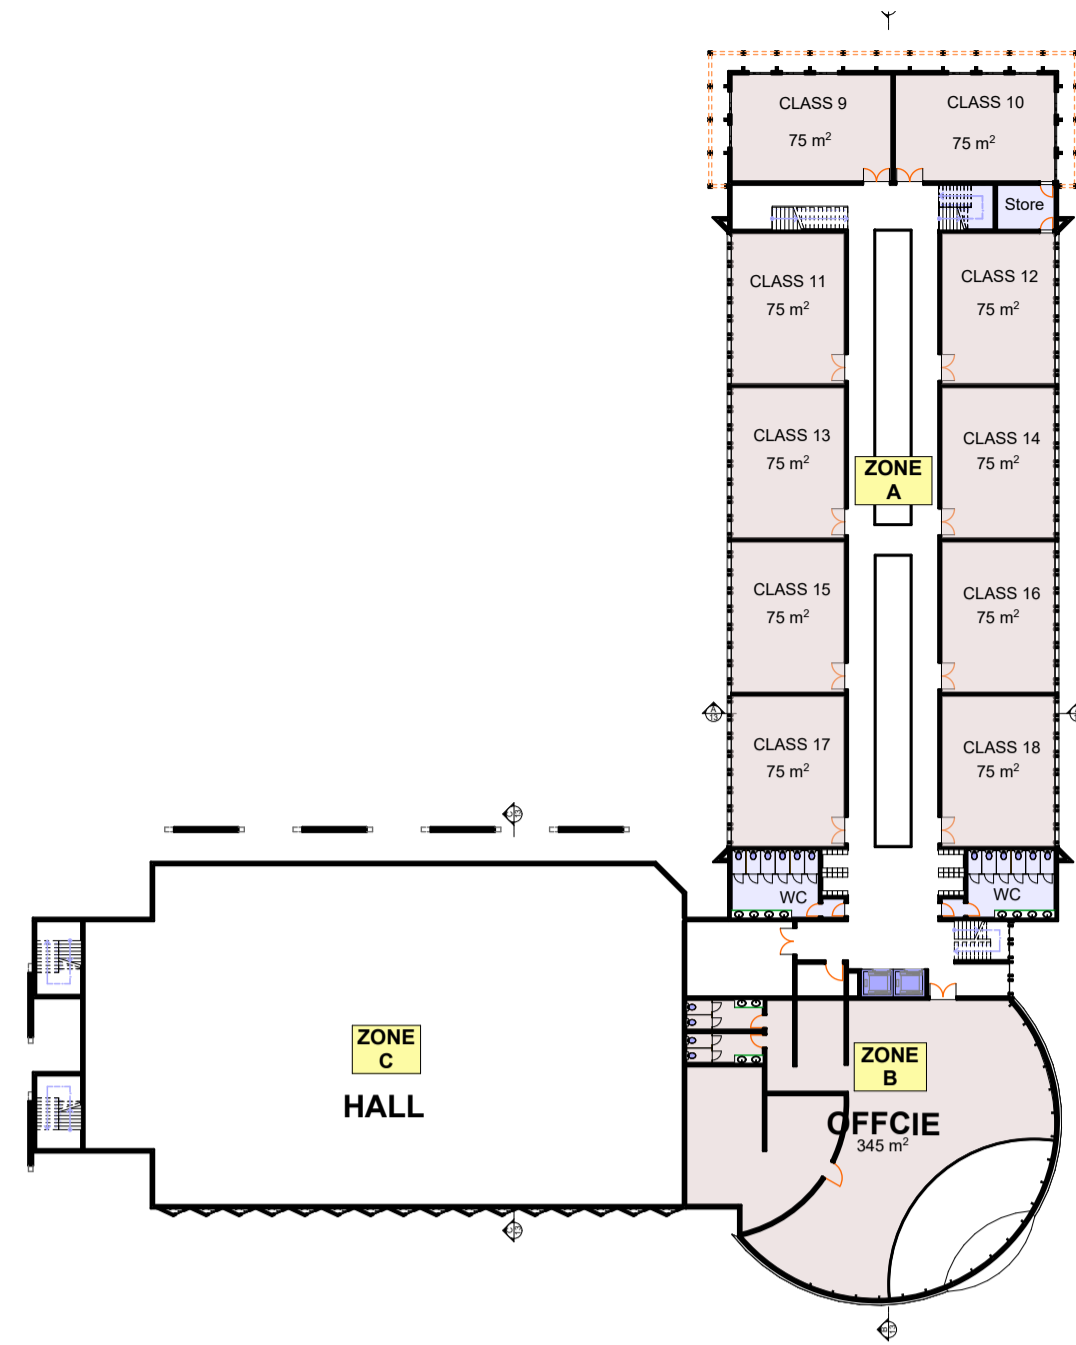


**FIRST FLOOR LAYOUT
1:500**

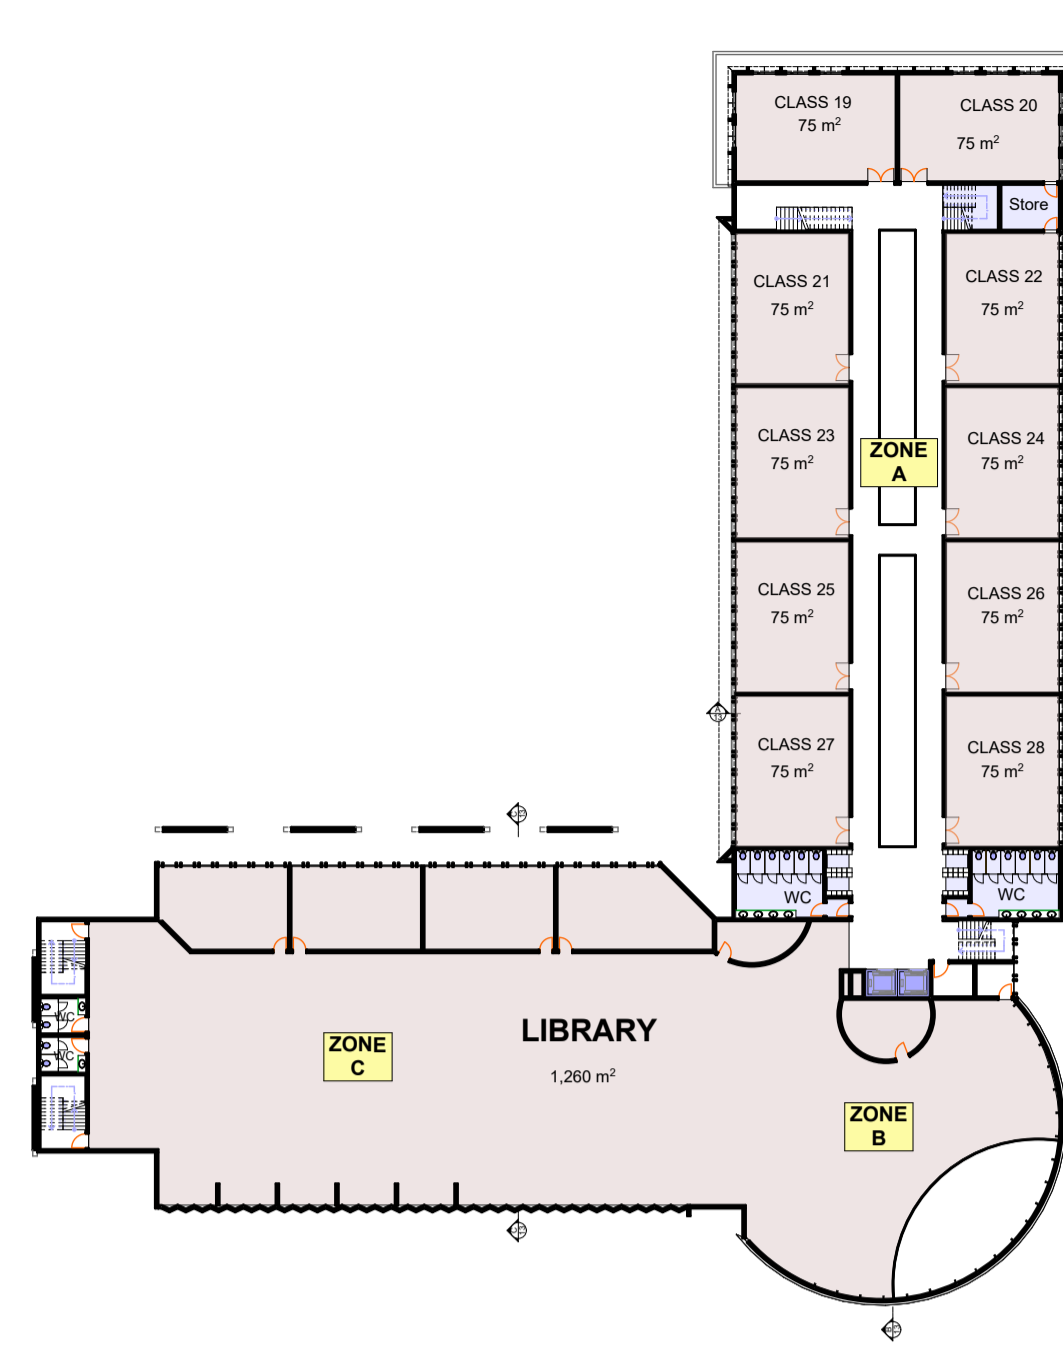


**SECOND FLOOR LAYOUT
1:500**

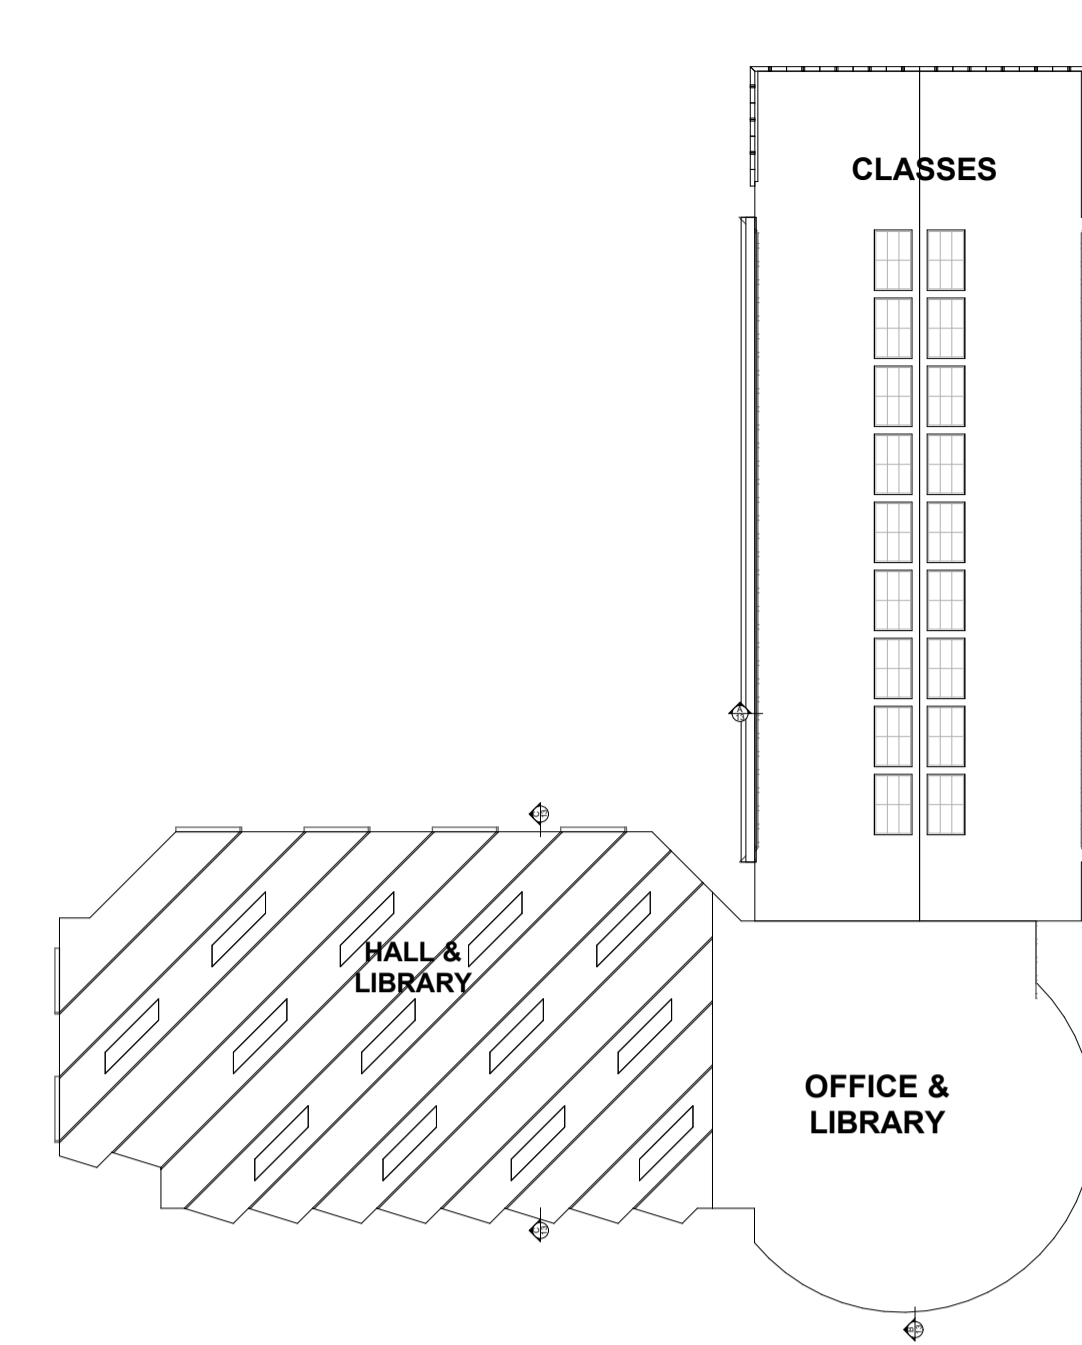


**ROOF LAYOUT
1:500**

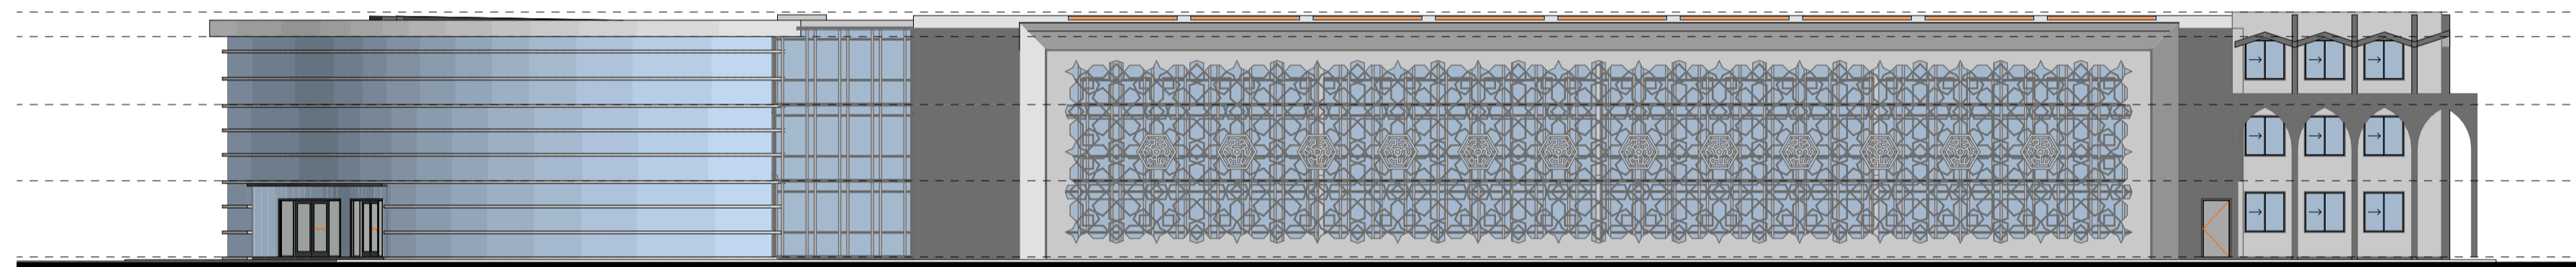


EAST COLLEGE ELEVATION

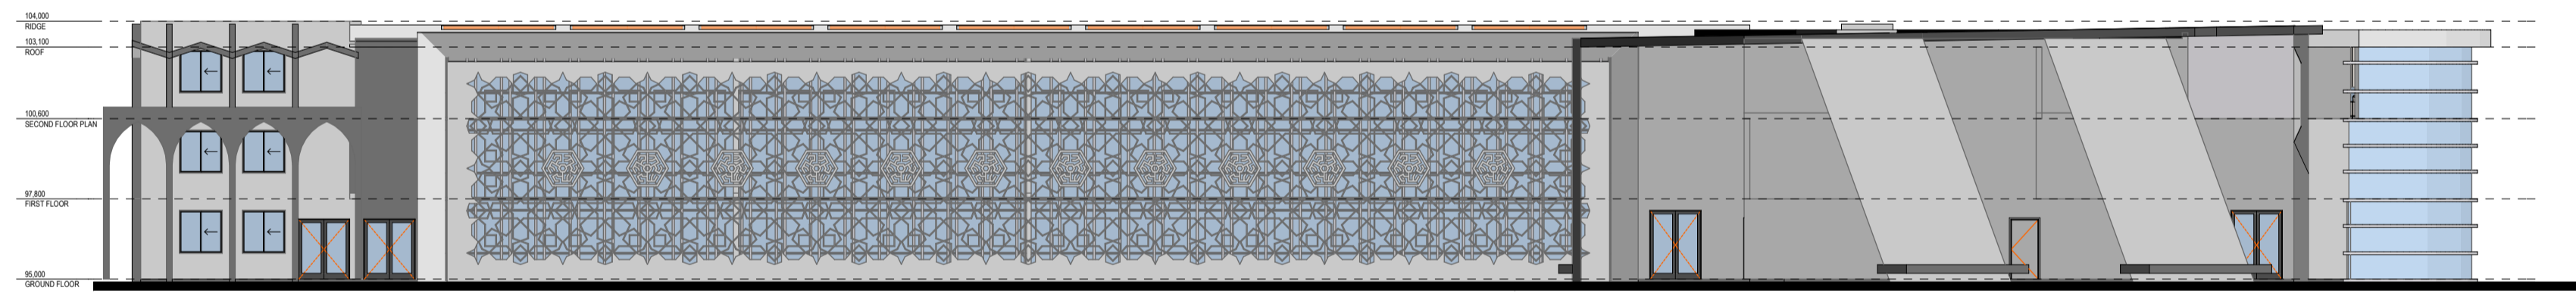

WEST COLLEGE ELEVATION

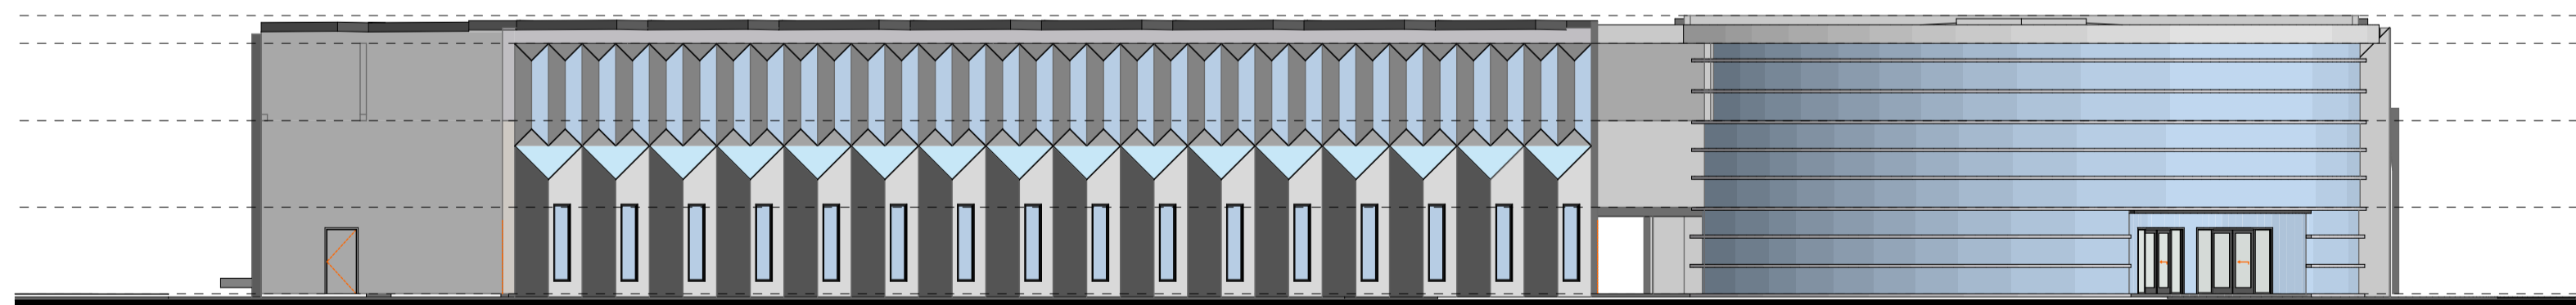

SOUTH COLLEGE ELEVATION

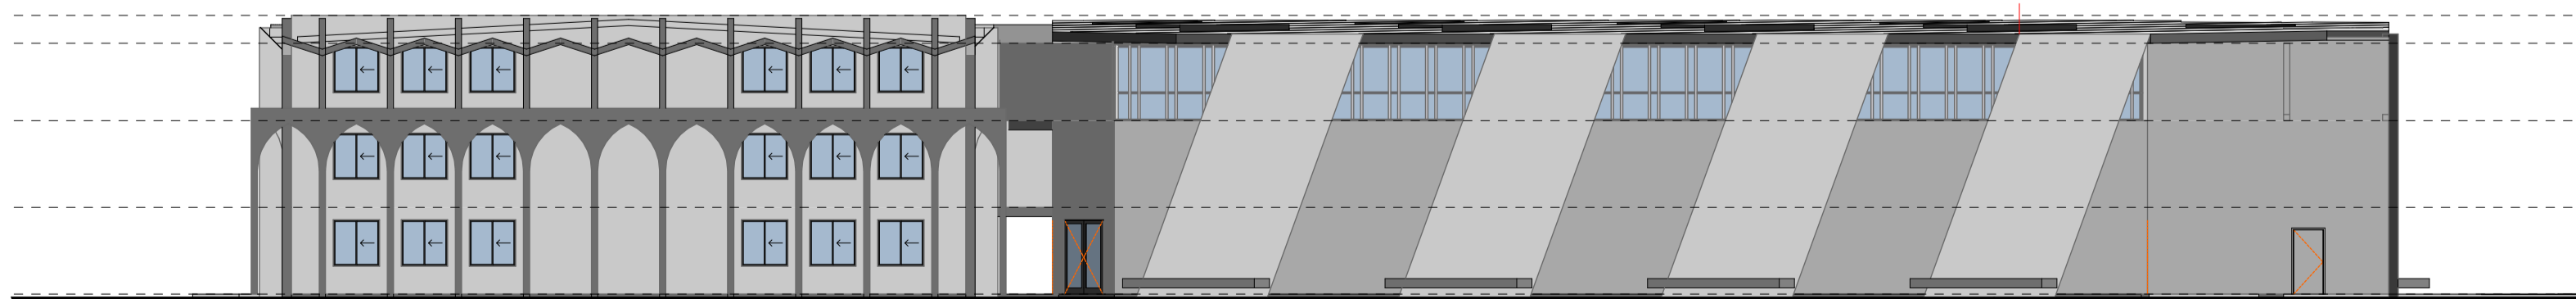

NORTH COLLEGE ELEVATION

NOTE:

- THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ARCHITECTURAL DRAWINGS AND SPECIFICATIONS AND OTHER WRITTEN INSTRUCTIONS.
- DIMENSIONS SHALL NOT BE OBTAINED BY SCALING FROM DRAWINGS.
- REFER TO ARCHITECTS FINAL DRAWINGS.
- BUILDER SHALL CHECK ALL RELEVANT DIMENSIONS ON SITE.
- REFER ANY DISCREPANCY TO THE ENGINEER/ARCHITECT.
- IF IN DOUBT - ASK.
- MATERIALS AND WORKMANSHIP SHALL COMPLY WITH THE APPROPRIATE SAA SPECIFICATIONS OR CODE AND WITH THE REQUIREMENTS OF THE RELEVANT LOCAL AUTHORITY.
- DURING CONSTRUCTION THE STRUCTURE SHALL BE MAINTAINED IN A STABLE CONDITION AND NO PART SHALL BE OVERSTRESSED. THE BUILDER SHALL BE RESPONSIBLE FOR ANY DAMAGE TO THE WORKS DURING CONSTRUCTION.
- ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED.
- CONCRETE QUALITY SHALL BE :-
- FC - SLUMP - Max Agg CEMENT
- SLABS - 20 MPa N/A - 20 mm - "A"
- PIERS - 20 MPa N/A - 20 mm - "A"
- REINFORCEMENT LAPS - MESH - 2 CROSSWIRES + 25 mm BARS - Y12-450 mm / Y16-550 mm
- COVER TO REINFORCEMENT - SLAB ABOVE GROUND - TOP : 30 mm
- BOTTOM : 30 mm
- SLAB ON GROUND - 40 mm (ALL ROUND)
- ALL REINFORCEMENT SHALL BE ADEQUATELY SUPPORTED IN ITS REQUIRED POSITION
- CONSTRUCTION JOINTS WHERE NOT SHOWN SHALL BE LOCATED TO THE APPROVAL OF THE ENGINEER.
- NO HOLES OR CHASES OTHER THAN THOSE SHOWN ON THE STRUCTURAL DRAWINGS SHALL BE MADE IN CONCRETE MEMBERS WITHOUT PRIOR APPROVAL OF THE ENGINEER.
- INTERNAL AND EDGE BEAMS ARE DESIGNED TO REST ON NATURAL GROUND OR CONTROLLED FILL WITH A SAFE BEARING CAPACITY OF 100 KPa U.N.O.
- PRIOR TO CONSTRUCTION OF THE SLAB OR FORMATION OF A CONTROLLED CUT/FILL BUILDING PLATFORM :-
- (a) AN AREA EXTENDING AT LEAST 1.0 m BEYOND THE EDGE OF THE SLAB AND TO THE TOE OF ANY FILL BATTERS SHALL BE STRIPPED OF ALL ORGANIC MATTER AND ASSOCIATED TOPSOIL.
- (b) THE SUBGRADE SHALL BE THOROUGHLY TRIMMED AND CONSOLIDATED.
- THE SLAB SHALL BE LAID ON MAX 50 mm THICKNESS OF CONSOLIDATED LEVELLING SAND COVERED WITH A 0.2 mm THICK POLYTHENE VAPOUR BARRIER WITH ALL JOINTS PROPERLY LAPPED AND TAPED.
- THE SLAB SHALL BE CURED BY ONE OF THE FOLLOWING METHODS :-
- (a) WETTING TWICE DAILY FOR THE FIRST THREE DAYS.
- (b) USING AN APPROVED CURING COMPOUND.
- ALL CONCRETE SHALL BE MECHANICALLY VIBRATED AND SHALL BE CAREFULLY WORKED AROUND THE REINFORCEMENT AND INTO CORNERS OF FORMWORK.
- THE OWNER'S ATTENTION IS DRAWN TO APPENDIX A OF AS2870.2-1996
- PERFORMANCE REQUIREMENTS AND FOUNDATION MAINTENANCE:-
- SLAB AND FOOTING DESIGN HAS BEEN BASED ON PRINCIPLES AS SET OUT IN AS2870.1-1996 "RESIDENTIAL SLABS AND FOOTINGS".
- ALL DEMOLITION WORK TO BE SUPERVISED BY THE STRUCTURAL ENGINEER AT ALL TIMES.

ALLOW +/- or -200 mm ON ALL RL(S) ON PLANS. ALL LEVELS ARE SUBJECT TO FINAL DETERMINATION ON SITE.
All work on this drawing must not be used or altered in anyway without the consent from A&H Eco Group pty ltd copyright ©

	ISSUE	REVISION	DATE	ISSUE	REVISION	DATE	PROJECT: 9 Howard road, Minto Height NSW 2566	DRAWING No: 5 OF 12 DATE: 24/03/16 SCALE: AS SHOWN @A1 DRAWN: AL Paper size: A1
	A	INITIAL SUBMISSION	24/03/16					
							CLIENT: Imam Ali College PROJECT No. 039/16	

**9 HOWARD ROAD,
MINTO HIEGHTS NSW
2566**

PROPOSED PRIVATE COLLEGE
LOT 1, DP 10092
TOTAL SITE AREA: 3.58 ha





ZONE LEGEND

ZONE A - CLASSES
ZONE B - ENTRY, OFFICE & LIBRARY
ZONE C - HALL & LIBRARY


NOTE:

- THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ARCHITECTURAL DRAWINGS AND SPECIFICATIONS AND OTHER WRITTEN INSTRUCTIONS.
- DIMENSIONS SHALL NOT BE OBTAINED BY SCALING FROM DRAWINGS.
- REFER TO ARCHITECTS FINAL DRAWINGS.
- BUILDER SHALL CHECK ALL RELEVANT DIMENSIONS ON SITE. REFER ANY DISCREPANCY TO THE ENGINEER/ARCHITECT.
- IF IN DOUBT - ASK.
- MATERIALS AND WORKMANSHIP SHALL COMPLY WITH THE APPROPRIATE SAA SPECIFICATIONS OR CODE AND WITH THE REQUIREMENTS OF THE RELEVANT LOCAL AUTHORITY.
- DURING CONSTRUCTION THE STRUCTURE SHALL BE MAINTAINED IN A STABLE CONDITION AND NO PART SHALL BE OVERSTRESSED. THE BUILDER SHALL BE RESPONSIBLE FOR ANY DAMAGE TO THE WORKS DURING CONSTRUCTION.
- ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED.
- CONCRETE QUALITY SHALL BE :-
FC - SLUMP Max Agg CEMENT
SLABS - 20 MPa 80 mm 20 mm "A"
PIERS - 20 MPa N/A 20 mm "A"
REINFORCEMENT LAPS - MESH - 2 CROSSWIRES + 25 mm BARS - Y12-450 mm / Y16-550 mm
- COVER TO REINFORCEMENT - SLAB ABOVE GROUND - TOP : 30 mm
- BOTTOM : 30 mm
- SLAB ON GROUND - 40 mm (ALL ROUND)
- ALL REINFORCEMENT SHALL BE ADEQUATELY SUPPORTED IN ITS REQUIRED POSITION
- CONSTRUCTION JOINTS WHERE NOT SHOWN SHALL BE LOCATED TO THE APPROVAL OF THE ENGINEER.
- NO HOLES OR CHASES OTHER THAN THOSE SHOWN ON THE STRUCTURAL DRAWINGS SHALL BE MADE IN CONCRETE MEMBERS WITHOUT PRIOR APPROVAL OF THE ENGINEER.
- INTERNAL AND EDGE BEAMS ARE DESIGNED TO REST ON NATURAL GROUND OR CONTROLLED FILL WITH A SAFE BEARING CAPACITY OF 100 KPa U.N.O.
- PRIOR TO CONSTRUCTION OF THE SLAB OR FORMATION OF A CONTROLLED CUT/FILL BUILDING PLATFORM :-
(a) AN AREA EXTENDING AT LEAST 1.0 m BEYOND THE EDGE OF THE SLAB AND TO THE TOE OF ANY FILL BATTERS SHALL BE STRIPPED OF ALL ORGANIC MATTER AND ASSOCIATED TOPSOIL.
(b) THE SUBGRADE SHALL BE THOROUGHLY TRIMMED AND CONSOLIDATED.
- THE SLAB SHALL BE LAID ON MAX 50 mm THICKNESS OF CONSOLIDATED LEVELLING SAND COVERED WITH A 0.2 mm THICK POLYTHENE VAPOUR BARRIER WITH ALL JOINTS PROPERLY LAPPED AND TAPED.
- THE SLAB SHALL BE CURED BY ONE OF THE FOLLOWING METHODS :-
(a) WETTING TWICE DAILY FOR THE FIRST THREE DAYS.
(b) USING AN APPROVED CURING COMPOUND.
- ALL CONCRETE SHALL BE MECHANICALLY VIBRATED AND SHALL BE CAREFULLY WORKED AROUND THE REINFORCEMENT AND INTO CORNERS OF FORMWORK.
- THE OWNER'S ATTENTION IS DRAWN TO APPENDIX A OF AS2870.2-1996 "PERFORMANCE REQUIREMENTS AND FOUNDATION MAINTENANCE".
- SLAB AND FOOTING DESIGN HAS BEEN BASED ON PRINCIPLES AS SET OUT IN AS2870.1-1996 "RESIDENTIAL SLABS AND FOOTINGS".
- ALL DEMOLITION WORK TO BE SUPERVISED BY THE STRUCTURAL ENGINEER AT ALL TIMES.

ALLOW ± 0 or - 200 mm ON ALL RL(S) ON PLANS. ALL LEVELS ARE SUBJECT TO FINAL DETERMINATION ON SITE.
All work on this drawing must not be used or altered in anyway without the consent from A&H Eco Group pty ltd copyright ©

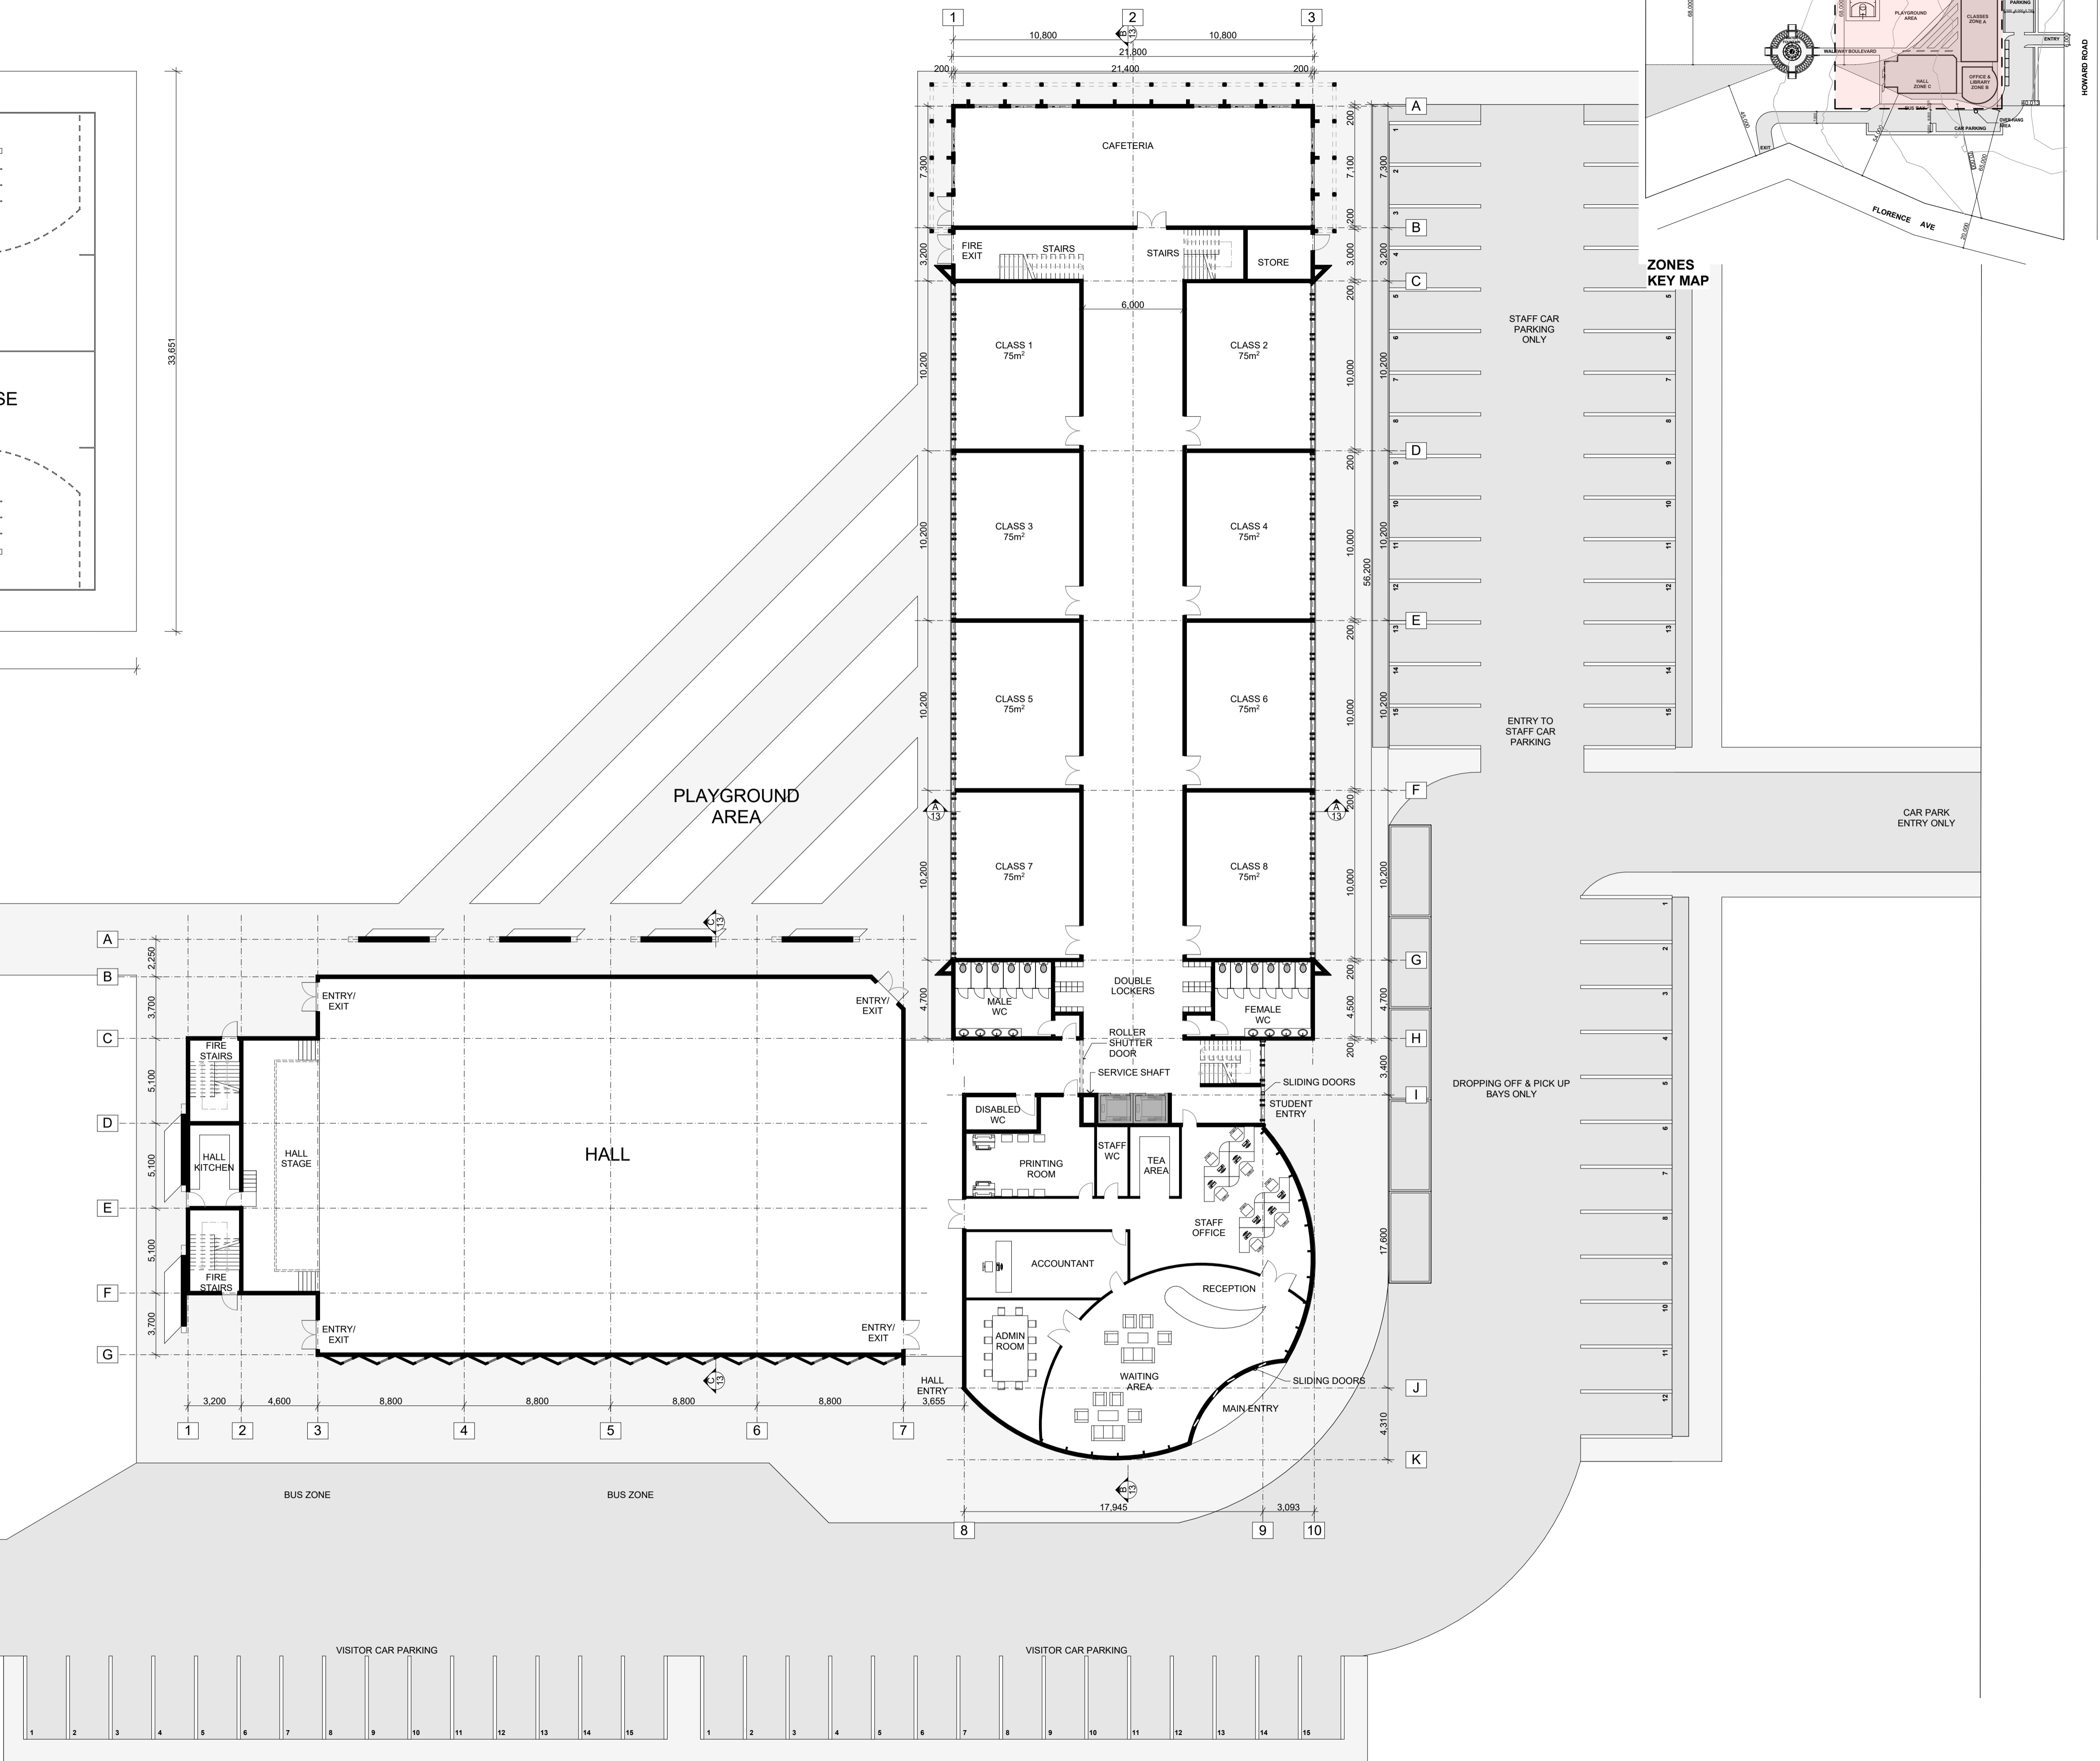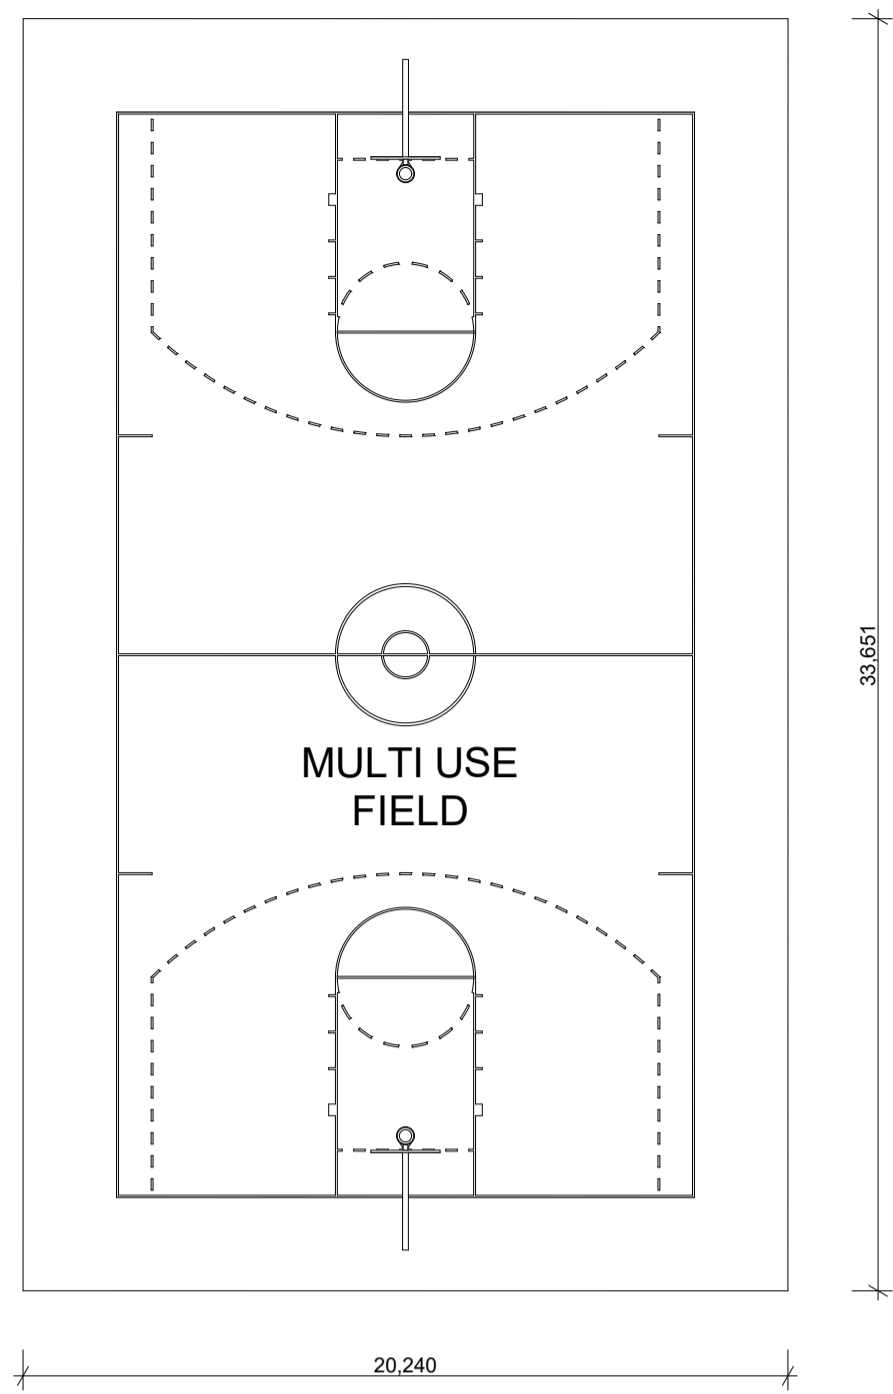

ZONES KEY MAP

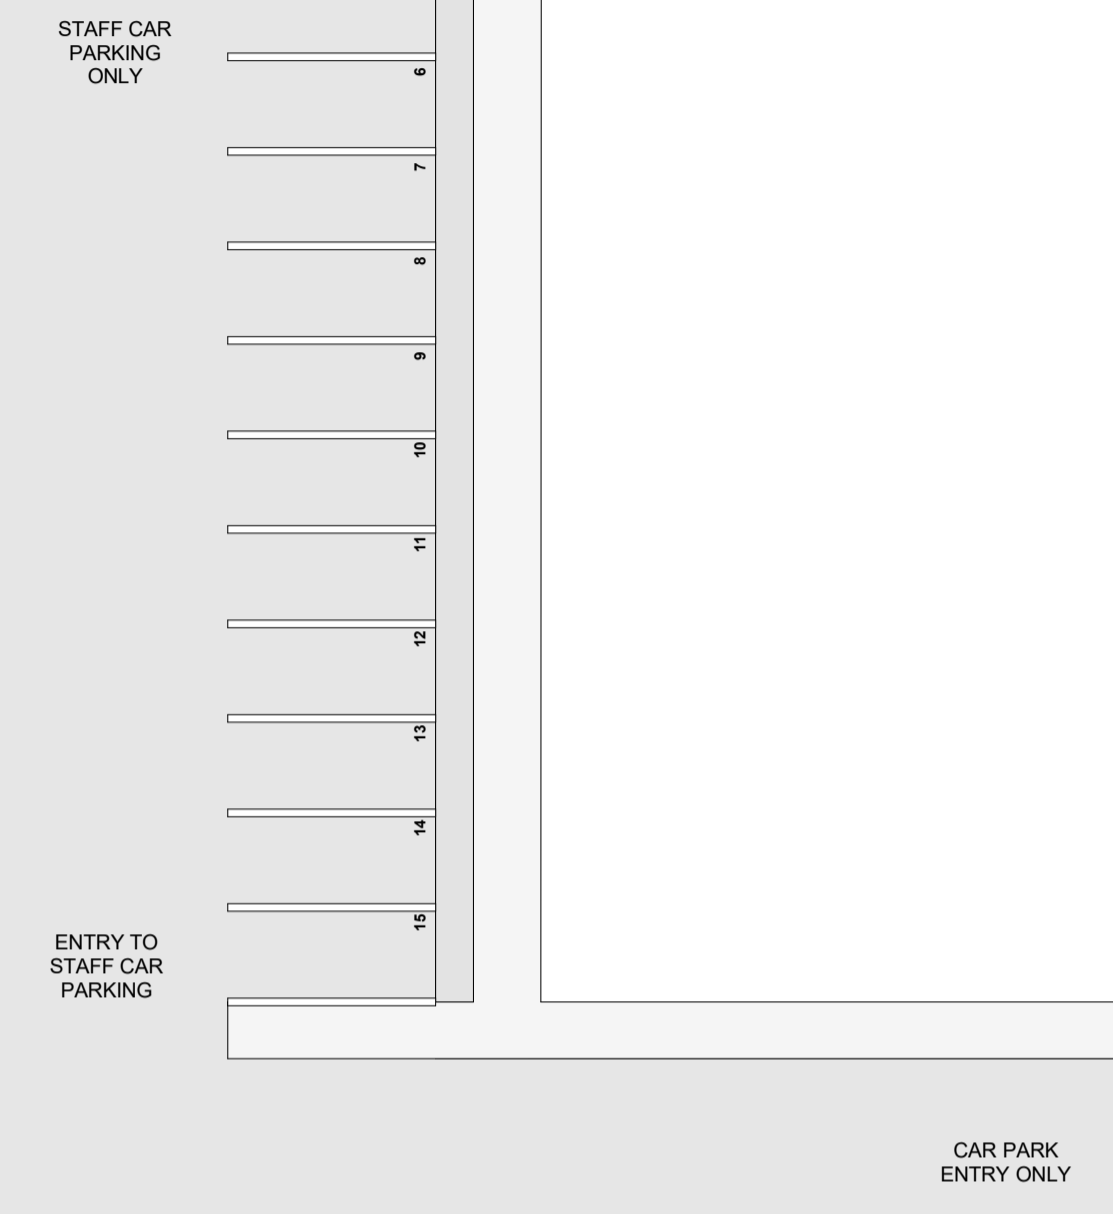


**GROUND FLOOR PLAN
1:200**


ISSUE	REVISION	DATE	ISSUE	REVISION	DATE
A	INITIAL SUBMISSION	24/03/18			

PROJECT:	9 Howard road, Minto Height NSW 2566	DRAWING No:	6 OF 12
CLIENT:	Imam Ali College	DATE:	24/03/18
PROJECT No:	039/16	SCALE:	AS SHOWN @A1
		DRAWN:	AL
		Paper size:	A1


**9 HOWARD ROAD,
MINTO HIEGHTS NSW
2566**
PROPOSED PRIVATE COLLEGE
LOT 1, DP 10092
TOTAL SITE AREA: 3.58 ha

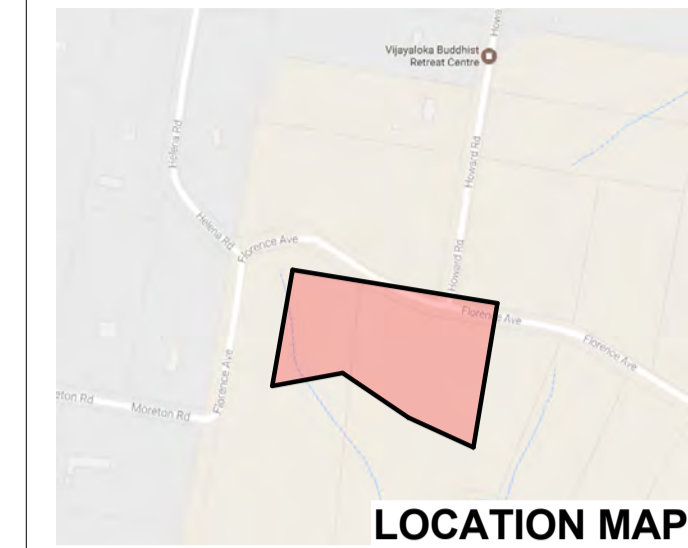

ZONE LEGEND
 ZONE A - CLASSES
 ZONE B - ENTRY, OFFICE & LIBRARY
 ZONE C - HALL & LIBRARY

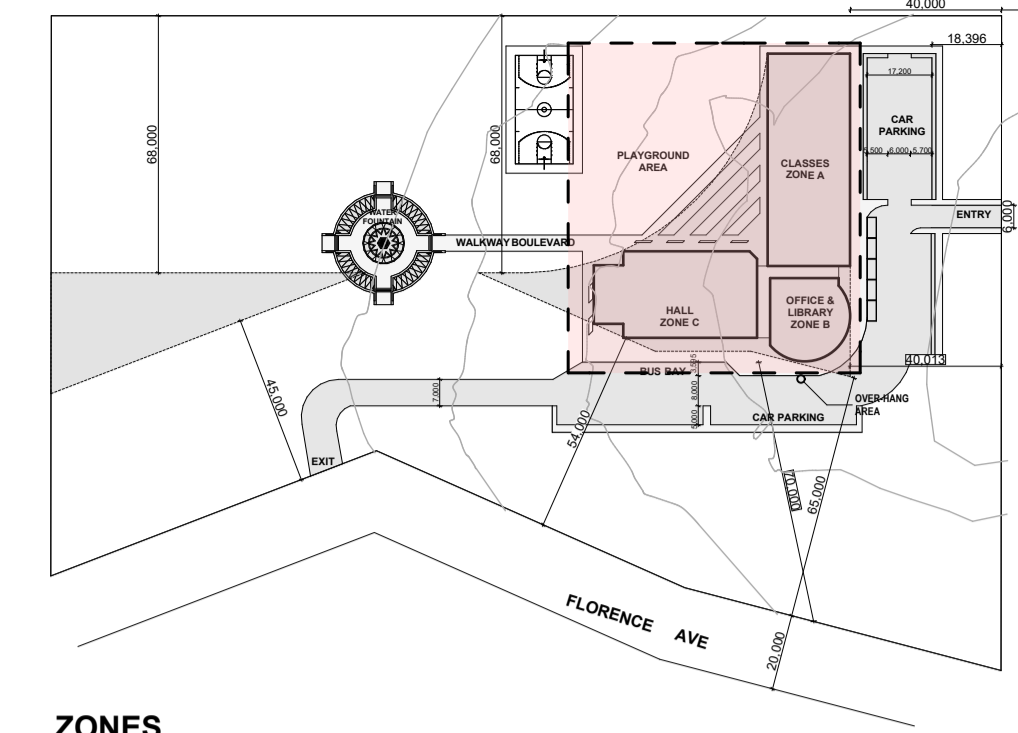

**ZONES
KEY MAP**

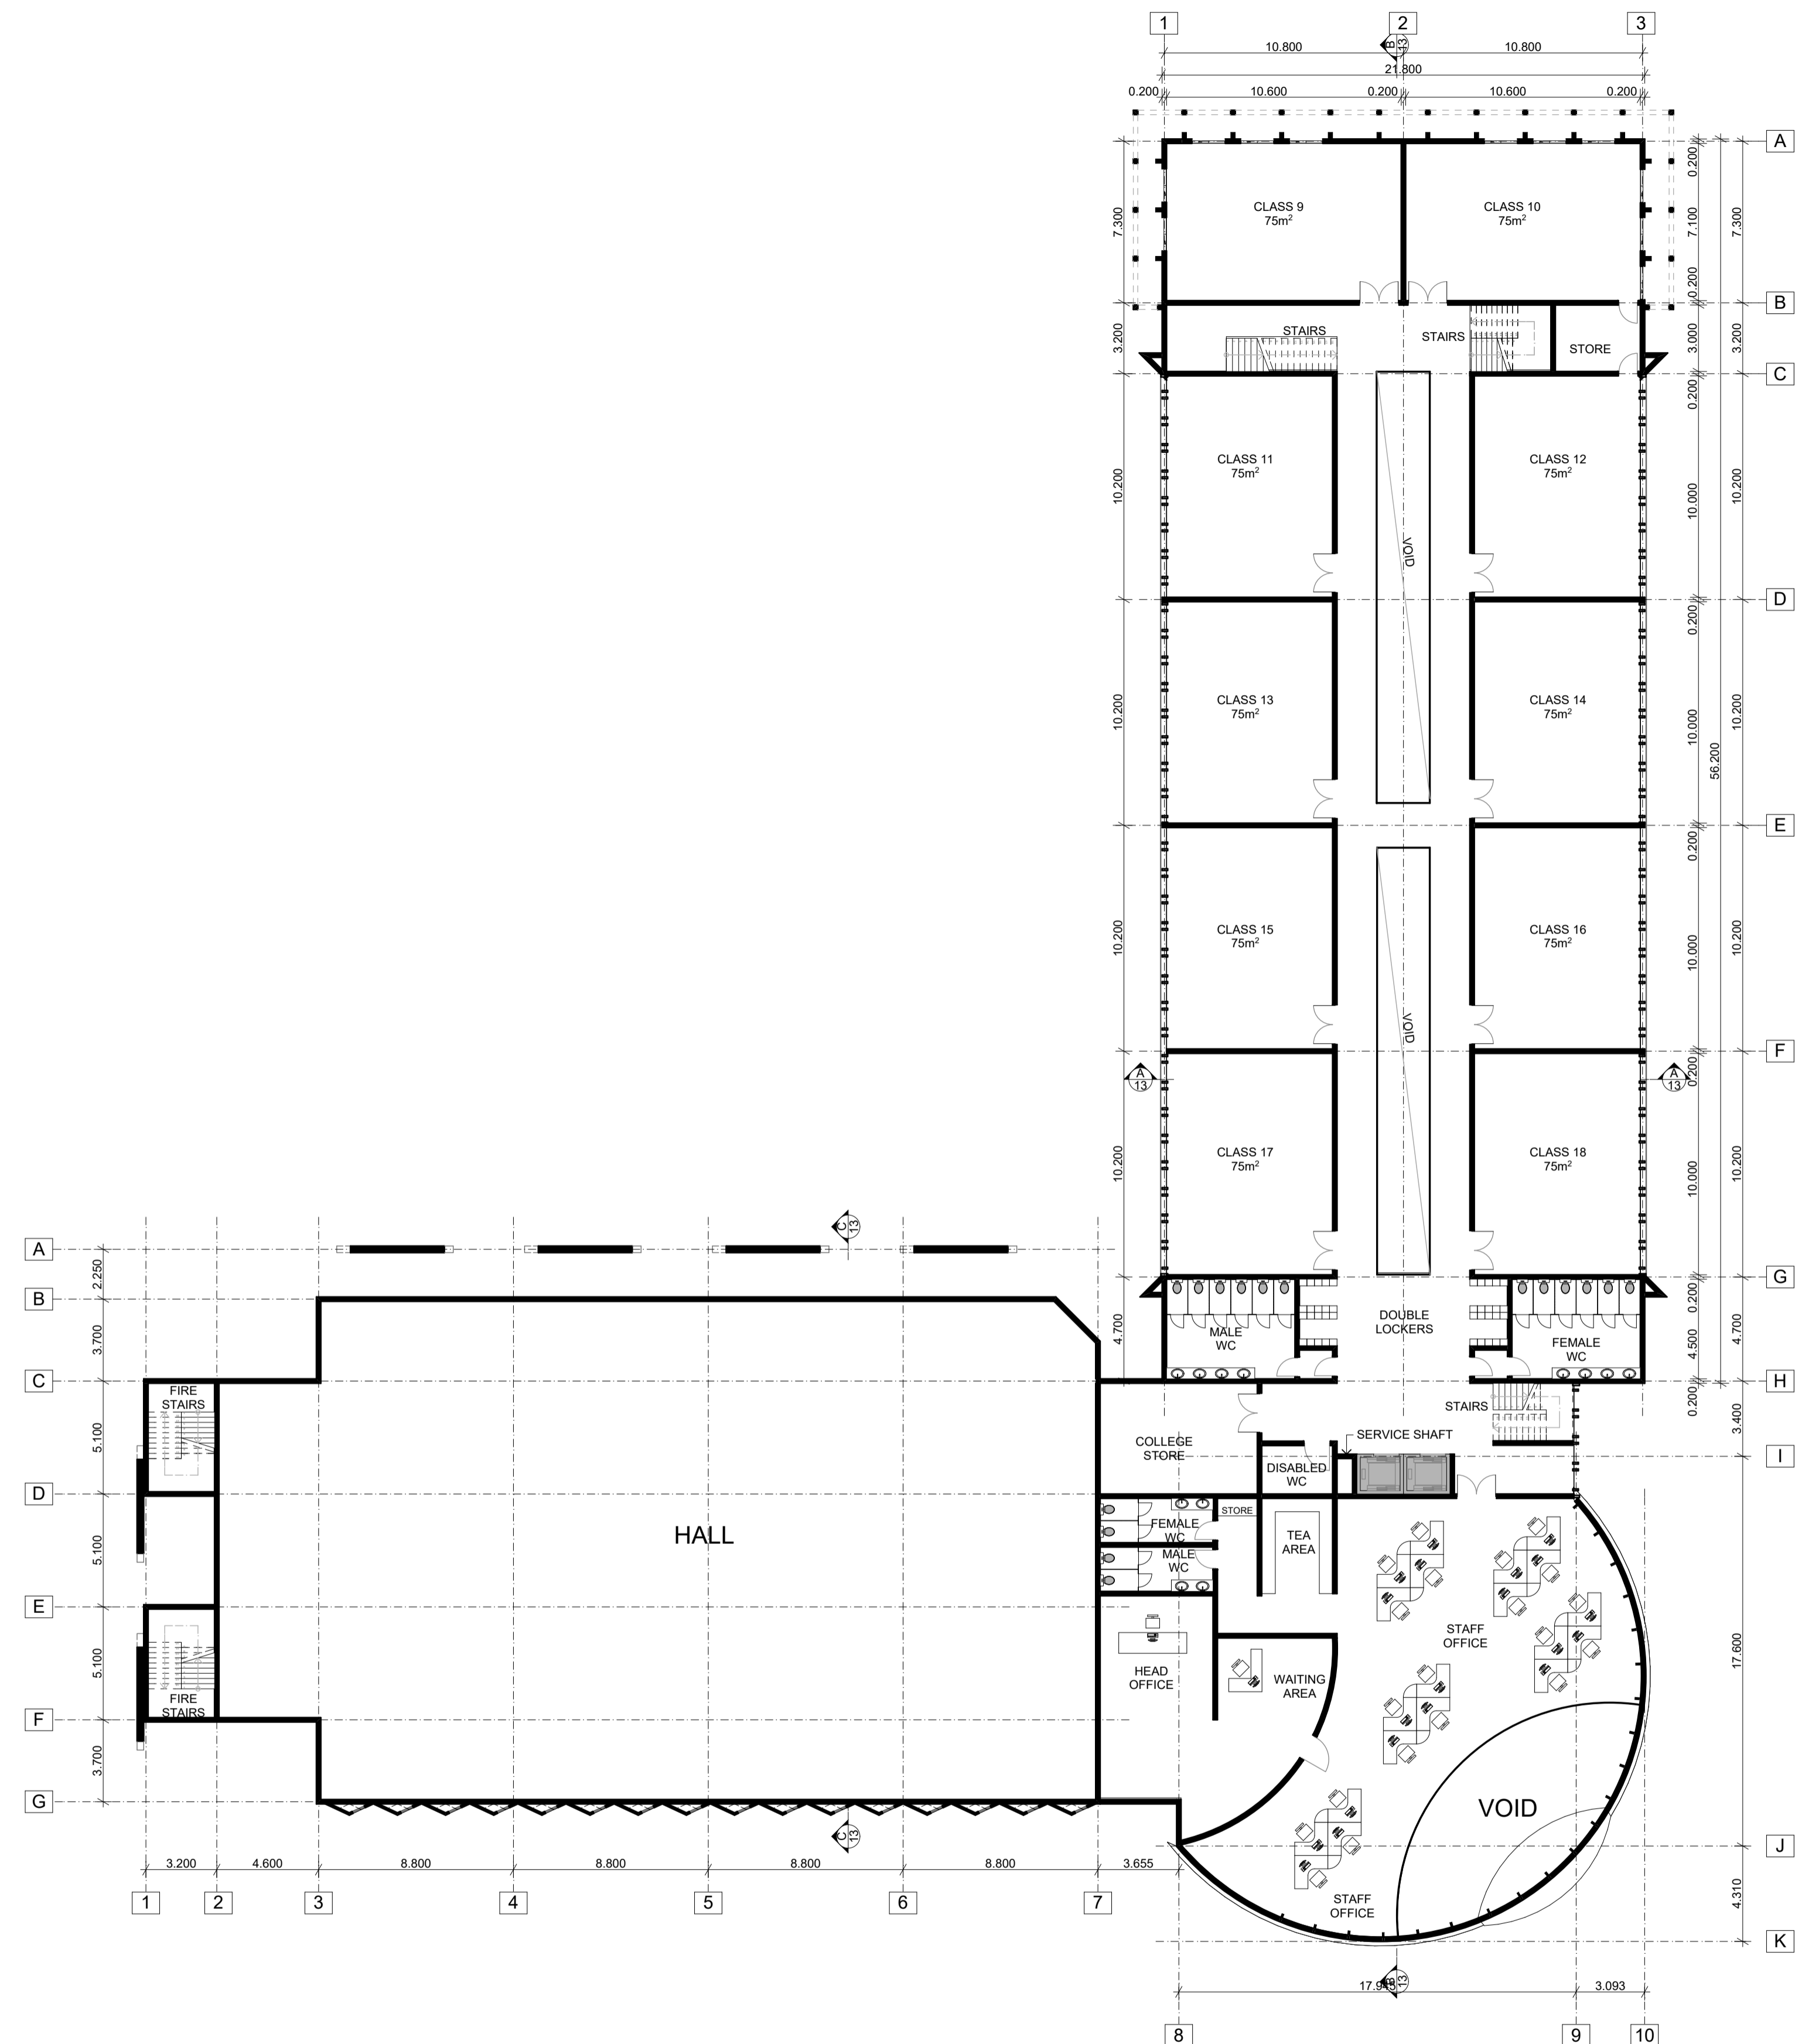

NOTE:

- THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ARCHITECTURAL DRAWINGS AND SPECIFICATIONS AND OTHER WRITTEN INSTRUCTIONS.
- DIMENSIONS SHALL NOT BE OBTAINED BY SCALING FROM DRAWINGS.
- REFER TO ARCHITECTS FINAL DRAWINGS.
- BUILDER SHALL CHECK ALL RELEVANT DIMENSIONS ON SITE.
- REFER ANY DISCREPANCY TO THE ENGINEER/ARCHITECT.
- IF IN DOUBT - ASK.
- MATERIALS AND WORKMANSHIP SHALL COMPLY WITH THE APPROPRIATE SAA SPECIFICATIONS OR CODE AND WITH THE REQUIREMENTS OF THE RELEVANT LOCAL AUTHORITY.
- DURING CONSTRUCTION THE STRUCTURE SHALL BE MAINTAINED IN A STABLE CONDITION AND NO PART SHALL BE OVERSTRESSED. THE BUILDER SHALL BE RESPONSIBLE FOR ANY DAMAGE TO THE WORKS DURING CONSTRUCTION.
- ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED.
- CONCRETE QUALITY SHALL BE :-
 Fc - SLUMP Max Agg CEMENT
 SLABS - 20 MPa NA 20 mm "A"
 PIERS - 20 MPa NA 20 mm "A"
 REINFORCEMENT LAPS - MESH - 2 CROSSWIRES + 25 mm BARS - Y12-450 mm / Y16-550 mm
- COVER TO REINFORCEMENT :- SLAB ABOVE GROUND - TOP : 30 mm
 - BOTTOM : 30 mm
 SLAB ON GROUND - 40 mm (ALL ROUND)
- ALL REINFORCEMENT SHALL BE ADEQUATELY SUPPORTED IN ITS REQUIRED POSITION
- CONSTRUCTION JOINTS WHERE NOT SHOWN SHALL BE LOCATED TO THE APPROVAL OF THE ENGINEER.
- NO HOLES OR CHASES OTHER THAN THOSE SHOWN ON THE STRUCTURAL DRAWINGS SHALL BE MADE IN CONCRETE MEMBERS WITHOUT PRIOR APPROVAL OF THE ENGINEER.
- INTERNAL AND EDGE BEAMS ARE DESIGNED TO REST ON NATURAL GROUND OR CONTROLLED FILL WITH A SAFE BEARING CAPACITY OF 100 KPa U.N.O.
- PRIOR TO CONSTRUCTION OF THE SLAB OR FORMATION OF A CONTROLLED CUT/FILL BUILDING PLATFORM :-
 (a) AN AREA EXTENDING AT LEAST 1.0 m BEYOND THE EDGE OF THE SLAB AND TO THE TOE OF ANY FILL BATTERS SHALL BE STRIPPED OF ALL ORGANIC MATTER AND ASSOCIATED TOPSOIL.
 (b) THE SUBGRADE SHALL BE THOROUGHLY TRIMMED AND CONSOLIDATED.
- THE SLAB SHALL BE LAID ON MAX 50 mm THICKNESS OF CONSOLIDATED LEVELLING SAND COVERED WITH A 0.2 mm THICK POLYETHENE VAPOUR BARRIER WITH ALL JOINTS PROPERLY LAPPED AND TAPED.
- THE SLAB SHALL BE CURED BY ONE OF THE FOLLOWING METHODS :-
 (a) WETTING TWICE DAILY FOR THE FIRST THREE DAYS.
 (b) USING AN APPROVED CURING COMPOUND.
- ALL CONCRETE SHALL BE MECHANICALLY VIBRATED AND SHALL BE CAREFULLY WORKED AROUND THE REINFORCEMENT AND INTO CORNERS OF FORMWORK.
- THE OWNER'S ATTENTION IS DRAWN TO APPENDIX A OF AS2870.2-1996 "PERFORMANCE REQUIREMENTS AND FOUNDATION MAINTENANCE".
- SLAB AND FOOTING DESIGN HAS BEEN BASED ON PRINCIPLES AS SET OUT IN AS2870.1-1996 "RESIDENTIAL SLABS AND FOOTINGS".
- ALL DEMOLITION WORK TO BE SUPERVISED BY THE STRUCTURAL ENGINEER AT ALL TIMES.

ALLOW + or - 200 mm ON ALL RL(S) ON PLANS. ALL LEVELS ARE SUBJECT TO FINAL DETERMINATION ON SITE.
 All work on this drawing must not be used or altered in anyway without the consent from A&H Eco Group pty ltd copyright ©

**FIRST FLOOR PLAN
1:200**

ISSUE	REVISION	DATE	ISSUE	REVISION	DATE
A	INITIAL SUBMISSION	24/03/18			


PROJECT: 9 Howard road, Minto Height NSW 2566
 DRAWING No: 7 OF 12
 DATE: 24/03/18
 SCALE: AS
 SHOWN @A1
 DRAWN: AL
 Paper size: A1

CLIENT: Imam Ali College
 PROJECT No. 039/16


**9 HOWARD ROAD,
MINTO HIEGHTS NSW
2566**
PROPOSED PRIVATE COLLEGE
LOT 1, DP 10092
TOTAL SITE AREA: 3.58 ha



- ZONE LEGEND**
- ZONE A - CLASSES
 - ZONE B - ENTRY, OFFICE & LIBRARY
 - ZONE C - HALL & LIBRARY

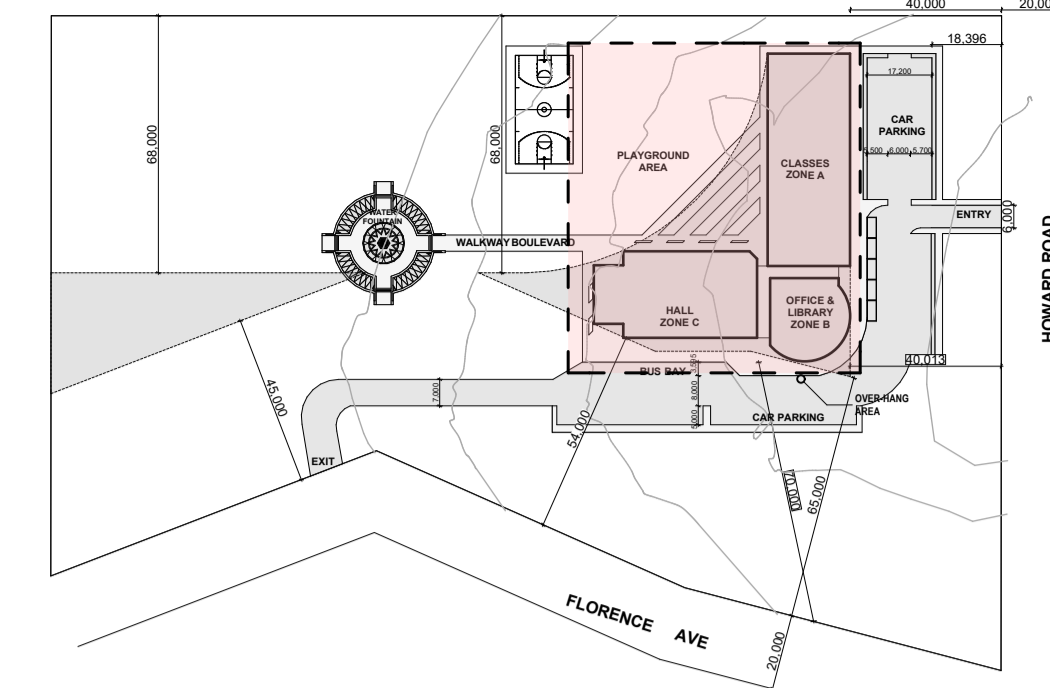

ZONES KEY MAP

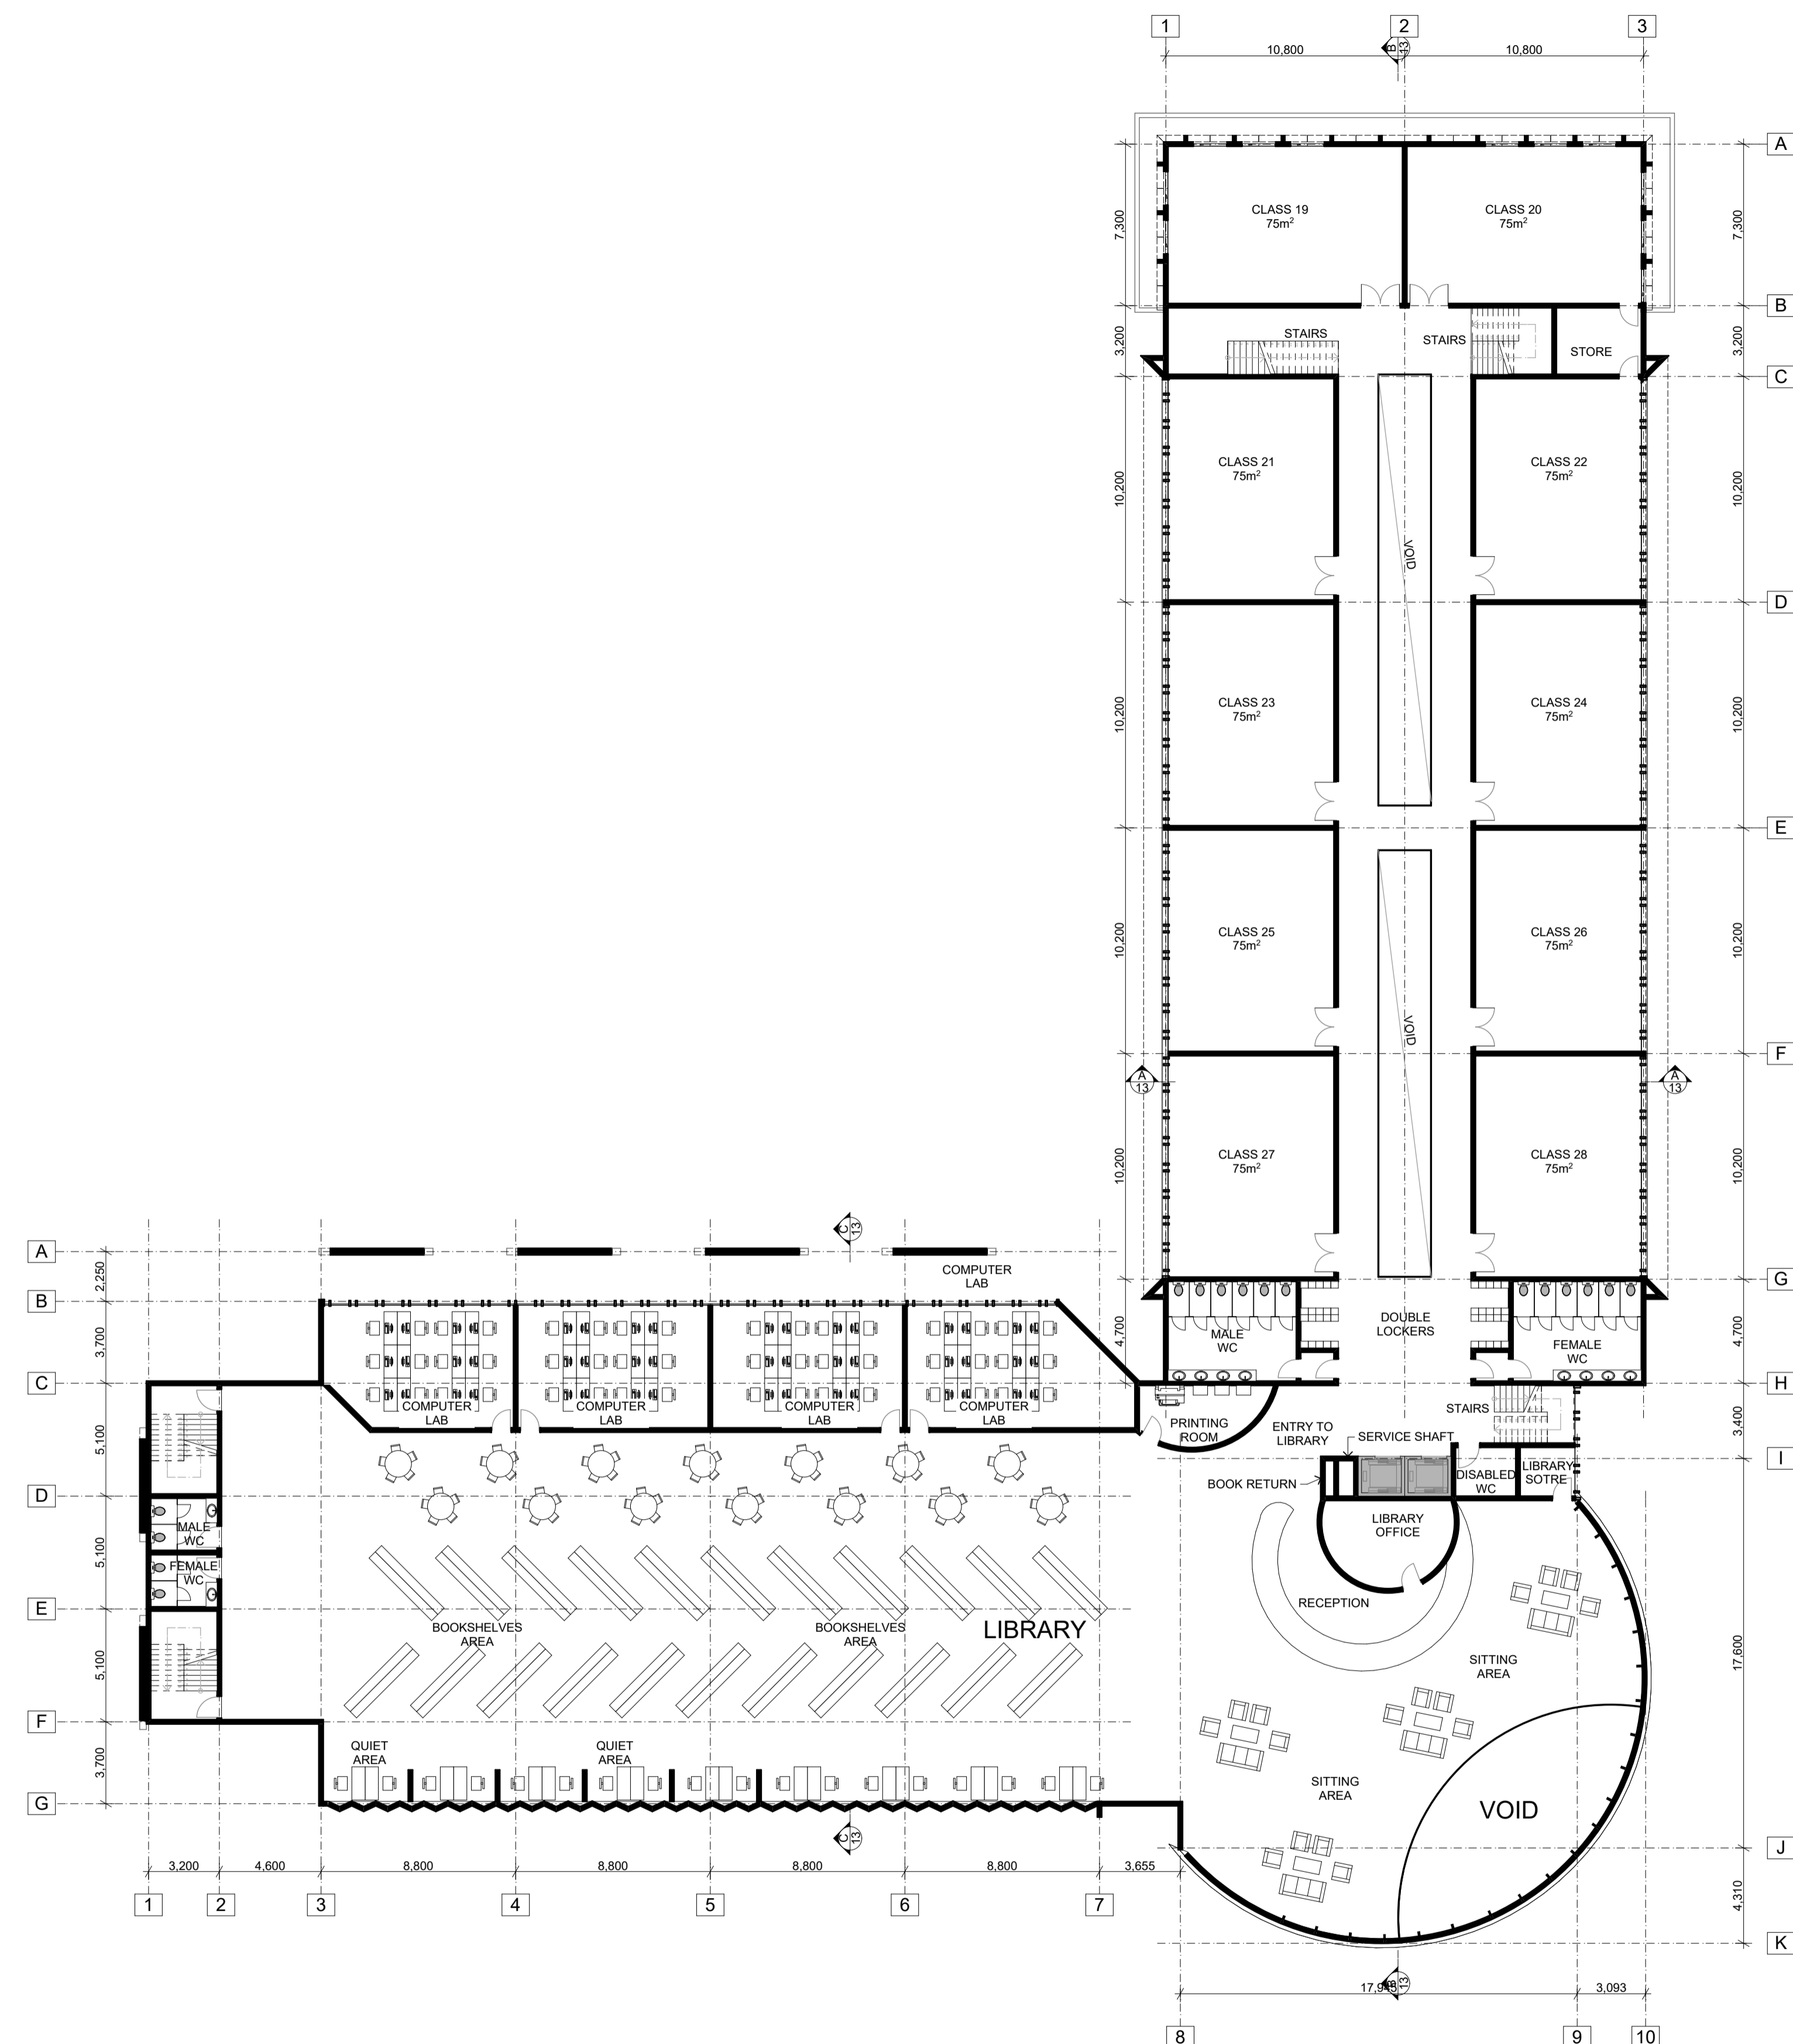

NOTE:

- THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ARCHITECTURAL DRAWINGS AND SPECIFICATIONS AND OTHER WRITTEN INSTRUCTIONS.
- DIMENSIONS SHALL NOT BE OBTAINED BY SCALING FROM DRAWINGS.
- REFER TO ARCHITECTS FINAL DRAWINGS.
- BUILDER SHALL CHECK ALL RELEVANT DIMENSIONS ON SITE. REFER ANY DISCREPANCY TO THE ENGINEER/ARCHITECT.
- IF IN DOUBT - ASK.
- MATERIALS AND WORKMANSHIP SHALL COMPLY WITH THE APPROPRIATE SAA SPECIFICATIONS OR CODE AND WITH THE REQUIREMENTS OF THE RELEVANT LOCAL AUTHORITY.
- DURING CONSTRUCTION THE STRUCTURE SHALL BE MAINTAINED IN A STABLE CONDITION AND NO PART SHALL BE OVERSTRESSED. THE BUILDER SHALL BE RESPONSIBLE FOR ANY DAMAGE TO THE WORKS DURING CONSTRUCTION.
- ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED.
- CONCRETE QUALITY SHALL BE :-
 Fc - SLUMP Max Agg CEMENT
 SLABS - 20 MPa NA 20 mm "A"
 PIERS - 20 MPa NA 20 mm "A"
 REINFORCEMENT LAPS - MESH - 2 CROSSWIRES + 25 mm BARS - Y12-450 mm / Y16-550 mm
- COVER TO REINFORCEMENT :- SLAB ABOVE GROUND - TOP : 30 mm
 - BOTTOM : 30 mm
 SLAB ON GROUND - 40 mm (ALL ROUND)
- ALL REINFORCEMENT SHALL BE ADEQUATELY SUPPORTED IN ITS REQUIRED POSITION
- CONSTRUCTION JOINTS WHERE NOT SHOWN SHALL BE LOCATED TO THE APPROVAL OF THE ENGINEER.
- NO HOLES OR CHASES OTHER THAN THOSE SHOWN ON THE STRUCTURAL DRAWINGS SHALL BE MADE IN CONCRETE MEMBERS WITHOUT PRIOR APPROVAL OF THE ENGINEER.
- INTERNAL AND EDGE BEAMS ARE DESIGNED TO REST ON NATURAL GROUND OR CONTROLLED FILL WITH A SAFE BEARING CAPACITY OF 100 KPa U.N.O.
- PRIOR TO CONSTRUCTION OF THE SLAB OR FORMATION OF A CONTROLLED CUT/FILL BUILDING PLATFORM :-
 (a) AN AREA EXTENDING AT LEAST 1.0 m BEYOND THE EDGE OF THE SLAB AND TO THE TOE OF ANY FILL BATTERS SHALL BE STRIPPED OF ALL ORGANIC MATTER AND ASSOCIATED TOPSOIL.
 (b) THE SUBGRADE SHALL BE THOROUGHLY TRIMMED AND CONSOLIDATED.
- THE SLAB SHALL BE LAID ON MAX 50 mm THICKNESS OF CONSOLIDATED LEVELLING SAND COVERED WITH A 0.2 mm THICK POLYTHENE VAPOUR BARRIER WITH ALL JOINTS PROPERLY LAPPED AND TAPED.
- THE SLAB SHALL BE CURED BY ONE OF THE FOLLOWING METHODS :-
 (a) WETTING TWICE DAILY FOR THE FIRST THREE DAYS.
 (b) USING AN APPROVED CURING COMPOUND.
- ALL CONCRETE SHALL BE MECHANICALLY VIBRATED AND SHALL BE CAREFULLY WORKED AROUND THE REINFORCEMENT AND INTO CORNERS OF FORMWORK.
- THE OWNER'S ATTENTION IS DRAWN TO APPENDIX A OF AS2870-2:1996 "PERFORMANCE REQUIREMENTS AND FOUNDATION MAINTENANCE".
- SLAB AND FOOTING DESIGN HAS BEEN BASED ON PRINCIPLES AS SET OUT IN AS2870-1:1996 "RESIDENTIAL SLABS AND FOOTINGS".
- ALL DEMOLITION WORK TO BE SUPERVISED BY THE STRUCTURAL ENGINEER AT ALL TIMES.


ALLOW + or - 200 mm ON ALL RL(S) ON PLANS. ALL LEVELS ARE SUBJECT TO FINAL DETERMINATION ON SITE.
 All work on this drawing must not be used or altered in anyway without the consent from A&H Eco Group pty ltd copyright ©

**SECOND FLOOR PLAN
1:200**

ISSUE	REVISION	DATE	ISSUE	REVISION	DATE	PROJECT	DRAWING No:
A	INITIAL SUBMISSION	24/03/18				9 Howard road, Minto Height NSW 2566	8 OF 12
							DATE: 24/03/18
							SCALE: AS
							SHOWN @A1
							DRAWN: AL
							PROJECT No. 039/16
							Paper size A1


**9 HOWARD ROAD,
MINTO HIEGHTS NSW
2566**

PROPOSED PRIVATE COLLEGE
LOT 1, DP 10092
TOTAL SITE AREA: 3.58 ha

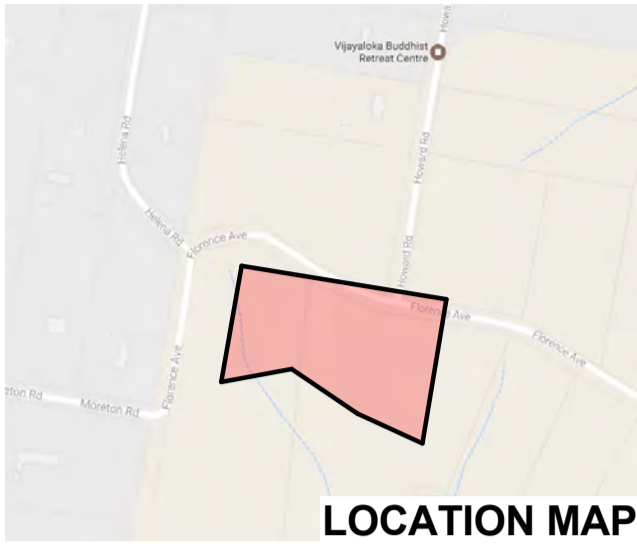


ZONE LEGEND

- ZONE A - CLASSES
- ZONE B - ENTRY, OFFICE & LIBRARY
- ZONE C - HALL & LIBRARY

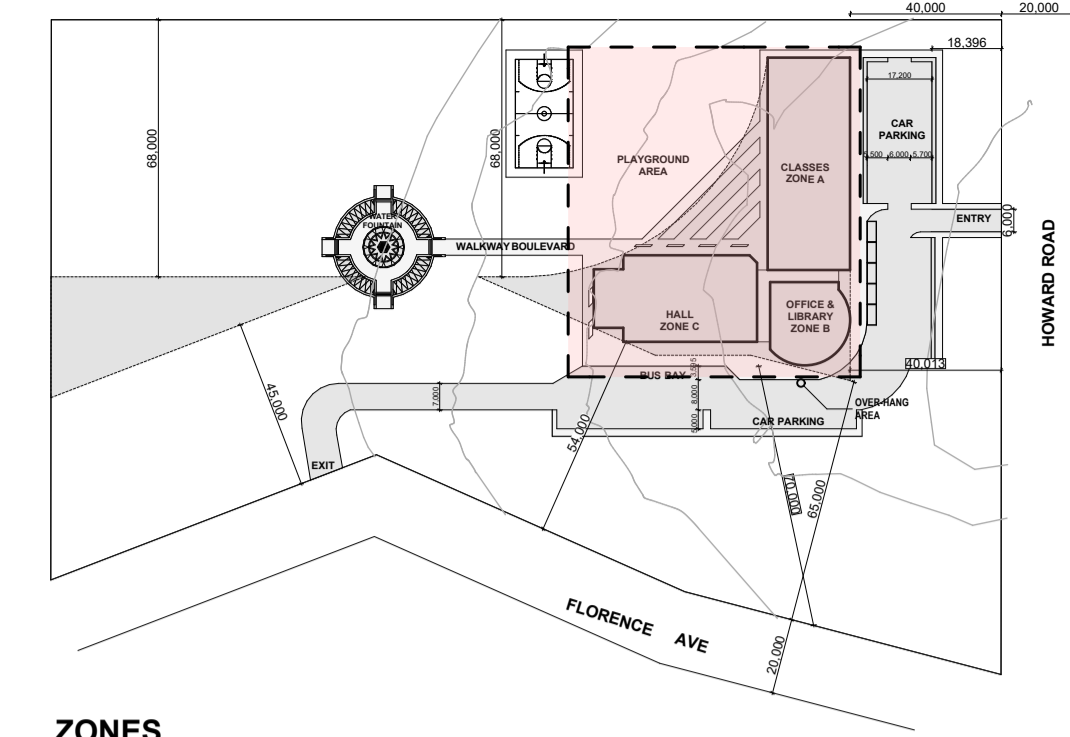

**ZONES
KEY MAP**

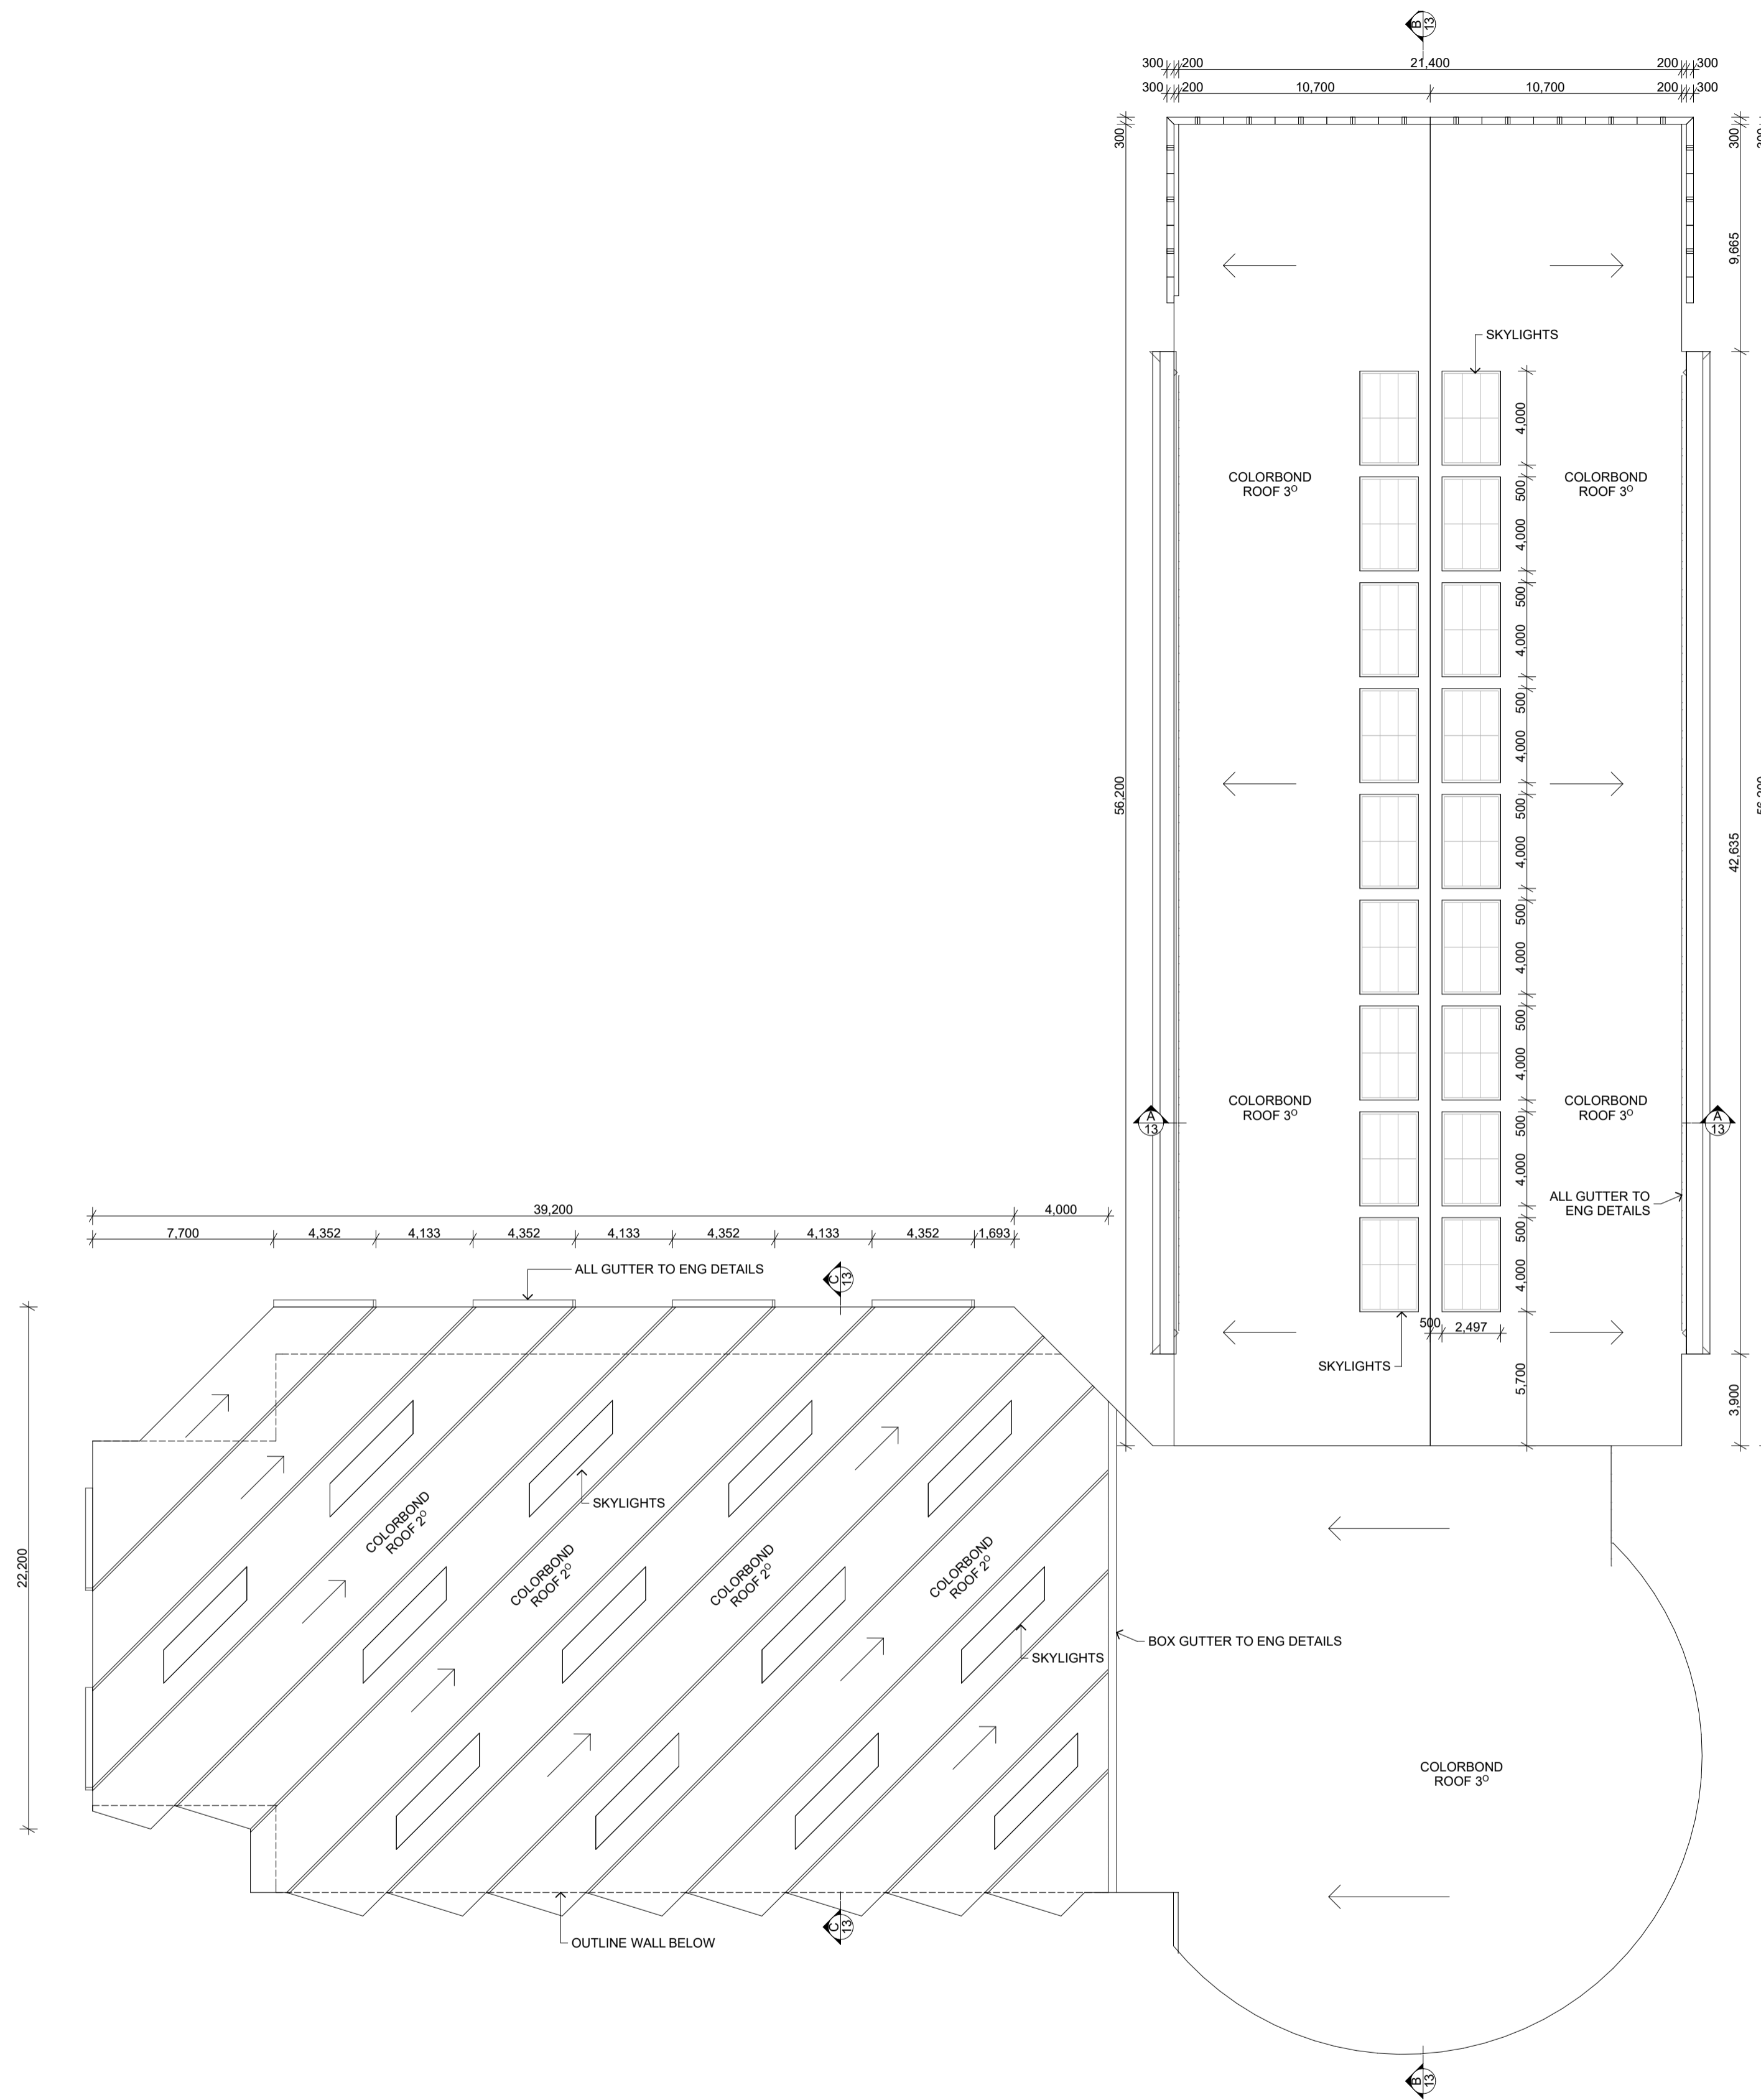

NOTE:

- THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ARCHITECTURAL DRAWINGS AND SPECIFICATIONS AND OTHER WRITTEN INSTRUCTIONS.
- DIMENSIONS SHALL NOT BE OBTAINED BY SCALING FROM DRAWINGS.
- REFER TO ARCHITECTS FINAL DRAWINGS.
- BUILDER SHALL CHECK ALL RELEVANT DIMENSIONS ON SITE.
- REFER ANY DISCREPANCY TO THE ENGINEER/ARCHITECT.
- IF IN DOUBT - ASK.
- MATERIALS AND WORKMANSHIP SHALL COMPLY WITH THE APPROPRIATE SAA SPECIFICATIONS OR CODE AND WITH THE REQUIREMENTS OF THE RELEVANT LOCAL AUTHORITY.
- DURING CONSTRUCTION THE STRUCTURE SHALL BE MAINTAINED IN A STABLE CONDITION AND NO PART SHALL BE OVERSTRESSED. THE BUILDER SHALL BE RESPONSIBLE FOR ANY DAMAGE TO THE WORKS DURING CONSTRUCTION.
- ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED.
- CONCRETE QUALITY SHALL BE :-
FC - SLUMP Max Agg CEMENT
SLABS - 20 MPa NA - 20 mm - A
PIERS - 20 MPa NA - 20 mm - A
- REINFORCEMENT LAPS - MESH - 2 CROSSWIRES + 25 mm BARS - Y12-450 mm / Y16-550 mm
- COVER TO REINFORCEMENT - SLAB ABOVE GROUND - TOP : 30 mm
- BOTTOM : 30 mm
- SLAB ON GROUND - 40 mm (ALL ROUND)
- ALL REINFORCEMENT SHALL BE ADEQUATELY SUPPORTED IN ITS REQUIRED POSITION
- CONSTRUCTION JOINTS WHERE NOT SHOWN SHALL BE LOCATED TO THE APPROVAL OF THE ENGINEER
- NO HOLES OR CHASES OTHER THAN THOSE SHOWN ON THE STRUCTURAL DRAWINGS SHALL BE MADE IN CONCRETE MEMBERS WITHOUT PRIOR APPROVAL OF THE ENGINEER
- INTERNAL AND EDGE BEAMS ARE DESIGNED TO REST ON NATURAL GROUND OR CONTROLLED FILL WITH A SAFE BEARING CAPACITY OF 100 KPa U.N.O.
- PRIOR TO CONSTRUCTION OF THE SLAB OR FORMATION OF A CONTROLLED CUT/FILL BUILDING PLATFORM :-
(a) AN AREA EXTENDING AT LEAST 1.0 m BEYOND THE EDGE OF THE SLAB AND TO THE TOE OF ANY FILL BATTERS SHALL BE STRIPPED OF ALL ORGANIC MATTER AND ASSOCIATED TOPSOIL.
(b) THE SUBGRADE SHALL BE THOROUGHLY TRIMMED AND CONSOLIDATED
- THE SLAB SHALL BE LAID ON MAX 50 mm THICKNESS OF CONSOLIDATED LEVELLING SAND COVERED WITH A 0.2 mm THICK POLYETHENE VAPOUR BARRIER WITH ALL JOINTS PROPERLY LAPPED AND TAPED.
- THE SLAB SHALL BE CURED BY ONE OF THE FOLLOWING METHODS :-
(a) WETTING TWICE DAILY FOR THE FIRST THREE DAYS.
(b) USING AN APPROVED CURING COMPOUND.
- ALL CONCRETE SHALL BE MECHANICALLY VIBRATED AND SHALL BE CAREFULLY WORKED AROUND THE REINFORCEMENT AND INTO CORNERS OF FORMWORK
- THE OWNER'S ATTENTION IS DRAWN TO APPENDIX A OF AS2870.2-1996
- PERFORMANCE REQUIREMENTS AND FOUNDATION MAINTENANCE:-
- SLAB AND FOOTING DESIGN HAS BEEN BASED ON PRINCIPLES AS SET OUT IN AS2870.1-1996 "RESIDENTIAL SLABS AND FOOTINGS".
- ALL DEMOLITION WORK TO BE SUPERVISED BY THE STRUCTURAL ENGINEER AT ALL TIMES.

ALLOW + or - 200 mm ON ALL RL(S) ON PLANS. ALL LEVELS ARE SUBJECT TO FINAL DETERMINATION ON SITE.

All work on this drawing must not be used or altered in anyway without the consent from A&H Eco Group pty ltd copyright ©

**ROOF PLAN
1:200**

ISSUE	REVISION	DATE	ISSUE	REVISION	DATE	PROJECT:	DRAWING No:
A	INITIAL SUBMISSION	24/03/18				9 Howard road, Minto Height NSW 2566	9 OF 12
							DATE: 24/03/18
							SCALE: AS
							SHOWN @A1
							DRAWN: AL
							Paper size: A1

