

The Secretary
NSW Department of Planning, Industry & Environment

18 April 2022

ATTENTION: Sally Munk

Dear Sir or Madam

I refer to the Department's email of 12 April 2022 regarding the amended application for State Significant Development SSD-6236 Eastern Creek Energy from Waste Facility at Honeycomb Drive, Eastern Creek (Part Lot 1, Part Lot 2 and Lot 3 DP 1145808) in the Blacktown City Local Government Area (LGA), advising the Applicant has appealed the Independent Planning Commission (IPC) refusal of the development in the Land & Environment Court, and has been granted leave to rely upon amended plans. Submissions need to be made to the Department by no later than 14 June 2022.

Endeavour Energy is unaware of the Commission's decision or the reasons for the refusal. Endeavour Energy's initial submission to the Department did not object to the Development Application but provided recommendations and comments as to matters affecting the electricity infrastructure on and in the vicinity of the site. Presumably these are not part of the reasons for the Commission's refusal and the ongoing Court Proceedings?

From a review of the Planning Statement there does not appear to be any matters which directly and materially impact Endeavour Energy's electricity infrastructure. However, should this not be the case, then the matter should be referred to the following contacts (also identified in Endeavour Energy's initial submission) for review and advice.

For any matters related to:

- Network capacity / connection, the applicant will need to contact Endeavour Energy's Customer Network Solutions Branch [via Head Office enquiries on business days from 9am - 4:30pm on telephone: 133 718 or (02) 9853 6666] who are responsible for managing the conditions of supply with the proponent and their Accredited Service Provider (ASP).
- All encroachments and /or activities (works) within the easements or affecting protected works / assets (other than those approved / certified by Endeavour Energy's Customer Network Solutions Branch as part of an enquiry / application for load or asset relocation project and even if not part of the Development Application) need to be referred to Endeavour Energy's Easement Officer for assessment and possible approval if they meet the minimum safety requirements and controls. However please note that this does not constitute or imply the granting of approval by Endeavour Energy to any or all of the proposed encroachments and / or activities within the easement. For further information please refer to the attached copy of Endeavour Energy's Mains Design Instruction MDI 0044 'Easements and Property Tenure'.

Endeavour Energy's Easement Officers can be contacted via Head Office enquiries on business days from 9am - 4:30pm on telephone: 133 718 or (02) 9853 6666 or alternatively by email Easements@endeavourenergy.com.au .

Could you please pass on a copy of this submission to the applicant? Should you wish to discuss this matter, or have any questions, please do not hesitate to contact me or the contacts identified in Endeavour Energy's initial submission in relation to the various matters. Due to the high number of development application / planning proposal notifications submitted to Endeavour Energy, to ensure a response contact by email to property.development@endeavourenergy.com.au is preferred.

Yours faithfully

Cornelis Duba

Development Application Specialist

Sustainability & Environment


M: 0455 250 981

E: cornelis.duba@endeavourenergy.com.au


51 Huntingwood Drive, Huntingwood NSW 2148

www.endeavourenergy.com.au



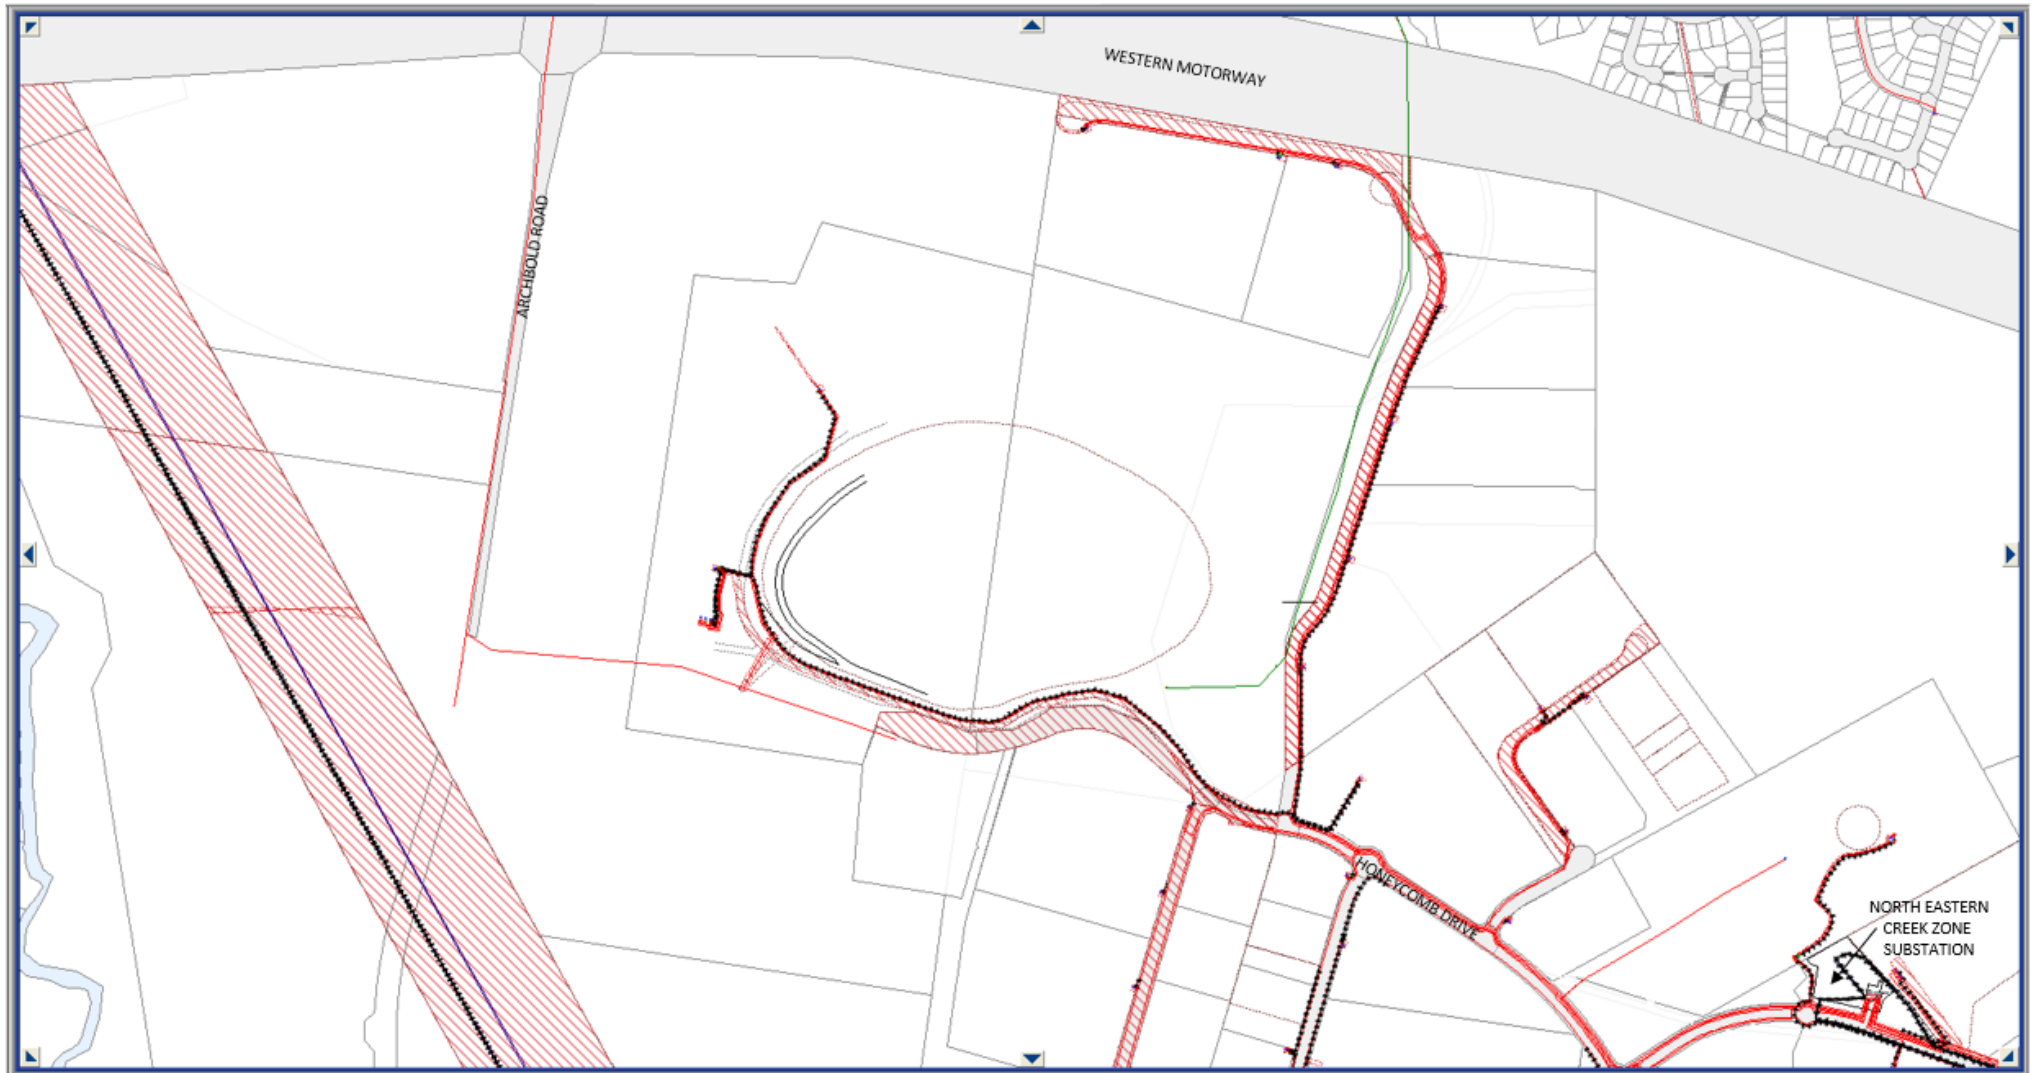

Please note the location, extent and type of any electricity infrastructure, boundaries etc. shown on the plan is indicative only. In addition it must be recognised that the electricity network is constantly extended, augmented and modified and there is a delay from the completion and commissioning of these works until their capture in the model. Easements benefitting Endeavour Energy are indicated by red hatching. Generally (depending on the scale and/or features selected), low voltage (normally not exceeding 1,000 volts) is indicated by blue lines and high voltage (normally exceeding 1,000 volts but for Endeavour Energy's network not exceeding 132,000 volts / 132 kV) by red lines (these lines can appear as solid or dashed and where there are multiple lines / cables only the higher voltage may be shown). This plan only shows the Endeavour Energy network and does not show electricity infrastructure belonging to other authorities or customers owned electrical equipment beyond the customer connection point / point of supply to the property. This plan is not a 'Dial Before You Dig' plan under the of Part 5E 'Protection of underground electricity power lines' of the *Electricity Supply Act 1995* (NSW).

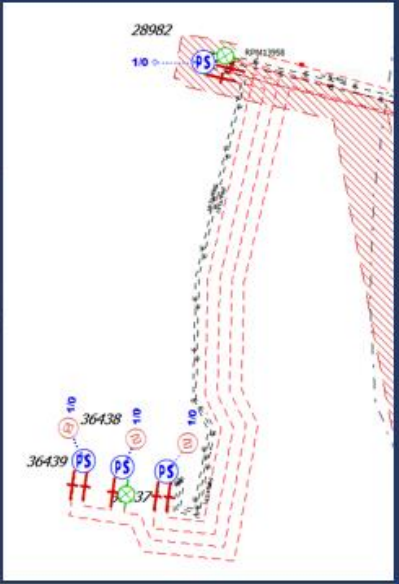

LEGEND	
	Padmount substation
	Indoor substation
	Ground substation
	Kiosk substation
	Cottage substation
	Pole mounted substation
	High voltage customer substation
	Metering unit
	Switch station
	Indoor switch station
	Customer connection point
	Low voltage pillar
	Streetlight column
	Life support customer
	Tower
	Pole
	Pole with streetlight
	Customer owned / private pole
	Cable pit
	Subject site