

Authority	Authority's Reference	Authority Contact	Authority Notification	Submission Due	Submission Made
NSW Planning, Industry & Environment	SSD-29668067	Patrick Copas	7/06/2022	7/07/2022	13/06/2022

Address	Land Title
311 South Street, Marsden Park	Lot 31 DP 262886

**Scope of Development Application or Planning Proposal**

Exhibition of Environmental Impact Statement (EIS) for the South Street Warehousing Estate. Construction and operation of a warehouse and distribution estate, comprising: two warehouses; associated office space; a portion of the north-south Collector Road off South Street; and supporting infrastructure, services and landscaping.

**As shown in the below site plan from Endeavour Energy's G/Net master facility model:**

There are:

- No easements benefitting Endeavour Energy (active easements are indicated by red hatching).
- Low voltage and 11,000 volt / 11 kilovolt (kV) high voltage overhead power lines (including pole mounted substation no. 15704) (which are proposed removed as indicated by the ■ colouring) and 132,000 volt /132 kV high voltage underground cables and underground earth cables and underground pilot cables (carrying protection signals or communications between substations) to the opposite side of South Street.
- The eastern side boundary adjoins a 'Developer Area' over Lot 30 DP 262886 shown by the proposed subdivision / road layout indicating enquiries and applications for contestable works projects with Endeavour Energy's Customer Network Solutions Branch for electricity supply. There are low voltage and 11 kV high voltage underground cables in the 'Developer Road' road verge / roadway which extends onto the site.



Relevant / applicable clause numbers from Endeavour Energy's standard conditions for Development Application and Planning Proposal Review indicated by ☒ .

Condition	Advice	Clause No.	Issue	Detail
<input type="checkbox"/>	<input type="checkbox"/>	1	Adjoining Sites	Adjoining or nearby development / use should be compatible with the use of Endeavour Energy's sites.
<input type="checkbox"/>	<input type="checkbox"/>	2	Asbestos	Area identified or suspected of having asbestos or asbestos containing materials (ACM) present in the electricity network.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	3	Asset Planning	Applicants should not assume adequate supply is immediately available to facilitate their proposed development.
<input type="checkbox"/>	<input type="checkbox"/>	4	Asset Relocation	Application must be made for an asset relocation / removal to determine possible solutions to the developer's requirements.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	5	Bush Fire	Risk needs to be managed to maintain the safety of customers and the communities served by the network.
<input type="checkbox"/>	<input type="checkbox"/>	6	Construction Management	Integrity of electricity infrastructure must be maintained and not impacted by vehicle / plant operation, excessive loads, vibration, dust or moisture penetration.
<input type="checkbox"/>	<input type="checkbox"/>	7	Contamination	Remediation may be required of soils or surfaces impacted by various forms of electricity infrastructure.
<input type="checkbox"/>	<input type="checkbox"/>	8	Demolition	All electricity infrastructure shall be regarded as live and care must be taken to not interfere with any part of the electricity network.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	9	Dial Before You Dig	Before commencing any underground activity the applicant must obtain advice from the Dial Before You Dig 1100 service.
<input type="checkbox"/>	<input type="checkbox"/>	10	Dispensation	If a proposal is not compliant with Endeavour Energy's engineering documents or standards, the applicant must request a dispensation.
<input type="checkbox"/>	<input type="checkbox"/>	11	Driveways	For public / road safety and to reduce the risk of vehicle impact, the distance of driveways from electricity infrastructure should be maximised.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	12	Earthing	The construction of any building or structure connected to or in close proximity to the electrical network must be properly earthed.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	13	Easement Management	Preference is for no activities to occur in easements and they must adhere to minimum safety requirements.
<input type="checkbox"/>	<input type="checkbox"/>	14	Easement Release	No easement is redundant or obsolete until it is released having regard to risks to its network, commercial and community interests.
<input type="checkbox"/>	<input type="checkbox"/>	15	Easement Subdivision	The incorporation of easements into to multiple / privately owned lots is generally not supported.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	16	Emergency Contact	Endeavour Energy's emergency contact number 131 003 should be included in any relevant risk and safety management plan.
<input type="checkbox"/>	<input type="checkbox"/>	17	Excavation	The integrity of the nearby electricity infrastructure shall not be placed at risk by the carrying out of excavation work.
<input type="checkbox"/>	<input type="checkbox"/>	18	Flooding	Electricity infrastructure should not be subject to flood inundation or stormwater runoff.

Condition	Advice	Clause No.	Issue	Detail
<input type="checkbox"/>	<input type="checkbox"/>	19	Hazardous Environment	Electricity infrastructure can be susceptible to hazard sources or in some situations be regarded as a hazardous source.
<input type="checkbox"/>	<input type="checkbox"/>	20	Modifications	Amendments can impact on electricity load and the contestable works required to facilitate the proposed development.
<input type="checkbox"/>	<input type="checkbox"/>	21	Network Access	Access to the electricity infrastructure may be required at any time particularly in the event of an emergency.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	22	Network Asset Design	Design electricity infrastructure for safety and environmental compliance consistent with safe design lifecycle principles.
<input checked="" type="checkbox"/>	<input type="checkbox"/>	23	Network Connection	Applicants will need to submit an appropriate application based on the maximum demand for electricity for connection of load.
<input type="checkbox"/>	<input type="checkbox"/>	24	Protected Works	Electricity infrastructure without an easement is deemed to be lawful for all purposes under Section 53 'Protection of certain electricity works' of the <i>Electricity Supply Act 1995 (NSW)</i> .
<input type="checkbox"/>	<input checked="" type="checkbox"/>	25	Prudent Avoidance	Development should avert the possible risk to health from exposure to emissions from electricity infrastructure such as electric and magnetic fields (EMF) and noise.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	26	Public Safety	Public safety training resources are available to help general public / workers understand the risk and how to work safely near electricity infrastructure.
<input type="checkbox"/>	<input type="checkbox"/>	27	Removal of Electricity	Permission is required to remove service / metering and must be performed by an Accredited Service Provider.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	28	Safety Clearances	Any building or structure must comply with the minimum safe distances / clearances for the applicable voltage/s of the overhead power lines.
<input type="checkbox"/>	<input type="checkbox"/>	29	Security / Climb Points	Minimum buffers appropriate to the electricity infrastructure being protected need to be provided to avoid the creation of climb points.
<input type="checkbox"/>	<input type="checkbox"/>	30	Service Conductors	Low voltage service conductors and customer connection points must comply with the 'Service and Installation Rules of NSW'.
<input type="checkbox"/>	<input type="checkbox"/>	31	Solar / Generation	Need to assess the performance of the generation system and its effects on the network and other connected customers.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	32	Streetlighting	Streetlighting should be reviewed and if necessary upgraded to suit any increase in both vehicular and pedestrian traffic.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	33	Sustainability	Reducing greenhouse gas emissions and helping customers save on their energy consumption and costs through new initiatives and projects to adopt sustainable energy technologies.
<input type="checkbox"/>	<input type="checkbox"/>	34	Swimming Pools	Whenever water and electricity are in close proximity, extra care and awareness is required.
<input type="checkbox"/>	<input type="checkbox"/>	35	Telecommunications	Address the risks associated with poor communications services to support the vital electricity supply network Infrastructure.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	36	Vegetation Management	Landscaping that interferes with electricity infrastructure is a potential safety risk and may result in the interruption of supply.

Condition	Advice	Clause No.	Issue	Detail
			Other	


<b>Endeavour Energy</b>	
<b>Completed by:</b>	<b>Decision</b>
Cornelis Duba	Approve (with conditions)
<b>Reason(s) for Conditions / Objection (If applicable)</b>	

- The Utility Service Assessment includes the following advice regarding whether the available electricity services are adequate for the proposed development.

**4.0 ELECTRICITY**

- Substantial Endeavour Energy electrical distribution system exists in South Street. Existing 132kv feeder cables exist in a conduit bank with the South Street corridor.
- A recent certified electrical design under URS18742 has recently been issued by Endeavour Energy for the residential development on the northern side of South Street, opposite the subject site. Conduit crossings across South Street are to be installed.
- The developer of the adjoining development to the east of the subject site has installed a conduit bank in Duckworth Street together with low voltage reticulation. These conduit banks would be available to install any 11kv feeders that would be required to service the site.
- Appendix B of this report estimates a demand of 1MVA for the proposed development. A padmount substation will be required to provide service to the proposed development.
- Substantial feeder network exists in the area to adequately cater for the proposed electrical demand for the site.

- The applicant will need to complete the application for connection of load process with Endeavour Energy's Customer Network Solutions Branch who are responsible for managing the conditions of supply with the proponent and their Accredited Service Provider (ASP).
- The Architectural Drawings show provision for a substation to the north eastern road frontage.

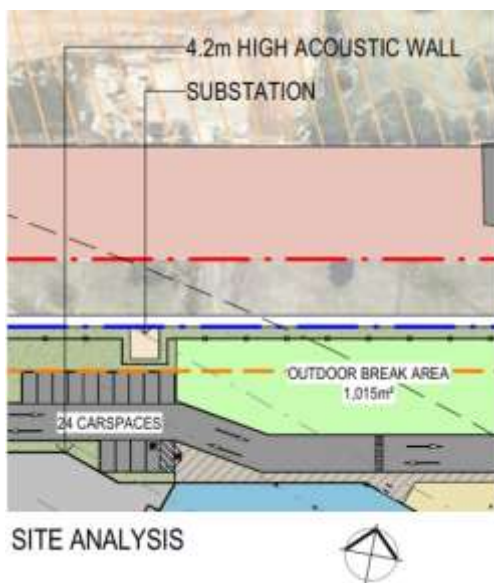

- Any required padmount substation/s will need to be located within the property (in a suitable and accessible location) and be protected (including any associated cabling) by an easement and associated restrictions benefiting and gifted to Endeavour Energy. Please refer to Endeavour Energy's Mains Design Instruction MDI 0044 'Easements and Property Tenure Rights'.

- Generally it is the Level 3 Accredited Service Provider's (ASP) responsibility (engaged by the developer) to make sure substation location and design complies with Endeavour Energy's standards the suitability of access, safety clearances, fire ratings, flooding etc.
- The planting of large / deep rooted trees to near electricity infrastructure is opposed by Endeavour Energy. Existing trees which are of low ecological significance in proximity of electricity infrastructure should be removed and if necessary replaced by an alternative smaller planting. The landscape designer will need to ensure any planting near electricity infrastructure achieves Endeavour Energy's vegetation management requirements.
- Screening vegetation around a padmount substation should be planted a minimum distance of 800mm plus half of the mature canopy width from the substation easement and have shallow / non-invasive roots. This is to avoid trees growing over the easement as falling branches may damage the cubicle and tree roots the underground cables. All vegetation is to be maintained in such a manner that it will allow unrestricted access by electrical workers to the substation easement all times.
- Not all the conditions / advice marked may be directly or immediately relevant or significant to the Development Application. However, Endeavour Energy's preference is to alert proponents / applicants of the potential matters that may arise should development within closer proximity of the existing and / or required electricity infrastructure needed to facilitate the proposed development on or in the vicinity of the site occur.

Yours faithfully

Cornelis Duba

Development Application Specialist

Sustainability & Environment

M: 0455 250 981


E: [cornelis.duba@endeavourenergy.com.au](mailto:cornelis.duba@endeavourenergy.com.au)

51 Huntingwood Drive, Huntingwood NSW 2148

[www.endeavourenergy.com.au](http://www.endeavourenergy.com.au)




## Site Plan from Endeavour Energy's G/Net Master Facility Model

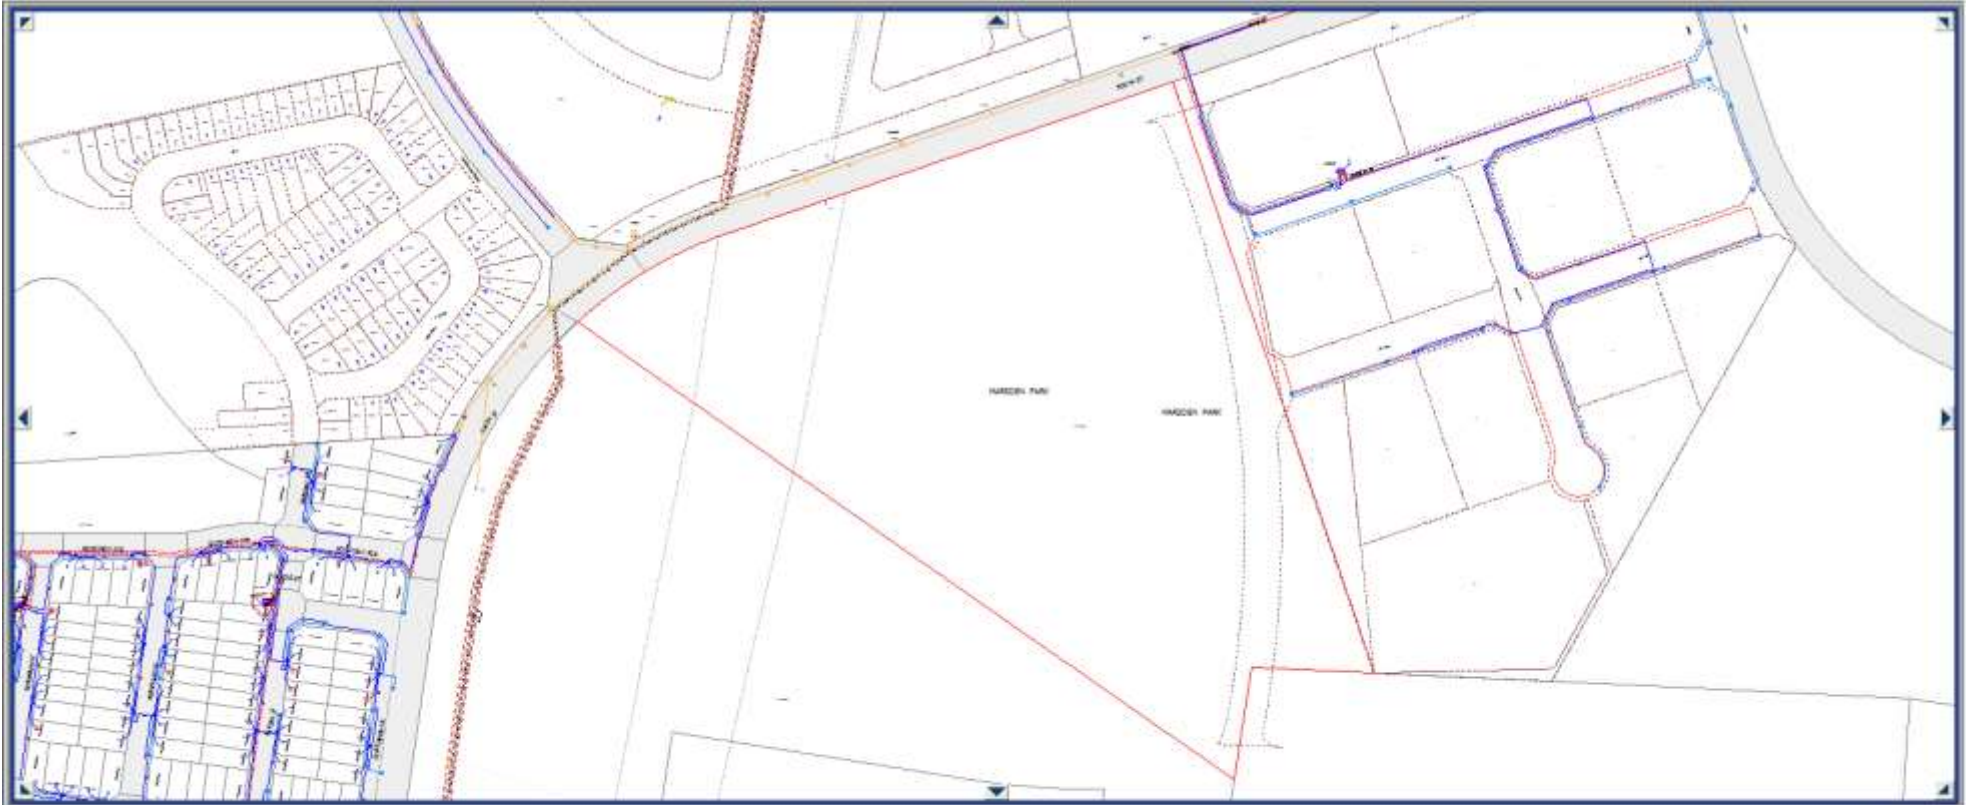







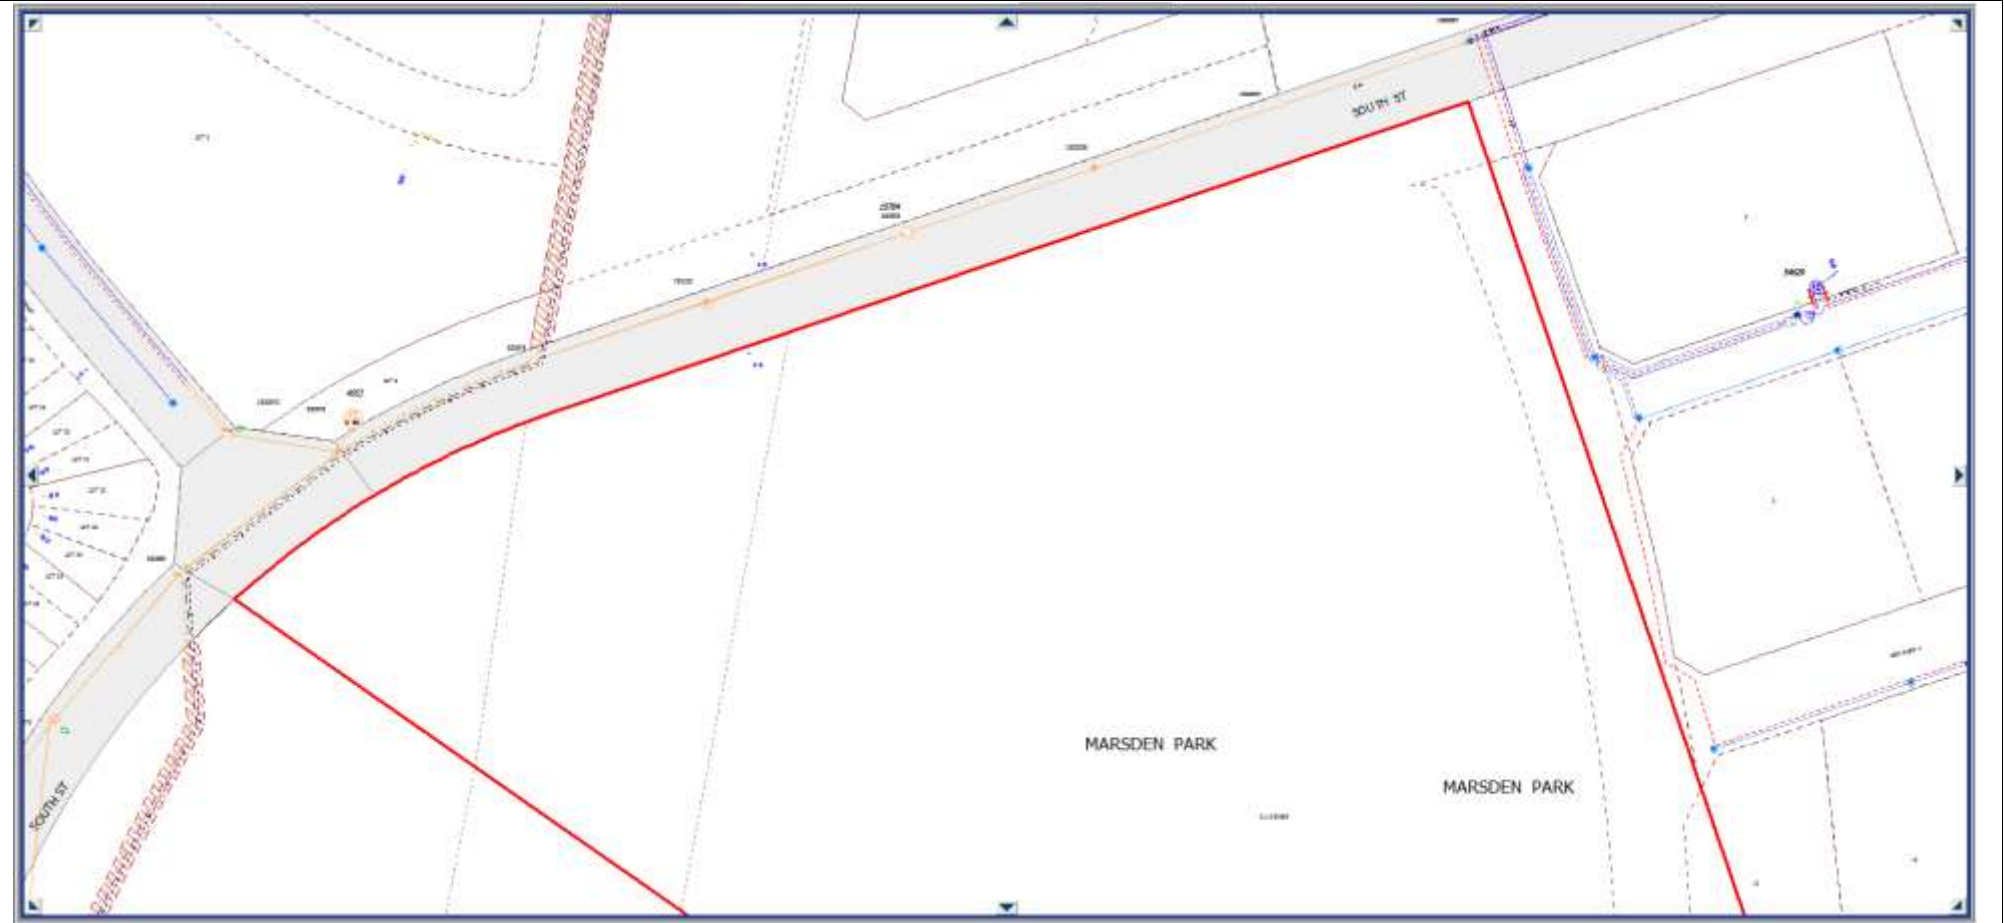













G3E_FID	Feature Name	Component Name	G3E_CID	G3E_ID	LOT	SECTION	DP
80726220	Crown Parcel	Crown Parcel Find	1	2253125	31		262886

Please note the location, extent and type of any electricity infrastructure, boundaries etc. shown on the plan is indicative only. In addition it must be recognised that the electricity network is constantly extended, augmented and modified and there is a delay from the completion and commissioning of these works until their capture in the model. Easements benefitting Endeavour Energy are indicated by red hatching. Generally (depending on the scale and/or features selected), low voltage (normally not exceeding 1,000 volts) is indicated by blue lines and high voltage (normally exceeding 1,000 volts but for Endeavour Energy's network not exceeding 132,000 volts / 132 kV) by red lines (these lines can appear as solid or dashed and where there are multiple lines / cables only the higher voltage may be shown). This plan only shows the Endeavour Energy network and does not show electricity infrastructure belonging to other authorities or customer owned electrical equipment beyond the customer connection point / point of supply to the property. This plan is not a 'Dial Before You Dig' plan under the of Part 5E 'Protection of underground electricity power lines' of the *Electricity Supply Act 1995* (NSW).

Site Plan from Endeavour Energy's G/Net Master Facility Model



LEGEND	
	Padmount substation
	Indoor substation
	Ground substation
	Kiosk substation
	Cottage substation
	Pole mounted substation
	High voltage customer substation
	Metering unit
	Switch station
	Indoor switch station
	Customer connection point
	Low voltage pillar
	Streetlight column
	Life support customer
	Tower
	Pole
	Pole with streetlight
	Customer owned / private pole
	Cable pit
	Subject site



# Google Maps Street View

