

Development Application and Planning Proposal Review

NSW Planning Portal Concurrence and Referral



Authority	Authority's Reference	Agency Concurrence and Referral	Authority Contact	Authority Notification	Submission Due	Submission Made
Parramatta City Council	DA/1137/2021	CNR-32997	Alex McDougall	14/12/2021	4/01/2022	16/12/2021

Address	Land Title
12 HASSALL STREET PARRAMATTA 2150	Lot 156 DP 1240854

Scope of Development Application or Planning Proposal

The erection of a 61-storey mixed-use building, containing a four (4) storey podium with tower above, comprising of 6 levels of basement car parking containing 216 vehicles, Ground level – retail tenancies, café, gym, residential lobby, commercial lobby, basement carpark entry and pedestrian thoroughfare, Level 1 – gym, retail uses and plant and services, Level 2 and 3 commercial uses, Levels - 4 to 61 containing a community room, 328 residential apartments and rooftop communal open space.

As shown in the below site plan from Endeavour Energy's G/Net master facility model:

There are:

- No easements benefitting Endeavour Energy (active easements are indicated by red hatching).
- Northern / rear boundary adjoins and easement for 11,000 volt / 11 kilovolt (kV) high voltage underground cables and indoor substation no. 22200 located on Lot 100 DP 1055253.
- Low voltage and 11 kV high voltage underground cables to the road verge / roadway including a low voltage pillar from which there is a low voltage underground cables going to an underground to overhead customer owned / private pole on the site from which there are two low voltage overhead service conductors going to the customer connection points for the existing buildings on the site.

Relevant / applicable clause numbers from Endeavour Energy's standard conditions for Development Application and Planning Proposal Review indicated by ☒ .

Condition	Advice	Clause No.	Issue	Detail
<input type="checkbox"/>	<input type="checkbox"/>	1	Adjoining Sites	Adjoining or nearby development / use should be compatible with the use of Endeavour Energy's sites.
<input type="checkbox"/>	<input type="checkbox"/>	2	Asbestos	Area identified or suspected of having asbestos or asbestos containing materials (ACM) present in the electricity network.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	3	Asset Planning	Applicants should not assume adequate supply is immediately available to facilitate their proposed development.
<input type="checkbox"/>	<input type="checkbox"/>	4	Asset Relocation	Application must be made for an asset relocation / removal to determine possible solutions to the developer's requirements.
<input type="checkbox"/>	<input type="checkbox"/>	5	Bushfire	Risk needs to be managed to maintain the safety of customers and the communities served by the network.
<input checked="" type="checkbox"/>	<input type="checkbox"/>	6	Construction Management	Integrity of electricity infrastructure must be maintained and not impacted by vehicle / plant operation, excessive loads, vibration, dust or moisture penetration.
<input type="checkbox"/>	<input type="checkbox"/>	7	Contamination	Remediation may be required of soils or surfaces impacted by various forms of electricity infrastructure.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	8	Demolition	All electricity infrastructure shall be regarded as live and care must be taken to not interfere with any part of the electricity network.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	9	Dial Before You Dig	Before commencing any underground activity the applicant must obtain advice from the Dial Before You Dig 1100 service.
<input type="checkbox"/>	<input type="checkbox"/>	10	Dispensation	If a proposal is not compliant with Endeavour Energy's engineering documents or standards, the applicant must request a dispensation.
<input type="checkbox"/>	<input type="checkbox"/>	11	Driveways	For public / road safety and to reduce the risk of vehicle impact, the distance of driveways from electricity infrastructure should be maximised.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	12	Earthing	The construction of any building or structure connected to or in close proximity to the electrical network must be properly earthed.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	13	Easement Management	Preference is for no activities to occur in easements and they must adhere to minimum safety requirements.
<input type="checkbox"/>	<input type="checkbox"/>	14	Easement Release	No easement is redundant or obsolete until it is released having regard to risks to its network, commercial and community interests.
<input type="checkbox"/>	<input type="checkbox"/>	15	Easement Subdivision	The incorporation of easements into multiple / privately owned lots is generally not supported.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	16	Emergency Contact	Endeavour Energy's emergency contact number 131 003 should be included in any relevant risk and safety management plan.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	17	Excavation	The integrity of the nearby electricity infrastructure shall not be placed at risk by the carrying out of excavation work.
<input type="checkbox"/>	<input type="checkbox"/>	18	Flooding	Electricity infrastructure should not be subject to flood inundation or stormwater runoff.

Condition	Advice	Clause No.	Issue	Detail
<input type="checkbox"/>	<input type="checkbox"/>	19	Hazardous Environment	Electricity infrastructure can be susceptible to hazard sources or in some situations be regarded as a hazardous source.
<input checked="" type="checkbox"/>	<input type="checkbox"/>	20	Modifications	Amendments can impact on electricity load and the contestable works required to facilitate the proposed development.
<input type="checkbox"/>	<input type="checkbox"/>	21	Network Access	Access to the electricity infrastructure may be required at any time particularly in the event of an emergency.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	22	Network Asset Design	Design electricity infrastructure for safety and environmental compliance consistent with safe design lifecycle principles.
<input checked="" type="checkbox"/>	<input type="checkbox"/>	23	Network Connection	Applicants will need to submit an appropriate application based on the maximum demand for electricity for connection of load.
<input type="checkbox"/>	<input type="checkbox"/>	24	Protected Works	Electricity infrastructure without an easement is deemed to be lawful for all purposes under Section 53 'Protection of certain electricity works' of the <i>Electricity Supply Act 1995</i> (NSW).
<input type="checkbox"/>	<input checked="" type="checkbox"/>	25	Prudent Avoidance	Development should avert the possible risk to health from exposure to emissions from electricity infrastructure such as electric and magnetic fields (EMF) and noise.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	26	Public Safety	Public safety training resources are available to help general public / workers understand the risk and how to work safely near electricity infrastructure.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	27	Removal of Electricity	Permission is required to remove service / metering and must be performed by an Accredited Service Provider.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	28	Safety Clearances	Any building or structure must comply with the minimum safe distances / clearances for the applicable voltage/s of the overhead power lines.
<input type="checkbox"/>	<input type="checkbox"/>	29	Security / Climb Points	Minimum buffers need to be provided to avoid the creation of climb point appropriate to the electricity infrastructure being protected.
<input type="checkbox"/>	<input type="checkbox"/>	30	Service Conductors	Low voltage service conductors and customer connection points must comply with the 'Service and Installation Rules of NSW'
<input type="checkbox"/>	<input checked="" type="checkbox"/>	31	Solar / Generation	Need to assess the performance of the generation system and its effects on the network and other connected customers.
<input type="checkbox"/>	<input type="checkbox"/>	32	Streetlighting	Streetlighting should be reviewed and if necessary upgraded to suit any increase in both vehicular and pedestrian traffic.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	33	Sustainability	Reducing greenhouse gas emissions and helping customers save on their energy consumption and costs through new initiatives and projects to adopt sustainable energy technologies.
<input type="checkbox"/>	<input type="checkbox"/>	34	Swimming Pools	Whenever water and electricity are in close proximity, extra care and awareness is required.
<input type="checkbox"/>	<input type="checkbox"/>	35	Telecommunications	Address the risks associated with poor communications services to support the vital electricity supply network Infrastructure.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	36	Vegetation Management	Landscaping that interferes with electricity infrastructure is a potential safety risk and result in the interruption of supply.

Con- dition	Advice	Clause No.	Issue	Detail
			Other	

Endeavour Energy	
Completed by:	Decision
Cornelis Duba	Approve (with conditions)
Reason(s) for Conditions / Objection (If applicable)	
<ul style="list-style-type: none"> The Development Application is supported by Connection of Load Application (Endeavour Energy Reference UML10072) dated 29 November 2021 providing the Design Brief for the method of supply requirements. The applicant will need to continue to complete the Connection of Load Application process with Endeavour Energy's Customer Network Solutions Branch who are responsible for managing the conditions of supply with the proponent and their Accredited Service Provider (ASP). The Architectural Plans shows the provision of an indoor substation. The substation will need to be located within the property (in a suitable and accessible location) and be protected (including any associated cabling) by an easement and associated restrictions benefiting and gifted to Endeavour Energy. Please refer to Endeavour Energy's Mains Design Instruction MDI 0044 'Easements and Property Tenure Rights'. Generally it is the Level 3 Accredited Service Provider's (ASP) responsibility (engaged by the developer) to make sure that the substation location and design complies with Endeavour Energy's standards the suitability of access, safety clearances, fire ratings, flooding etc. As a condition of the Development Application consent Council should request the submission of documentary evidence from Endeavour Energy confirming that satisfactory arrangements have been made for the connection of electricity and the design requirements for the substation, prior to the release of the Construction or Subdivision Certificate / commencement of works. Endeavour Energy is urging applicants /customers to engage with an Electrical Consultant / Accredited Service Provider (ASP) prior to finalising plans to in order to assess and incorporate any required electricity infrastructure. In so doing the consideration can also be given to its impact on the other aspects of the proposed development. This can assist in avoiding the making of amendments to the plan or possibly the need to later seek modification of an approved development application. Not all the conditions / advice marked may be directly or immediately relevant or significant to the Development Application. However, Endeavour Energy's preference is to alert proponents / applicants of the potential matters that may arise should development within closer proximity of the existing and/or required electricity infrastructure needed to facilitate the proposed development on or in the vicinity of the site occur. Please also refer to Endeavour Energy's previous submission made to Council via email on 5 August 2020 regarding the public exhibition of Planning Proposal RZ/15/2016 to amend the Parramatta Local Environmental Plan 2011 (PLEP2011) to accommodate a mixed-use development of approximately 328 units and minimum 2,055sqm commercial floor space at 12 Hassall Street Parramatta. 	

Yours faithfully

Cornelis Duba

Development Application Specialist

Sustainability & Environment

M: 0455 250 981


E: cornelis.duba@endeavourenergy.com.au

51 Huntingwood Drive, Huntingwood NSW 2148

www.endeavourenergy.com.au





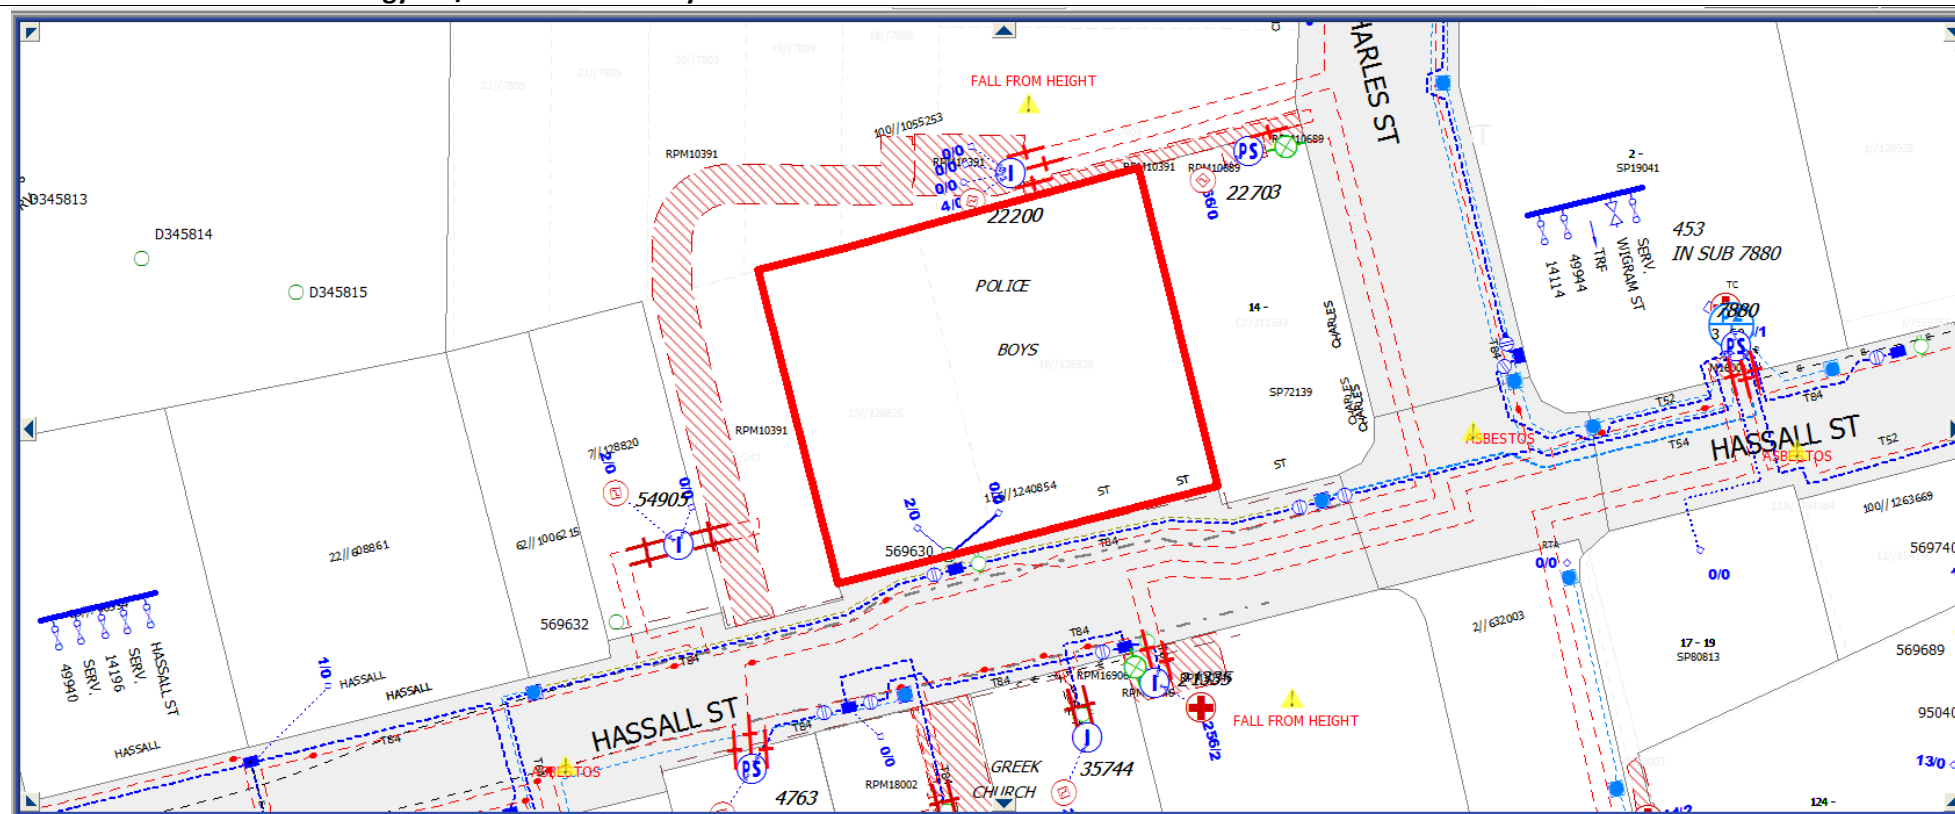

















Site Plan from Endeavour Energy's G/Net Master Facility Model




G3E_FID	Feature Name	Component Name	G3E_CID	G3E_ID	LOT	SECTION	DP
81072257	Crown Parcel	Crown Parcel Find	1	2285661	156		1240854

Please note the location, extent and type of any electricity infrastructure, boundaries etc. shown on the plan is indicative only. In addition it must be recognised that the electricity network is constantly extended, augmented and modified and there is a delay from the completion and commissioning of these works until their capture in the model. Easements benefitting Endeavour Energy are indicated by red hatching. Generally (depending on the scale and/or features selected), low voltage (normally not exceeding 1,000 volts) is indicated by blue lines and high voltage (normally exceeding 1,000 volts but for Endeavour Energy's network not exceeding 132,000 volts / 132 kV) by red lines (these lines can appear as solid or dashed and where there are multiple lines / cables only the higher voltage may be shown). This plan only shows the Endeavour Energy network and does not show electricity infrastructure belonging to other authorities or customers owned electrical equipment beyond the customer connection point / point of supply to the property. This plan is not a 'Dial Before You Dig' plan under the of Part 5E 'Protection of underground electricity power lines' of the *Electricity Supply Act 1995* (NSW).

LEGEND	
	Padmount substation
	Indoor substation
	Ground substation
	Kiosk substation
	Cottage substation
	Pole mounted substation
	High voltage customer substation
	Metering unit
	Switch station
	Indoor switch station
	Customer connection point
	Low voltage pillar
	Streetlight column
	Life support customer
	Tower
	Pole
	Pole with streetlight
	Customer owned / private pole
	Cable pit
	Subject site


Google Maps Street View

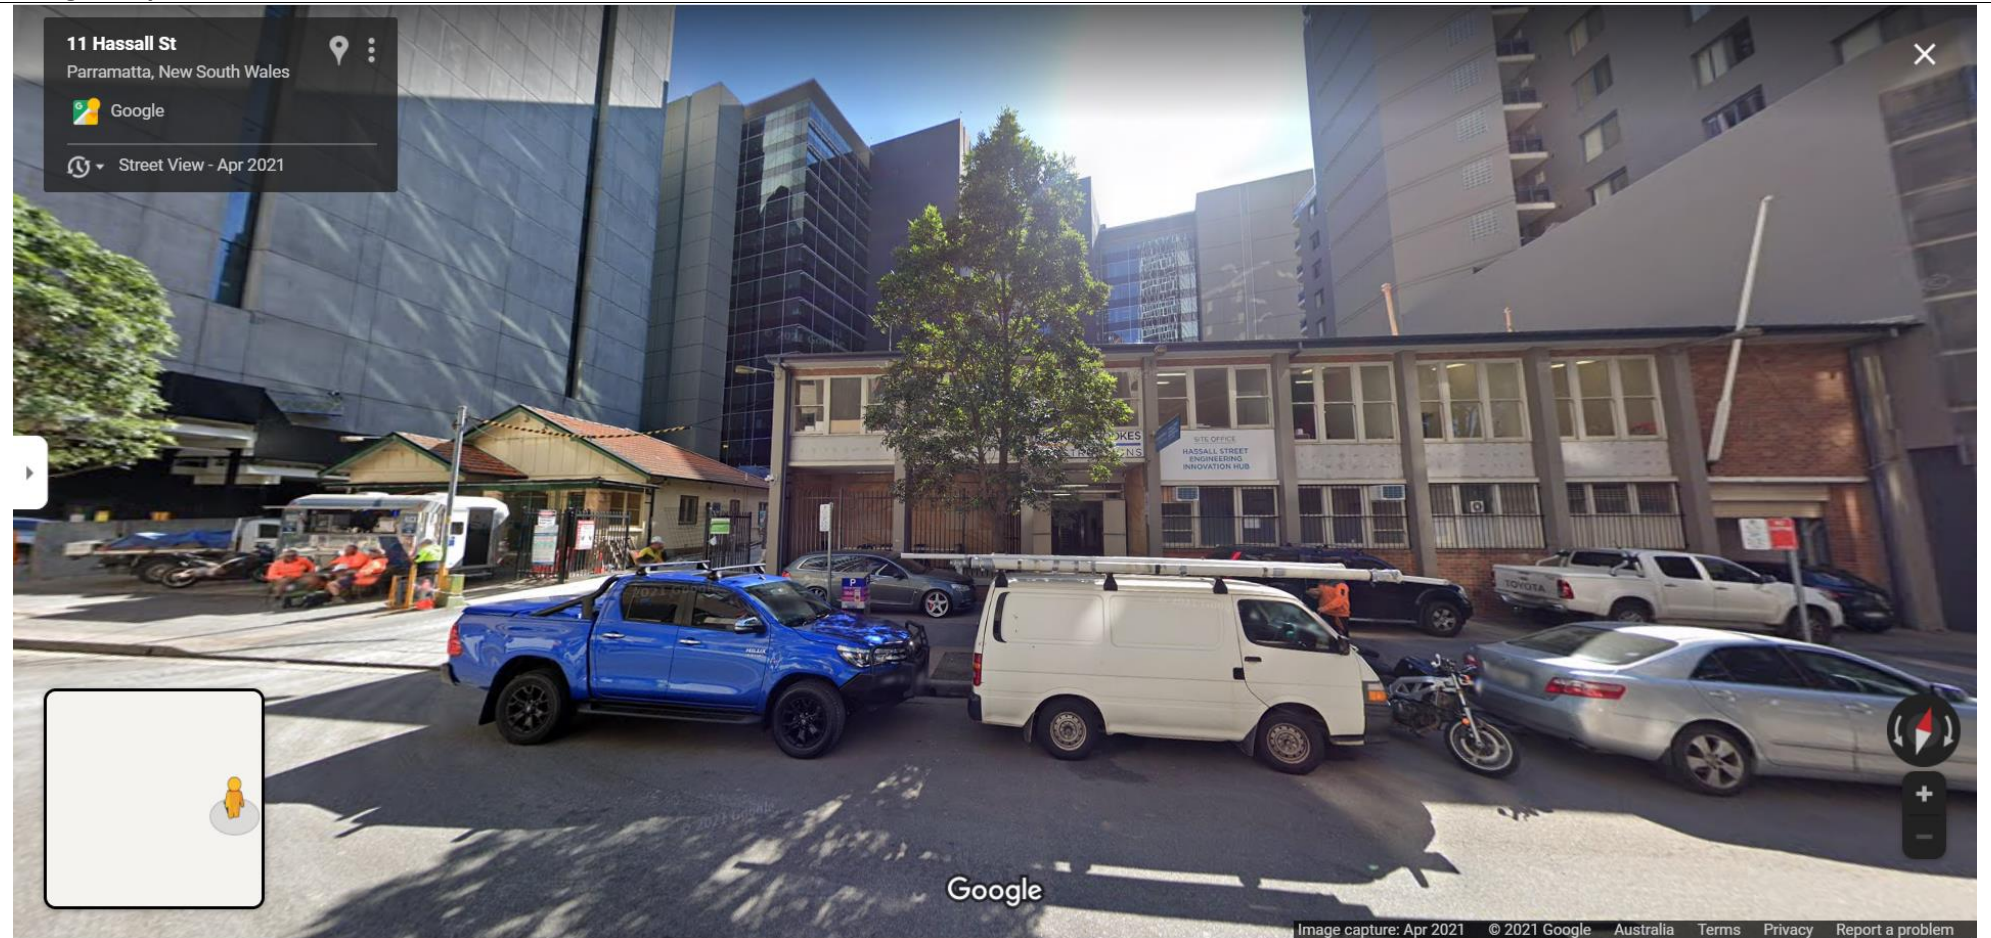

Google Maps Street View



Extracts of Architectural Plans. Provision has been made for an indoor substation.

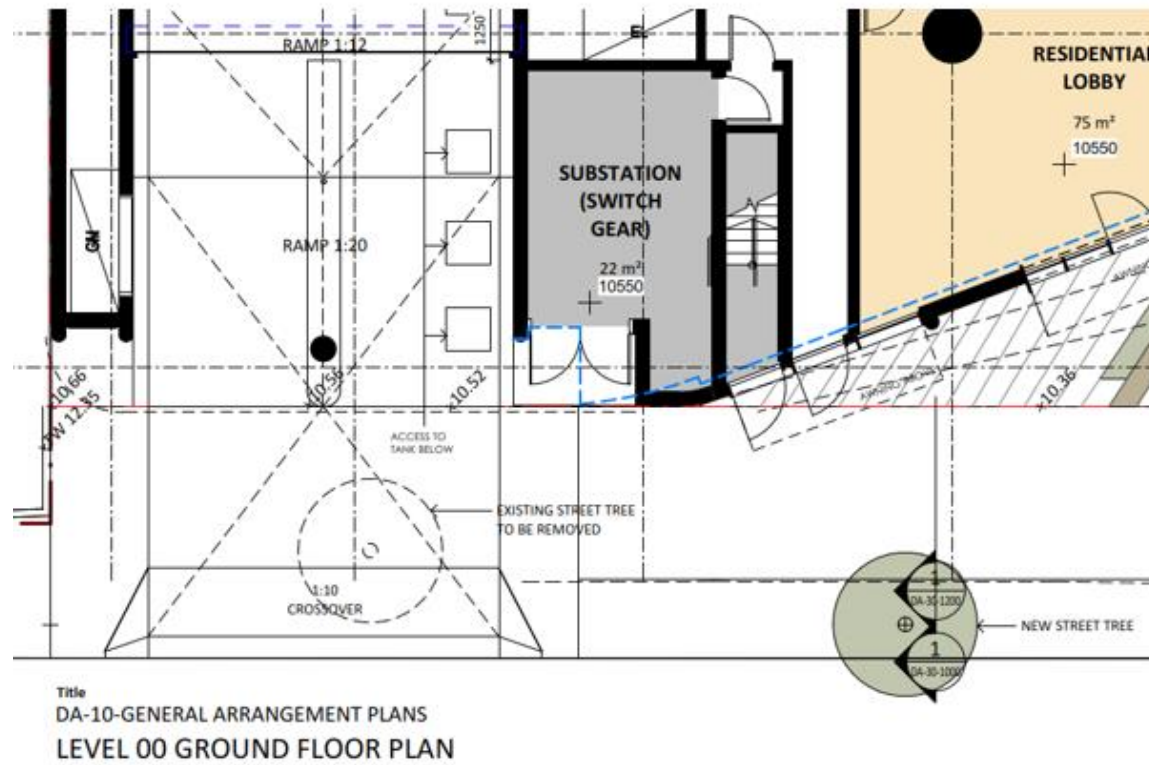

② **PODIUM ELEVATION - SOUTH (HASSALL ST)**
1 : 100 @A1