

6 September 2024

The Secretary
NSW Department of Planning, Housing and Infrastructure

Attention: Thomas Bertwistle

SSD-7500-Mod-6 Minto Logistics Layout Changes

Dear Sir or Madam

I refer to the Department's email of 4 September 2024 regarding State Significant Development SSD-7500-Mod-6 Minto Logistics Layout Changes for 'Changes to the approved Stage 4 warehouse building to split into three different buildings' at 5 & 9 Culverston Road Minto 2566 (Lot 53 DP 1229736, Lot 400 DP 875711) in the Campbelltown City Council local government area (LGA). Submissions need to be made to the Department by 19 September 2024.

Please refer to the attached copy of Endeavour Energy's submission made to the Department on 1 August 2016 for SSD 7500. Notwithstanding the proposed amendments the recommendations and comments provided therein essentially remain applicable.

Please find attached for the applicant's reference copies of Endeavour Energy's:

- Land Interest Guidelines for Network Connection Works, Version 5, December 2022.
- Standard Conditions for Development Applications and Planning Proposals, Version 9, August 2023 which provides some additional and updated information.

For further advice the applicant can call Endeavour Energy via Head Office enquiries on business days from 9am - 4:30pm on telephone: 133 718 and the following contacts:

- Customer Network Solutions Branch for matters related to the electricity supply or asset removal / relocation who are responsible for managing the conditions of supply with the applicant and their Accredited Service Provider (ASP). Alternatively contact can be made by email CWAdmin@endeavourenergy.com.au.

The applicant will need to contact Endeavour Energy's Customer Network Solutions Branch if this Development Application:

- Includes any contestable works projects that are outside of any existing approved / certified works.
- Results in an electricity load that is outside of any existing Supply / Connection Offer requiring the incorporation of the additional load for consideration.

- Easements Officers for matters related to easement management, protected works or other forms of property tenure / interests. Alternatively contact can be made by email Easements@endeavourenergy.com.au .

All encroachments, activities and / or works (including subdivision and even if not part of the Development Application) whether temporary or permanent within or affecting an easement, restriction, right of access or protected works (other than those approved / certified by Endeavour Energy's Customer Network Solutions Branch as part of an enquiry / application for load or asset relocation project) need to be referred to Endeavour Energy's Easements Officers for assessment and possible approval if they meet the minimum safety requirements and controls. However please note that this does not constitute or imply the granting of approval by Endeavour Energy to any or all of the proposed encroachments and / or activities.

For further information please refer to the attached copies of Endeavour Energy's:

- General Restrictions for Overhead Power Lines.
 - General Restrictions for Underground Cables.
 - Guide to Fencing, Retaining Walls and Maintenance Around Padmount Substations.
 - Mains Design Instruction MDI 0044 'Easements and Property Tenure Rights' Amendment 1 March 2017. which deals with activities / encroachments within easements.
- Property Branch for matters related to property tenure. Alternatively contact can be made by email network_property@endeavourenergy.com.au (underscore between 'network' and 'property').
- Field Operations Branch for safety advice for building or working near electrical assets in public areas. The site is in the area covered by Narellan Field Service Centre. Alternatively contact can be made by email Construction.Works@endeavourenergy.com.au .

Subject to and based on the foregoing Endeavour Energy has no objection to the Development Application. Should you wish to discuss this matter, or have any questions, please do not hesitate to contact me or the contacts identified above in relation to the various matters. Due to the high number of development application / planning proposal notifications submitted to Endeavour Energy, to ensure a response contact by email to Property.Development@endeavourenergy.com.au is preferred.

Yours faithfully

Cornelis Duba | Development Application Specialist

M 0455250981

E cornelis.duba@endeavourenergy.com.au

Level 40-42, 8 Parramatta Square, 10 Darcy Street
Parramatta NSW 2150.

Dharug/Wiradjuri/Dharawal/Gundungurra/Yuin Country

endeavourenergy.com.au |    



**Endeavour
Energy**

**POWER
together**




Endeavour Energy respectfully acknowledges the Traditional Custodians on whose lands we live, work, and operate and their Elders past and present.

Site Plan from Endeavour Energy's G/Net Master Facility Model








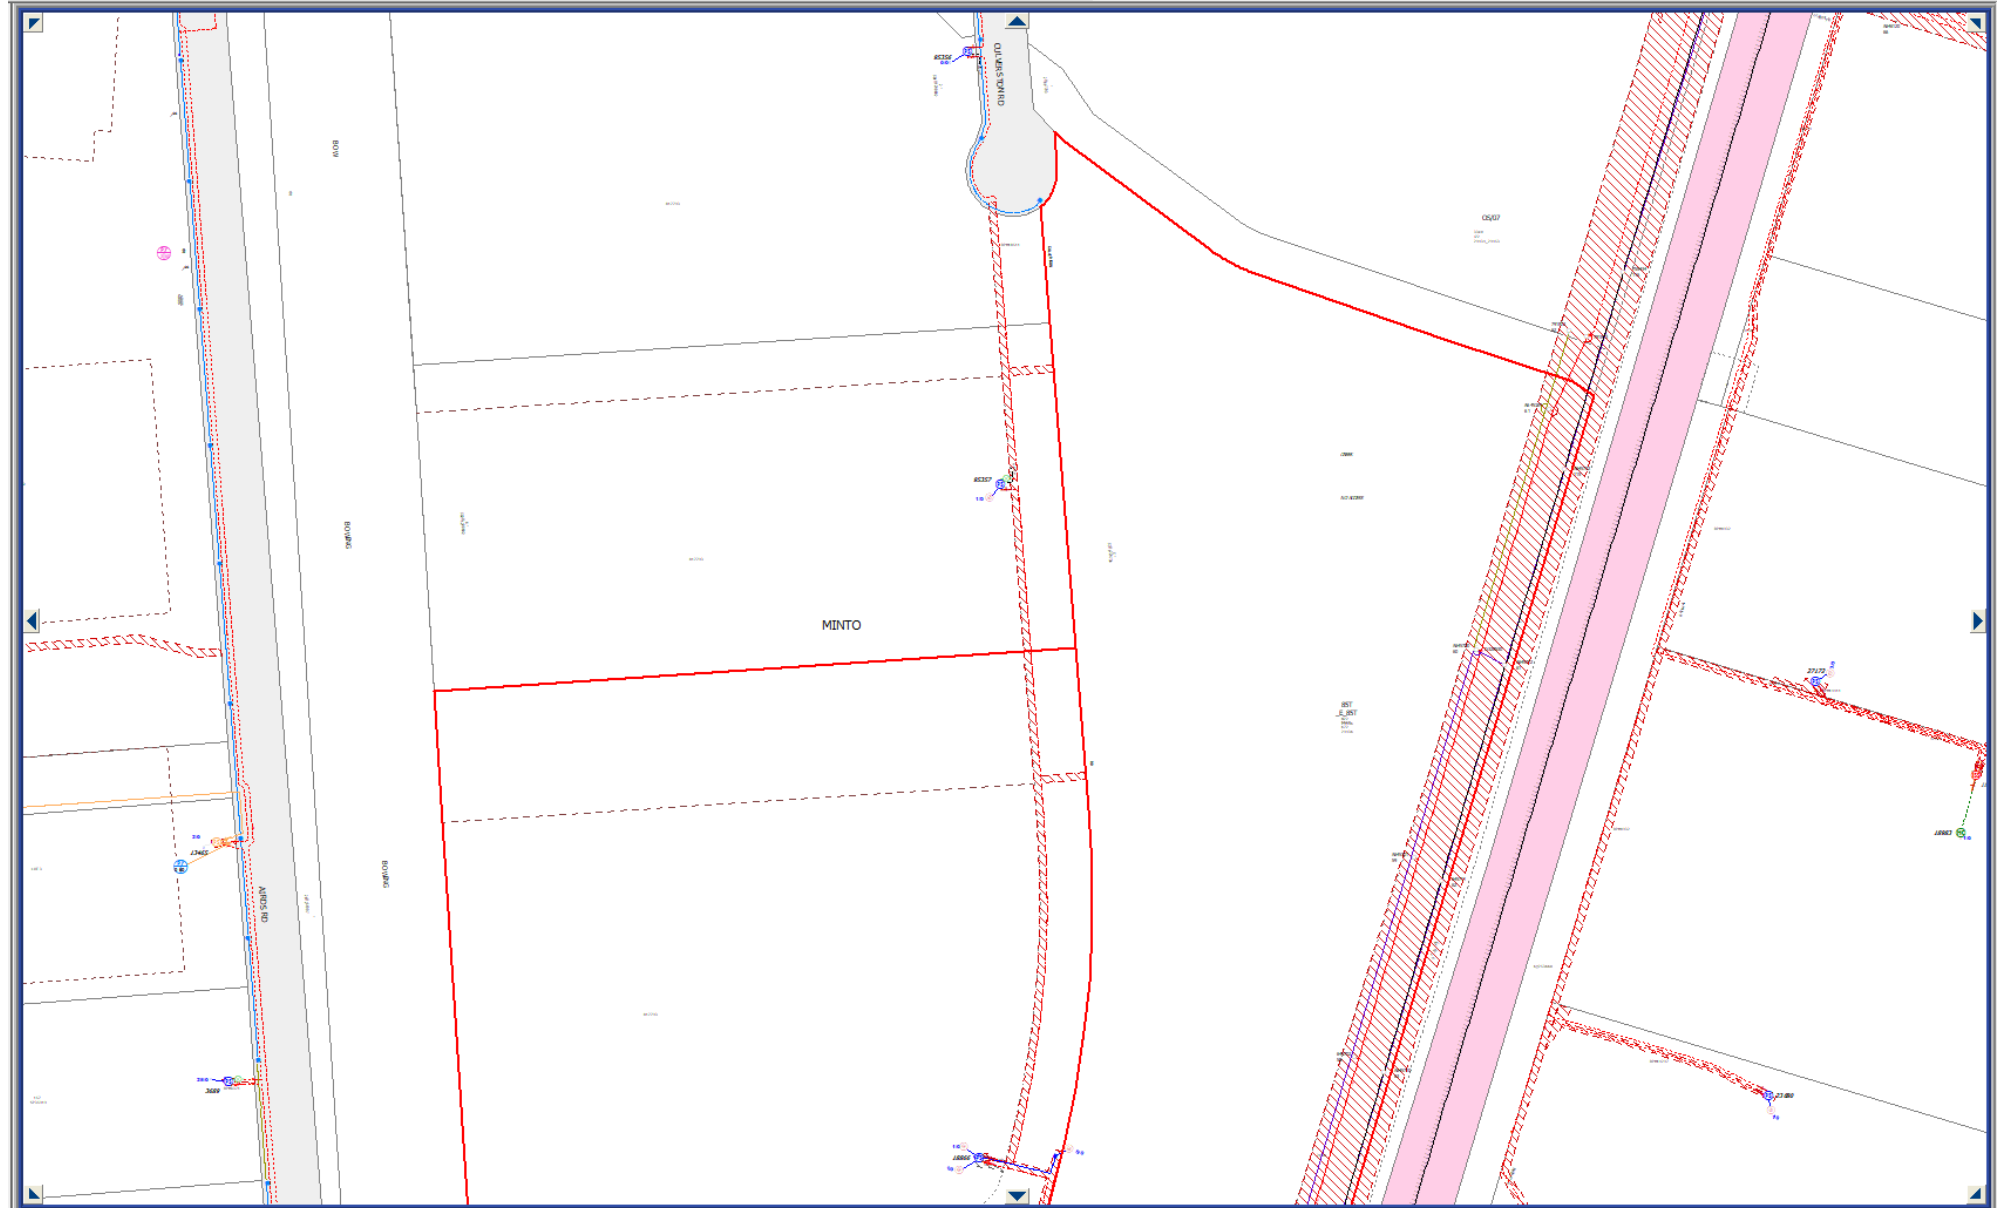



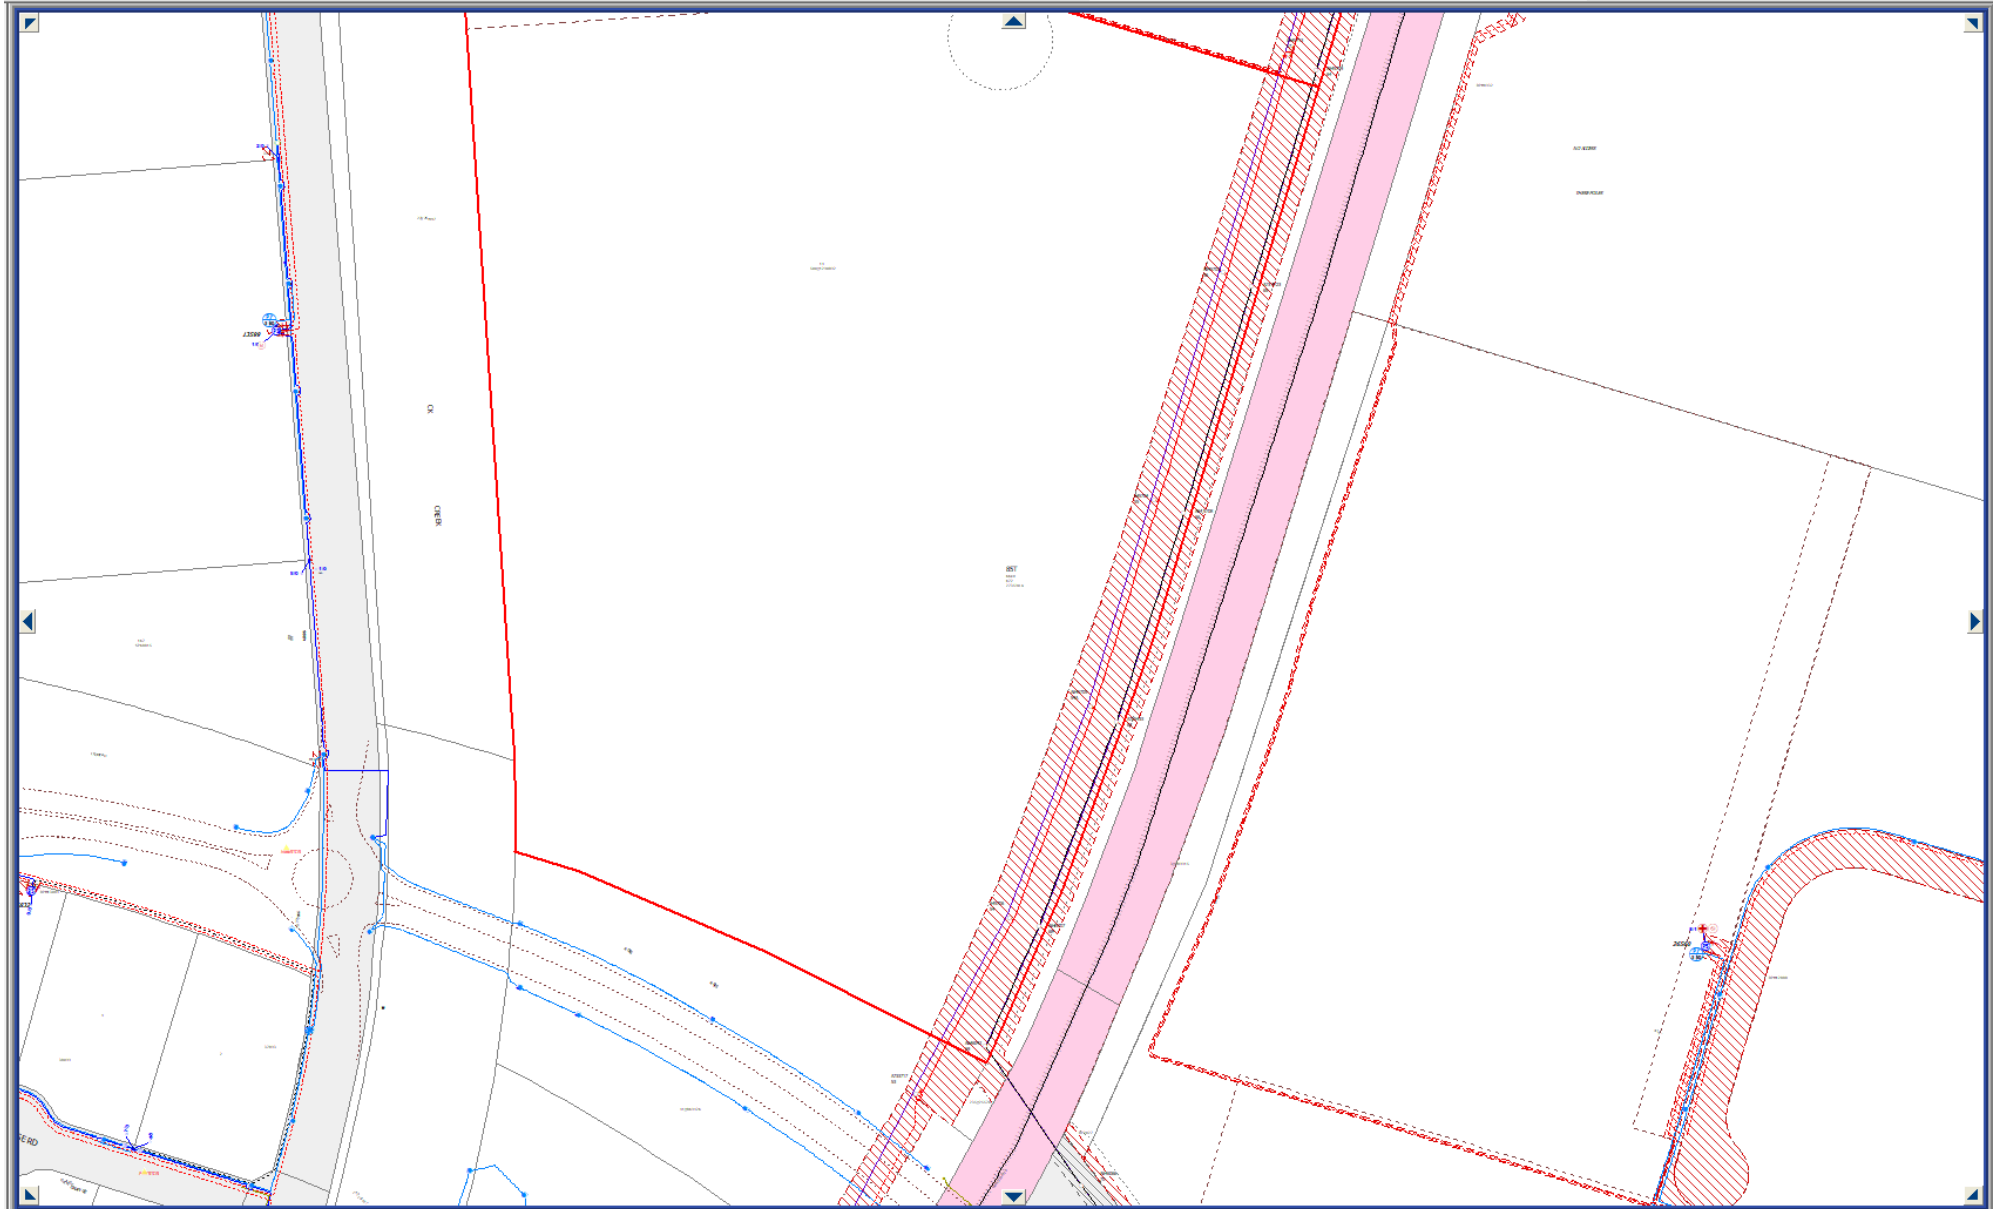
















Please note the location, extent and type of any electricity infrastructure, boundaries etc. shown on the plan is indicative only. In addition it must be recognised that the electricity network is constantly extended, augmented and modified and there is a delay from the completion and commissioning of these works until their capture in the model. Easements benefitting Endeavour Energy are indicated by red hatching. Generally (depending on the scale and/or features selected), low voltage (normally not exceeding 1,000 volts) is indicated by blue lines and high voltage (normally exceeding 1,000 volts but for Endeavour Energy's network not exceeding 132,000 volts / 132 kV) by red lines (these lines can appear as solid or dashed and where there are multiple lines / cables only the higher voltage may be shown). This plan only shows the Endeavour Energy network and does not show electricity infrastructure belonging to other authorities or customers owned electrical equipment beyond the customer connection point / point of supply to the property. This plan does not constitute the provision of information on underground electricity power lines by network operators under Part 5E 'Protection of underground electricity power lines' of the *Electricity Supply Act 1995* (NSW).

Site Plan from Endeavour Energy's G/Net Master Facility Model



Site Plan from Endeavour Energy's G/Net Master Facility Model



LEGEND	
	Padmount substation
	Indoor substation
	Ground substation
	Kiosk substation
	Cottage substation
	Pole mounted substation
	High voltage customer substation
	Metering unit
	Switch station
	Indoor switch station
	Voltage regulator
	Customer connection point
	Low voltage pillar
	Streetlight column
	Life support customer
	Tower
	Pole
	Pole with streetlight
	Customer owned / private pole
	Cable pit
	Load break switch
	Recloser
	Proposed removed
	Easement
	Subject site

Site Masterplan

