

12 February 2025

The Secretary  
NSW Department of Planning, Housing and Infrastructure

**Attention: Traki Gotsis**

**SSD-43065987-MOD-2 CARLINGFORD AND CUMBERLAND SCHOOLS MODIFICATION 2**

Dear Sir or Madam

I refer to the Department's letter of 7 February 2025 regarding State Significant Development SSD-43065987-MOD-2 Carlingford and Cumberland Schools Modification 2 for 'Minor architectural and tree removal and planting changes' at 57-73 Felton Road and 183 Pennant Hills Road, Carlingford (Lots 1-5 DP 235625) in the City of Parramatta Local Government Area (LGA). Submissions need to be made to the Department by 24 February 2025.

Please refer to Endeavour Energy's submission made to the Department on 8 November 2022 regarding the Environmental Impact Statement (EIS) for State Significant Development SSD-43065987 Upgrades to Carlingford West Public School and Cumberland High School. Notwithstanding the proposed amendments, the conditions and advice provided therein essentially remain applicable.

Please find attached for the applicant's reference a copy of Endeavour Energy's Standard Conditions for Development Applications and Planning Proposals, Version 10, January 2025 which provides some additional and updated information. For further advice the applicant can call Endeavour Energy via Head Office enquiries on business days from 9am - 4:30pm on telephone: 133 718 and the following contacts:

- Customer Network Solutions Branch for matters related to the electricity supply or asset removal / relocation who are responsible for managing the conditions of supply with the applicant and their Accredited Service Provider (ASP). Alternatively contact can be made by email [CWAdmin@endeavourenergy.com.au](mailto:CWAdmin@endeavourenergy.com.au) .

The applicant will need to contact Endeavour Energy's Customer Network Solutions Branch if this Development Application:

- Includes any contestable works projects that are outside of any existing approved / certified works.
- Results in an electricity load that is outside of any existing Supply / Connection Offer requiring the incorporation of the additional load for consideration.
- Easements Officers for matters related to easement management, protected works or other forms of property tenure / interests. Alternatively contact can be made by email [Easements@endeavourenergy.com.au](mailto:Easements@endeavourenergy.com.au) .

All encroachments, activities and / or works (including subdivision and even if not part of the Development Application) whether temporary or permanent within or affecting an easement, restriction, right of access or protected works (other than those approved / certified by Endeavour Energy's Customer Network Solutions Branch as part of an enquiry / application for load or asset relocation project) need to be referred to Endeavour Energy's Easements Officers for assessment and possible approval if they meet the minimum safety requirements and controls. However please note that this does not constitute or imply the granting of approval by Endeavour Energy to any or all of the proposed encroachments and / or activities.

For further information please refer to the attached copies of Endeavour Energy's:

- General Restrictions for Underground Cables.
  - Guide to Fencing, Retaining Walls and Maintenance Around Padmount Substations.
  - Mains Design Instruction MDI 0044 'Easements and Property Tenure Rights' which deals with activities / encroachments within easements.
- Property Branch for matters related to property tenure. Alternatively contact can be made by email [network\\_property@endeavourenergy.com.au](mailto:network_property@endeavourenergy.com.au) (underscore between 'network' and 'property').
  - Field Operations Branch for safety advice for building or working near electrical assets in public areas. The site is in the area covered by Parramatta Field Service Centre. Alternatively contact can be made by email [Construction.Works@endeavourenergy.com.au](mailto:Construction.Works@endeavourenergy.com.au).

Based on and subject to the foregoing Endeavour Energy has no objection to the Development Application. Should you wish to discuss this matter, or have any questions, please do not hesitate to contact me or the contacts identified above or in Endeavour Energy's submission to the EIS in relation to the various matters. Due to the high number of development application / planning proposal notifications submitted to Endeavour Energy, to ensure a response contact by email to [Property.Development@endeavourenergy.com.au](mailto:Property.Development@endeavourenergy.com.au) is preferred.

Yours faithfully

**Cornelis Duba** | Development Application Specialist

M 0455250981

E [cornelis.duba@endeavourenergy.com.au](mailto:cornelis.duba@endeavourenergy.com.au)

Level 40-42, 8 Parramatta Square, 10 Darcy Street  
Parramatta NSW 2150.

Dharug/Wiradjuri/Dharawal/Gundungurra/Yuin Country

[endeavourenergy.com.au](http://endeavourenergy.com.au) |    




**Endeavour  
Energy**

**POWER  
together**






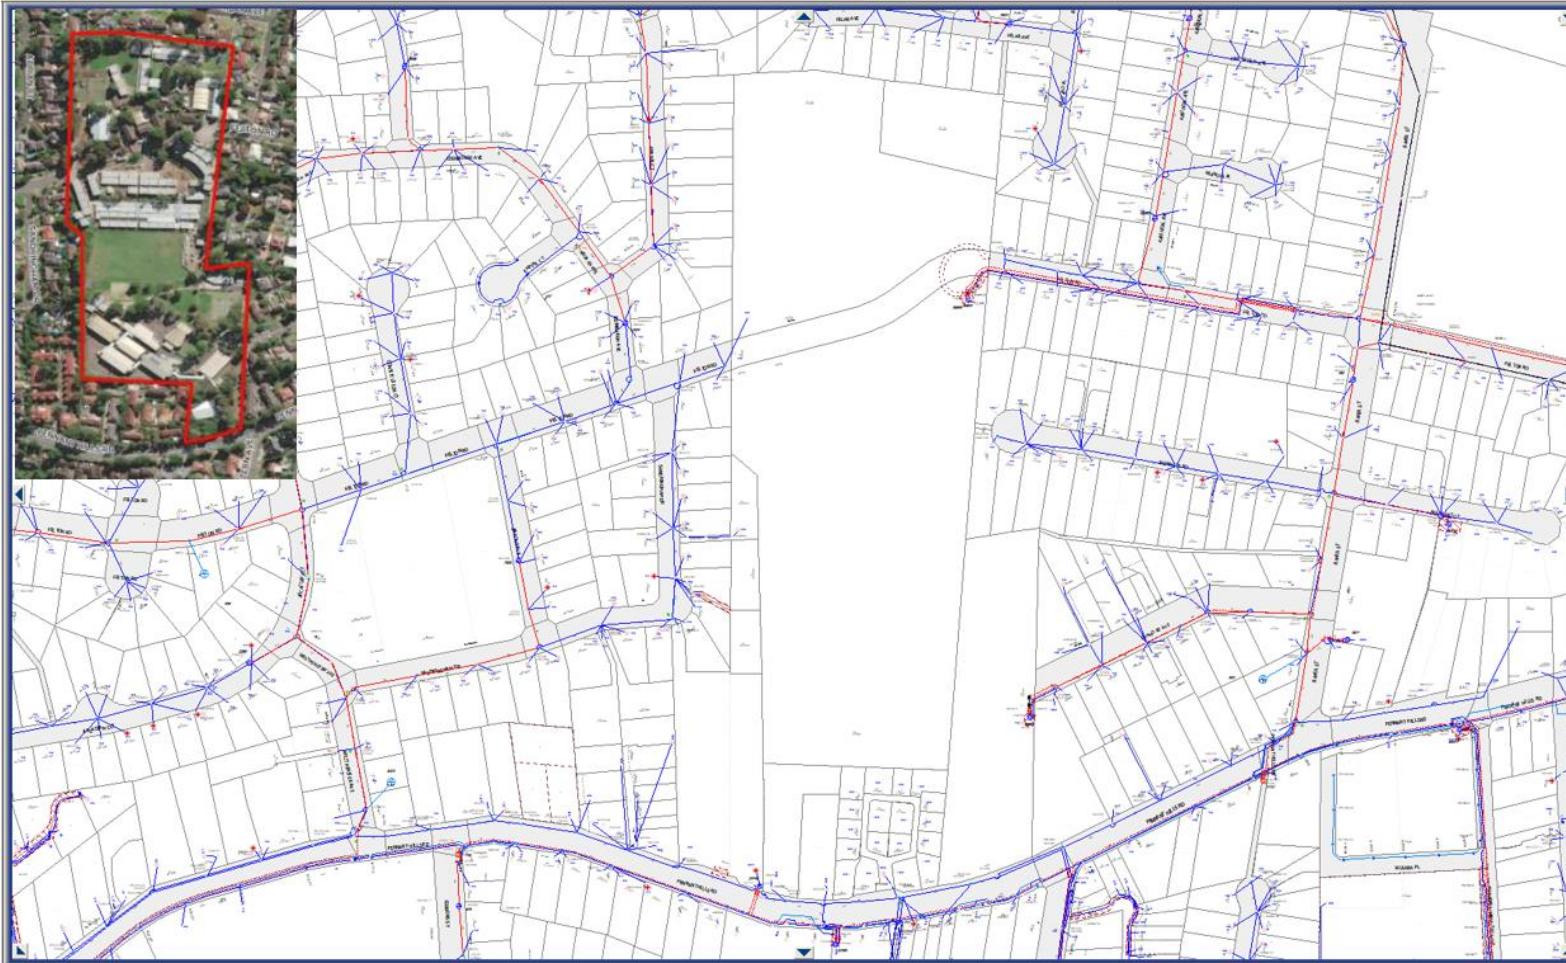





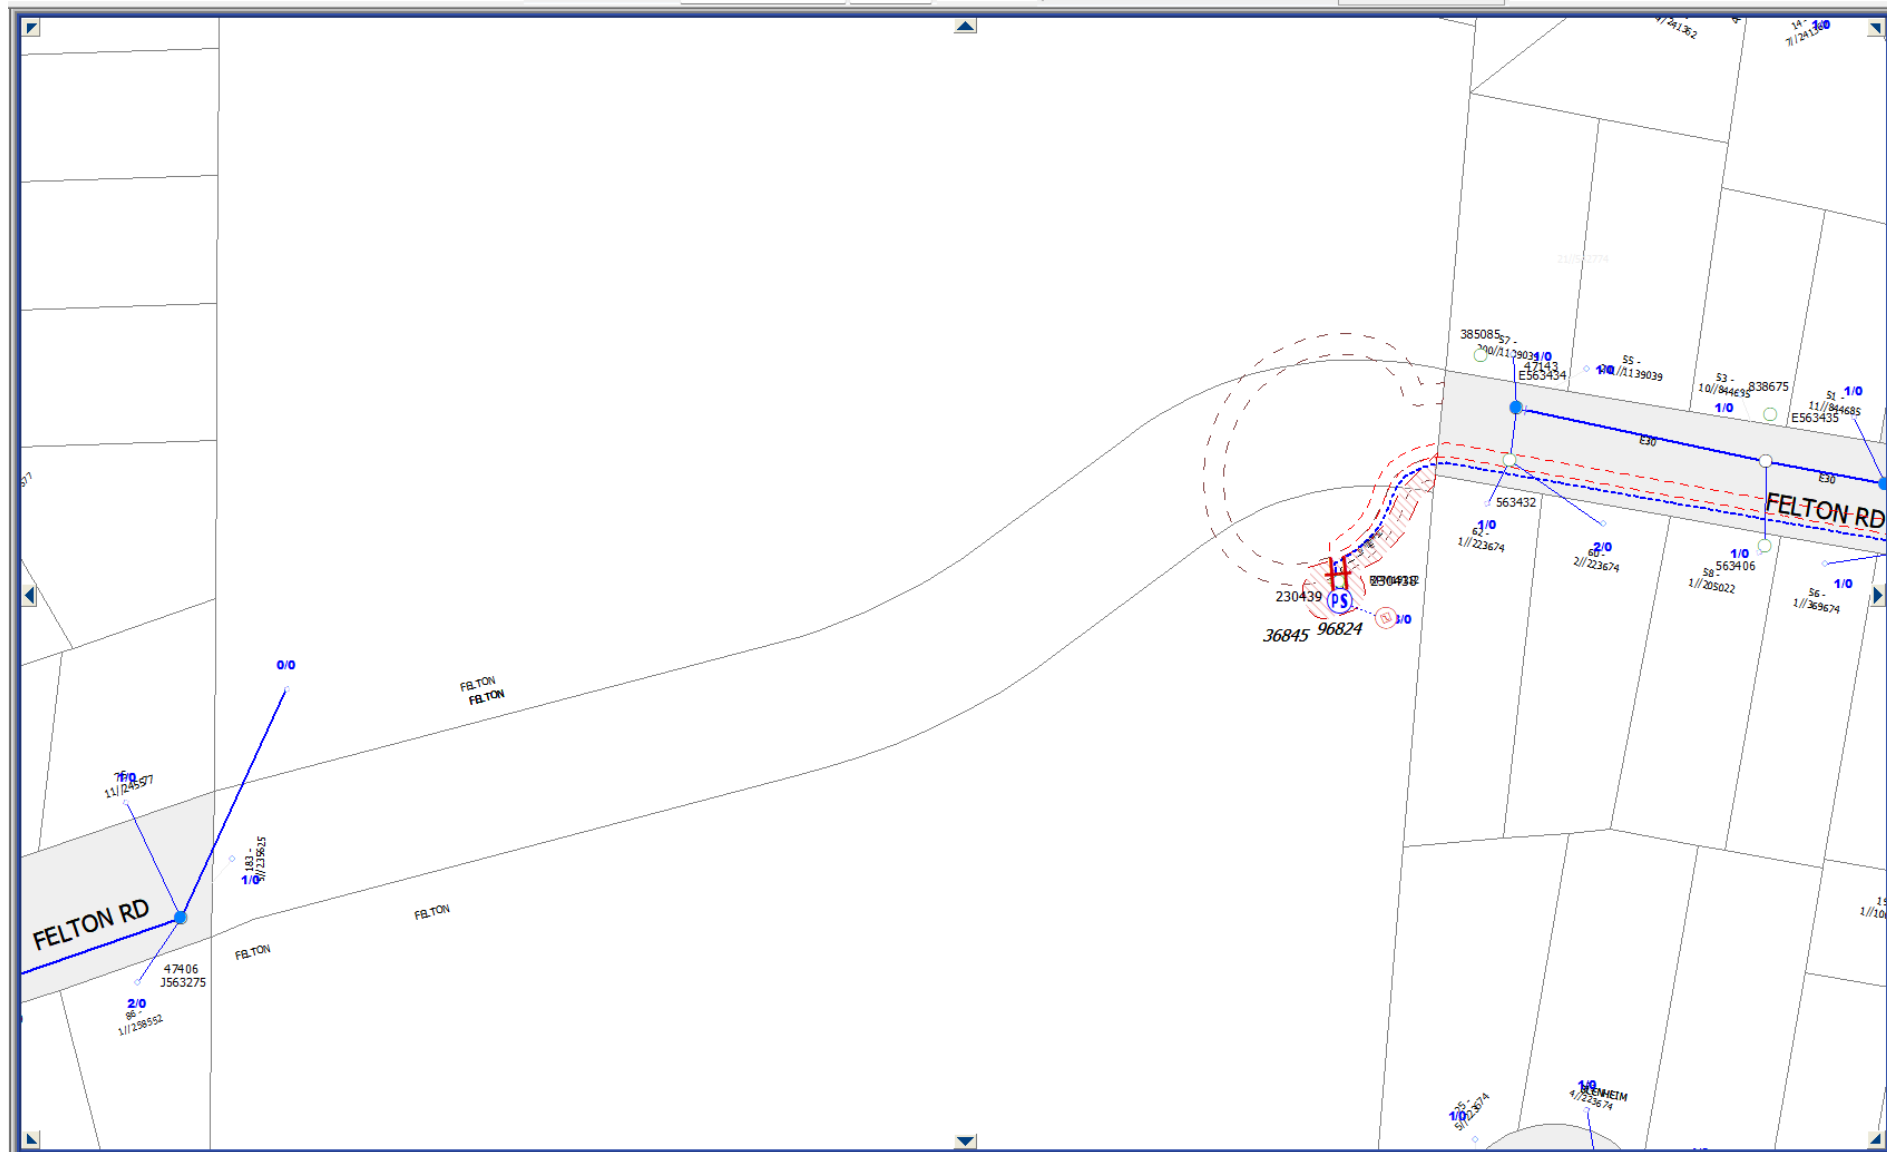



















Endeavour Energy respectfully acknowledges the Traditional Custodians on whose lands we live, work, and operate and their Elders past and present.



Please note the location, extent and type of any electricity infrastructure, boundaries etc. shown on the plan is indicative only. In addition it must be recognised that the electricity network is constantly extended, augmented and modified and there is a delay from the completion and commissioning of these works until their capture in the model. Easements benefitting Endeavour Energy are indicated by red hatching. Generally (depending on the scale and/or features selected), low voltage (normally not exceeding 1,000 volts) is indicated by blue lines and high voltage (normally exceeding 1,000 volts but for Endeavour Energy's network not exceeding 132,000 volts / 132 kV) by red lines (these lines can appear as solid or dashed and where there are multiple lines / cables only the higher voltage may be shown). This plan only shows the Endeavour Energy network and does not show electricity infrastructure belonging to other authorities or customers owned electrical equipment beyond the customer connection point / point of supply to the property. This plan does not constitute the provision of information on underground electricity power lines by network operators under Part 5E 'Protection of underground electricity power lines' of the *Electricity Supply Act 1995* (NSW).

**Site Plan from Endeavour Energy's HxGN NetWorks Core NetViewer Master Facility Model. WARNING: Electricity infrastructure shown is indicative only.**



LEGEND	
	Padmount substation
	Indoor substation
	Ground substation
	Kiosk substation
	Cottage substation
	Padmount high voltage plugboard
	Pole mounted substation
	High voltage customer substation
	Metering unit
	Switch station
	Indoor switch station
	Voltage regulator
	Customer connection point
	Low voltage pillar
	Streetlight column
	Life support customer
	Tower
	Pole
	Pole with streetlight
	Customer owned / private pole
	Cable pit
	Load break switch
	Recloser
	Proposed removed
	Easement active
	Easement proposed
	Licence active
	Subject site

# Extract of Deposited Plan DP 1301540

