

2 June 2025

The Secretary
NSW Department of Planning, Housing and Infrastructure

Attention: Sally Munk

SSD-76913969 ALDI Automated Distribution Centre

Dear Sir or Madam

I refer to the Department's email of 28 May 2025 regarding the Environmental Impact Statement (EIS) for State Significant Development SSD-76913969 ALDI Automated Distribution Centre for 'Construction and operation of an automated warehouse and distribution centre' at 475 Badgerys Creek Road, Bradfield (Lot 100 DP 1287207) in the Liverpool City Council local government area (LGA). Submissions need to be made to the Department by 26 June 2025.

Please refer to Endeavour Energy's submission made to the Department on 16 October 2024 regarding the request for Secretary's Environmental Assessment Requirements (SEARs) for SSD-76913969 ALDI Automated Distribution Centre. The conditions and advice provided therein essentially remain applicable.

Please find attached for the applicant's reference a copy of Endeavour Energy's Standard Conditions for Development Applications and Planning Proposals, Version 10, January 2025 which provides some additional and updated information. For further advice the applicant can call Endeavour Energy via Head Office enquiries on business days from 9am - 4:30pm on telephone: 133 718 and the following contacts:

- Customer Network Solutions Branch for matters related to the electricity supply or asset removal / relocation who are responsible for managing the conditions of supply with the applicant and their Accredited Service Provider (ASP). Alternatively contact can be made by email CWAdmin@endeavourenergy.com.au .
- Easements Officers for matters related to easement management, protected works or other forms of property tenure / interests. Alternatively contact can be made by email Easements@endeavourenergy.com.au .
- Property Branch for matters related to property tenure. Alternatively contact can be made by email network_property@endeavourenergy.com.au (underscore between 'network' and 'property').
- Field Operations Branch for safety advice for building or working near electrical assets in public areas. The site is in the area covered by Narellan Field Service Centre. Alternatively contact can be made by email Construction.Works@endeavourenergy.com.au .

Based on and subject to the foregoing Endeavour Energy has no objection to the Development Application. Should you wish to discuss this matter, or have any questions, please do not hesitate to contact me or the contacts identified above in relation to the various matters. Due to the high number of development application / planning proposal notifications submitted to Endeavour Energy, to ensure a response contact by email to Property.Development@endeavourenergy.com.au is preferred.

Yours faithfully

Cornelis Duba | Development Application Specialist

M 0455250981

E cornelis.duba@endeavourenergy.com.au

Level 40-42, 8 Parramatta Square, 10 Darcy Street
Parramatta NSW 2150.

Dharug/Wiradjuri/Dharawal/Gundungurra/Yuin Country

endeavourenergy.com.au |    



**Endeavour
Energy**


**POWER
together**



Endeavour Energy respectfully acknowledges the Traditional Custodians on whose lands we live, work, and operate and their Elders past and present.

Locality Plan




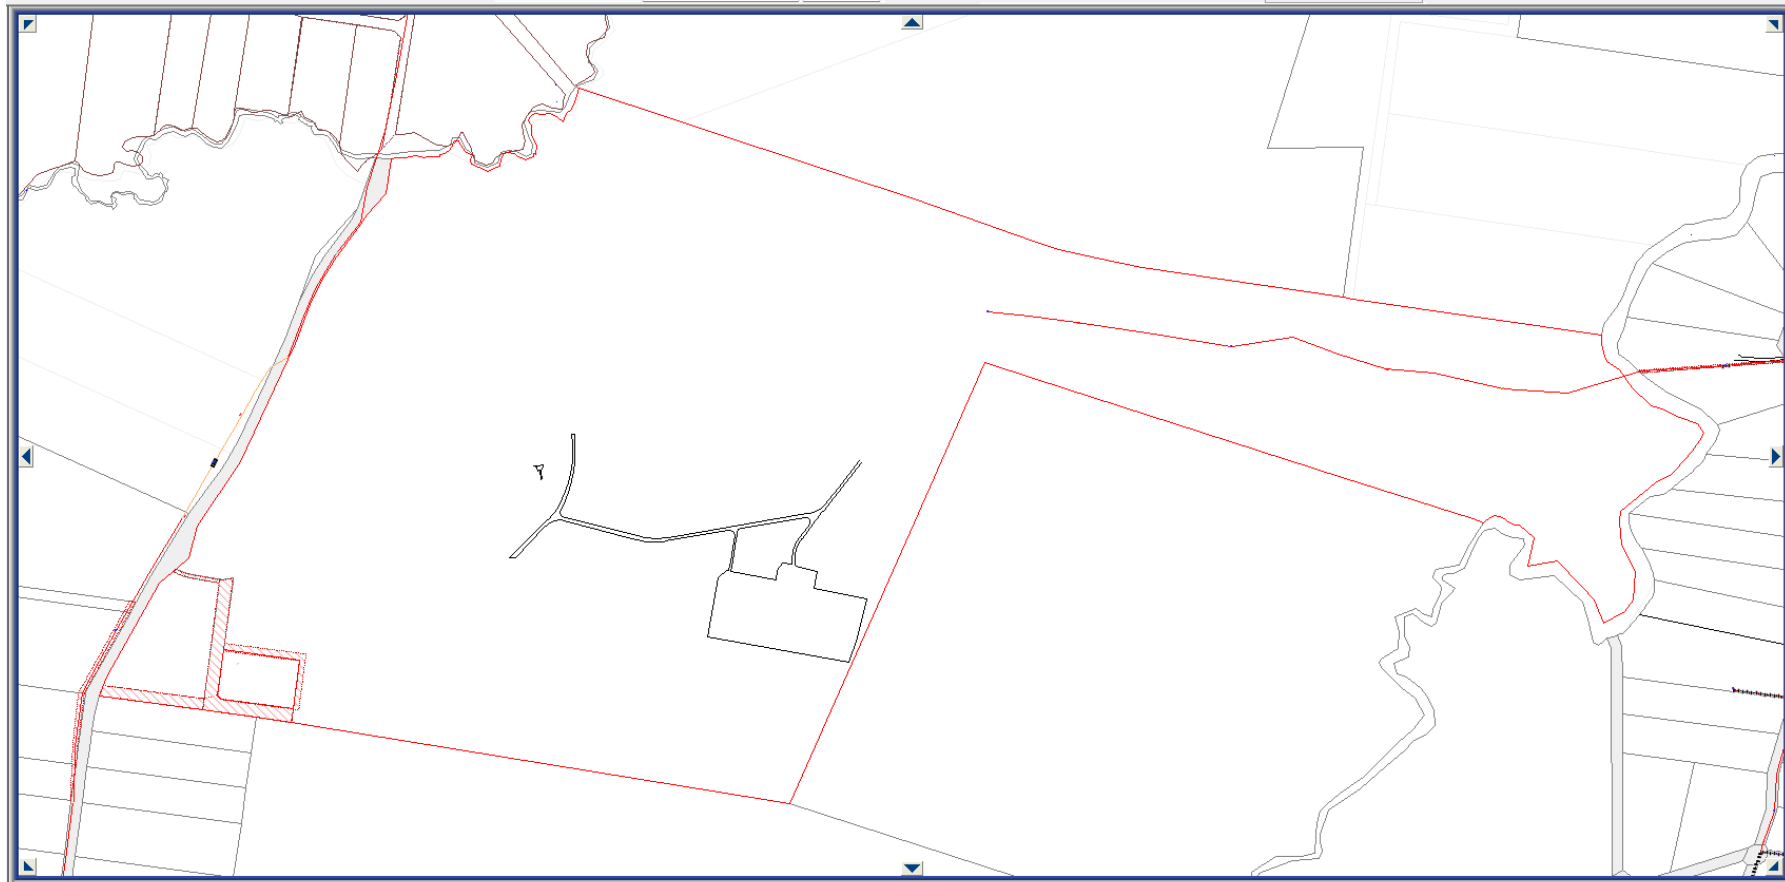







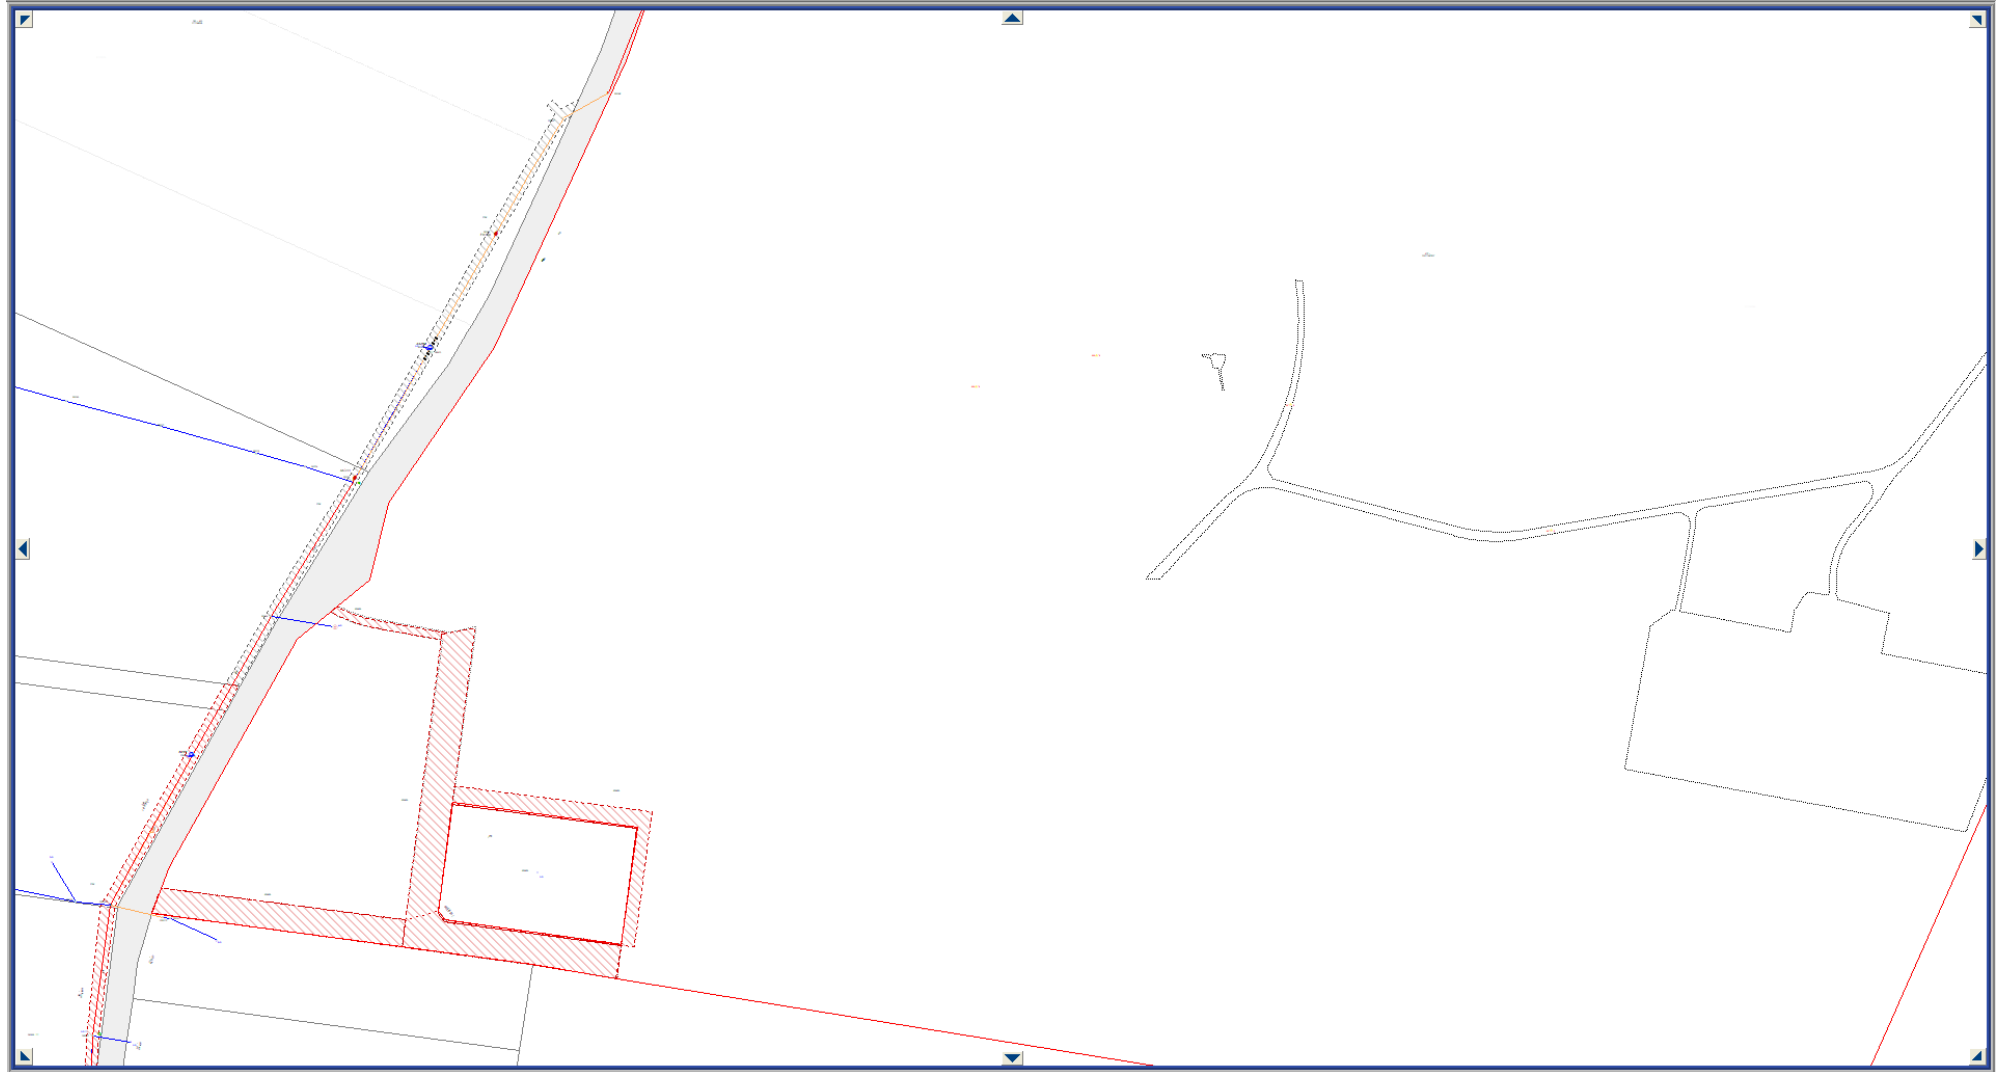





















G3E_FID	Feature Name	Component Name	G3E_CID	G3E_ID	LOT	SECTION	DP
86580676	Crown Parcel	Crown Parcel Find	1	2490270	100		1287207

Please note the location, extent and type of any electricity infrastructure, boundaries etc. shown on the plan is indicative only. In addition it must be recognised that the electricity network is constantly extended, augmented and modified and there is a delay from the completion and commissioning of these works until their capture in the model. Easements benefitting Endeavour Energy are indicated by red hatching. Generally (depending on the scale and/or features selected), low voltage (normally not exceeding 1,000 volts) is indicated by blue lines and high voltage (normally exceeding 1,000 volts but for Endeavour Energy's network not exceeding 132,000 volts / 132 kV) by red lines (these lines can appear as solid or dashed and where there are multiple lines / cables only the higher voltage may be shown). This plan only shows the Endeavour Energy network and does not show electricity infrastructure belonging to other authorities or customers owned electrical equipment beyond the customer connection point / point of supply to the property. This plan does not constitute the provision of information on underground electricity power lines by network operators under Part 5E 'Protection of underground electricity power lines' of the *Electricity Supply Act 1995* (NSW).

Site Plan from Endeavour Energy's HxGN NetWorks Core NetViewer Master Facility Model



LEGEND	
	Padmount substation
	Indoor substation
	Ground substation
	Kiosk substation
	Cottage substation
	Padmount high voltage plugboard
	Pole mounted substation
	High voltage customer substation
	Metering unit
	Switch station
	Indoor switch station
	Voltage regulator
	Customer connection point
	Low voltage pillar
	Streetlight column
	Life support customer
	Tower
	Pole
	Pole with streetlight
	Customer owned / private pole
	Cable pit
	Load break switch
	Recloser
	Proposed removed
	Easement active
	Easement proposed
	Licence active
	Subject site