

7 November 2025

The Secretary
NSW Department of Planning, Housing and Infrastructure

Attention: Dave Auster

SSD-58978472 Aspect Industrial Estate IVE Printing and Packaging Facility (WH8)

Dear Sir or Madam

I refer to the Department's email of 4 November 2025 regarding the Amendment Report for State Significant Development SSD-58978472 Kelso Crescent Multi-Level Warehouse, Moorebank for 'Fit out and use of the WH8 building for the IVE Group packaging and print operation. The proposal includes a modification to the concept plan including changes to site layout, parking and landscaping requirements' at 20 Kelso Crescent, Moorebank (Lot 1 DP 1296586) in the Liverpool City Council local government area (LGA). Submissions need to be made to the Department by 19 November 2025.

Please refer to the attached copy of Endeavour Energy's submission made to the Department on 1 July 2024 regarding the Environmental Impact Statement (EIS) for SSD-58978472 Kelso Crescent Multi-Level Warehouse, Moorebank. Notwithstanding the proposed amendments the conditions and advice provided therein essentially remain applicable.

The Amendment Report includes the following advice.

3.3 UPDATED DEVELOPMENT DESCRIPTION

The proposed SSD Application seeks approval for the construction and operation of a warehouse and distribution centre, including:

- Provision of infrastructure comprising civil works and utilities servicing
- Diversion of overhead electricity transmission lines at the western and southern boundaries to new subterranean channels

The below copy of the Ground Floor / Site Plan shows provision for three padmount substations and 'Electrical Easement Hatched'.

Any required padmount substation/s will need to be located within the property (in a suitable and accessible location) and be protected (including any associated cabling not located within a public road / reserve) with an appropriate form of property tenure as detailed in the attached copy of Endeavour Energy's 'Land Interest Guidelines for Network Connection'.

Generally it is the Level 3 Accredited Service Provider's (ASP) responsibility (engaged by the developer) to make sure substation location and design complies with Endeavour Energy's standards the suitability of access, safety clearances, fire ratings, flooding etc. If the substation does not comply with Endeavour Energy's standards, the applicant must request a dispensation.

For further information please also refer to the attached copies of Endeavour Energy's:

- Mains Design Instruction MDI 0044 'Easements and Property Tenure Rights'.
- Guide to Fencing, Retaining Walls and Maintenance Around Padmount Substations.

For situations when network assets have to be removed or relocated to facilitate a proposed development, the applicant will need to make an application to Endeavour Energy's Customer Network Solutions Branch. The design and construction works will generally need to be funded by and arranged by the applicant under the contestable works framework by an Accredited Service Provider (ASP). However please note that this does not constitute or imply the granting of approval by Endeavour Energy to any or all of the proposed works or the associated release of easement.

No easement is considered to be redundant or obsolete until it is released. Even if there is no 'Inservice' electricity distribution infrastructure, Endeavour Energy may continue to manage the easement as if network assets are in place.

Please find attached for the applicant's reference a copy of Endeavour Energy's Standard Conditions for Development Applications and Planning Proposals, Version 10A, August 2025 which provides some additional and updated information.

For further advice the applicant can call Endeavour Energy via General Enquiries on business days from 9am - 4:30pm on telephone: 133 718 and the following contacts:

- Customer Network Solutions Branch for matters related to the electricity supply or asset removal / relocation who are responsible for managing the conditions of supply with the applicant and their Accredited Service Provider (ASP). Alternatively contact can be made by the [Connect Online](#) page on Endeavour Energy's website.

The applicant will need to contact Endeavour Energy's Customer Network Solutions Branch if this Development Application:

- Includes any contestable works projects that are outside of any existing approved / certified works.
- Results in an electricity load that is outside of any existing Supply / Connection Offer requiring the incorporation of the additional load for consideration.
- Easements Officers for matters related to easement management, protected works or other forms of property tenure / interests. Alternatively contact can be made by email Easements@endeavourenergy.com.au.

All encroachments, activities and / or works (including subdivision and even if not part of the Development Application) whether temporary or permanent within or affecting an easement, restriction, statutory right, right of access or protected works (other than those approved / certified by Endeavour Energy's Customer Network Solutions Branch as part of an enquiry / application for load or asset relocation project) need to be referred to Endeavour Energy's Easements Officers for assessment and possible approval if they meet the minimum safety requirements and controls. However please note that this does not constitute or imply the granting of approval by Endeavour Energy to any or all of the proposed encroachments and / or activities.

For further information please refer to the attached copies of Endeavour Energy's:

- General Restrictions for Overhead Power Lines.
 - General Restrictions for Underground Cables.
 - Guide to Fencing, Retaining Walls and Maintenance Around Padmount Substations.
 - Mains Design Instruction MDI 0044 'Easements and Property Tenure Rights' which deals with activities / encroachments within easements.
- Property Branch for matters related to property tenure. Alternatively contact can be made by email network_property@endeavourenergy.com.au (underscore between 'network' and 'property').
 - Construction Works Team for safety advice for building or working near electrical assets or street infrastructure in public areas. Alternatively contact can be made by Alternatively contact can be made by the [Connect Online](#) page on Endeavour Energy's website.

Based on and subject to the foregoing Endeavour Energy has no objection to the Development Application. Could you please pass on a copy of this submission to the applicant? Should you wish to discuss this matter, or have any questions, please do not hesitate to contact me or the contacts identified above in relation to the various matters. Due to the high number of development application / planning proposal notifications submitted to Endeavour Energy, to ensure a response contact by email to Property.Development@endeavourenergy.com.au is preferred.

Yours faithfully

Cornelis Duba | Development Application Specialist

M 0455250981

E cornelis.duba@endeavourenergy.com.au

Level 40-42, 8 Parramatta Square, 10 Darcy Street
Parramatta NSW 2150.


Dharug/Wiradjuri/Dharawal/Gundungurra/Yuin Country

endeavourenergy.com.au |    



Endeavour Energy respectfully acknowledges the Traditional Custodians on whose lands we live, work, and operate and their Elders past and present.

Site Plan from Endeavour Energy's HxGN NetWorks Core NetViewer Master Facility Model. WARNING: Electricity infrastructure shown is indicative only.

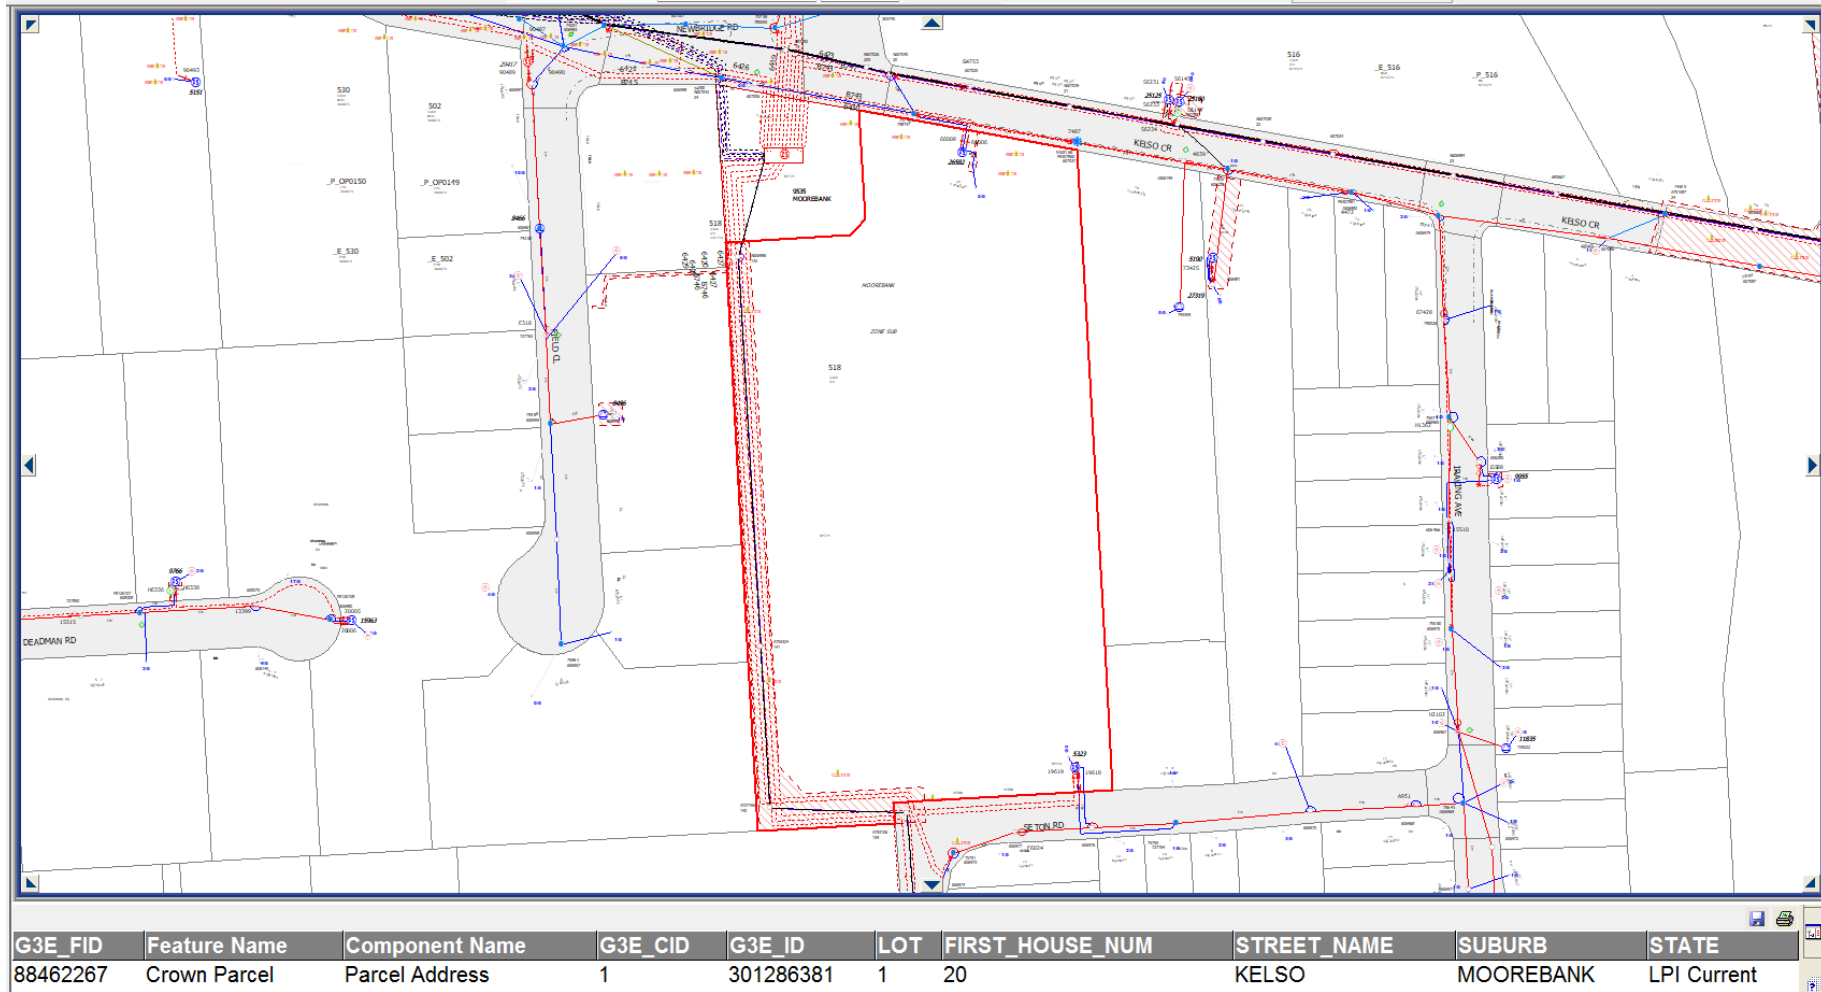

Please note the location, extent and type of any electricity infrastructure, boundaries etc. shown on the plan is indicative only. In addition it must be recognised that the electricity network is constantly extended, augmented and modified and there is a delay from the completion and commissioning of these works until their capture in the model. Easements benefitting Endeavour Energy are indicated by red hatching. Generally (depending on the scale and/or features selected), low voltage (normally not exceeding 1,000 volts) is indicated by blue lines and high voltage (normally exceeding 1,000 volts but for Endeavour Energy's network not exceeding 132,000 volts / 132 kV) by red lines (these lines can appear as solid or dashed and where there are multiple lines / cables only the higher voltage may be shown). This plan only shows the Endeavour Energy network and does not show electricity infrastructure belonging to other authorities or customers owned electrical equipment beyond the customer connection point / point of supply to the property. This plan does not constitute the provision of information on underground electricity power lines by network operators under Part 5E 'Protection of underground electricity power lines' of the *Electricity Supply Act 1995* (NSW).

LEGEND	
	Padmount substation
	Indoor substation
	Ground substation
	Kiosk substation
	Cottage substation
	Padmount high voltage plugboard
	Pole mounted substation
	Overhead battery substation
	High voltage customer substation
	Metering unit
	Switch station
	Indoor switch station
	Voltage regulator
	Customer connection point
	Low voltage pillar
	Streetlight column
	Life support customer
	Tower
	Pole
	Pole with streetlight
	Customer owned / private pole
	Cable pit
	Load break switch
	Recloser
	Proposed removed
	Easement active
	Easement proposed
	Licence active
	Subject site

Ground Floor / Site Plan

