



570 George Street
Sydney NSW 2000
All mail to GPO Box 4009
Sydney NSW 2001
T +61 2 131 365
www.ausgrid.com.au

10 August 2015

Ms Megan Fu
Department of Planning & Environment
GPO Box 4009
SYDNEY NSW 2001

By email: megan.fu@planning.nsw.gov.au

Dear Ms Fu

SSD 7024 - St George Hospital Redevelopment Stage 2 – Acute Services Building

Notice of Exhibition

I refer to the Department's correspondence dated 23 June 2015 inviting Ausgrid to make a submission on the abovementioned project.

A review of the development has been undertaken in relation to potential impacts or interfaces with Ausgrid's electricity infrastructure. Ausgrid has identified the following (please refer to the enclosed drawings):

1. 11,000 cables and substation within the proposed development area, which will be impacted.
2. 132,000 volt cables and 33,000 volt gas pressurised cables, which reside in the vicinity of the proposed development. Whilst these may not be directly affected by the current proposal, it is anticipated that future carpark development along Kensington Street will impact these cables due to construction vibration.

We note you have identified that electrical substation works will be undertaken as part of the development. Ausgrid requires that the Department make it a condition of consent that Health Infrastructure (**Proponent**) consult with Ausgrid regarding the continued safe and secure supply to the hospital, and for any works necessary for the relocation of Ausgrid's infrastructure.


Ausgrid would like to advise the Department and the Proponent that Ausgrid reserves the right under the *Electricity Supply Act (1995)* to intervene in any cases which risks interference with or could impact the safety of Ausgrid's infrastructure.

Should you wish to discuss these matters further, please contact Matthew Faferko on 9269 4620 or via email mfaferko@ausgrid.com.au.

Yours sincerely

A handwritten signature in blue ink, appearing to read "Matthew Faferko", with a long horizontal line extending to the right.

Matthew Faferko
Senior Area Development Manager – Sydney North & East
Ausgrid

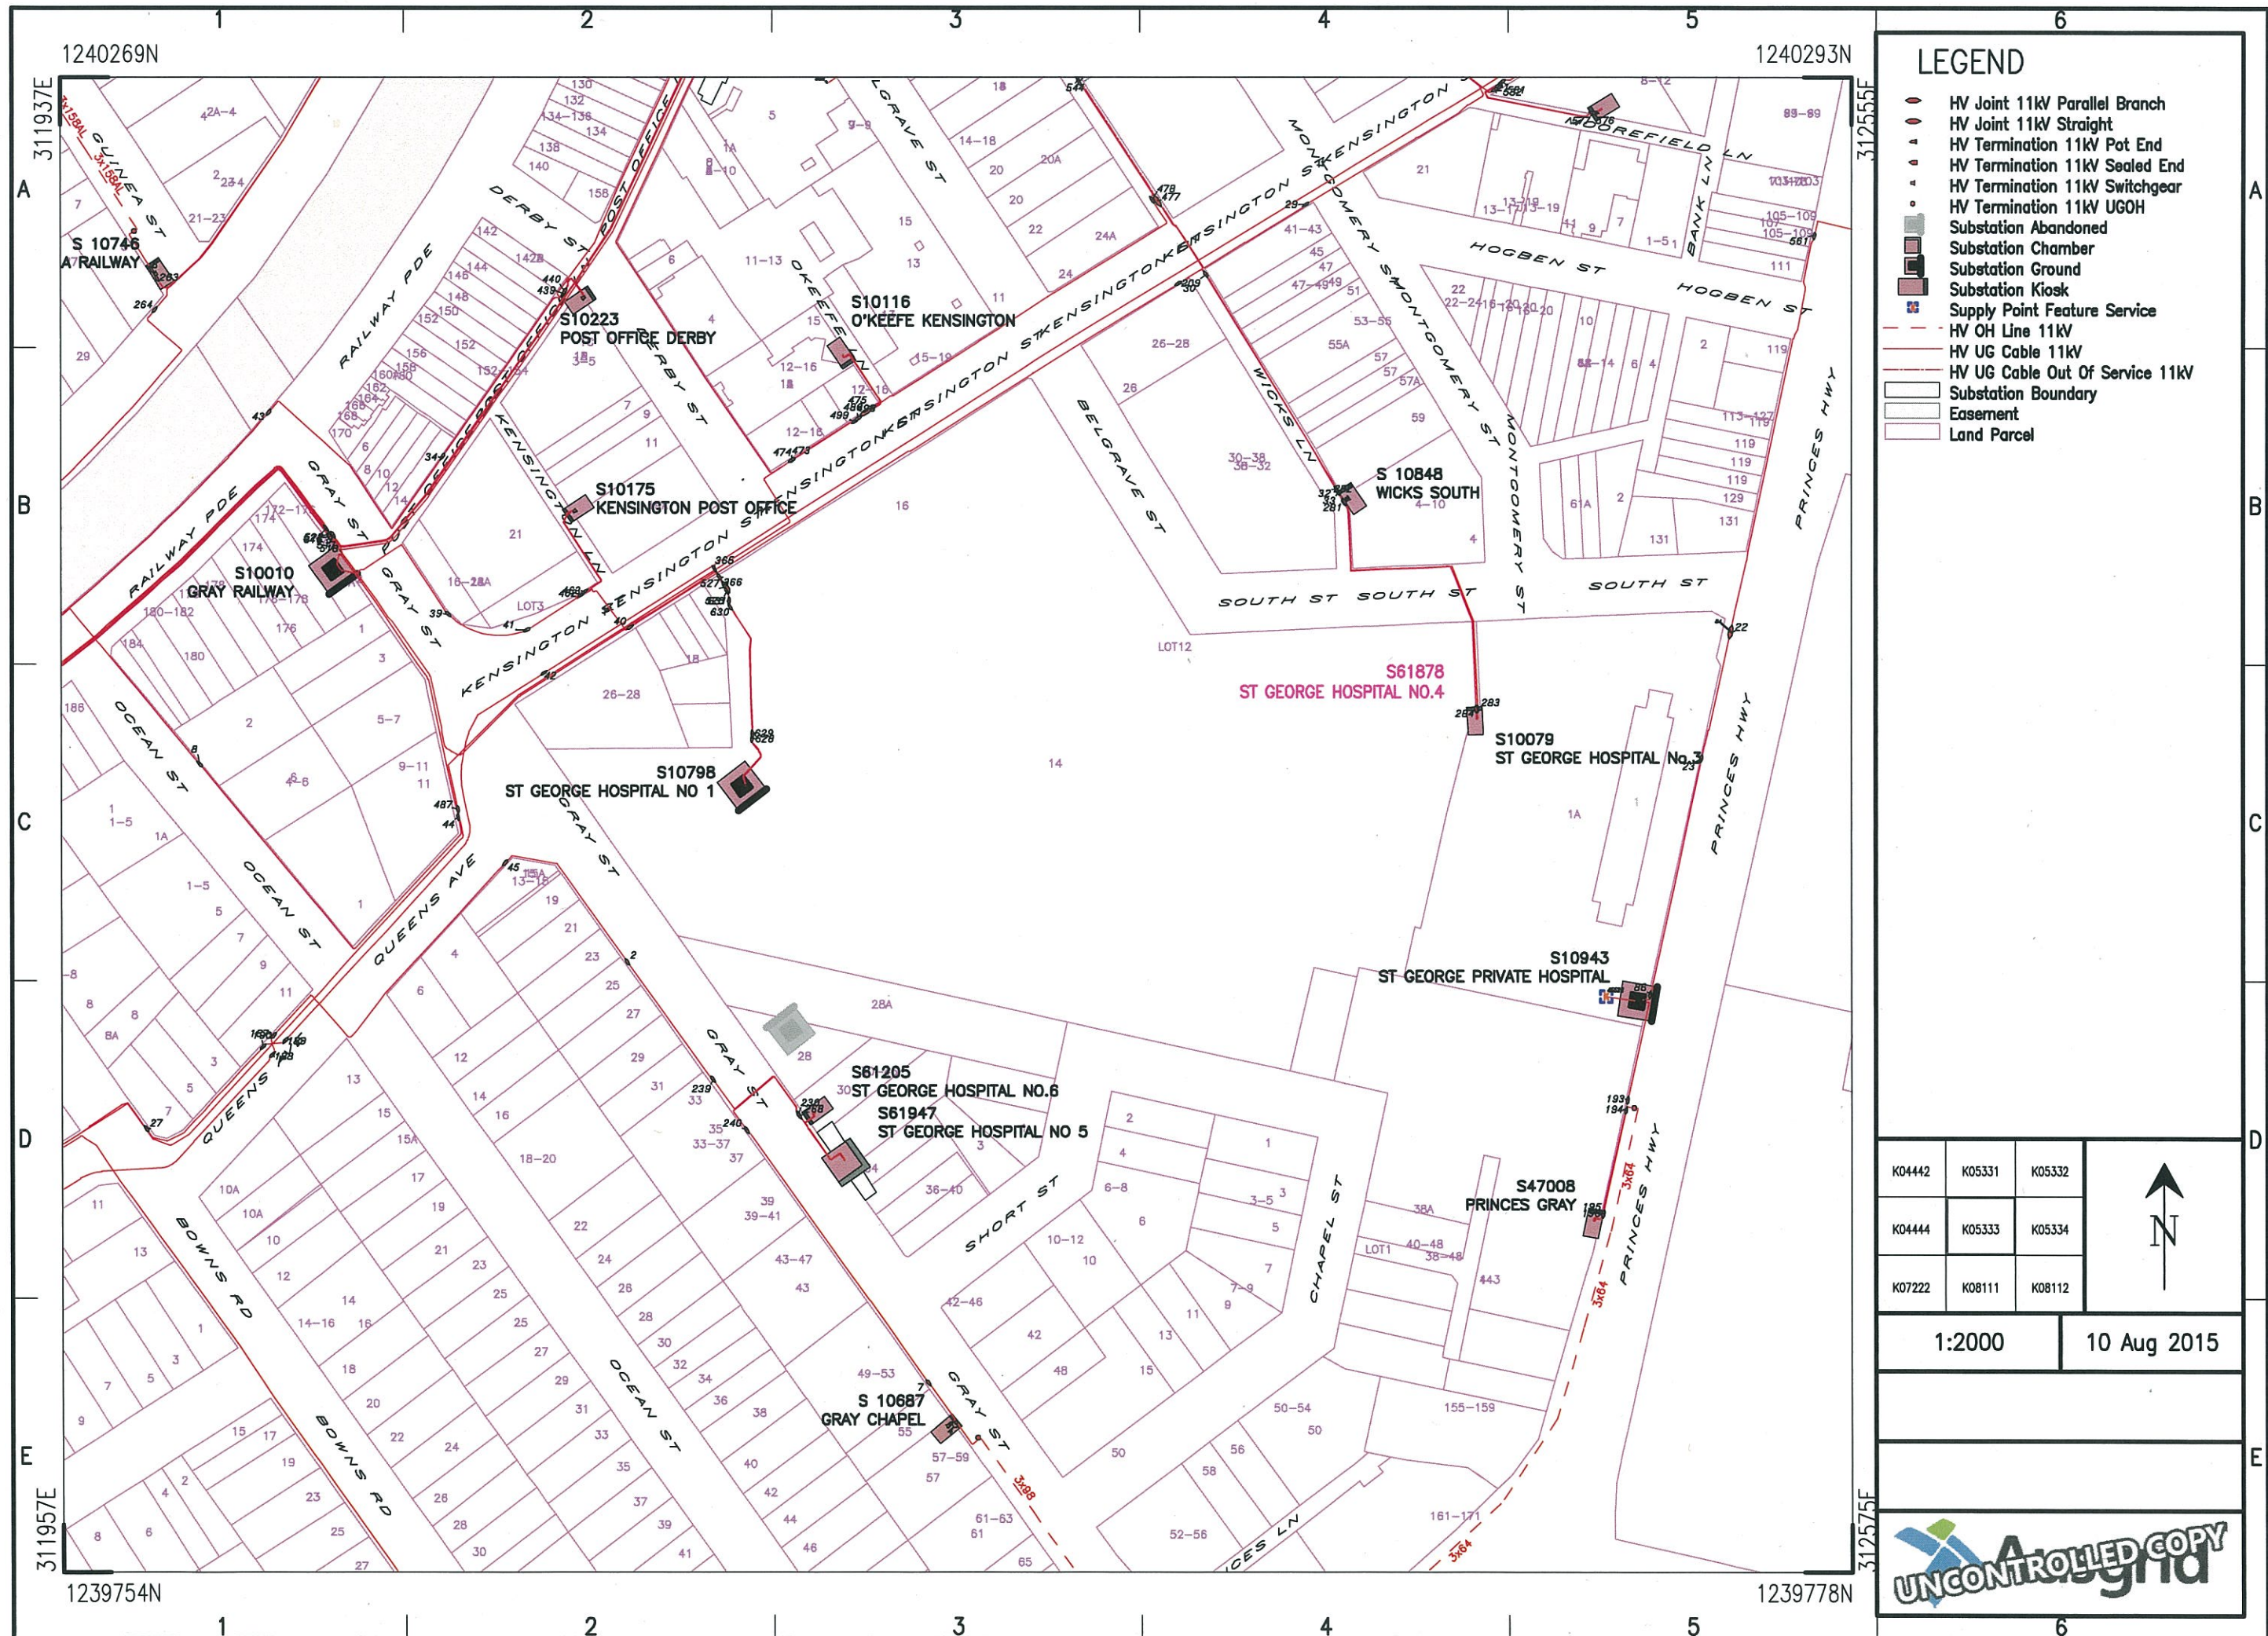


LEGEND

- HV Joint 11kV Parallel Branch
- HV Joint 11kV Straight
- HV Termination 11kV Pot End
- HV Termination 11kV Sealed End
- HV Termination 11kV Switchgear
- HV Termination 11kV UGOH
- Substation Abandoned
- Substation Chamber
- Substation Ground
- Substation Kiosk
- Supply Point Feature Service
- HV OH Line 11kV
- HV UG Cable 11kV
- HV UG Cable Out Of Service 11kV
- Substation Boundary
- Easement
- Land Parcel

K04442	K05331	K05332
K04444	K05333	K05334
K07222	K08111	K08112

1:2000

10 Aug 2015

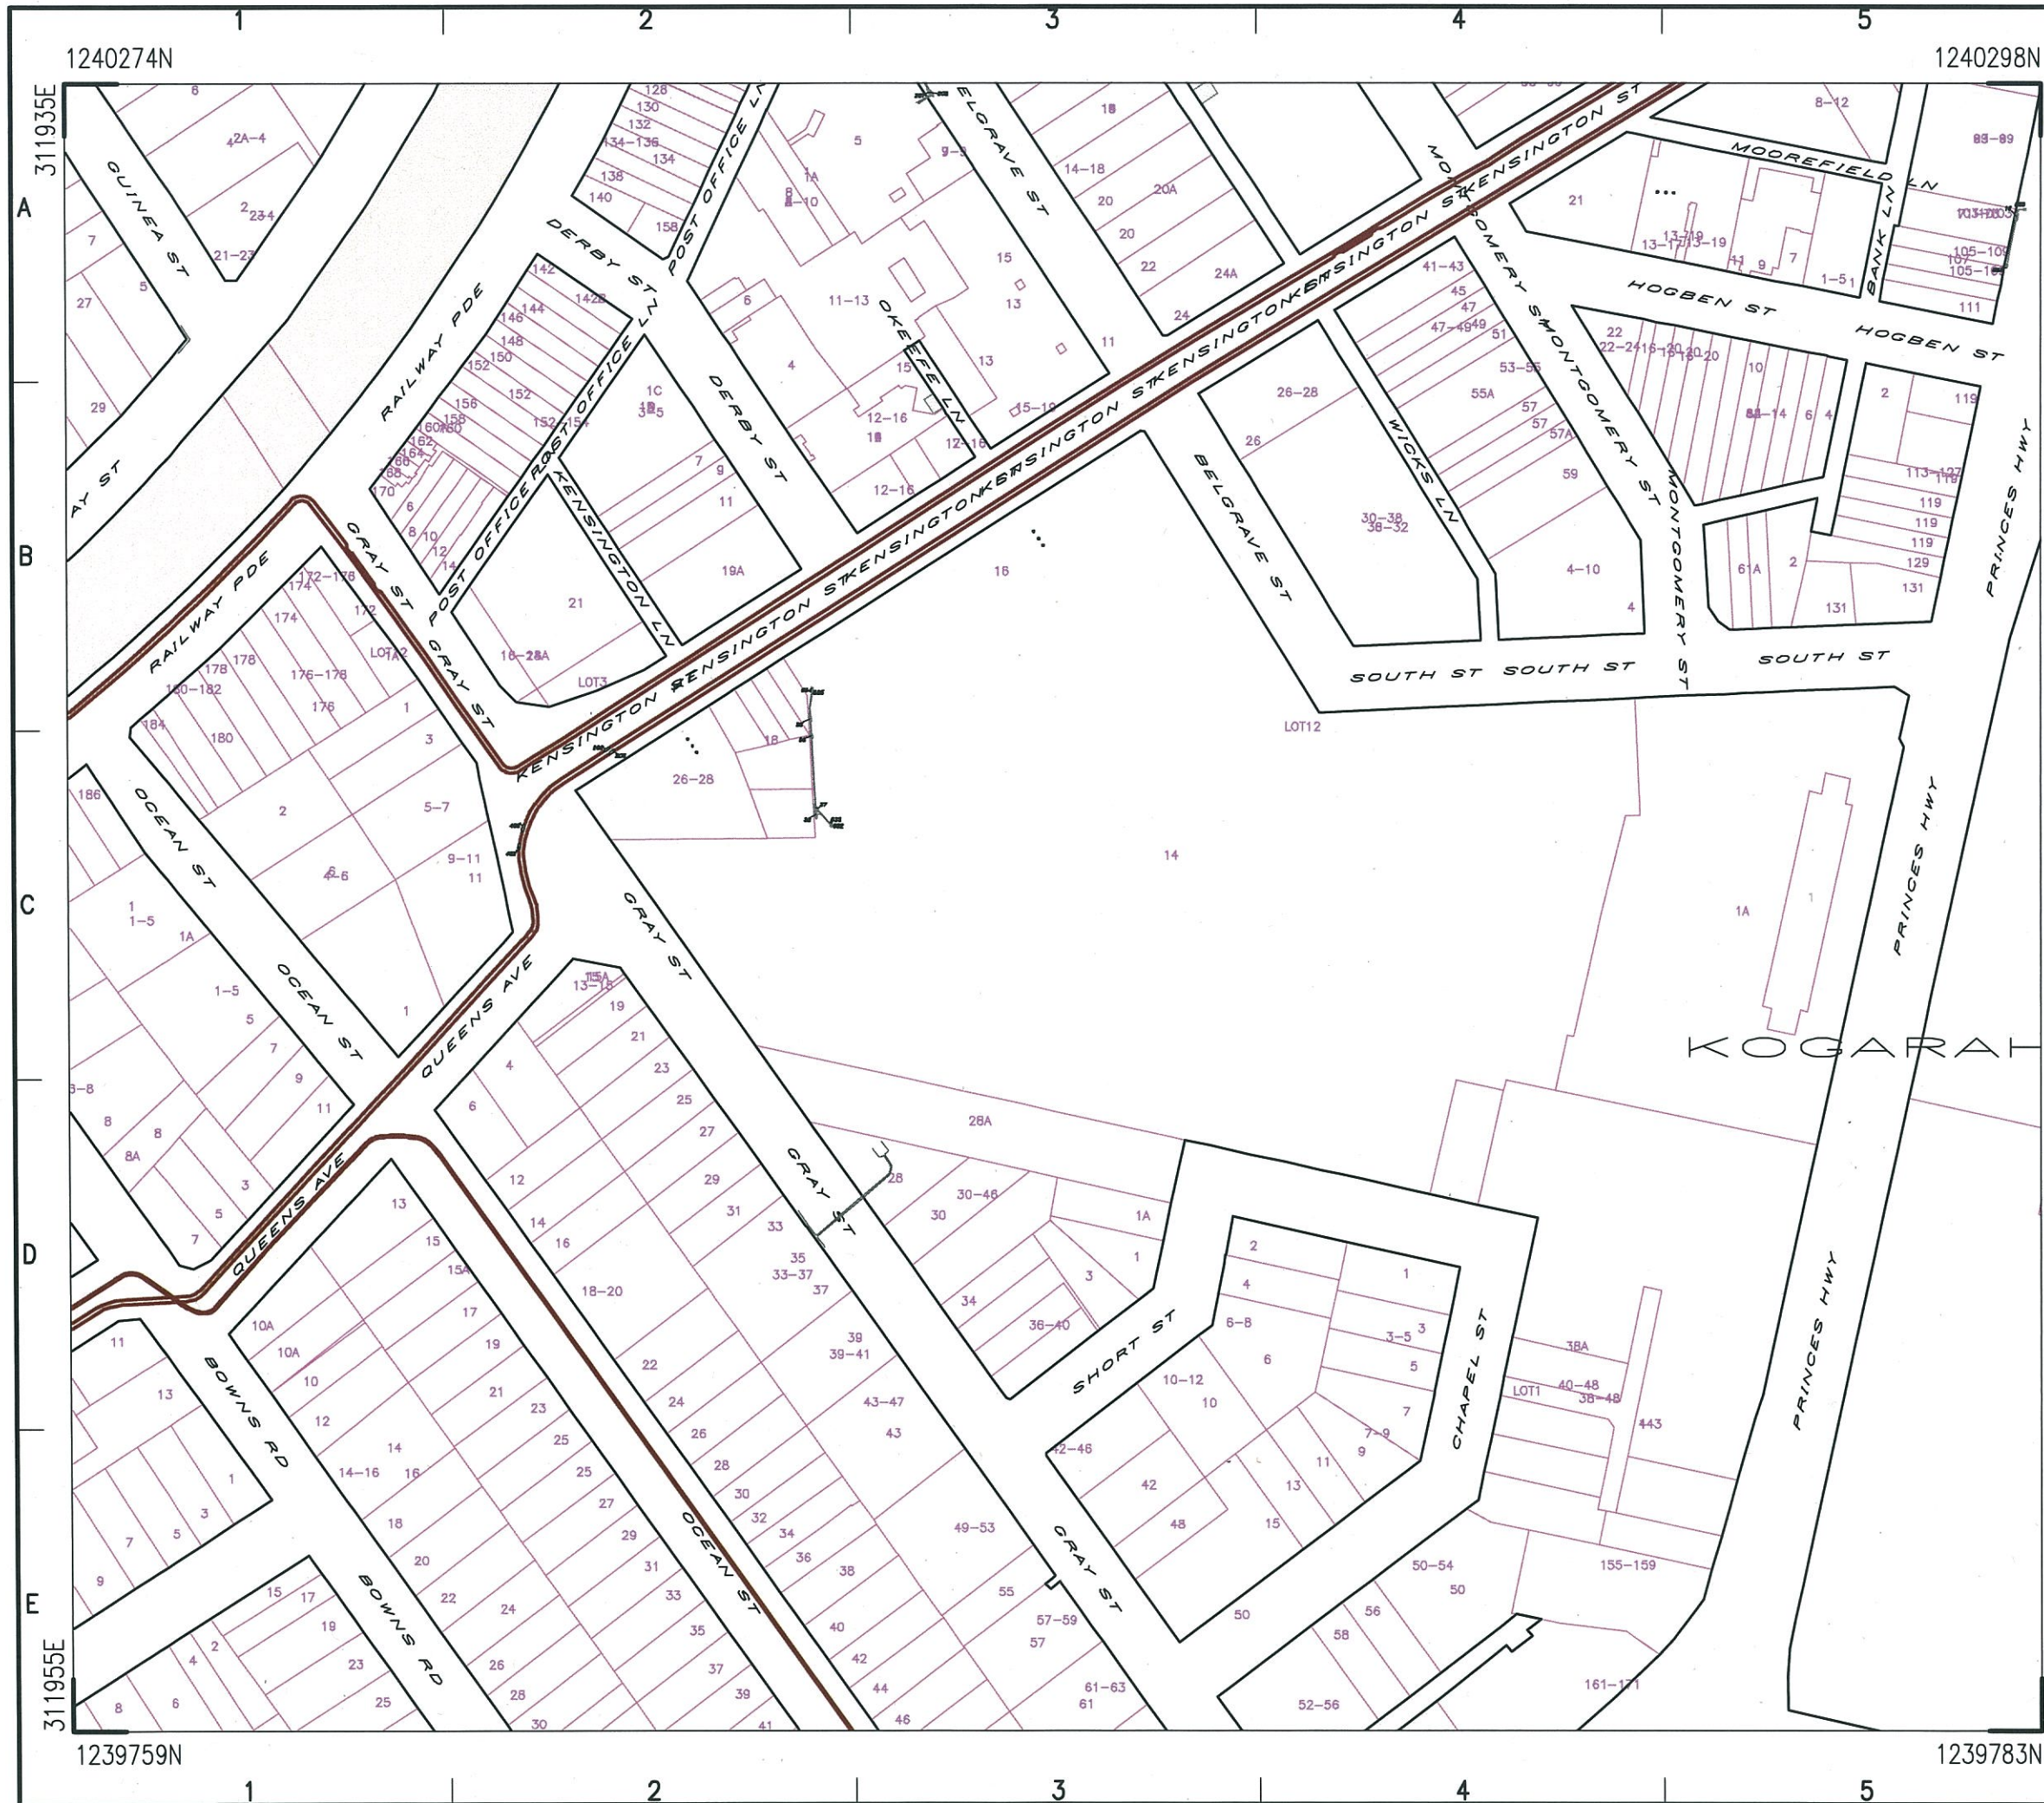

LEGEND

- HV Joint 33kV Straight
- HV Joint Abandoned
- HV Termination Abandoned
- Abandoned UG Cable
- HV UG Cable 132kV Transmission
- HV UG Cable 33kV Transmission
- miscellaneous
- Easement
- Land Parcel

K04442	K05331	K05332
K04444	K05333	K05334
K07222	K08111	K08112

N

1:2000	10 Aug 2015
--------	-------------

UNCONTROLLED COPY