


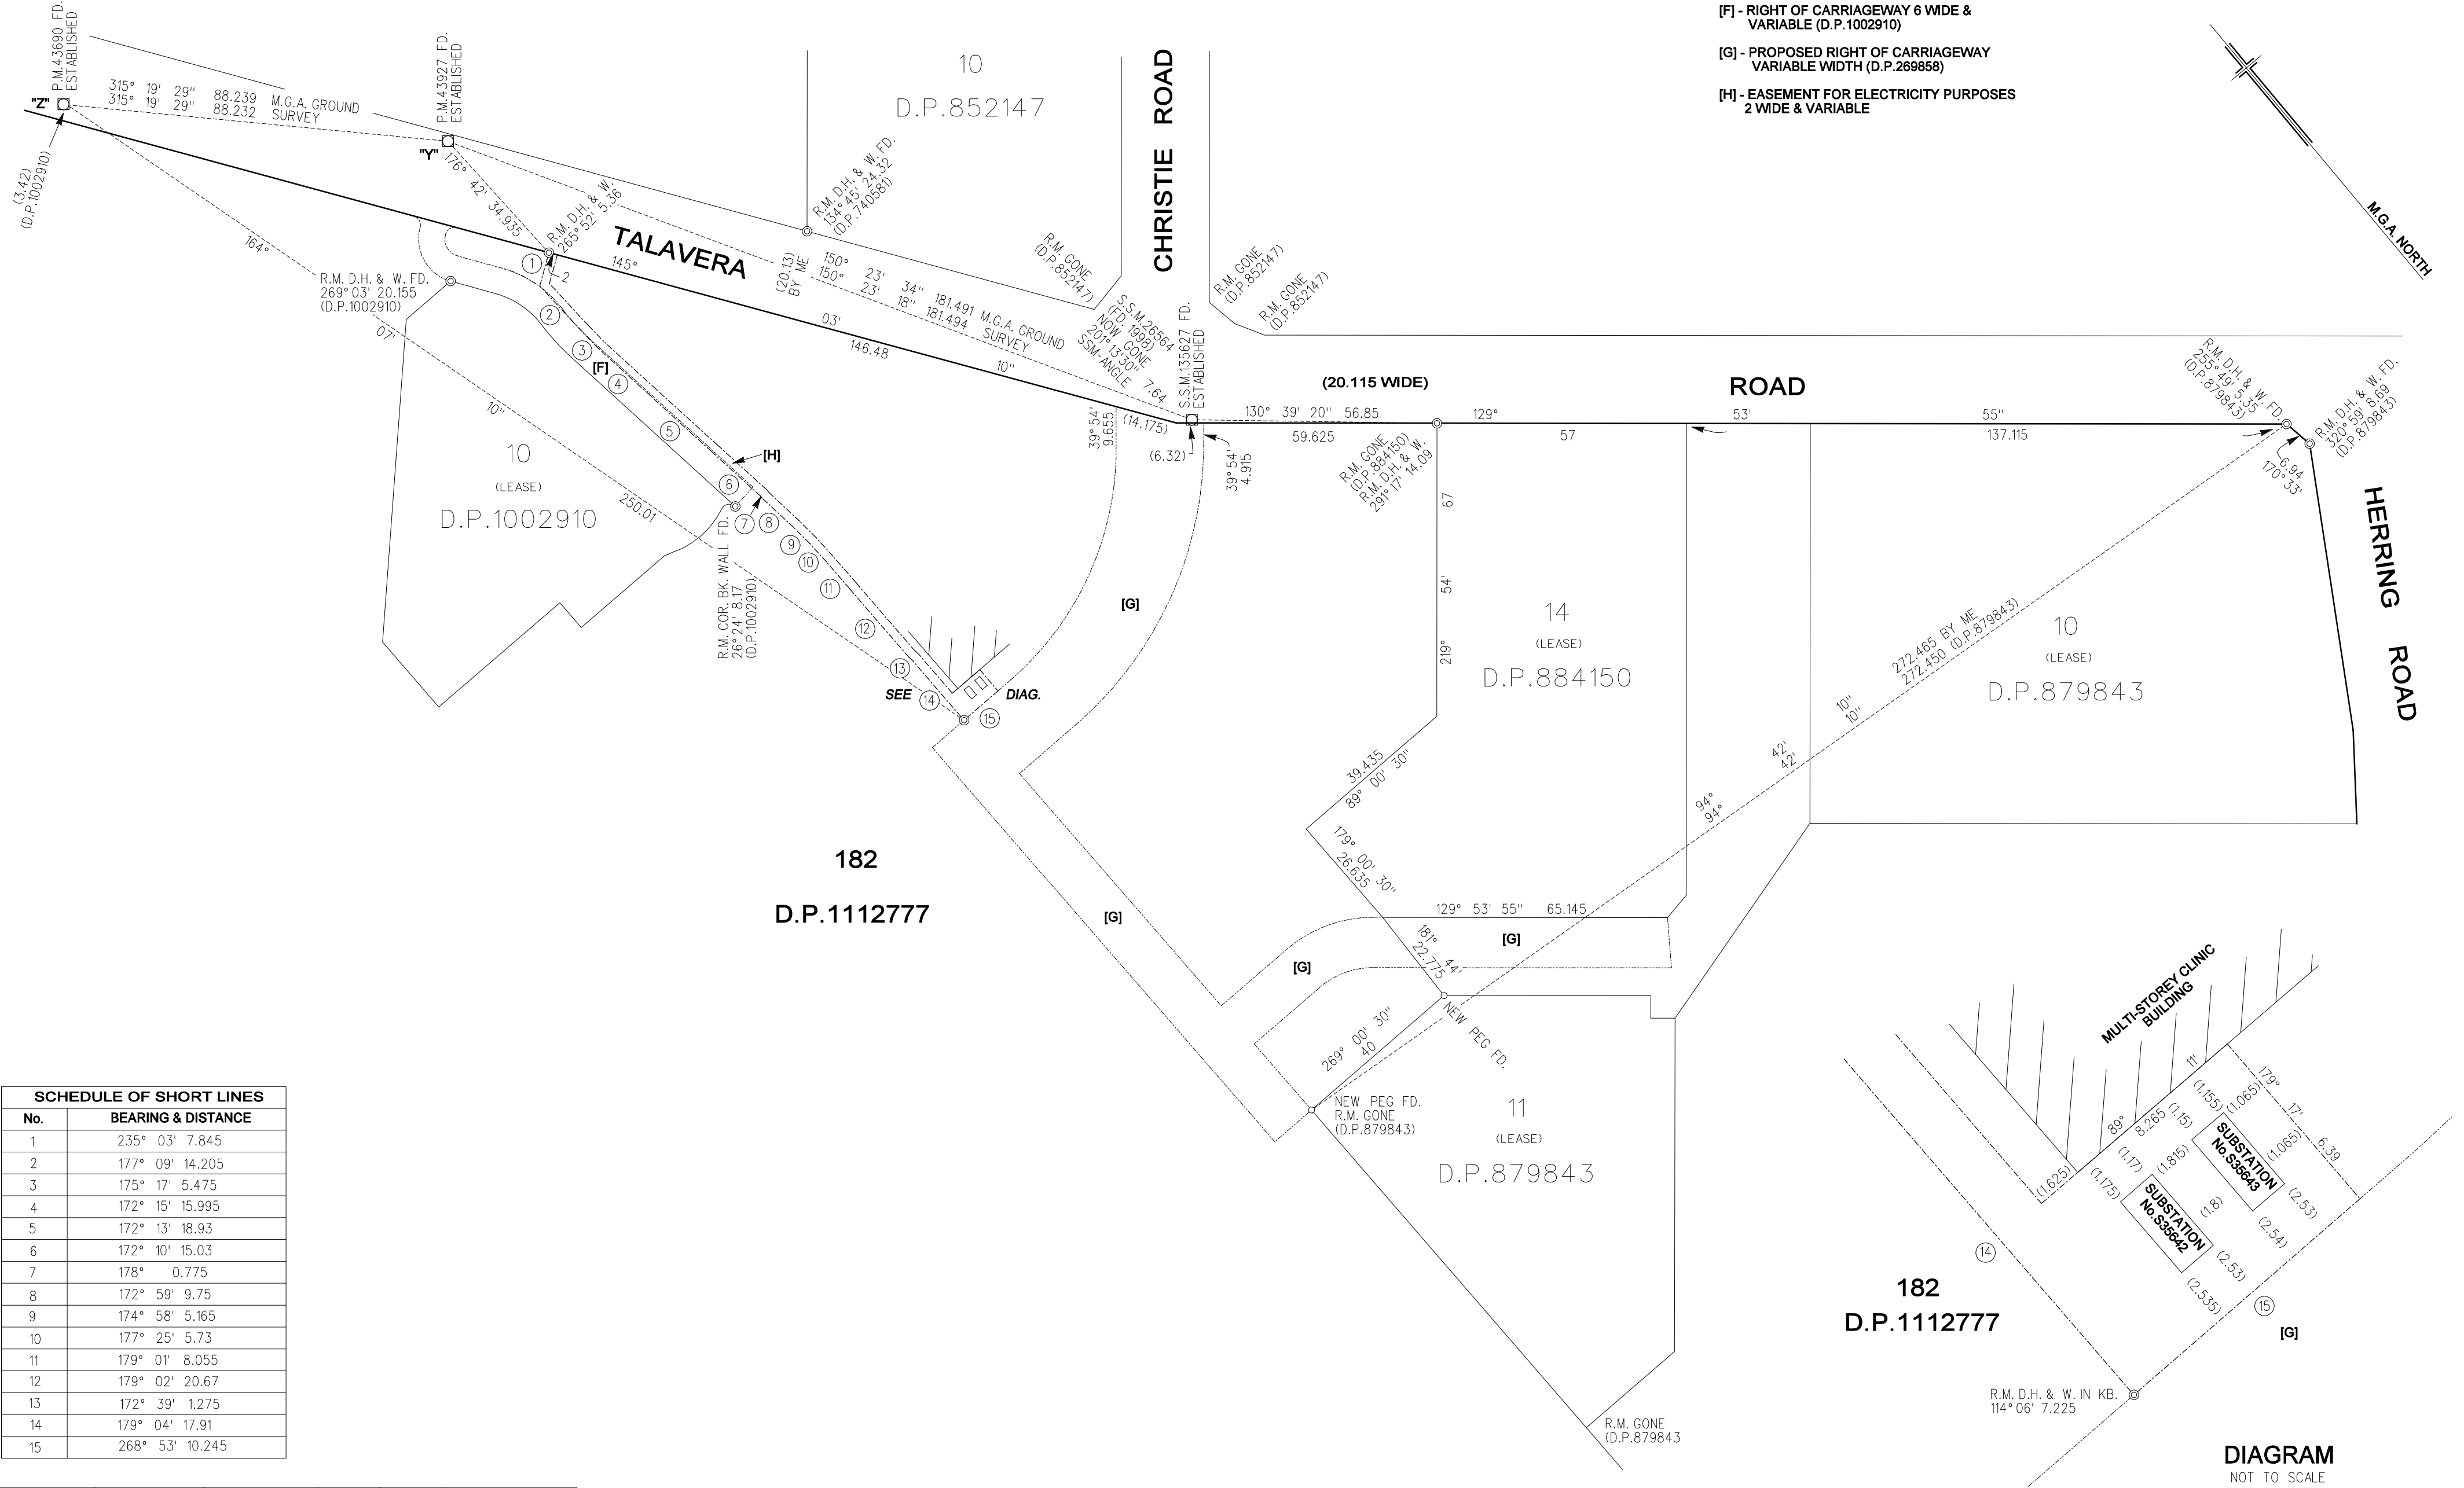

SCHEDULE OF SHORT LINES	
No.	BEARING & DISTANCE
1	235° 03' 7.845
2	177° 09' 14.205
3	175° 17' 5.475
4	172° 15' 15.995
5	172° 13' 18.93
6	172° 10' 15.03
7	178° 0' 0.775
8	172° 59' 9.75
9	174° 58' 5.165
10	177° 25' 5.73
11	179° 01' 8.055
12	179° 02' 20.67
13	172° 39' 1.275
14	179° 04' 17.91
15	268° 53' 10.245

MARK	EASTING	NORTHING	CLASS	ORDER	METHOD	ORIGIN
P.M.43690	325 608.495	6 261 612.594	B	2	-	S.C.I.M.S
P.M.43927	325 670.533	6 261 549.849	B	2	-	S.C.I.M.S
S.S.M.135627	325 760.196	6 261 392.060	C	4	-	S.C.I.M.S
M.G.A. CO-ORDINATES ADOPTED FROM S.C.I.M.S. AS AT 11TH FEBRUSRAY, 2009. COMBINED SCALE FACTOR = 0.999966 ZONE : 56						

Surveyor : PETER RAYMOND SALMON Date of Survey : Surveyor's Ref : 73614 CHECKLIST	PLAN OF EASEMENT FOR ELECTRICITY PURPOSES 2 WIDE & VARIABLE WITHIN LOT 182 D.P.1112777	LGA: RYDE Locality : MACQUARIE PARK Subdivision No: Lengths are in metres. Reduction Ratio 1:1000	Registered	DP DRAFT 170309
---	--	--	------------	-----------------

00	10	20	30	40	50	Table of mm	90	100	110	120	130	140
----	----	----	----	----	----	-------------	----	-----	-----	-----	-----	-----