





N.T.S

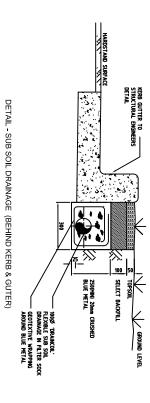


NOTE
ALL SUB SOIL DRAINAGE IS TO HAVE A MINIMUM GRADIENT OF 1:200 (0.5%)


DETAIL - SUB SOIL DRAINAGE (BEHIND RETAINING WALL)

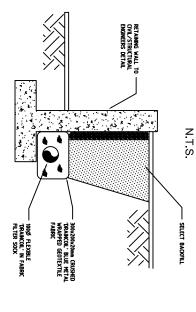


SECTION THROUGH DISH DRAIN AT SWP
AT LANDSCAPE AREA ADJACENT NEW STORE/AMENITIES BUILDING



SECTION THROUGH DISH DRAIN
AT LANDSCAPE AREA ADJACENT NEW STORE/AMENITIES BUILDING
N.T.S.



SECTION THROUGH DISH DRAIN AT SWP AT ADMINISTRATION BUILDING




BYPASS CHAMBER CONVERTER SLAB

600 × 600mm CLASS D GALVANIZED FRAME & GRATE/

PLAN VIEW

 NOTE: COVER TO ALIGN WITH FINISHED GROUND LEVEL

SECTION THROUGH DISH DRAIN AT ADMINISTRATION BUILDING N.T.S.



DECANT PIPE

 $(\Phi)$ 

ושדננד

OIL SAMPLE PORT

DECANT PIPE

