


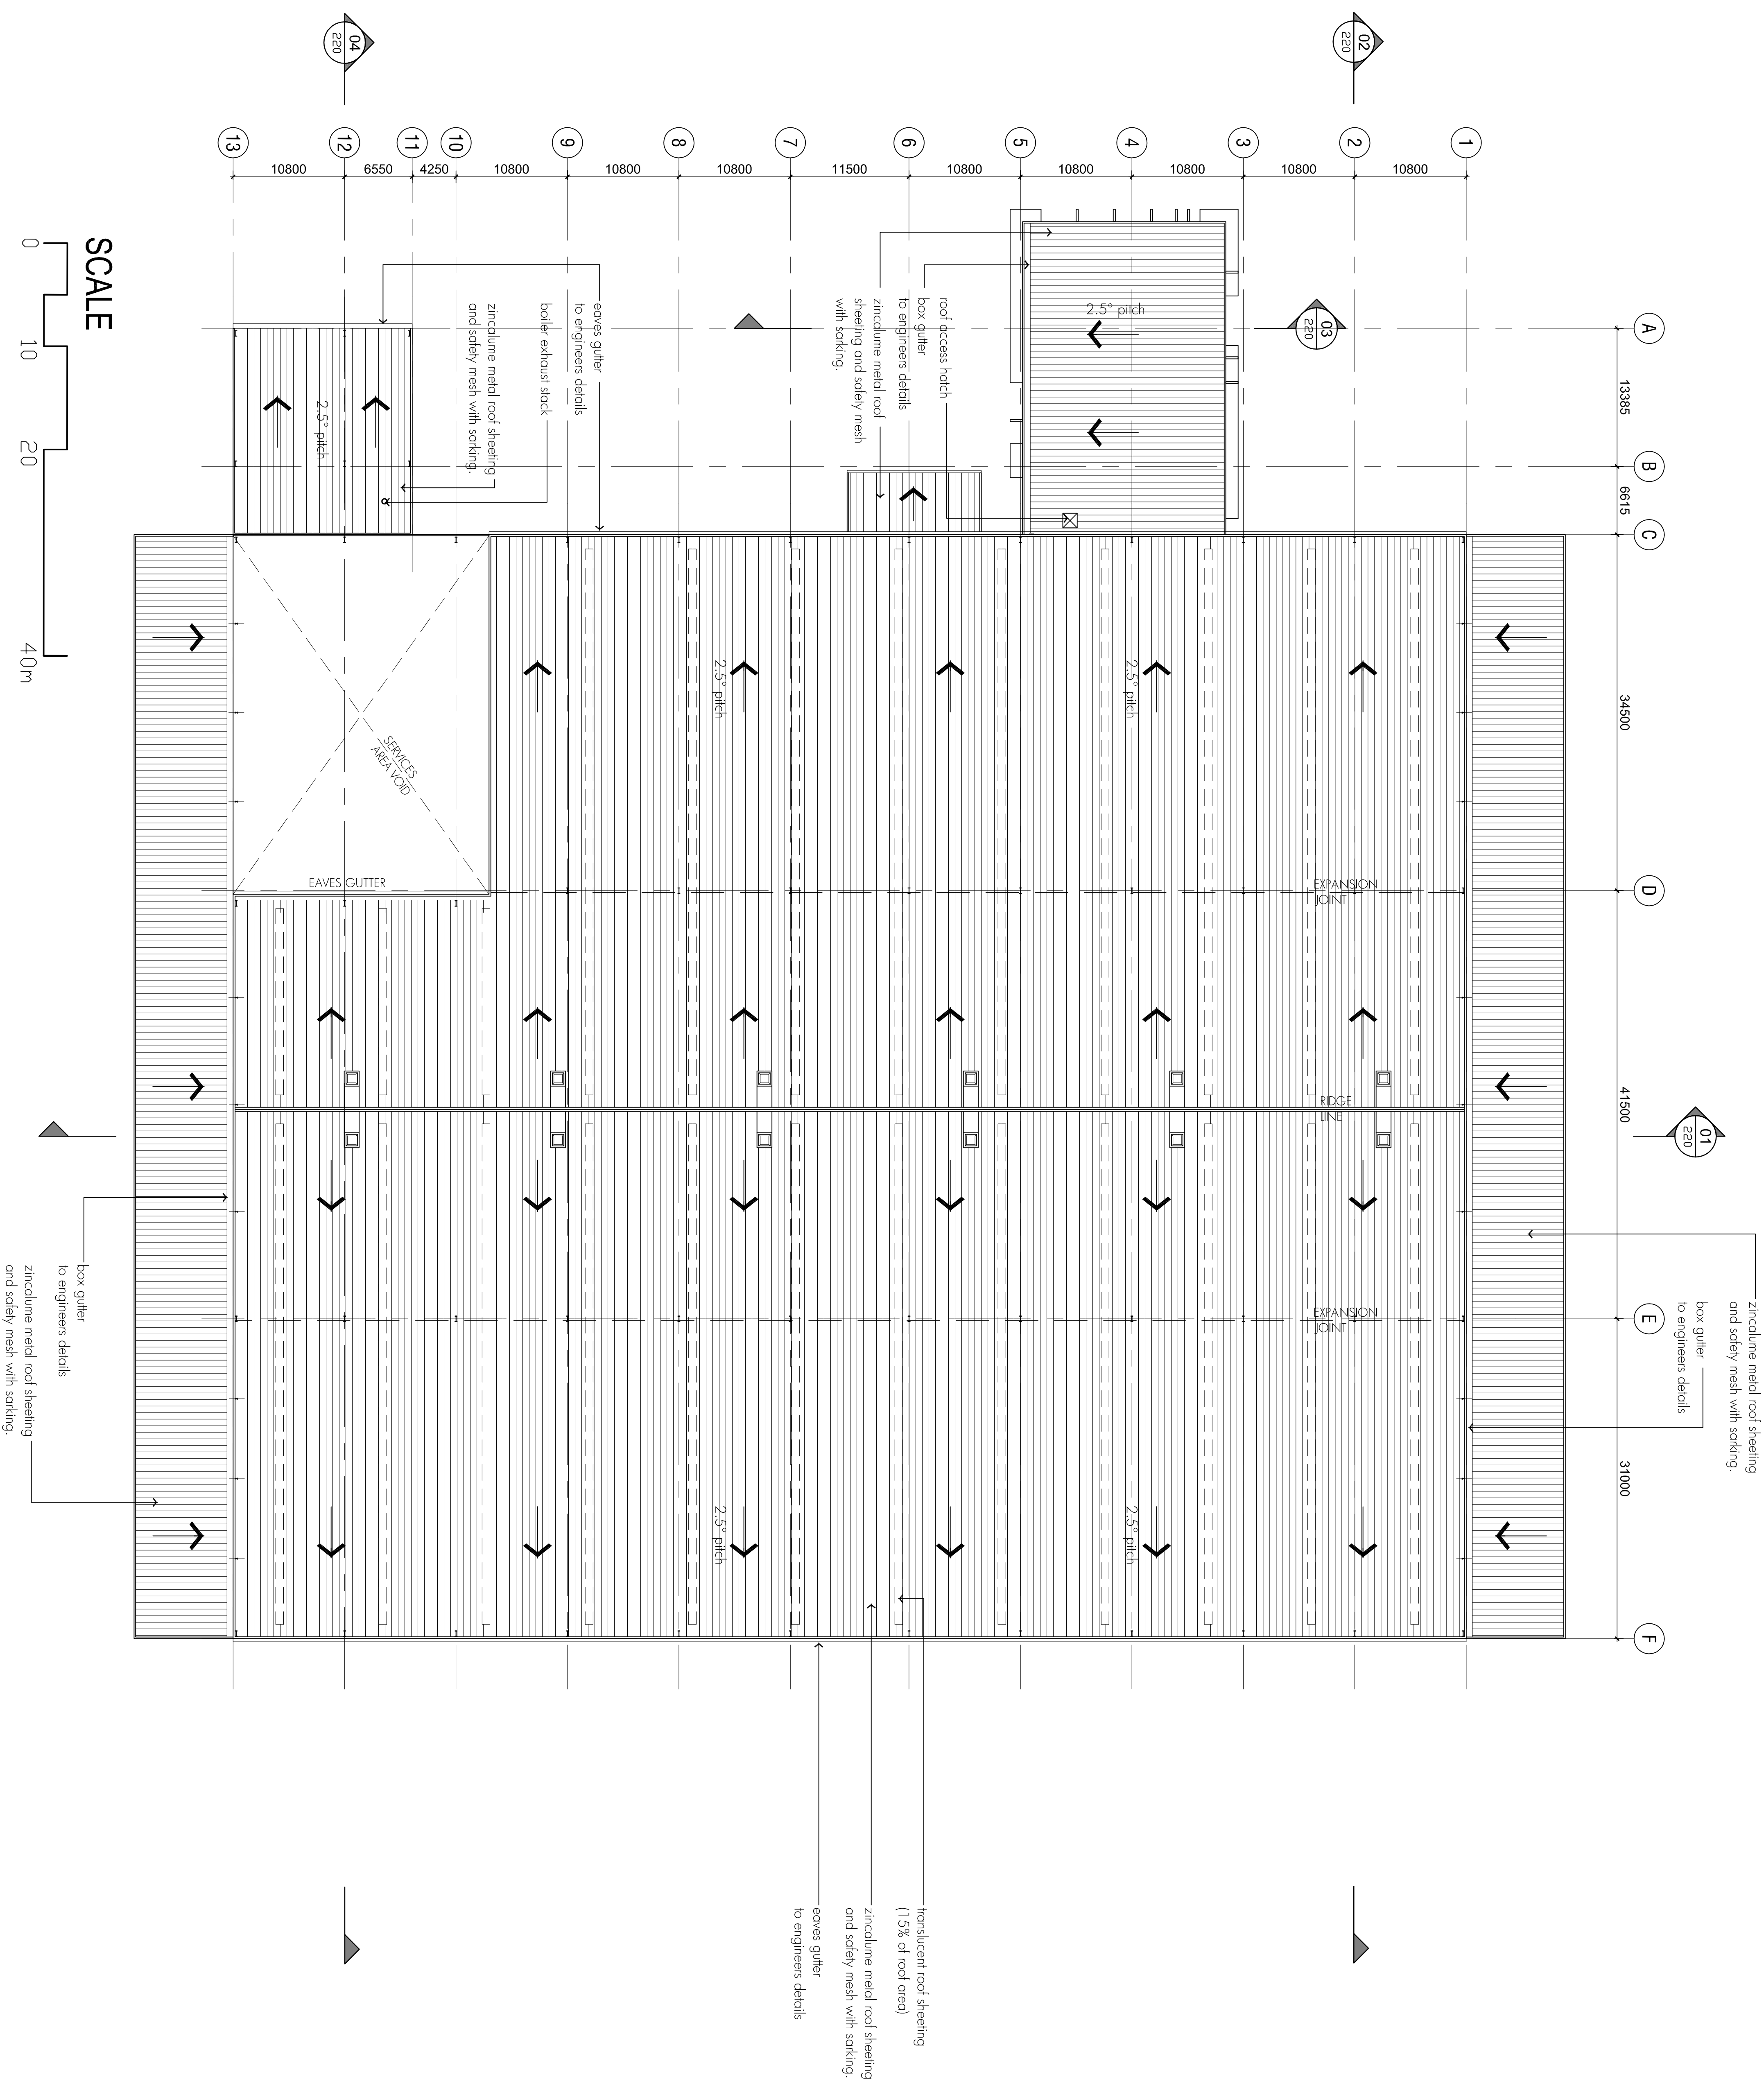

NOTE:

Air ventilation system are indicative only, to be confirmed by Hansen Yuckten / mechanical HVAC consultant.

Roof eaves & box gutters are indicative only, to be confirmed by Hansen Yuckten / hydraulic consultant.

Boiler exhaust stack is indicative, to be confirmed by Goodman Fielder / ESO (process consultant).

No 145 DA NOT FOR EXAMINATION. DIMENSIONS ARE TO BE DIMENSIONED IN REFERENCE TO SQUARE DIMENSIONS WITH ALL ELEMENTS & DIMENSIONS TO A LOCAL CONVENTION OF DIMENSIONS. CONVENTION OF DIMENSIONS: ALL DIMENSIONS ARE TO CONFORM TO IS THE PROPERTY OF THE AUTHOR. INSTRUCTIONS NOT AUTHORITY OF SPREAD DESIGN PTY LTD.		Revision 1 A 25/03/2018 DA PRELIMINARY ISSUED B 10/04/2018 ISSUED FOR DA SUBMISSION		Structural Consultant Hydraulic Consultant Landscape Consultant Mechanical Consultant		Refined Consultant Builder: hansen yuncken Building Value Hansen Yuncken Pty Ltd Level 4, Freeway Avenue Melbourne NSW 2015 Phone: (02) 9770 7001 Fax: (02) 9770 7001		Site 605 14/60 Street Sharing NSW 2000 Phone: (02) 9207 2717 email: contact@spreadesign.com.au		Project GOODMAN FIELDER SITE E, TEMPLAR ROAD, ERSKINE PARK DEVELOPMENT APPLICATION ROOF PLAN		Scale: AS SHOWN 25 MARCH 2008 Drawing No: GF-TE-DA-120 08000		Client: AS SHOWN Drawing No: AMV Status: B	
Sheet Size: B1								SPREAD DESIGN Pty Ltd ABN 53 226 266 500		GPT The GPT Group					