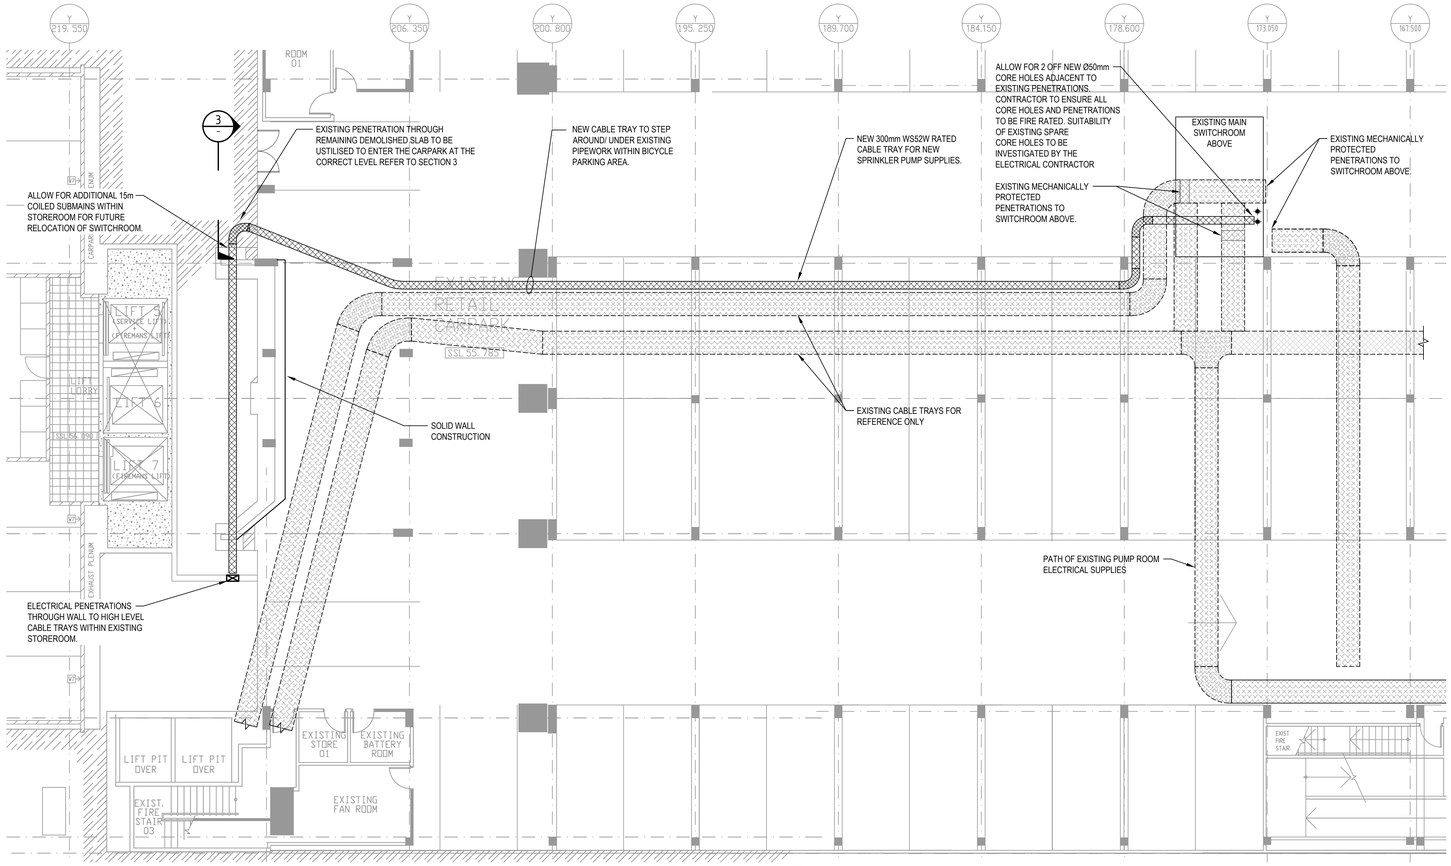

CABLE TRAY LAYOUT
1:100

POWER NOTES:

1. MAXIMUM FINAL SUBCIRCUIT LENGTH SHALL BE IN ACCORDANCE WITH AS3000 TABLE B5.1 FOR TYPE C MCB'S. TYPICALLY ACTIVE 2.5mm², EARTH 2.5mm², 20A 68m.
2. MAXIMUM FINAL SUBCIRCUIT VOLTAGE DROP SHALL NOT EXCEED 2.5%
3. ALL WALL PENETRATIONS REQUIRED BY ELECTRICAL SERVICES MUST BE REINSTATED/PATCHED FILLED WITH FIRE RATING MATERIAL
4. CABLE TRAY/LADDER ROUTE INDICATIVE ONLY. CONTRACTOR TO ALLOW FOR SET-DOWNS, SET-UPS, BENDS, SUPPORTS, TEE-OFFS AND FINAL CIRCUIT CONCEALED CONDUITS. TO MAKE A COMPLETE WORKING SOLUTION.
5. CORE HOLE POSITION INDICATIVE ONLY. CONTRACTOR TO ALLOW FOR SCANNING SLAB TO ENSURE STRUCTURAL TENDONS ARE NOT COMPROMISED.
6. SAFETY CONSIDERATIONS TO BE MADE WHERE ACCESS REQUIRED TO OPEN VOID. ALLOW FOR SCAFFOLD/SAFETY FENCE TO MITIGATE RISKS ASSOCIATED WITH THESE WORKS.

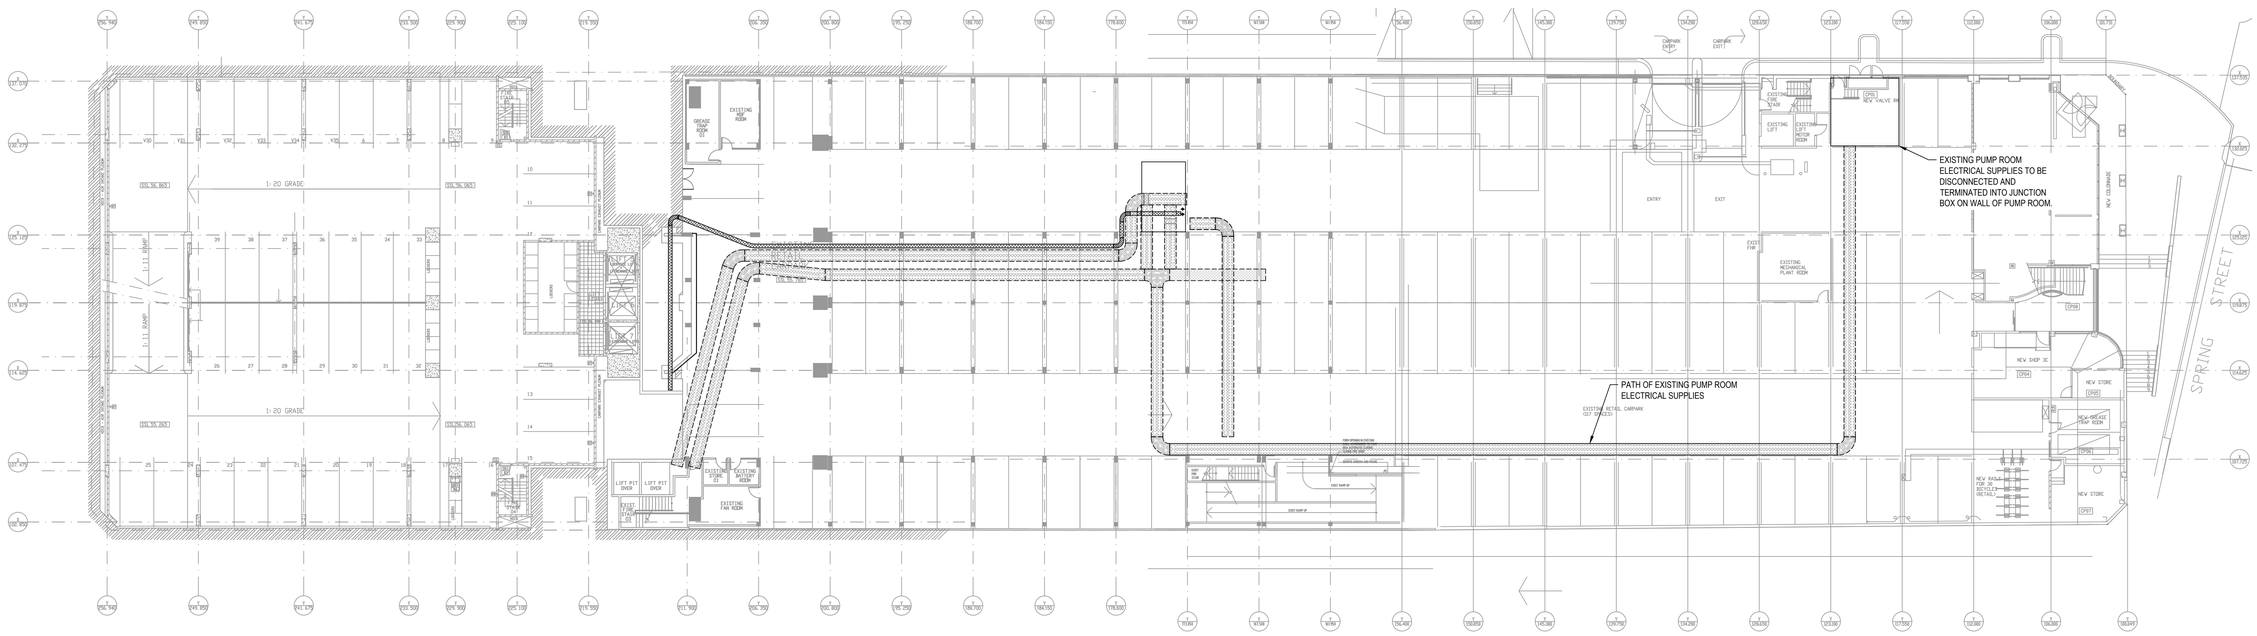

SITE PLAN
1:200

aurecon
www.aurecongroup.com

CLIENT
1 DENISON STREET HOLDINGS PTY LTD

REV	DATE	REVISION DETAILS	APP
2	10.02.14	REVISED TENDER ISSUE	NK
1	24.01.14	CONSTRUCTION ISSUE	NK
B	10.12.13	REVISED ISSUE FOR TENDER	NK
A	03.12.13	ISSUED FOR TENDER REVIEW	NK

DRAWN	DESIGNED
M.BORDER	D.CHECCHIN

CHECKED: M.MAGRAITH

APPROVED: *NENO KEVIC* DATE *10.12.13*
N.KEVIC

PROJECT
77-81 BERRY STREET, NORTH SYDNEY
RELOCATION OF SHARED FACILITIES

TITLE
ELECTRICAL SERVICES
BASEMENT LEVEL B3

TENDER
NOT FOR CONSTRUCTION

PROJECT No. 234976

SCALE	SIZE
1:100 @ B1	B1

DRAWING No.	REV
DW-EW-E-10103	2

Cad File: P:\BO\234976\CAD\DWGS\ELC\DW-EW-E-10103.dwg | Plot Date: 24-Jan-2014 - 04:57pm | Plot By: jchin.dam | Xrefs: 234976-XR-B1RVS basement3