



LEVEL 3

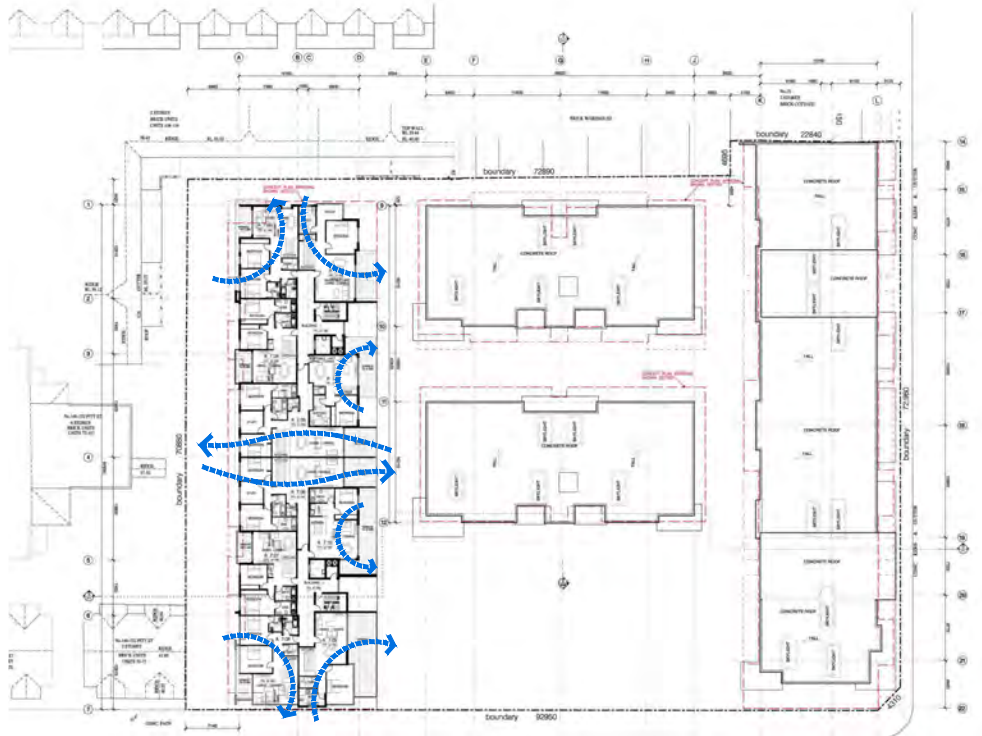

LEVEL 5

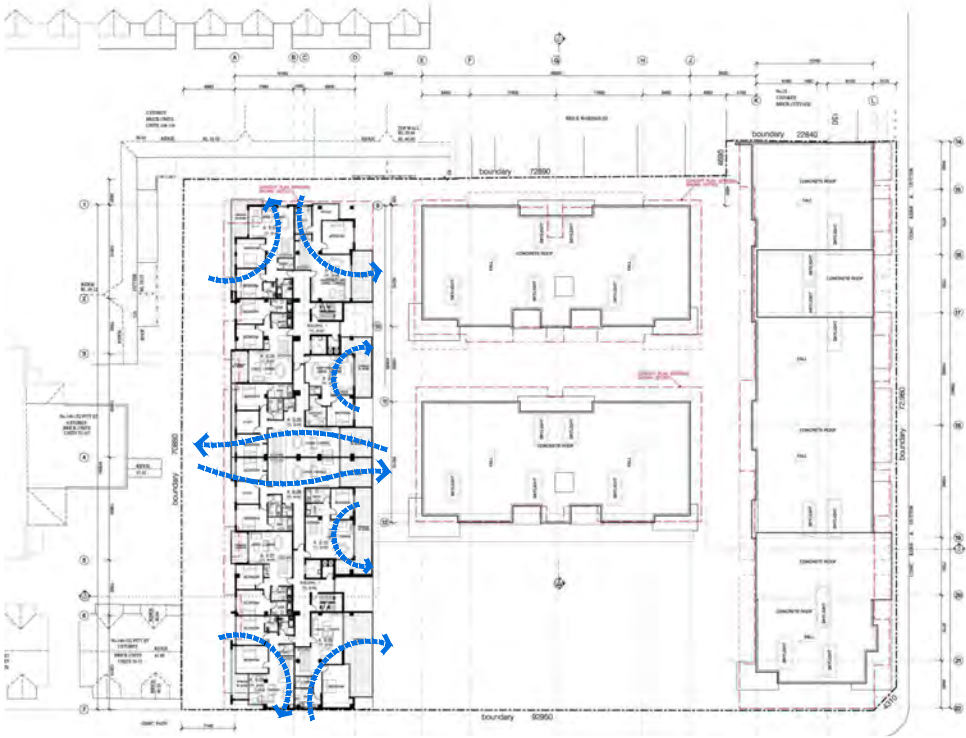

LEVEL 4

CROSS VENTILATION:
SEPP65 Requirement: 60% cross ventilated (95 UNITS)

	TOTAL UNITS	COMPLIANT	%	✗
TOTAL DEVELOPMENT	158	88	55.7%	
BUILDING A	TOTAL UNITS	COMPLIANT	%	✓
	67	54	80.6%	
BUILDING B	TOTAL UNITS	COMPLIANT	%	✗
	24	8	33.3%	
BUILDING C	TOTAL UNITS	COMPLIANT	%	✗
	22	8	36.4%	
BUILDING D	TOTAL UNITS	COMPLIANT	%	✗
	45	18	40.0%	

VENTILATION DIAGRAM - APPROVED PROJECT