


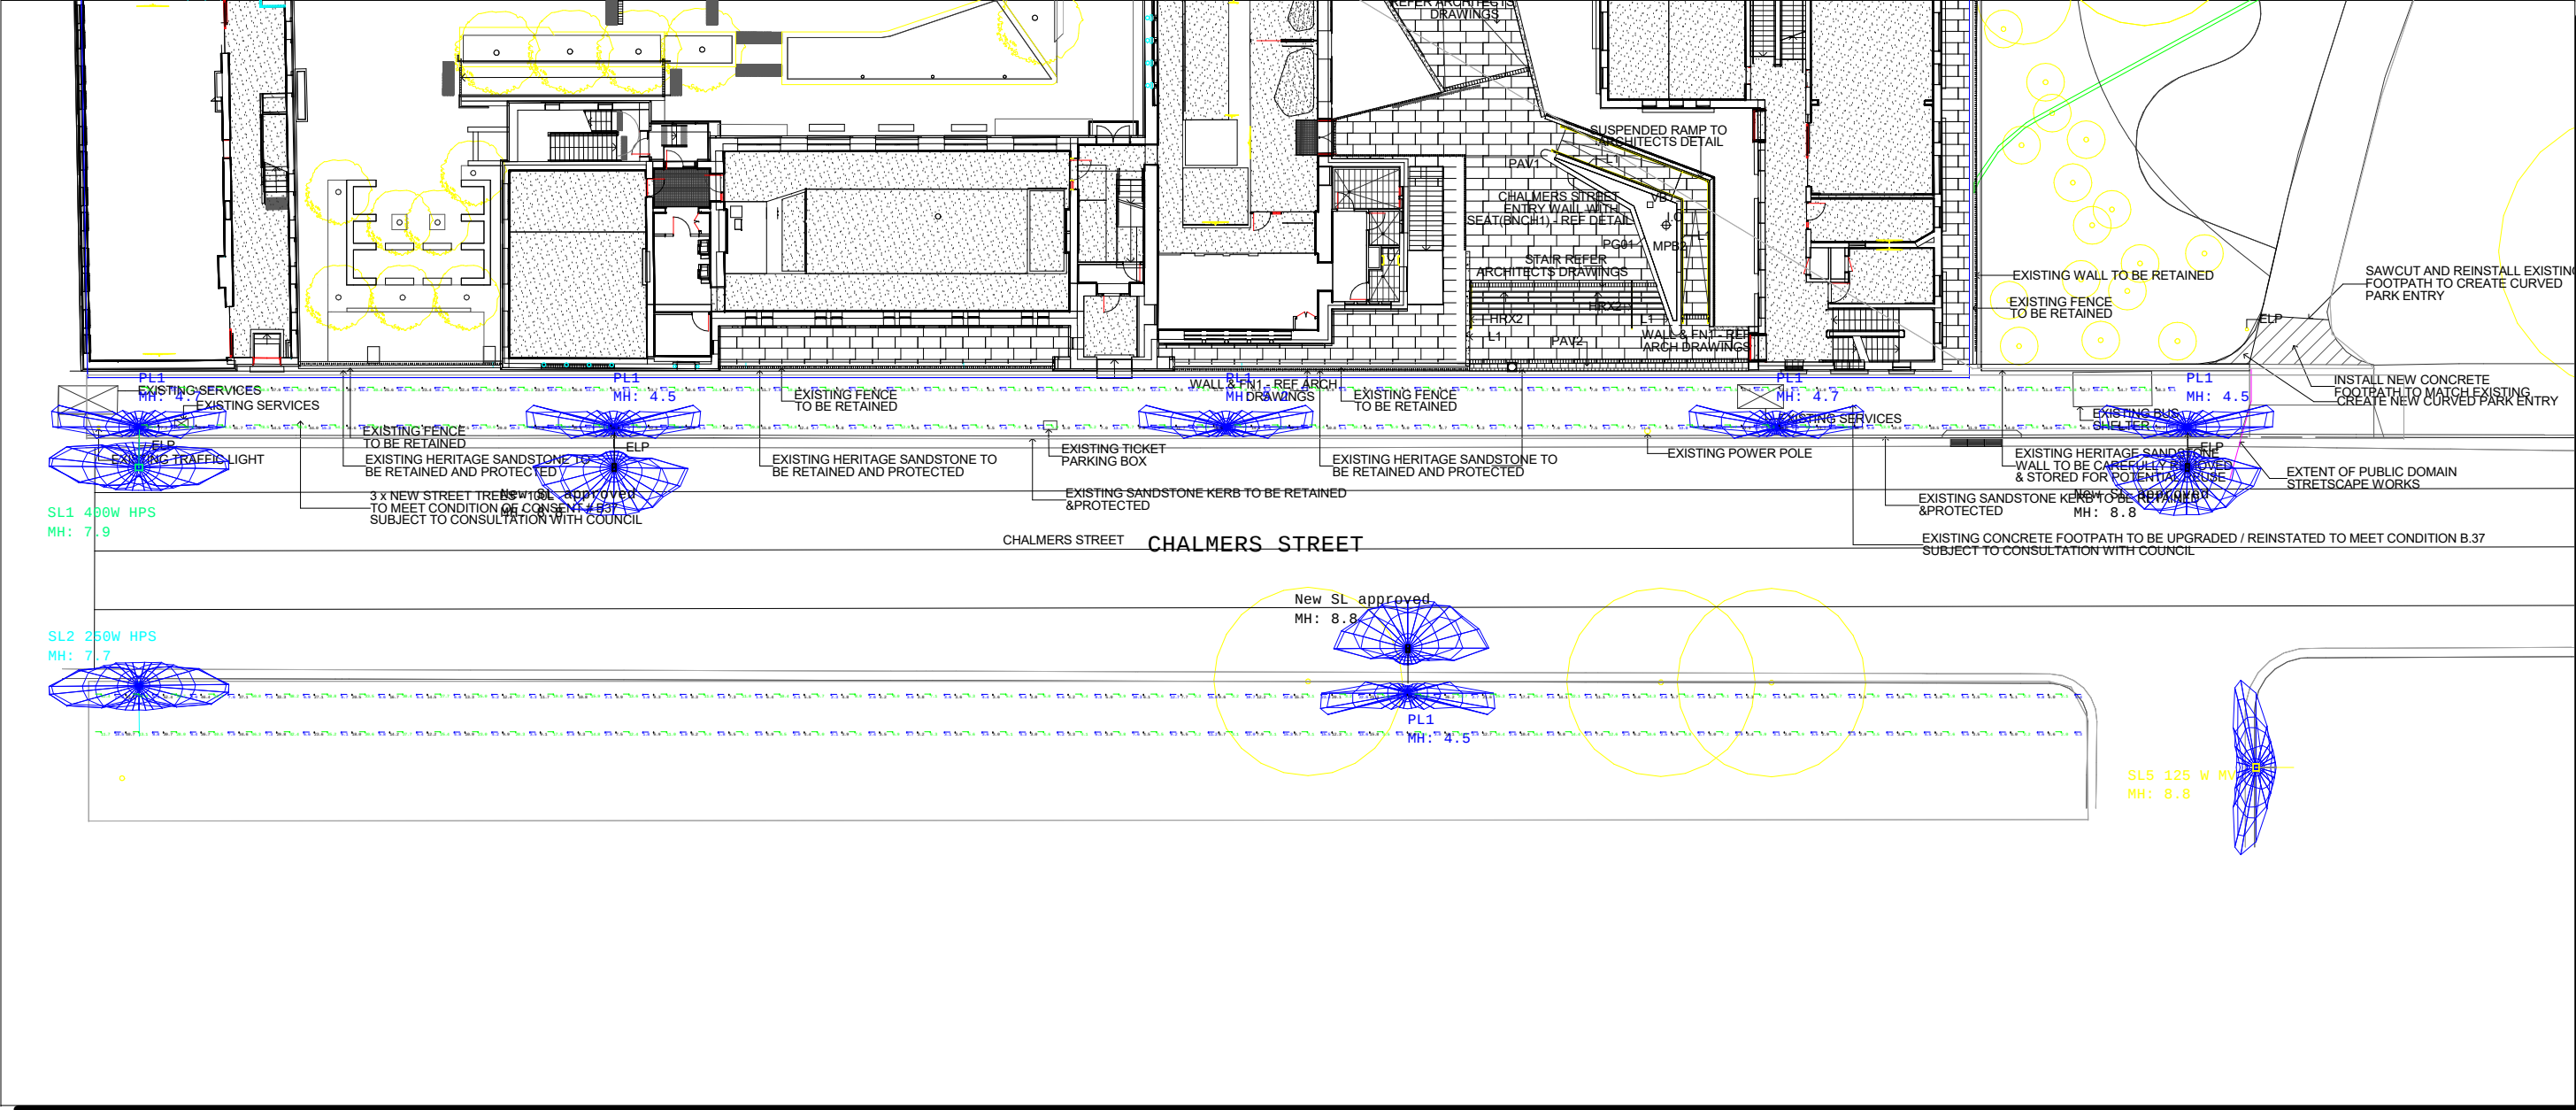

Luminaire Schedule				
Symbol	Qty	LLF	Tag	Description
	1	0.600	SL1 400W HPS	2m outreach
	2	0.600	SL3 400W MV	1.85M OR
	5	0.600	SL2 250W HPS	2.7 OR
	1	0.600	SL5 125 W MV	2m OR
	6	0.609	PL1	StreetLED2 4000K 14W AERO
	3	0.700	New SL approved	V162100WT3N7PBP
	1	0.750	New SL approved	V162200WT3N7PBP
	13	0.750	SL8	ECLATEC

Calculation Summary						
Label	CalcType	Units	Avg	Max	Min	Max/Avg
ISHS Chalmers Street Path H	Illuminance	Lux	17.77	77.2	5.1	4.34
ISHS Chalmers Street Path V1	Illuminance	Lux	11.19	29.3	3.1	2.62
ISHS Chalmers Street Path V2	Illuminance	Lux	18.13	78.5	4.0	4.33
ISHS opposite side of Chalmers H	Illuminance	Lux	11.86	53.4	2.9	4.50
ISHS Opposite Side of Chalmer V2	Illuminance	Lux	6.01	23.4	1.8	3.89
ISHS opposite side of Chalmers V	Illuminance	Lux	13.12	50.8	2.0	3.87

1. THIS SCHEME IS FOR INFORMATION ONLY AND NOT FOR CONSTRUCTION.
2. Values shown are MAINTAINED values and calculated in the nominated planes.