

# HORSLEY LOGISTICS PARK

**SSD 10436**

**Section 4.55 Modification MOD3  
Operational Noise Impact Assessment**

**Prepared for:**

ESR  
Level 29  
20 Bond Street  
Sydney

SLR Ref: 610.19360-R09  
Version No: -v1.2  
November 2021



## PREPARED BY

SLR Consulting Australia Pty Ltd  
ABN 29 001 584 612  
Tenancy 202 Submarine School, Sub Base Platypus, 120 High Street  
North Sydney NSW 2060 Australia

T: +61 2 9427 8100  
E: sydney@slrconsulting.com www.slrconsulting.com

## BASIS OF REPORT

This report has been prepared by SLR Consulting Australia Pty Ltd (SLR) with all reasonable skill, care and diligence, and taking account of the timescale and resources allocated to it by agreement with ESR (the Client). Information reported herein is based on the interpretation of data collected, which has been accepted in good faith as being accurate and valid.

This report is for the exclusive use of the Client. No warranties or guarantees are expressed or should be inferred by any third parties. This report may not be relied upon by other parties without written consent from SLR.

SLR disclaims any responsibility to the Client and others in respect of any matters outside the agreed scope of the work.

## DOCUMENT CONTROL

Reference	Date	Prepared	Checked	Authorised
610.19360-R09-v1.2	3 November 2021	Mark Irish	John Sleeman	Mark Irish
610.19360-R09-v1.1	2 November 2021	Mark Irish	John Sleeman	Mark Irish
610.19360-R09-v1.0	8 October 2021	Mark Irish	John Sleeman	Mark Irish
610.19360-R09-v0.1	6 October 2021	Mark Irish	John Sleeman	

## EXECUTIVE SUMMARY

An operational noise impact assessment has been conducted for the Lot 201 Warehouse 2A & 2B design of the Horsley Logistics Park (HLP). The proposed modification includes specification of external mechanical plant and operational vehicle numbers for the operation of Lot 201 Warehouse 2A & 2B to reflect the needs of UPS, the future operator of the site.

### Operational Noise Impacts

An analysis of the prevailing weather conditions for the HLP indicated that adverse weather is a feature of the area only during the night-time period.

The operational noise modelling of the Modification 3 Application Masterplan found no exceedances of the Operational Noise Limits at any sensitive receivers under both neutral (day, evening periods) and adverse (night period) weather conditions. Compliance with the sleep disturbance screening criterion in each catchment is also predicted.

### Noise Mitigation Measures

The assessment concluded the following noise mitigation measures associated with Lot 201 Warehouse 2A & 2B are required:

- Two-sided screening to five rooftop packaged units, minimum enclosure height 1.0m above top of unit height.

### Comparison with Approved Development

The operational noise impacts at the identified residential receivers are generally predicted to be consistent with the Modification 1 Application Masterplan.

## CONTENTS

<b>1</b>	<b>INTRODUCTION .....</b>	<b>6</b>
1.1	MOD1 Approved Development .....	6
1.2	Section 4.55 Modification (MOD3) .....	8
<b>2</b>	<b>OPERATIONAL NOISE LIMITS .....</b>	<b>8</b>
<b>3</b>	<b>PREVAILING WEATHER CONDITIONS .....</b>	<b>8</b>
<b>4</b>	<b>OPERATIONAL NOISE IMPACT ASSESSMENT .....</b>	<b>9</b>
4.1	Operational Noise Modelling.....	9
4.1.1	Lot 201 Warehouse 2A & 2B Vehicle Numbers.....	9
4.1.2	Area Sources .....	11
4.1.3	External Point Sources .....	12
4.1.4	Nearest Sensitive Receivers.....	13
4.2	Predicted Operational Noise Impacts .....	14
4.3	Noise Mitigation Measures .....	17
4.4	Discussion of Noise Impacts .....	17
4.5	Comparison with Approved MOD1 Development Impacts .....	18
<b>5</b>	<b>CONCLUSION .....</b>	<b>18</b>

## DOCUMENT REFERENCES

### TABLES

Table 1	Operational Noise Limits.....	8
Table 2	Supplied Heavy Vehicle Volumes for Lot 201 Warehouse 2A & 2B .....	10
Table 3	Lot 201 Daytime Vehicle Movements.....	11
Table 4	Lot 201 Night-time Vehicle Movements .....	11
Table 5	L <sub>Aeq</sub> Sound Power Levels – Area Sources .....	11
Table 6	External Plant Sound Power Levels .....	12
Table 7	L <sub>Amax</sub> Sound Power Levels – Hardstand, Loading Areas and Car Parks .....	13
Table 8	Predicted Operational Noise Levels – MOD3 Masterplan .....	14

### FIGURES

Figure 1	MOD1 Masterplan .....	7
Figure 2	Lot 201 Warehouse 2A & 2B Site and Facility Plan MOD3.....	8
Figure 3	Lot 201 Warehouse 2A & 2B External Plant Locations .....	12
Figure 4	Predicted Daytime/Evening Noise Levels – MOD3 Masterplan .....	15
Figure 5	Predicted Night-time Noise Levels – MOD3 Masterplan .....	16
Figure 6	Lot 201 Warehouse 2A & 2B Rooftop Plant Screening Locations .....	17

## CONTENTS

### APPENDICES

#### Appendix A      Acoustic Terminology

# 1 Introduction

SLR Consulting Australia Pty Ltd (SLR) has been engaged by ESR to prepare a noise impact assessment for a modification (MOD3) to the Horsley Logistics Park (HLP) Masterplan. This assessment is required to accompany a S4.55 modification (MOD3) of the Development Consent SSD 10436.

The proposed modification includes specification of external mechanical plant and operational vehicle numbers for the operation of Lot 201 Warehouse 2A & 2B to reflect the needs of UPS, the future operator of the site.

The SSDA approved development was assessed in SLR report 610.19360-R02-v2.1 dated 2 November 2020.

The consent was subsequently modified in Modification 1 Application (MOD1), which was assessed in SLR report 610.19360-R06-v0.1 dated 12 April 2021. MOD1 addresses the building form, office fit-out, car parking layout and hardstand arrangements.


This assessment uses specific acoustic terminology. An explanation of common terms is included as **Appendix A**.

## 1.1 MOD1 Approved Development

The location of the approved development and surrounding receivers are shown in **Figure 1**.




**Figure 1 MOD1 Masterplan**

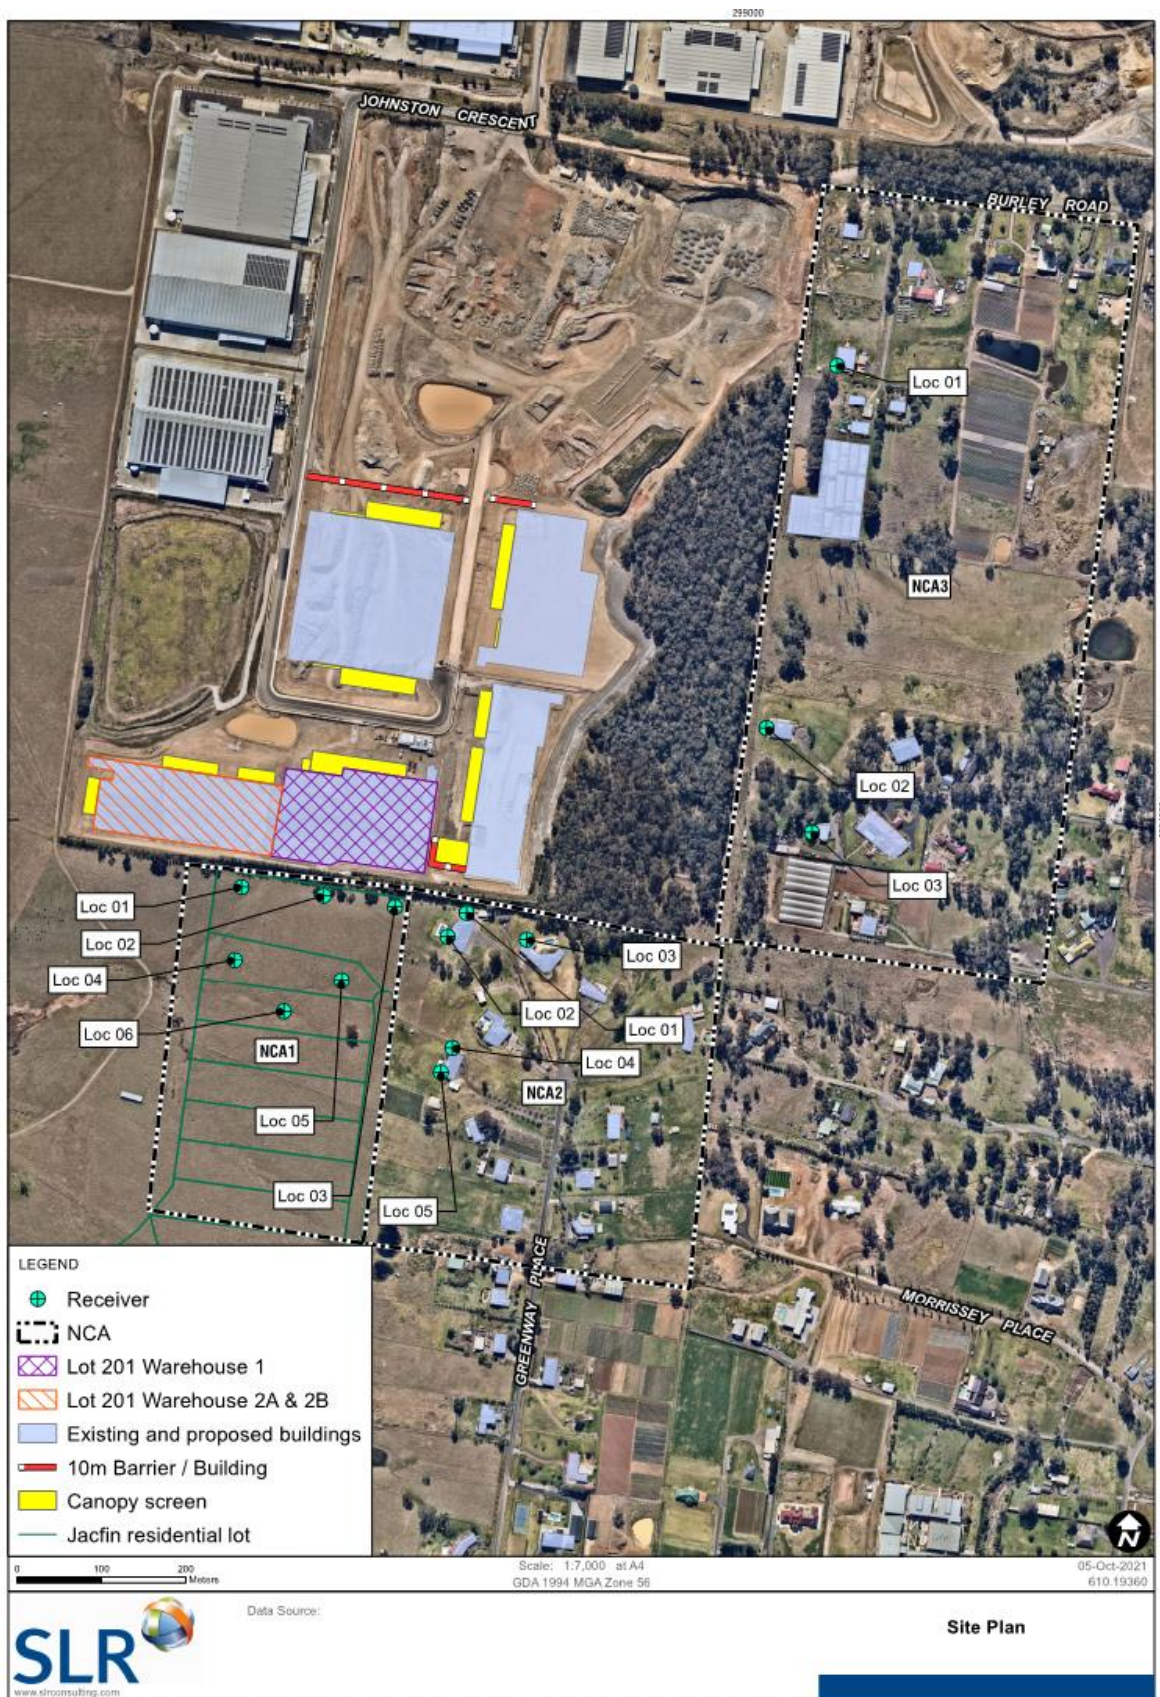

## 1.2 Section 4.55 Modification (MOD3)

The proposed S4.55 modification (MOD3) covers the external mechanical plant, vehicle movements and hardstand activity associated with HLP Lot 201 Warehouse 2A & 2B, shown in the Site and Facility plan DA-201-A100 Rev P24 dated 9.8.21, as shown in **Figure 2**.

**Figure 2 Lot 201 Warehouse 2A & 2B Site and Facility Plan MOD3**

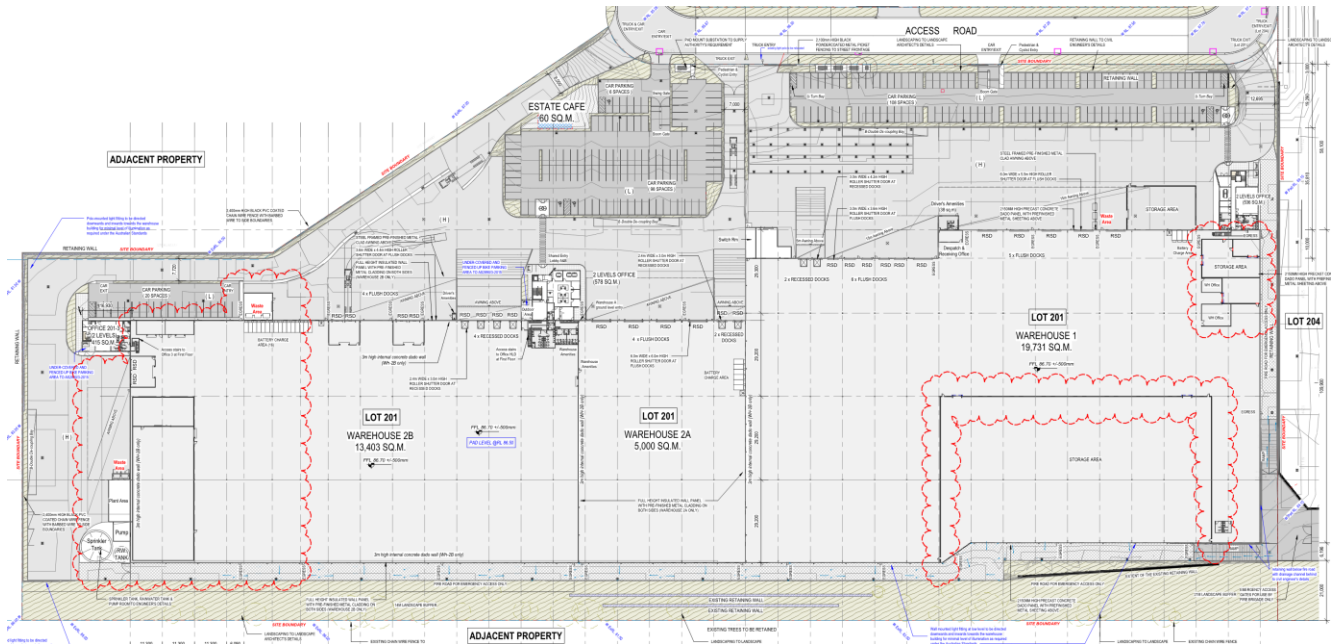

External operations for Lot 201 Warehouse 1 have been addressed in the MOD1 assessment.

## 2 Operational Noise Limits

The operational noise limits for the HLP are defined in Condition B11 of Development Consent SSD 10436. The operational noise limits for each receiver Noise Catchment Area (NCA) are shown in **Table 1**.

**Table 1 Operational Noise Limits**

Location	Daytime LAeq(15minute) (dBA)	Evening LAeq(15minute) (dBA)	Night-time LAeq(15minute) (dBA)	Night-time LAFmax (dBA)
NCA1	44	43	38	52
NCA2	40	40	38	52
NCA3	44	43	38	52

## 3 Prevailing Weather Conditions

Certain meteorological/weather conditions can increase noise levels. This can occur during temperature inversions (where temperatures increase with height above ground level), or where there is a wind gradient (where wind speed increases with height).



The *Noise Policy for Industry* (NPfI) contains guidance for determining prevailing weather conditions. The weather conditions at the development site were determined using 12 months of weather data (January 2016 to December 2016) obtained from the Bureau of Meteorology automatic weather station at Horsley Park, which is approximately 6 km to the east of the development. This data was analysed to determine the frequency of noise-enhancing wind and temperature inversion conditions which may affect noise levels at the site.

The analysis indicated that during the daytime and evening periods, winds of up to 3 m/s did not exceed the 30% threshold specified in the NPfI during any season. However, the 30% threshold was exceeded during the night-time period in autumn, in both the south-west and west-south-west directions.

The analysis also indicated that temperature inversions of Class F or Class G are likely to occur for more than 30% of the night-time period during all four seasons. Therefore, noise-enhancing temperature inversions are required to be included in the assessment of noise impacts during the night-time period.

On this basis, assessment of noise-enhancing weather during the daytime and evening periods is not required, although consideration of noise-enhancing conditions (wind and temperature inversion) for night-time operations is required.

## 4 Operational Noise Impact Assessment

### 4.1 Operational Noise Modelling

Noise modelling of the development site was undertaken using the CONCAWE noise prediction algorithms in SoundPLAN modelling software.

A 3D digital noise model was constructed from a combination of aerial photography, existing ground topography, design ground topography, receiver buildings / structures and design plans for the development. Warehouse buildings and office buildings within the HLP have been modelled based on the design plans.

The modelled MOD3 layout is shown in **Figure 2**.

The modelling inputs and source sound power levels (SWL) for each type of noise source associated with Lot 201 Warehouse 2A & 2B are summarised in the following sections.

#### 4.1.1 Lot 201 Warehouse 2A & 2B Vehicle Numbers

Supplied heavy vehicle volumes for Lot 201 Warehouse 2A & 2B are provided in **Table 2**. All other Lots have been modelled with identical vehicle movements to the approved MOD1.

**Table 2 Supplied Heavy Vehicle Volumes for Lot 201 Warehouse 2A & 2B**

From	To	Inbound Movements	Outbound Movements	Total
12:00 AM	1:00 AM	0	0	0
1:00 AM	2:00 AM	0	0	0
2:00 AM	3:00 AM	0	0	0
3:00 AM	4:00 AM	0	0	0
4:00 AM	5:00 AM	0	0	0
5:00 AM	6:00 AM	0	0	0
6:00 AM	7:00 AM	0	0	0
7:00 AM	8:00 AM	2	2	4
8:00 AM	9:00 AM	12	6	18
9:00 AM	10:00 AM	14	6	20
10:00 AM	11:00 AM	8	6	14
11:00 AM	12:00 PM	6	6	12
12:00 PM	1:00 PM	0	0	0
1:00 PM	2:00 PM	4	6	10
2:00 PM	3:00 PM	2	4	6
3:00 PM	4:00 PM	2	8	10
4:00 PM	5:00 PM	0	12	12
5:00 PM	6:00 PM	0	2	2
6:00 PM	7:00 PM	0	0	0
7:00 PM	8:00 PM	0	0	0
8:00 PM	9:00 PM	0	0	0
9:00 PM	10:00 PM	0	0	0
10:00 PM	11:00 PM	0	0	0
11:00 PM	12:00 AM	0	0	0
<b>Daily</b>		<b>50</b>	<b>58</b>	<b>108</b>

It has been conservatively assumed that up to 50% of the hourly daytime or night-time peak heavy vehicle movements could occur in the modelled 15 minute scenario.

The modelling inputs and source Sound Power Levels (SWL) for each component of the vehicle access road, manoeuvring and loading are summarised below.

The heavy vehicle (HV) and light vehicle (LV) volumes for Lot 201 Warehouse 2A & 2B are provided in **Table 3** and **Table 4**. All other Lots have been modelled with identical vehicle movements to both the approved SSDA and MOD1.

The modelled line sources were subdivided into the following sections:

- Access road movements at 25 km/h, 20% accelerating driving condition
- Loading and hardstand areas at 5 km/h.

**Table 3 Lot 201 Daytime Vehicle Movements**

Source	Source SWL, dBA	Number of Vehicles (two way)
201 (2A) HV Day Loading	105	5
201 (2A) HV Day Road	105 (80%) 111 (20%)	5
201 (2B) HV Day Loading	105	5
201 (2B) HV Day Road	105 (80%) 111 (20%)	5
201 (2A&2B) LV Day Carpark	96	21
201 (2A&2B) LV Day Road	96	21

**Table 4 Lot 201 Night-time Vehicle Movements**

Source	Source SWL, dBA	Number of Vehicles (two way)
201 (2A) HV Day Loading	105	0
201 (2A) HV Day Road	105 (80%) 111 (20%)	0
201 (2B) HV Day Loading	105	0
201 (2B) HV Day Road	105 (80%) 111 (20%)	0
201 (2A&2B) LV Day Carpark	96	0
201 (2A&2B) LV Day Road	96	0

#### 4.1.2 Area Sources

The area sources associated with each hardstand or loading area are included in **Table 5**.

**Table 5 LAeq Sound Power Levels – Area Sources**


Noise Source	Source SWL, dBA	Duration of Use in Peak 15-minute Period, s	Comment
Truck Reversing Alarm	107 <sup>1</sup>	60	Applicable to 50% of two way truck movements
Forklift Reversing Alarm	102 <sup>1</sup>	90	-
Gas Forklift	93	900	-

Note 1. LAeq sound power level 3 dBA lower than the maximum sound power level

### 4.1.3 External Point Sources

External packaged unit locations for Lot 201 Warehouse 2A & 2B are shown in **Figure 3**.

**Figure 3 Lot 201 Warehouse 2A & 2B External Plant Locations**

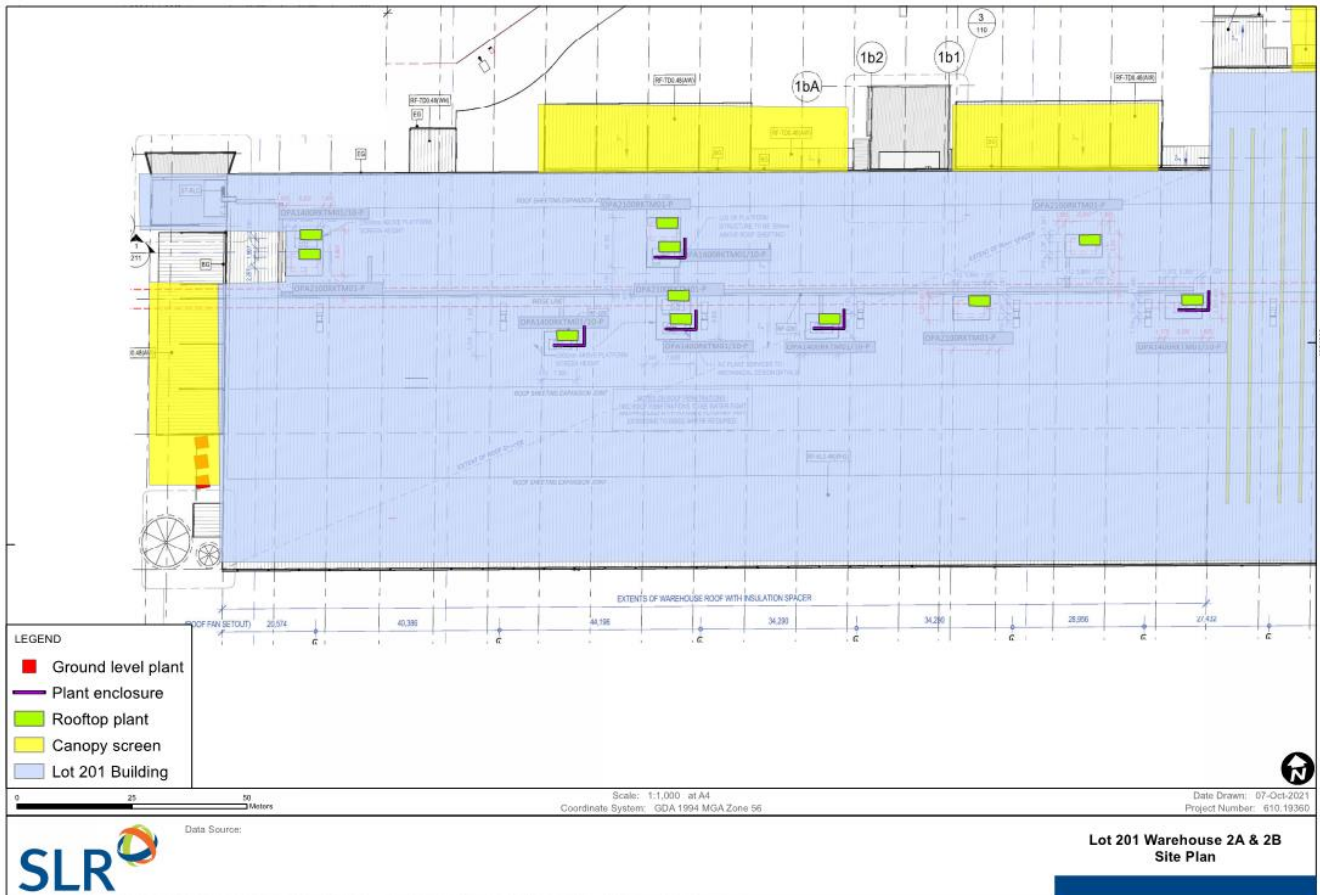

External plant sound power levels are detailed in **Table 6**.

**Table 6 External Plant Sound Power Levels**

Designator	Noise Source	Radiated SWL per unit, dBA
2A-PAC-3 2B-PAC-1 2B-PAC-3 2B-PAC-4 2B-PAC-5 3-PAC-2	Temperzone OPA1400 Eco Ultra	84
2A-PAC-1 2A-PAC-2 2B-PAC-2 2B-PAC-6 3-PAC-1	Temperzone OPA2100 Eco Ultra	76

Designator	Noise Source	Radiated SWL per unit, dBA
Western Hardstand Plant Enclosure (6 units)	Bitzer Evo 8	92

Maximum noise level events are modelled to occur anywhere within the area sources at each hardstand with the SWLs shown in **Table 7**.

**Table 7** **L<sub>Amax</sub> Sound Power Levels – Hardstand, Loading Areas and Car Parks**

Noise Source	Source SWL, dBA
Air brake	118
Truck Reversing Alarm	110
Forklift Reversing Alarm	105
Car Peak Events	100

It is anticipated that the L<sub>Aeq</sub> noise contribution from occasional impact sounds due to loading activities would not be significant compared to the dominant sources included in **Table 7**.

The maximum SWL of occasional impact sounds is also considered unlikely to exceed the air brake SWL of 118 dBA in **Table 7** for the sleep disturbance screening assessment.

#### 4.1.4 Nearest Sensitive Receivers

The area surrounding the development has been divided into three Noise Catchment Areas (NCAs). The NCAs and sensitive receivers near to the development are shown in **Figure 1**. NCA1 includes nominal locations of future receivers to the south of the development. NCA2 and NCA3 include existing receivers to the south and east of the development, respectively.

Noise levels have been assessed at the most-affected point at each residential property, see **Figure 1**, and at a height of between 1.2–1.5 m above ground level, in accordance with guidance in the NPfI.

Demonstrating compliance at the nearest receivers as indicated in **Figure 1** will also result in compliance at more distant residential and educational receivers.



## 4.2 Predicted Operational Noise Impacts

The predicted MOD3 operational noise levels at the most affected receiver in each catchment are summarised in **Table 8**. These predictions also include all external sources of noise from the MOD1 assessment. The indicative 10 m barriers/buildings representing future Stage 3 development are also included in the noise model as shown in **Figure 1**.

**Table 8 Predicted Operational Noise Levels – MOD3 Masterplan**

NCA	Period (weather)	LAeq(15minute) Noise Level (dBA)			LAmass Noise Level (dBA)		
		Operational Noise Limit	Predicted	Compliance	Sleep Disturbance Screening Noise Level	Predicted	Compliance
NCA01	Daytime (neutral)	44	36	Yes	n/a <sup>2</sup>	n/a	n/a
	Evening (neutral)	43	36	Yes	n/a <sup>2</sup>	n/a	n/a
	Night-time (noise-enhancing)	38	37	Yes	52	47	Yes
NCA02	Daytime (neutral)	40	38	Yes	n/a <sup>2</sup>	n/a	n/a
	Evening (neutral)	40	38	Yes	n/a <sup>2</sup>	n/a	n/a
	Night-time (noise-enhancing)	38	38	Yes	52	48	Yes
NCA03	Daytime (neutral)	44	34	Yes	n/a <sup>2</sup>	n/a	n/a
	Evening (neutral)	43	34	Yes	n/a <sup>2</sup>	n/a	n/a
	Night-time (noise-enhancing)	38	36	Yes	52	49	Yes


Note 1: **Bold** text indicates an exceedance of the Operational Noise Limits.

The above results indicate that compliance with the Operational Noise Limits is predicted at the most affected receivers in all noise catchments during all periods.

Compliance with the sleep disturbance screening criterion is also predicted, therefore, a detailed maximum noise level assessment is not required.


Noise contours are provided for daytime/evening (neutral weather) in **Figure 4** and night-time (noise-enhancing weather) in **Figure 5**.

**Figure 4 Predicted Daytime/Evening Noise Levels – MOD3 Masterplan**

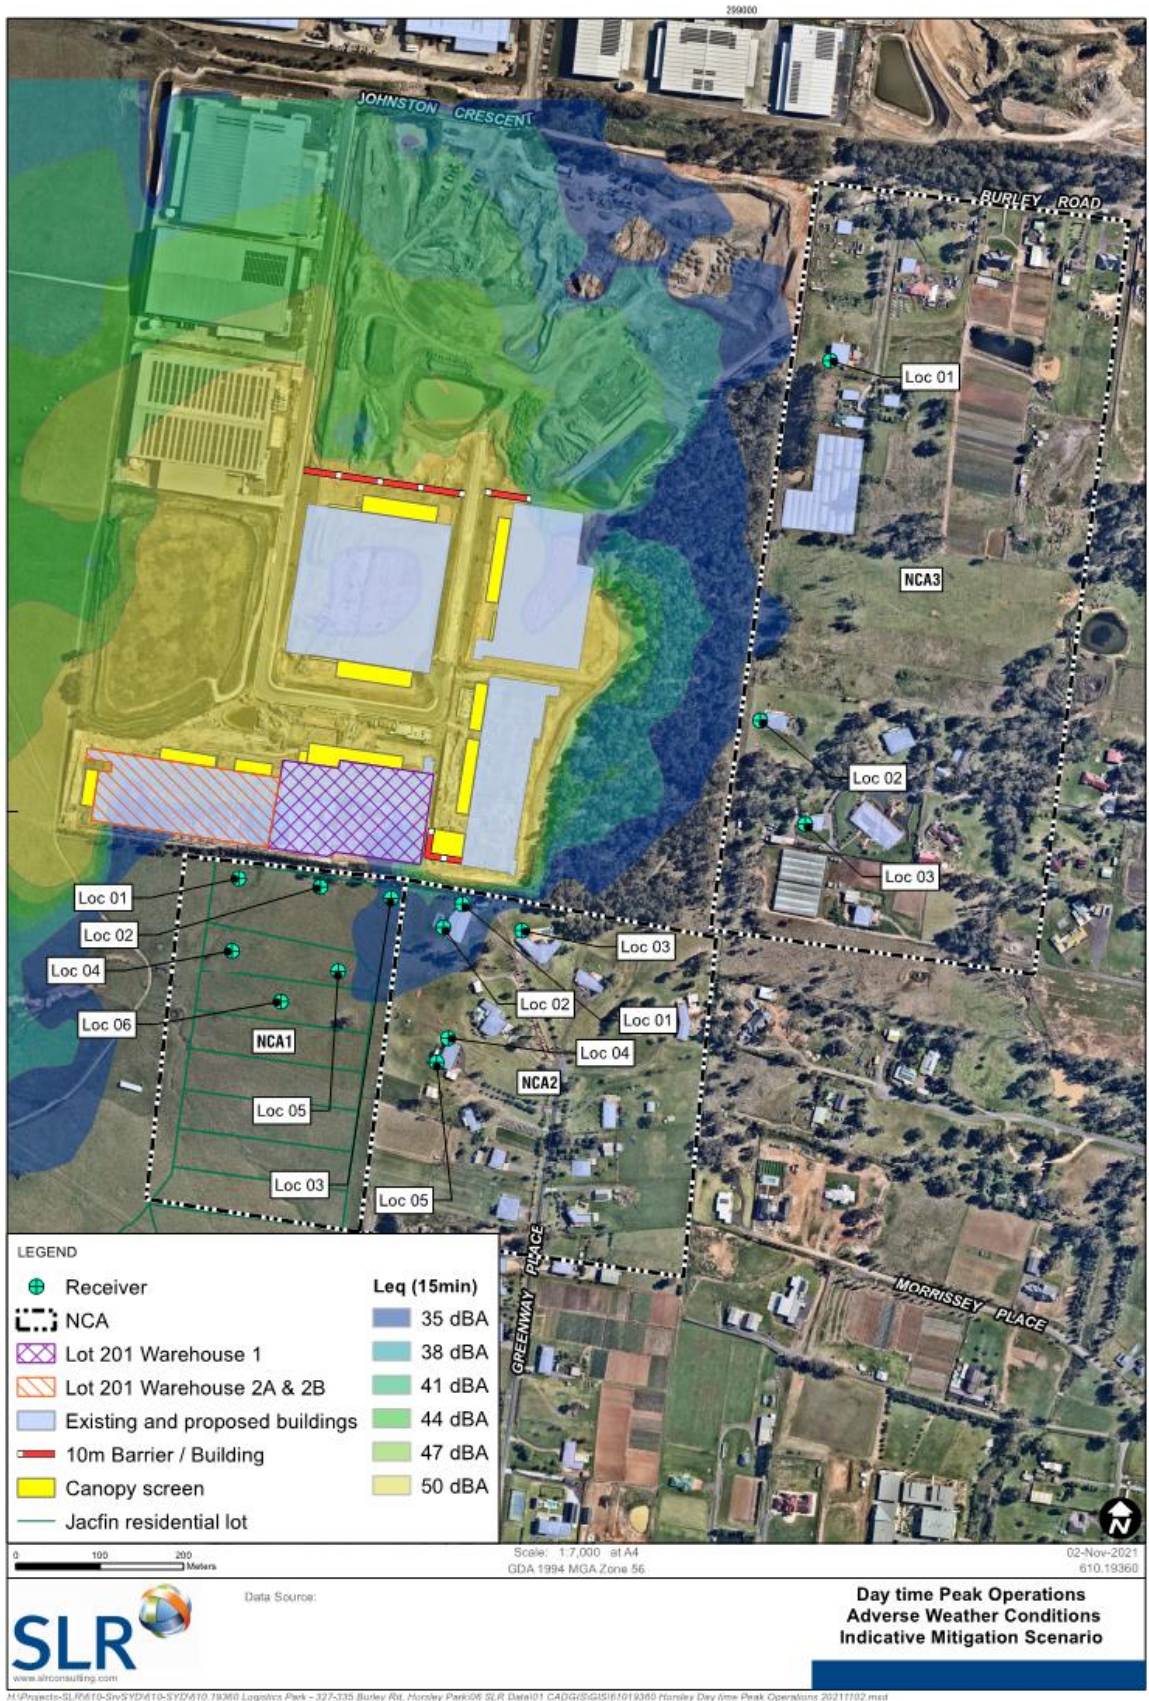



**Figure 5 Predicted Night-time Noise Levels – MOD3 Masterplan**

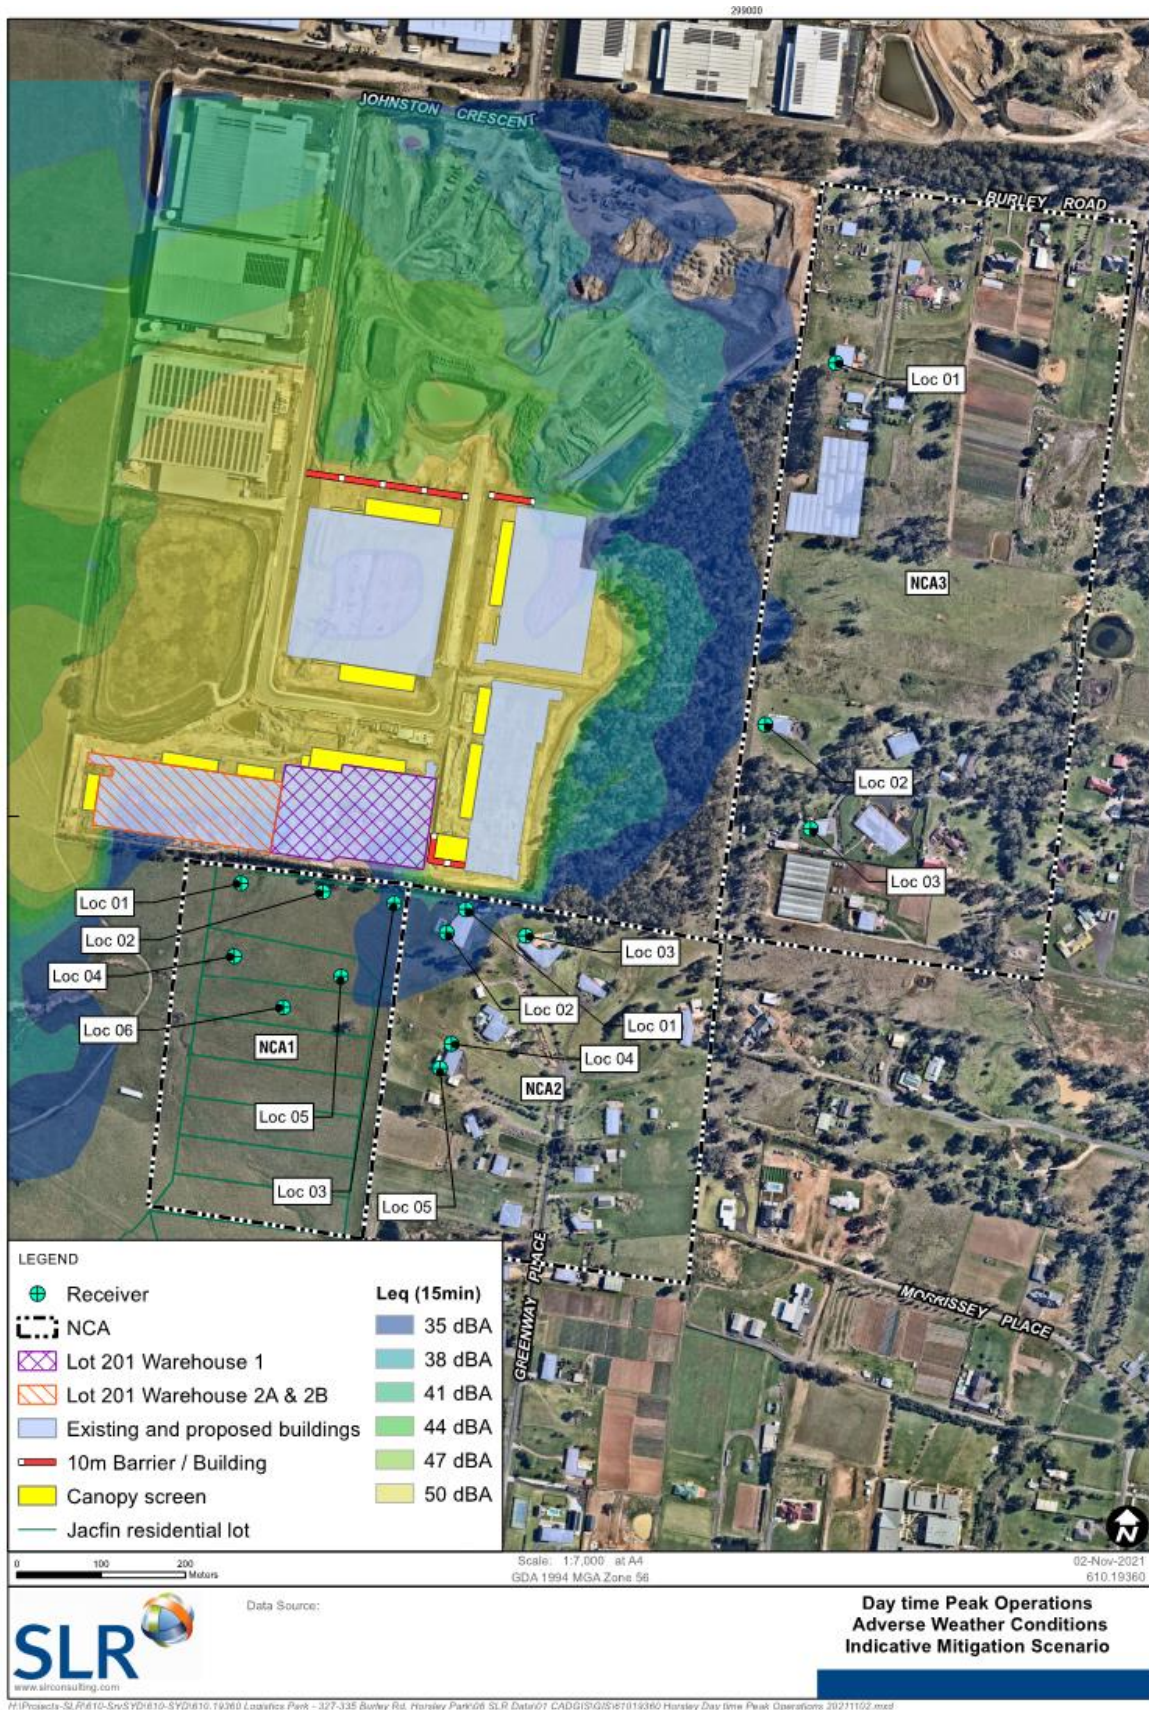


## 4.3 Noise Mitigation Measures

The following noise mitigation measures, shown in **Figure 3** and **Figure 6**, have been used in the design of Lot 201 Warehouse 2A & 2B:

- Two-sided solid screening to five rooftop packaged units, minimum height 1.0m above top of unit height (locations shown in **Figure 3** and **Figure 6**).

**Figure 6 Lot 201 Warehouse 2A & 2B Rooftop Plant Screening Locations**

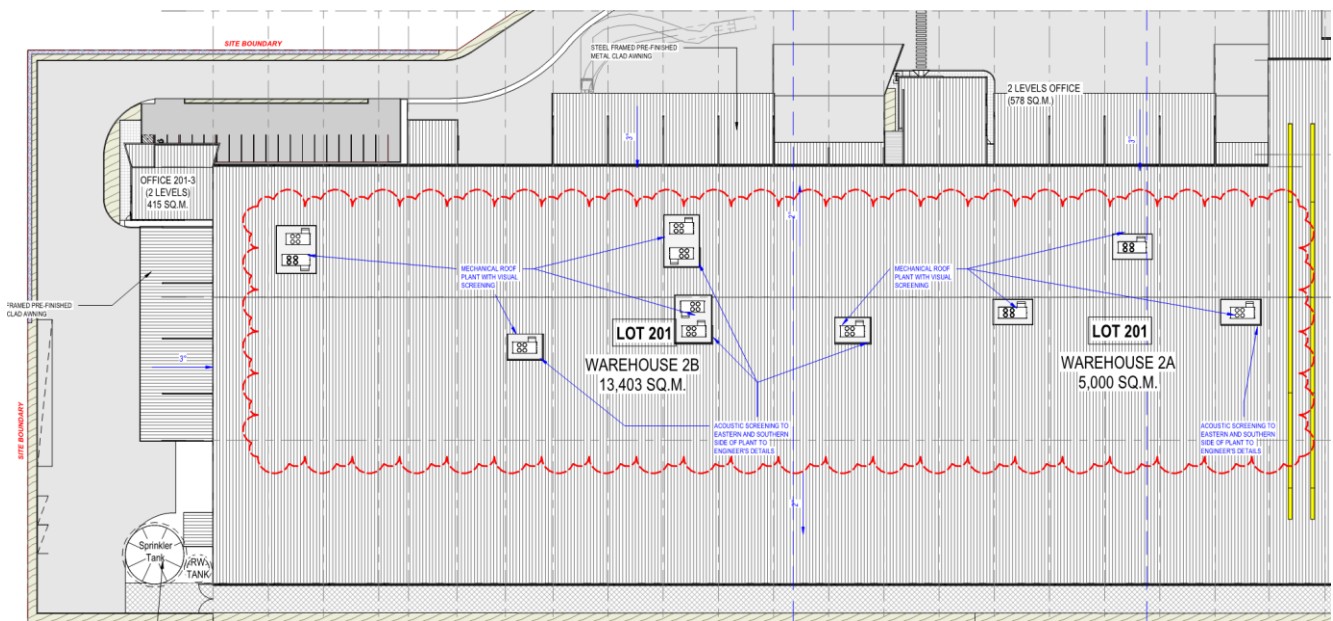

These mitigation measures are required to achieve the predicted operational noise levels in **Table 8**.

The noise mitigation measures associated with other Lots included in the model are summarised below:

- Infill noise wall to southern and western eave height of Lot 204 super canopy (shown in **Figure 1**)
- Rooftop plant screening to southern and eastern elevations of other Lots.

Lot 204 infill noise wall is included in the noise model primarily to provide screening of noise sources associated with Lot 204 itself, along with a residual screening benefit to external sources associated with other Lots.

## 4.4 Discussion of Noise Impacts

The results in **Table 8** indicate that operational noise levels of Lot 201 Warehouse 2A & 2B and the MOD3 Masterplan design are predicted to comply with the residential noise limits at all identified residential receivers under both neutral and adverse weather conditions during the applicable periods.

Compliance with the sleep disturbance screening criterion in each NCA is also predicted, therefore, a detailed maximum noise level assessment is not required. It is noted that there are no vehicle movements or hardstand activity associated with Warehouse 2A & 2B during the night-time period.

As such, operational noise emissions from the MOD3 Masterplan are considered to be compliant, assuming the mitigation measures detailed in **Section 4.3** are used.

An Operation Noise Management Plan for Lot 201 should be provided prior to occupancy to ensure the operational noise impacts are appropriately managed and monitored to maintain compliance with the Operational Noise Limits.

## 4.5 Comparison with Approved MOD1 Development Impacts

The operational noise impacts at the identified residential receivers are predicted to be compliant with the Operational Noise Limits with the addition of the Lot 201 Warehouse 2A & 2B external operations.

Overall, the predicted operational noise impacts of the Lot 201 Warehouse 2A & 2B external operations are considered to be consistent with those of the approved MOD1 development.

## 5 Conclusion

An operational noise impact assessment has been conducted for the operations of Lot 201 Warehouse 2A & 2B of the Horsley Logistics Park.

Approval for development of the Horsley Logistics Park was granted under State Significant Development Application Development Consent SSD 10436. The consent was subsequently modified in Modification 1 Application.

The operational noise modelling of the Modification 3 Application Masterplan and external operations of Lot 201 Warehouse 2A & 2B found no exceedances of the Operational Noise Limits at any sensitive receivers under both neutral (day, evening and night periods) and adverse (night period) weather conditions. Compliance with the sleep disturbance screening criterion in each catchment is also predicted.

Overall, the predicted operational noise impacts of the operations of Lot 201 Warehouse 2A & 2B are considered to be consistent with those of the approved Modification 1 Application development.



# APPENDIX A

## Acoustic Terminology

### 1. Sound Level or Noise Level

The terms 'sound' and 'noise' are almost interchangeable, except that 'noise' often refers to unwanted sound.

Sound (or noise) consists of minute fluctuations in atmospheric pressure. The human ear responds to changes in sound pressure over a very wide range with the loudest sound pressure to which the human ear can respond being ten million times greater than the softest. The decibel (abbreviated as dB) scale reduces this ratio to a more manageable size by the use of logarithms.

The symbols SPL, L or LP are commonly used to represent Sound Pressure Level. The symbol LA represents A-weighted Sound Pressure Level. The standard reference unit for Sound Pressure Levels expressed in decibels is  $2 \times 10^{-5}$  Pa.

### 2. 'A' Weighted Sound Pressure Level

The overall level of a sound is usually expressed in terms of dBA, which is measured using a sound level meter with an 'A-weighting' filter. This is an electronic filter having a frequency response corresponding approximately to that of human hearing.

People's hearing is most sensitive to sounds at mid frequencies (500 Hz to 4,000 Hz), and less sensitive at lower and higher frequencies. Different sources having the same dBA level generally sound about equally loud.

A change of 1 dB or 2 dB in the level of a sound is difficult for most people to detect, whilst a 3 dB to 5 dB change corresponds to a small but noticeable change in loudness. A 10 dB change corresponds to an approximate doubling or halving in loudness. The table below lists examples of typical noise levels.

Sound Pressure Level (dBA)	Typical Source	Subjective Evaluation
130	Threshold of pain	Intolerable
120	Heavy rock concert	Extremely noisy
110	Grinding on steel	
100	Loud car horn at 3 m	Very noisy
90	Construction site with pneumatic hammering	
80	Kerbside of busy street	Loud
70	Loud radio or television	
60	Department store	Moderate to quiet
50	General Office	
40	Inside private office	Quiet to very quiet
30	Inside bedroom	
20	Recording studio	Almost silent

Other weightings (eg B, C and D) are less commonly used than A-weighting. Sound Levels measured without any weighting are referred to as 'linear', and the units are expressed as dB(lin) or dB.

### 3. Sound Power Level


The Sound Power of a source is the rate at which it emits acoustic energy. As with Sound Pressure Levels, Sound Power Levels are expressed in decibel units (dB or dBA), but may be identified by the symbols SWL or LW, or by the reference unit  $10^{-12}$  W.

The relationship between Sound Power and Sound Pressure is similar to the effect of an electric radiator, which is characterised by a power rating but has an effect on the surrounding environment that can be measured in terms of a different parameter, temperature.

### 4. Statistical Noise Levels

Sounds that vary in level over time, such as road traffic noise and most community noise, are commonly described in terms of the statistical exceedance levels LAN, where LAN is the A-weighted sound pressure level exceeded for N% of a given measurement period. For example, the LA1 is the noise level exceeded for 1% of the time, LA10 the noise level exceeded for 10% of the time, and so on.

The following figure presents a hypothetical 15 minute noise survey, illustrating various common statistical indices of interest.

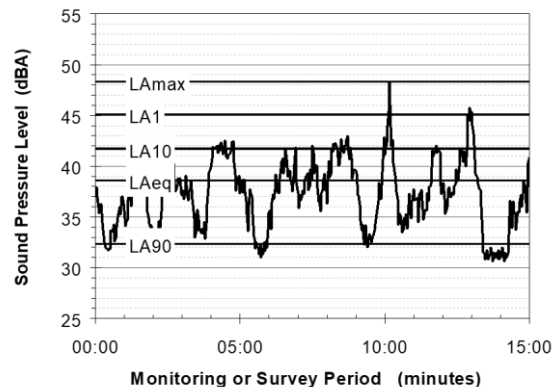

Of particular relevance, are:

LA1 The noise level exceeded for 1% of the 15 minute interval.

LA10 The noise level exceeded for 10% of the 15 minute interval. This is commonly referred to as the average maximum noise level.

LA90 The noise level exceeded for 90% of the sample period. This noise level is described as the average minimum background sound level (in the absence of the source under consideration), or simply the background level.

LAeq The A-weighted equivalent noise level (basically, the average noise level). It is defined as the steady sound level that contains the same amount of acoustical energy as the corresponding time-varying sound.

### 5. Frequency Analysis


Frequency analysis is the process used to examine the tones (or frequency components) which make up the overall noise or vibration signal.

The units for frequency are Hertz (Hz), which represent the number of cycles per second.

Frequency analysis can be in:

- Octave bands (where the centre frequency and width of each band is double the previous band)
- 1/3 octave bands (three bands in each octave band)
- Narrow band (where the spectrum is divided into 400 or more bands of equal width)

The following figure shows a 1/3 octave band frequency analysis where the noise is dominated by the 200 Hz band. Note that the indicated level of each individual band is less than the overall level, which is the logarithmic sum of the bands.

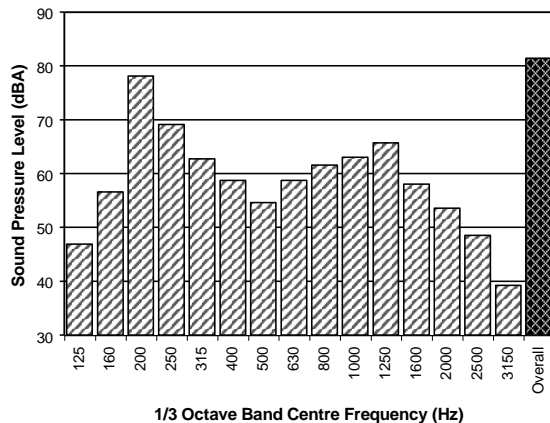

## 6. Annoying Noise (Special Audible Characteristics)

A louder noise will generally be more annoying to nearby receivers than a quieter one. However, noise is often also found to be more annoying and result in larger impacts where the following characteristics are apparent:

- **Tonality** - tonal noise contains one or more prominent tones (ie differences in distinct frequency components between adjoining octave or 1/3 octave bands), and is normally regarded as more annoying than 'broad band' noise.
- **Impulsiveness** - an impulsive noise is characterised by one or more short sharp peaks in the time domain, such as occurs during hammering.
- **Intermittency** - intermittent noise varies in level with the change in level being clearly audible. An example would include mechanical plant cycling on and off.
- **Low Frequency Noise** - low frequency noise contains significant energy in the lower frequency bands, which are typically taken to be in the 10 to 160 Hz region.

## 7. Vibration

Vibration may be defined as cyclic or transient motion. This motion can be measured in terms of its displacement, velocity or acceleration. Most assessments of human response to vibration or the risk of damage to buildings use measurements of vibration velocity. These may be expressed in terms of 'peak' velocity or 'rms' velocity.

The former is the maximum instantaneous velocity, without any averaging, and is sometimes referred to as 'peak particle velocity', or PPV. The latter incorporates 'root mean squared' averaging over some defined time period.

Vibration measurements may be carried out in a single axis or alternatively as triaxial measurements (ie vertical, longitudinal and transverse).

The common units for velocity are millimetres per second (mm/s). As with noise, decibel units can also be used, in which case the reference level should always be stated. A vibration level  $V$ , expressed in mm/s can be converted to decibels by the formula  $20 \log (V/V_0)$ , where  $V_0$  is the reference level ( $10^{-9}$  m/s). Care is required in this regard, as other reference levels may be used.

## 8. Human Perception of Vibration


People are able to 'feel' vibration at levels lower than those required to cause even superficial damage to the most susceptible classes of building (even though they may not be disturbed by the motion). An individual's perception of motion or response to vibration depends very strongly on previous experience and expectations, and on other connotations associated with the perceived source of the vibration. For example, the vibration that a person responds to as 'normal' in a car, bus or train is considerably higher than what is perceived as 'normal' in a shop, office or dwelling.

## 9. Ground-borne Noise, Structure-borne Noise and Regenerated Noise

Noise that propagates through a structure as vibration and is radiated by vibrating wall and floor surfaces is termed 'structure-borne noise', 'ground-borne noise' or 'regenerated noise'. This noise originates as vibration and propagates between the source and receiver through the ground and/or building structural elements, rather than through the air.

Typical sources of ground-borne or structure-borne noise include tunnelling works, underground railways, excavation plant (eg rockbreakers), and building services plant (eg fans, compressors and generators).

The following figure presents an example of the various paths by which vibration and ground-borne noise may be transmitted between a source and receiver for construction activities occurring within a tunnel.

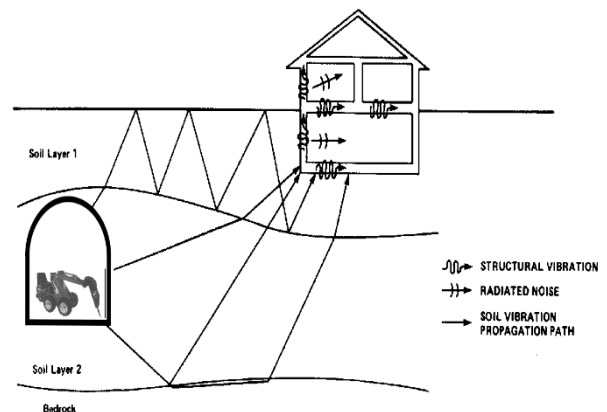

The term 'regenerated noise' is also used in other instances where energy is converted to noise away from the primary source. One example would be a fan blowing air through a discharge grill. The fan is the energy source and primary noise source. Additional noise may be created by the aerodynamic effect of the discharge grill in the airstream. This secondary noise is referred to as regenerated noise.



## ASIA PACIFIC OFFICES

### BRISBANE

Level 2, 15 Astor Terrace  
Spring Hill QLD 4000  
Australia  
T: +61 7 3858 4800  
F: +61 7 3858 4801

### CANBERRA

GPO 410  
Canberra ACT 2600  
Australia  
T: +61 2 6287 0800  
F: +61 2 9427 8200

### DARWIN

Unit 5, 21 Parap Road  
Parap NT 0820  
Australia  
T: +61 8 8998 0100  
F: +61 8 9370 0101

### GOLD COAST

Level 2, 194 Varsity Parade  
Varsity Lakes QLD 4227  
Australia  
M: +61 438 763 516

### MACKAY

21 River Street  
Mackay QLD 4740  
Australia  
T: +61 7 3181 3300

### MELBOURNE

Level 11, 176 Wellington Parade  
East Melbourne VIC 3002  
Australia  
T: +61 3 9249 9400  
F: +61 3 9249 9499

### NEWCASTLE

10 Kings Road  
New Lambton NSW 2305  
Australia  
T: +61 2 4037 3200  
F: +61 2 4037 3201

### PERTH

Ground Floor, 503 Murray Street  
Perth WA 6000  
Australia  
T: +61 8 9422 5900  
F: +61 8 9422 5901

### SYDNEY

Tenancy 202 Submarine School  
Sub Base Platypus  
120 High Street  
North Sydney NSW 2060  
Australia  
T: +61 2 9427 8100  
F: +61 2 9427 8200

### TOWNSVILLE

12 Cannan Street  
South Townsville QLD 4810  
Australia  
T: +61 7 4722 8000  
F: +61 7 4722 8001

### WOLLONGONG

Level 1, The Central Building  
UoW Innovation Campus  
North Wollongong NSW 2500  
Australia  
T: +61 404 939 922

### AUCKLAND

68 Beach Road  
Auckland 1010  
New Zealand  
T: 0800 757 695

### NELSON

6/A Cambridge Street  
Richmond, Nelson 7020  
New Zealand  
T: +64 274 898 628