

Development Consent

Section 89E of the *Environmental Planning & Assessment Act 1979*

As delegate of the Minister for Planning, the Planning Assessment Commission approves the development application referred to in schedule 1, subject to the conditions in schedules 2 to 5.

These conditions are required to:

- prevent, minimise, and/or offset adverse environmental impacts;
- set standards and performance measures for acceptable environmental performance;
- require regular monitoring and reporting; and
- provide for the ongoing environmental management of the development.

Member of the Commission

Member of the Commission

Member of the Commission

Sydney

2015

Green type represents June 2019 modification (MOD 1)

Red type represents May 2020 modification (MOD 2)

Blue type represents September 2020 modification (MOD 3)

SCHEDULE 1

Application Number:

SSD-6697

Applicant:

Crudine Ridge Wind Farm Pty Ltd

Consent Authority:

Minister for Planning

Land:

See Appendix 1

Development:

Crudine Ridge Wind Farm

TABLE OF CONTENTS

ADMINISTRATIVE CONDITIONS	5
Obligation to Minimise Harm to the Environment	5
Terms of Consent	5
Limits on Consent	5
Notification to Department	6
Structural Adequacy	6
Demolition	6
Protection of Public Infrastructure	6
Operation of Plant and Equipment	6
Updating & Staging of Strategies, Plans or Programs	6
Community Enhancement	7
ENVIRONMENTAL CONDITIONS - GENERAL	8
Acquisition upon Request	8
Visual	8
Noise & Vibration	9
Air	11
Water	11
Biodiversity	11
Heritage	13
Transport	14
Aviation	15
Telecommunications	16
Bushfire	16
Safety	16
Waste	16
Rehabilitation & Decommissioning	16
ADDITIONAL PROCEDURES	18
Notification of Landowners	18
Land Acquisition	18
ENVIRONMENTAL MANAGEMENT, REPORTING AND AUDITING	20
Environmental Management	20
Reporting	21
Auditing	21
Access to Information	21
APPENDIX 1: SCHEDULE OF LAND	23
APPENDIX 2: GENERAL LAYOUT OF DEVELOPMENT	25
APPENDIX 3: GENERAL TERMS OF APPLICANT'S VPA OFFER	30
APPENDIX 4: NOISE COMPLIANCE ASSESSMENT	31
APPENDIX 5: BIODIVERSITY OFFSET AREA	32
APPENDIX 6: ROAD UPGRADE REQUIREMENTS	33
APPENDIX 7: OVER-DIMENSIONAL VEHICLE ACCESS ROUTE RESTRICTIONS	34

DEFINITIONS

Aboriginal stakeholders	Aboriginal stakeholders registered for cultural heritage consultation for the development
Ancillary infrastructure	All wind farm infrastructure with the exception of wind turbines, including but not limited to collector substations, switching stations, permanent offices and site compounds, underground and overhead electricity transmission lines, wind monitoring masts and internal roads
Applicant	Crudine Ridge Wind Farm Pty Ltd, or any person carrying out the development approved under this consent
BC Act	Biodiversity Conservation Act 2016
BCD	The Department's Biodiversity and Conservation Division
BRC	Bathurst Regional Council
CASA	Civil Aviation Safety Authority
CCC	Community Consultative Committee
Clearing	Clearing of native vegetation as per the meaning in Part 5A of the <i>Local Land Services Act 2013</i>
Conditions of this consent	Conditions contained in schedules 1 to 5 inclusive
Construction	The construction of the development, including but not limited to the construction of wind turbines, ancillary infrastructure and road upgrades (excludes geotechnical drilling and surveying)
Councils	BRC and MWRC
CPI	Consumer Price Index
Curtilage	The land immediately surrounding a residence, including any closely associated buildings or structures where domestic and/or recreational activities take place
Day	The period from 7am to 6pm on Monday to Saturday, and 8am to 6pm on Sundays and public holidays
Decommissioning	The removal of wind turbines and any associated above ground infrastructure
Department	Department of Planning, Industry and Environment
Development	The development as described in the EA
Development corridor	The corridor shown in the figure in Appendix 2
DoE	Commonwealth Department of the Environment
DPI	Department of Primary Industries
EA	The environmental assessment for the <i>Crudine Ridge Wind Farm</i> , prepared by CWP and dated December 2012, as modified by: <ul style="list-style-type: none"> • <i>Crudine Ridge Response to Submissions and Preferred Project Report</i>, prepared by CWP and dated November 2013; • the supplementary visual wireframe analysis and wind turbine layout plans prepared by CWP and dated 12 December 2014; and • the documents submitted in support of the first application to modify the consent, including the <i>Environmental Assessment</i> dated December 2018, the <i>Response to Submissions</i> dated January 2019 and the <i>Supplementary Information</i> dated February 2019; and • the documents submitted in support of the second application to modify the consent, including the <i>Environmental Assessment</i> dated April 2020 and the additional information dated May 2020; and • the documents submitted in support of the third application to modify the consent, including the <i>Modification Report</i> dated August 2020.
EEC	Endangered ecological community, as defined under the BC Act and/or EPBC Act
EP&A Act	<i>Environmental Planning and Assessment Act 1979</i>
EP&A Regulation	<i>Environmental Planning and Assessment Regulation 2000</i>
EPA	Environment Protection Authority
EPBC Act	<i>Environment Protection & Biodiversity Conservation Act 1999</i>
EPL	Environment Protection Licence issued under the POEO Act
Evening	The period from 6pm to 10pm
Feasible	Feasible relates to engineering considerations and what is practical to build or implement
Heritage Act	<i>Heritage Act 1977</i>
Heritage item	An item as defined under the Heritage Act and/or an Aboriginal Object or Aboriginal Place as defined under the NPW Act
Incident	A set of circumstances that: <ul style="list-style-type: none"> • causes or threatens to cause material harm to the environment; and/or • breaches or exceeds the limits or performance measures/criteria in this consent
Land	In general, the definition of land is consistent with the definition in the EP&A Act. However, in relation to the acquisition conditions in schedules 3 and 4 of this approval it means the whole of a lot, or contiguous lots owned by the same landowner, in a current plan registered at the Land Titles Office at the date of this approval
Material harm to the environment	Is harm that:

	<ul style="list-style-type: none"> involves actual or potential harm to the health or safety of human beings or to ecosystems that is not trivial; or results in actual or potential loss of property damage of an amount, or amounts in aggregate, exceeding \$10,000 (such loss includes the reasonable costs and expenses that would be incurred in taking all reasonable and practicable measures to prevent, mitigate or make good harm to the environment)
Minister	Minister for Planning and Public Spaces, or delegate
Mitigation	Activities associated with reducing the impacts of the development
MWRC	Mid-Western Regional Council
Night	The period from 10pm to 7am on Monday to Saturday, and 10pm to 8am on Sundays and NSW Public Holidays
Non-associated residence	Any residence on privately-owned land where the landowner has not reached a financial or in kind agreement with the Applicant in relation to the development. In some cases, this agreement will be restricted. First, it may only cover certain aspects of the development (such as the noise or visual impacts). In such cases, the residence is only associated for those aspects covered by the agreement, and remains a non-associated residence for all those aspects that are not covered by the agreement. Second, while the agreement may cover a certain aspect of the development (such as noise impacts), it may limit the extent of any such impact (by setting absolute noise levels at a residence, for instance). In these cases, the residence is only associated to the extent that the impact is covered by the agreement, and is considered to be non-associated for any impacts that exceed the limits specified in the agreement
NP&W Act	<i>National Parks & Wildlife Act 1974</i>
OLS	Obstacle Limitation Surface
Operation	The operation of the development, but does not include commissioning trials of equipment or use of temporary facilities
Over-dimensional	Over-mass and/or over-size/length vehicles
POEO Act	<i>Protection of the Environment Operations Act 1997</i>
Pre-construction minor works	Includes the following activities: <ul style="list-style-type: none"> building/road dilapidation surveys; investigative drilling, excavation or salvage; minor clearing or translocation of native vegetation; establishing temporary site office (in locations meeting the criteria identified in the conditions of this approval); installation of environmental impact mitigation measures, fencing, enabling works, wind monitoring masts; and minor access roads and minor adjustments to services/utilities, etc.
Privately-owned land	Land that is not owned by a public agency or a publicly-owned commercial entity (or its subsidiary)
Public infrastructure	Linear and related infrastructure that provides services to the general public, such as roads, railways, water supply, drainage, sewerage, gas supply, electricity, telephone, telecommunications
RAAF	Royal Australian Air Force – Aeronautical Information Services
Reasonable	Reasonable relates to the application of judgement in arriving at a decision, taking into account: mitigation benefits, cost of mitigation versus benefits provided, community views and the nature and extent of potential improvements
Rehabilitation	The restoration of land disturbed by the development to a good condition, to ensure it is safe, stable and non-polluting
Residence	Any dwelling in existence at the date of this consent, or a dwelling that is either the subject of a development consent or development application that was lodged but not yet determined at the date of this consent once construction of the dwelling is complete
RFS	Rural Fire Service
RMS	Roads and Maritime Services
Secretary	Secretary of the Department, or nominee
Shadow flicker	The flickering effect caused by the intermittent shading of the sun by the rotating blades of the wind turbines
Site	The land defined in Appendix 1
Temporary facilities	Temporary facilities used for the construction and/or decommissioning of the development, including but not limited to temporary site offices and compounds, concrete batching plants, materials storage compounds, maintenance workshops, testing laboratories or material stockpiles
VPA	Voluntary Planning Agreement
Wind turbine	Turbines used for the generation of electricity by wind, including the tower, blades and associated components

SCHEDULE 2 ADMINISTRATIVE CONDITIONS

OBLIGATION TO MINIMISE HARM TO THE ENVIRONMENT

1. In addition to meeting the specific environmental performance criteria established under this consent, the Applicant shall implement all reasonable and feasible measures to prevent and/or minimise any material harm to the environment that may result from the construction, operation, or decommissioning of the development.

TERMS OF CONSENT

2. The Applicant shall carry out the development:
 - (a) generally in accordance with the EA; and
 - (b) in accordance with the conditions of this consent.

Note: The general layout of the development is shown in Appendix 2.
3. If there is any inconsistency between the above documents, the most recent document shall prevail to the extent of the inconsistency. However, the conditions of this consent shall prevail to the extent of any inconsistency.
4. The Applicant shall comply with any reasonable requirement/s of the Secretary arising from the Department's assessment of:
 - (a) any strategies, plans, programs, reviews, audits, reports or correspondence that are submitted in accordance with this consent;
 - (b) any reports, reviews or audits commissioned by the Department regarding compliance with this consent; and
 - (c) the implementation of any actions or measures contained in these documents.

LIMITS ON CONSENT

Wind Turbines

5. The Applicant may construct, operate and replace or upgrade as necessary up to 37 wind turbines.

Notes:

- To avoid any doubt, the Applicant does not require additional approval to replace or upgrade wind turbines over time, as long as the replacement or upgrade is carried out in accordance with the conditions of this consent.
- To identify the approved wind turbines, see the figures and corresponding GIS coordinates in Appendix 2.

Wind Turbine Height

6. No wind turbines may be greater than 160 metres in height (measured from above ground level to the blade tip).

Micro-siting Restrictions

7. The Applicant may micro-site the wind turbines and ancillary infrastructure without further approval provided:
 - (a) they remain within the development corridor shown on the figure in Appendix 2;
 - (b) no wind turbine is moved more than 100 metres from the location shown on the figures in Appendix 2;
 - (c) no wind turbine is moved closer to residences CR28, CR34, CR41 or HER07 from the GIS locations in Appendix 2; and
 - (d) the revised location of the wind turbine and/or ancillary infrastructure would not result in any non-compliance with the conditions of this consent.

Final Layout Plans

8. Prior to the commencement of construction, the Applicant shall submit detailed plans of the final layout of the development to the Secretary, including:
 - (a) details on the micro-siting of any wind turbines and/or ancillary infrastructure; and
 - (b) the GIS coordinates of the wind turbines.

Note: If the construction of the development is to be staged, then the provision of these plans may be staged.

NOTIFICATION TO DEPARTMENT

9. Prior to the commencement of the construction, operation and/or decommissioning of the development, the Applicant shall notify the Department in writing of the date of commencement.

If the construction, operation and/or decommissioning of the development is to be staged, then the Applicant must:

- (a) notify the Department in writing prior to the commencement of the relevant stage, and clearly identify the development that would be carried out during the relevant stage; and
- (b) inform the local community and the Community Consultation Committee about the proposed staging plans.

STRUCTURAL ADEQUACY

10. The Applicant shall ensure that the wind turbines are constructed in accordance with the relevant standards, including the structural design requirements of *IEC 61400-1 Wind turbines – Part 1: Design Requirements* (or equivalent).
11. The Applicant shall ensure that all new buildings and structures, and any alterations or additions to existing buildings and structures, are constructed in accordance with the relevant requirements of the BCA.

Notes:

- Under Part 4A of the EP&A Act, the Applicant is required to obtain construction and occupation certificates for the proposed building works.
- Part 8 of the EP&A Regulation sets out the requirements for the certification of the development.

DEMOLITION

12. The Applicant shall ensure that all demolition work on site is carried out in accordance with *AS 2601-2001: The Demolition of Structures*, or its latest version.

PROTECTION OF PUBLIC INFRASTRUCTURE

13. Unless the Applicant and the applicable authority agree otherwise, the Applicant shall:
- (a) repair, or pay the full costs associated with repairing, any public infrastructure that is damaged by the development; and
 - (b) relocate, or pay the full costs associated with relocating, any public infrastructure that needs to be relocated as a result of the development.

This condition does not apply to the upgrade and maintenance of the road network, which is expressly provided for in the conditions of this consent.

OPERATION OF PLANT AND EQUIPMENT

14. The Applicant shall ensure that all plant and equipment used on site, or in connection with the development, is:
- (a) maintained in a proper and efficient condition; and
 - (b) operated in a proper and efficient manner.

UPDATING & STAGING OF STRATEGIES, PLANS OR PROGRAMS

15. With the approval of the Secretary, the Applicant may submit any strategy, plan or program required by this consent on a progressive basis.

To ensure the strategies, plans or programs under the conditions of this consent are updated on a regular basis, the Applicant may at any time submit revised strategies, plans or programs to the Secretary for approval.

With the agreement of the Secretary, the Applicant may prepare any revised strategy, plan or program without undertaking consultation with all the parties referred to under the relevant condition of this consent.

Notes:

- While any strategy, plan or program may be submitted on a progressive basis, the Applicant must ensure that all development being carried out on site is covered by suitable strategies, plans or programs at all times.
- If the submission of any strategy, plan or program is to be staged, then the relevant strategy, plan or program must clearly describe the specific stage to which the strategy, plan or program applies, the relationship of this stage to any future stages, and the trigger for updating the strategy, plan or program.

COMMUNITY ENHANCEMENT

16. Prior to the commencement of construction, unless the Secretary agrees otherwise, the Applicant shall enter into VPAs with the Councils in accordance with:
- (a) Division 6 of Part 4 of the EP&A Act; and
 - (b) the terms of the applicable offer in Appendix 3.

SCHEDULE 3 ENVIRONMENTAL CONDITIONS - GENERAL

ACQUISITION UPON REQUEST

1. For a period of 5 years from the commencement of construction of the applicable cluster, the owner(s) of the land listed in Table 1 may request the Applicant to acquire their land. Upon receiving a written request from these owner(s), the Applicant shall acquire the land in accordance with the procedures in conditions 2 and 3 of schedule 4.

However, this condition does not apply if the Applicant has an agreement with the owner(s) of the relevant land in regard to visual impacts associated with the development, and the Applicant has advised the Department in writing of the terms of this agreement.

Table 1: Land subject to acquisition upon request

Acquisition Basis	Land	Cluster
Visual Impact	CR33, CR34	Sallys Flat (Turbines A61 to A106)
Visual Impact	CR15, CR18, CR24, CR41	Pyramul (Turbines A1 to A58)

Note: To identify the land, clusters and wind turbines referred to in Table 1, see the figures in Appendix 2.

VISUAL

Visual Impact Mitigation

2. For a period of 5 years from the commencement of construction of the development the owner(s) of:
 - (a) the land listed in Table 1 (unless the landowner has requested acquisition or has an agreement with the Applicant in regard to visual impacts);
 - (b) the residences listed in Table 2; or
 - (c) any other non-associated residence within 4 kilometres of any wind turbine,
 may request additional visual mitigation measures at their residence. Upon receiving a written request from these owner(s), the Applicant shall implement visual impact mitigation measures (such as landscaping, vegetation screening, provision of awnings/blinds) at the residence (including its curtilage) in consultation with the landowner.

Table 2: Visual impact mitigation upon request

Residence	Characterisation of impact
CR19, CR27, CR28, CR35, CR36, CR37, SFR04, SFR05, SFR08	Moderate
SFR10, SFR11, SFR12, SFR13, SFR14, SFR15, SFR16, SFR17, SFR18, SFR19, SFR20, PL01, CR26	Low

These mitigation measures must be reasonable and feasible, directed towards reducing the visual impacts of the wind turbines on the residence (including its curtilage), and commensurate with the level of visual impact.

The mitigation measures must be implemented within 12 months of receiving the written request, unless the Secretary agrees otherwise.

If the Applicant and the owner cannot agree on the measures to be implemented, or there is a dispute about the implementation of these measures, then either party may refer the matter to the Secretary for resolution.

Notes:

- To identify the residences referred to in Table 2, see the figures in Appendix 2.
- To avoid any doubt, the visual impact mitigation measures must be aimed at reducing the visibility of the wind turbines from the residence and its curtilage. Mitigation measures are not required to be implemented to reduce the visibility of wind turbines from other locations on the property.
- In some cases, mitigation measures may not be warranted as the wind turbines would not be visible from the residence and its curtilage.
- The identification of appropriate visual impact mitigation measures will be easier following the construction of the wind turbines. While landowners may ask for the implementation of visual impact mitigation measures shortly after the commencement of construction, they should consider the merits of delaying this request until the wind turbines are visible from their residence.

Visual Appearance

3. The Applicant shall:
- (a) implement all reasonable and feasible measures to minimise the off-site visual impacts of the development;
 - (b) ensure the wind turbines are:
 - painted off white/grey; and
 - finished with a surface treatment that minimises the potential for glare and reflection;
 - (c) ensure the visual appearance of all ancillary infrastructure (including paint colours, specifications and screening) blends in as far as possible with the surrounding landscape; and
 - (d) not mount any advertising signs or logos on wind turbines or ancillary infrastructure

Lighting

4. The Applicant shall:
- (a) implement all reasonable and feasible measures to minimise the off-site lighting impacts of the development;
 - (b) ensure that any aviation hazard lighting complies with CASA's requirements;
 - (c) ensure that all external lighting associated with the development (apart from any aviation hazard lighting):
 - is installed as low intensity lighting (except where required for safety or emergency purposes);
 - does not shine above the horizontal;
 - uses best management practice for bat deterrence; and
 - complies with *Australian Standard AS4282 (INT) 1997 – Control of Obtrusive Effects of Outdoor Lighting*, or its latest version.

Shadow Flicker

5. The Applicant shall ensure that shadow flicker from operational wind turbines does not exceed 30 hours per annum at any non-associated residence.

NOISE & VIBRATION

Construction & Decommissioning

6. The Applicant shall implement all reasonable and feasible measures to minimise the construction or decommissioning noise of the development, including any associated traffic noise.
7. The Applicant shall ensure that the noise generated by any construction or decommissioning activities is managed in accordance with the best practice requirements outlined in the *Interim Construction Noise Guideline* (DECC, 2009), or its latest version.
8. Unless the Secretary agrees otherwise, the Applicant shall only undertake construction or decommissioning activities between:
- (a) 7 am to 6 pm Monday to Friday;
 - (b) 8 am to 1 pm Saturdays; and
 - (c) at no time on Sundays and NSW public holidays.

The following construction activities may be undertaken outside these hours without the approval of the Secretary:

- activities that are inaudible at non-associated residences;
 - the delivery of materials as requested by the NSW Police Force or other authorities for safety reasons; or
 - emergency work to avoid the loss of life, property and/or material harm to the environment.
9. The Applicant shall only carry out blasting on site between 9 am and 5 pm Monday to Friday and between 8 am and 1 pm on Saturday. No blasting is allowed on Sundays or public holidays.

10. The Applicant shall ensure that any blasting carried out during the construction of the development does not exceed the criteria in Table 3.

Table 3: Blasting criteria

Location	Airblast overpressure (dB(Lin Peak))	Ground vibration (mm/s)	Allowable exceedance
Any non- associated residence	120	10	0%
	115	5	5% of the total number of blasts or events over a period of 12 months

Operational Noise Criteria – Wind Turbines

11. The Applicant shall ensure that the noise generated by the operation of wind turbines does not exceed the relevant criteria in Table 4 at any non-associated residence.

Table 4: Noise criteria dB(A)

Residence No	Criteria (dB(A)) with Reference to Hub Height Wind Speed (m/s)														
	3	4	5	6	7	8	9	10	11	12	13	14	15	16	
APR2, 3, 4, 5, 6, 7, 8, 9,10 CR15	35	35	35	35	35	36	38	39	41	42	44	46	48	48	
CR16, 18, 19, 20, 21, 24	35	35	35	35	35	35	36	37	38	40	42	44	47	47	
CR26, 27, 28	35	35	35	35	35	35	35	35	36	38	41	43	45	45	
CR32, 33, 34, 35, 36	35	35	35	35	35	35	37	40	42	45	47	50	52	55	
CR37, HER3, 4, TR1, 2, 3, 4, 5, 6	35	35	35	35	35	35	35	36	38	39	40	41	41	41	
HER10, 11, 13	35	35	35	35	37	39	41	43	45	46	46	46	46	46	
PL1, 2, PR1, 3, 4, 9, 10, 11, SFR1, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 16, 17, 18, 19	35	35	35	35	35	37	39	41	43	44	46	46	46	46	
All other non-associated residences	The higher of 35 dB(A) or the existing background noise level (LA90 (10-minute)) plus 5 dB(A)														

Note: To identify the residences referred to in Table 4, see the applicable figures in Appendix 2.

Noise generated by the operation of the wind turbines is to be measured in accordance with the relevant requirements of the South Australian Environment Protection Authority's Wind Farms – Environmental Noise Guidelines 2009 (or its latest version), as modified by the provisions in Appendix 4. If this guideline is replaced by an equivalent NSW guideline, then the noise generated is to be measured in accordance with the requirements in the NSW guideline.

Operational Noise Criteria – Ancillary Infrastructure

12. The Applicant shall ensure that the noise generated by the operation of ancillary infrastructure does not exceed 35 dB(A) L_{Aeq}(15 minute) at any non-associated residence.

Noise generated by the development is to be measured in accordance with the relevant requirements of the NSW Industrial Noise Policy (or its equivalent) as modified by the provisions in Appendix 4.

Noise Monitoring

13. Within 3 months of the commencement of operations, **unless otherwise agreed by the Secretary**, the Applicant shall:
 - (a) undertake noise monitoring to determine whether the development is complying with the relevant conditions of this consent; and
 - (b) submit a copy of the monitoring results to the Department and the EPA.
14. The Applicant shall undertake further noise monitoring of the development if required by the Secretary.

AIR

15. The Applicant shall:
 - (a) implement all reasonable and feasible measures to minimise the off-site dust and fume emissions of the development; and
 - (b) minimise the surface disturbance of the site.

WATER

Water Supply

16. The Applicant shall ensure that it has sufficient water for all stages of the development, and if necessary, adjust the scale of the development to match its available water supply.

Note: Under the Water Act 1912 and/or the Water Management Act 2000, the Applicant is required to obtain the necessary water licences for the development.

Water Pollution

17. Unless an EPL authorises otherwise, the Applicant shall ensure that the development does not cause any water pollution.

Note: Section 120 of the POEO Act makes it an offence to pollute any waters.

Operating Conditions

18. The Applicant shall:
 - (a) ensure that all activities are undertaken in accordance with:
 - *Managing Urban Stormwater: Soils and Construction* (Landcom, 2004) manual, **or its latest version**;
 - guidelines for waterway crossings and fish passage, including:
 - *Policy and Guidelines for Fish Friendly Waterway Crossings* (2004), **or its latest version**;
 - *Why Do Fish Need to Cross the Road? Fish Passage Requirements for Waterway Crossings* (2004), **or its latest version**; and
 - *Water Guidelines for Controlled Activities on Waterfront Land* (2012), **or its latest version**;
 - (b) ensure that the storage and handling of all dangerous goods and hazardous materials is undertaken in accordance with *AS1940-2004: The storage and handling of flammable and combustible liquids*, or its latest version.

BIODIVERSITY

Operating Conditions

19. The Applicant shall:
 - (a) **ensure, unless the Secretary agrees otherwise, that no more than:**
 - 5.7 hectares of Box Gum Woodland is cleared for the development, including the 0.95 hectares that would be cleared for the Aarons Pass Road upgrades;
 - 5.64 hectares of Red Stringybark - Red Box - Long-leaved Box – Inland Scribbly Gum is cleared for the Aarons Pass Road upgrades; and
 - (b) **implement all reasonable and feasible measures to minimise:**
 - **impacts on the Small-Purple Pea (*Swainsona recta*), *Acacia meiantha* and *Pomaderris cotoneaster*;**
 - limb-lopping of hollow bearing trees along Aarons Pass Road;
 - impacts on threatened bird and bat populations;

- the approved clearing of native woodland vegetation and fauna habitat, including hollow-bearing trees; and
- (c) if micro-siting wind turbines, ensure that the revised location of the turbine is at least 30 metres from any existing hollow-bearing trees, and where reasonable and feasible, 50 metres from any existing hollow-bearing tree, unless the Secretary agrees otherwise.

Note: In considering a request for micro-siting of turbines within 30 m of existing hollow-bearing trees, the Secretary will consider safety concerns, the constructability of the turbine, and/or whether the micro-siting would materially increase biodiversity impacts.

Biodiversity Offset Strategy - Wind Farm

20. Within 2 years of the commencement of construction, unless the Secretary agrees otherwise, the Applicant must enter into a stewardship agreement under the BC Act for the enhancement and protection of the 674 Biodiversity Offset Area (see the figure in Appendix 5) in accordance with the biodiversity offset strategy described in the EA for the development.

Biodiversity Offset - Aarons Pass Road

21. Within 2 years of the commencement of construction, unless the Secretary agrees otherwise, the Applicant must retire biodiversity credits of a number and class specified in Tables 5 and 6 below.

The retirement of credits must be carried out in accordance with the requirements of the *NSW Biodiversity Offsets Scheme* and can be achieved by:

- acquiring or retiring 'biodiversity credits' within the meaning of the *Biodiversity Conservation Act 2016*;
- making payments into the Biodiversity Conservation Fund; and
- funding a biodiversity conservation action that benefits the threatened entity impacted by the development, consistent with the 'Ancillary rules: Biodiversity conservation actions'.

Table 5: Ecosystem Credit Requirements

Vegetation Community	PCT ID	Credits Required
Blakely's Red Gum – Yellow Box grassy tall woodland of the NSW South Western Slopes Bioregion	277	16
Red Stringybark – Red Box – Long-leaved Box – Inland Scribbly Gum tussock grass shrub low open forest on hills in the southern part of the NSW South Western Slopes Bioregion	290	123

Table 6: Species Credit Requirements

Species	Credits Required
Glossy Black Cockatoo	154
Powerful Owl	154
Masked Owl	154
Koala	156
<i>Acacia meiantha</i>	5
<i>Pomaderris cotoneaster</i>	1

Biodiversity Management Plan

22. Prior to carrying out further work on the upgrades on Aarons Pass Road after the date of approval of Modification 1, the Applicant must prepare a revised Biodiversity Management Plan for the development to the satisfaction of the Secretary. This plan must:
- (a) be prepared in consultation with BCD and DoE; and
 - (b) include a:
 - a description of the measures that would be implemented for:
 - satisfying the requirements in condition 19 above;
 - rehabilitating and revegetating temporary disturbance areas;
 - protecting vegetation and fauna habitat outside the approved disturbance area;
 - maximising the salvage of resources such as vegetative and soil resources within the approved disturbance area, including along Aarons Pass Road, for beneficial reuse such as fauna habitat enhancement on site and/or in the biodiversity offset area;
 - collecting and propagating seed (where relevant);
 - minimising the impacts on fauna on site, including undertaking pre-clearance surveys;
 - controlling weeds and feral pests;
 - controlling erosion;
 - controlling access; and
 - minimising bushfire risks;
 - a Translocation Plan for moving any *Acacia meiantha* in the approved development area for the Aarons Pass Road upgrades;
 - Bird and Bat Adaptive Management Plan, that includes:
 - baseline data on bird and bat populations in the locality that could potentially be affected by the development, particularly 'at risk' species and threatened species;
 - a detailed description of the measures that would be implemented on site for minimising bird and bat strike during operation of the development, including:
 - o minimising the availability of raptor perches;
 - o prompt carcass removal;
 - o controlling pests;
 - o using best practice methods for bat deterrence, including managing potential lighting impacts;
 - o adaptive management of turbines to reduce mortality; and
 - a program to monitor and report on the vegetation clearing required for the Aarons Pass Road upgrades, including:
 - o a clear methodology to calculate and verify the vegetation clearing;
 - o verification of the vegetation clearing by suitably qualified experts;
 - o regular reporting on the scale and nature of the vegetation clearing on the proponent's website; and
 - o the publication of a detailed report documenting all the clearing undertaken for the road upgrades on the proponent's website within 4 weeks of completing the final clearing; and
 - (c) include a detailed program to monitor and report on:
 - the effectiveness of these measures and plans; and
 - bird and bat strike annually, or as otherwise directed by the Secretary.
23. Following approval, the Applicant must implement the measures described in the Biodiversity Management Plan.
24. Deleted.

HERITAGE

Protection of Aboriginal Heritage Items

25. The Applicant shall ensure that the development does not cause any direct or indirect impact on any Aboriginal heritage items located outside the approved disturbance area.

Aboriginal Heritage Management Plan

26. Prior to the commencement of construction, the Applicant shall prepare an Aboriginal Heritage Management Plan for the development to the satisfaction of the Secretary. This plan must:
- (a) be prepared in consultation with BCD and Aboriginal stakeholders; and
 - (b) include a description of the measures that would be implemented for:
 - minimising ground disturbance within the project area during construction and decommissioning works;

- managing impacts to Aboriginal heritage items within the project disturbance area;
- managing the discovery of human remains or previously unidentified Aboriginal heritage items on site; and
- ensuring workers on site receive suitable heritage inductions prior to carrying out any development on site, and that suitable records are kept of these inductions.

27. Following approval, the Applicant must implement the measures described in the Aboriginal Heritage Management Plan.

TRANSPORT

Road Upgrades – Aarons Pass Road

28. Prior to the commencement of construction (other than pre-construction minor works or the construction of the external overhead transmission line), the Applicant shall:
- undertake the road upgrades and other traffic management measures (including the construction of passing bays) identified in Appendix 6 to the satisfaction of MWRC;
 - upgrade the existing intersection between Aarons Pass Road and the Castlereagh Highway to the satisfaction of the RMS, unless the RMS determines these upgrades are unnecessary; and
 - construct the new intersection between Aarons Pass Road and the northern site access road to the satisfaction of MWRC. The intersection design must include:
 - a widened shoulder prior to the intersection to assist turning vehicles; and/or
 - a widened intersection to facilitate the flow of entering traffic off the road; and/or
 - placing site entrance gates back from the road so that they do not create a hold point for entering vehicles prior to their egress from Aarons Pass Road.

The Applicant may commence construction of the external overhead transmission line (as identified in Appendix 2), prior to completion of the Aarons Pass Road upgrades set out in this condition, provided that all heavy and over-dimensional vehicles associated with the construction of this transmission line:

- access the site from Bombandi Road; and
- do not use Aarons Pass Road before it has been upgraded in accordance with this condition.

Road Upgrades – Bombandi Road

29. Prior to the commencement of construction of the external transmission line (see the figures in Appendix 2), the Applicant shall:
- undertake the road upgrades and other traffic management measures identified in Appendix 6 to the satisfaction of MWRC; and
 - upgrade the existing intersection between Bombandi Road and the Castlereagh Highway to the satisfaction of the RMS, unless the RMS determines these upgrades are unnecessary.

Road Maintenance

30. The Applicant shall:
- prepare a pre-dilapidation survey of the transport route prior to the commencement of any construction or decommissioning works other than pre-construction minor works;
 - prepare a post-dilapidation survey of the transport route within 1 month of the completion of construction or decommissioning works other than pre-construction minor works, or other timing as may be agreed by the applicable roads authority; and
 - rehabilitate and/or make good any project-related damage identified in the post-dilapidation survey within 2 months of the completion of survey, or other timing as may be agreed by the relevant roads authority,

to the satisfaction of the relevant roads authority.

If the construction and/or decommissioning of the development is to be staged, the obligations in this condition apply to each stage of construction and/or decommissioning.

If there is a dispute about the scope of any remedial works or the implementation of the works, then either party may refer the matter to the Secretary for resolution.

Unformed Crown Roads

31. The Applicant shall ensure the future use of any unformed Crown road reserve is not compromised by the development.

Restriction on Transport Routes

32. The Applicant shall ensure that all:
- (a) over-dimensional vehicle access to and from the site is via the northern route using Castlereagh Highway and Aarons Pass Road;
 - (b) over-dimensional vehicle access through Mudgee is via:
 - Route 1 (using Castlereagh Highway, Market Street, Douro Street and Horatio Street), for vehicles up to 50 metres length; or
 - Route 2 (using Castlereagh Highway, Market Street, Cox Street, Short Street, Lawson Street, Mortimer Street, Burrundulla Avenue and Horatio Street), for vehicles more than 50 metres length;
 - (c) other heavy vehicle access to and from the site is via:
 - the northern route using Castlereagh Highway and Aarons Pass Road; or
 - the southern route using Hill End Road and the Ilford-Sofala Road or Sofala Road; or
 - the minor access routes using Bombandi Road and/or Crudine Road,
- unless the **Secretary** agrees otherwise.

Notes:

- The Applicant is required to obtain relevant permits under the Heavy Vehicle National Law (NSW) for the use of over-dimensional vehicles on the road network.
- Identified over-dimensional vehicle access routes through Mudgee are shown in Appendix 7.

Traffic Management

33. Prior to carrying out further work on the upgrades on Aarons Pass Road after the date of approval of Modification 1 or the commencement of the Bombandi Road upgrades, whichever occurs first, the Applicant must prepare a revised Traffic Management Plan for the development to the satisfaction of the Secretary. This plan must be prepared in consultation with RMS and the Councils, and include:
- (a) details of all transport routes and traffic types to be used for development-related traffic;
 - (b) a protocol for undertaking dilapidation surveys to assess the:
 - existing condition of the transport route/s prior to construction or decommissioning works; and
 - condition of the transport route/s following construction or decommissioning works;
 - (c) a protocol for the repair of any roads identified in the dilapidation surveys to have been damaged during construction or decommissioning works;
 - (d) details of the measures that would be implemented to minimise traffic safety issues and disruption to local users of the transport route/s during any road upgrades and construction or decommissioning works, including:
 - temporary traffic controls, including detours and signage;
 - notifying the local community about project-related traffic impacts;
 - minimising potential for conflict with school buses and rail services, including avoiding heavy vehicle transport through Mudgee between the hours of 7 am and 10 am and 2 pm and 4.30 pm Monday to Friday, as far as practicable;
 - undertaking monitoring and maintenance on Aarons Pass Road;
 - responding to any emergency repair or maintenance requirements; and
 - a traffic management system for managing over-dimensional vehicles; and
 - (e) a drivers code of conduct that addresses:
 - travelling speeds;
 - procedures to ensure that drivers adhere to the designated transport routes; and
 - procedures to ensure that drivers implement safe driving practices, particularly if using local roads through Mudgee.

If the construction and/or decommissioning of the development is to be staged, the obligations in this condition apply to each stage of construction and/or decommissioning.

34. Following approval, the Applicant must implement the measures described in the Traffic Management Plan.

AVIATION

Notification of Aviation Authorities

35. Prior to the commencement of construction of any wind turbine or wind monitoring mast, the Applicant shall provide the following information to CASA, Airservices Australia and the RAAF (together the authorities):
- (a) co-ordinates of latitude and longitude of each turbine and mast;
 - (b) the final height of each turbine and mast in Australian Height Datum;
 - (c) the ground level at the base of each turbine and mast in Australian Height Datum;
 - (d) confirmation of compliance with any OLS; and
 - (e) details of any aviation hazard lighting.

36. Within 30 days of the practical completion of any turbine or mast, the Applicant shall:
- (a) provide confirmation to the authorities and local aviation users that the information that was previously provided remains accurate; or
 - (b) update the information previously provided.

TELECOMMUNICATIONS

37. If the development results in the disruption to radio or telecommunications services in the area, then the Applicant shall make good any disruption to these services as soon as practicable following the disruption.

If there is a dispute about the mitigation measures to be implemented or the implementation of these mitigation measures, then either party may refer the matter to the Secretary for resolution.

BUSHFIRE

38. The Applicant shall:
- (a) ensure that the development:
 - provides for asset protection in accordance with the RFS's *Planning for Bushfire Protection 2006* (or equivalent);
 - is suitably equipped to respond to any fires on site;
 - (b) develop procedures to manage potential fires on site; and
 - (c) assist the RFS and emergency services as much as practicable if there is a fire in the vicinity of the site.

SAFETY

39. The Applicant shall:
- (a) prepare a Safety Management System for the development in accordance with the Department's *Hazardous Industry Planning Advisory Paper No. 9, 'Safety Management'* prior to commissioning any wind turbines on site; and
 - (b) implement, and if necessary update, the system over the remaining life of the development.

WASTE

40. The Applicant shall:
- (a) implement all reasonable and feasible measures to minimise the waste generated by the development;
 - (b) classify all waste in accordance with the EPA's *Waste Classification Guidelines* and at appropriately licensed waste facilities; and
 - (c) manage the waste in accordance with any requirements under the POEO Act and its associated regulations.

REHABILITATION & DECOMMISSIONING

Progressive Rehabilitation

41. The Applicant shall rehabilitate all areas of the site not proposed for future disturbance progressively, that is, as soon as reasonably practicable following construction or decommissioning. All reasonable and feasible measures must be taken to minimise the total area exposed at any time. Interim rehabilitation strategies shall be employed when areas prone to dust generation, soil erosion and weed incursion cannot yet be permanently rehabilitated.

Rehabilitation Objectives – Decommissioning

42. The Applicant shall rehabilitate the site to the satisfaction of the Secretary. This rehabilitation must comply with the objectives in [Table 7](#).

Table 7: Rehabilitation Objectives

<i>Feature</i>	<i>Objective</i>
Development site (as a whole)	<ul style="list-style-type: none">• Safe, stable and non-polluting• Minimise the visual impact of any above ground ancillary infrastructure agreed to be retained for an alternative use as far as is reasonable and feasible
Revegetation	<ul style="list-style-type: none">• Restore native vegetation generally as identified in the EA
Above ground wind turbine infrastructure (excluding wind turbine pads)	<ul style="list-style-type: none">• To be decommissioned and removed, unless the Secretary agrees otherwise
Above ground ancillary infrastructure	<ul style="list-style-type: none">• To be decommissioned and removed, unless an agreed alternative use is identified to the satisfaction of the Secretary
Internal access roads	<ul style="list-style-type: none">• To be decommissioned and removed, unless an agreed alternative use is identified to the satisfaction of the Secretary
Land use	<ul style="list-style-type: none">• Restore or maintain land capability as described in the EA
Community	<ul style="list-style-type: none">• Ensure public safety

Decommissioning of Wind Turbines

43. All wind turbines must be decommissioned within 18 months of the cessation of operations, unless the Secretary agrees otherwise.
44. Any individual wind turbines which cease operating for more than 12 consecutive months must be dismantled within 18 months after that 12 month period, unless the Secretary agrees otherwise.
-

SCHEDULE 4 ADDITIONAL PROCEDURES

NOTIFICATION OF LANDOWNERS

1. Within 1 month of the commencement of development under this consent, the Applicant shall notify in writing the owners of:
 - (a) the land listed in Table 1 of schedule 3 that they have the right to require the Applicant to acquire their land in accordance with the procedures in conditions 2 and 3 below at any time within 5 years after the commencement of construction of the applicable cluster; and
 - (b) the land/residences listed in Table 1 and Table 2 of schedule 3, and any other non-associated residence within 4 kilometres of any wind turbine, that they have the right to request the Applicant to implement visual impact mitigation measures at their residence (including its curtilage) at any time within 5 years following the commencement of construction of the development.

In addition to the notification requirements in 1(a) above, within 1 month of the commencement of construction of the applicable cluster under this consent, the Applicant shall re-notify in writing the owners of the land listed in Table 1 of schedule 3 that construction of the applicable cluster has commenced.

LAND ACQUISITION

2. Within 3 months of receiving a written request from a landowner with acquisition rights, the Applicant shall make a binding written offer to the landowner based on:
 - (a) the current market value of the landowner's interest in the land at the date of this written request, as if the land was unaffected by the development, having regard to the:
 - existing and permissible use of the land, in accordance with the applicable planning instruments at the date of the written request; and
 - presence of improvements on the land and/or any approved building or structure which has been physically commenced at the date of the landowner's written request, and is due to be completed subsequent to that date, but excluding any improvements or reasonable costs that have resulted from the implementation of the visual impact mitigation measures in condition 2 of schedule 3;
 - (b) the reasonable costs associated with:
 - relocating within the Bathurst or Mid-Western Regional local government areas, or to any other local government area determined by the Secretary; and
 - obtaining legal advice and expert advice for determining the acquisition price of the land, and the terms upon which it is to be acquired; and
 - (c) reasonable compensation for any disturbance caused by the land acquisition process.

However, if at the end of this period, the Applicant and landowner cannot agree on the acquisition price of the land and/or the terms upon which the land is to be acquired, then either party may refer the matter to the Secretary for resolution.

Upon receiving such a request, the Secretary shall request the President of the NSW Division of the Australian Property Institute to appoint a qualified independent valuer to:

- consider submissions from both parties;
- determine a fair and reasonable acquisition price for the land and/or the terms upon which the land is to be acquired, having regard to the matters referred to in paragraphs (a)-(c) above;
- prepare a detailed report setting out the reasons for any determination; and
- provide a copy of the report to both parties.

Within 14 days of receiving the independent valuer's report, the Applicant shall make a binding written offer to the landowner to purchase the land at a price not less than the independent valuer's determination.

However, if either party disputes the independent valuer's determination, then within 14 days of receiving the independent valuer's report, they may refer the matter to the Secretary for review. Any request for a review must be accompanied by a detailed report setting out the reasons why the party disputes the independent valuer's determination. Following consultation with the independent valuer and both parties, the Secretary will determine a fair and reasonable acquisition price for the land, having regard to the matters referred to in paragraphs (a)-(c) above, the independent valuer's report, the detailed report of the party that disputes the independent valuer's determination, whether an adjustment to the market value of the land since the independent valuation was completed is warranted and any other relevant submissions.

Within 14 days of this determination, the Applicant shall make a binding written offer to the landowner to purchase the land at a price not less than the Secretary's determination.

If the landowner refuses to accept the Applicant's binding written offer under this condition within 6 months of the offer being made, unless the Secretary determines otherwise, then the Applicant's obligations to acquire the land shall cease.

3. The Applicant shall pay all reasonable costs associated with the land acquisition process described in condition 2 above, including the costs associated with obtaining Council approval for any plan of subdivision (where permissible), and registration of this plan at the Office of the Registrar-General.
-

SCHEDULE 5

ENVIRONMENTAL MANAGEMENT, REPORTING AND AUDITING

ENVIRONMENTAL MANAGEMENT

Environmental Management Strategy

1. Prior to the commencement of construction, the Applicant shall prepare an Environmental Management Strategy for the development to the satisfaction of the Secretary. This strategy must:
 - (a) provide the strategic framework for environmental management of the development;
 - (b) identify the statutory approvals that apply to the development;
 - (c) describe the role, responsibility, authority and accountability of all key personnel involved in the environmental management of the development;
 - (d) describe the procedures that would be implemented to:
 - keep the local community and relevant agencies informed about the operation and environmental performance of the development;
 - receive, handle, respond to, and record complaints;
 - resolve any disputes that may arise;
 - respond to any non-compliance;
 - respond to emergencies; and
 - (e) include:
 - copies of any strategies, plans and programs approved under the conditions of this consent; and
 - a clear plan depicting all the monitoring to be carried out in relation to the development.
2. Following approval, the Applicant shall implement the Environmental Management Strategy.

Adaptive Management

3. The Applicant shall assess and manage development-related risks to ensure that there are no exceedances of the criteria and/or performance measures in schedule 3. Any exceedance of these criteria and/or performance measures constitutes a breach of this consent and may be subject to penalty or offence provisions under the EP&A Act or EP&A Regulation.

Where any exceedance of these criteria and/or performance measures has occurred, the Applicant must, at the earliest opportunity:

- (a) take all reasonable and feasible steps to ensure that the exceedance ceases and does not recur;
- (b) consider all reasonable and feasible options for remediation (where relevant) and submit a report to the Department describing those options and any preferred remediation measures or other course of action; and
- (c) implement remediation measures as directed by the Secretary.

Revision of Strategies, Plans and Programs

4. Within 3 months of:
 - (a) the submission of an incident report under condition 6 below;
 - (b) the submission of an audit under condition 8 below; or
 - (c) any modification to the conditions of this consent (unless the conditions require otherwise),

the Applicant shall review and, if necessary, revise the strategies, plans, and programs required under this consent to the satisfaction of the Secretary. Where this review leads to revisions in any such document, then within 4 weeks of the review the revised document must be submitted to the Secretary for approval.

Note: This is to ensure the strategies, plans and programs are updated on a regular basis, and incorporate any recommended measures to improve the environmental performance of the development.

Community Consultative Committee

5. The Applicant shall establish and operate a Community Consultative Committee (CCC) for the development to the satisfaction of the Secretary. This CCC must be established and operated in accordance with any applicable CCC guideline.

Notes:

- *The CCC is an advisory committee. The Department and other relevant agencies are responsible for ensuring the Applicant complies with this consent.*
- *The CCC should be comprised of an independent chair and appropriate representation from the Applicant, Councils and the local community.*

REPORTING

Incident Notification

6. The Department must be notified **via the Major Projects website portal** within 7 days after the Applicant becomes aware of the incident. The notification must identify the development, including the development application number and the name of the development, and set out the location and nature of the incident.

Non-Compliance Notification

- 6A. The Department must be notified **via the Major Projects website portal** within 7 days after the Applicant becomes aware of any non-compliance. The notification must identify the development and the application number for it, set out the condition of consent that the development is non-compliant with, the way in which it does not comply and the reasons for the non-compliance (if known) and what actions have been done, or will be undertaken, to address the non-compliance.

Regular Reporting

7. The Applicant shall provide regular reporting on the environmental performance of the development on its website, in accordance with the reporting arrangements in any plans or programs approved under the conditions of this consent.

AUDITING

8. Within 1 year of the commencement of construction, and every 3 years thereafter, unless the Secretary directs otherwise, the Applicant shall commission and pay the full cost of an Independent Environmental Audit of the development. This audit must:
 - (a1) be prepared in accordance with the relevant *Independent Audit Post Approval Requirements (DPE 2018, or its latest version)*;
 - (a) be conducted by a suitably qualified, experienced and independent team of experts whose appointment has been endorsed by the Secretary;
 - (b) include consultation with the relevant agencies;
 - (c) assess the environmental performance of the development, **and whether it complies with the relevant requirements in this consent**;
 - (d) review the adequacy of any approved strategy, plan or program required under the abovementioned **consent**; and
 - (e) recommend measures or actions to improve the environmental performance of the development, and/or any strategy, plan or program required under **this consent**.

Note: This audit team must be led by a suitably qualified auditor and/or experts in any other fields specified by the Secretary.
9. Within 3 months of commissioning this audit, or as otherwise agreed by the Secretary, the Applicant shall submit a copy of the audit report to the Secretary, together with its response to any recommendations contained in the audit report.

ACCESS TO INFORMATION

10. The Applicant shall:
 - (a) make the following information publicly available on its website as relevant to the stage of the development:
 - the EA;
 - the final layout plans for the development;
 - current statutory approvals for the development;
 - approved strategies, plans or programs required under the conditions of this consent;
 - the proposed staging plans for the development if the construction, operation and/or decommissioning of the development is to be staged;
 - a comprehensive summary of the monitoring results of the development, which have been reported in accordance with the various plans and programs approved under the conditions of this consent;
 - a complaints register, which is to be updated on a monthly basis;
 - minutes of CCC meetings;
 - the annual Statement of Compliance with the EPL;

- any independent environmental audit, and the Applicant's response to the recommendations in any audit; and
 - any other matter required by the Secretary; and
- (b) keep this information up to date,
to the satisfaction of the Secretary.
-

APPENDIX 1: SCHEDULE OF LAND

Wind Farm


Landowner	Lot	DP	Landowner	Lot	DP
Landowner 2	100	756878	Landowner 6	1 101	870385 755792
Landowner 3	2	740568	Landowner 5	27 100	755792 756913
Landowner 4	35	756878	Landowner 8	209 218	756913 756913
Landowner 10	123 129 169 188	756913 756913 756913 756913	Landowner 15	27 57 134 135 136 137 190 202 210 211	756913 756913 756913 756913 756913 756913 756913 756913 756913 756913
Landowner 1	177	756913	Landowner 16	17 24 35 36 39 47 98 125 141 159 160	756913 756913 756913 756913 756913 756913 756913 756913 756913 756913 756913
Landowner 9	8 18 199	756913 756913 756913		45 46 65 79 88 89	755792 755792 755792 755792 755792 755792
Landowner 11	1 97 17 76 161	734393 756878 756878 756878 756878		37 38 46 53 60 127	756913 756913 756913 756913 756913 756913
Landowner 12	1 44 62 63 64 81 99	1097478 755792 755792 755792 755792 755792 755792			
Landowner 13	156 162 171 173 179 195 197 214	756909 756913 756913 756913 756913 756913 756913 756913			
Landowner 14	12 13 10 165 184 185	756913 756913 756913 756913 756913 756913			

Aarons Pass Road Upgrades

Tenure	Lot	DP
Freehold	9	246645
Freehold	140	756909
Freehold	144	756909
Freehold	154	756909
Freehold	155	756909
Freehold	1	246645
Freehold	8	246645
Freehold	1	1154792
Freehold	4	563144
Freehold	143	756909
Freehold	1	1101182
Freehold	134	756909
Crown Land	51	1160463
Crown Land	101	1063263

Note: The project site will also be taken to include any crown land, and any road reserves, contained within the project site.


APPENDIX 2: GENERAL LAYOUT OF DEVELOPMENT

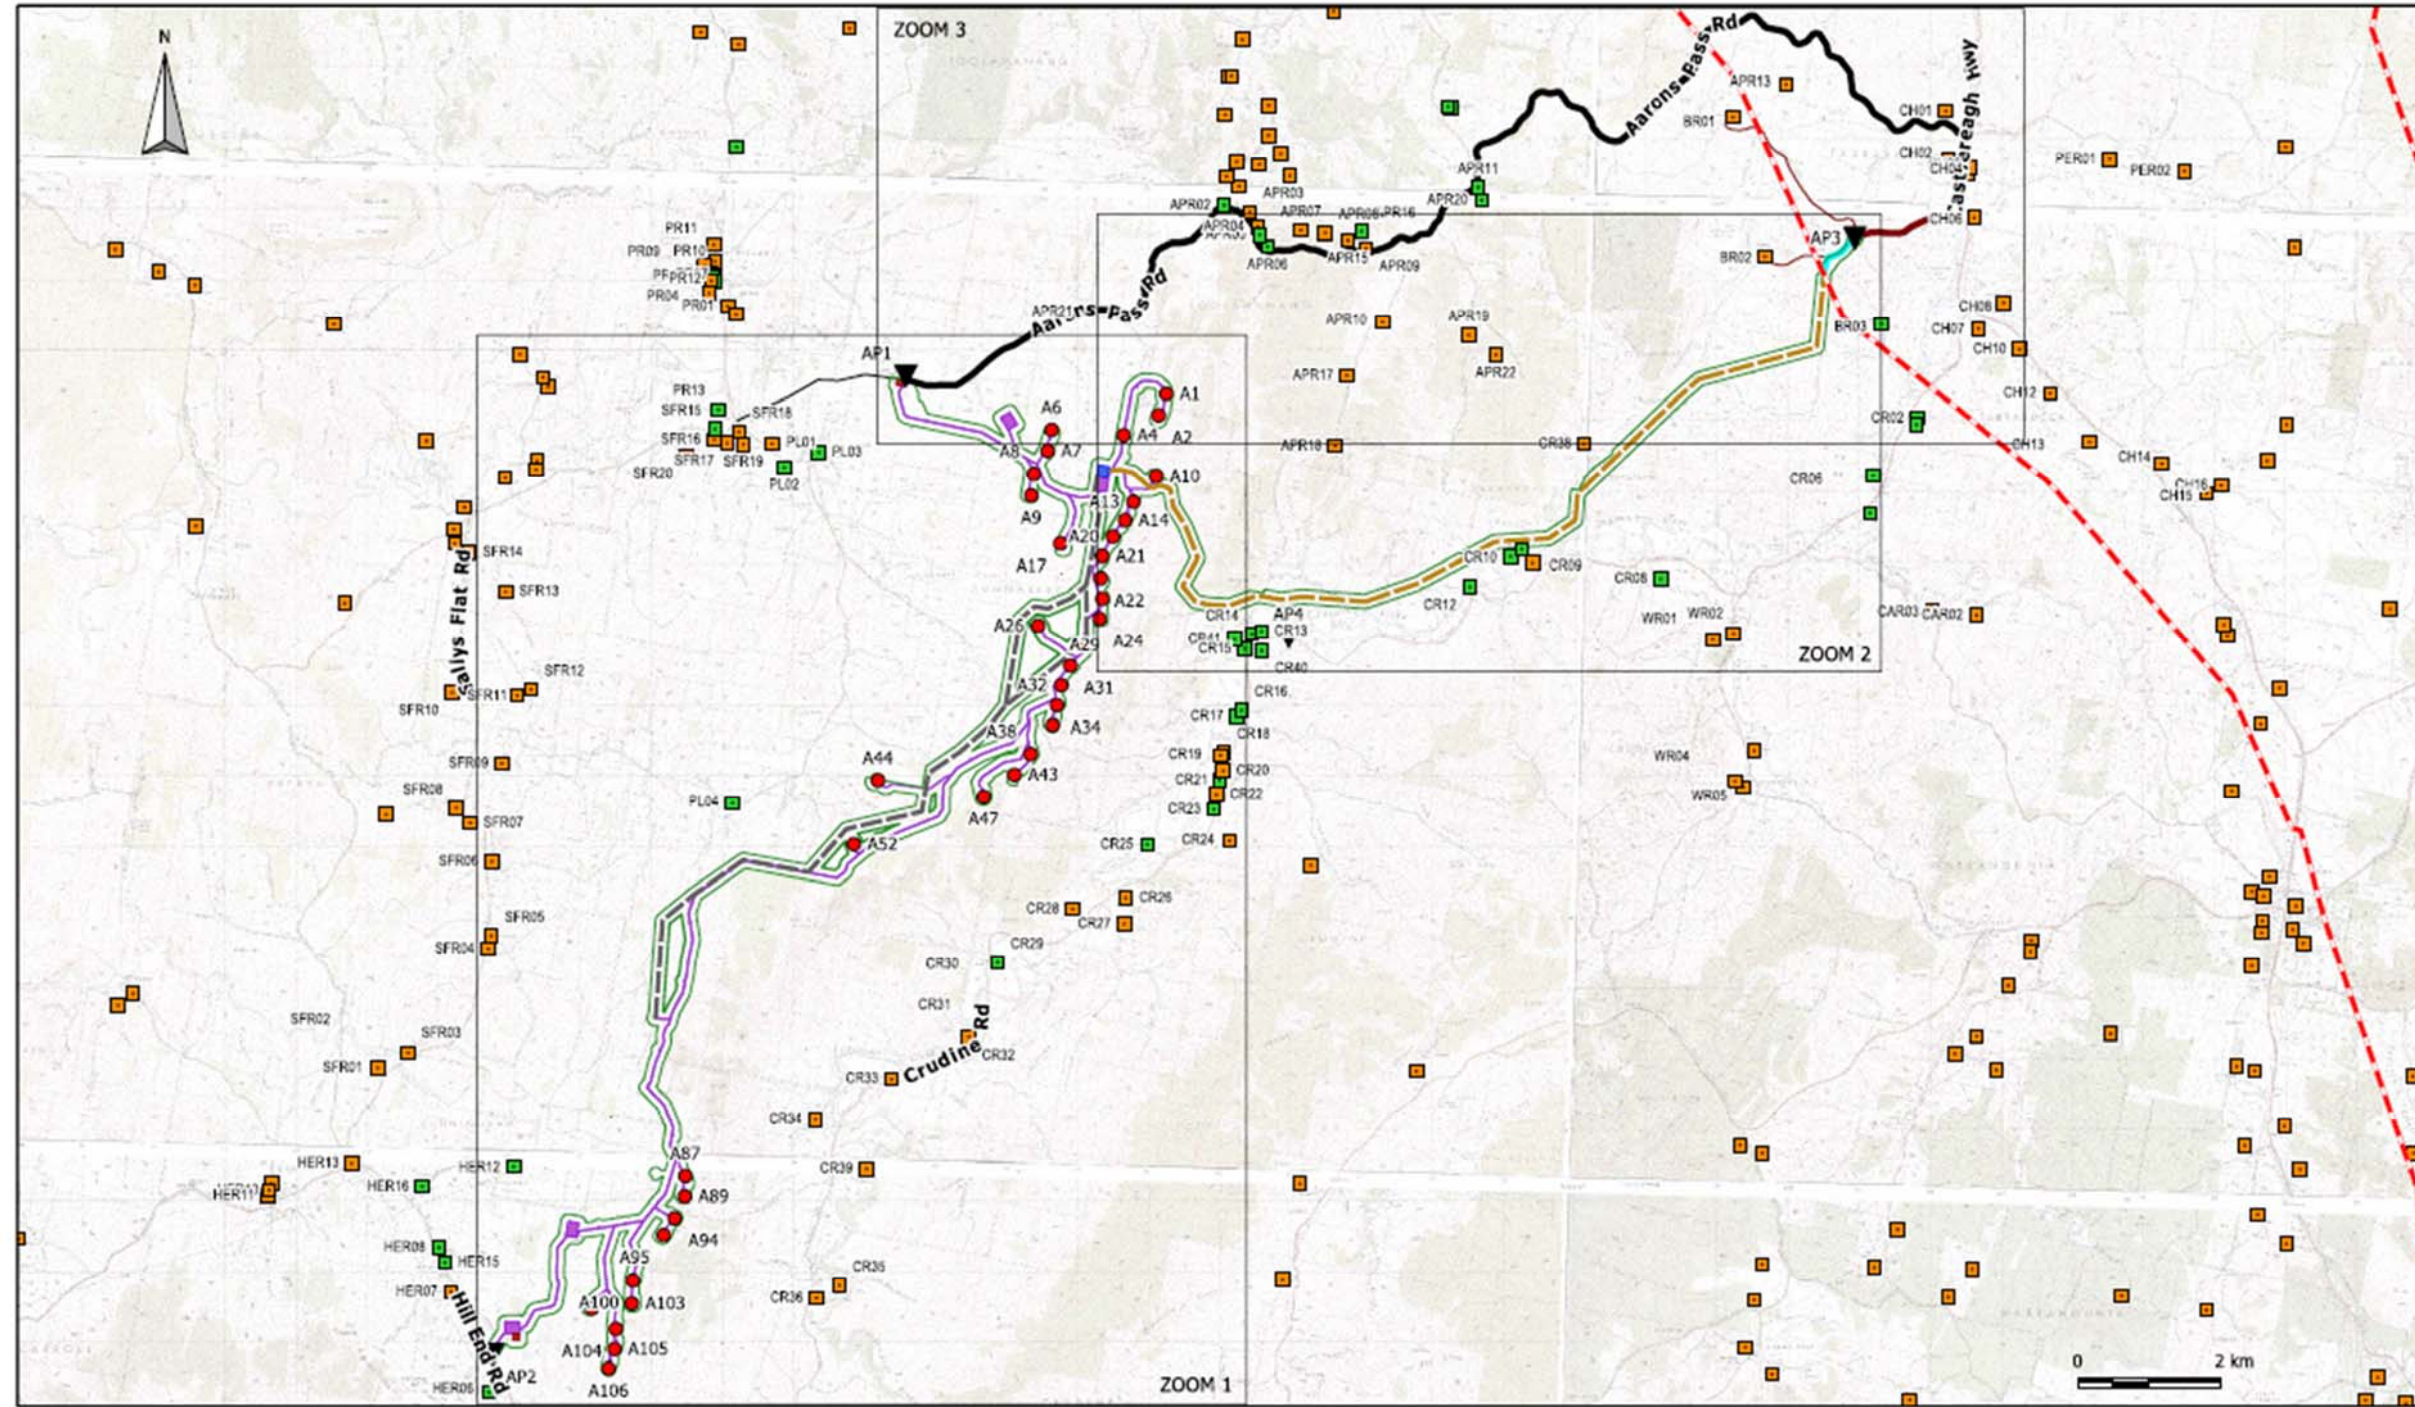


LEGEND		COMPANY				
● GE 37 WTG Locations	— Micro-sited Layout - Internal Roads	— Internal Overhead Transmission Line	CRWF NOMINEES PTY LTD			
■ Involved Residence	■ Non-involved Residence	— External Overhead Transmission Line	TITLE			
— Aaron's Pass Rd	— Aaron's Pass Rd Upgrade	— 132 kV Transmission Line	DPE OVERVIEW MAPS			
— Eldon Court laneway to switching station	— Bombandi Road	— CRWF Development Corridor	DATE	SCALE	DWG NO	REV
— Bombandi Road Upgrade	— Secondary Collector Substation	— Site Compound Options	19 MAR 2019	1:87000	CRU311	A
	— Rock Crushing & Batching Plant	▲ Access Point	DRAWN BY	CHECKED BY	SHEET	JOB NO
			B KRONENBERG	M BRANSON	1 OF 4	080401
						VER
						3
						SIZE
						A3

Wind Turbine Coordinates

X	Y	ID
751340.9	6356501	A1
751252	6356181	A2
750785.3	6355965	A4
749769	6356019	A6
749694	6355769	A7
749498.5	6355437	A8
749443	6355112	A9
751219	6355394	A10
750903.1	6355110	A13
750819	6354844	A14
749929.7	6354425	A17
750594	6354469	A20
750427.5	6354203	A21
750476.4	6353901	A22
750469	6353644	A23
750440.8	6353372	A24
749560.7	6353341	A26
750207.5	6352954	A29
750018.6	6352707	A31
749816.3	6352445	A32
749847.4	6352174	A34
749751.9	6351903	A35
749465.2	6351478	A38
749242.9	6351107	A43
747298.4	6351105	A44
748805.1	6350872	A47
746971.7	6350212	A52
744607.1	6345442	A87
744562.6	6345251	A89
744469.3	6344920	A94
744267	6344662	A95
743867	6344045	A100
743293.6	6343722	A102
743862.5	6343758	A103
743615.9	6343396	A104
743624.8	6343149	A105
743544.7	6342873	A106

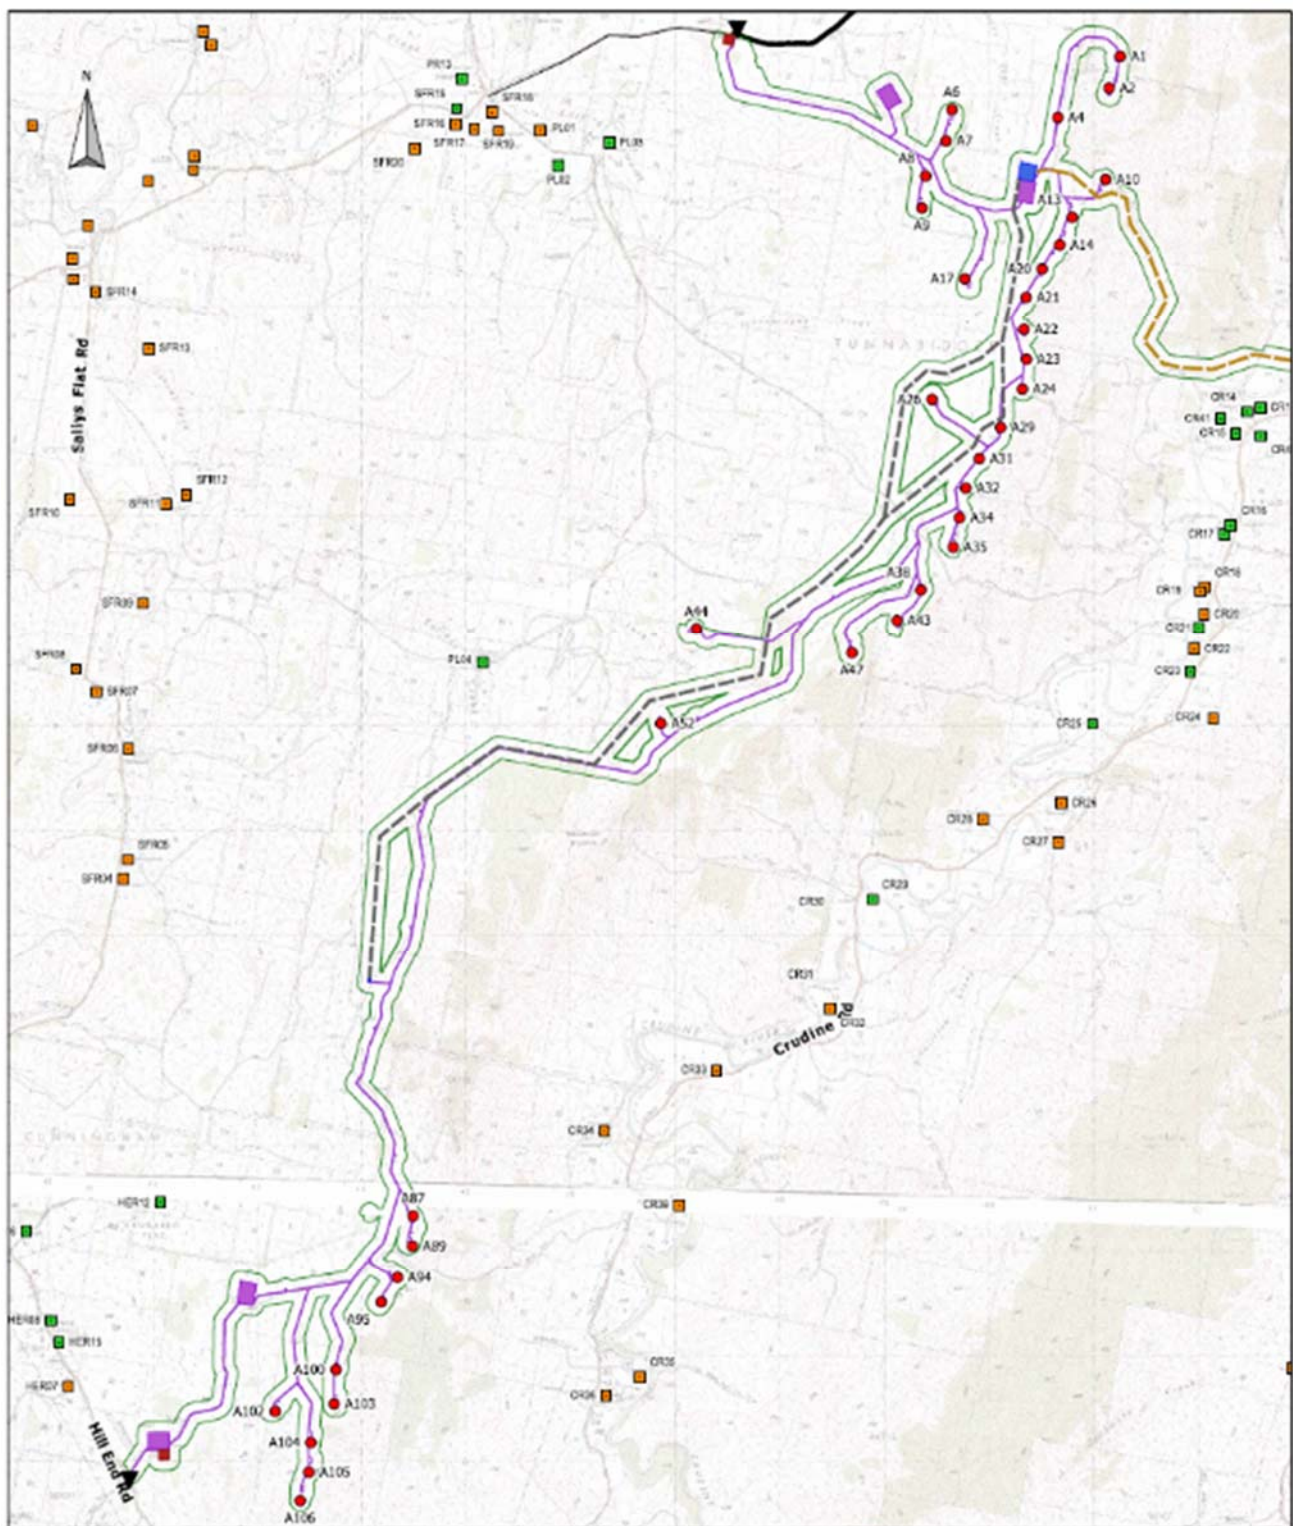

LEGEND		COMPANY		CRWF NOMINEES PTY LTD							
 37 WYG Micro-sited Layout		 Internal Overhead Transmission Line		TITLE FIGURE 2: PROPOSED MODIFICATION							
 Micro-sited Layout - Internal Roads		 External Overhead Transmission Line									
 Involved Residence		 132 kV Transmission Line									
 Non-involved Residence		 Development Corridor									
 Aerons Pass Rd		 Secondary Collector Substation									
 Aerons Pass Rd Upgrade		 Site Compound Options									
 Eldon Court laneway to switching station		 Rock Crushing & Batching Plant Options									
 Bombardi Rd		 Access Point									
 Bombardi Rd Upgrade											
SCALE BAR		DATE		SCALE		DWG NO		REV		VER	
		24 JAN 2019		1:46000		CRU308		A		2	
		DRAWN BY		CHECKED BY		SHEET		JOB NO		SIZE	
		B KRONENBERG		M BRANSON		1 OF 3		080401		A3	

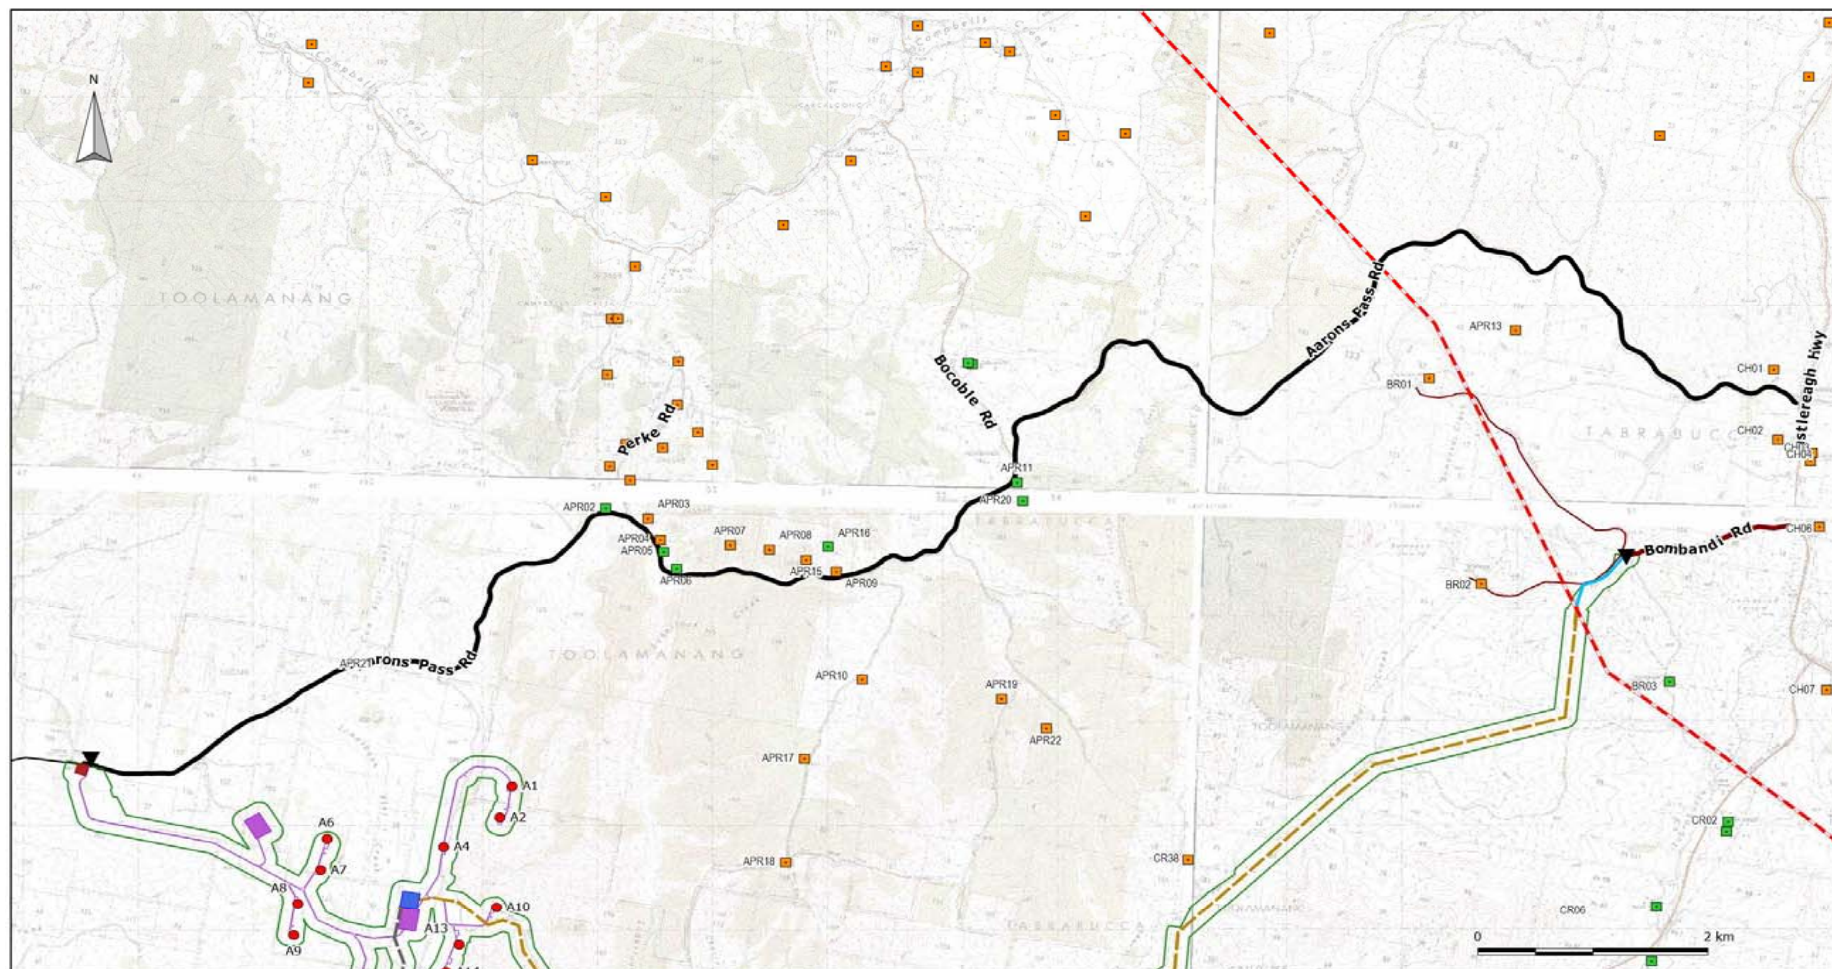

LEGEND

- 37 WTG Micro-sited Layout
- Micro-sited Layout - Internal Roads
- Involved Residence
- Non-Involved Residence
- Aaron's Pass Rd
- Aaron's Pass Rd Upgrade
- Eldon Court laneway to switching station
- Bombandi Rd
- Bombandi Rd Upgrade
- Internal Overhead Transmission Line
- External Overhead Transmission Line
- 132 kV Transmission Line
- Development Corridor
- Secondary Collector Substation
- Site Compound Options
- Rock Crushing & Batching Plant Options
- ▼ Access Point

COMPANY

CRWF NOMINEES PTY LTD



TITLE

FIGURE 2: PROPOSED MODIFICATION

DATE	24 JAN 2019	SCALE	1:42000	DWG NO	CRU308	REV	A	VER	1
DRAWN BY	B KRONENBERG	CHECKED BY	M BRANSON	SHEET	3 OF 3	JOB NO	080401	SIZE	A3

APPENDIX 3: GENERAL TERMS OF APPLICANT'S VPA OFFER

The VPAs shall include provisions for the payment, collection, management and distribution of the contributions under the agreement, with a focus on funding community projects in the area surrounding the project site.

Council	Payment Details
MWRC	\$1,250 per megawatt (MW) per annum as installed at the development within the Mid-Western Regional Council local government area over the operational life of the development, commencing the date on which the development begins operation and ceasing when the development is decommissioned in accordance with the definitions within this consent, and CPI adjusted from 1 July commencing on the first anniversary of the operational date.
BSC	\$1,250 per megawatt (MW) per annum as installed at the development within the Bathurst Regional Council local government area over the operational life of the development, commencing the date on which the development begins operation and ceasing when the development is decommissioned in accordance with the definitions within this consent, and CPI adjusted from 1 July commencing on the first anniversary of the operational date.

APPENDIX 4: NOISE COMPLIANCE ASSESSMENT

PART A: SOUTH AUSTRALIAN WIND FARMS: ENVIRONMENTAL NOISE GUIDELINES 2009 (MODIFIED)

South Australian *Wind Farms: Environmental Noise Guidelines 2009* (Modified) refers to the South Australian EPA document modified for use in NSW.

The modifications are as follows:

Tonality

The presence of excessive tonality (a special noise characteristic) is consistent with that described in *ISO 1996.2: 2007 Acoustics — Description, measurement and assessment of environmental noise – Determination of environmental noise levels* and is defined as when the level of one-third octave band measured in the equivalent noise level $L_{eq}(10\text{minute})$ exceeds the level of the adjacent bands on both sides by:

- 5dB or more if the centre frequency of the band containing the tone is in the range 500Hz to 10,000Hz;
- 8dB or more if the centre frequency of the band containing the tone is in the range 160 to 400Hz; and/or
- 15dB or more if the centre frequency of the band containing the tone is in the range 25Hz to 125Hz.

If tonality is found to be a repeated characteristic of the wind turbine noise, 5 dB(A) should be added to measured noise levels from the wind farm. If tonality is only identified for certain wind directions and speeds, the penalty is only applicable under these conditions. The tonal characteristic penalty applies only if the tone from the wind turbine is audible at the relevant receiver. Absence of tone in noise emissions measured at an intermediate location is sufficient proof that the tone at the receiver is not associated with the wind farm's operation. The assessment for tonality should only be made for frequencies of concern from 25 Hz to 10 KHz and for sound pressure levels above the threshold of hearing (as defined in *ISO 389.7: 2005 Acoustics - Reference zero for the calibration of audiometric equipment - Part 7: Reference threshold of hearing under free-field and diffuse-field listening conditions*).

Low Frequency Noise

The presence of excessive low frequency noise (a special noise characteristic) [i.e. noise from the wind farm that is repeatedly greater than 65 dB(C) during the day time or 60 dB(C) during the night time at any relevant receiver] will incur a 5 dB(A) penalty, to be added to the measured noise level for the wind farm, unless a detailed internal low frequency noise assessment demonstrates compliance with the proposed criteria for the assessment of low frequency noise disturbance (UK Department for Environment, Food and Rural Affairs (DEFRA, 2005)) for a steady state noise source.

Notes:

- For the purposes of these conditions, a special noise characteristic is defined as a repeated characteristic if it occurs for more than 10% of an assessment period. This equates to being identified for more than 144 minutes during any 24 hour period. This definition refers to verified wind farm noise only.
- The maximum penalty to be added to the measured noise level from the wind farm for any special noise characteristic individually or cumulatively is 5 dB(A).

PART B: NOISE COMPLIANCE ASSESSMENT


Applicable Meteorological Conditions – Wind Turbines

1. The noise criteria in Table 4 of the conditions are to apply under all meteorological conditions.

Applicable Meteorological Conditions – Other Facilities

2. The noise criteria in Condition 15 are to apply under all meteorological conditions except the following:
 - a) wind speeds greater than 3 m/s at 10 m above ground level; or
 - b) temperature inversion conditions between 1.5 °C and 3°C/100m and wind speeds greater than 2 m/s at 10 m above ground level; or
 - c) temperature inversion conditions greater than 3°C/100m.

APPENDIX 5: BIODIVERSITY OFFSET AREA

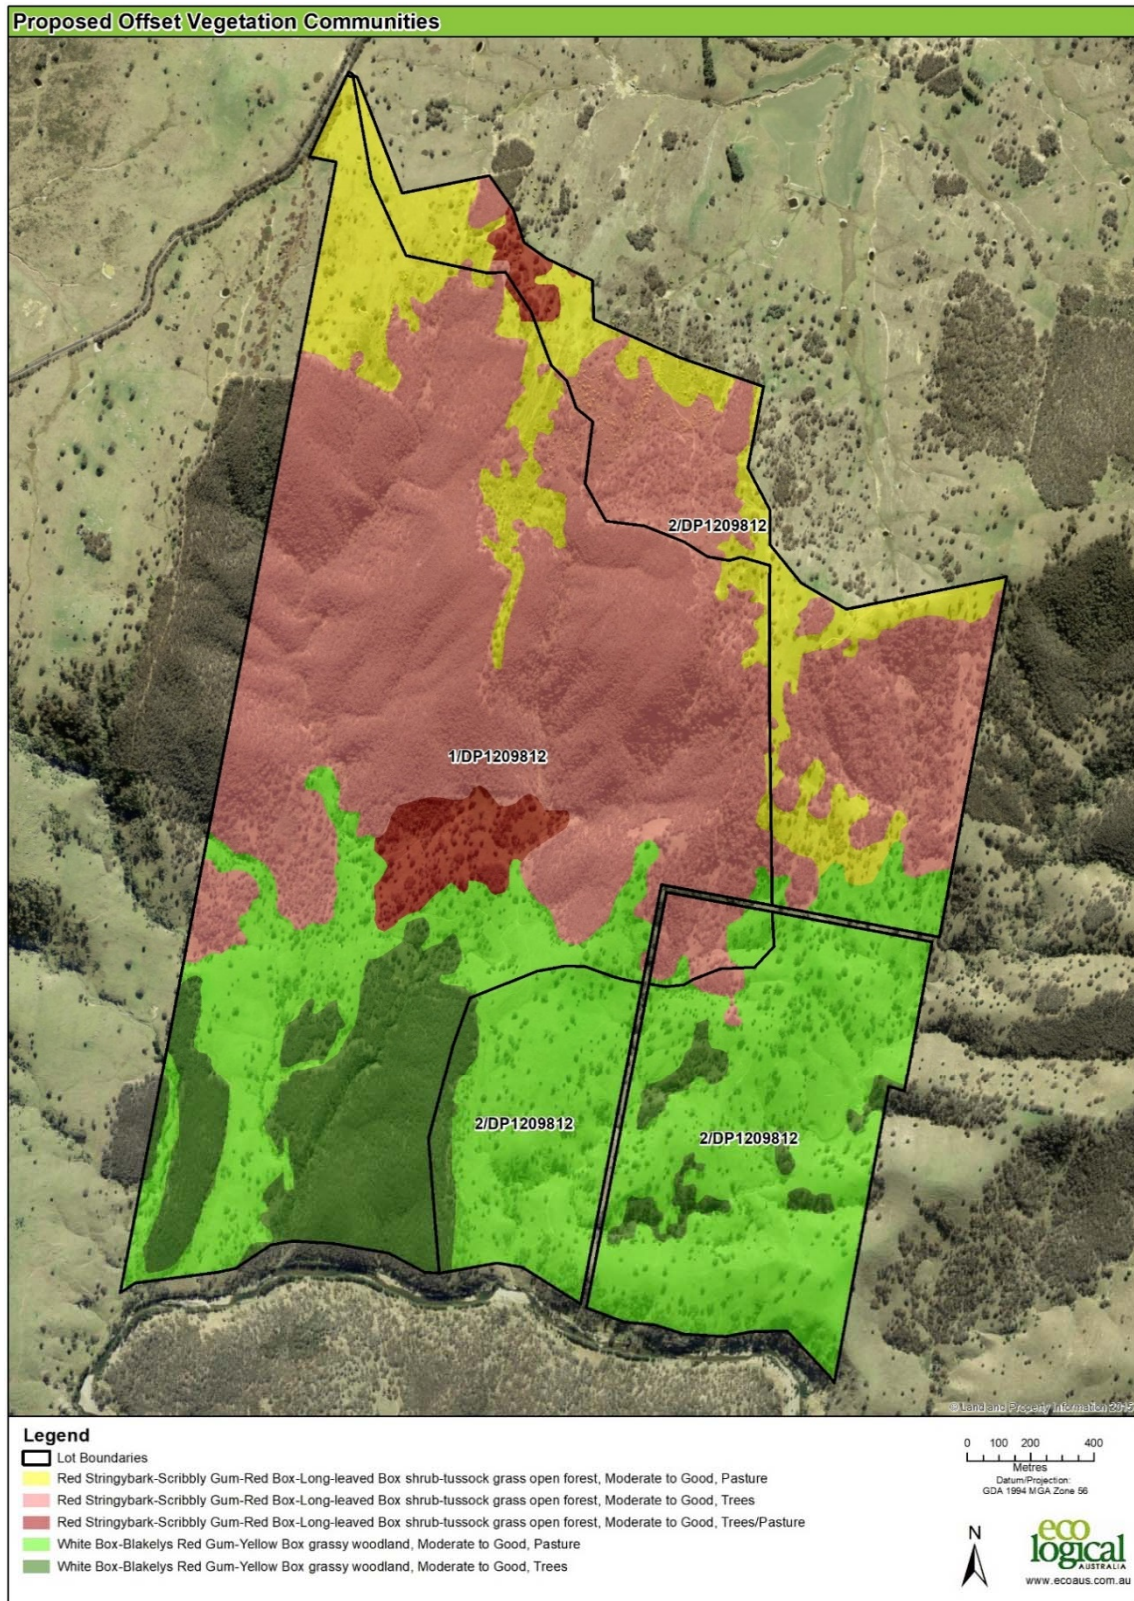

APPENDIX 6: ROAD UPGRADE REQUIREMENTS

Aarons Pass Road

Geometry / Feature Description	Design Specifications
Min. Road Width	6.0 m
Max. Gradient	15%
Min. Radius (H)	60 m
Min. Radius (V)	400 m
Passing Opportunities	Passing bays to be constructed at approximate 1 km intervals at the locations to be agreed with MWRC
Fill Batters	1:2 or as otherwise agreed with MWRC
Cut Batters	Generally 1:2 (1:1 at steep batters) or as otherwise agreed with MWRC
Longitudinal Drainage	Longitudinal drain capacity 1:2 or as otherwise agreed with MWRC
Cross-road Drainage	Cross road drainage designed to meet MWRC requirements

Bombandi Road

1. Installation of five [5] heavy duty grids with end assemblies and gates at the locations of the existing grids.
2. Installation of two [2] culverts at approximately 200 metres and 500 metres from the Castlereagh Highway.
3. Maintenance of the used section of Bombandi Road for the duration of the Lease.
4. Establish a new access ("Eldon Court Laneway to Switching Station") point from Bombandi Road approximately 80 metres west from the Eldon Court driveway and which is approximately 1.5 kilometres west from the Castlereagh Highway.

APPENDIX 7: OVER-DIMENSIONAL VEHICLE ACCESS ROUTE RESTRICTIONS

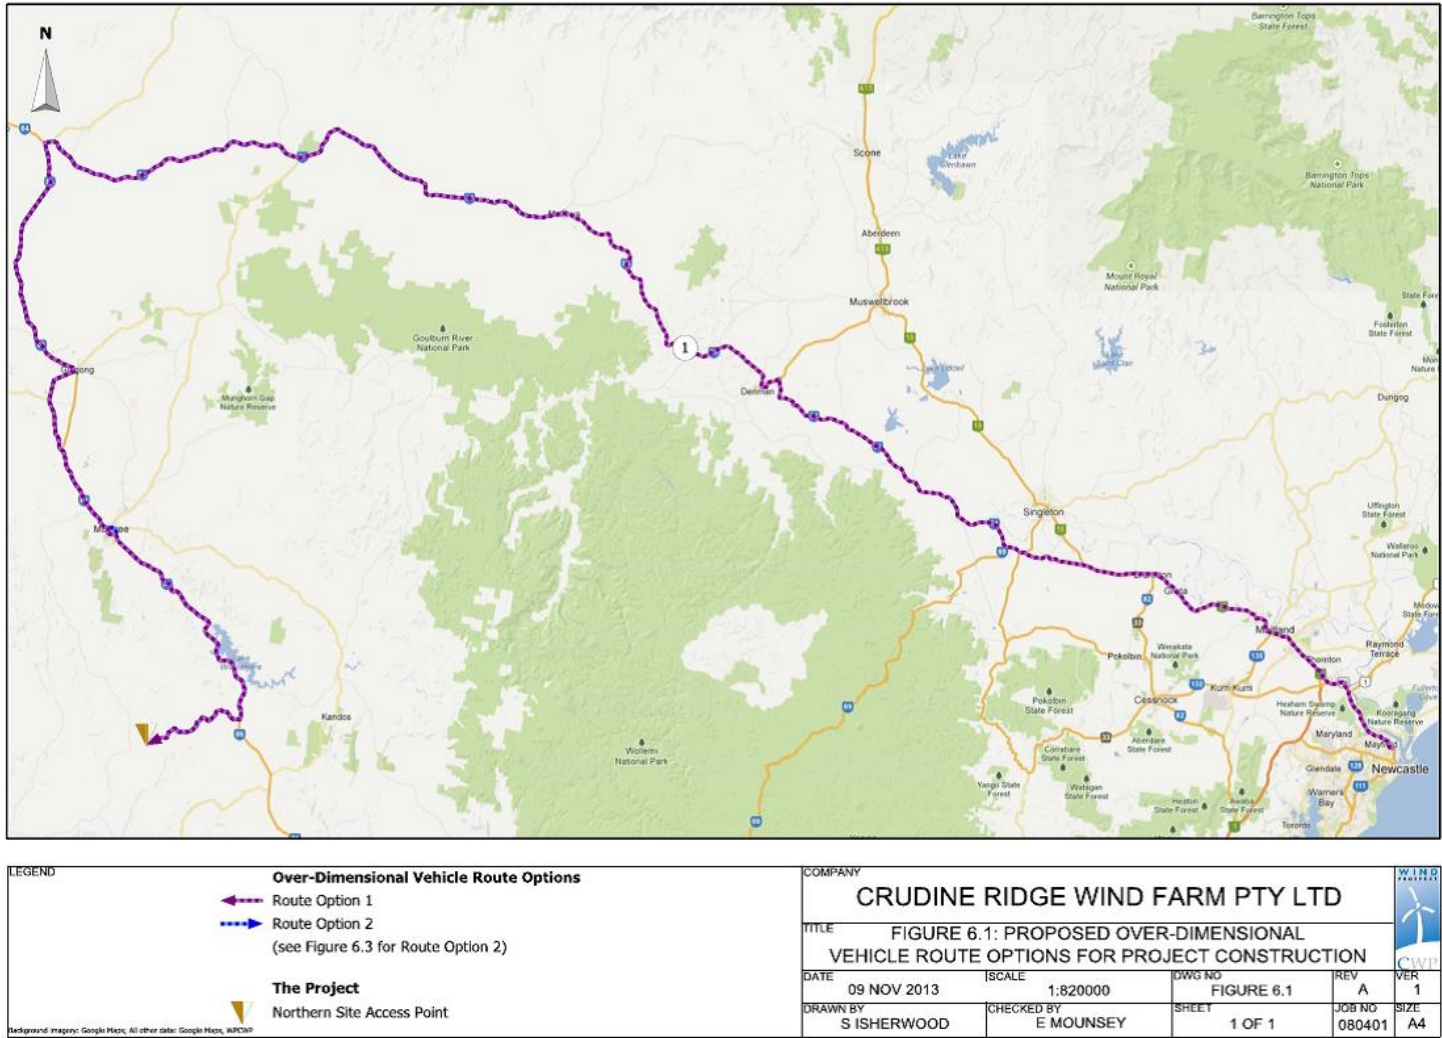


Figure 7A: Overview of Over-Dimensional Vehicle Route from Port of Newcastle to Northern Site Access Point

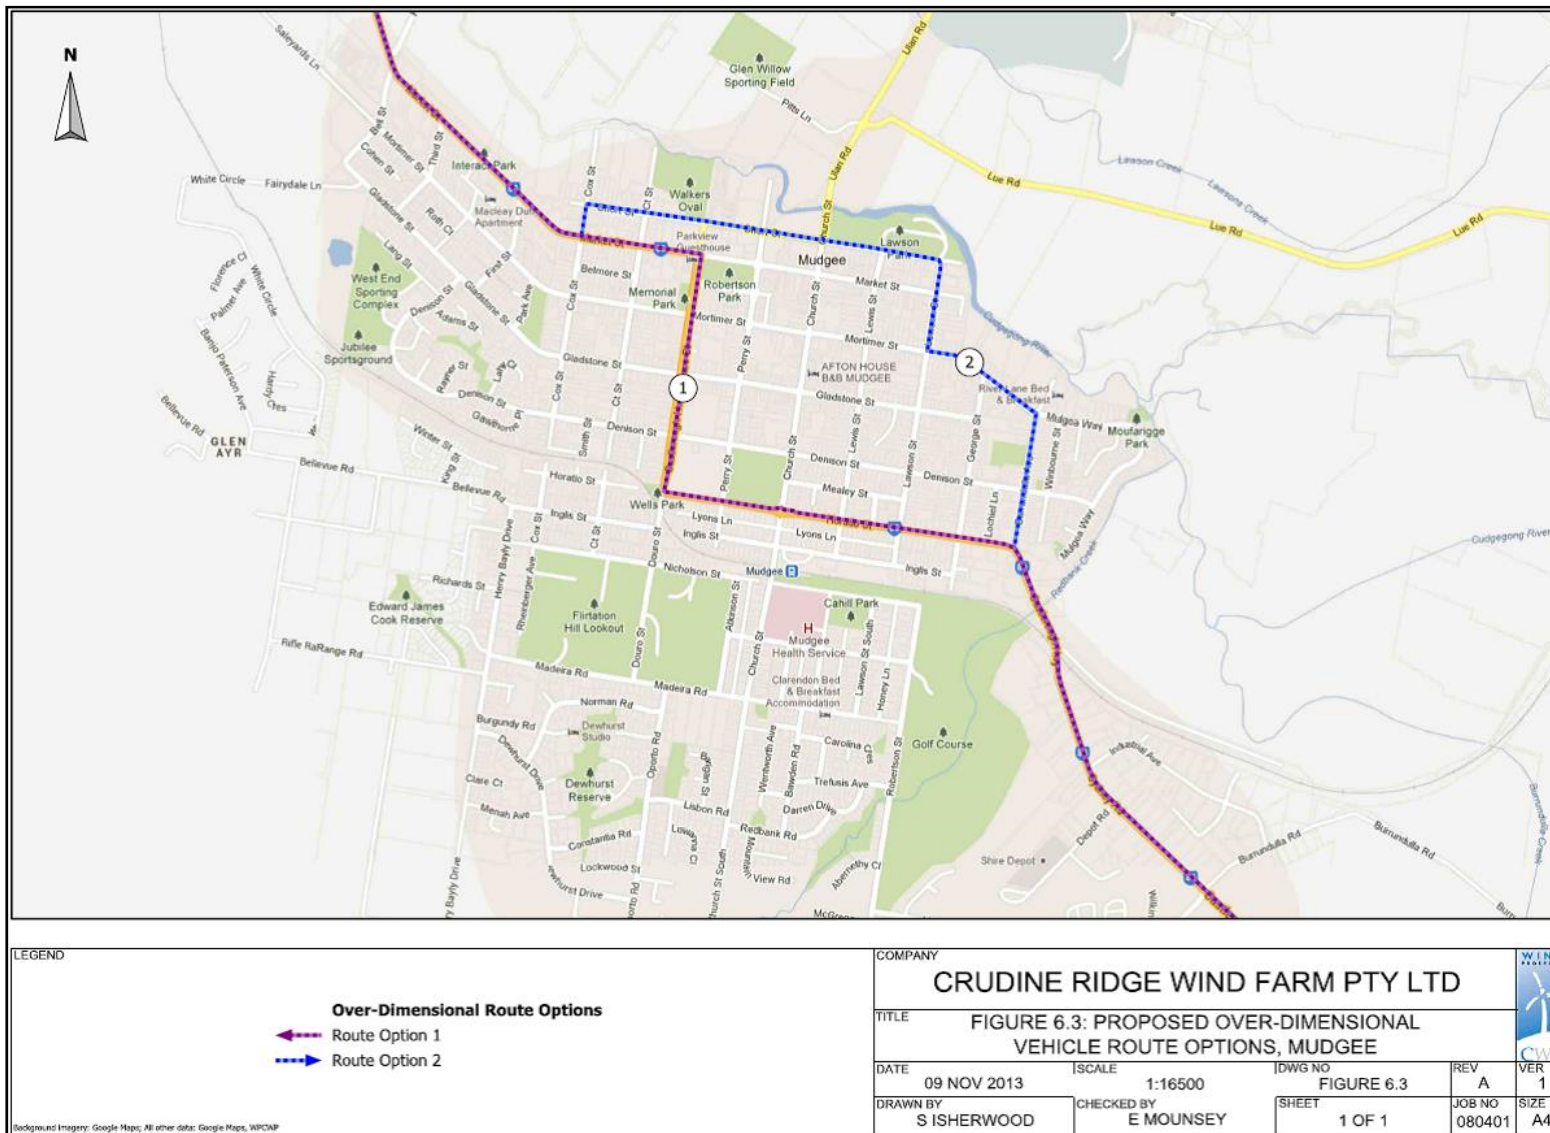


Figure 7B: Over-Dimensional Vehicle Route Options – Mudgee