



SOLAR LIGHT REFLECTIVITY ANALYSIS

LEES1 BUILDING, UNIVERSITY OF SYDNEY

WC596-04AF03(REV0)- SR REPORT (LEES1)

MAY 20, 2016

Prepared for:

Richard Crookes Constructions Pty Ltd

214 Willoughby Road
Naremburn, NSW 2065

DOCUMENT CONTROL

Date	Revision History	Issued Revision	Prepared By (initials)	Instructed By (initials)	Reviewed & Authorised by (initials)
May 20, 2016	Update of previous report (report reference WC596-03AF03(rev0), dated march 14, 2016) for the latest design scheme.	0	MC	TR	MC

The work presented in this document was carried out in accordance with the Windtech Consultants Quality Assurance System, which is based on International Standard ISO 9001.

This document is issued subject to review and authorisation by the Team Leader noted by the initials printed in the last column above. If no initials appear, this document shall be considered as preliminary or draft only and no reliance shall be placed upon it other than for information to be verified later.

This document is prepared for our Client's particular requirements which are based on a specific brief with limitations as agreed to with the Client. It is not intended for and should not be relied upon by a third party and no responsibility is undertaken to any third party without prior consent provided by Windtech Consultants. The information herein should not be reproduced, presented or reviewed except in full. Prior to passing on to a third party, the Client is to fully inform the third party of the specific brief and limitations associated with the commission.

EXECUTIVE SUMMARY

This report presents the results of a detailed study for the effect of potential solar glare from the proposed development known as Building LEES1, located within the University of Sydney. The analysis has been undertaken based on the architectural drawings prepared by the project architect Rice Daubney, received during May 2016.

This study identifies any possible adverse reflected solar glare conditions affecting motorists and pedestrians within the local surrounding area, and to occupants of neighbouring buildings. If necessary, recommendations are made to mitigate any potentially adverse effects. This study assesses compliance with the controls for solar glare from the City of Sydney Development Control Plan 2012.

A site survey has been undertaken to obtain photographs of the critical sightlines of motorists on surrounding streets. These photographs are calibrated and are able to be overlaid with a glare meter, which allows the extent, if any, of potential solar glare reflections from the subject development to be determined.

The results of the study indicate that, to avoid any adverse glare to motorists and pedestrians on the surrounding streets, occupants of neighbouring buildings, and to comply with the abovementioned planning control requirements, it is recommended that all glazing used on the external façade of the development should have a maximum normal specular reflectance of visible light of 20%.

It should be noted that the most reflective surface on the façade of a building is the glazing. Reflected solar glare from concrete, brickwork, timber, etc, is negligible (ie: less than 1% normal specular reflectance) and hence will not cause any adverse solar glare effects. Note also that, for any painted or powder-coated metallic surfaces on the exterior façade of the development, the maximum normal specular reflectance of visible light for those types of surfaces is in the range of 1% to 5%, which is well within the abovementioned limit.

With the incorporation of this recommendation, the results of this study indicate that the subject development will not cause adverse solar glare to pedestrians and motorists in the surrounding area, or to occupants of neighbouring buildings, and will comply with the planning controls regarding reflectivity for the City of Sydney Development Control Plan 2012.

CONTENTS

Executive Summary	iii
1 Methodology	1
2 Analysis	4
2.1 Impact onto Motorists and Pedestrians	4
2.1.1 Drivers heading south-west along City Road	4
2.1.2 Drivers heading north-east along City Road	5
2.1.3 Drivers heading west along Ivy Street	5
2.1.4 Drivers heading west along Cleveland Street	5
2.2 Occupants of Neighbouring Buildings	6
2.3 Typical Normal Specular Reflectivity from Building Surfaces	6
2.3.1 Glazed Surfaces	6
2.3.2 Painted and/or Powder-Coated Metallic Surfaces	6
3 Conclusion	7
References	8
 APPENDIX A - Glare Overlays for the Critical Sight-Lines	 9
APPENDIX B - Solar Charts for the Various Critical Aspects	16
APPENDIX C - Standard Sun Chart for the Sydney Region	20

1 METHODOLOGY

This study assesses compliance with the controls for solar glare from the City of Sydney Development Control Plan 2012.

The reflectivity analysis of the subject development has been carried out using the technique published by Hassall (1991). The limiting veiling luminance of 500 cd/m² for the comfort of motorists, as suggested in Hassall (1991), has been adopted as a basis of assessing the glare impact from the subject development. In meeting this criterion for vehicle motorists, conditions will also be satisfactory for pedestrians.

The various critical glazed aspects were determined for the development and are shown in Figure 1. Solar charts for each of these critical glazed aspects are presented in Appendix B, and these are used to derive the check zones which are shown in Figure 2. The check zones highlight the areas that are potentially affected by solar reflections from each critical glazed aspect. It should be noted that the check zones shown in Figure 2 do not take into account the effect of overshadowing by neighbouring buildings or the shielding effect of any existing trees or other obstructions. These effects are examined in the detailed analysis described in Section 2 of this report.

Study point locations are selected within the check zone areas where motorists are facing the general direction of the subject development. These are shown in Figure 2. For each of the study point locations, photographs have been taken from the viewpoint of motorists using a calibrated camera. Views from the study point locations are presented in Appendix A of this report. A scaled glare protractor has been superimposed over each photograph.

The glare protractor is used to assess the amount of glare likely to be caused and to provide a direct comparison with the criterion of 500 cd/m². Alternatively, the glare protractor can be used to determine the maximum acceptable reflectivity index of the façade material of the development for the glare to be within the criterion of 500 cd/m².

If it is found that a section of the subject development will be within the zone of sensitive vision of a motorist at a selected study point location (the central area of the glare protractor), the glare protractor is used to determine what the maximum normal specular reflectance of visible light should be for the glazing or any other reflective material used on that section of the façade of the development to ensure that solar glare will not cause discomfort or threaten the safety of motorists or pedestrians, and hence to allow the subject development to comply with the relevant planning control requirements.

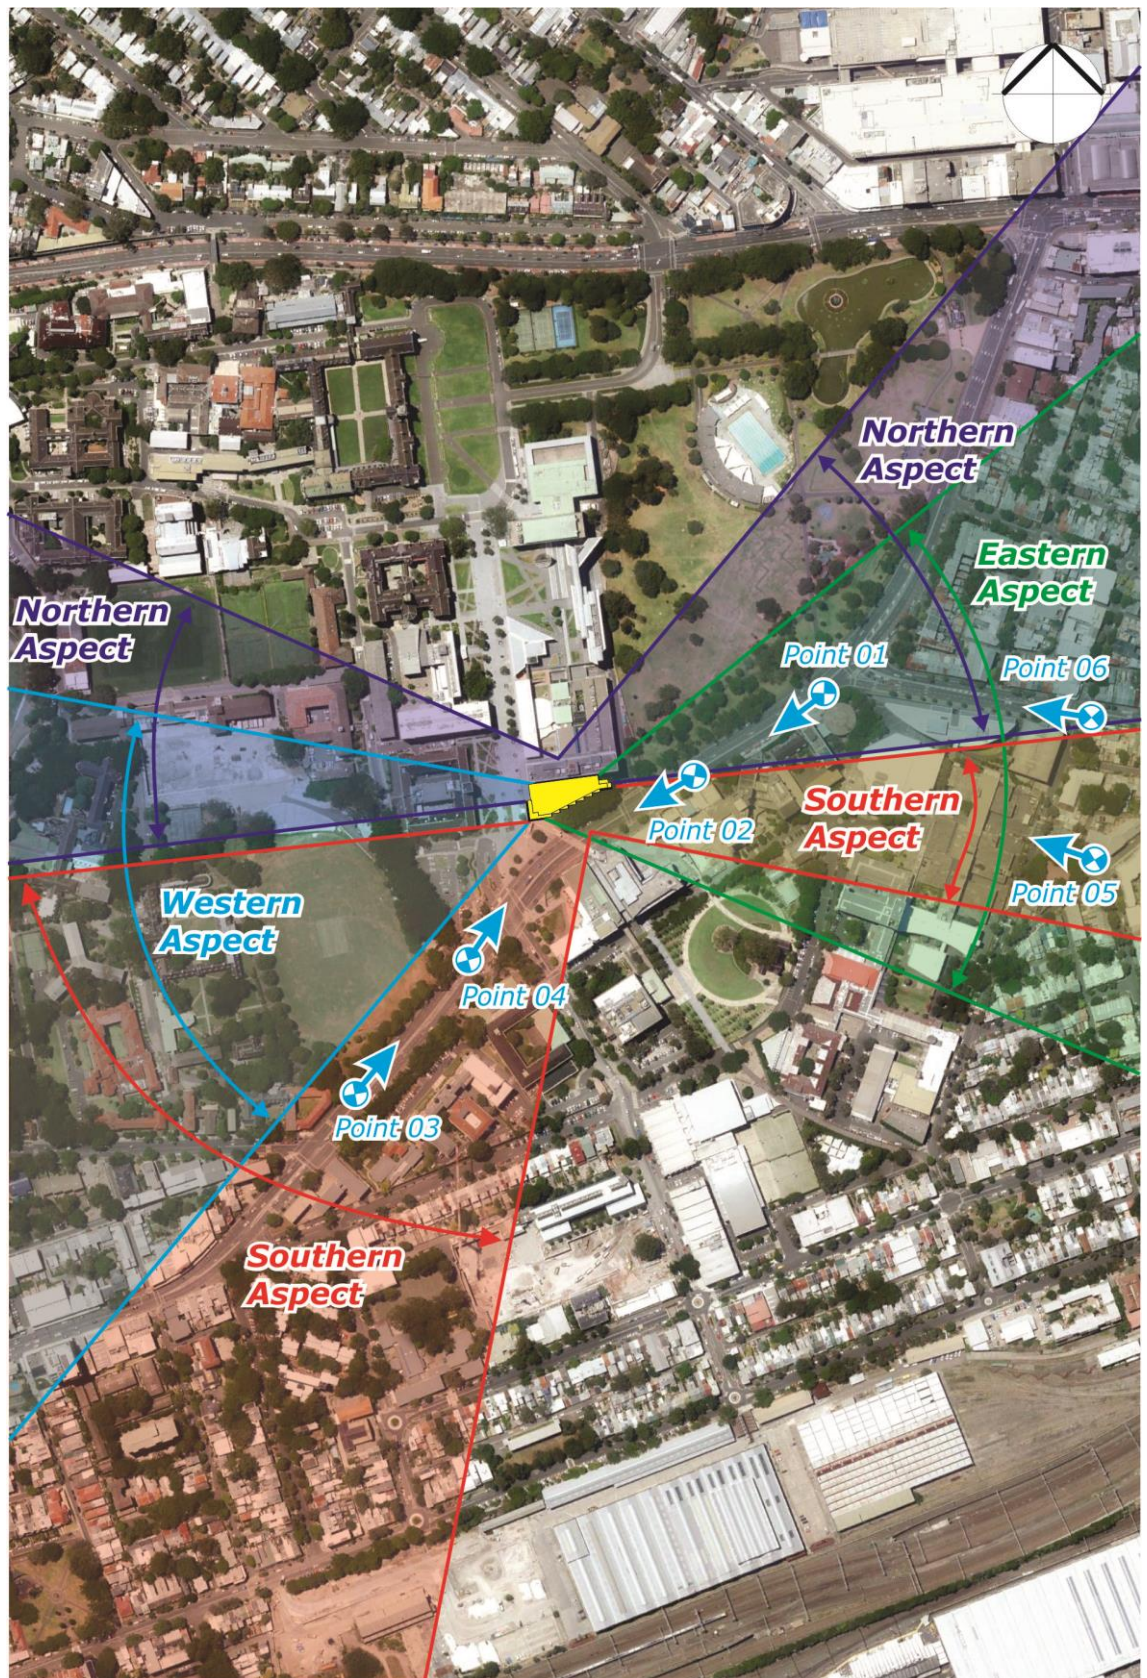


Figure 2: Check Zones and Study Point Locations of the Development
 (the check zones are the areas where glare could potentially be observed)

2 ANALYSIS

2.1 Impact onto Motorists and Pedestrians

From the study of the check zones shown in Figure 2, a total 6 street level locations have been identified for detailed analysis. A summary of the location of each study point, and the aspects of the subject development could potentially reflect solar glare to each study point location, is shown in Table 1 below. Note that, as mentioned in Section 1, the check zones shown in Figure 2 do not take into account the effect of overshadowing by neighbouring buildings or the shielding effect of any existing trees or other obstructions. These effects are examined in the detailed analysis described in the following sub-sections.

Table 1: Aspects of the Proposed Development that could reflect Solar Glare to each Study Point

Study Point	Location and Viewpoint	Aspect(s) of the Development
1	City Road, heading south-west.	Northern and eastern aspects.
2	City Road, heading south-west.	Northern, southern and eastern aspects.
3	City Road, heading north-east.	Southern aspect.
4	City Road, heading north-east.	Southern aspect.
5	Ivy Street, heading west.	Southern and eastern aspects.
6	Cleveland Street, heading west.	Southern and eastern aspects.

2.1.1 Drivers heading south-west along City Road

Points 1 and 2 are located along City Road, to the east of the development site. These points represent the critical sightlines of drivers heading south-west along City Road at these locations. A site survey of these points has been undertaken, and photographs showing the viewpoints of drivers at these locations were obtained using a calibrated camera. Each photograph has been scaled to enable the glare meter to be overlaid onto these images, as shown in Figures A1 and A2 of Appendix A.

An analysis of the glare meter overlaid onto the viewpoints at Points 1 and 2 indicates that the subject development is visible but is not within the zone of sensitive vision of motorists. Hence, there will be no adverse solar glare observed by motorists or pedestrians heading south-west on City Road.

2.1.2 Drivers heading north-east along City Road

Points 3 and 4 are located along City Road, to the south-west of the development site. These points represent the critical sightlines of drivers heading north-east along City Road at these locations. A site survey of these points has been undertaken, and photographs showing the viewpoints of drivers at these locations were obtained using a calibrated camera. Each photograph has been scaled to enable the glare meter to be overlaid onto these images, as shown in Figures A3 and A4 of Appendix A.

An analysis of the glare meter overlaid onto the viewpoints at Points 3 and 4 indicates that the 173° aspect of the subject development on Levels 5 and above is visible and is within the zone of sensitive vision of motorists at Point 4. However further analysis indicates that Point 4 is not within the check zone of the visible portion of the façade. Hence, there will be no adverse solar glare observed by motorists or pedestrians heading north-east along City Road.

2.1.3 Drivers heading west along Ivy Street

Point 5 is located along Ivy Street, to the east of the development site. This point represents the critical sightline of drivers heading west along Ivy Street at this location. A site survey of this point has been undertaken, and a photograph showing the viewpoint of drivers at this location was obtained using a calibrated camera. The photograph has been scaled to enable the glare meter to be overlaid onto this image, as shown in Figure A5 of Appendix A.

An analysis of the glare meter overlaid onto the viewpoints at Point 5 indicates that the subject development is not visible and is not within the zone of sensitive vision of motorists. Hence, there will be no adverse solar glare observed by motorists or pedestrians heading west along Ivy Street.

2.1.4 Drivers heading west along Cleveland Street

Point 6 is located along Cleveland Street, to the east of the development site. This point represents the critical sightline of drivers heading west along Cleveland Street at this location. A site survey of this point has been undertaken, and a photograph showing the viewpoint of drivers at this location was obtained using a calibrated camera. The photograph has been scaled to enable the glare meter to be overlaid onto this image, as shown in Figure A6 of Appendix A.

An analysis of the glare meter overlaid onto the viewpoints at Point 6 indicates that the subject development is not visible and is not within the zone of sensitive vision of motorists. Hence, there will be no adverse solar glare observed by motorists or pedestrians heading west along Cleveland Street.

2.2 Occupants of Neighbouring Buildings

Our past experience involving more than 250 projects, and also research by Rofail and Dowdle (2004), tends to indicate that Buildings which cause a nuisance to occupants of neighbouring buildings are those that have a normal specular reflectivity of visible light greater than 20%. This seems to justify the suggested limit of 20% reflectivity by many local government authorities and state planning bodies.

Hence a general recommendation is made that all glazing and other reflective materials used on the façade of the subject development have a maximum normal specular reflectivity of visible light of 20% to avoid adverse solar glare to occupants of neighbouring buildings.

2.3 Typical Normal Specular Reflectivity from Building Surfaces

It should be noted that the most reflective surface on the façade of a building is the glazing. Reflected solar glare from concrete, brickwork, timber, etc, is negligible (ie: less than 1% normal specular reflectance) and hence will not cause any adverse solar glare effects. The following sub-sections provide some general reflectance values of more reflective materials used on building facades.

2.3.1 Glazed Surfaces

A glazing supplier will be able to provide information on the maximum normal specular reflectance of visible light of different types of glazing. Some typical reflectivity values of different types of glazing are listed as follows:

- Clear float glass – typically 5% to 8%
- Low-e solar control glazing – typically 8% to 12%
- Other types of compliant performance glazing – up to 20%

2.3.2 Painted and/or Powder-Coated Metallic Surfaces

In the event that some portions of the external façade of the development feature powder-coated or painted metallic surfaces, it is not expected that adverse glare will be observed from those surfaces since the maximum normal specular reflectance of visible light of these types of façade materials range from 1% to 5%. This is well within the maximum limits specified in previous sections of this report.

3 CONCLUSION

This report presents the results of a detailed study for the effect of potential solar glare from the proposed development known as Building LEES1, located within the University of Sydney. The analysis has been undertaken based on the architectural drawings prepared by the project architect Rice Daubney, received during May 2016.

This study identifies any possible adverse reflected solar glare conditions affecting motorists and pedestrians within the local surrounding area, and to occupants of neighbouring buildings. If necessary, recommendations are made to mitigate any potentially adverse effects. This study assesses compliance with the controls for solar glare from the City of Sydney Development Control Plan 2012.

A site survey has been undertaken to obtain photographs of the critical sightlines of motorists on surrounding streets. These photographs are calibrated and are able to be overlaid with a glare meter, which allows the extent, if any, of potential solar glare reflections from the subject development to be determined.

The results of the study indicate that, to avoid any adverse glare to motorists and pedestrians on the surrounding streets, occupants of neighbouring buildings, and to comply with the abovementioned planning control requirements, it is recommended that all glazing used on the external façade of the development should have a maximum normal specular reflectance of visible light of 20%.

It should be noted that the most reflective surface on the façade of a building is the glazing. Reflected solar glare from concrete, brickwork, timber, etc, is negligible (ie: less than 1% normal specular reflectance) and hence will not cause any adverse solar glare effects. Note also that, for any painted or powder-coated metallic surfaces on the exterior façade of the development, the maximum normal specular reflectance of visible light for those types of surfaces is in the range of 1% to 5%, which is well within the abovementioned limit.

With the incorporation of this recommendation, the results of this study indicate that the subject development will not cause adverse solar glare to pedestrians and motorists in the surrounding area, or to occupants of neighbouring buildings, and will comply with the planning controls regarding reflectivity for the City of Sydney Development Control Plan 2012.

REFERENCES

City of Sydney Council, "City of Sydney Development Control Plan 2012".

Hassall, D.N., "Reflectivity, Dealing with Rogue Solar Reflections", (published by author), 1991.

Phillips, R.O., "Sunshine and Shade in Australasia", Sixth Edition, CSIRO Publishing, 1992.

Rofail, A.W., and Dowdle, B., "Reflectivity Impact on Occupants of Neighbouring Properties", International Conf. on Building Envelope Systems & Technologies, Sydney, 2004.

APPENDIX A - GLARE OVERLAYS FOR THE CRITICAL SIGHT-LINES

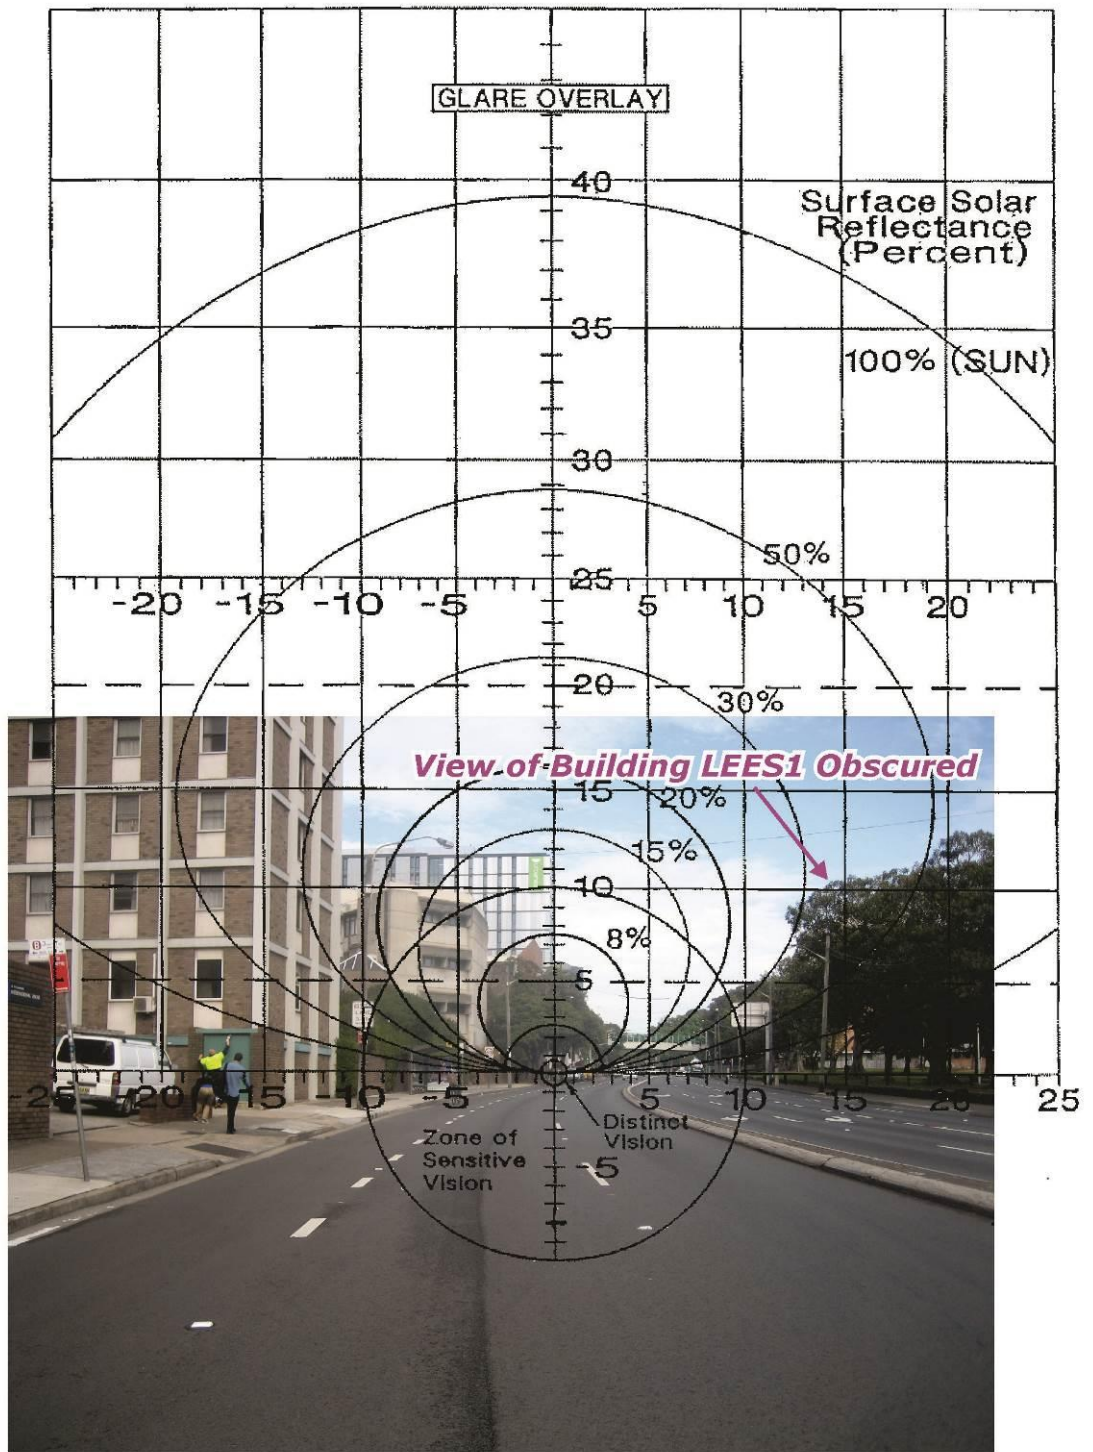


Figure A1: Glare Overlay for Point 1

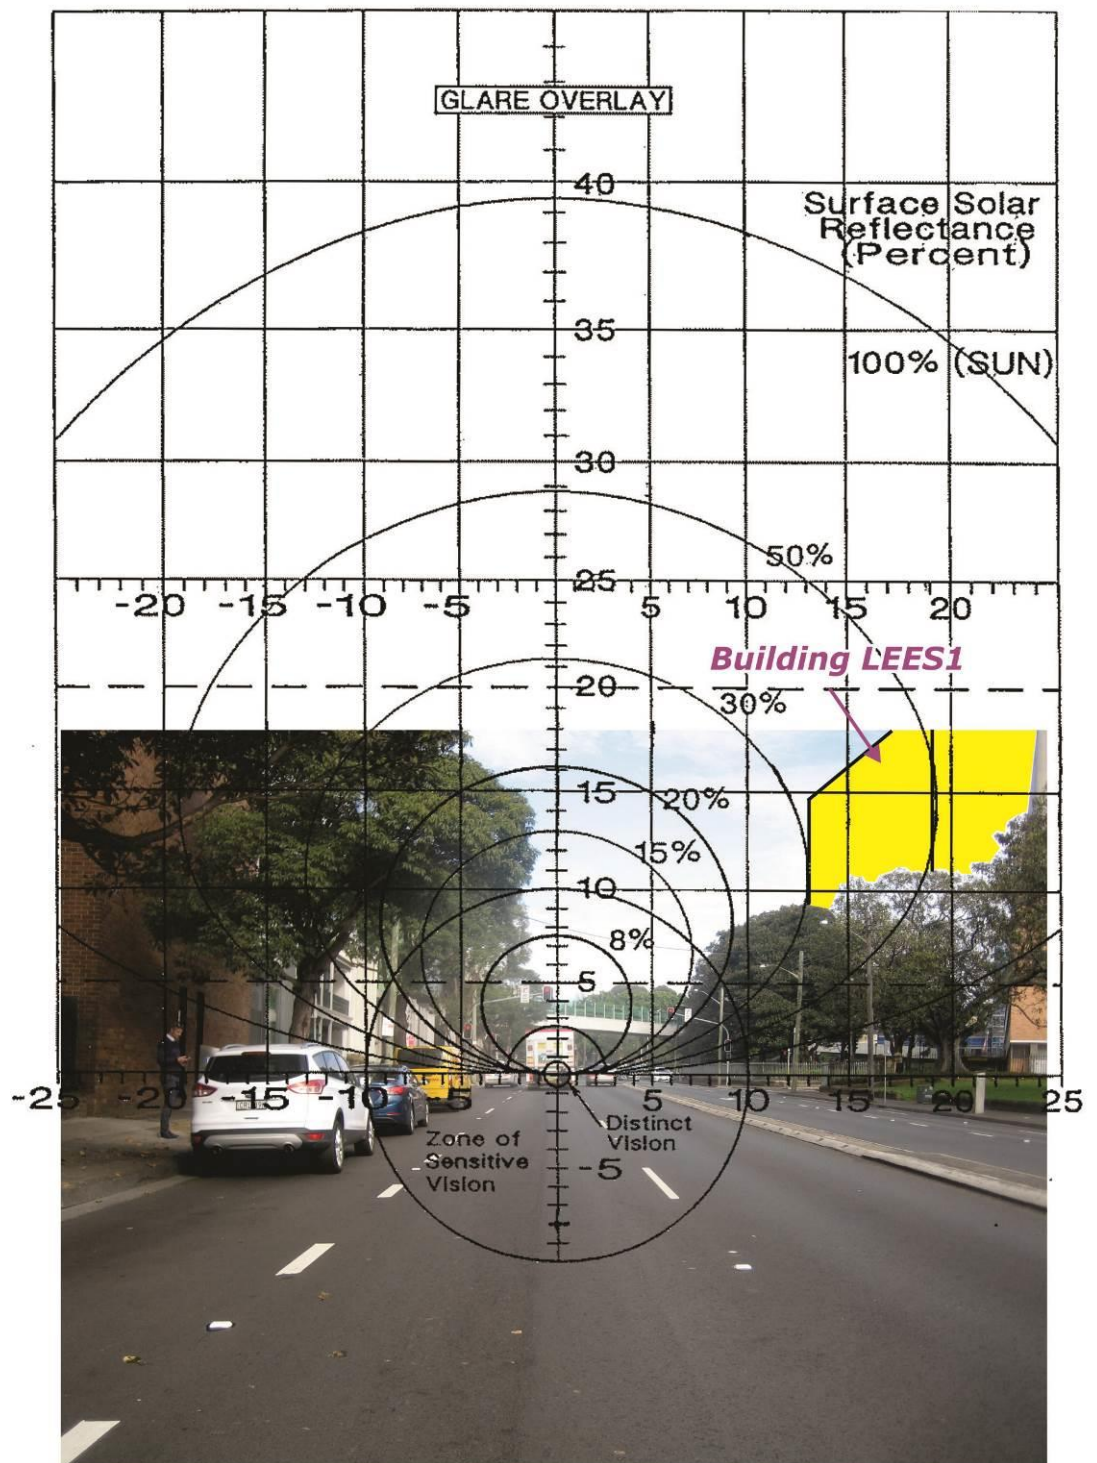


Figure A2: Glare Overlay for Point 2

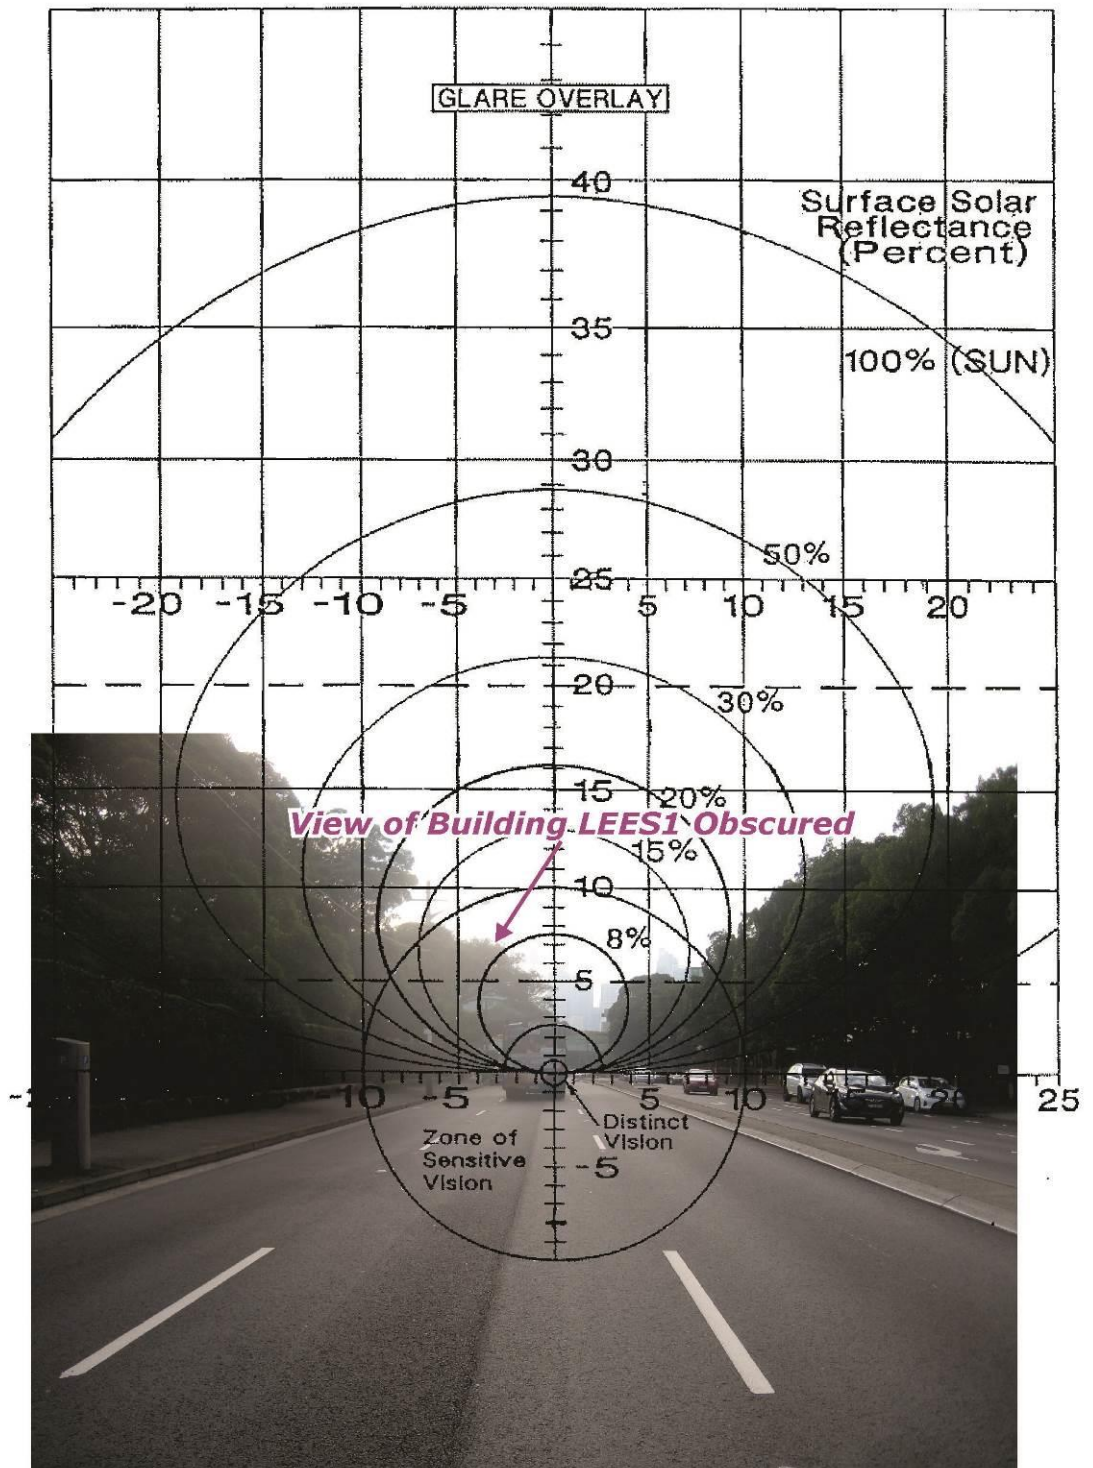


Figure A3: Glare Overlay for Point 3

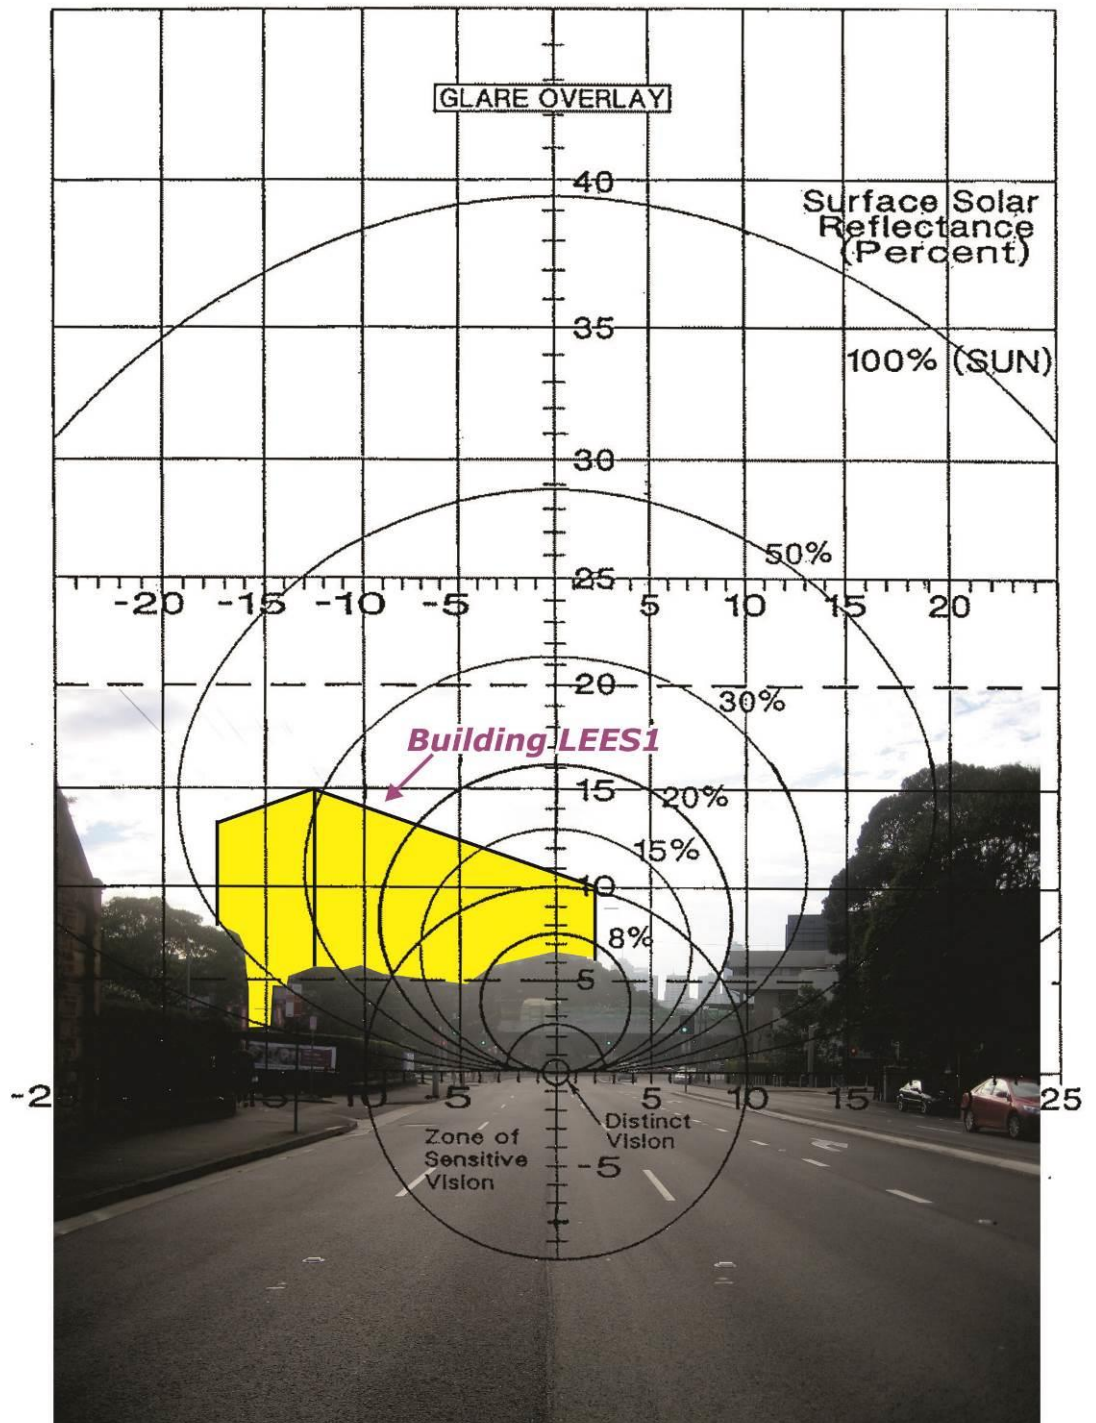


Figure A4: Glare Overlay for Point 4


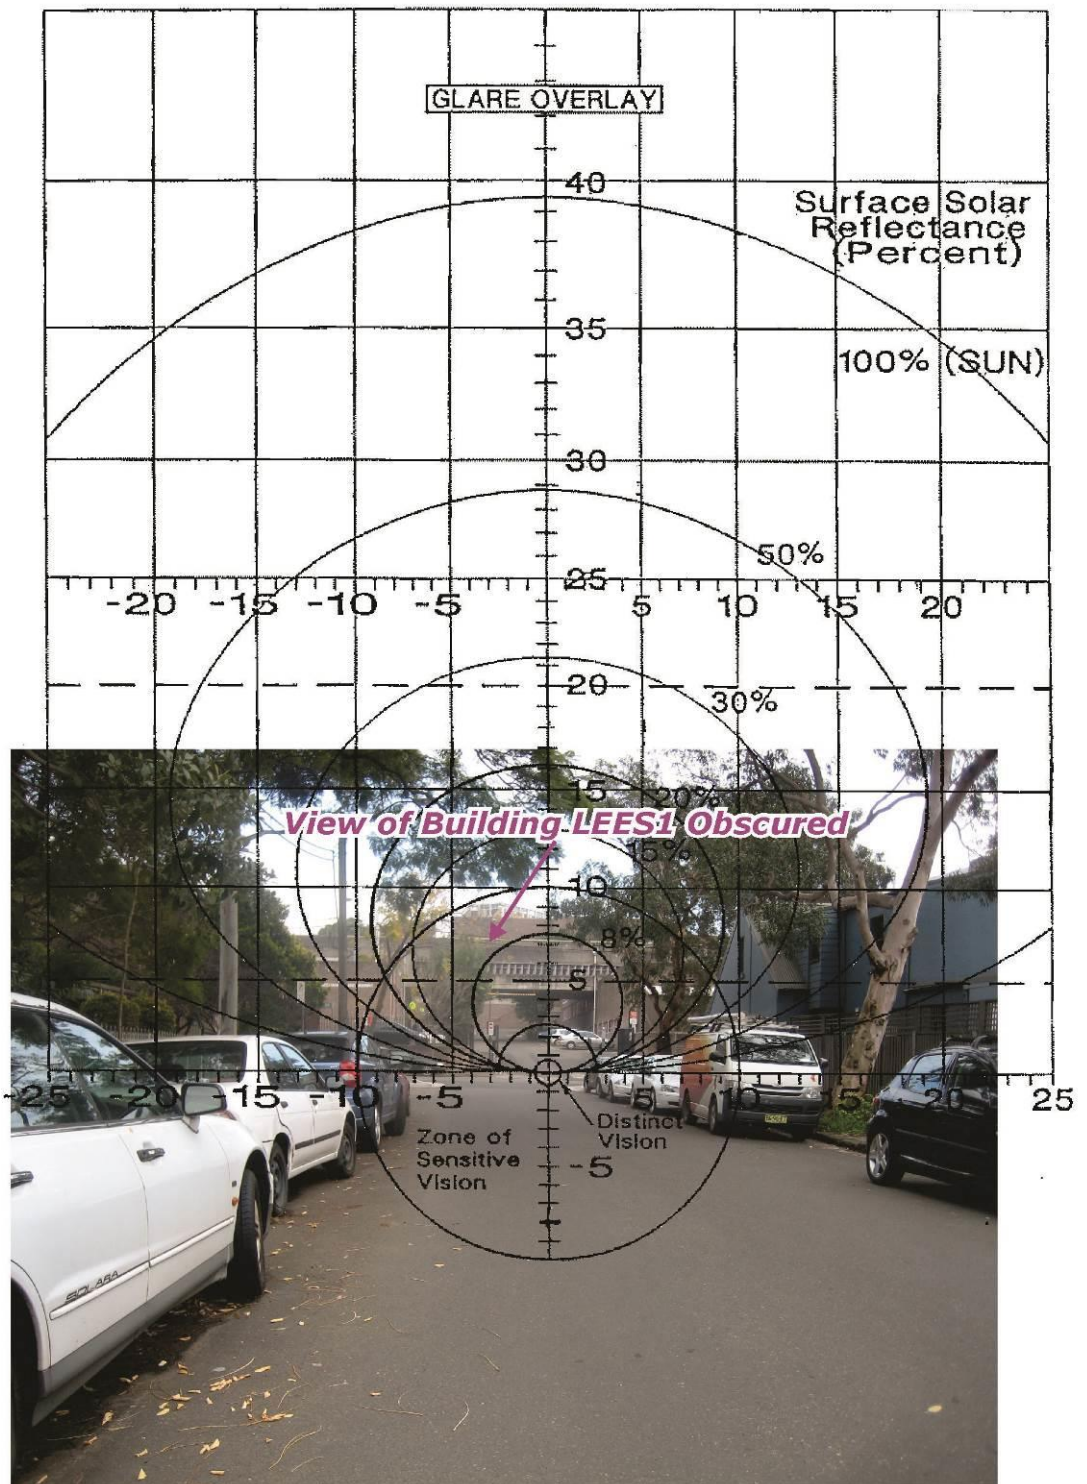


Figure A5: Glare Overlay for Point 5

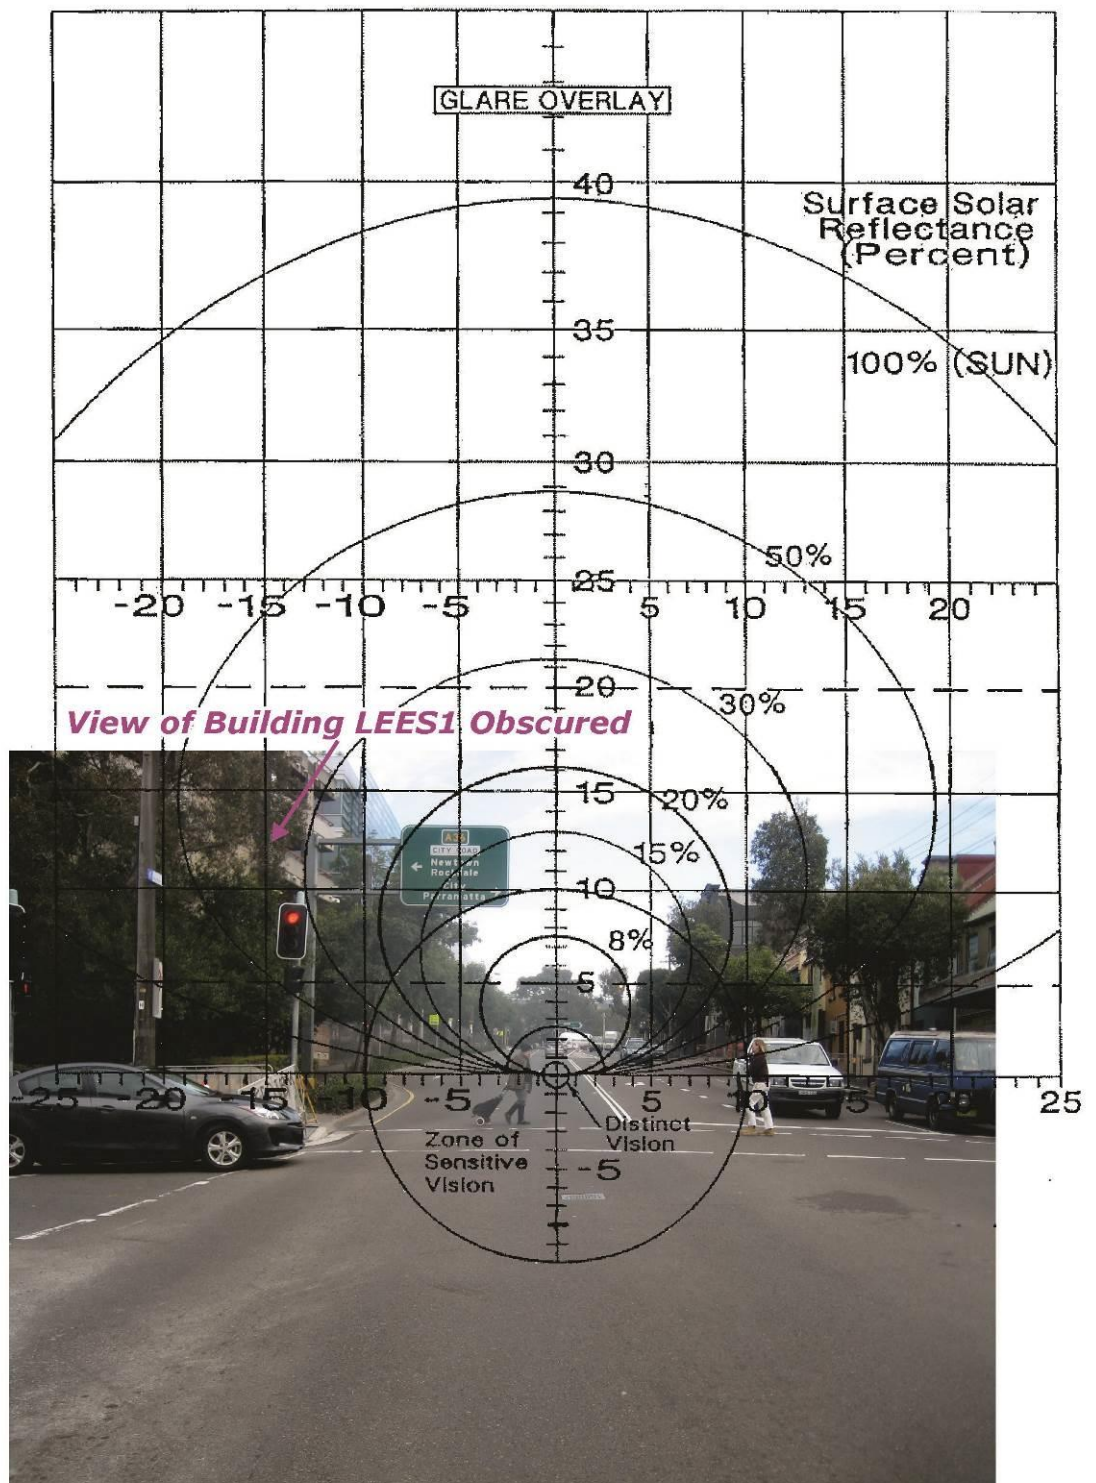

APPENDIX B - SOLAR CHARTS FOR THE VARIOUS CRITICAL ASPECTS

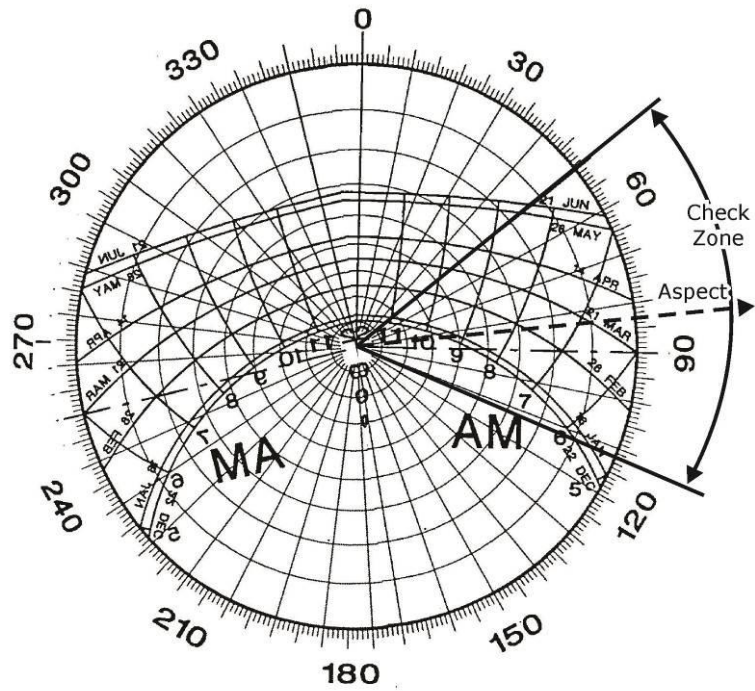


Figure B1: Sun Chart for Aspect 083°

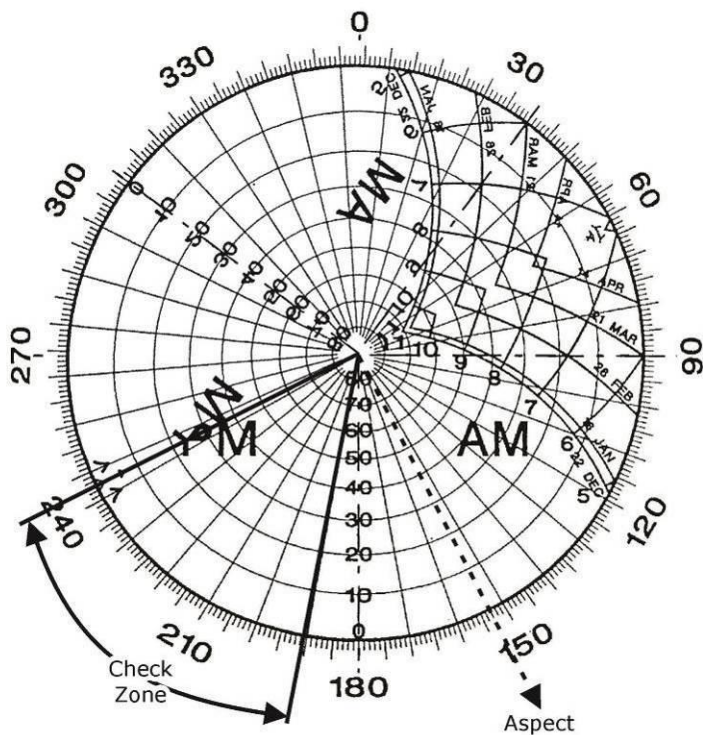


Figure B2: Sun Chart for Aspect 153°

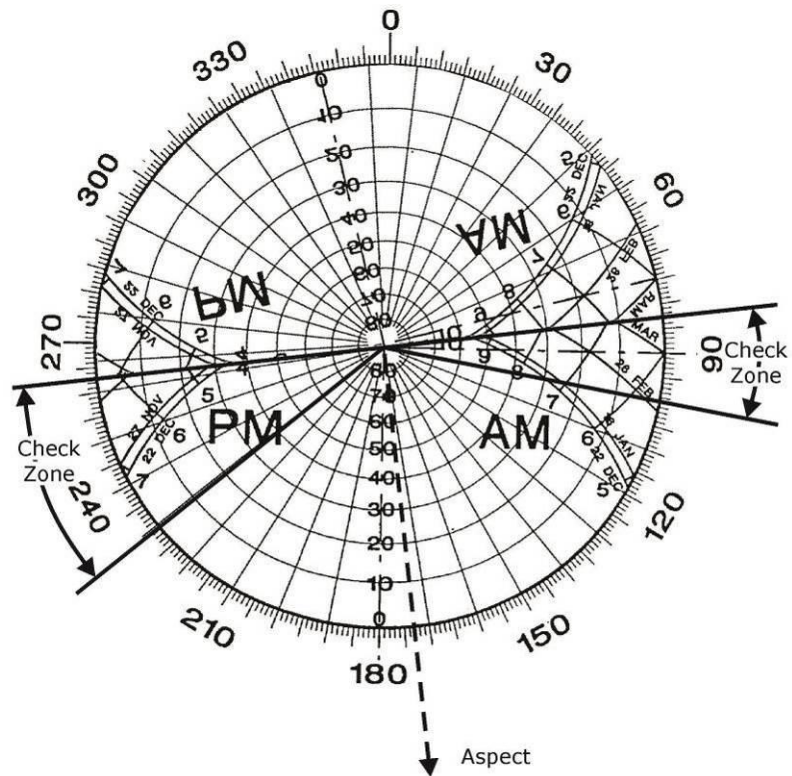


Figure B3: Sun Chart for Aspect 173°

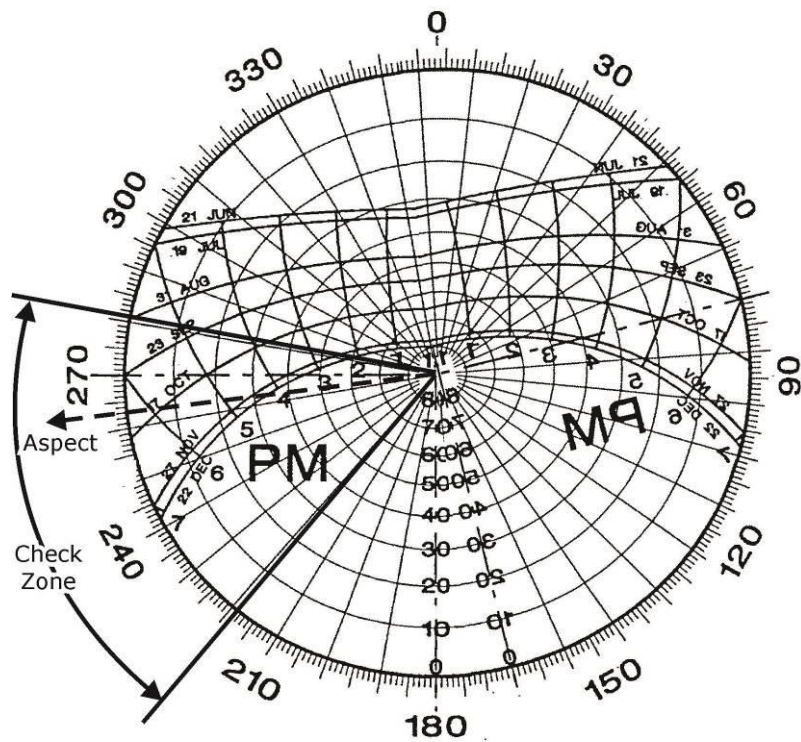


Figure B4: Sun Chart for Aspect 263°

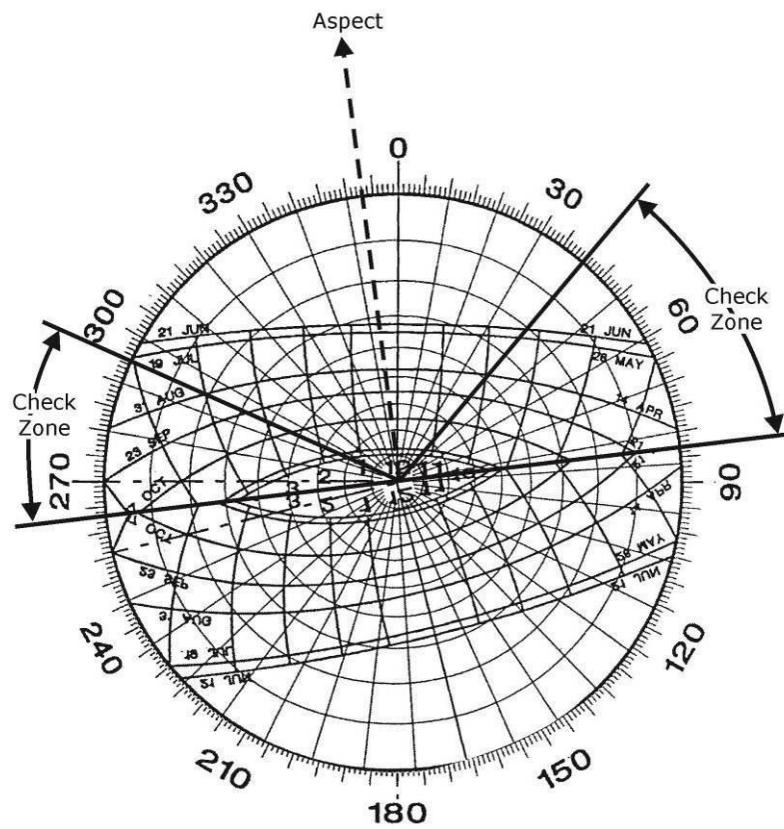


Figure B5: Sun Chart for Aspect 353°

APPENDIX C - STANDARD SUN CHART FOR THE SYDNEY REGION

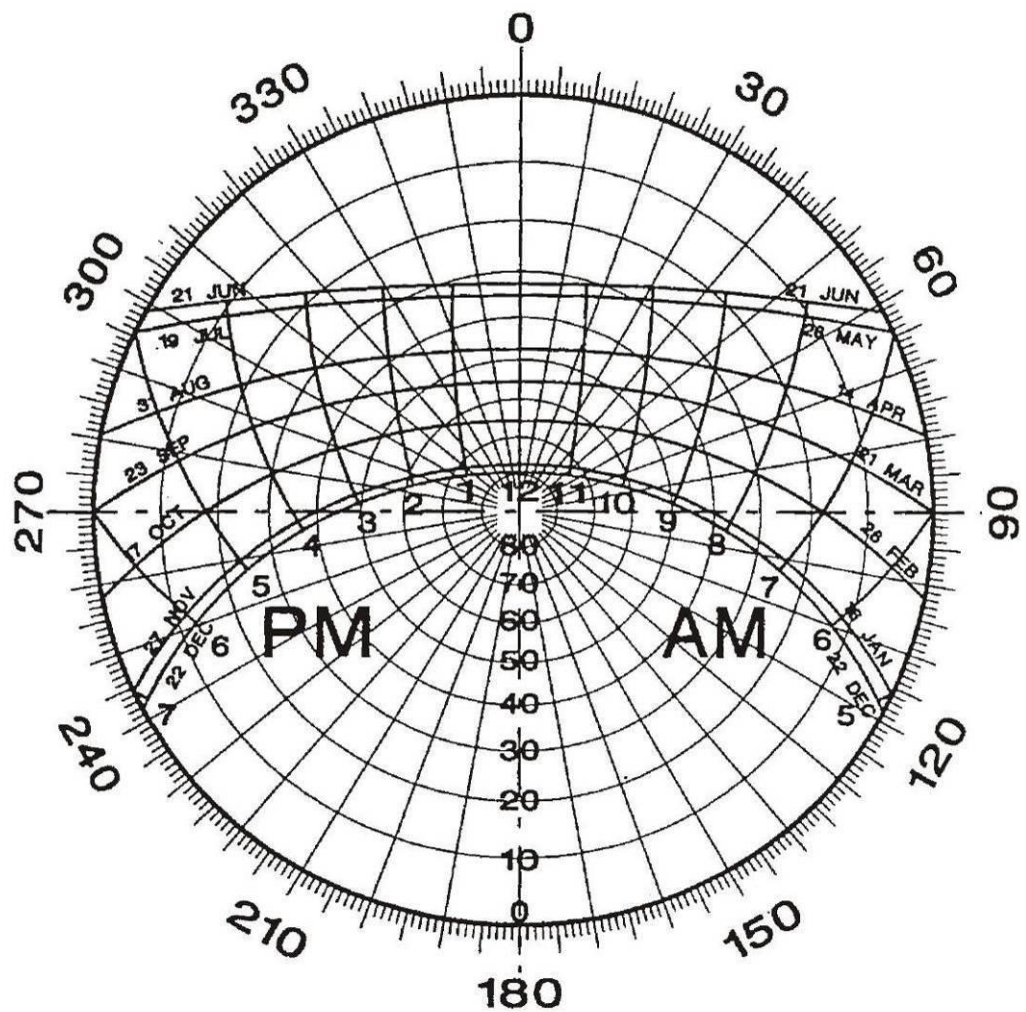


Figure C1: Standard Sun Chart for the Sydney Region