


APPENDIX D STORMWATER AND DUST SUPPRESSION PLANS

Minto Resource Recovery Facility Response to Submissions

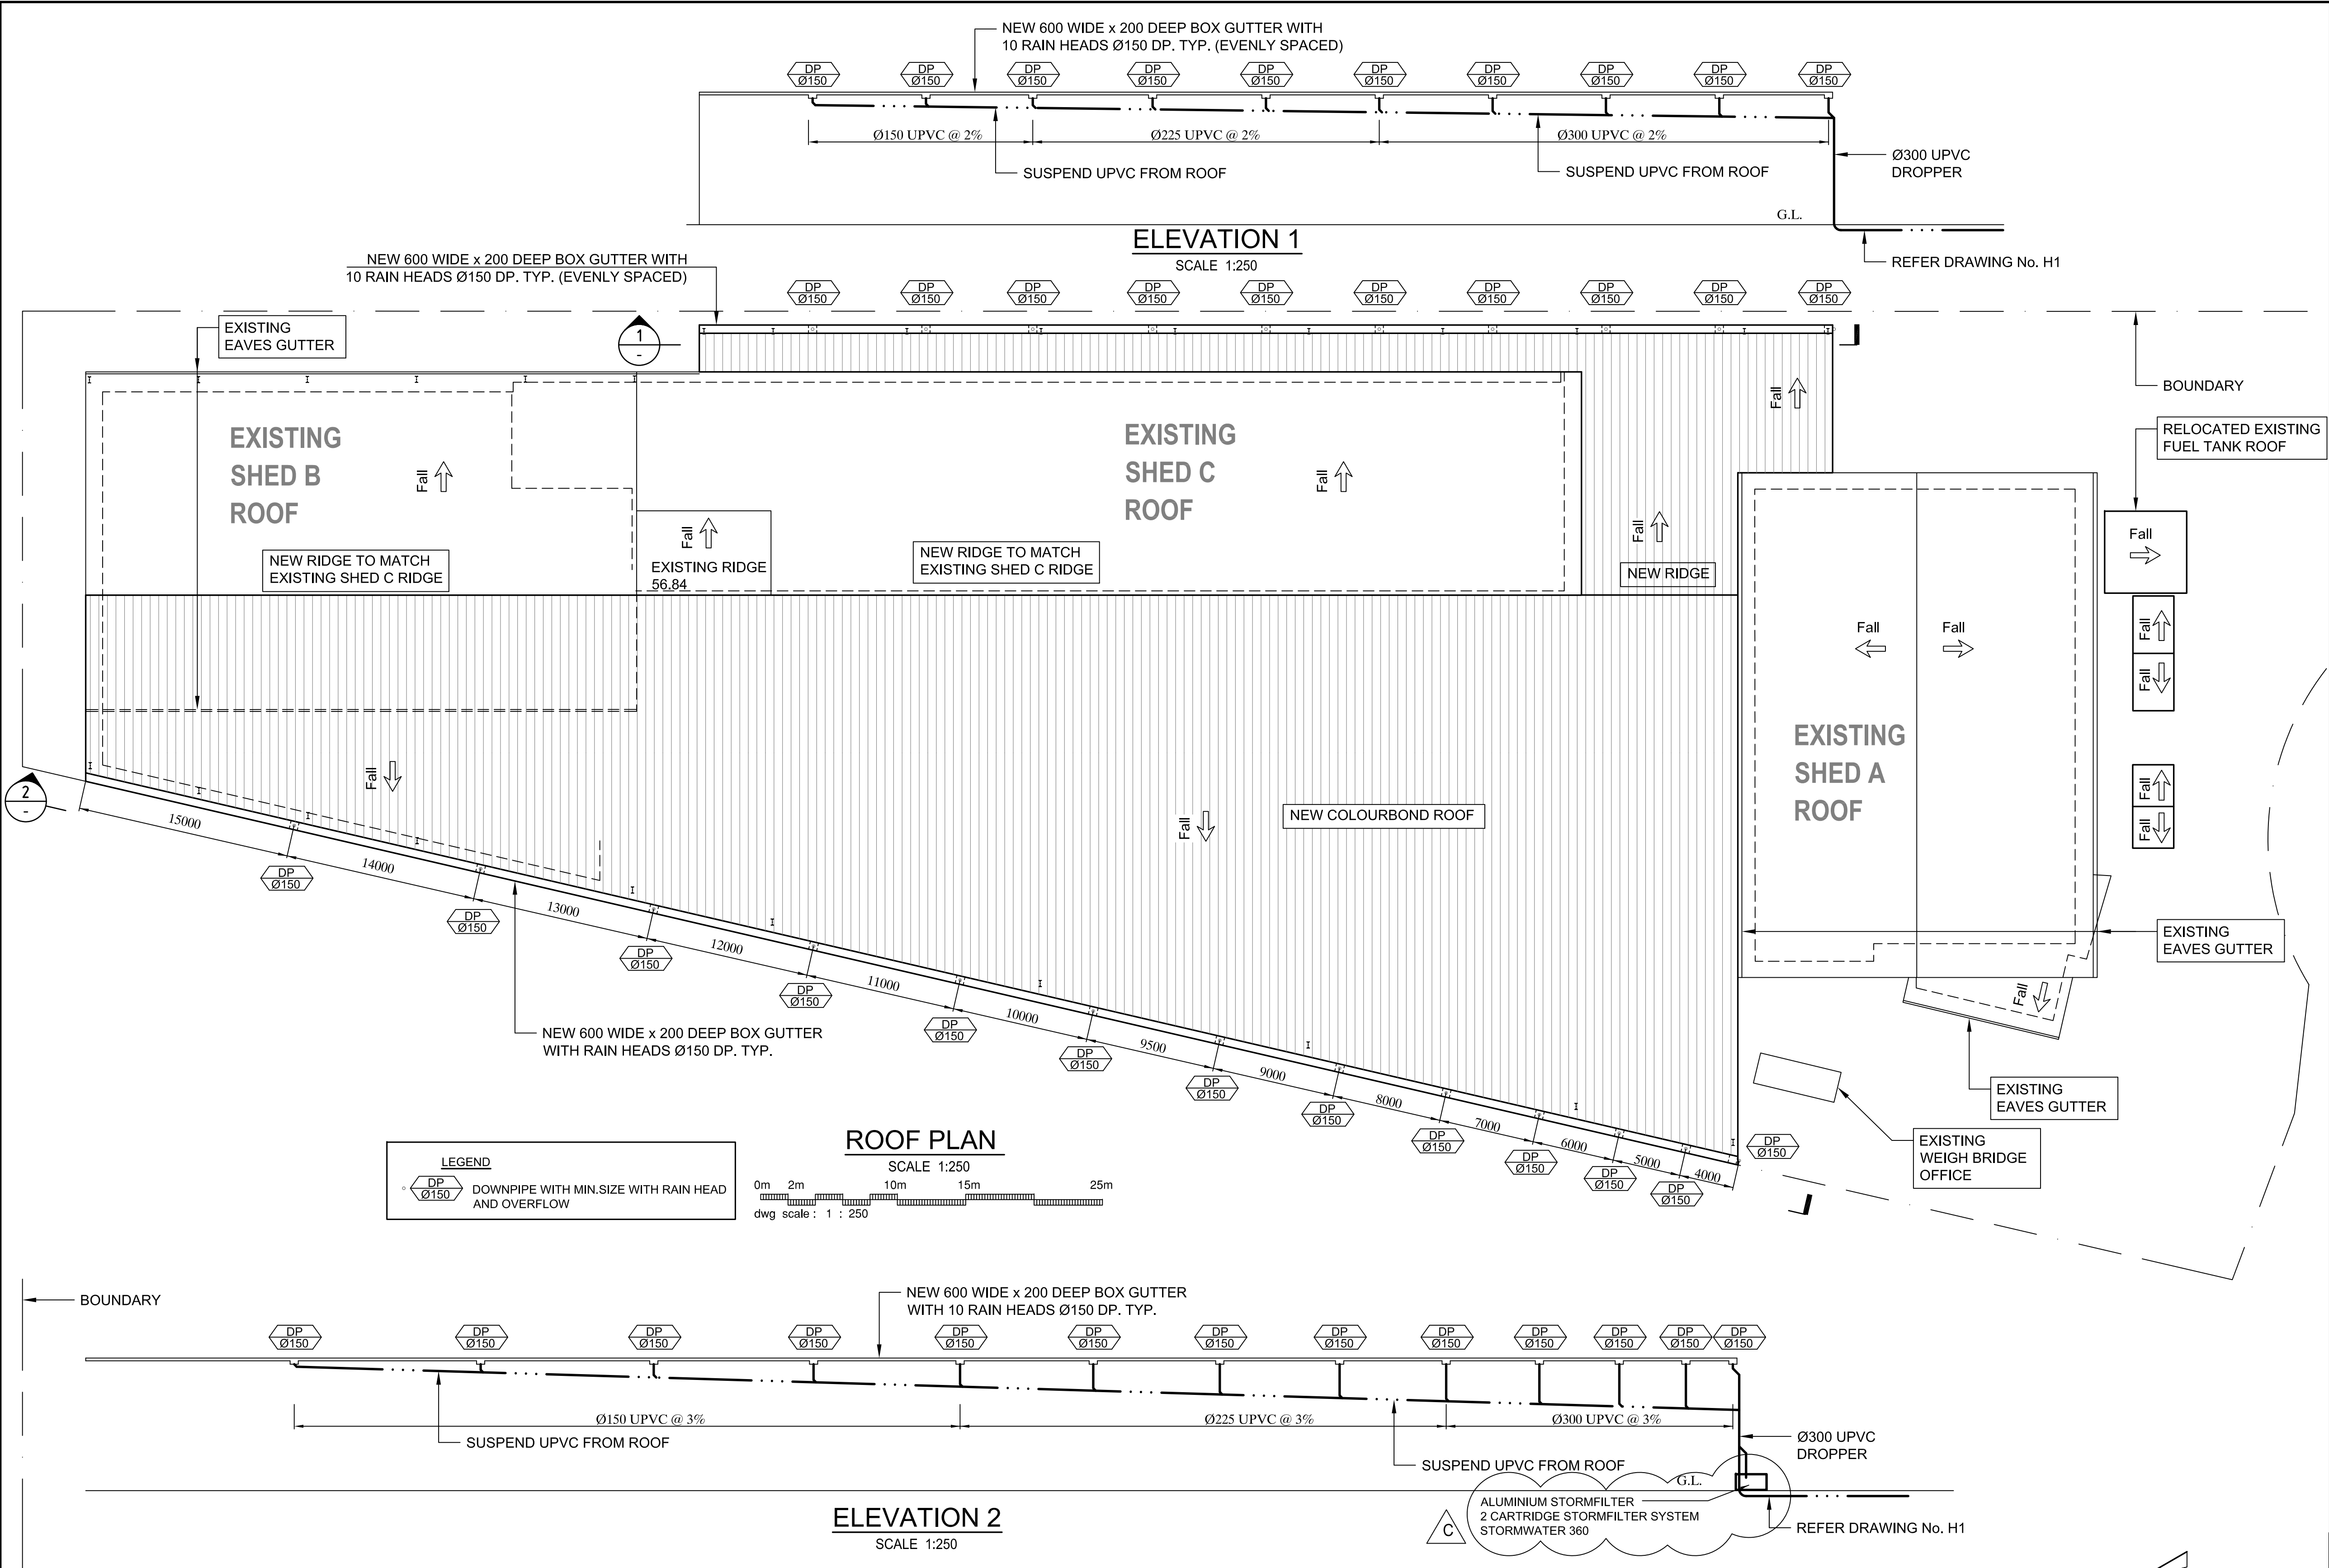


- GENERAL STORMWATER NOTES**
1. All pipes and stormwater structures shall be in strict accordance with relevant S.A.A. Codes for materials, workmanship and to rules and regulations of the local Council.
 2. The drawings are diagrammatic and setouts shall be checked with the Architectural drawings.
 3. All levels and dimensions shall be checked on site prior to start of construction.
 4. Pipe materials indicated may be altered provided they comply with the requirements of the relevant authorities.
 5. Gutters and downpipes shall be in strict accordance with AS 2179 & AS 2180. Gutters shall have a minimum effective cross sectional area of 9300mm sq (1250QUOD GUTTER or similar) with 1 in 500 min. grade with 100 x 75 downpipes unless otherwise noted on plans.
 6. Stormwater pipes up to and including 300 dia. shall be PVC pipes, sewer grade, conforming to AS 1280 and installed in accordance with AS 3500.3 and related reference documents.
 7. All existing services to be located prior to the commencement of construction. Any costs incurred for adjustments and/or relocation of services to be borne by the applicant.
 8. Provide unrestricted overland flowpaths from all pits and drain to detention tank inlet grates.
 9. On-site stormwater detention reduces flooding by providing temporary storage of stormwater during storms. After the storm, the stored water is slowly released, normally through a control orifice. Systems incorporating a High Early Discharge first fill the HED section, then overflow into the storage and later flow-back into HED through a one-way line. During light rain, no storage occurs. During extreme rainfall, the detention system will fill and could overflow. A typical storage system will quickly fill but take several hours to empty. Submersion during this period will not affect most grass, plants or trees.
 10. Councils require that on-site detention systems be inspected during construction to enable a final Hydraulic Certificate and Work as Executed details to be supplied upon completion. Councils require that concrete works (tank bases, lids, retaining walls etc.) are inspected before pouring and a Structural Engineers Certificate is issued on completion.
 11. These details are subject to approval by Council and possibly other authorities. Do not continue or commit to any works until these details are approved. Advise Design Engineer of any special conditions imposed or design variations made to the details. Any alterations (however minor) must be authorised by the Design Engineer.
 12. Conditions found during construction that conflict with these details shall be reported to the Design Engineer. If in doubt, ask. Design sizes, levels, heights and depths must not be varied without approval.
 13. All works are to be completed before the Final Certificate will be issued. Tanks are to be clear of all formwork, builder's rubbish and silt. The outline and sump drain is to be clear. All pits and grates are to be completed and shall be free of building material and spoil. All downpipes are to be connected. Landscape works including driveways, kerbs and drive trench grates shall be installed. Orifices, screens, step irons and tank grate locks are to be correctly fitted. Surface detention areas are to be turfed.
 14. Maintenance of the on-site stormwater detention system is the responsibility of the Owner. A complete set of these details shall be provided to the present owner. The details should be passed on to subsequent owners. It is important that these systems are not modified without approval. Do not enter any pit or tank where there is risk of inadequate ventilation or buildup of noxious odours, gases, or leakage of any volatile or toxic contaminations into the chamber. Obtain professional assistance if any of these conditions occur.
 15. Maintenance and cleaning is required as follows. Remove and flush clean the trash screen. Hose out the tank base and remove accumulated debris. Flush the discharge-line clear. This must be done to Council's time requirements and as all Council's vary it is the responsibility of the Owner to find out Council's requirements.
 16. Orifice plates shall be fabricated from 3mm thick stainless steel, with a circular hole machined to 1/2mm. Plates shall be fixed flush using four stainless steel expansion or chemical anchors. If required by Council, the orifice plate shall also be epoxy fixed. Unless otherwise detailed, plates shall be fixed on the centreline of the outlet.
 17. Screen mesh shall be Lysaght's expanded metal, type RH3030, and shall not be hot dipped galvanised after fabrication. The screen shall have elongated mesh openings set horizontal, and the projecting mesh lines pointing down and facing upstream. Screens shall be provided with a suitable handle located on the top upstream face of the screen (for removal and, for flat screens, to define the screen orientation). All screens shall be removable by hand without the use of tools. Fixing brackets shall be stainless or galvanised mild-steel type. Bracket anchors shall be stainless steel. When installed, the maximum edge gap shall be 3mm + or - 3mm.
 18. One-way flaps shall be Roda Floodgate type. Flaps shall be located clear of inlets, screens and step irons and must not prevent the screen from being removed.
 19. Concrete shall be 20 MPa for footings and tank bases, and 25 MPa for suspended tank lid slabs. Mesh reinforcement shall be lapped one square plus 25mm and bar reinforcement shall be lapped 500mm.
 20. Permanent (non-structural) formwork shall be Lysaght's Bondek, any grade, or equal.
 21. Tanks may be in-situ or precast. Note that falls, sumps and the position and depth to orifice plates or discharge control pipe is critical; both for hydraulic and health reasons. Overflow and access grates also provide light and ventilation requirements of various Authorities. Provide step irons to all tanks over 1200 depth.
 22. Tank risers should be in-situ concrete. Risers shall have the same clear internal size as the tank access opening. Provide step irons to risers as specified.
 23. Individual-rung step irons to tank, tank risers and deep pits shall be an approved type (galvanised steel or high impact plastic) complying with AS 1657. Fix rungs permanently and securely by drilling and epoxy grouting. Provide the specified number of step-irons, equally spaced vertically between 250mm and 350mm, with alternate rungs offset 200mm.
 24. Grates and frame units shall be hinged and childproof, using either a spring loaded bolt or a bolt and lug locking system (padlocks are not permitted). The frames shall be securely attached to the tank or riser, or built into an in-situ slab.
 25. Grates shall be class A (light duty) in paths and lawns; class B (medium duty) in residential vehicular areas; and class C (heavy duty) in public roadways.

C	STORMFILTER SYSTEM ADDED	05 12 2017
B	ROOF SLOPE, DOWNPIPES +	
A	ELEVATION 2 REVISED	29 09 2017
	ISSUE FOR APPROVAL	25 09 2017
Amendment		Date


**PROPOSED ALTERATIONS & ADDITIONS
TO EXISTING FACTORY FACILITY AT
13 PEMBURY RD, MINTO**

BURGESS, ARNOTT & GRAVA PTY LTD
CONSULTING CIVIL, STRUCTURAL & HYDRAULIC ENGINEERS
61A THE CENTRE FORESTVILLE P.O. BOX 69 FORESTVILLE 2087
Ph. 9451 4411 Fax. 9975 2274
email rob@gravaconsulting.com.au


STORMWATER ROOF PLAN			
Checked	Scale @ A1	Date	Drawing No.
R. GRAVA	AS SHOWN	MAY 2016	2016-041-H3 C
Approved	Chartered Engineer	Drawing 3 in set of 3 Drawing size A1	

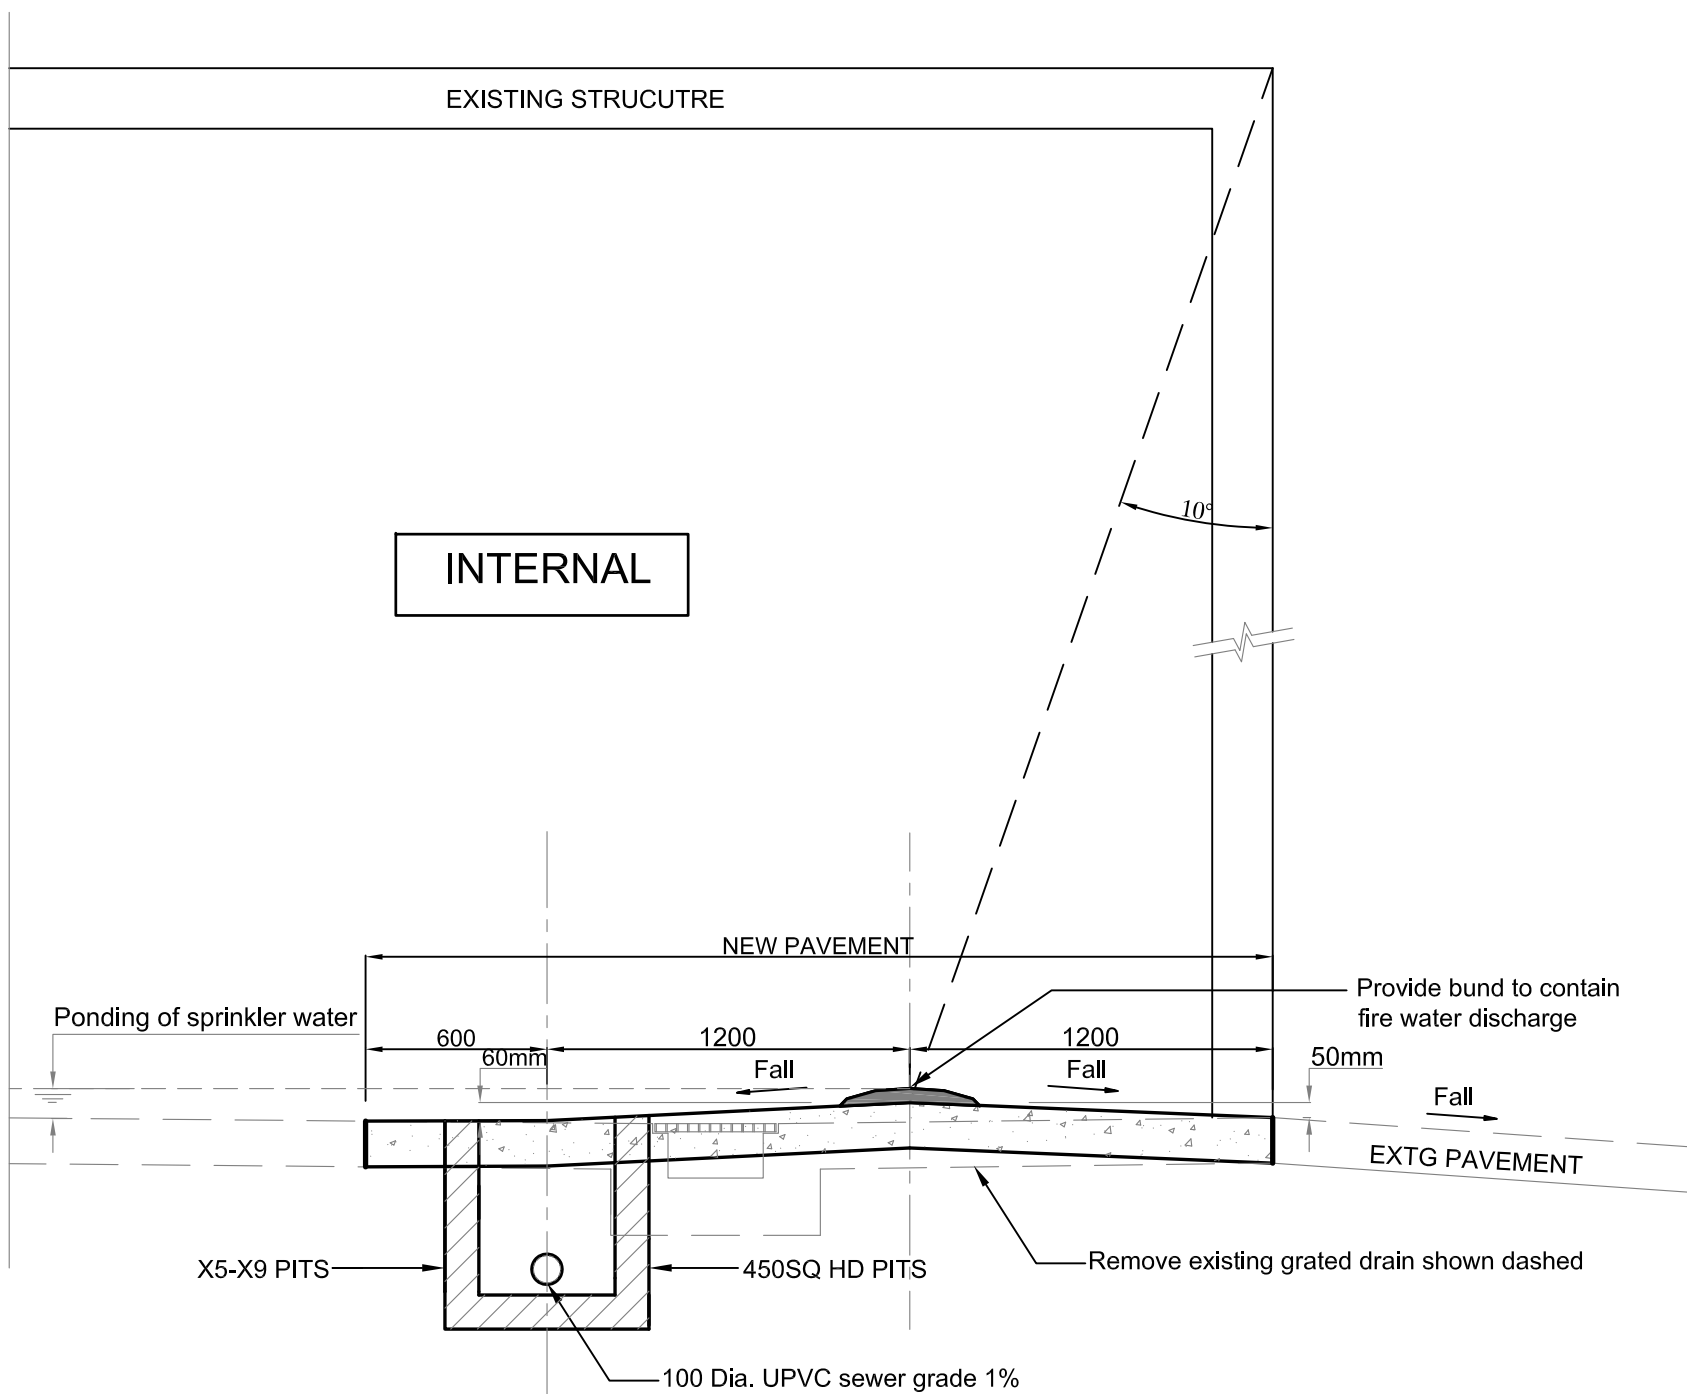

SECTION THROUGH ENTRY TO SHED C

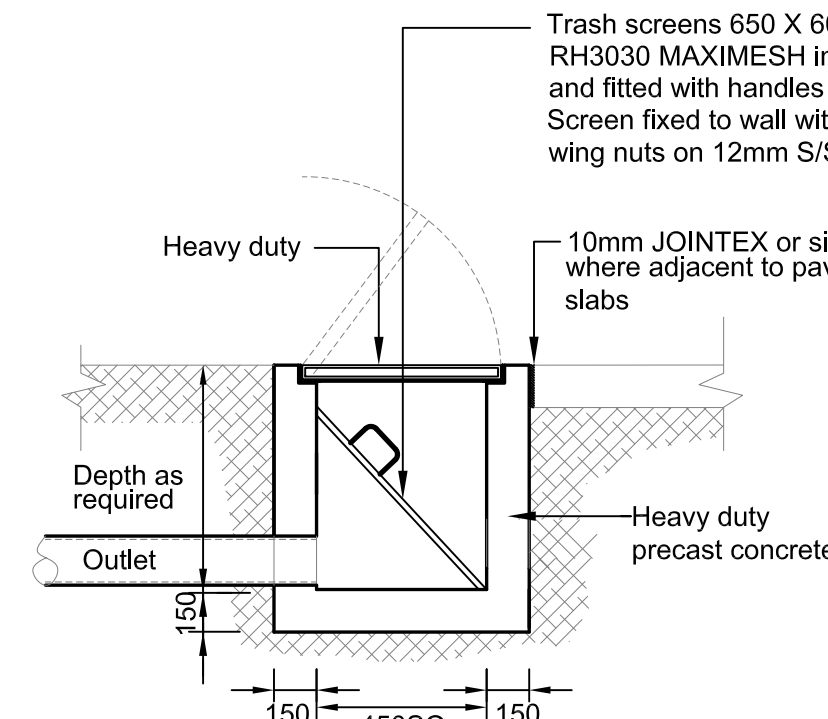


TYPICAL HD PIT DETAIL FOR PITS X5-X9

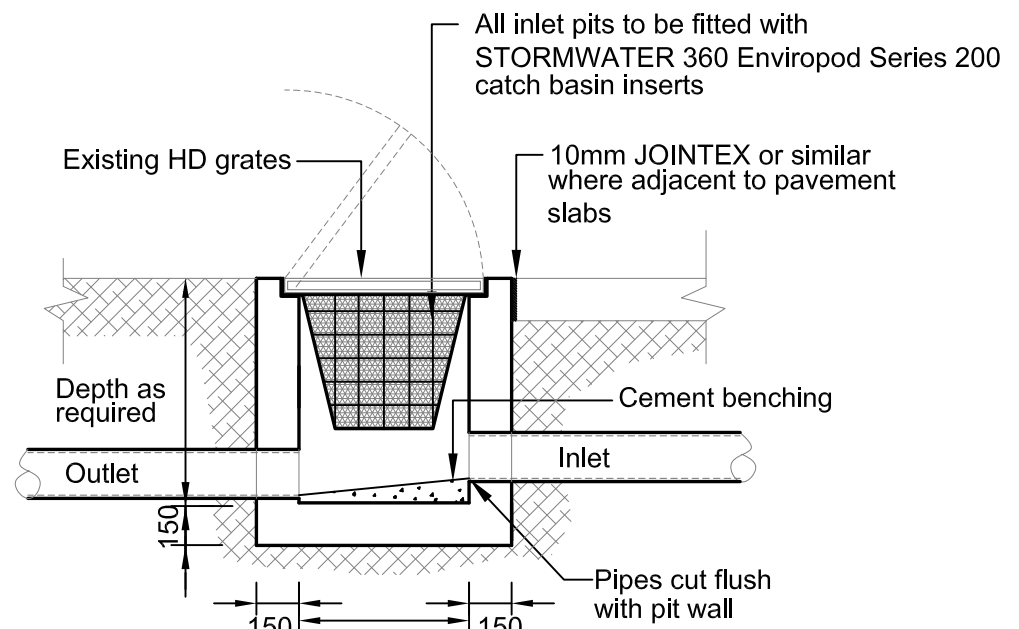

TYPICAL PIT DETAIL U.O.N-WITH OR WITHOUT ENVIROPOD

All Pits Existing

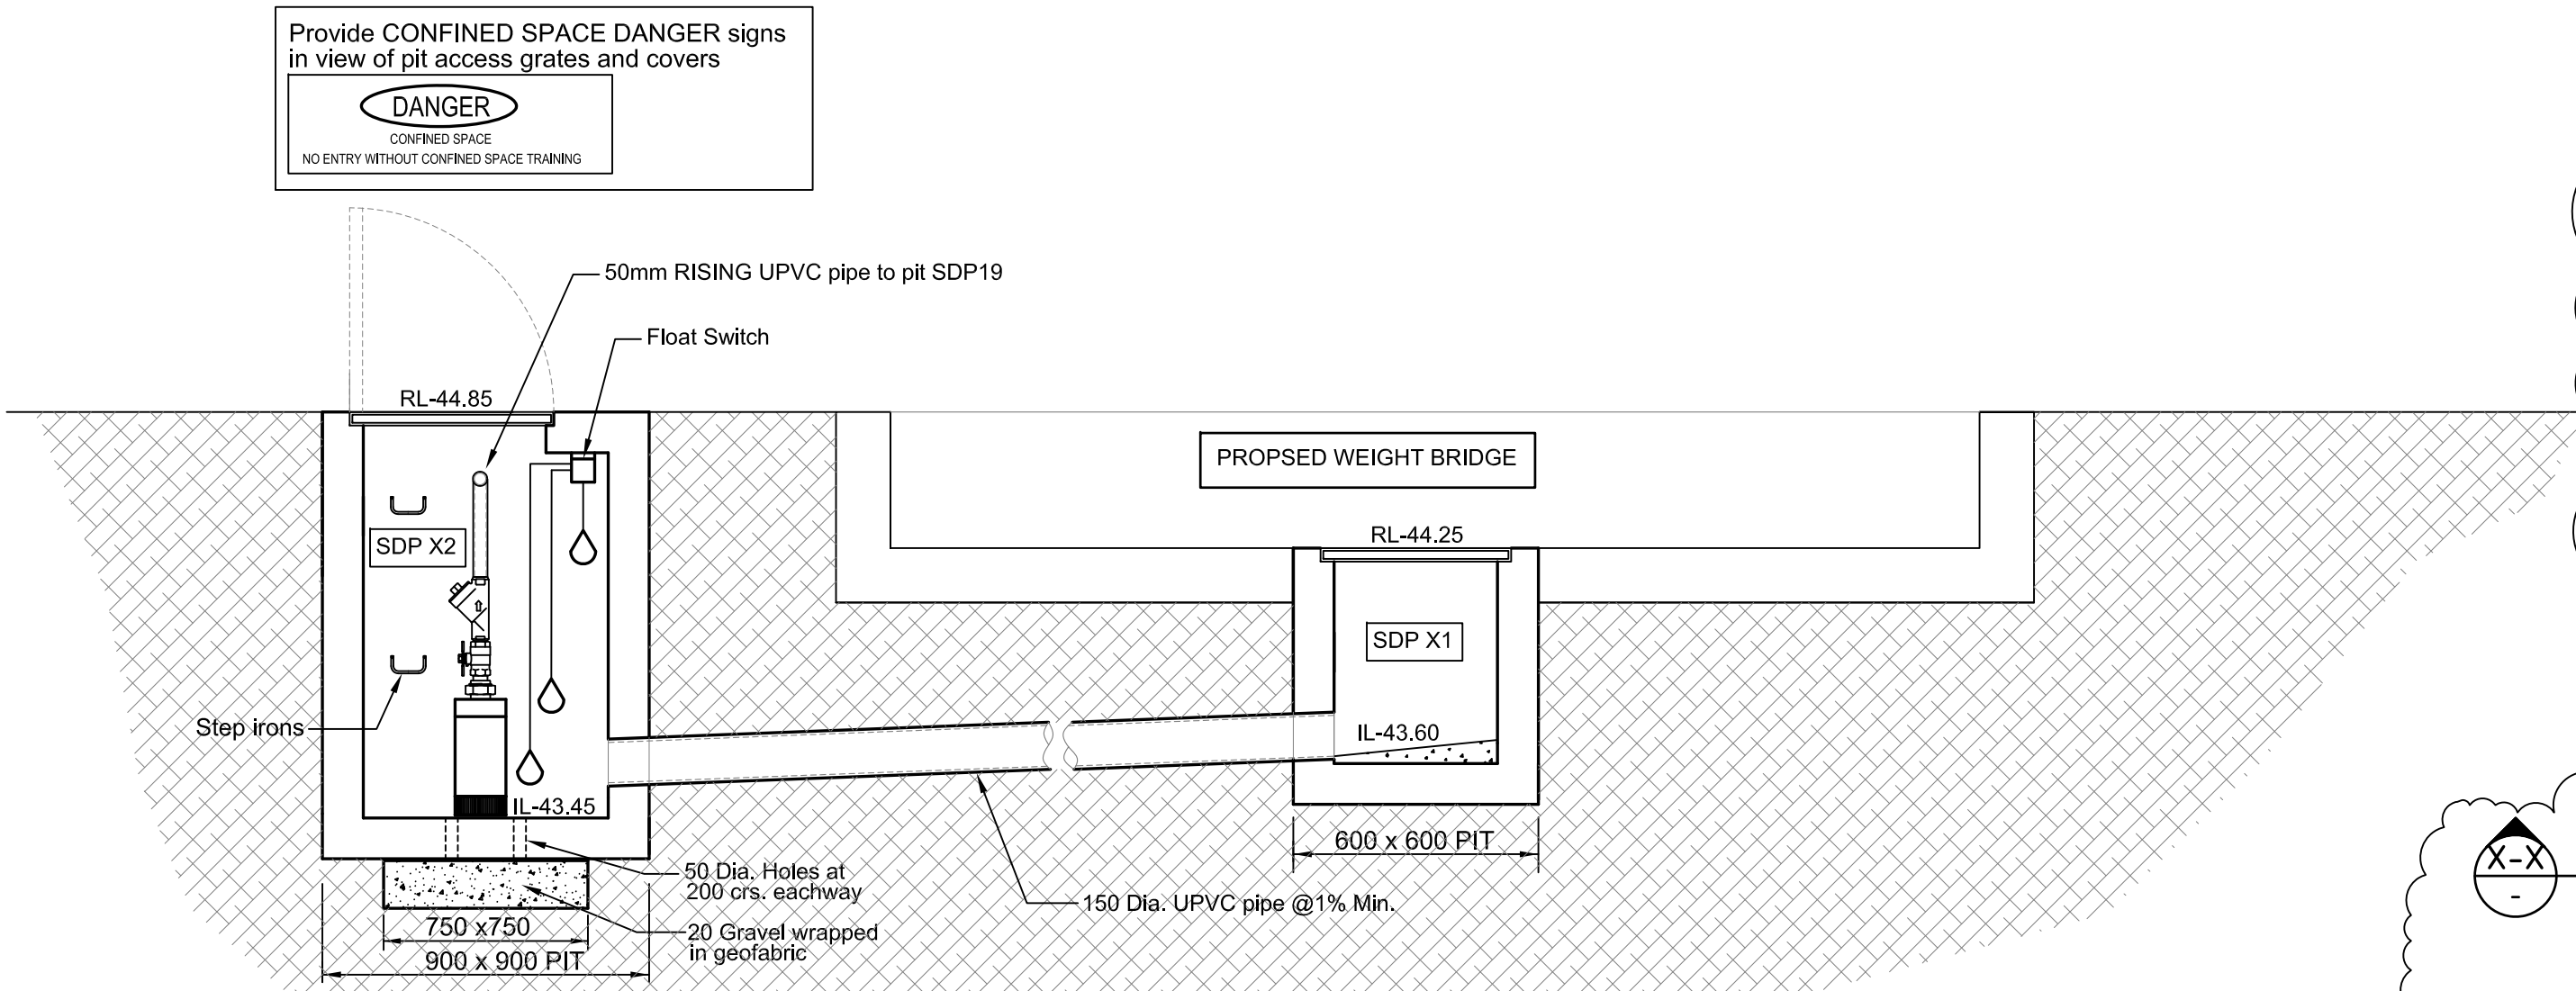


SECTION THROUGH WEIGHT BRIDGE TO PUMP OUT SDP X1-X2


- GENERAL NOTES**
1. INLET AND OUTLET PIPING SHALL BE SPECIFIED BY SITE CIVIL ENGINEER (SEE PLANS) AND PROVIDED BY CONTRACTOR. STORMFILTER IS PROVIDED WITH OPENINGS AT INLET AND OUTLET LOCATIONS.
 2. IF THE PEAK FLOW RATE, AS DETERMINED BY THE SITE CIVIL ENGINEER, EXCEEDS THE PEAK HYDRAULIC CAPACITY OF THE PRODUCT, AN UPSTREAM BYPASS STRUCTURE IS REQUIRED. PLEASE CONTACT STORMWATER360 AUSTRALIA FOR OPTIONS.
 3. THE FILTER CARTRIDGE(S) ARE SIPHON-ACTUATED AND SELF-CLEANING. THE ACTUAL NUMBER SHALL BE SPECIFIED BY THE SITE CIVIL ENGINEER ON SITE PLANS OR IN DATA TABLE BELOW. PRECAST STRUCTURE TO BE CONSTRUCTED BY STORMWATER360 AUSTRALIA IN ACCORDANCE WITH AS3600.
 4. SEE STORMFILTER DESIGN TABLE FOR REQUIRED HYDRAULIC DROP. FOR SHALLOW, LOW DROP OR SPECIAL DESIGN CONSTRAINTS, CONTACT STORMWATER360 AUSTRALIA FOR DESIGN OPTIONS.
 5. ALL WATER QUALITY PRODUCTS REQUIRE PERIODIC MAINTENANCE AS OUTLINED IN THE O&M GUIDELINES. PROVIDE MINIMUM CLEARANCE FOR MAINTENANCE ACCESS.
 6. STRUCTURE AND ACCESS COVERS DESIGNED TO MEET AUSTRROADS T44 LOAD RATING WITH 0.0m TO 2.0m FILL MAXIMUM (CLASS D).
 7. THE STRUCTURE THICKNESSES SHOWN ARE FOR REPRESENTATIONAL PURPOSES AND VARY REGIONALLY.
 8. ANY BACKFILL DEPTH, SUB-BASE, AND OR ANTI-FLOTATION PROVISIONS ARE SITE-SPECIFIC DESIGN CONSIDERATIONS AND SHALL BE SPECIFIED BY SITE CIVIL ENGINEER.
 9. CARTRIDGE HEIGHT IS 690mm FOR FILTER CHAMBER 1 (SHOWN). CARTRIDGE HEIGHT AND ASSOCIATED DESIGN PARAMETERS PER STORMFILTER DESIGN TABLE.
 10. STORMFILTER BY STORMWATER360 AUSTRALIA: PHONE: 1300 354 722 OR www.stormwater360.com.au

STORMFILTER DESIGN TABLE


CARTRIDGE HEIGHT	690	460	310
SYSTEM HYDRAULIC DROP (H - REQ'D. MIN.)	930	700	550
TREATMENT BY MEDIA SURFACE AREA L/s/m ²	1.4	0.7	1.4
CARTRIDGE FLOW RATE (L/s)	1.42	0.71	0.63

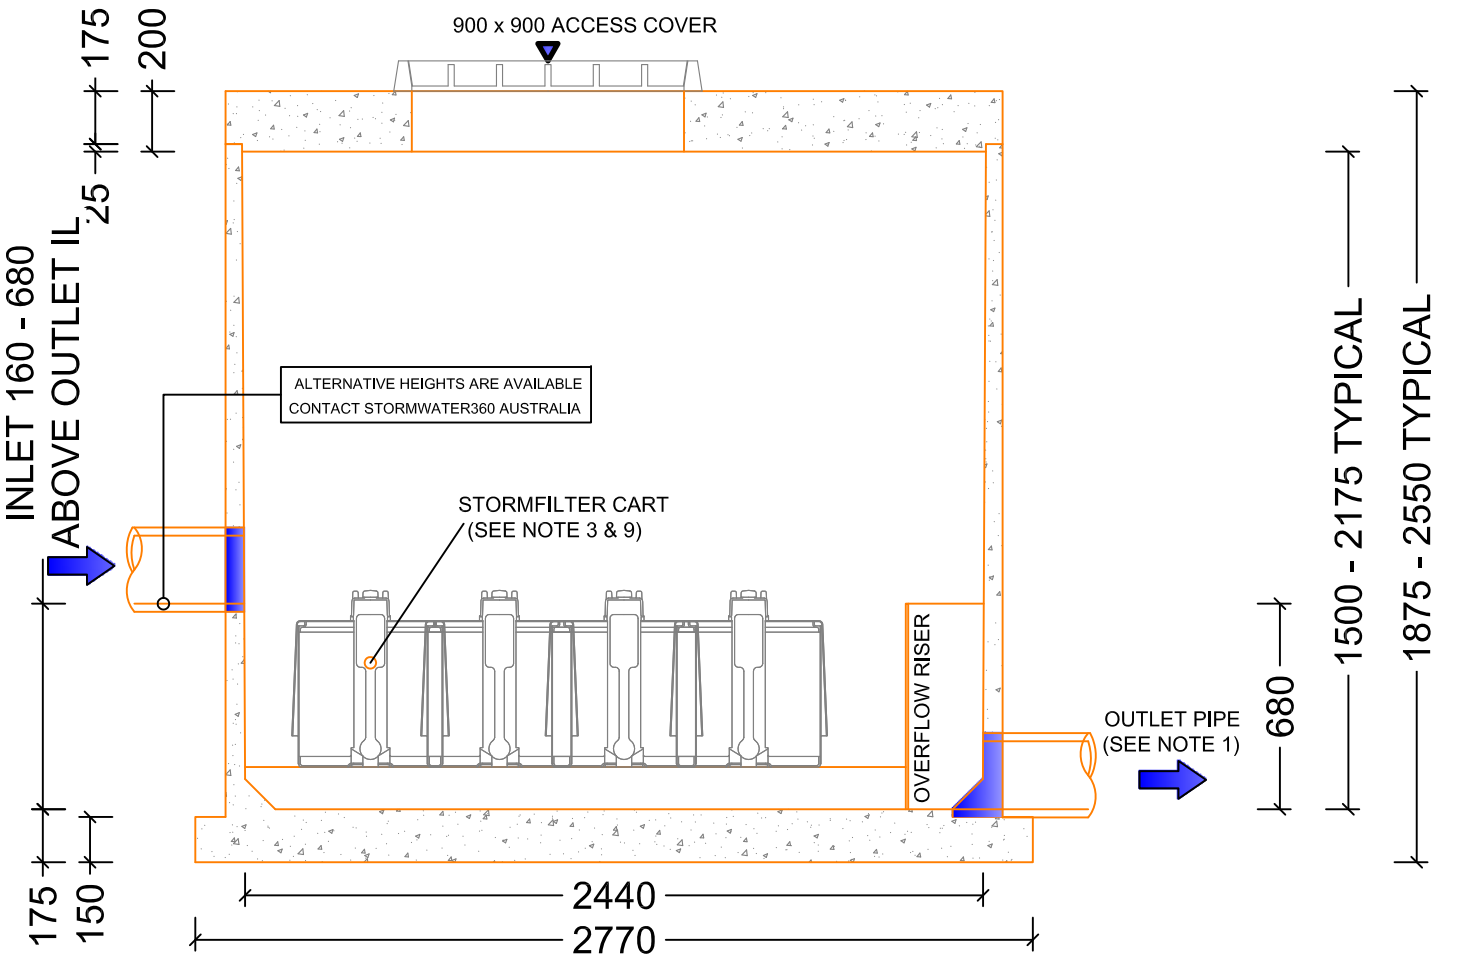


MANHOLE STORMFILTER SECTION STORMWATER 360

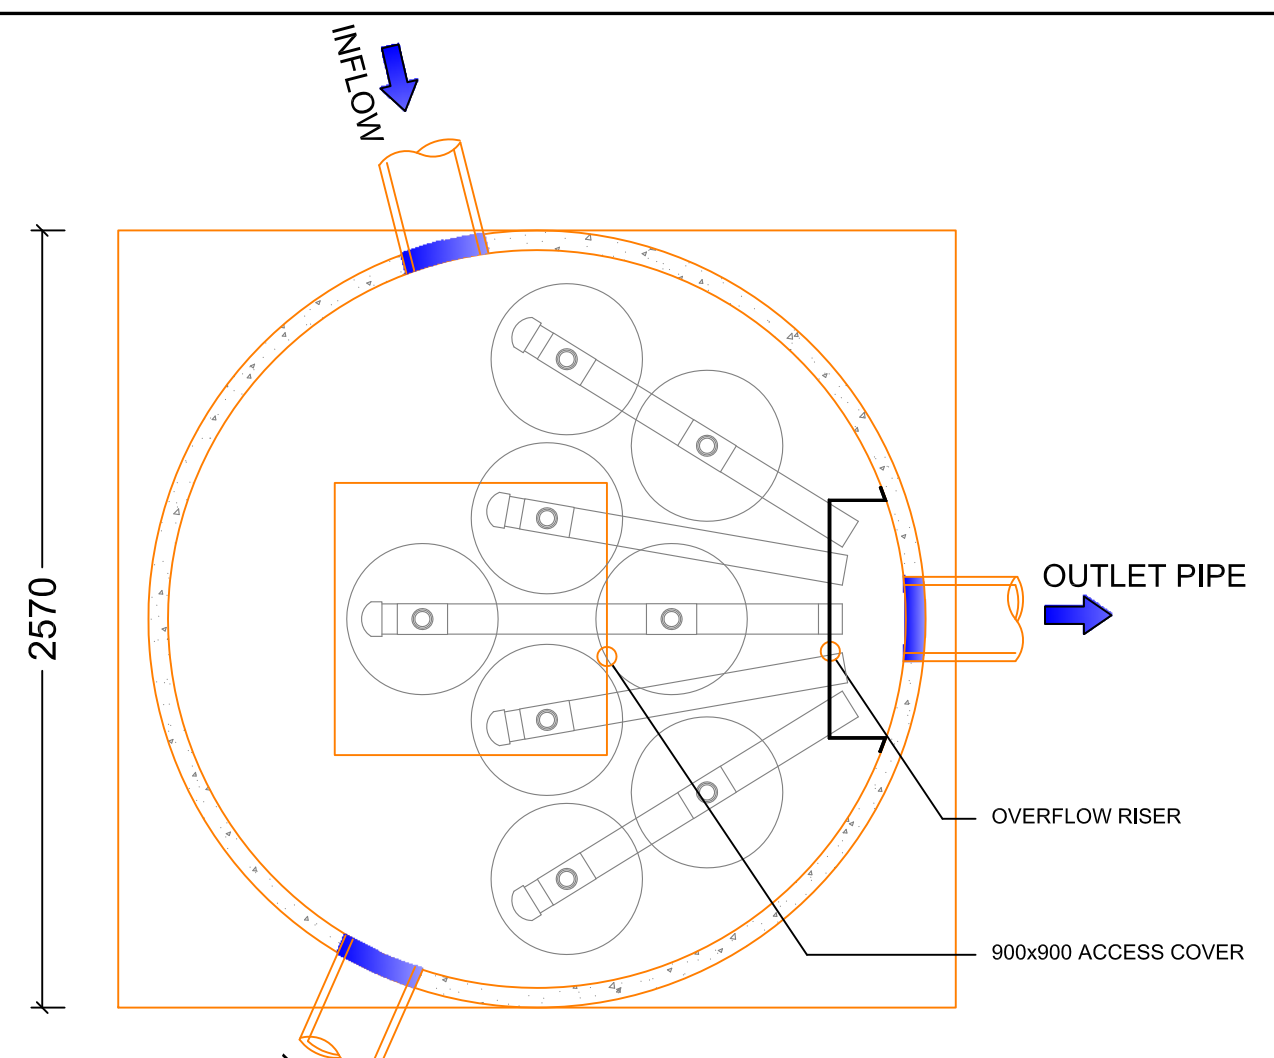

MANHOLE STORMFILTER PLAN STORMWATER 360

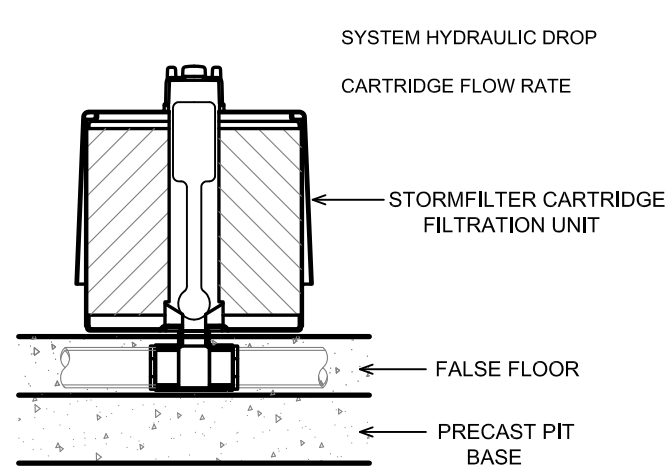


STORMFILTER CARTRIDGE DETAIL

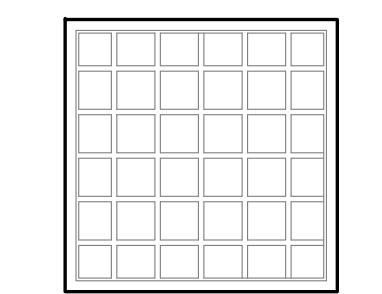


900x900 ACCESS COVER


DETAIL-STORMWATER 360 FILTER CHAMBER-1
8 CARTRIDGE STORMFILTER SYSTEM
2240DIA. CONCRETE MANHOLE

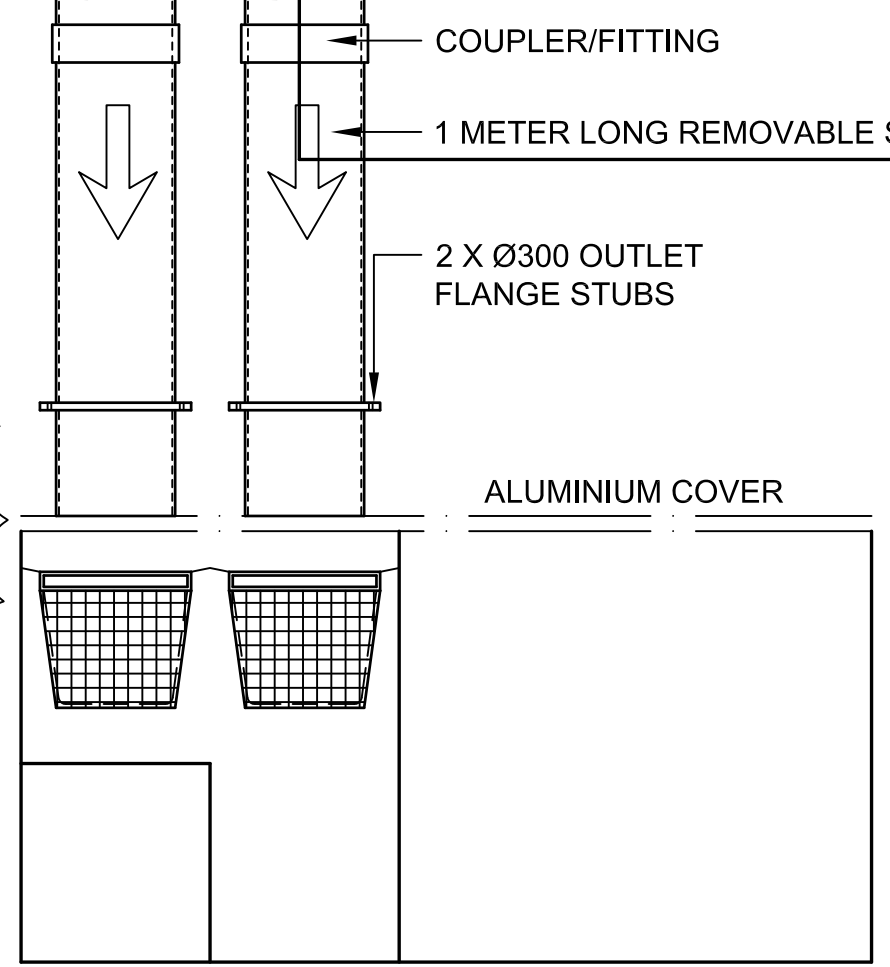


SECTION X-X
SCALE 1:20

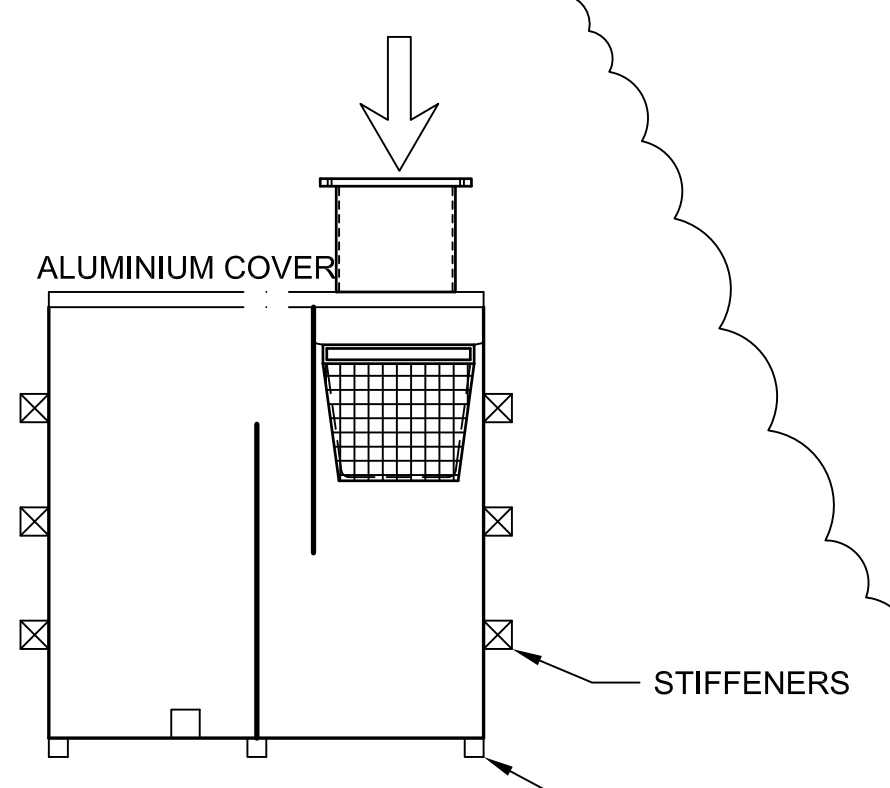


SECTION Y-Y
SCALE 1:20

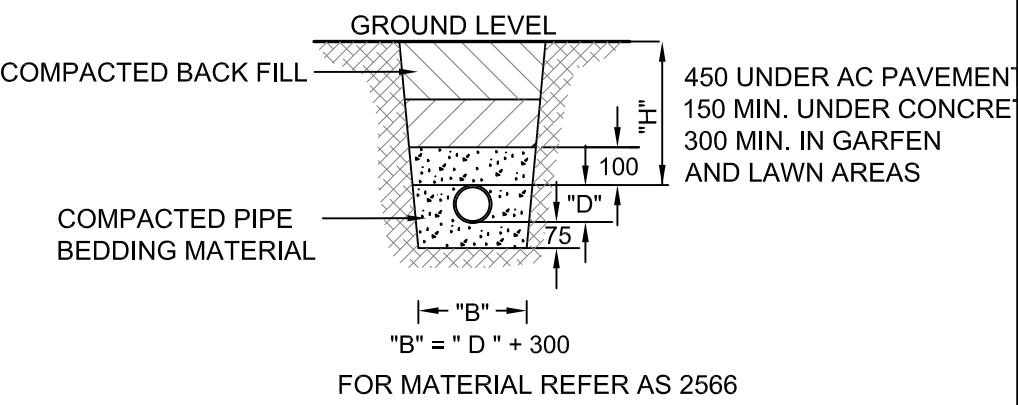

TYPICAL SECTION OF STORMWATER DRAIN

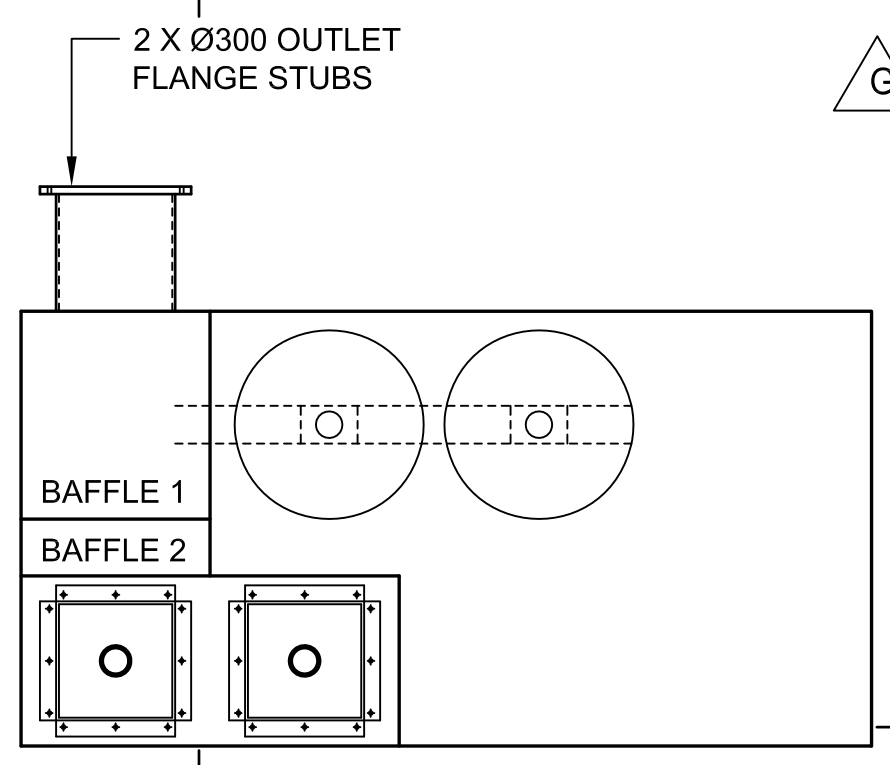

PLAN
SCALE 1:20

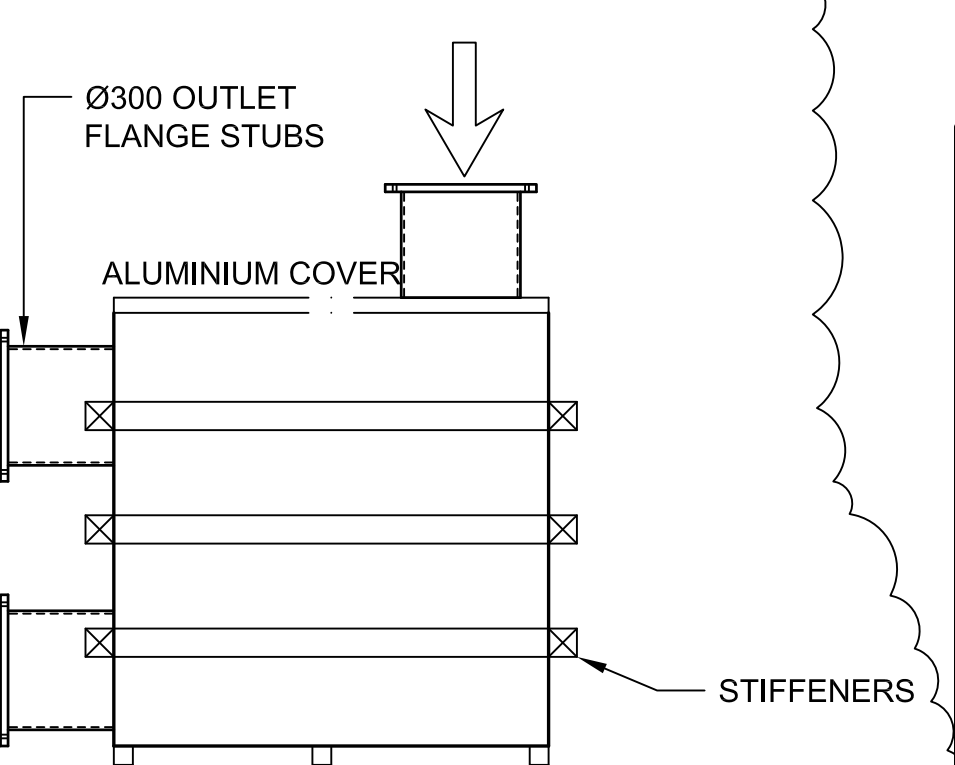

ELEVATION
SCALE 1:20

NOTE: FLANGE STUB TO SUIT 3150D GEBERIT HDPE FITTINGS


ALUMINIUM STORMFILTER, 2 CARTRIDGE STORMFILTER SYSTEM, STORMWATER 360

Amendment	Date
G	05.12.2017
F	25.09.2017
E	26.07.2016
D	11.07.2016
C	23.06.2016
B	06.06.2016
A	03.06.2016

PROPOSED ALTERATIONS & ADDITIONS
TO EXISTING FACTORY FACILITY AT
13 PEMBURY RD, MINTO

BURGESS, ARNOTT & GRAVA PTY LTD
CONSULTING CIVIL, STRUCTURAL & HYDRAULIC ENGINEERS
61A THE CENTRE FORESTVILLE P.O. BOX 69 FORESTVILLE 2087
Ph. 9451 4411 Fax. 9975 2274
email_rob@gravaconsulting.com.au

STORMWATER DETAILS			
Checked	Scale @ A1	Date	Drawing No.
R. GRAVA	AS SHOWN	MAY 2016	2016-041-H2 G
Approved	Chartered Engineer		Drawing 2 in set of 2 Drawing size A1

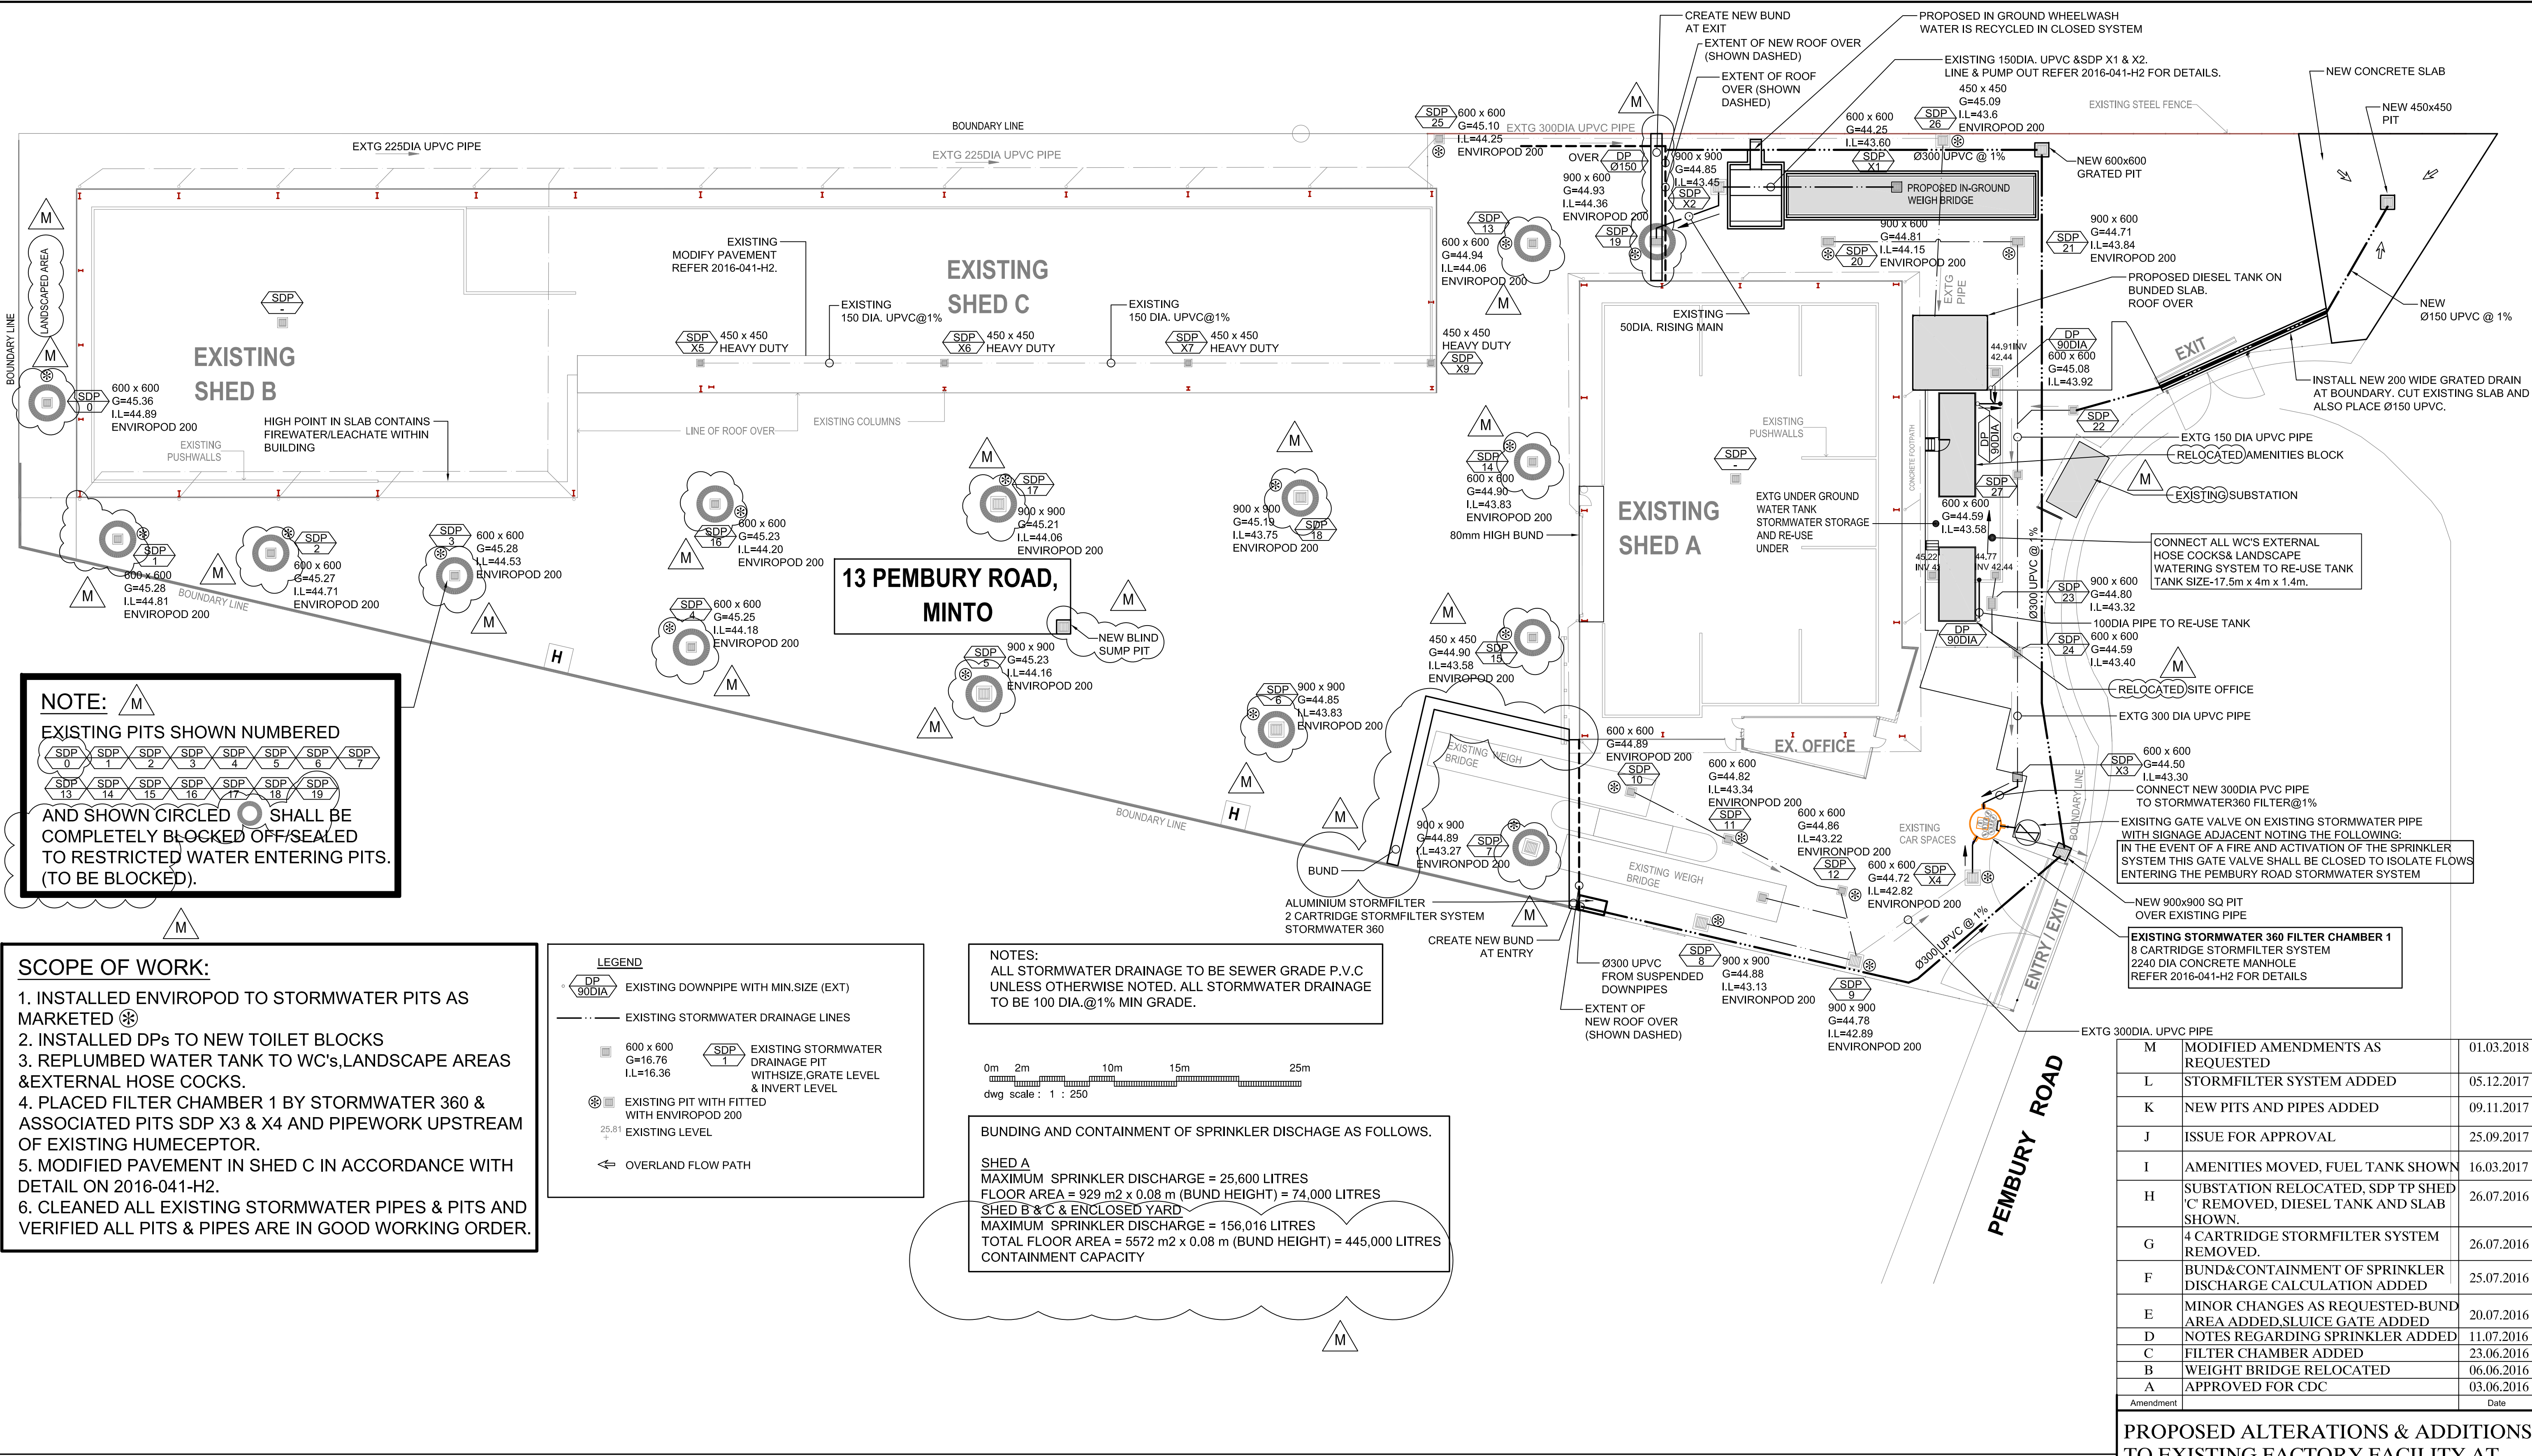

STORMWATER NOTES.

1. All pipes and stormwater structures shall be in strict accordance with relevant S.A.A. Codes for materials, workmanship and to rules and regulations of the local Council.
2. The drawings are diagrammatic and setouts shall be checked with the Architectural drawings.
3. All levels and dimensions shall be checked on site prior to start of construction.
4. Pipe materials indicated may be altered provided they comply with the requirements of the relevant authorities.
5. Gutter and downpipes shall be in strict accordance with AS2179&AS2180. Gutters shall have a minimum effective cross sectional area of 9300mm sq(125QUOD GUTTER or similar)with 100 dia. downpipe unless otherwise noted on plans.
6. Stormwater pipes up to and including 300 dia. shall be PVC pipes, sewer grade conforming to AS1260 and installed in accordance with AS3500.3 and related reference documents.
7. All existing services to be located prior to the commencement of construction. Any cost incurred for adjustments and/or relocation of services to be borne by the applicant.
8. Provide unrestricted overland flowpaths from all pits and drain to detention tank inlet grates.

9. On-site stormwater detention reduces flooding by providing temporary storage of stormwater during storms. After the storm, the stored water is slowly released, normally through a control orifice. System incorporating a High Early Discharge first fill the HED section, then overflow into the storage and later flow-back into HED through a one-way line. During light rain, no storage occurs. During extreme rainfall, the detention system will fill and could overflow. A typical storage system will quickly fill but take several hours to empty. Submergence during this period will not affect most grass, plants or trees.
10. Councils require that on-site detention systems be inspected during construction to enable a final Hydraulic Certificate and Work as Executed details to be supplied upon completion. Councils require that concrete works (tank bases, lids, retaining walls etc.) are inspected before pouring and a Structural Engineers Certificate is issued on completion.
11. These details are subject to approval by Council and possibly other authorities. Do not continue or commit to any works until these details are approved. Advise Design Engineer of any special conditions imposed or design variations made to the details. Any alterations (however minor) must be authorised by the Design Engineer.
12. Conditions found during construction that conflict with these details shall be reported to the Design Engineer. If in doubt, ask. Design sizes, levels, heights and depths must not be varied without approval.

13. All works are to be completed before the Final Certificate will be issued. Tanks are to be clear of all formwork, builder's rubbish and silt. The outline and sump drain is to be clear. All pits and grates are to be completed and shall be free of building material and spoil. All downpipes are to be connected. Landscape works including driveways, kerbs and drive trench grates shall be installed. Orifices, screens, step irons and tank grate locks are to be correctly fitted. Surface detention areas are to be turfed.
14. Maintenance of the on-site stormwater detention system is the responsibility of the Owner. A complete set of these details shall be provided to the present owner. The details should be passed on to subsequent owners. It is important that these systems are not modified without approval. Do not enter any pit or tank where there is risk of inadequate ventilation or buildup of noxious odours, gases, or leakage of any volatile or toxic contaminations into the chamber. Obtain professional assistance if any of these conditions occur.
15. Maintenance and cleaning is required as follows. Remove and flush clean the trash screen. Hose out the tank base and remove accumulated debris. Flush the discharge-line clear. This must be done to Council's time requirements and as all Council's vary it is the responsibility of the Owner to find out Council's requirements.

16. Orifice plates shall be fabricated from 3mm thick stainless steel, with a circular hole machined to 1/2mm. Plates shall be fixed flush using four stainless steel expansion or chemical anchors. If required by Council, the orifice plate shall also be epoxy fixed. Unless otherwise detailed, plates shall be fixed on the centreline of the outlet.
17. Screen mesh shall be Lysaght's expanded metal, type RH3030, and shall not be hot dipped galvanised after fabrication. The screen shall have elongated mesh openings set horizontal, and the projecting mesh lines pointing down and facing upstream. Screens shall be provided with a suitable handle located on the top upstream face of the screen (for removal and, for flat screens, to define the screen orientation). All screens shall be removable by hand without the use of tools. Fixing brackets shall be stainless or galvanised mild-steel type. Bracket anchors shall be stainless steel. When installed, the maximum edge gap shall be 3mm + or - 3mm.
18. One-way flaps shall be Roda Floodgate type. Flaps shall be located clear of inlets, screens and step irons and must not prevent the screen from being removed.
19. Concrete shall be 20 MPa for footings and tank bases, and 25 MPa for suspended tank lid slabs. Mesh reinforcement shall be lapped one square plus 25mm and bar reinforcement shall be lapped 500mm.
20. Permanent (non-structural) formwork shall be Lysaght's Bondek, any grade, or equal.

21. Tanks may be in-situ or precast. Note that falls, sumps and the position and depth to orifice plates or discharge control pipe is critical: both for hydraulic and health reasons. Overflow and access grates also provide light and ventilation requirements of various Authorities. Provide step irons to all tanks over 1200 depth.
22. Tank risers should be in-situ concrete. Risers shall have the same clear internal size as the tank access opening. Provide step irons to risers as specified.
23. Individual-rung step irons to tank, tank risers and deep pits shall be an approved type (galvanised steel or high impact plastic) complying with AS 1657. Fix rungs permanently and securely by drilling and epoxy grouting. Provide the specified number of step-irons, equally spaced vertically between 250mm and 350mm, with alternate rungs offset 200mm.
24. Grates and frame units shall be hinged and childproof, using either a spring loaded bolt or a bolt and lug locking system (padlocks are not permitted). The frames shall be securely attached to the tank or riser, or built into an in-situ slab.
25. Grates shall be class A (light duty) in paths and lawns; class B (medium duty) in residential vehicular areas; and class C (heavy duty) in public roadways.

Checked	Scale @ A1	Date	Drawing No.
R. GRAVA	AS SHOWN	MAY 2016	2016-041-H1 M
Approved	Chartered Engineer	Drawing 3 in set of 3 Drawing size A1	

