


GENERAL LAYOUT OF DEVELOPMENT

CENTRALISED BATTERY ENERGY STORAGE (BESS) SYSTEM FORMAT

Legend

- Site Boundary (630ha)
- Development Footprint (375ha) [inside 15m APZ buffer]
- Construction laydown area (1.6ha)
- Construction parking and storage facilities (0.4ha)
- Proposed 132kV Substation [inside 20m APZ buffer]
- Photovoltaic solar arrays
- Access point
- Transmission line & easement (45m width)
- Haulage route
- Access Road
- 20m APZ
- Continuous Vegetation Screening
- Supplementary Vegetation Screening
- Intermittent vegetation screening
- Centralised energy storage system

- Paddock trees - no hollows
- Paddock trees - with hollows
- Stag- with hollows
- Existing plantings
- Archaeological Site
- Waterway Buffer (40 m)
- Sandy Hollow to Maryvale Railway line
- Retained vegetation
- Archaeological Area
- Associated receivers
- Non-associated receivers
- Waterways
- Railway Corridor

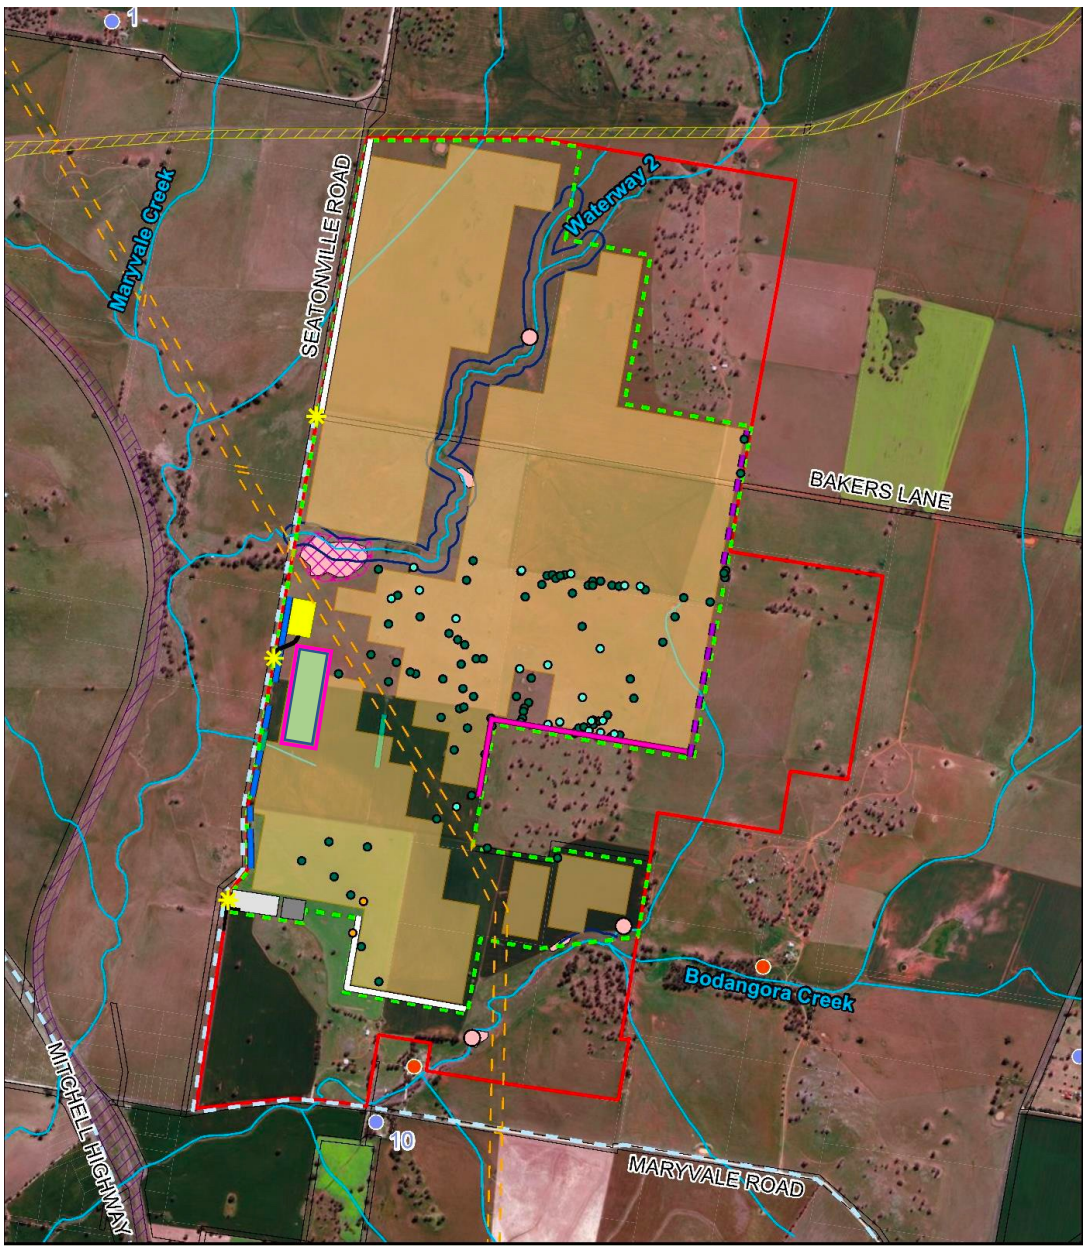

GENERAL LAYOUT OF DEVELOPMENT DISTRIBUTED BATTERY ENERGY STORAGE SYSTEM (BESS) FORMAT

