



SUITE 17, 808 FOREST ROAD, PEAKHURST 2210 ABN: 73 107 291 494
P. 02 9046 3800 ACOUSTICS@DAYDESIGN.COM.AU WWW.DAYDESIGN.COM.AU

Noise and Vibration Assessment

St Francis Catholic College Masterplan
130 – 160 Jardine Drive, Edmondson Park, NSW

REPORT No
5948-5.1R

DATE ISSUED
8 May 2018

Prepared For:

Catholic Education Office, Diocese of Wollongong
C/- JDH Architects
44 Little Oxford Street
Darlinghurst NSW 2010

Attention: Mr Jason Tan



Revision History

Report	Date	Prepared	Checked	Comment
Draft	11/04/2018	William Wang	Stephen Gauld	By email, for client review
Draft 2	30/04/2018	William Wang	Stephen Gauld	
Final	08/05/2018	William Wang	Stephen Gauld	

Document R\5948-5.1R, 41 pages plus attachments

Disclaimer

The work presented in this document was carried out in accordance with the Day Design Pty Ltd Quality Management System. Day Design is certified to ISO9001.

Day Design Pty Ltd reserves all copyright of intellectual property in any or all of Day Design's documents. No permission, license or authority is granted by Day Design to any person or organisation to use any of Day Design's documents for any purpose without written consent of Day Design.

This report has been prepared for the client identified and cannot be relied or used by any third party. Any representation, statement, opinion or advice, expressed or implied in this report is made in good faith but on the basis that Day Design is not liable (whether by reason of negligence, lack of care or otherwise) to any person for any damage or loss whatsoever which has occurred or may occur in relation to that person taking or not taking (as the case may be) action in any respect of any representation, statement, or advice referred to above.

Recommendations made in this report are intended to resolve acoustical problems only. No claims of expertise in other areas are made and no liability is accepted in respect of design or construction for issues falling outside the specialist field of acoustical engineering including but not limited to structural, fire, thermal, architectural buildability, fit for purpose, waterproofing or other aspects of building construction. Supplementary professional advice should be sought in respect of these issues.

The information in this document should not be reproduced, presented or reviewed except in full. Prior to passing onto a third party, the Client is to fully inform the third party of the specific brief and limitations associated with the commission.



TABLE OF CONTENTS

1.0	CONSULTING BRIEF	5
2.0	PROJECT AND SITE DESCRIPTION.....	6
3.0	NOISE SURVEY INSTRUMENTATION	10
4.0	NOISE EMISSION CRITERIA	11
4.1	Background Noise Level.....	11
4.4	AAAC Noise Criteria for Outdoor Play Areas	14
4.5	Road Traffic Noise Criteria.....	15
4.6	Project Specific Noise Emission Criteria.....	15
5.0	COLLEGE NOISE EMISSION	16
5.1	Students in Outdoor Areas	16
5.2	Public Address System and College Bell	18
5.3	College Hall	18
5.4	Car Park Noise Emission	21
5.5	On-Road Traffic Noise Impact.....	22
5.6	Mechanical Plant	23
6.0	ACCEPTABLE NOISE INTRUSION LEVELS	24
7.0	CONSTRUCTION NOISE AND VIBRATION CRITERIA	25
7.1	Australian Standard AS2436	25
7.2	EPA Construction Noise Guideline.....	26
7.3	EPA Vibration Guideline.....	28
8.0	CONSTRUCTION NOISE AND VIBRATION ASSESSMENT.....	29
8.1	Stage 1 – Site Preparation.....	29
8.2	Stage 2 – Earthworks.....	30
8.3	Vibration Impacts.....	32
8.4	Stage 3 – Construction	33
9.0	CONSTRUCTION NOISE AND VIBRATION MITIGATION RECOMMENDATIONS.....	34
9.1	Engineering and Practical Noise Controls	34
9.2	Noisy Equipment/Machinery.....	35
9.3	Use Quieter Methods	35
9.4	Use Quieter Equipment.....	35
9.5	Maintain Equipment	36
9.6	Transmission Path	36
9.7	Periods of Respite	36
9.8	Work Practices	37
9.9	Heavy Vehicles and Staff Vehicles	37
9.10	Community Relations	38
9.11	Managing a Noise Complaint.....	38
9.12	Noise Monitoring.....	39
9.13	Vibration Monitoring.....	39
9.14	Noise Measurement Equipment.....	39
9.15	Attended Residential Noise Monitoring Procedure	40
9.16	Noise Monitoring of Equipment.....	40
10.0	NOISE IMPACT STATEMENT	41



TABLES

Table 1	Noise Sensitive Receptors	7
Table 2	Noise Instrumentation	10
Table 3	Ambient Noise Levels – Edmondson Park.....	11
Table 4	Amenity Noise Level.....	13
Table 5	Road Traffic Noise Assessment Criteria - Residential.....	15
Table 6	Students at Play (outside) L_{eq} Sound Power Levels	16
Table 7	Predicted L_{eq} Outdoor Noise Levels	17
Table 8	Hall Activity L_{eq} Sound Power Levels	18
Table 9	Predicted L_{eq} Hall Noise Levels (Doors Open)	19
Table 10	L_{eq} Levels of Car Parks	21
Table 11	L_{eq} Levels of a Car Park with traffic flow of 900 trips in 1 hour	22
Table 12	Mechanical Plant L_{eq} Sound Power Levels	23
Table 13	Predicted L_{eq} Noise Levels from Condenser Units	23
Table 14	Required Indoor Noise Levels – Residential Buildings.....	24
Table 15	L_{eq} Noise Management Levels from Construction Activities	27
Table 16	Vibration Dose Values (VDV) from Construction Activities	28
Table 17	Transient Vibration Guide Values for Cosmetic Damage	28
Table 18	Typical Site Preparation Equipment - Sound Power Levels	29
Table 19	Calculated Receptor Sound Pressure Levels from Site Preparation	30
Table 20	Typical Earthworks Equipment - Sound Power Levels	30
Table 21	Calculated Receptor Sound Pressure Levels from Earthworks.....	31
Table 22	Recommended Safe Working Distances for Vibration Generating Plant	32
Table 23	Typical Construction Equipment - Sound Power Levels.....	33
Table 24	Calculated Receptor Sound Pressure Levels from Construction	33
Table 25	Relative Effectiveness of Various Forms of Noise Control	34



1.0 CONSULTING BRIEF

Day Design Pty Ltd was engaged by JDH Architects on behalf of the Catholic Education Office, Diocese of Wollongong to carry out an acoustic assessment for the masterplan development of St Francis Catholic College located at 130-160 Jardine Drive, Edmondson Park, NSW. As part of the State Significant Development application, the Secretary's Environmental Assessment Requirements relating to noise and vibration are addressed in this report.

The scope of work is as follows:

- Review the architectural drawings
- Inspect the development site in Edmondson Park
- Determine the background noise levels at critical locations and times
- Establish acceptable noise level criteria
- Quantify noise emissions from the College
- Calculate the level of noise emission, taking into account building envelope transmission loss, screen walls, ground absorption and distance attenuation
- Prepare a site plan identifying the development and nearby noise sensitive locations
- Provide recommendations for noise control (if necessary)
- Prepare an Acoustic Assessment Report.



2.0 PROJECT AND SITE DESCRIPTION

A temporary catholic school is located at 130-160 Jardine Drive, Edmondson Park, NSW. The masterplan for the college will be to have a capacity for approximately 1,900 students catering from Kindergarten to Year 12 and 140 full time equivalent staff. An 80 place learning centre with 14 staff is also proposed on the site.

The Catholic Education Office, Diocese of Wollongong received two development consents from Liverpool City Council (DA456/2016 and DA422/2017) to construct a temporary college for St Francis Catholic College. The temporary College is currently operating.

The subject site was zoned SP2 Infrastructure - Educational Establishment until 2016. In 2016, it was rezoned to R1 General Residential. Educational Establishments are permissible with consent under the *Liverpool Local Environmental Plan 2008* (LEP) in the R1 zone. The LEP's definition of Educational Establishments is consistent with the *State Environmental Planning Policy (Educational Establishments and Child Care Facilities) 2017* (SEPP).

The Secretary's Environmental Assessment Requirements (SEARs) requires a noise and vibration assessment of the proposed College masterplan, extracted below:

11. Noise and Vibration

Identify and provide a quantitative assessment of the main noise and vibration generating sources during site preparation, bulk excavation, construction and operation, including consideration of any public address system, college bell, mechanical services (eg air conditioning plant), use of any college hall for concerts etc. (both during and outside college hours) and any out of hours community use of college facilities, and outline measures to minimise and mitigate the potential noise impacts on surrounding occupiers of land

Relevant Policies and Guidelines

- *NSW Industrial Noise Policy (EPA)*
- *Interim Construction Noise Guideline (DECC)*
- *Assessing Vibration: A Technical Guideline 2006*
- *Development Near Rail Corridors and Busy Roads – Interim Guideline (Department of Planning 2008).*

Edmondson Park is undergoing redevelopment, with land in the process of being developed for low density residential dwellings.

Existing and future residences will be located in all directions of the college site, with some along the common western boundary and other across local roads. Refer to Figures 1 and 2 for more detail.



The nearest noise sensitive receptors to the property, in various directions, are shown in Figure 1 and as follows in Table 1.

Table 1 Noise Sensitive Receptors

Receptor and Type	Address	Direction from site
R1 - Future Residence	Jardine Drive	North-west
R2 - Future Residence	New Road	West
R3 - Future Residence	Poziers Road	North-east
R4 - Future Residence	Vinny Road	East
R5 - Future Residence	Guillemont Road	South

Long term ambient noise measurements have previously been taken on the site, behind a previously existing residential dwelling at 130 Jardine Drive, prior to any construction works, with the location shown as Location 'A' on Figure 1. Ambient noise levels are presented in Section 3 of this report. This location was chosen to represent the acoustic environment of the nearby residential neighbours, prior to any construction works on the site.

Acceptable noise limits are derived from the EPA's NSW Noise Policy for Industry for intrusive noise impacts from mechanical plant and indoor noise, at each residence, and The Association of Australasian Acoustical Consultants (AAAC) *Technical Guideline for Child Care Centre Noise Assessment* noise criteria for children in outdoor areas.

Noise levels from children in the outdoor areas, public address system and use of the hall have been calculated at the nearest residential premises and are presented in Section 5.0.



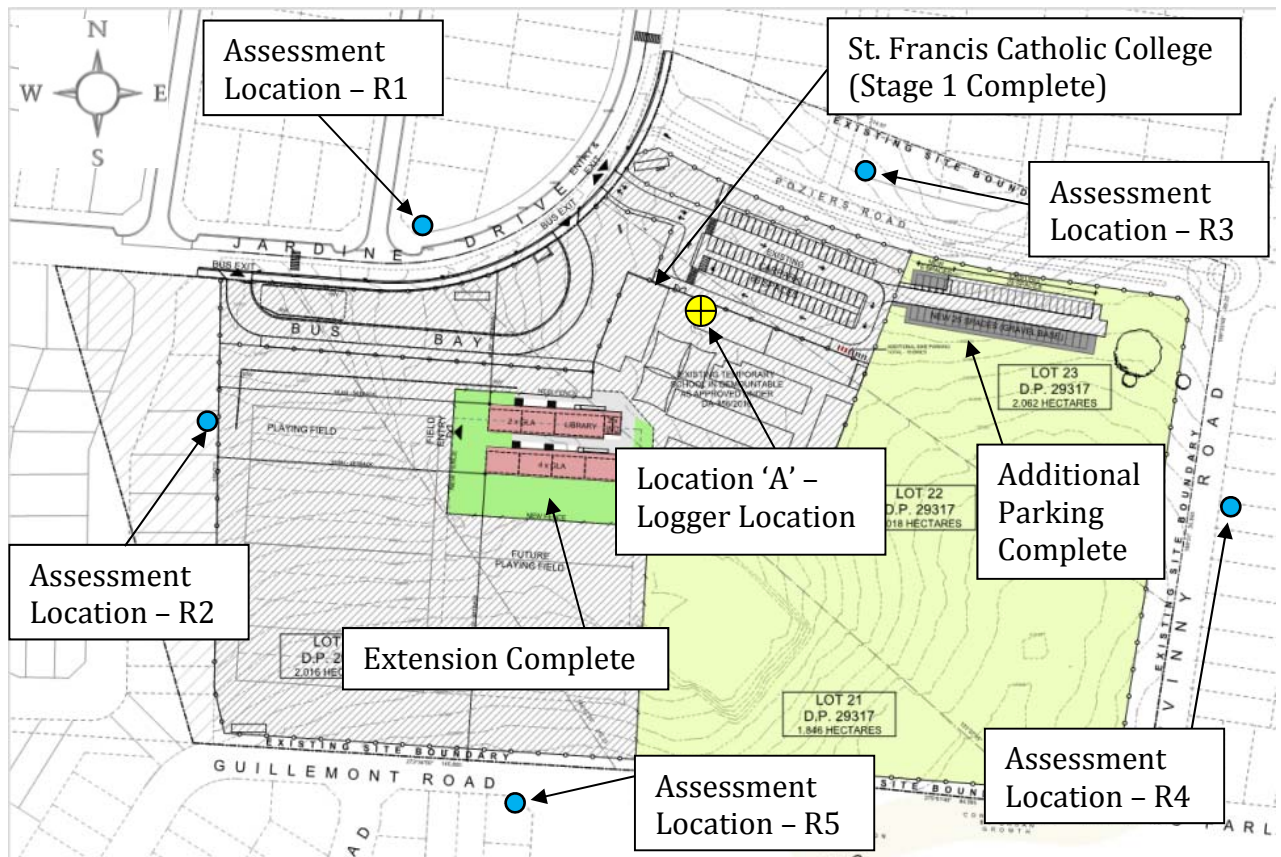


Figure 1 - Location Plan, 130 - 160 Jardine Drive, Edmondson Park





3.0 NOISE SURVEY INSTRUMENTATION

Noise level measurements and analysis were made with instrumentation as follows in Table 2:

Table 2 Noise Instrumentation

Description	Model No	Serial No
Infobyte Noise Logger(Type 2)	iM4	112
Condenser Microphone 0.5" diameter	MK 250	112

An environmental noise logger is used to continuously monitor ambient noise levels and provide information on the statistical distribution of noise during an extended period of time. The Infobyte Noise Monitor iM4 is a Type 2 precision environmental noise monitors meeting all the applicable requirements of AS1259 for an integrating-averaging sound level meter.

All instrument systems had been laboratory calibrated using instrumentation traceable to Australian National Standards and certified within the last two years thus conforming to Australian Standards. The measurement system was also field calibrated prior to and after noise surveys. Calibration drift was found to be less than 1 dB for unattended measurements. No adjustments for instrument drift during the measurement period were warranted.



4.0 NOISE EMISSION CRITERIA

4.1 Background Noise Level

In order to assess the severity of a possible environmental noise problem in a residential area it is necessary to measure the ambient background noise level at the times and locations of worst possible annoyance. The lower the background noise level, the more perceptible the intrusive noise becomes and the more potentially annoying.

The ambient L_{90} background noise level is a statistical measure of the sound pressure level that is exceeded for 90% of the measuring period (typically 15 minutes).

The Rating Background Level (RBL) is defined by the NSW EPA as the median value of the (lower) tenth percentile of L_{90} ambient background noise levels for the day, evening or night time periods, measured over a number of days during the proposed days and times of operation.

The places of worst possible annoyance are the potential future two-storey residential dwellings surrounding the site. These potentially affected locations can be seen in Figure 1 above. The times of greatest annoyance will be during the day when the College is operating.

An environmental noise logger was placed in the rear yard of 130 Jardine Drive in April 2016, prior to any construction works on site, to determine the Rating Background Level of the area. This location is shown on Figure 1 as Location 'A'.

The measured noise levels are presented in the attached Appendix A and also in Table 3 below.

Table 3 Ambient Noise Levels – Edmondson Park

Location	Time Period	L_{90} Rating Background Level (dBA)	Existing L_{eq} Noise Level (dBA)
Location 'A' – 130 Jardine Drive, Edmondson Park	Day (7 am to 6 pm)	41	50
	Evening (6 pm to 10 pm)	40	48
	Night (10 pm to 7 am)	33	45

Atmospheric conditions were ideal for noise monitoring. Noise measurements were therefore considered reliable and typical for the receptor area.



4.2 NSW Noise Policy for Industry

The NSW Industrial Noise Policy has been superseded by the *NSW Noise Policy for Industry*.

The NSW Environment Protection Authority (EPA) published the *Noise Policy for Industry* (NPI) in October 2017. The NPI supersedes the NSW Industrial Noise Policy. The NPI is specifically aimed at assessing noise from industrial noise sources listed in Schedule 1 of the Protection of the Environment Operations Act 1997 (POEO, 1997).

The proposed College is not a 'scheduled premises' under the Protection of the Environment Operations Act 1997, as it is not required to hold a licence under that Act for operations at the site.

The appropriate regulatory authority (Liverpool City Council) may, by notice in writing given to such a person, prohibit the person from causing, permitting or allowing:

- (a) any specified activity to be carried on at the premises, or
- (b) any specified article to be used or operated at the premises,

or both, in such a manner as to cause the emission from the premises, at all times or on specified days, or between specified times on all days or on specified days, of noise that, when measured at any specified point (whether within or outside the premises,) is in excess of a specified level.

The NPI provides a useful framework to assess noise emission from non-scheduled premises, whether that premises produces intrusive or non-intrusive noise.

4.2.1 Project Intrusiveness Noise Level

The EPA states in Section 2.3 of its NSW NPI (October 2017) that the intrusiveness of an industrial noise source may generally be considered acceptable if the level of noise from the source (represented by the L_{Aeq} descriptor), measured over a 15-minute period, does not exceed the rating background noise level by more than 5 dB when beyond a minimum threshold (EPA NPI, 2017, Section 2.3).

The Rating Background Level at Edmondson Park was, 41dBA in the day, 40 dBA in the evening, and 33 dBA at night. Therefore the acceptable L_{eq} noise intrusiveness criteria in this area is:

- $(41 + 5 =) 46$ dBA during the day;
- $(40 + 5 =) 45$ dBA in the evening; and
- $(33 + 5 =) 38$ dBA at night.



4.2.2 Project Amenity Noise Level

Depending on the type of area in which the noise is being made, there is a certain reasonable expectancy for noise amenity. The NSW NPI provides a schedule of recommended L_{eq} industrial noise levels that under normal circumstances should not be exceeded. If successive developments occur near a residential area, each one allowing a criterion of background noise level plus 5 dB, the ambient noise level will gradually creep higher.

The project amenity noise level is typically the recommended amenity noise level minus 5 dB. However, where the resultant project amenity level is 10 dB or lower than the existing industrial noise level, the project amenity level can be set to 10 dB below the existing noise level. The recommended L_{eq} noise levels below in Table 4 are taken from Section 2.4, Table 2.2 of the NPI.

Table 4 Amenity Noise Level

Type of Receiver	Indicative Noise Amenity Area	Time of Day	Recommended L_{eq} Noise Level, dBA
Residence	Suburban	Day	55
		Evening	45
		Night	40

The L_{Aeq} is determined over a 15-minute period for the project intrusiveness noise level and over an assessment period (day, evening and night) for the project amenity noise level. This leads to the situation where, because of the different averaging periods, the same numerical value does not necessarily represent the same amount of noise heard by a person for different time periods. To standardise the time periods for the intrusiveness and amenity noise levels, the NPI assumes that the $L_{Aeq,15min}$ will be taken to be equal to the $L_{Aeq, period} + 3 \text{ decibels (dB)}$.

The recommended amenity noise level at Edmondson Park is 55 dBA during the day, 45 dBA in the evening and 40 dBA at night for residential premises. The acceptable L_{eq} amenity noise level for in this area is:

- $(55 - 5 + 3 =) 53 \text{ dBA}$ during the day;
- $(45 - 5 + 3 =) 43 \text{ dBA}$ in the evening; and
- $(40 - 5 + 3 =) 38 \text{ dBA}$ at night.



4.3 Modifying Factors

Where a noise source contains certain characteristics, such as tonality, impulsiveness, intermittency or dominant low-frequency content, there is evidence to suggest that it can cause greater annoyance than other noise at the same noise level. On the other hand, some sources may cause less annoyance where only a single event occurs for a limited duration. Correction factors are to be applied to the noise from the source measured or predicted at the receiver before comparison with the project noise level. AC500-10 in the Appendices is extracted from Table C.1 of the NPI.

4.4 AAAC Noise Criteria for Outdoor Play Areas

In May 2008, the Association of Australasian Acoustical Consultants (AAAC) first published the *Technical Guideline for Child Care Centre Noise Assessment*. The guideline was updated in 2010 to assist both AAAC members and local councils to assess the noise impact from proposed child care centres both accurately and fairly, (see www.aaac.org.au).

Although the proposed masterplan development is a college and therefore may produce different levels of noise than a childcare centre, there are similarities in noise emission from uses of outdoor play areas for colleges and childcare centres. As students do not play outdoors continuously for long periods of time, and as the duration of time for students playing outside is reduced, the overall noise annoyance reduces. Therefore, it is reasonable to allow a higher level of noise impact for a shorter duration.

The AAAC document states that a total time limit of 2 hours of outdoor play per day (eg 1 hour in the morning and 1 hour in the afternoon) should allow an additional 5 dB noise impact.

We recommend that the noise criteria detailed in *Technical Guideline for Child Care Centre Noise Assessment* be applied to outdoor areas of the College.

The relevant criteria is $L_{eq, 15min}$ noise level emitted from the outdoor play area shall not exceed the background noise level by more than 10 dB at the residential assessment location.

Up to 2 hours (total) per day – The $L_{eq, 15min}$ noise level emitted from the outdoor areas shall not exceed the background noise level by more than 10 dB at the assessment location.

More than 2 hours per day – The $L_{eq, 15min}$ noise level emitted from the outdoor areas shall not exceed the background noise level by more than 5 dB at the assessment location.



4.5 Road Traffic Noise Criteria

The NSW Road Noise Policy, in Section 2.3.1, sets out road traffic noise assessment criteria for residential land uses in Table 3. The information in that table is extracted below in Table 5.

Table 5 Road Traffic Noise Assessment Criteria - Residential

Road Category	Type of project/land use	Assessment Criteria - dB(A)	
		Day (7am – 10pm)	Night (10pm – 7am)
Local roads	1. Existing residences affected by noise from new local road corridors		
	2. Existing residences affected by noise from redevelopment of existing local roads	L _{Aeq} , (15 hour) 55 (external)	L _{Aeq} , (9 hour) 50 (external)
	3. Existing residences affected by additional traffic on existing local roads generated by land use developments		

Note: Land use developers must meet internal noise goals in the Infrastructure SEPP for sensitive developments near busy roads.

4.6 Project Specific Noise Emission Criteria

College Noise Criteria

When all the above factors are considered, we find that the most stringent noise criterion at the nearby residential premises is:

- (41 + 10 =) **51 dBA** for outdoor play during the day;
- **46 dBA** during the day for all other activities;
- **43 dBA** in the evening; and
- **38 dBA** dBA at night.

These criteria apply at the most-affected point on or within the residential property boundary. For upper floors, the noise is assessed outside the nearest window.

Road Traffic Noise Criteria

Additional traffic on local roads should not exceed 55 dBA during the day time (7 am to 10 pm) and 50 dBA during night time (10 pm to 7 am).



5.0 COLLEGE NOISE EMISSION

The main sources of noise from St Francis Catholic College will be from students playing in the outdoor areas, amplified music and speech in the hall and mechanical plant. Calculations are based on the building layout provided by JDH Architects dated 27 March 2018 shown in Appendix B.

5.1 Students in Outdoor Areas

Students will be outside for a range of times, including before college, recess, lunch, PE classes and after college, however the outdoor areas are only likely to be at capacity during recess and lunch.

In order to model the worst case scenario of noise emission from students outdoors at play, we have assessed the total proposed number of 1900 students. It is estimated that up to 50% will engage in active play, with the remaining talking in groups.

Sound power levels of children at play were previously measured for other similar projects and are presented in Table 6. These levels represent the typical maximum noise levels of students at play and will be used in this noise assessment.

Table 6 Students at Play (outside) L_{eq} Sound Power Levels

Description	Sound Power Levels (dB) at Octave Band Centre Frequencies (Hz)								
	dBA	63	125	250	500	1k	2k	4k	8k
1 Child at play – Primary College	79	54	64	69	73	76	73	68	65
1000 Primary Children at play	109	84	94	99	103	106	103	98	95
1 person talking normally – High College Student	66	57	57	63	66	59	55	51	46
1 person talking with a raise voice – High College Student	72	61	61	67	72	67	63	58	51
900 High College students	102	91	91	97	102	97	93	88	81

Knowing the sound power level of a noise source, the sound pressure level (as measured with a sound level meter) can be calculated at a remote location using suitable formulae to account for distance losses, sound barriers, etc.



The predicted level of noise from all 1900 students outside was used as a worst case scenario and is calculated to be as shown in Table 7 at the most affected residences.

Table 7 Predicted L_{eq} Outdoor Noise Levels

Receptor Location	Predicted Noise Level (dBA)	AAAC Noise Criteria (dBA)	Amenity Noise Criteria (dBA)
R1 - Jardine Drive	55	51	53
R2 - New Road	59	51	53
R3 - Poziers Road	56	51	53
R4 - Vinny Road	54	51	53
R5 - Guillemont Road	59	51	53

The noise from outdoor play will likely exceed the acceptable noise criteria by up to 8 dB at first floor level of the nearby residences. However, the overall design of the college provides acoustic benefits, including location of buildings near the boundaries to provide sound shielding to the central play areas. The areas such as sports fields are difficult to treat acoustically as by design, they are open fields.

The times of worst impact are likely to be when the college is at capacity and all of the students are outside, which occurs during recess and lunch breaks. This is a very short time period of the day where this impact occurs.

Given the existing temporary college noise emission, the limited duration of noise from outdoor play and expectations of noise from children on a college site we are of the opinion that the noise from outdoor play would be considered acceptable.



5.2 Public Address System and College Bell

The College will be provided with a public address system and a bell to signal the start and end of classes. The location of the speakers has not yet been determined however assuming up to 6 speaker locations are provided, the maximum sound pressure level should be no greater than **80 dBA** at 3 metres from each speaker in order to meet the residential noise criteria.

5.3 College Hall

The Hall will likely be used by students and teachers during college hours for activities such as indoor sport and fitness, assemblies, drama and music rehearsal and production. The College may be used infrequently outside of these hours by community groups and after hours events.

The design of the hall has not been finalized. We have assumed that large double doors will open to the north, towards the playground areas of the college. We have assumed a reception area is located on the southern side towards the car park separating the hall from the external façade.

A schedule of the sound power levels for loudest activities that may occur within the Hall is presented in Table 8.

Table 8 Hall Activity L_{eq} Sound Power Levels

Description	Sound Power Levels (dB) at Octave Band Centre Frequencies (Hz)								
	dBA	63	125	250	500	1k	2k	4k	8k
Amplified music – concert	98	103	106	102	95	92	86	81	78
Fitness class – 30 people with amplified music	87	93	87	82	81	84	79	75	72
Indoor ball sports	97	71	74	79	84	94	92	87	81

The indoor sports and fitness class may occur during the daytime and are therefore compared against the daytime criteria. The amplified music during a concert / function may occur during the evening and is therefore compared against the evening criteria.



The predicted level of noise from activities within the hall is calculated with the doors open to the north towards the playground as shown below in Table 9 below at the worst affected residences.

Table 9 Predicted L_{eq} Hall Noise Levels (Doors Open)

Receptor Location	Predicted Noise Level (dBA)	Noise Criteria (dBA)	Compliance (Yes/No)
During College Hours			
R1 - Jardine Drive			
- Fitness class	31	46	Yes
- Indoor ball sports	41	46	Yes
R2 - New Road			
- Fitness class	24	46	Yes
- Indoor ball sports	34	46	Yes
R3 - Poziers Road			
- Fitness class	31	46	Yes
- Indoor ball sports	41	46	Yes
R4 - Vinny Road			
- Fitness class	21	46	Yes
- Indoor ball sports	29	46	Yes
R5 - Guillemont Road			
- Fitness class	28	46	Yes
- Indoor ball sports	37	46	Yes



Table 9 Predicted L_{eq} Hall Noise Levels (Doors Open) (continued)

Receptor Location	Predicted Noise Level (dBA)	Noise Criteria (dBA)	Compliance (Yes/No)
After College Hours			
R1 - Jardine Drive			
- Concert / Function	43	45	Yes
R2 - New Road			
- Concert / Function	37	45	Yes
R3 - Poziers Road			
- Concert / Function	43	45	Yes
R4 - Vinny Road			
- Concert / Function	33	45	Yes
R5 - Guillemont Road			
- Concert / Function	41	45	Yes

The levels of noise in Table 9 are within the acceptable noise criteria in Section 4.0 and are therefore acceptable.



5.4 Car Park Noise Emission

Road traffic access to the College is provided via Jardine Drive. A bus bay is incorporated as a loop for buses and other services such as waste garbage and maintenance to enter and depart in a forward manner on Jardine Drive. Parking is provided in a car park with a capacity of 226 off street parking spaces. A drop off zone is incorporated into the car park near Vinny Road

We have assumed that there will be a total of 75 staff at the college for 1900 students. As a typical worst case scenario, we have assumed that eighty percent of students will generate two vehicle trips, with 75 trips for staff arriving in the morning. The remaining students will arrive by bus.

Our calculations assume that all vehicle trips will arrive and depart over a 2 hour time period. Therefore our noise assessment is based on the 3600 trips in 2 hours (450 trips in 15 minutes) for the car park areas. Vehicles are able to access the college site from either Jardine Drive to the north or Guillemont Road to the south. Assuming an equal distribution of traffic flow, each main car park will carry 225 trips in 15 minutes.

Table 10 L_{eq} Levels of Car Parks

Description	dBA	Sound Power Levels (dB) at Octave Band Centre Frequencies (Hz)							
		63	125	250	500	1k	2k	4k	8k
1 car trip in 15 minutes	67	75	68	65	63	64	59	54	47
225 car trips in 15 minutes (car park)	91	99	93	89	87	88	83	78	71
1 Bus, Idling	90	97	93	86	86	85	85	79	73
1 Bus, Volvo, 30km/h	98	105	101	94	94	93	93	87	81
L _{eq} , 15 minute one bus passing	78	84	80	73	73	72	72	66	60

The calculated noise impact from cars entering and exiting the car parks at the college is calculated to be 46 dBA at the nearest and potentially most affected future residential premises located directly across Jardine Drive. At the nearest residences on Guillemont Road, the predicted level of noise from the car park is 38 dBA. These levels meet the noise criterion of 46 dBA during the day and is therefore acceptable.



5.5 On-Road Traffic Noise Impact

The traffic flow to and from the College is expected to be at its maximum in the morning before college and in the afternoon after college. Parents will drop off and pick up their children during these periods. Some children will travel via public transport and others will walk to and from the College. The staff will also be arriving and departing around these times.

We have assumed a total of 3600 trips will be generated by the College, distributed over the north and south boundaries. We have assumed this will occur over a 2 hour period. Therefore the on road traffic generation will be 900 trips per hour on the roads bounding the site to the north and south.

Table 11 L_{eq} Levels of a Car Park with traffic flow of 900 trips in 1 hour

Description	dBA	Sound Power Levels (dB) at Octave Band Centre Frequencies (Hz)							
		63	125	250	500	1k	2k	4k	8k
1 Trip in 15 minutes	67	75	68	65	63	64	59	54	47
900 Trips in 1 hour	97	105	98	95	93	94	89	84	77

The closest receptors to Jardine Drive are likely to be at a distance of approximately 12 metres from the nearest trafficable lane.

Based on a calculated traffic flow of 900 vehicle passbys per hour, the calculated on road traffic impact is 54 dBA outside the closest residence on Jardine Drive, which meets the requirements of the EPA's Road Noise Policy, and acceptable.



5.6 Mechanical Plant

The location and type of mechanical plant has not yet been selected for the new College. Any new mechanical plant will typically only operate during day time hours, Monday to Friday. The use of the hall outside college hours may have some mechanical plant operating up to 10 pm.

The sound power level for typical equipment used at college sites is presented in Table 12.

Table 12 Mechanical Plant L_{eq} Sound Power Levels

Description	dBA	Sound Power Levels (dB) at Octave Band Centre Frequencies (Hz)							
		63	125	250	500	1k	2k	4k	8k
Kitchen Exhaust Fan	90	91	89	89	87	87	81	71	68
Supply Fan	83	74	76	77	80	80	73	69	61
Toilet Exhaust Fan	59	48	48	56	57	54	53	45	38
Air Conditioner - Typical (Similar to RXYQ10TY1A)	68	71	73	69	67	61	56	52	43

We have assumed that there may be up to 10 condensers per building on the college site. Given the large separation distances from the buildings to the adjoining neighbours as a result of the car park along the boundaries, it is likely that the noise emission will be able to meet the noise criteria. The plant areas can be either positioned or acoustically treated to further reduce the level of noise emission.

Table 13 Predicted L_{eq} Noise Levels from Condenser Units

Receptor Location	Predicted Noise Level (dBA)	Noise Criteria (dBA)	Compliance (Yes/No)
R1 - Jardine Drive	37	45	Yes
R2 - New Road	29	45	Yes
R3 - Poziers Road	37	45	Yes
R4 - Vinny Road	42	45	Yes
R5 - Guillemont Road	36	45	Yes

Once the mechanical plant selection has been finalised, a final assessment should be made of the mechanical plant noise emission, prior to the issue of a Construction Certificate.



6.0 ACCEPTABLE NOISE INTRUSION LEVELS

6.1 NSW Department of Planning

The NSW Department of Planning document “*Development Near Rail Corridors and Busy Roads – Interim Guidelines*” (2008) recommends noise criteria as shown in Table 14 below, with reference to State Environmental Planning Policy (Infrastructure) 2007.

Table 14 Required Indoor Noise Levels – Residential Buildings

Type of Occupancy	Noise Level, dBA	Applicable Time Period
Sleeping areas (bedrooms)	35	Night 10 pm to 7 am
Other habitable rooms (excl. garages, kitchens, bathrooms & hallways)	40	At any time

Note: airborne noise is calculated as $L_{eq}(9h)(night)$ and $L_{eq}(15hr)(day)$. Ground borne noise is calculated as $L_{max}(slow)$ for 95% of rail pass-by events

The State Environmental Planning Policy (Infrastructure) 2007 in Clause 102 defines applicable developments that are exposed to road corridor with an annual average daily traffic volume of more than 40,000 vehicles.

As Jardine Drive is unlikely to carry such high traffic volumes, no traffic noise intrusion assessment has been carried out.



7.0 CONSTRUCTION NOISE AND VIBRATION CRITERIA

7.1 Australian Standard AS2436

The Australian Standard AS2436:2010 *“Guide to noise and vibration control on construction, demolition and maintenance sites”* provides guidance on noise control in respect to construction, demolition and maintenance sites. The Standard also provides guidance for the preparation of noise and vibration management plans.

Section 1.5 ‘Regulatory Requirements’ of the Standard states:

“Legislation associated with the control of noise and vibration on and from construction, demolition and maintenance sites in Australia is generally the responsibility of the relevant State or Territory government, local council or a designated statutory authority.”

Consequently the Standard does not provide specific noise criterion rather sets out practical methods for determining the potential for noise and vibration impact on the community from construction, demolition and maintenance sites.

A qualitative method is described in Section 3.3 of the standard, which is designed to avoid the need for complex noise predictions by following a series of questions relating to, for example, whether the noise is likely to be loud, have annoying characteristics or affect sleep.

In the event that any of these outcomes are likely, a more detailed and quantitative approach should be adopted.

In relation to carrying out detailed noise impact assessments, Section 4 ‘General’ of the standard states:

“Regulatory authorities may have relevant policies and/or guidelines for the control of noise and vibration on construction sites. These should also be referred to when developing noise and vibration management plans for such projects.”

In NSW this is the NSW Environment Protection Authority’s *Interim Construction Noise Guideline 2009* as outlined in Section 7.2 below.

The Standard further states, in Section 4.6.1, that if noisy processes cannot be avoided, then the amount of noise reaching the receiver should be minimised and goes on to provide advice and recommendations to reduce noise and vibration impacts as far as reasonably practicable.



7.2 EPA Construction Noise Guideline

The NSW Environment Protection Authority published the *Interim Construction Noise Guideline* in July 2009. While some noise from construction sites is inevitable, the aim of the Guideline is to protect the majority of residences and other sensitive land uses from noise pollution most of the time.

The Guideline presents two ways of assessing construction noise impacts; the quantitative method and the qualitative method.

The quantitative method is generally suited to longer term construction projects and involves predicting noise levels from the construction phase and comparing them with noise management levels given in the guideline.

The qualitative method for assessing construction noise is a simplified way to identify the cause of potential noise impacts and may be used for short-term works, such as repair and maintenance projects of short duration.

In this instance, the quantitative method is the most appropriate and has been used in this assessment. Details of the quantitative method are given in Section 4 of the Guideline.

Normal construction hours are defined by the EPA as follows:

- 7.00 am to 6.00 pm Monday to Friday;
- 8.00 am to 1.00 pm Saturday; and
- No work on Sunday or Public Holiday.

Table 2 in Section 4 of the Guideline sets out noise management levels at affected residences and how they are to be applied during normal construction hours. The noise management level is derived from the rating background level (RBL) plus 10 dB in accordance with the Guideline. This level is considered to be the 'noise affected level' which represents the point above which there may be some community reaction to noise.

The 'highly noise affected' level of 75 dBA represents the point above which there may be strong community reaction to noise. This level is provided in the Guideline and is not based on the RBL. Restrictions to the hours of construction may apply to activities that generate noise at residences above the 'highly noise affected' noise management level.



Based on the background noise level of 41 dBA in the daytime, the recommended noise management level during all aspects of the construction program are summarised in Table 15.

Table 15 **L_{eq} Noise Management Levels from Construction Activities**

Receptor Location	Noise Management Level	How to Apply
All Residential Receptors	51 dBA (41 + 10)	<p>The noise affected level represents the point above which there may be some community reaction to noise.</p> <ul style="list-style-type: none"> Where the predicted or measured L_{Aeq} (15 min) noise level is greater than the noise affected level, the proponent should apply all feasible and reasonable* work practices to meet the noise affected level. The proponent should also inform all potentially impacted residents of the nature of works to be carried out, the expected noise levels and duration, as well as contact details.
	Highly noise affected 75 dBA	<p>The highly noise affected level represents the point above which there may be strong community reaction to noise.</p> <ul style="list-style-type: none"> Where noise is above this level, the relevant authority (consent, determining or regulatory) may require respite periods by restricting the hours that the very noisy activities can occur, taking into account: <ol style="list-style-type: none"> times identified by the community when they are less sensitive to noise (such as before and after college for works near colleges, or mid-morning or mid-afternoon for works near residences); if the community is prepared to accept a longer period of construction in exchange for restrictions on construction times.

* Section 6, 'work practices' of The *Interim Construction Noise Guideline*, states: "there are no prescribed noise controls for construction works. Instead, all feasible and reasonable work practices should be implemented to minimise noise impacts.

This approach gives construction site managers and construction workers the greatest flexibility to manage noise".

Definitions of the terms feasible and reasonable are given in Section 1.4 of the Guideline.



7.3 EPA Vibration Guideline

The NSW EPA published the *Assessing Vibration: a technical guideline* in February 2006. This guideline is based on the British Standard BS6472:1992 “*Evaluation of human exposure to vibration in buildings (1 Hz to 80 Hz)*.”

The guideline presents preferred and maximum vibration values for use in assessing human responses to vibration and provides recommendations for measurement and evaluation techniques. The guideline considers vibration from construction activities as Intermittent Vibration. Table 2.4 of the guideline sets out limits for Vibration Dose Values to assess intermittent vibration and is replicated in Table 16 for residential receptor locations.

Table 16 Vibration Dose Values (VDV) from Construction Activities

Receptor Location	Daytime	
	Preferred value (m/s ^{1.75})	Maximum value (m/s ^{1.75})
All Residences	0.20	0.40

The British Standard BS7385-2:1993 “*Evaluation and measurement for vibration in buildings – Part 2: Guide to damage levels from groundborne vibration*” provides guide values for transient vibration relating to cosmetic damage, replicated in Table 17 for residential buildings.

Table 17 Transient Vibration Guide Values for Cosmetic Damage

Type of Building	Peak component particle velocity in frequency range of predominant pulse	
	4 Hz to 15 Hz	15 Hz and above
Residential	15 mm/s at 4 Hz increasing to 20 mm/s at 15 Hz	20 mm/s at 15 Hz increasing to 50 mm/s at 40 Hz and above

In our opinion, an overall peak particle velocity of **15 mm/s** at the boundaries is an acceptable criterion for intermittent vibration to prevent cosmetic damage to the adjacent residential buildings.



8.0 CONSTRUCTION NOISE AND VIBRATION ASSESSMENT

The main sources of noise on the site during the construction of the college buildings will be from heavy machinery such as excavators, dump trucks and hand held pneumatic and electric power tools, etc. Activities that may cause particular annoyance, due to tonality, spectral content or impulsiveness include generator motors, hand tools such as grinders, jackhammering and other activities involving impacts. These activities will require particular attention with regard to mitigation.

8.1 Stage 1 – Site Preparation

Site establishment works are likely to be completed within 2 months. Works will involve the use of excavators and regular truck movements transporting waste materials from the site. The equipment likely to be used and their corresponding sound power levels are presented in Table 18.

Table 18 Typical Site Preparation Equipment - Sound Power Levels

Description	Qty	Sound Power Level, dBA [^]
Excavators (up to 38 ton)	Up to 2	107 to 110
Trucks (up to 40 ton)	Up to 2	107 to 110
Bulldozer (21 ton)	1	108
Generator	2	Up to 89
Pneumatic and Electric Hand Tools	Up to 5 simultaneously	Up to 110

[^]All sound power levels are based on AS2436:2010 of various plant noise measurements.

As a conservative approach, it is assumed that all items of plant will be operating simultaneously.



Levels are based on the closest potential distance and furthest potential distance at which each item of plant may operate from each respective residential location. The calculated noise levels at nearby residential receptors are presented in Table 19.

Table 19 Calculated Receptor Sound Pressure Levels from Site Preparation

Receptor Location	Calculated Sound Pressure Levels (dBA)	Noise Management Level (dBA)	Compliance
R1 - Jardine Drive	54 - 65	51	No
R2 - New Road	53 - 59	51	No
R3 - Poziers Road	57 - 67	51	No
R4 - Vinny Road	57 - 72	51	No
R5 - Guillemont Road	58 - 68	51	No

8.2 Stage 2 – Earthworks

The Stage 2 Works will be completed within 5 months. The equipment likely to be used and their corresponding sound power levels are presented in Table 20.

Table 20 Typical Earthworks Equipment - Sound Power Levels

Description	Qty	Sound Power Level, dBA [^]
Excavators (up to 38 ton)	Up to 2	107 to 110
Trucks (up to 40 ton)	Up to 2	107 to 110
Compactor Rollers	Up to 2	110
Bulldozer (25 ton)	2	108
Front End Loader (25 ton)	1	110 to 115
Silenced Diesel Generator	Up to 2	Up to 89
Elevated Work Platforms	2	Up to 95
Pneumatic and Electric Hand Tools	Up to 5 simultaneous	Up to 110
Pile Driver	Up to 2	Up to 120
Hydraulic Rock Breaker	Up to 2	Up to 118

[^]All sound power levels are based on AS2436:2010 and DEFRA database of various plant noise measurements.

As a conservative approach, it is assumed that all items of plant will be operating simultaneously. Levels are based on the closest potential distance and furthest potential distance at which each item of plant may operate from each respective residential location.



Given the intensity of work involved with pile driving and rock breaking, it is unlikely that these two activities will take place at the same time as any other activity. Therefore we have assessed the noise impact of these two activities individually.

The calculated noise levels at nearby residential receptors are presented in Table 21.

Table 21 Calculated Receptor Sound Pressure Levels from Earthworks

Receptor Location	Calculated Sound Pressure Levels (dBA)	Noise Management Level (dBA)	Compliance
R1 - Jardine Drive	54 - 65	51	No
R2 - New Road	53 - 59	51	No
R3 - Poziers Road	57 - 67	51	No
R4 - Vinny Road	57 - 72	51	No
R5 - Guillemont Road	58 - 68	51	No
Rock breaking or pile driving (If required)			
R1 - Jardine Drive	65 - 75	51	No
R2 - New Road	64 - 70	51	No
R3 - Poziers Road	67 - 77	51	No
R4 - Vinny Road	67 - 82	51	No
R5 - Guillemont Road	68 - 79	51	No



8.3 Vibration Impacts

Past measurements of ground borne vibration show that vibration levels can vary significantly at different distances and receptor locations. Recommended safe working distances for various items of vibration generating plant are given in Section 6.3 of Transport for NSW Construction Noise Strategy 2012. This information is shown below in Table 22.

Table 22 Recommended Safe Working Distances for Vibration Generating Plant

Plant Item	Rating/Description	Safe Working Distance	
		Cosmetic Damage (BS7385)	Human Response (OH&E Assessing Vibration – A Technical Guideline)
Small Hydraulic Hammer	300 kg – 5 to 12T Excavator	2 m	7 m
Medium Hydraulic Hammer	900 kg – 12 to 18T Excavator	7 m	23 m
Vibratory Pile Driver	Sheet piles	2 m to 20 m	20 m
Pile Boring	≤800 mm	2 m (nominal)	N/A
Jackhammer	Hand held	1 m (nominal)	Avoid contact with structure

We recommend that compliance monitoring of ground borne vibration is carried out at the nearest residence, when vibratory machinery such as pile drivers, jackhammers and the like are used on site. Refer to Section 9.13 for the mitigation measures to be engaged to reduce the impact of adverse vibration.



8.4 Stage 3 – Construction

The construction of the college is estimated to take 60 weeks and will involve the use of power tools and portable mechanical plant such as generators and cement mixers. The equipment likely to be used and their corresponding sound power levels are presented in Table 23.

Table 23 Typical Construction Equipment - Sound Power Levels

Description	Qty	Sound Power Level, dBA [^]
Silenced Diesel Generator	Up to 2	Up to 89
Telehandler (3 ton)	1	Up to 99
Elevated Work Platforms	2	Up to 95
Pneumatic and Electric Hand Tools	Up to 5 simultaneous	Up to 110

[^]All sound power levels are based on AS2436:2010 and DEFRA database of various plant noise measurements.

During the construction phase, work will be more dispersed across the site as the scale of work, compared to the previous two phases, is less intensive. Calculations consider distance attenuation only and the range of levels are based on the closest potential distance and furthest potential distance at which each item of plant may operate from each respective residential location.

The calculated noise levels at nearby residential receptors are presented in Table 24.

Table 24 Calculated Receptor Sound Pressure Levels from Construction

Receptor Location	Calculated Sound Pressure Levels (dBA)	Noise Management Level (dBA)	Compliance
R1 - Jardine Drive	53 - 64	51	No
R2 - New Road	52 - 58	51	No
R3 - Poziers Road	56 - 66	51	No
R4 - Vinny Road	56 - 71	51	No
R5 - Guillemont Road	57 - 67	51	No

Note that once the college buildings begin to be erected, the buildings will act as a noise barrier to the adjoining receptor locations, reducing the level of construction noise as construction progresses.



9.0 CONSTRUCTION NOISE AND VIBRATION MITIGATION RECOMMENDATIONS

The predicted level of noise (Section 8.1, 8.2, and 8.4) and vibration (Section 8.3) emission from the construction of the College show that noise levels will likely exceed the Noise Management Levels established in Section 7.2 of this report.

The following work practices are recommended to be implemented where necessary and practicable, to reduce noise emission as far as reasonably practicable:

- Works to be staged to minimise noise impact
- Methodology of demolition will be carried out so that noisy activities do not occur concurrently where possible
- Impact noise will be limited
- Substitution of equipment will be considered to minimise noise (Section 9.4)
- Impulsive and tonal noise is restricted to the hours of 9.00 am to 4.00 pm Mon-Fri, and continuous blocks will not exceed three hours each with a minimum respite from those activities and works of not less than one hour between each block (Section 9.7)
- Management plan to ensure construction vehicles arrive and depart during construction hours only
- Reversing alarms to be of “quacker” broadband alarm style.

9.1 Engineering and Practical Noise Controls

Australian Standard AS2436:2010, Appendix C, Table C3 provides the relative effectiveness of various forms of noise control that may be applicable and implemented on various construction sites and projects. Table C3 is replicated in Table 25 below.

Table 25 Relative Effectiveness of Various Forms of Noise Control

Control by	Nominal Noise Reduction Possible, dB
Distance	Approximately 6 dB for each doubling of distance
Screening	Normally 5 dB to 10 dB maximum 15 dB
Enclosure	Normally 5 dB to 25 dB maximum 50 dB
Silencing	Normally 5 dB to 10 dB maximum 20 dB

Distance

Where applicable, we recommend locating mechanical plant near the centre of the site such that it is as far as practically possible from either residence to the north and south.

Enclosure

Constructing acoustical enclosures around items of mobile plant such as generators is recommended where extended use for long periods of time is expected.



Screening

We recommend erecting temporary sound barrier screens along the boundaries of the site near adjacent residential buildings to remain throughout all construction phases, as far as reasonably practicable. All sound barriers should be designed by a structural engineer to resist wind loads.

Silencing

Consideration should be given to any mobile plant already acoustically treated when assessing tenders. All plant and machinery should be selected with consideration to low noise options where practicable and available.

Care should be taken to ensure that not more than one item of plant is operating simultaneously within close proximity of any given residence as far as reasonably practicable, to minimise cumulative noise impacts.

9.2 Noisy Equipment/Machinery

We recommend that noisy equipment and machinery such as generators and compressors be located as far away as practicable from the nearest residences to block the direct line of sight between these activities and the residences.

9.3 Use Quieter Methods

Use alternatives to diesel and petrol engines and pneumatic units, such as hydraulic or electric controlled units where feasible and reasonable. Where there is no electricity supply, use an electrical generator located away from residences.

9.4 Use Quieter Equipment

- Examine different types of machines that perform the same function and compare the noise level data to select the least noisy machine. For example, rubber wheeled tractors can be less noisy than steel tracked tractors.
- Noise labels are required by NSW legislation for pavement breakers, mobile compressors, chainsaws and mobile garbage compactors. These noise labels can be used to assist in selecting less noisy plant.
- Pneumatic equipment is traditionally a problem – select super silenced compressors, silenced jackhammers and damped bits where possible.
- When renting, select quieter items of plant and equipment where feasible and reasonable.
- When purchasing, select, where feasible and reasonable, the most effective mufflers, enclosures and low-noise tool bits and blades. Always seek the manufacturer's advice before making modifications to plant to reduce noise.



9.5 Maintain Equipment

- Regularly inspect and maintain equipment to ensure it is in good working order. Also check the condition of mufflers.
- Equipment must not be operated until it is maintained or repaired, where maintenance or repair would address the annoying character of noise identified.
- For machines with enclosures, check that doors and door seals are in good working order and that the doors close properly against the seals.
- Return any hired equipment that is causing noise that is not typical for the equipment – the increased noise may indicate the need for repair.
- Ensure air lines on pneumatic equipment do not leak.

9.6 Transmission Path

- Reduce the line-of-sight noise transmission to residences or other sensitive land uses using temporary barriers where practicable.
- If using temporary noise barriers, ensure they are erected before work commences to reduce noise from works as soon as possible.
- Consult with most affected neighbours about how effective the proposed noise mitigation measures will be in addressing their concerns.

9.7 Periods of Respite

All activities associated with the construction shall take place within the standard hours, as shown below:

- 7:00 am to 6:00 pm, Monday to Friday inclusive; and
- 8:00 am to 1:00 pm Saturdays;
- At no time on Sundays or public holidays.

Works that result in impulsive or tonal noise emissions shall only be undertaken:

- 8:00 am and 4:00 pm Monday to Friday inclusive;
- In continuous blocks, not exceeding 3 hours each, with a minimum respite from those activities and works of not less than one hour between each block.



9.8 Work Practices

Workers and contractors shall be trained in work practices to minimise noise emission such as the following:

- Avoid dropping materials from a height.
- Avoid shouting and talking loudly outdoors.
- Avoid the use of radios outdoors that can be heard at the boundary of residences.
- Turn off equipment when not being used.
- Carry out work only within the approved hours of operation.
- Construction vehicles to arrive and depart during construction hours only.

9.9 Heavy Vehicles and Staff Vehicles

- Truck drivers shall be informed of designated vehicle routes, parking locations, acceptable delivery hours or other relevant practices (for example, minimising the use of engine brakes, and no extended periods of engine idling).
- Site vehicle entrances shall be located away from residences where practicable.
- The number of vehicle trips shall be configured to reduce the number of trips to and from the site – movements shall be organised to amalgamate loads rather than using a number of vehicles with smaller loads.
- Parking and queuing of staff vehicles and other construction vehicles shall be avoided as far as is practicable on streets outside of the site.
- There shall be no access the site via, or park within residential areas prior to 7 am on any occasion, in order to avoid sleep disturbance.
- Vehicles shall be fitted with broadband reversing alarms or alternative, non-tonal proximity warning systems.
- For the duration of construction, use of compression braking shall not be permitted on the site or nearby the site, such as on access roads within close proximity to residential premises.



9.10 Community Relations

- A Community Liaison Officer may be appointed by the contractor prior to the commencement of any works;
- The officer will approach all potentially affected residents prior to the commencement of any works as an initial introduction and provide their contact details;
- The officer will explain the project, duration of works, potentially noisy periods as well as determine any particularly sensitive receivers or sensitive time periods and schedule works accordingly, as far as reasonably practical;

Once works commence, communication with the community may be maintained by the Community Liaison Officer. Communication may be maintained via the aforementioned methods.

Consultation and cooperation between the contractor and the neighbours and the removal of uncertainty and rumour can help to reduce adverse reaction to noise.

9.11 Managing a Noise Complaint

The Liaison Officer shall receive and manage noise complaints and implement a Construction Complaints Management System.

All complaints shall be treated promptly and with courtesy.

In the event that a noise complaint is received, noise monitoring will be carried out at the affected receptor location and appropriate measures be taken to reduce the noise emission as far as reasonably practicable.

Where it is not practicable to stop the noise, or reduce the noise, a full explanation of the event taking place, the reason for the noise and times when it will stop shall be given to the complainant.

The following guidelines are recommended in Section 6 of the *Interim Construction Noise Guideline* to manage a noise complaint:

- Provide a readily accessible contact point, for example, through a 24 hour toll-free information and complaints line.
- Give complaints a fair hearing.
- Have a documented complaints process, including an escalation procedure so that if a complainant is not satisfied there is a clear path to follow.
- Call back as soon as possible to keep people informed of action to be taken to address noise problems. Call back at night-time only if requested by the complainant to avoid further disturbance.
- Provide a quick response to complaints, with complaint handling staff having both a good knowledge of the project and ready access to information.



- Implement all feasible and reasonable measures to address the source of complaint, which may include standing equipment down.
- Keep a register of any complaints, including details of the complaint such as date, time, person receiving complaint, complainant's contact number, person referred to, description of the complaint, work area (for larger projects), time of verbal response and timeframe for written response where appropriate.

9.12 Noise Monitoring

In the event of a noise complaint, monitoring shall be carried out at the complainant's residence to determine which activities are generating excessive noise. If practicable, noise mitigation measures, such as those outlined above, shall be implemented and further monitoring shall then be employed to determine the effectiveness of noise mitigation.

9.13 Vibration Monitoring

If high impact activities, such as rock hammering or piling are to be conducted at any time during each stage, vibration measurements may be carried out at a residence within each of the nearest receptor locations at the commencement of high impact activities to determine the maximum levels of vibration during these peak vibration generating events.

In the event of an exceedance of the Peak Particle Velocity (PPV) vibration criteria as defined in Table 17, unattended vibration monitor or monitors shall be installed at each residential location where an exceedance was measured.

Unattended vibration monitors shall have the capability to trigger an alert to make the site manager and/or plant operator aware immediately when the vibration limit is exceeded. The vibration monitor should be set to trigger the alert when the overall PPV exceeds the criteria within each frequency range, as stipulated in Table 17, at the nearest residential building.

In the event that levels of ground-borne vibration exceed the recommended acceptable levels for cosmetic damage vibration causing works should cease immediately and alternative methods shall be considered.

9.14 Noise Measurement Equipment

All acoustic instrumentation employed throughout the monitoring programme will comply with the requirements of AS IEC 61672.1:2004 *Electroacoustics – Sound level Meters-Specifications*. All sound level meters must have a current calibration certificate from a NATA accredited laboratory in accordance with NATA guidelines. Instrument calibration shall be checked before and after each measurement survey, with the variation in calibrated levels not exceeding ± 0.5 dB.



9.15 Attended Residential Noise Monitoring Procedure

The measurements will be conducted in accordance with the procedures outlined in Australian Standard AS1055 *Acoustics – Description and measurement of environmental noise* and in accordance with methods outlined in the NSW Industrial Noise Policy (INP). The following points should be followed when conducting noise monitoring:

- A field calibration should be conducted before and after measurements;
- The sound level meters must be set to A-weighting and Fast response;
- The sound level meters sample period should be set to 15 minutes;
- The following descriptors should be measured as a minimum: L_{A1} , L_{Aeq} and L_{A90} ; and
- Measurements should be conducted a minimum of 3 metres from the nearest façade and/or solid fence/wall. If it is not possible to do this corrections for façade reflection should be applied to the measurement results.

9.16 Noise Monitoring of Equipment

In addition to the residential noise monitoring procedures described above, the following equipment measurements will be undertaken:

- Noise emission levels of all critical items of mobile plant and equipment will be checked by the site environmental officer for compliance with noise limits appropriate to those items prior to the equipment going into regular service;
- For equipment and mobile plant used for construction works, L_{Aeq} measurements will be taken at an appropriate distance, normally 7 metres and converted to a Sound Power Level;
- An *Equipment Noise Certificate*, presenting relevant sound levels of the equipment tested, will be issued by the Construction Contractor's site environmental officer within the first week of the equipment commencing at the construction site.

The equipment sound power levels will be compared to the levels contained in Table 18, 20 and 23. If noise checks on any equipment result in a prediction of non-compliance, quieter equipment should be substituted.




10.0 NOISE IMPACT STATEMENT

Day Design Pty Ltd was engaged by JDH Architects on behalf of Catholic Education Office, Diocese of Wollongong to provide acoustical advice for the proposed masterplan of the St Francis Catholic College located at 130-160 Jardine Drive, Edmondson Park, NSW.

Measurements and calculations show that the level of noise emitted by the proposed St Francis Catholic College will be able to meet the acceptable noise level requirements of the EPA NSW Noise Policy for Industry as detailed in Section 4 of this report.

No assessment for road traffic noise intrusion has been carried out due to the expected low volumes of road traffic on Jardine Drive.

The noise impact due to the proposed construction activities have been predicted at all nearby receptor locations. The Noise Management Level is predicted to be exceeded at times and therefore recommendations for noise controls have been provided in Section 9 of this report.



William Wang, BE (Mechatronics), MIEAust, MAAS

Senior Acoustical Engineer

for and on behalf of Day Design Pty Ltd

AAAC MEMBERSHIP

Day Design Pty Ltd is a member company of the Association of Australian Acoustical Consultants, and the work herein reported has been performed in accordance with the terms of membership.


Attachments:


- Appendix A – Ambient Noise Survey
- Appendix B – St Francis Catholic College MasterPlan
- AC108-1 to 4 – Glossary of Acoustical Terms
- AC500-10 – Modifying Factor Corrections



AMBIENT NOISE SURVEY

Located at 130-160 Jardine Drive, Edmondson Park, NSW

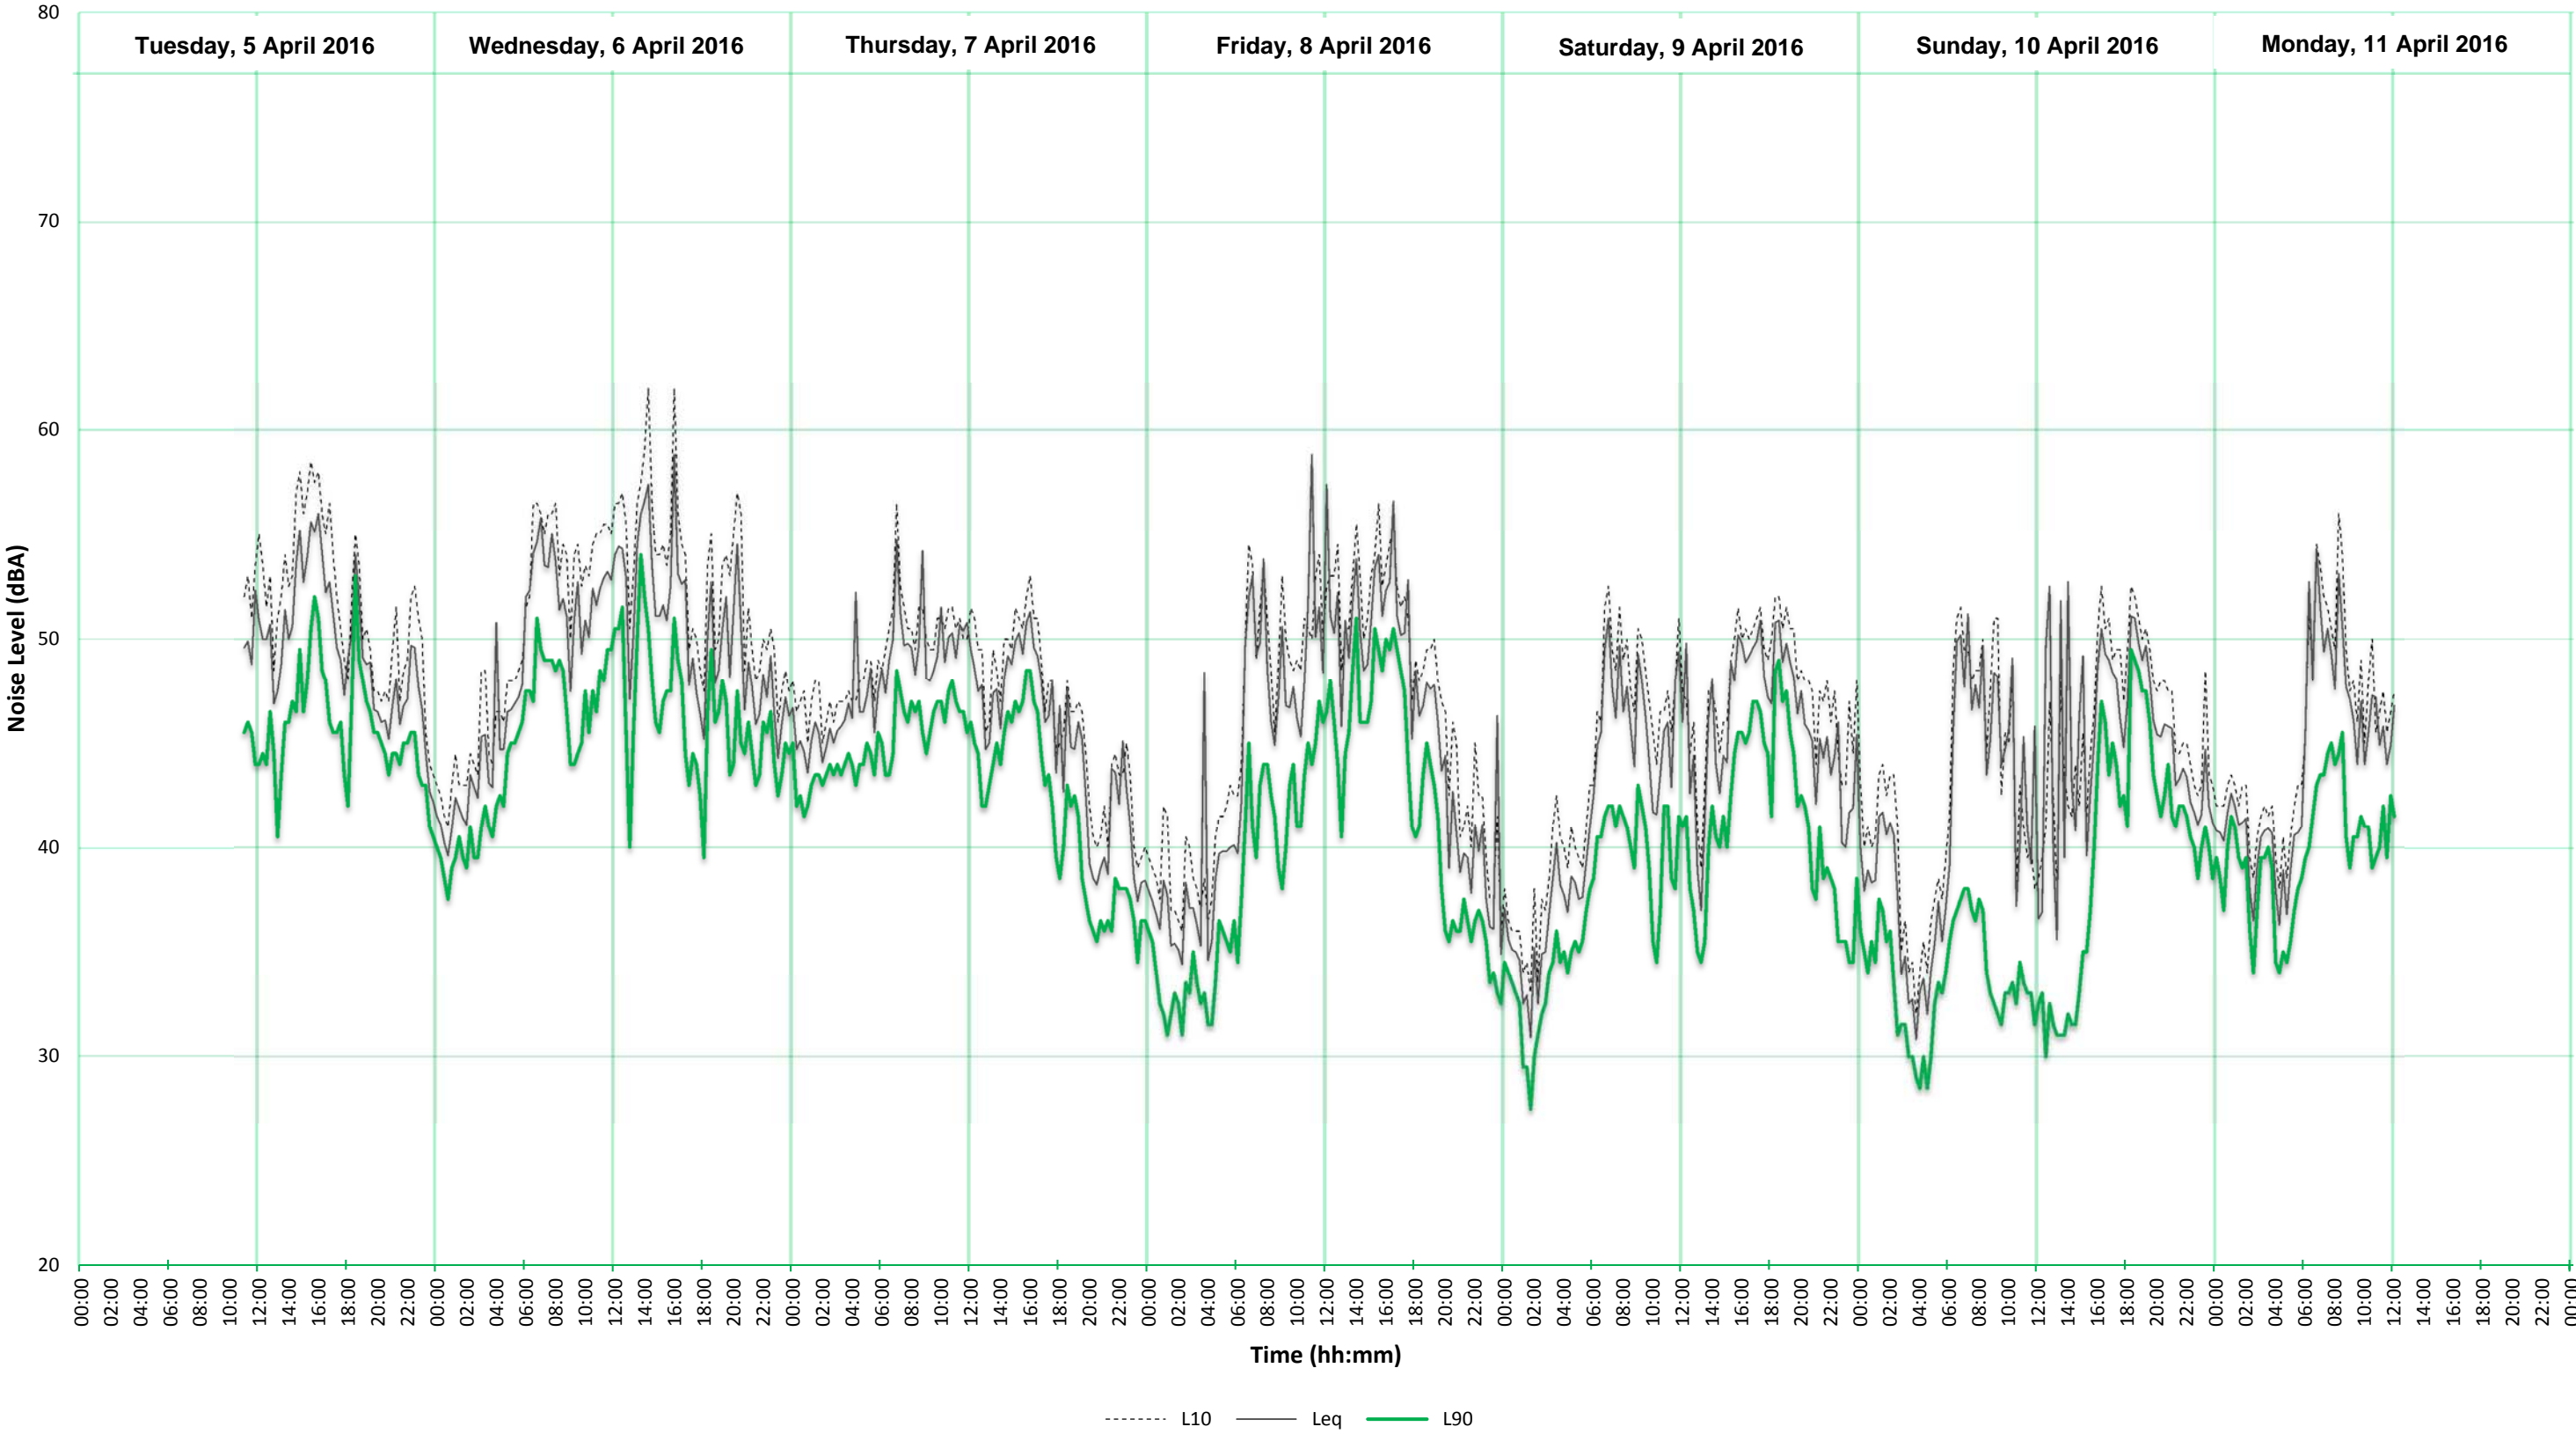

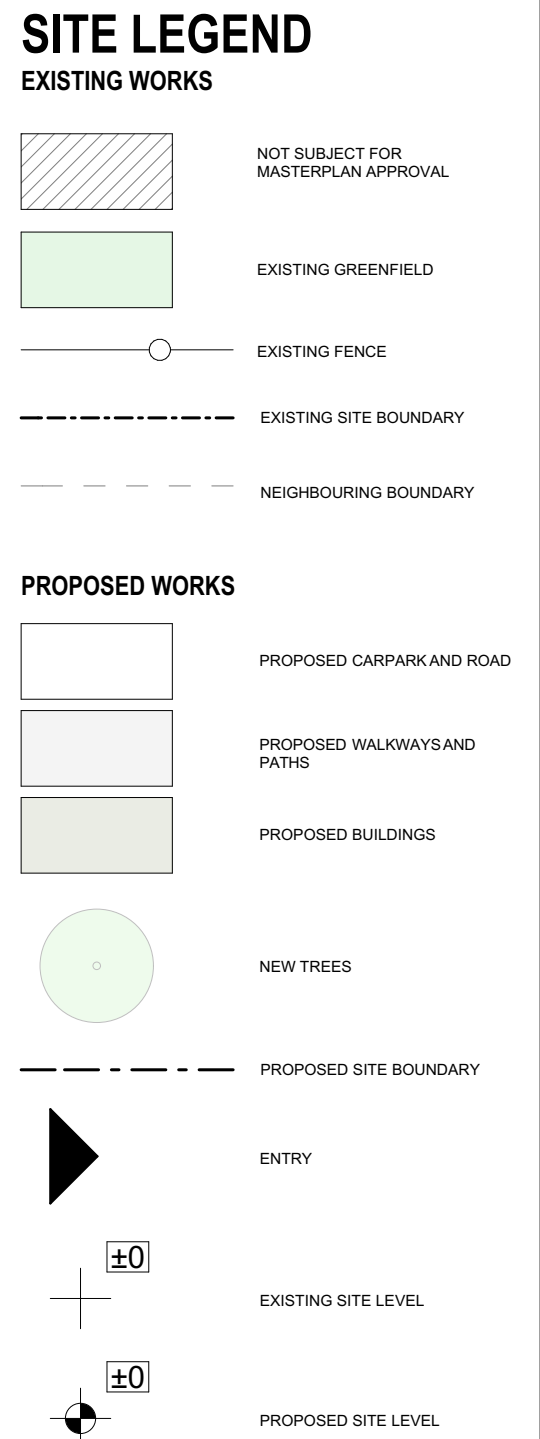

Project Name			
EDMONDSON PARK MASTER PLAN			
130-160 JARDINE DRIVE EDMONDSON PARK NSW, 2174			
Drawing Title			N 
PROPOSED GROUND FLR PLAN			
Scale : 1:100, 1:500 @A1		Date : 27/03/2018	
Drawn : RG		Checked : J.T	
Project No.		Drawing No.	
939	SSD12	02	
QUALITY CONTROLLED (ISO) 9001	INITIATING THE 'DRAWN' AND THE 'CHECK' BOXES CONFIRMS THAT THIS DRAWING HAS BEEN PREPARED IN CONFORMANCE WITH ICH ARCHITECTS Q.M.S. PROCEDURES.		
Status: SSD APPLICATION			

ACOUSTICAL – Pertaining to the science of sound, including the generation, propagation, effects and control of both noise and vibration.

AMBIENT NOISE – The ambient noise level at a particular location is the overall environmental noise level caused by all noise sources in the area, both near and far, including road traffic, factories, wind in the trees, birds, insects, animals, etc.

AUDIBLE – means that a sound can be heard. However, there are a wide range of audibility grades, varying from “barely audible” to “just audible”, “clearly audible” and “prominent”. Chapter 83 of the NSW Environment Protection Authority – Environmental Noise Control Manual (1985) states:

“noise from a particular source might be offensive if it is clearly audible, distinct from the prevailing background noise and of a volume or character that a reasonable person would be conscious of the intrusion and find it annoying or disruptive”.

It follows that the word “audible” in an environmental noise context means “clearly audible”.

BACKGROUND NOISE LEVEL – Silence does not exist in the natural or the built-environment, only varying degrees of noise. The Background Noise Level is the average minimum dBA level of noise measured in the absence of the noise under investigation and any other short-term noises such as those caused by cicadas, lawnmowers, etc. It is quantified by the L_{A90} or the dBA noise level that is exceeded for 90 % of the measurement period (usually 15 minutes).

- **Assessment Background Level (ABL)** is the single figure background level representing each assessment period – day, evening and night (ie three assessment background levels are determined for each 24hr period of the monitoring period). Determination of the assessment background level is by calculating the tenth percentile (the lowest tenth percent value) of the background levels (L_{A90}) for each period (refer: NSW Industrial Noise Policy, 2000).
- **Rating Background Level (RBL)** as specified by the Environment Protection Authority is the overall single figure (L_{A90}) background noise level representing an assessment period (day, evening or night) over a monitoring period of (normally) three to seven days.

The RBL for an assessment period is the median of the daily lowest tenth percentile of L_{90} background noise levels.

If the measured background noise level is less than 30 dBA, then the Rating Background Level (RBL) is considered to be 30 dBA.

DECIBEL – The human ear has a vast sound-sensitivity range of over a thousand billion to one. The decibel is a logarithmic unit that allows this same range to be compressed into a somewhat more comprehensible range of 0 to 120 dB. The decibel is ten times the logarithm of the ratio of a sound level to a reference sound level. See also Sound Pressure Level and Sound Power Level.

Decibel noise levels cannot be added arithmetically since they are logarithmic numbers. If one machine is generating a noise level of 50 dBA, and another similar machine is placed beside it, the level will increase to 53 dBA, not 100 dBA. Ten similar machines placed side by side increase the sound level by 10 dBA, and one hundred machines increase the sound level by 20 dBA.

dBA – The human ear is less sensitive to low frequency sound than high frequency sound. We are most sensitive to high frequency sounds, such as a child’s scream. Sound level meters have an inbuilt weighting network, termed the dBA scale, that approximates the human loudness response at quiet sound levels (roughly approximates the 40 phon equal loudness contour).



However, the dBA sound level provides a poor indication of loudness for sounds that are dominated by low frequency components (below 250 Hz). If the difference between the “C” weighted and the “A” weighted sound level is 15 dB or more, then the NSW Industrial Noise Policy recommends a 5 dBA penalty be applied to the measured dBA level.

dbc – The dbc scale of a sound level meter is similar to the dBA scale defined above, except that at high sound intensity levels, the human ear frequency response is more linear. The dbc scale approximates the 100 phon equal loudness contour.

EQUIVALENT CONTINUOUS NOISE LEVEL, L_{Aeq} – Many noises, such as road traffic or construction noise, vary continually in level over a period of time. More sophisticated sound level meters have an integrating electronic device inbuilt, which average the A weighted sound pressure levels over a period of time and then display the energy average or L_{Aeq} sound level. Because the decibel scale is a logarithmic ratio the higher noise levels have far more sound energy, and therefore the L_{Aeq} level tends to indicate an average which is strongly influenced by short term, high level noise events. Many studies show that human reaction to level-varying sounds tends to relate closely to the L_{Aeq} noise level.

FREE FIELD – This is a sound field not subject to significant reflection of acoustical energy. A free field over a reflecting plane is usually outdoors with the noise source resting on hard flat ground, and not closer than 6 metres to any large flat object such as a fence or wall; or inside an anechoic chamber.

FREQUENCY – The number of oscillations or cycles of a wave motion per unit time, the SI unit being the Hertz, or one cycle per second.

IMPACT ISOLATION CLASS (IIC) – The American Society for Testing and Materials (ASTM) has specified that the IIC of a floor/ceiling system shall be determined by operating an ISO 140 Standard Tapping Machine on the floor and measuring the noise generated in the room below. The IIC is a number found by fitting a reference curve to the measured octave band levels and then deducting the sound pressure level at 500 Hz from 110 decibels. Thus the higher the IIC, the better the impact sound isolation.

IMPACT SOUND INSULATION ($L_{nT,w}$) – Australian Standard AS ISO 717.2 – 2004 has specified that the Impact Sound Insulation of a floor/ceiling system be quantified by operating an ISO 140 Standard Tapping Machine on the floor and measuring the noise generated in the room below. The Weighted Standardised Impact Sound Pressure Level ($L_{nT,w}$) is the sound pressure level at 500 Hz for a reference curve fitted to the measured octave band levels. Thus the lower $L_{nT,w}$ the better the impact sound insulation.

IMPULSE NOISE – An impulse noise is typified by a sudden rise time and a rapid sound decay, such as a hammer blow, rifle shot or balloon burst.

INTRUSIVE NOISE LEVEL, L_{Aeq} – The level of noise from a factory, place of entertainment, etc. in NSW is assessed on the basis of the average maximum noise level, or the L_{Aeq} (15 min). This is the energy average A weighted noise level measured over any 15 minute period.

LOUDNESS – The degree to which a sound is audible to a listener is termed the loudness. The human ear perceives a 10 dBA noise level increase as a doubling of loudness and a 20 dBA noise increase as a quadrupling of the loudness.



MAXIMUM NOISE LEVEL, L_{Amax} – The rms maximum sound pressure level measured on the "A" scale of a sound level meter during a noise survey is the L_{Amax} noise level. It may be measured using either the Fast or Slow response time of the meter. This should be stated.

NOISE RATING NUMBERS – A set of empirically developed equal loudness curves has been adopted as Australian Standard AS1469-1983. These curves allow the loudness of a noise to be described with a single NR number. The Noise Rating number is that curve which touches the highest level on the measured spectrum of the subject noise. For broadband noise such as fans and engines, the NR number often equals the dBA level minus five.

NOISE – Noise is unwanted sound. Sound is wave motion within matter, be it gaseous, liquid or solid. "Noise includes sound and vibration".

NOISE REDUCTION COEFFICIENT – See: "Sound Absorption Coefficient".

OFFENSIVE NOISE - (Reference: Dictionary of the Protection of the Environment Operations Act 1997). *"Offensive Noise means noise:*

- (a) *that, by reason of its level, nature, character or quality, or the time at which it is made, or any other circumstances:*
 - (i) *is harmful to (or likely to be harmful to) a person who is outside the premise from which it is emitted, or*
 - (ii) *interferes unreasonably with (or is likely to interfere unreasonably with) the comfort or repose of a person who is outside the premises from which it is emitted, or*
- (b) *that is of a level, nature, character or quality prescribed by the regulations or that is made at a time, or in other circumstances prescribed by the regulations."*

PINK NOISE – Pink noise is a broadband noise with an equal amount of energy in each octave or third octave band width. Because of this, Pink Noise has more energy at the lower frequencies than White Noise and is used widely for Sound Transmission Loss testing.

REVERBERATION TIME, T_{60} – The time in seconds, after a sound signal has ceased, for the sound level inside a room to decay by 60 dB. The first 5 dB decay is often ignored, because of fluctuations that occur while reverberant sound conditions are being established in the room. The decay time for the next 30 dB is measured and the result doubled to determine the T_{60} . The Early Decay Time (EDT) is the slope of the decay curve in the first 10 dB normalised to 60 dB.

SOUND ABSORPTION COEFFICIENT, α – α Sound is absorbed in porous materials by the viscous conversion of sound energy to heat energy as the sound waves pass through it. Sound is similarly absorbed by the flexural bending of internally damped panels. The fraction of incident energy that is absorbed is termed the Sound Absorption Coefficient, α . An absorption coefficient of 0.9 indicates that 90 % of the incident sound energy is absorbed. The average α from 250 to 2000 Hz is termed the Noise Reduction Coefficient (NRC).

SOUND ATTENUATION – If an enclosure is placed around a machine, or a silencer is fitted to a duct, the noise emission is reduced or attenuated. An enclosure that attenuates the noise level by 30 dBA, reduces the sound energy by one thousand times.

SOUND EXPOSURE LEVEL (SEL) – The total sound energy of a single noise event condensed into a one second duration or in other words it is an L_{eq} (1 sec).



SOUND PRESSURE LEVEL, L_p – The level of sound measured on a sound level meter and expressed in decibels, dB, dBA, dBC, etc. $L_p = 20 \times \log (P/P_0) \dots \text{dB}$

where P is the rms sound pressure in Pascal and P_0 is a reference sound pressure of 20 μPa .
 L_p varies with distance from a noise source.

SOUND POWER LEVEL, L_w – The Sound Power Level of a noise source is an absolute that does not vary with distance or with a different acoustic environment.

$$L_w = L_p + 10 \log A \dots \text{dB, re: } 1\text{pW,}$$

where A is the measurement noise-emission area in square metres in a free field.

SOUND TRANSMISSION CLASS (STC) – An internationally standardised method of rating the sound transmission loss of partition walls to indicate the decibels of noise reduction of a human voice from one side to the other. (Refer: Australian Standard AS1276 – 1979)

SOUND TRANSMISSION LOSS – The amount in decibels by which a random sound is reduced as it passes through a sound barrier. A method for the measurement of airborne Sound Transmission Loss of a building partition is given in Australian Standard AS1191 - 2002.

STATISTICAL EXCEEDENCE SOUND LEVELS, L_{A90} , L_{A10} , L_{A1} , etc – Noise which varies in level over a specific period of time (usually 15 minutes) may be quantified in terms of various statistical descriptors:

The L_{A90} is the dBA level exceeded for 90 % of the time. In NSW the L_{A90} is measured over periods of 15 minutes, and is used to describe the average minimum or background noise level.

The L_{A10} is the dBA level that is exceeded for 10 % of the time. In NSW the L_{A10} measured over a period of 10 to 15 minutes. It was until recently used to describe the average maximum noise level, but has largely been replaced by the L_{Aeq} for describing level-varying noise.

The L_{A1} is the dBA level that is exceeded for 1 % of the time. In NSW the L_{A1} may be used for describing short-term noise levels such as could cause sleep arousal during the night.

STEADY NOISE – Noise, which varies in level by 6 dBA or less, over the period of interest with the time-weighting set to “Fast”, is considered to be “steady”. (Refer AS 1055.1 1997)

WEIGHTED SOUND REDUCTION INDEX, R_w – This is a single number rating of the airborne sound insulation of a wall, partition or ceiling. The sound reduction is normally measured over a frequency range of 100 to 3,150 Hertz and averaged in accordance with ISO standard weighting curves (Refer AS/NZS 1276.1:1999).

Internal partition wall $R_w + C$ ratings are frequency weighted to simulate insulation from human voice noise. The $R_w + C$ is always similar in value to the STC rating value. External walls, doors and windows may be $R_w + C_{tr}$ rated to simulate insulation from road traffic noise. This is normally a lower number than the STC rating value.

WHITE NOISE – White noise is broadband random noise whose spectral density is constant across its entire frequency range. The sound power is the same for equal bandwidths from low to high frequencies. Because the higher frequency octave bands cover a wider spectrum, white noise has more energy at the higher frequencies and sounds like a hiss.



NSW NOISE POLICY FOR INDUSTRY MODIFYING FACTOR CORRECTIONS

AC500-10

Table C.1 **Modifying factor corrections**
(See definitions in Section C2)

Factor	Assessment/ Measurement	When to apply	Correction ¹	Comments
Tonal noise	One-third octave band analysis using the objective method for assessing the audibility of tones in noise – simplified method (<i>ISO1996.2-2007 – Annex D</i>).	Level of one-third octave band exceeds the level of the adjacent bands on both sides by: <ul style="list-style-type: none"> • 5 dB or more if the centre frequency of the band containing the tone is in the range 500–10,000 Hz • 8 dB or more if the centre frequency of the band containing the tone is in the range 160–400 Hz • 15 dB or more if the centre frequency of the band containing the tone is in the range 25–125 Hz. 	5 dB ^{2,3}	Third octave measurements should be undertaken using unweighted or Z-weighted measurements. Note: Narrow-band analysis using the reference method in <i>ISO1996-2:2007, Annex C</i> may be required by the consent/regulatory authority where it appears that a tone is not being adequately identified, e.g. where it appears that the tonal energy is at or close to the third octave band limits of contiguous bands.
Low frequency noise	Measurement of source contribution C-weighted and A-weighted level and one-third octave measurements in the range 10–160 Hz	Measure/assess source contribution C- and A-weighted Leq,T levels over same time period. Correction to be applied where the C minus A level is 15 dB or more and: <ul style="list-style-type: none"> • where any of the one-third octave noise levels in Table C2 are exceeded by up to and including 5 dB and cannot be mitigated, a 2 dB(A) positive adjustment to measured/predicted A-weighted levels applies for the evening/night period • where any of the one-third octave noise levels in Table C2 are exceeded by more than 5 dB and cannot be mitigated, a 5-dB(A) positive adjustment to measured/predicted A-weighted levels applies for the evening/night period and a 2dB(A) positive adjustment applies for the daytime period. 	2 or 5 dB ²	A difference of 15 dB or more between C- and A-weighted measurements identifies the potential for an unbalance spectrum and potential increased annoyance. The values in Table C2 are derived from Moorhouse (2011) for DEFRA fluctuating low-frequency noise criteria with corrections to reflect external assessment locations.



Table C.1 **Modifying factor corrections – continued**

Factor	Assessment/ Measurement	When to apply	Correction ¹	Comments
Intermittent noise	Subjectively assessed but should be assisted with measurement to gauge the extent of change in noise level.	The source noise heard at the receiver varies by more than 5 dB(A) and the intermittent nature of the noise is clearly audible.	5 dB	Adjustment to be applied for night-time only
Duration	Single-event noise duration may range from 1.5 min to 2.5 h.	One event in any assessment period.	0 to 20 dB(A)	The project noise trigger level may be increased by an adjustment depending on duration of noise (see Table C3).
Maximum Adjustment	Refer to individual modifying factors.	Where two or more modifying factors are indicated.	Maximum correction of 10 dB(A) ² (excluding duration correction).	

Notes:

1. Corrections to be added to the measured or predicted levels, except in the case of duration where the adjustment is to be made to the criterion.
2. Where a source emits tonal and low-frequency noise, only one 5-dB correction should be applied if the tone is in the low-frequency range, that is, at or below 160 Hz.
3. Where narrow-band analysis using the reference method is required, as outlined in column 5, the correction will be determined by the ISO1996-2:2007 standard.

