

**LEGEND**

ACCESSIBLE ACCESS IS NOT REQUIRED TO THESE AREAS

ACCESSIBLE WC/SHR AND AMBULANT CUBICLE. DETAIL OF WC/SHR/AMBULANT FACILITY TO SATISFY THE REQUIREMENTS CLAUSES 15 & 16 OF AS1428.1:2009

THE ACCESSIBLE WC IS TO ALTERNATE AT EACH LEVEL FROM RH TO LH WC PAN

DETAILS OF STAIRS TO SATISFY CLAUSES 11 & 12 OF AS1428.1:2009

THE MINIMUM CLEAR WIDTH OF DOORWAYS AND THE ACTIVE LEAF TO DOUBLE DOORS IS TO BE NOT LESS THAN 850mm CLEAR.

THE MAXIMUM FORCE TO OPERATE DOORS FITTED WITH DOOR CLOSERS OR FLOOR SPRINGS OTHER THAN FIRE DOORS IS TO BE NOT MORE THAN 20N FORCE.

BRAILLE TACTILE SIGNAGE IS TO BE PROVIDED AND INSTALLED IN ACCORDANCE WITH THE REQUIREMENTS OF NCC CLAUSE D3.6 AND NCC SPECIFICATION D3.6.

Visual indicators to glazing as per the requirements of Clause 6.6 of AS1428.1:2009

CIRCULATION AT DOORWAYS COMPLIANT WITH THE PROVISIONS OF NCC CLAUSE 13.3 OF AS1428.1:2009

1540x2070mm MINIMUM AREA TO UNDERTAKE A 180DEG TURN AT DEAD END CORRIDORS

The detailing of this stair will need to satisfy the requirements of Clauses 11 & 12 of AS1428.1:2009. The detailing of the handrails may necessitate the repositioning of the stair. A solid landing will be required to be provided at the base of the stairs. The minimum dimensions of the landing will need to be 1200mm x width of stairs.

The detailing of this stair will need to satisfy the requirements of Clauses 11 & 12 of AS1428.1:2009. The detailing of the handrails may necessitate the repositioning of the stair. A solid landing will be required to be provided at the base of the stairs. The minimum dimensions of the landing will need to be 1200mm x width of stairs.

Provide a level threshold to the external door.





**LEGEND**

- ACCESSIBLE ACCESS IS NOT REQUIRED TO THESE AREAS
- ACCESSIBLE WC/SHR AND AMBULANT CUBICLE. DETAIL OF WC/SHR/AMBULANT FACILITY TO SATISFY THE REQUIREMENTS CLAUSES 15 & 16 OF AS1428.1:2009
- THE ACCESSIBLE WC IS TO ALTERNATE AT EACH LEVEL FROM RH TO LH WC PAN
- DETAILS OF STAIRS TO SATISFY CLAUSES 11 & 12 OF AS1428.1:2009
- THE MINIMUM CLEAR WIDTH OF DOORWAYS AND THE ACTIVE LEAF TO DOUBLE DOORS IS TO BE NOT LESS THAN 850mm CLEAR.
- THE MAXIMUM FORCE TO OPERATE DOORS FITTED WITH DOOR CLOSERS OR FLOOR SPRINGS OTHER THAN FIRE DOORS IS TO BE NOT MORE THAN 20N FORCE.
- BRAILLE TACTILE SIGNAGE IS TO BE PROVIDED AND INSTALLED IN ACCORDANCE WITH THE REQUIREMENTS OF NCC CLAUSE D3.6 AND NCC SPECIFICATION D3.6
- Visual indicators to glazing as per the requirements of Clause 6.6 of AS1428.1:2009
- CIRCULATION AT DOORWAYS COMPLIANT WITH THE PROVISIONS OF NCC CLAUSE 13.3 OF AS1428.1:2009
- 1540x2070mm MINIMUM AREA TO UNDERTAKE A 180DEG TURN AT DEAD END CORRIDORS





- LEGEND
- ACCESSIBLE ACCESS IS NOT REQUIRED TO THESE AREAS

ACCESSIBLE WC/SHR AND AMBULANT CUBICLE. DETAIL OF WC/SHR/AMBULANT FACILITY TO SATISFY THE REQUIREMENTS CLAUSES 15 & 16 OF AS1428.1:2009

THE ACCESSIBLE WC IS TO ALTERNATE AT EACH LEVEL FROM RH TO LH WC PAN

DETAILS OF STAIRS TO SATISFY CLAUSES 11 & 12 OF AS1428.1:2009

THE MINIMUM CLEAR WIDTH OF DOORWAYS AND THE ACTIVE LEAF TO DOUBLE DOORS IS TO BE NOT LESS THAN 850mm CLEAR.


THE MAXIMUM FORCE TO OPERATE DOORS FITTED WITH DOOR CLOSERS OR FLOOR SPRINGS OTHER THAN FIRE DOORS IS TO BE NOT MORE THAN 20N FORCE.

BRAILLE TACTILE SIGNAGE IS TO BE PROVIDED AND INSTALLED IN ACCORDANCE WITH THE REQUIREMENTS OF NCC CLAUSE D3.6 AND NCC SPECIFICATION D3.6.

Visual indicators to glazing as per the requirements of Clause 6.6 of AS1428.1:2009

CIRCULATION AT DOORWAYS COMPLIANT WITH THE PROVISIONS OF NCC CLAUSE 13.3 OF AS1428.1:2009

1540x2070mm MINIMUM AREA TO UNDERTAKE A 180DEG TURN AT DEAD END CORRIDORS

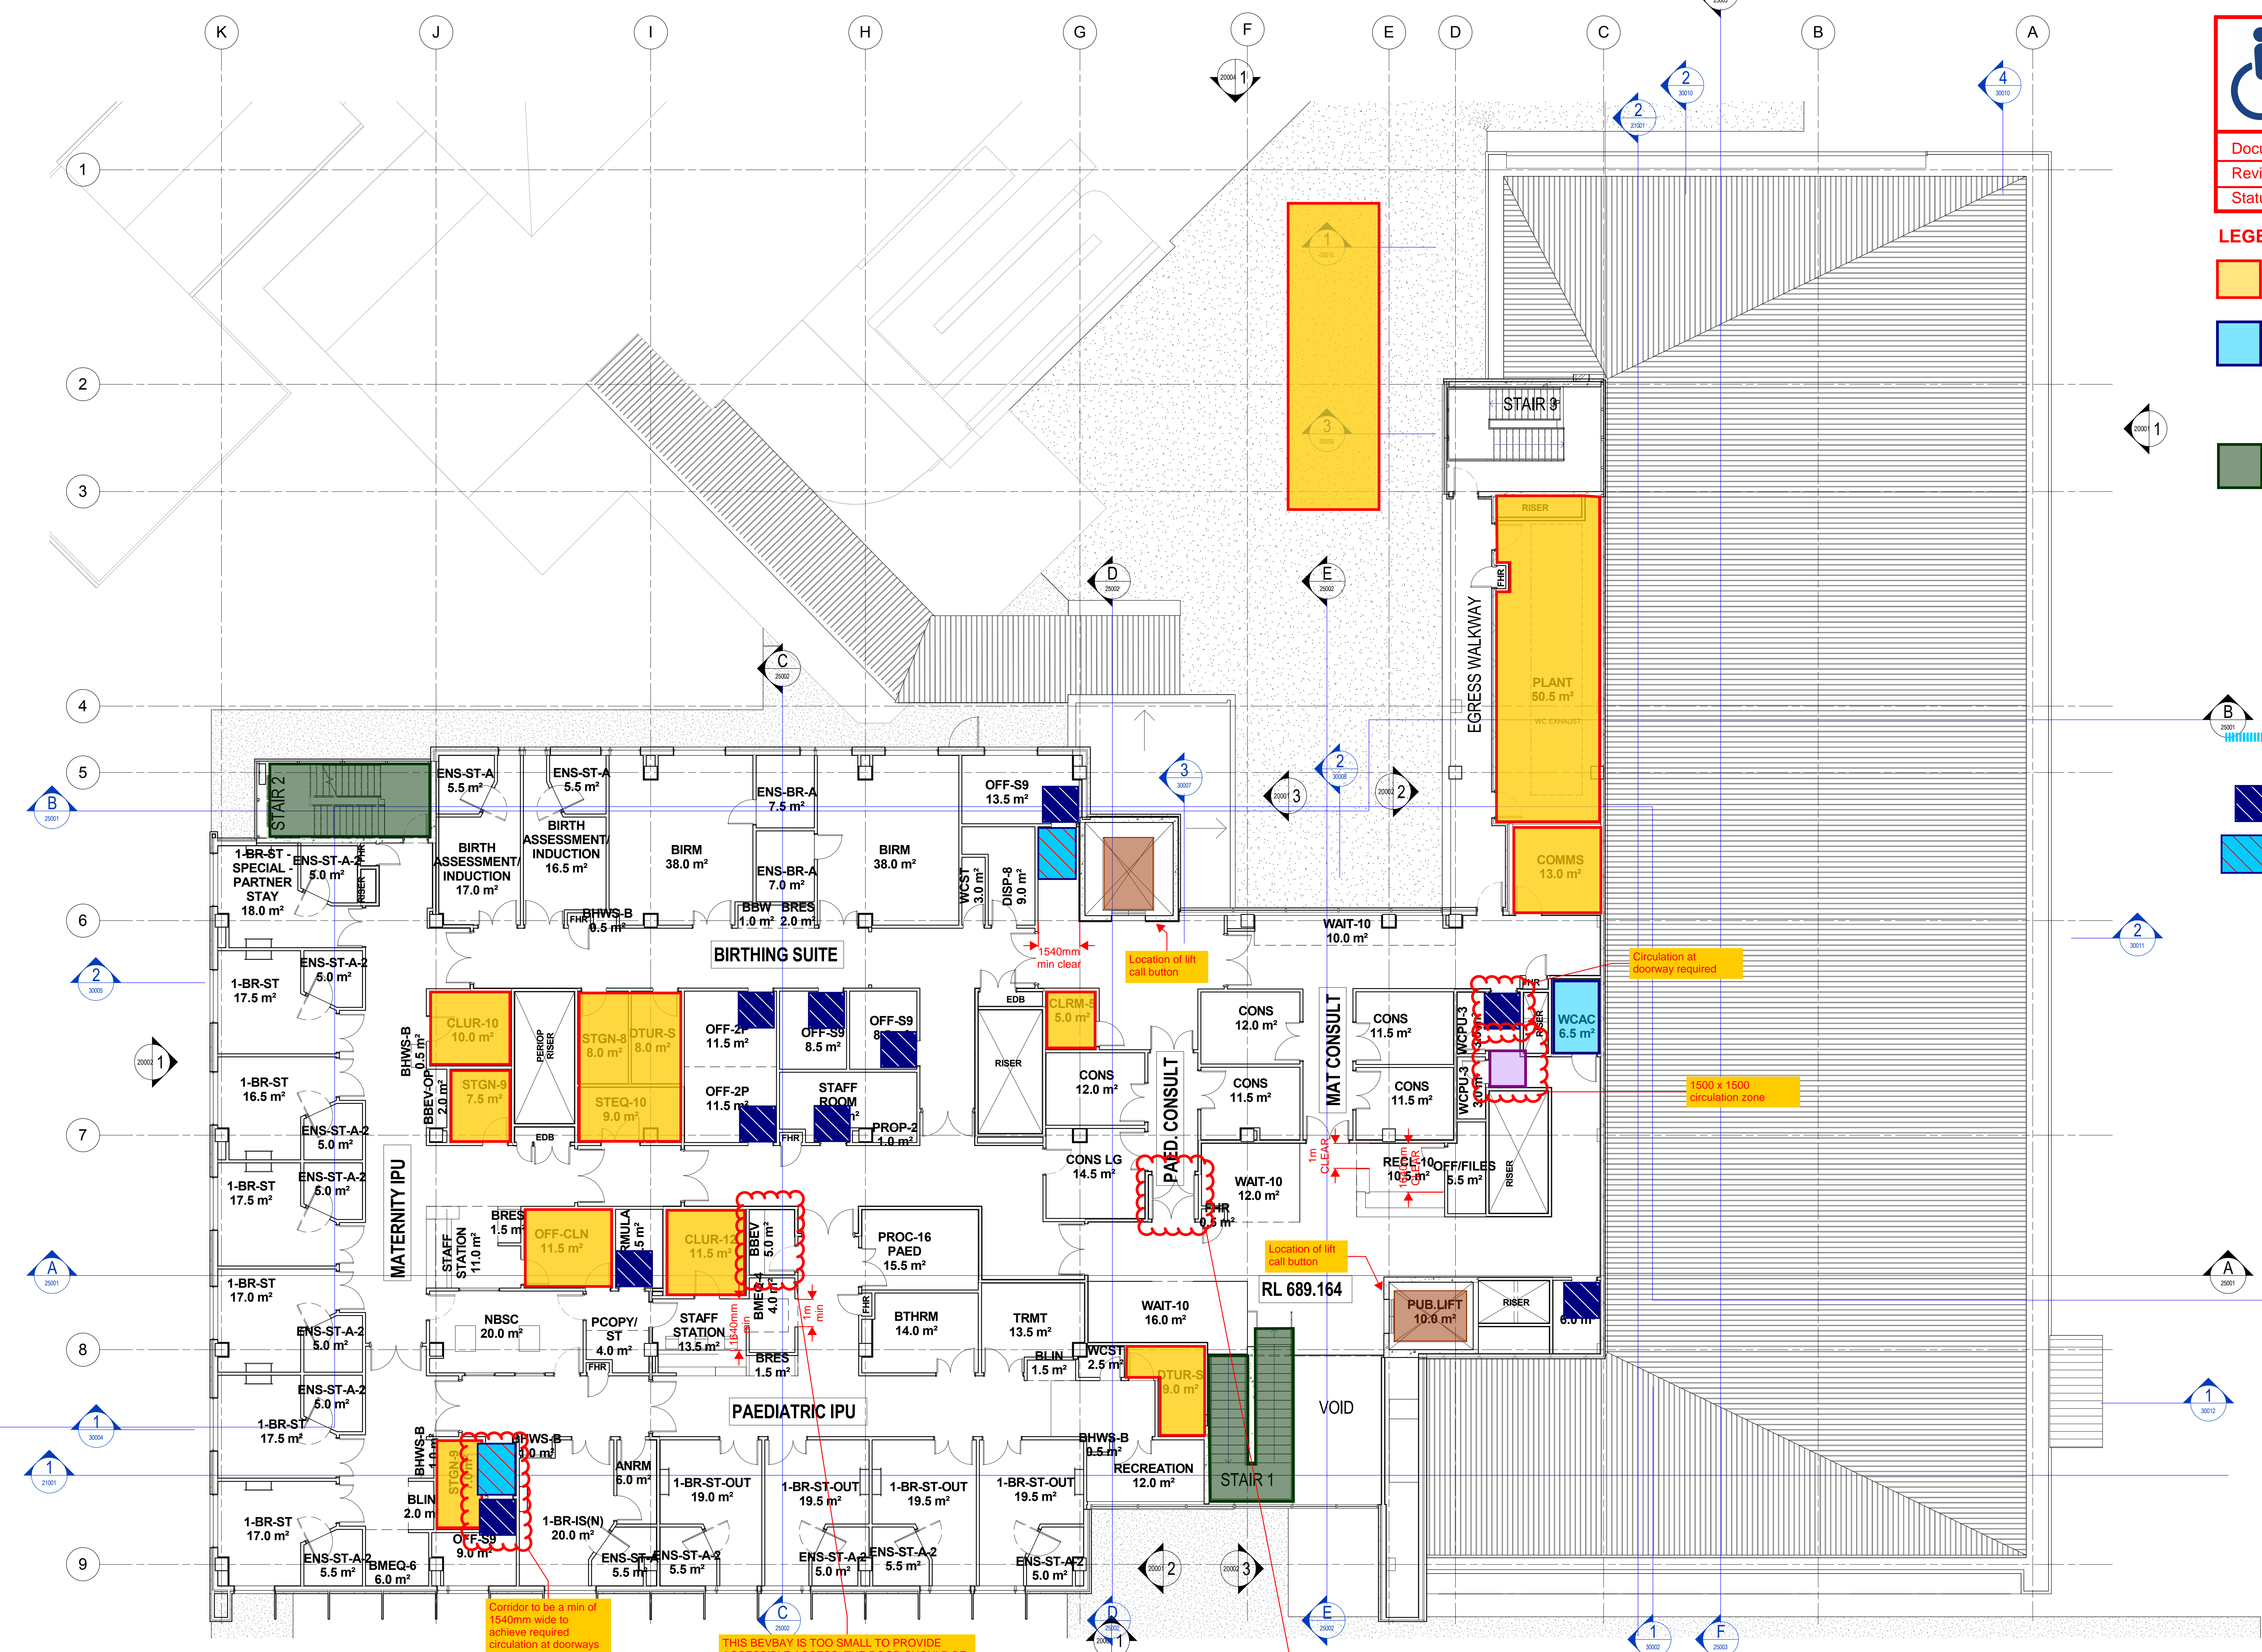




**LEGEND**

- ACCESSIBLE ACCESS IS NOT REQUIRED TO THESE AREAS
- ACCESSIBLE WC/SHR AND AMBULANT CUBICLE: DETAIL OF WC/SHR/AMBULANT FACILITY TO SATISFY THE REQUIREMENTS CLAUSES 15 & 16 OF AS1428.1:2009
- THE ACCESSIBLE WC IS TO ALTERNATE AT EACH LEVEL FROM RH TO LH WC PAN
- DETAILS OF STAIRS TO SATISFY CLAUSES 11 & 12 OF AS1428.1:2009
- THE MINIMUM CLEAR WIDTH OF DOORWAYS AND THE ACTIVE LEAF TO DOUBLE DOORS IS TO BE NOT LESS THAN 850mm CLEAR.
- THE MAXIMUM FORCE TO OPERATE DOORS FITTED WITH DOOR CLOSERS OR FLOOR SPRINGS OTHER THAN FIRE DOORS IS TO BE NOT MORE THAN 20N FORCE.
- BRAILLE TACTILE SIGNAGE IS TO BE PROVIDED AND INSTALLED IN ACCORDANCE WITH THE REQUIREMENTS OF NCC CLAUSE D3.6 AND NCC SPECIFICATION D3.6.
- Visual indicators to glazing as per the requirements of Clause 6.6 of AS1428.1:2009
- CIRCULATION AT DOORWAYS COMPLIANT WITH THE PROVISIONS OF NCC CLAUSE 13.3 OF AS1428.1:2009
- 1540x2070mm MINIMUM AREA TO UNDERTAKE A 180DEG TURN AT DEAD END CORRIDORS





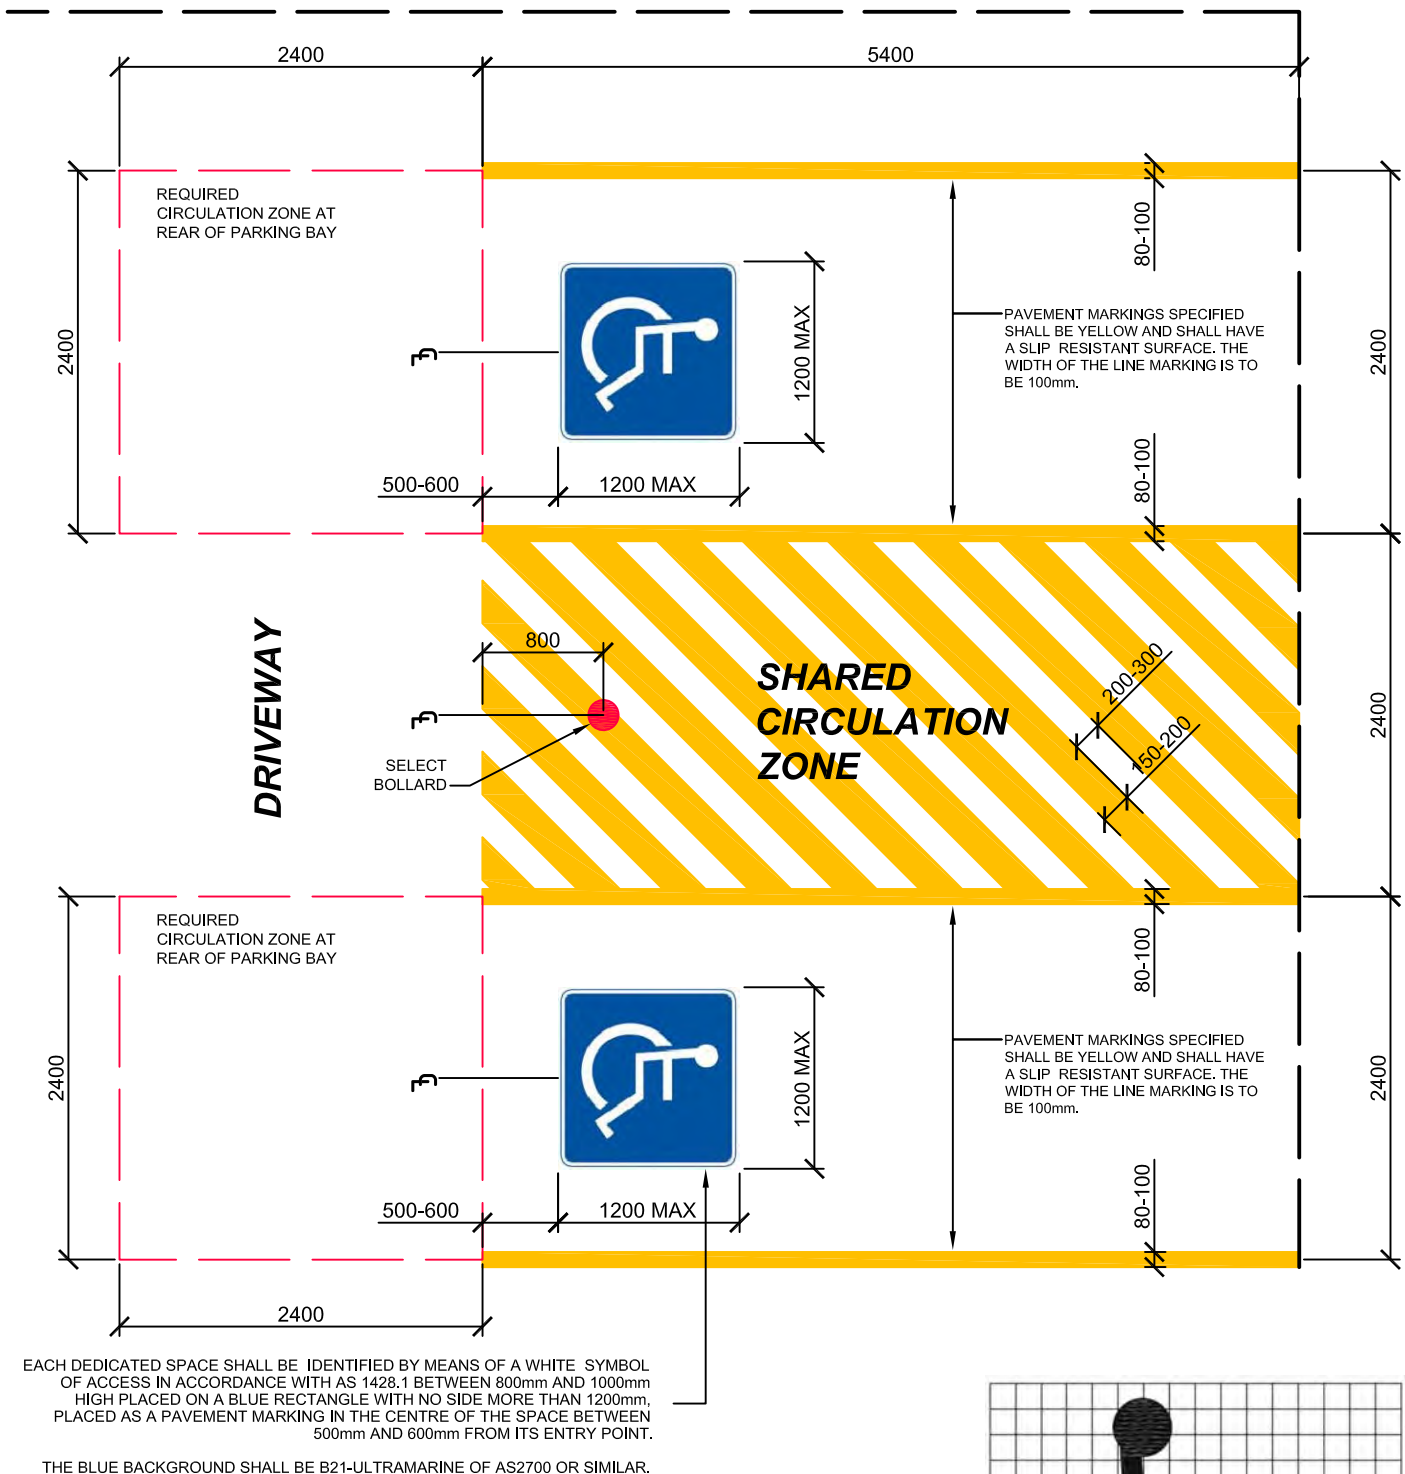


## 1 ACCESSIBLE PARKING SPACES

PLAN VIEW Scale: 1:50@A4



ACCESSIBLE PARKING SIGN TO BE POLE FIXED OR MOUNTED ON WALL. BOTTOM OF SIGN TO BE MOUNTED 1200mm AFFL. THE BLUE BACKGROUND SHALL BE B21-ULTRAMARINE OF AS2700 OR SIMILAR.

SIGNS MAY BE EQUAL TO RMS STANDARD SIGNAGE.

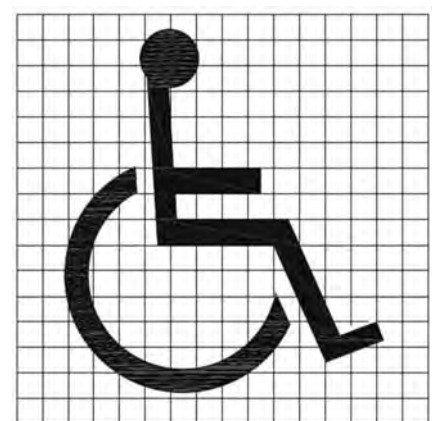

NOTE: The grid is for positional purposes only.

THE ABOVE DETAIL INDICATES THE PROPORTIONAL SETOUT OF THE INTERNATIONAL SYMBOL OF ACCESS AS DESIGNATED IN AS1428.1


## 2 ACCESSIBLE PARKING SIGN

Scale: NTS

## 3 ACCESSIBLE SYMBOL SETOUT

Scale: NTS

	<p>iAccess Consultants 2/20 BALFOUR ROAD ROSE BAY, NSW 2020 (P) 0408 627 908 (E) r.seidman@iaccessconsultants.com (W) www.iaccessconsultants.com</p>		<p>TITLE: <b>ACCESSIBLE PARKING - PERPENDICULAR LINE MARKING SETOUT</b></p> <p>DWG. No. ###</p>	<p>TECHNICAL SHEET</p> <p>DATE: OCT 2014 SCALE: AS SHOWN STAGE: - DRAWN: RAS TYPE: - REVIEWED: [-]</p>	<p><b>A20</b></p>
--	--	--	---	--	-------------------

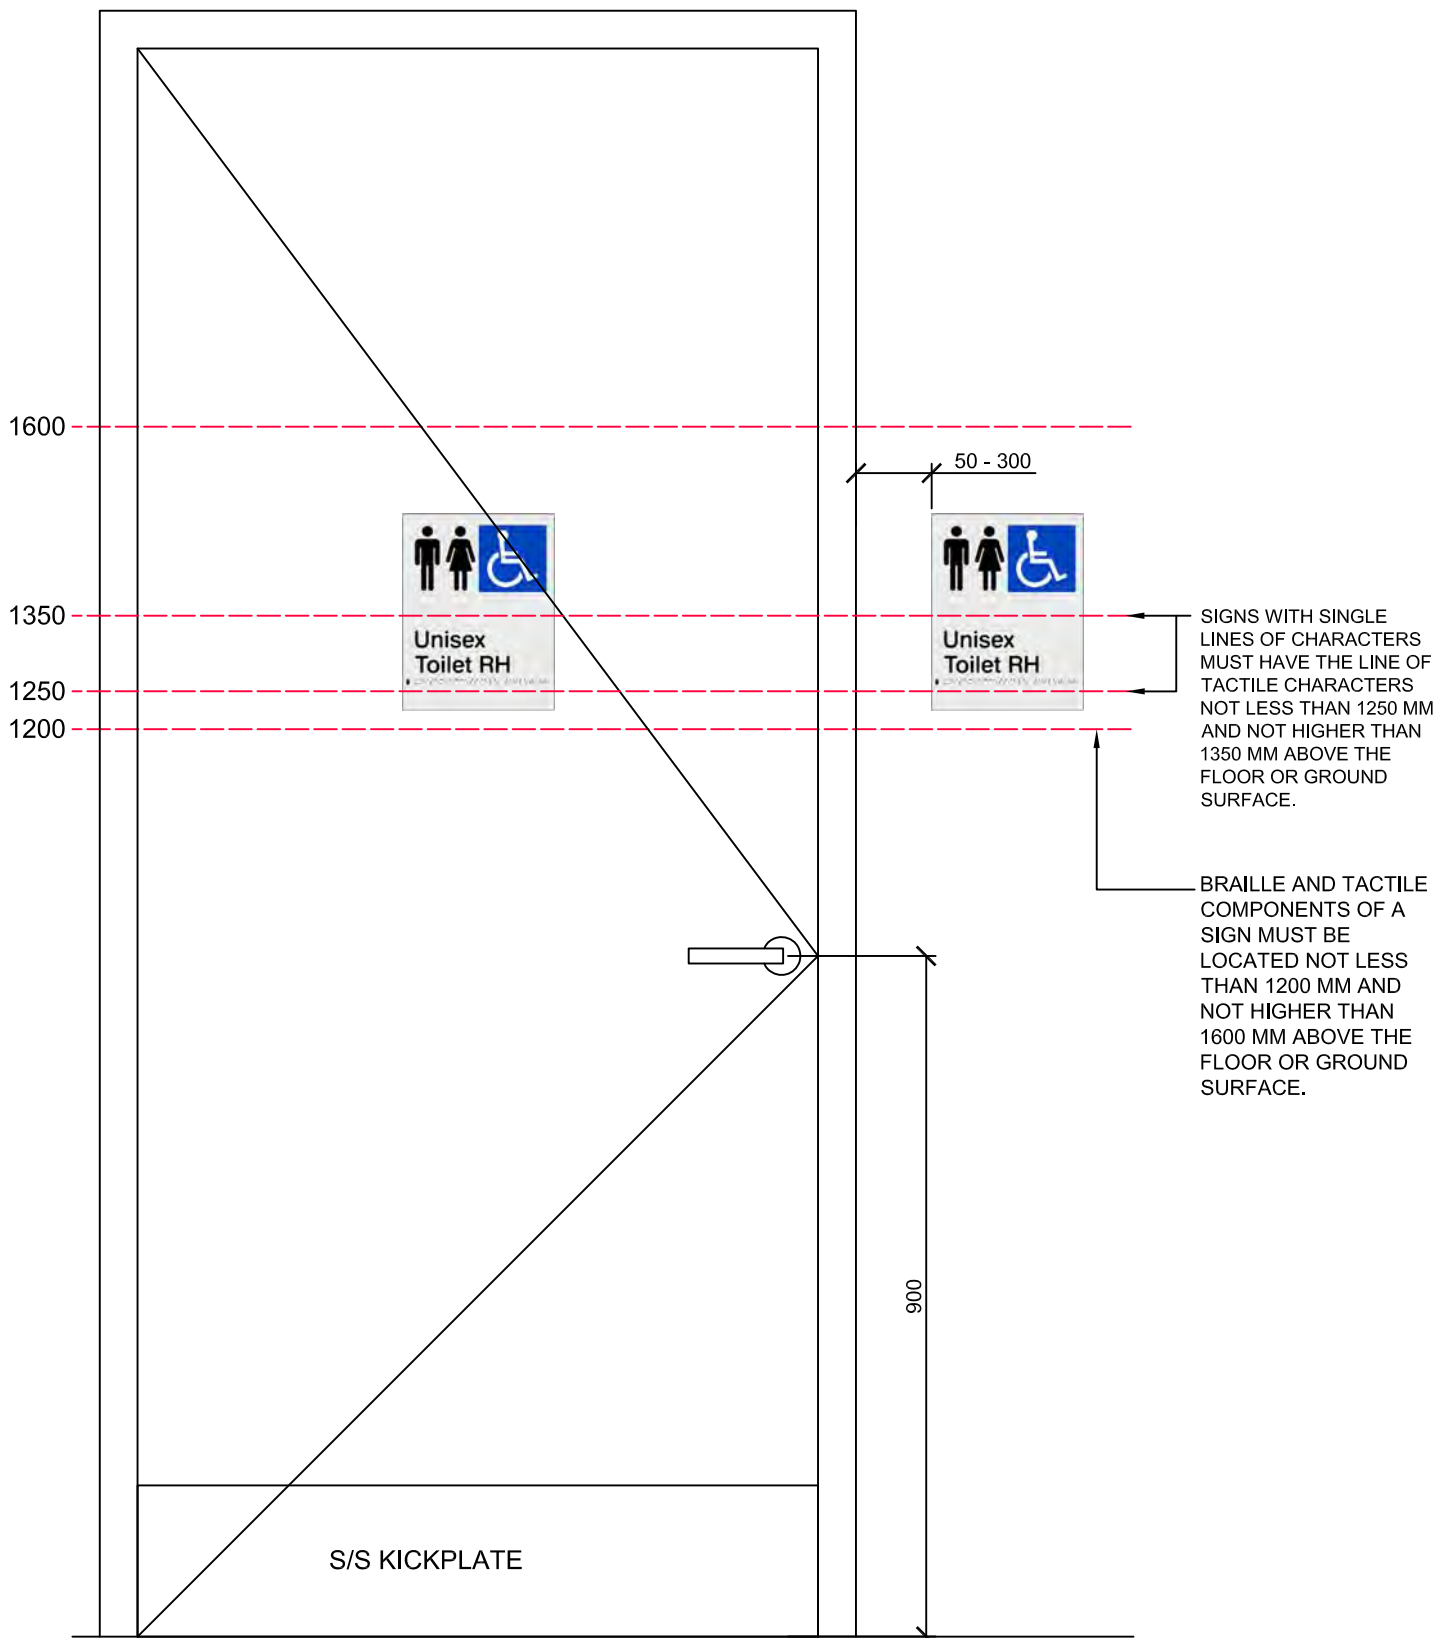

# 1 ACCESSIBLE DOOR SIGN

Scale: 1:10@A4

THE LOCATION OF THE SIGN IS PREFERRED TO BE LOCATED ON THE LATCH SIDE OF THE DOOR. WHERE THIS IS **NOT POSSIBLE** THE SIGN MAY BE LOCATED ON THE DOOR.