



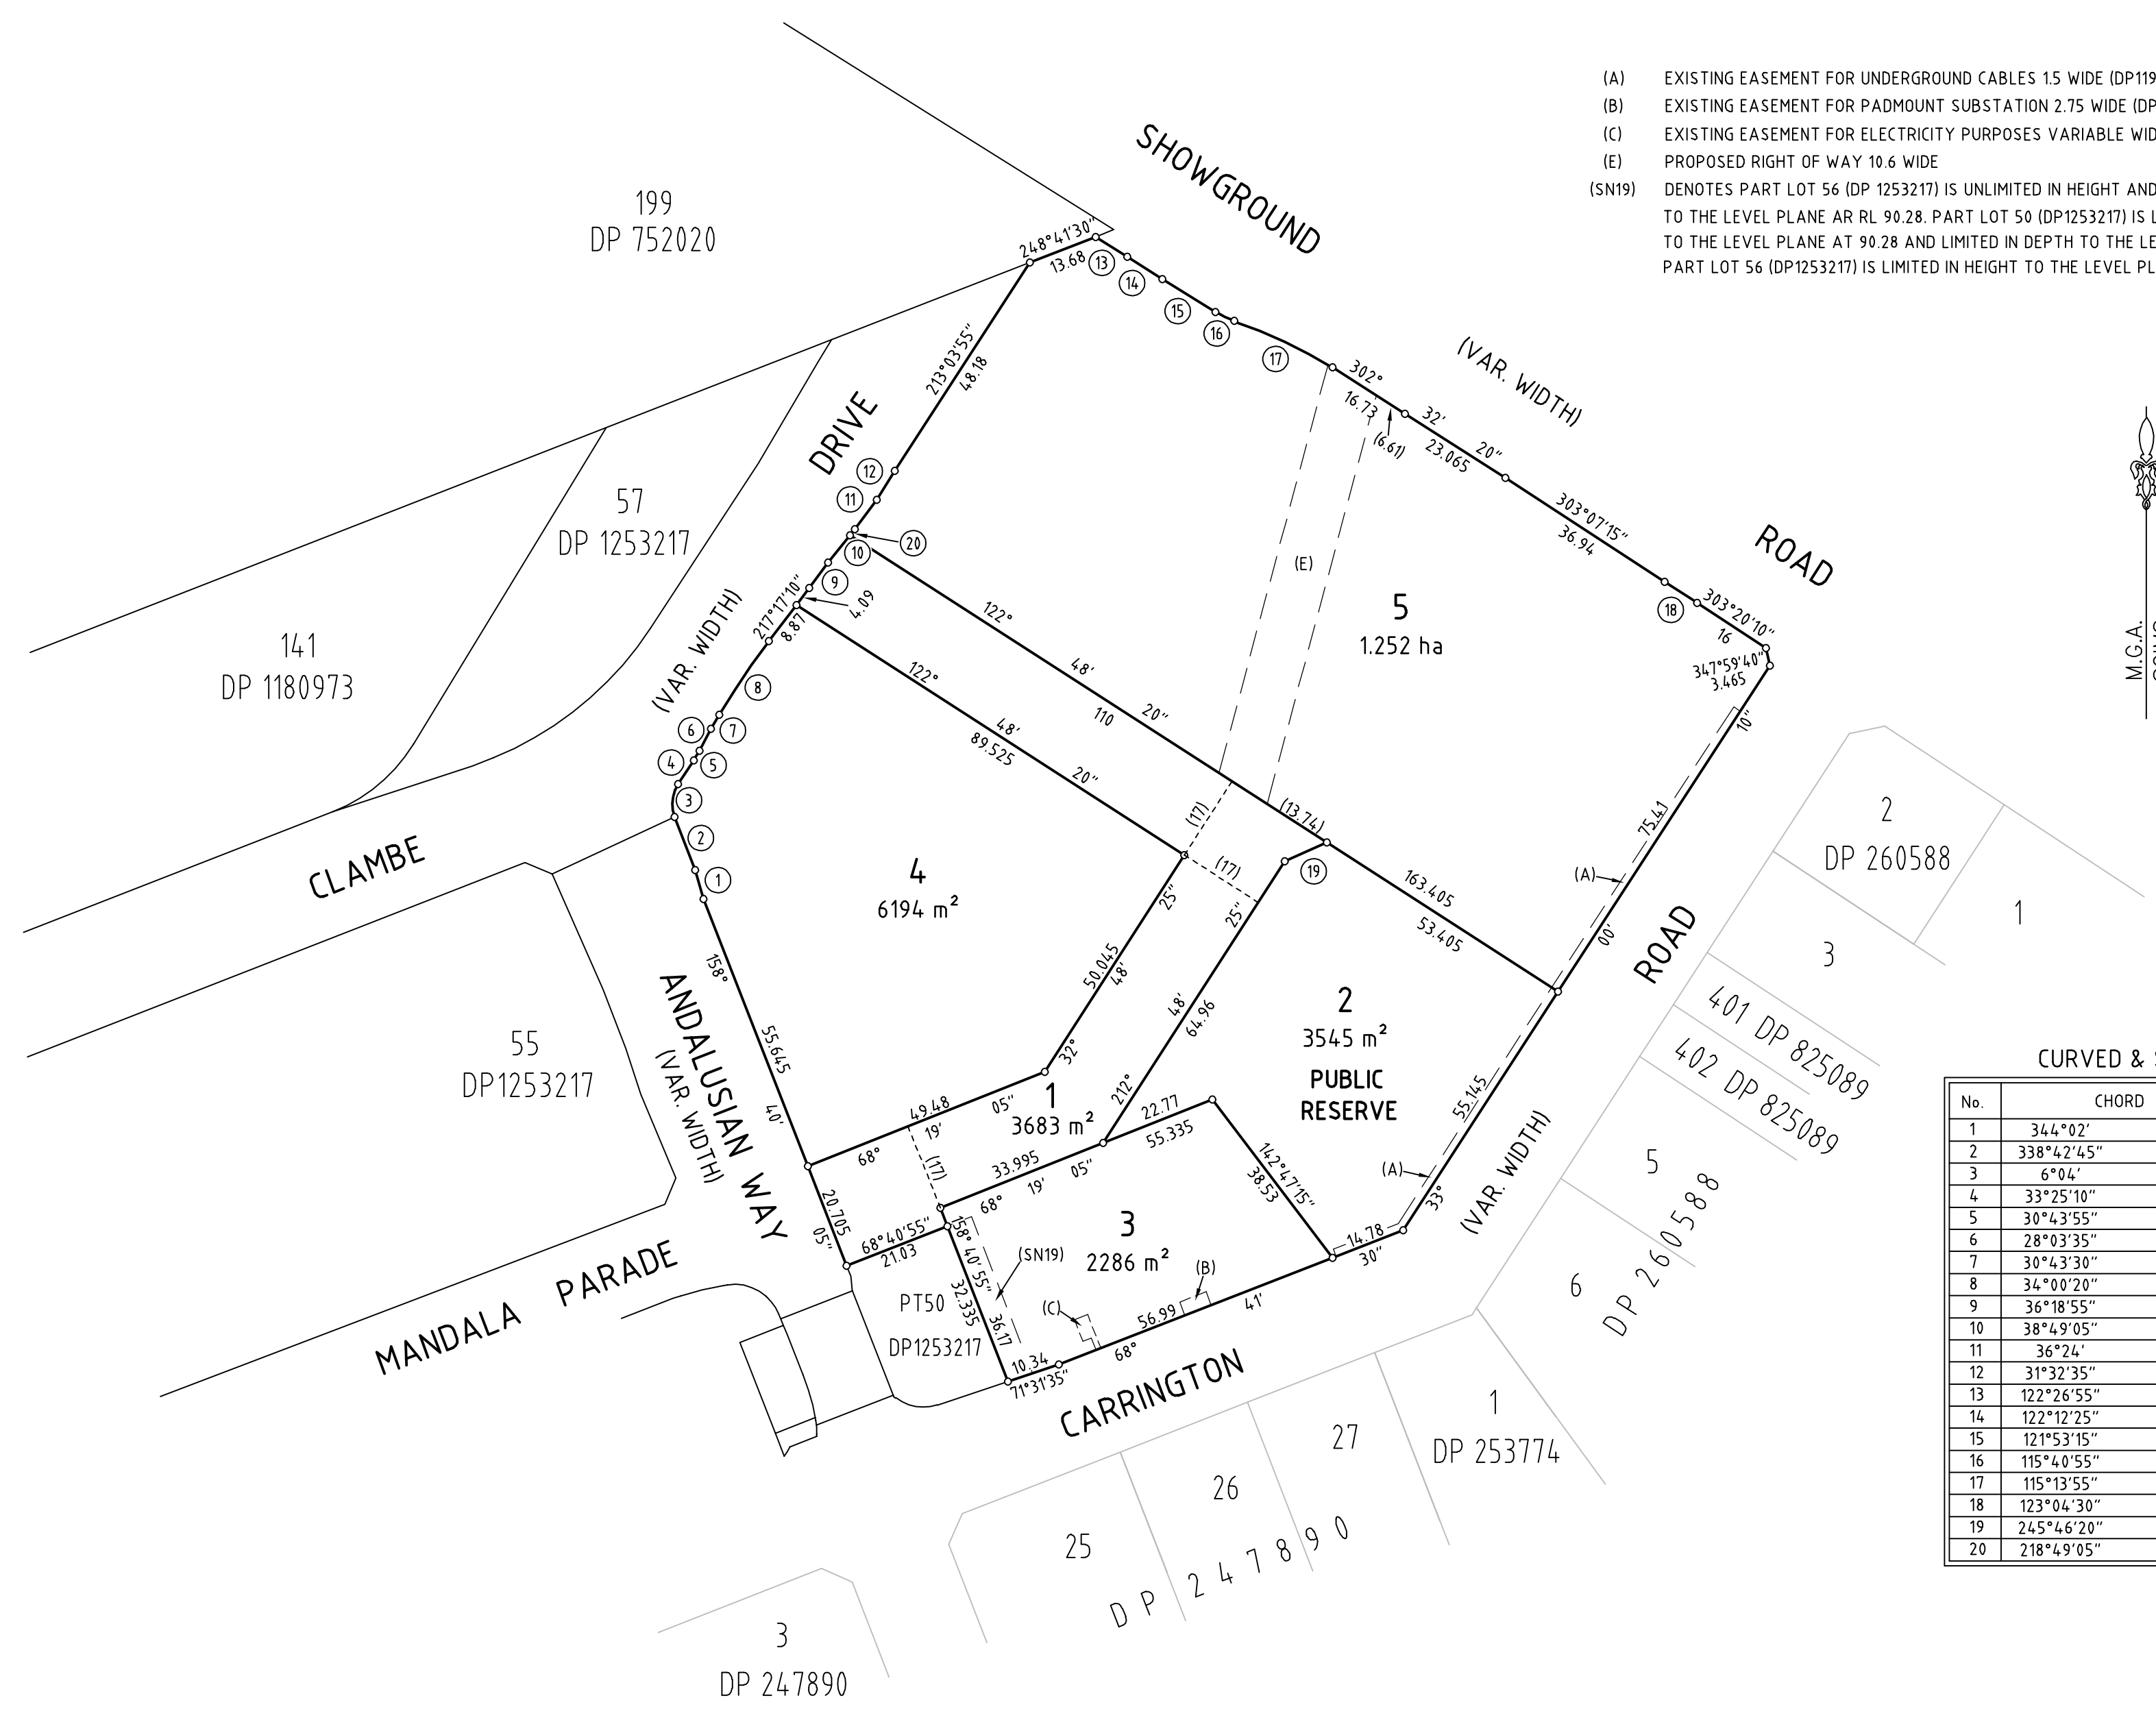

- (A) EXISTING EASEMENT FOR UNDERGROUND CABLES 1.5 WIDE (DP1194607)
- (B) EXISTING EASEMENT FOR PADMOUNT SUBSTATION 2.75 WIDE (DP1194607)
- (C) EXISTING EASEMENT FOR ELECTRICITY PURPOSES VARIABLE WIDTH VIDE DP633665
- (E) PROPOSED RIGHT OF WAY 10.6 WIDE
- (SN19) DENOTES PART LOT 56 (DP 1253217) IS UNLIMITED IN HEIGHT AND LIMITED IN DEPTH TO THE LEVEL PLANE AR RL 90.28. PART LOT 50 (DP1253217) IS LIMITED IN HEIGHT TO THE LEVEL PLANE AT 90.28 AND LIMITED IN DEPTH TO THE LEVEL PLANE AT 63.63. PART LOT 56 (DP1253217) IS LIMITED IN HEIGHT TO THE LEVEL PLANE AT 63.63 AND UNLIMITED IN DEPTH.



CURVED & SHORT BOUNDARIES

No.	CHORD	ARC	RADIUS
1	344°02'	5.825	-
2	338°42'45"	11.025	-
3	6°04'	6.435	7
4	33°25'10"	5.505	-
5	30°43'55"	2.195	23.5
6	28°03'35"	4.8	-
7	30°43'30"	3.185	-
8	34°00'20"	17.165	150
9	36°18'55"	6.14	-
10	38°49'05"	8.265	-
11	36°24'	7.18	-
12	31°32'35"	6.585	-
13	122°26'55"	7.255	-
14	122°12'25"	8.06	-
15	121°53'15"	12.09	-
16	115°40'55"	4.05	14.945
17	115°13'55"	21.05	95.82
18	123°04'30"	7.55	-
19	245°46'20"	8.975	-
20	218°49'05"	1.43	-

Surveyor: TERRY EDWARD BARTLETT Date of Survey: 5th October 2019 Surveyor's Ref: 80220010 DP-01	PLAN OF SUBDIVISION OF PT LOTS 50 & 56 IN DP 1253217	L.G.A.: THE HILLS SHIRE Locality: CASTLE HILL Subdivision No: Lengths are in metres. Reduction Ratio 1:1000	Registered	DRAFT
--	---	--	------------	--------------